

**2023 ANNUAL GROUNDWATER MONITORING
AND CORRECTIVE ACTION REPORT
CLOSED GYPSUM POND
CROSS GENERATING STATION**

**by Santee Cooper
Moncks Corner, South Carolina**

January 31, 2024

Table of Contents	Page
1. Annual Groundwater Monitoring Report Summary	3
2. 40 CFR §257.90 Applicability	4
2.1 40 CFR § 257.90(a) and (c)	4
2.2 40 CFR § 257.90(e) – Summary	4
2.2.1 Status of the Groundwater Monitoring Program	4
2.2.2 Key Actions Completed	5
2.2.3 Problems Encountered	6
2.2.4 Actions to Resolve Problems	6
2.2.5 Project Key Activities for Upcoming Year	7
2.3 40 CFR § 257.90(e) – Information	7
2.3.1 40 CFR § 257.90(e)(1)	8
2.3.2 40 CFR § 257.90(e)(2)	8
2.3.3 40 CFR § 257.90(e)(3)	8
2.3.4 40 CFR § 257.90(e)(4)	8
2.3.5 40 CFR § 257.90(e)(5)	9

Table No.	Title
1	Summary of Analytical Results
2	2023 Synoptic Water Levels for Groundwater Monitoring Wells

Figure No.	Title
1	Location of Closed Gypsum Pond Groundwater Monitoring Wells for CCR Compliance
2	Potentiometric Map January 2023
3	Potentiometric Map April 2023
4	Potentiometric Map June 2023
5	Potentiometric Map November 2023

Appendix A – Statistical Analyses

Appendix B – Laboratory Analytical Results

Appendix C – Well Construction Records

Appendix D – Assessment of Corrective Measures 60-day Extension

1. Annual Groundwater Monitoring Report Summary

The South Carolina Public Service Authority (Santee Cooper) has prepared this 2023 Annual Groundwater Monitoring and Corrective Action Report for the Closed Gypsum Pond at the Cross Generating Station (CGS). This 2023 Annual Report was prepared to comply with the United States Environmental Protection Agency (EPA) Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals (CCR) from Electric Utilities, Title 40 Code of Federal Regulations (CFR) Part 257, Subpart D dated April 17, 2015 (Rule), specifically subsection § 257.90(e)(1) through (6).

The Closed Gypsum Pond was closed under state regulations; however, it was an active CCR impoundment for a brief period time after the effective date of the CCR Rule. Therefore, it is regulated under the CCR Rule. As background, Santee Cooper filed a Notice of Intent with the South Carolina Department of Health and Environmental Control (SCDHEC) on March 10, 2016, to initiate closure of the Gypsum Pond, a permitted industrial wastewater pond. The SCDHEC-approved closure plan met the requirements of § 257.102(b) and as of October 17, 2016, Santee Cooper had removed all CCR material from the Gypsum Pond. On March 22, 2017, SCDHEC formally certified state closure requirements had been met.

In accordance with § 257.90(e)(6), an overview of the status of groundwater monitoring and corrective action programs for the CCR unit is provided below:

At the start and end of the current annual reporting period (January 1, 2023 – December 31, 2023), Santee Cooper was operating under an assessment monitoring program in accordance with § 257.95.

The statistical analysis of the January 2022 detection monitoring event data identified statistically significant increases (SSIs) of boron, calcium, chloride, sulfate, and total dissolved solids in monitoring wells CGYP-1, CGYP-2, CGYP-3, CGYP-4, and CGYP-6; fluoride in monitoring wells CGYP-1, CGYP-3, CGYP-4, and CGYP-6; and pH in monitoring wells CGYP-2, CGYP-3, CGYP-4, and CGYP-6. Therefore, an assessment monitoring program for the Closed Gypsum Pond was initiated and a notification was posted to the public CCR website on September 29, 2022.

The second assessment monitoring event was conducted in October 2022, within 90 days of the first assessment monitoring event, to resample all Appendix III and Appendix IV constituents. The analytical results were received and validated in December 2022 and the corresponding statistical analysis for the two assessment monitoring event results identified statistically significant levels (SSLs) of beryllium in monitoring wells CGYP-1, CGYP-3, CGYP-4, and CGYP-6; cobalt in monitoring wells CGYP-1, CGYP-2, CGYP-3, CGYP-4, and CGYP-6; lead in monitoring wells CGYP-2 and CGYP-3; and lithium in monitoring wells CGYP-3, CGYP-4, and CGYP-6. Assessment monitoring results for the 2023 semiannual sampling events resulted in the same SSLs as identified above for the October 2022 event. Therefore, an assessment of corrective measures was initiated on June 7, 2023.

An assessment of corrective measures report was prepared on October 30, 2023. To fulfill the requirement outlined in Title 40 CFR § 257.96(e) of the CCR Rule, a public meeting is planned for 2024 to discuss the assessment of potential groundwater corrective measures for the Closed Gypsum Pond. Therefore, remedy selection and remedial activities are required and will follow the public meeting.

To report on the activities conducted during the 2023 reporting period and document progress complying with the CCR Rule, the specific requirements listed in § 257.90(e)(1) through (5) are provided in the next section in bold/italic type followed by a short narrative stating how that specific requirement was met.

2. 40 CFR § 257.90 Applicability

2.1 40 CFR § 257.90(a) and (c)

All CCR landfills, CCR surface impoundments, and lateral expansions of CCR units are subject to the groundwater monitoring and corrective action requirements under § 257.90 through § 257.98.

Once a groundwater monitoring system and groundwater monitoring program has been established at the CCR unit as required by this subpart, the owner or operator must conduct groundwater monitoring and, if necessary, corrective action throughout the active life and post-closure care period of the CCR unit.

The Closed Gypsum Pond at CGS is subject to the groundwater monitoring and corrective action requirements set forth by the EPA in 40 CFR § 257.90 through § 257.98. This document satisfies the requirement under § 257.90(e) which requires the CCR landfill Owner/Operator to prepare an Annual Groundwater Monitoring and Corrective Action Report.

2.2 40 CFR § 257.90(e) – SUMMARY

Annual groundwater monitoring and corrective action report. For existing CCR landfills and existing CCR surface impoundments, no later than January 31, 2018, and annually thereafter, the owner or operator must prepare an annual groundwater monitoring and corrective action report. For new CCR landfills, new CCR surface impoundments, and all lateral expansions of CCR units, the owner or operator must prepare the initial annual groundwater monitoring and corrective action report no later than January 31 of the year following the calendar year a groundwater monitoring system has been established for such CCR unit as required by this subpart, and annually thereafter. For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year. For purposes of this section, the owner or operator has prepared the annual report when the report is placed in the facility's operating record as required by § 257.105(h)(1).

This Annual Groundwater Monitoring and Corrective Action Report documents the activities completed in 2023 for the Closed Gypsum Pond as required by the CCR Rule Groundwater Monitoring and Corrective Action regulations. Groundwater sampling and analysis was conducted per the requirements of § 257.93, and the status of the groundwater monitoring program, as set forth in § 257.94 and § 257.95, is provided in this report.

2.2.1 Status of the Groundwater Monitoring Program

The initial detection monitoring event was conducted in January 2022. Statistical analysis of the January 2022 detection monitoring event data determined SSIs of all Appendix III constituent concentrations in at least four of the five downgradient monitoring wells. Therefore, an assessment monitoring program for the Closed Gypsum Pond was initiated on September 29, 2022.

Because of significant lab delays, Santee Cooper conservatively performed the first assessment monitoring event in June 2022, to stay on the normal semi-annual sampling schedule, sampling for all Appendix III and Appendix IV constituents. The second assessment monitoring event was conducted in October 2022, within 90 days of the first assessment monitoring event, resampling all Appendix III and Appendix IV constituents. The analytical results were received and validated in December 2022, and the corresponding statistical analysis of both assessment monitoring event results in March 2023 found statistically significant levels (SSLs) of beryllium in monitoring wells CGYP-1, CGYP-3, CGYP-4, and CGYP-6; cobalt in monitoring wells CGYP-1, CGYP-2, CGYP-3, CGYP-4, and CGYP-6; lead in monitoring wells CGYP-2 and CGYP-3; and lithium in monitoring wells CGYP-3, CGYP-4, and CGYP-6. Therefore, an assessment of corrective measures was initiated on June 7, 2023. An assessment of corrective measures report was completed on October 30, 2023. To fulfill the requirement outlined in § 257.96, a public meeting is planned for 2024 to discuss the assessment of potential groundwater corrective measures for the Closed Gypsum Pond. Remedy selection and remedial activities are required and will follow the public meeting.

This CCR unit will continue groundwater monitoring in accordance with the assessment monitoring program until a final remedy is selected and the corrective action groundwater monitoring program is initiated.

2.2.2 Key Actions Completed

The following key actions were completed in 2023:

- Prepared 2022 Annual Report including:
 - The Annual Report was placed in the facility's operating record pursuant to § 257.105(h)(1);
 - Pursuant to § 257.106(h)(1), the notification was sent to the relevant State Director within 30 days of the Annual Report being placed in the facility's operating record [§ 257.106(d)];
 - Pursuant to § 257.107(h)(1), the Annual Report was posted to the CCR Website within 30 days of the Annual Report being placed in the facility's operating record [§ 257.107(d)];
- Collected and analyzed two rounds (January and June) of groundwater monitoring data (Table 1 & Appendix B) in accordance with § 257.95(b) and § 257.95(d)(1). The concentrations were recorded in the facility's operating record as required by § 257.95(d)(1). Groundwater monitoring results from the January and June 2023 monitoring events are summarized in Table 1 and laboratory analytical results are provided in Appendix B.
- Completed statistical evaluations to determine if SSLs greater than GWPS were present for Appendix IV constituents in accordance with § 257.93(h)(2) (Appendix A).
- Continued collecting independent samples to establish a baseline prior to including in the statistical evaluations for recently installed monitoring well CGYP-7. CGYP-7 will be added to the compliance groundwater monitoring network after eight rounds of baseline sampling is complete.
- Four nature and extent wells (CCMGP-1, CCMGP-2, CCMGP-3, and CCMGP-4) and one property boundary well (CCMGP-5) were installed as part of the nature and extent characterization in accordance with § 257.95(g)(1). Well installation records are provided in Appendix C. Analytical results for nature and extent wells sampled in June, August, and November are presented in Table 1.
- Initiated the assessment of corrective measures process in accordance with §257.96(c) on June 7, 2023.

- Pursuant to §257.96(a), demonstrated an additional 60 days was required to complete the assessment of corrective measures. This certification is provided in Appendix D.
- The *CCR Assessment of Corrective Measures Report* was completed in October 2023 and documents the fulfillment of the requirements of § 257.96(c).
- Continue improving the potentiometric surface characterization of the uppermost aquifer given changing site conditions by:
 - Collecting site-wide synoptic rounds of water levels within a 48-hour period prior to initiating semi-annual sampling of the groundwater monitoring wells. Groundwater elevation measurements continued to be collected in each well immediately prior to collecting the sample.
 - The water surface elevations of unlined ponds were surveyed at approximately the same time as the semi-annual monitoring events. Unlined ponds are sources of hydraulic head and groundwater recharge; therefore, it is appropriate to include pond surface water elevations in the potentiometric interpretation of the uppermost aquifer.
- Evaluated turbidity, oxidation-reduction potential, and well screen submersion trends in sitewide wells and identified wells to be redeveloped by a certified well driller to remove buildup of sediment fines and suspected biofouling on the well screens. A submersible camera was used to investigate wells with unsubmerged screens prior to redevelopment. Camera investigation and well redevelopment were completed in November 2023. Success of redevelopment will be monitored during 2024 sampling events.
- Updated the CGS Sampling and Analysis Plan in August 2023 to make general revisions and improvements to reflect newly installed monitoring wells and locations and hydrogeologic changes due to site construction and impoundment closures.

2.2.3 Problems Encountered

Upon receipt and review of the analytical results for the March 2023 sampling event, the non-detect reporting limits for monitoring well CGYP-7 (Sample ID #AF58977 and duplicate Sample ID#AF58978) were greater than the GWPS for lithium.

There was a 6-week delay in mobilizing a South Carolina-certified well driller to install monitoring wells in accordance with § 257.95(g)(1). Additionally, approximately 60 of the 90-day timeframe allowed by the CCR Rule to complete the assessment of corrective measures evaluation and report was spent waiting on analytical results of the nature and extent wells.

2.2.4 Actions to Resolve Problems

Because this monitoring well is in baseline sampling phase and analytical results from previous sampling events were less than the GWPS, it was concluded that the non-detect values for lithium do not represent a GWPS exceedance. The elevated non-detect reporting limits for two lithium results will be incorporated in the statistical evaluation once eight independent samples are analyzed. At that time, the results will be evaluated and determined whether to be included or removed from the data set.

A demonstration was prepared and certified to provide an additional 60 days to complete the assessment of corrective measures report. This certification is provided in Appendix D.

2.2.5 Project Key Activities for Upcoming Year

Key activities to be completed in 2024 will include the following:

- Prepare the 2023 annual report; place it in the record as required by § 257.105(h)(1), notify the Relevant State Director [§ 257.106(d)]; and post to the facility's publicly available CCR website [§ 257.107(d)].
- Conduct semi-annual groundwater monitoring consistent with § 257.95(d)(1) and in accordance with the CGS GMP. Ongoing sampling and analysis will provide a more robust data set to aid in evaluation of potential remedial approaches identified in the Assessment of Corrective Measures report.
- Continue to collect baseline samples on a bimonthly basis for CGYP-7 to establish a statistically representative dataset. CGYP-7 will be added to the CCR Rule compliance groundwater monitoring network after collecting eight samples.
- Monitoring well CGYP-6 will be abandoned to accommodate the wastewater treatment system expansion. A replacement well is planned to be installed once the expansion is complete.
- Conduct statistical analysis of assessment monitoring analytical data to determine if SSLs of the detected Appendix IV constituents are greater than the established GWPS.
- Continue nature and extent investigation activities as required under § 257.95(g) and § 257.97 that include:
 - Statistical analysis of groundwater monitoring data collected from nature extent wells to determine if Appendix IV constituent concentrations are greater than GWPS.
 - Additional hydrogeologic investigation to determine site conditions that might affect the remedy selected.
- Continue to improve the potentiometric surface characterization of the uppermost aquifer given changing site conditions by:
 - Continuing the sitewide synoptic water level measurements on a quarterly basis and in conjunction with the semi-annual groundwater monitoring events.
 - Continue collecting surface water elevations from unlined ponds, also on the same quarterly basis as the sitewide synoptic water level measurements.
- Semi-annual progress reports on the remedy selection and design process will be prepared and placed in the operating record and on the public website in accordance with § 257.97 beginning approximately 6 months after the Assessment of Corrective Measures report was placed in the operating record.
- Conduct a public meeting in accordance with § 257.96(e) to discuss the results of the corrective measures assessment with interested and affected parties.

2.3 40 CFR § 257.90(e) – Information

At a minimum, the annual groundwater monitoring and corrective action report must contain the following information, to the extent available:

2.3.1 40 CFR § 257.90(e)(1)

A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit;

As required by § 257.90(e)(1), a map showing the location of the Closed Gypsum Pond and associated upgradient and downgradient wells is presented as Figure 1.

2.3.2 40 CFR § 257.90(e)(2)

Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken;

Four nature and extent wells to monitor lateral and vertical extent (CCMGP-1, CCMGP-2, CCMGP-3, and CCMGP-4) and one property boundary well (CCMGP-5) were installed as part of the nature and extent and assessment of corrective measures process in accordance with § 257.95(g)(1)(i) and § 257.95(g)(1)(iii).

No monitoring wells were decommissioned during 2023. Well installation records are provided in Appendix C.

2.3.3 40 CFR § 257.90(e)(3)

In addition to all the monitoring data obtained under § 257.90 through § 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs;

In accordance with § 257.94(b), at least two independent samples from each background and downgradient monitoring well were collected and analyzed. A summary table including the sample names, dates of sample collection, reason for sample collection, and monitoring data obtained for the groundwater monitoring program for the Closed Gypsum Pond is presented in Table 1 of this report. In addition, as required by § 257.95(d)(3), Table 1 includes the GWPS established under § 257.95(d)(2). Laboratory analytical data reports, along with field sampling forms, are provided in Appendix B to this report.

2.3.4 40 CFR § 257.90(e)(4)

A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels); and

The groundwater monitoring program is in the process of transitioning from assessment monitoring to corrective action. A summary of the groundwater monitoring programs for this CCR Unit is provided in below. Statistical evaluation memos are provided in Appendix A.

Following eight rounds of baseline sampling and one round of detection monitoring from the original monitoring wells (CGYP-1, CGYP-2 and CGYP-3) in 2020, the monitoring well network was updated with additional monitoring wells to ensure ongoing compliance with § 257.91(c). Synoptic water levels in one monitoring well (CGYP-3) indicated that groundwater flow directions were not consistent. Flow directions in CGYP-3 fluctuate between downgradient and side gradient of the Closed Gypsum Pond; Therefore, the original monitoring network for the Closed Gypsum Pond was supplemented with three additional monitoring wells (CGYP-4, CGYP-5, and CGYP-6).

Additionally, during baseline sampling for the newly installed monitoring wells in 2021, Santee Cooper concluded that analytical results from monitoring well CGYP-5 were not representative of groundwater quality associated with the Closed Gypsum Pond. Therefore, monitoring well CGYP-5 is only used to support the evaluation of the potentiometric surface.

As required by § 257.91 and § 257.94, the sample concentrations from the downgradient wells for each of the detected Appendix III constituents from the January 2022 detection monitoring event were compared to their respective background values. SSIs were identified for boron, calcium, chloride, sulfate, and total dissolved solids in monitoring wells CGYP-1, CGYP-2, CGYP-3, CGYP-4, and CGYP-6; fluoride in monitoring wells CGYP-1, CGYP-3, CGYP-4, and CGYP-6; and pH in monitoring wells CGYP-2, CGYP-3, CGYP-4, and CGYP-6. Therefore, the Closed Gypsum Pond transitioned to the assessment monitoring program on September 29, 2022.

Because of significant lab delays, Santee Cooper conservatively performed the first assessment monitoring event in June 2022 to stay on the normal semi-annual sampling schedule, sampling for all Appendix III and Appendix IV constituents. The second assessment monitoring event was conducted in October 2022, within 90 days of the first assessment monitoring event, resampling all Appendix III and Appendix IV constituents. The analytical results were received and validated in December 2022 and the corresponding statistical analysis of both assessment monitoring event results in March 2023 found statistically significant levels (SSLs) of beryllium in monitoring wells CGYP-1, CGYP-3, CGYP-4, and CGYP-6; cobalt in monitoring wells CGYP-1, CGYP-2, CGYP-3, CGYP-4, and CGYP-6; lead in monitoring wells CGYP-2 and CGYP-3; and lithium in monitoring wells CGYP-3, CGYP-4, and CGYP-6. Therefore, an assessment of corrective measures was initiated on June 7, 2023. An assessment of corrective measures report was prepared on October 30, 2023. To fulfill the requirement outlined in § 257.96, a public meeting is planned for 2024 to discuss the assessment of potential groundwater corrective measures for the Closed Gypsum Pond.

This CCR unit will continue groundwater monitoring in accordance with the assessment monitoring program until a final remedy is selected and the corrective action groundwater monitoring program is initiated.

2.3.5 40 CFR § 257.90(e)(5)

Other information required to be included in the annual report as specified in § 257.90 through § 257.98.

This Annual Report documents activities conducted to comply with Sections § 257.90 through § 257.98 of the Rule.

Groundwater elevations, flow rate, and direction are provided as Figures 2, 3, 4, and 5 for quarterly synoptic water level events as specified in § 257.93(c).

As the number of groundwater monitoring wells and associated samples have increased considerably across the site since the promulgation of the CCR Rule in 2015, turnaround times for labs have increased compared to historical expectations. Average turnaround times were approximately 60 days in 2023. Additionally, expansion of the groundwater monitoring networks (i.e., wells and samples) has contributed to a significant increase in data volume and complexity.

TABLES

Table 2
Cross Generating Station

2023 Synoptic Water Levels for Groundwater Monitoring Wells

Well Name	Top of Casing Elevation (ft msl) ²	1st Event - 2/13/2023		2nd Event - 5/1/2023		3rd Event - 6/26/2023		4th Event - 11/14/2023	
		Depth to Groundwater (ft btoc) ²	Groundwater Elevation (ft msl) ²	Depth to Groundwater (ft btoc) ²	Groundwater Elevation (ft msl) ²	Depth to Groundwater (ft btoc) ²	Groundwater Elevation (ft msl) ²	Depth to Groundwater (ft btoc) ²	Groundwater Elevation (ft msl) ²
PM-1	83.24	8.24	75.00	7.89	75.35	7.91	75.33	8.61	74.63
CBW-1	85.80	9.00	76.80	9.57	76.23	9.65	76.15	10.11	75.69
CAP-1	82.70	6.25	76.45	6.42	76.28	6.32	76.38	6.79	75.91
CAP-2 ¹	89.70	15.66	76.19	15.73	73.97	15.71	73.99	16.16	73.54
CAP-3	91.49	15.41	76.08	15.34	76.15	15.34	76.15	15.74	75.75
CAP-4	91.77	15.80	75.97	15.74	76.03	15.74	76.03	16.15	75.62
CAP-5	91.78	14.90	76.88	15.82	75.96	15.88	75.90	16.21	75.57
CAP-6	91.82	15.44	76.38	16.31	75.51	16.44	75.38	16.92	74.90
CAP-7	91.64	14.65	76.99	15.68	75.96	15.74	75.90	16.37	75.27
CAP-8	91.61	16.08	75.53	17.02	74.59	17.10	74.51	17.72	73.89
CAP-9	91.59	14.00	77.59	15.20	76.39	14.97	76.62	15.45	76.14
CAP-10	95.68	20.39	75.29	21.35	74.33	21.33	74.35	22.00	73.68
CAP-11 ¹	95.55	19.06	76.49	19.33	76.22	18.55	77.00	19.03	76.52
CAP-12 ¹	98.33	22.65	75.68	23.10	75.23	22.86	75.47	23.42	74.91
CAP-13	80.77	3.68	77.09	5.63	75.14	5.39	75.38	5.80	74.97
CAP-14 ¹	80.77	3.91	76.86	5.65	75.12	5.56	75.21	5.82	74.95
CCMLF-1	80.86	3.44	77.42	5.04	75.82	4.69	76.17	5.14	75.72
CCMLF-1D	80.65	3.26	77.39	4.78	75.87	4.44	76.21	4.86	75.79
CCMLF-2	84.08	6.54	77.54	8.79	75.29	8.63	75.45	9.31	74.77
POZ-3	82.61	4.71	77.90	6.10	76.51	6.03	76.58	6.11	76.50
POZ-4	82.73	4.11	78.62	6.33	76.40	6.19	76.54	6.52	76.21
POZ-5D ¹	82.49	4.30	78.19	6.49	76.00	6.32	76.17	6.67	75.82
POZ-6	83.84	5.40	78.44	7.83	76.01	7.47	76.37	8.03	75.81
POZ-7	82.02	4.31	77.71	5.80	76.22	6.06	75.96	6.08	75.94
POZ-8	83.13	4.94	78.19	7.09	76.04	6.93	76.20	7.28	75.85
CLF1B-1	83.76	6.77	76.99	7.36	76.40	7.42	76.34	7.51	76.25
CLF1B-2	82.04	4.95	77.09	5.75	76.29	5.77	76.27	5.95	76.09
CLF1B-3	82.75	5.23	77.52	6.64	76.11	6.53	76.22	6.74	76.01
CLF1B-4	82.74	4.95	77.09	7.78	74.96	6.60	76.14	6.89	75.85
CLF1B-5	81.09	3.25	77.84	5.32	75.77	5.21	75.88	5.48	75.61
CLF1B-5D	80.93	3.72	77.21	5.51	75.42	5.46	75.47	5.75	75.18
CCMAP-1	80.21	4.28	75.93	6.12	74.09	5.87	74.34	6.64	73.57
CCMAP-2	81.24	6.65	74.59	7.41	73.83	7.42	73.82	8.45	72.79
CCMAP-3	81.91	6.29	75.62	7.34	74.57	7.43	74.48	8.12	73.79
CCMAP-4	81.83	4.83	77.00	5.74	76.09	5.82	76.01	6.09	75.74
CCMAP-5	83.71	6.58	77.13	7.54	76.17	7.51	76.20	7.77	75.94
CCMAP-6	84.41	7.67	76.74	9.49	74.92	9.59	74.82	9.87	74.54
CCMAP-7	81.57	6.83	74.74	7.53	74.04	7.71	73.86	8.75	72.82
CCMAP-8	82.89	6.38	76.68	7.88	75.01	7.97	74.92	8.41	74.48
CGYP-1	91.89	16.45	75.44	16.81	75.08	16.81	75.08	16.99	74.90
CGYP-2	84.88	8.75	76.13	9.69	75.19	9.70	75.18	9.90	74.98
CGYP-3	83.95	6.63	77.32	8.68	75.27	8.68	75.27	8.76	75.19
CGYP-4	83.49	6.44	77.05	7.84	75.65	7.73	75.76	7.88	75.61
CGYP-5 ³	84.12	7.77	76.35	7.74	76.38	7.69	76.43	8.16	75.96
CGYP-6	83.23	7.61	75.62	7.86	75.37	7.89	75.34	8.31	74.92
CGYP-7	85.37	9.79	75.58	10.19	75.18	10.21	75.16	10.40	74.97
CGSPZ-1	83.31	7.71	75.60	7.96	75.35	7.91	75.40	8.52	74.79
CGSPZ-2	82.56	6.47	76.09	7.71	74.85	7.71	74.85	7.82	74.74
CGSPZ-3	82.85	4.69	78.16	7.97	74.88	8.74	74.11	8.04	74.81
CGSPZ-4	81.28	3.91	77.37	5.27	76.01	5.51	75.77	5.51	75.77
CGSPZ-5	80.56	2.57	77.99	4.71	75.85	4.56	76.00	4.25	76.31
CCMGP-1 ⁴	84.30	-	-	-	-	9.13	75.17	9.48	74.82
CCMGP-2 ⁴	96.73	-	-	-	-	21.68	75.05	21.74	74.99
CCMGP-3 ⁴	84.44	-	-	-	-	9.75	74.69	9.86	74.58
CCMGP-4 ⁴	84.82	-	-	-	-	9.44	75.38	9.78	75.04
CCMGP-5 ⁴	79.91	-	-	-	-	6.84	73.07	6.73	73.18
CGS-PSE-1 ⁵	-	-	75.74	-	74.78	-	74.81	-	75.08
CGS-PSE-2 ⁵	-	-	81.10	-	80.69	-	89.99	-	79.21
CGS-PSE-3 ⁵	-	-	82.24	-	81.67	-	81.57	-	79.26
CGS-PSE-4 ⁵	-	-	83.29	-	77.95	-	NA	-	NA
CGS-PSE-5 ⁵	-	-	77.60	-	76.46	-	76.71	-	77.10
CGS-PSE-6 ⁵	-	-	75.73	-	74.72	-	74.64	-	74.52

- Notes:
1. Additional groundwater monitoring wells used for development of potentiometric maps. These wells monitor groundwater constituent concentrations under the SC DHEC Wastewater Permit #SC0037401 and are not used for CCR constituent concentrations.
 2. Depth to Groundwater is measured below the top of the casing (btoc) to the water surface. The Top of Casing Elevation and GW Elevation are shown relative to mean sea level (msl).
 3. Per the 2021 CCR Annual Report, CGYP-5 was no longer sampled for CCR GW constituents. Beginning in June 2022, water level data was collected for potentiometric surface interpretation.
 4. Wells were installed between the 2nd and 3rd events.
 5. Pond surface elevations (PSE) were collected to aid in the potentiometric surface interpretation. No surface water present at PSE-4 during 3rd and 4th event, so unable to collect surface water elevation.

FIGURES




BOTTOM AS

LEGEND

- ⊕ BACKGROUND WELL
- ▲ CGS PIEZOMETERS
- ⊙ CLOSED GYPSUM POND MONITORING WELLS
- ⊖ GYPSUM POND NATURE & EXTENT WELL
- ⊕ GYPSUM POND PROPERTY BOUNDARY WELL
- CCR UNIT BOUNDARY
- ⊖ CROSS GENERATING STATION PROPERTY BOUNDARY
- ⊖ SANTEE COOPER PROPERTY BOUNDARY
- POND WATER SURFACE ELEVATION MEASUREMENT LOCATION

NOTES:

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE.
2. AERIAL IMAGERY SOURCE: ESRI



SANTEE COOPER
CROSS GENERATING STATION
PINEVILLE, SOUTH CAROLINA

**LOCATION OF CLOSED GYPSUM POND
GROUNDWATER MONITORING WELLS
FOR CCR COMPLIANCE**

JANUARY 2024

FIGURE 1


**FIGURE 2
POTENTIOMETRIC MAP
JANUARY 23, 2023**

GRAPHIC SCALE
600 9 1200
IN FEET


DRAWN BY: J. CHASTAIN
CHECKED BY: K. FERRI
DATE: 1/24/2024
APPROVED BY: K. FERRI
DATE: 1/24/2024
FILE NAME:
LAYOUT FIG 1 (POTENT MAP 2023-01-23)
LAST SAVED BY: J. CHASTAIN
DATE: 01/26/2024 8:58 AM
PLOT DATE: 01/26/2024 8:59 AM



www.synterracorp.com



santee cooper
CROSS GENERATING STATION
PINEVILLE, SOUTH CAROLINA

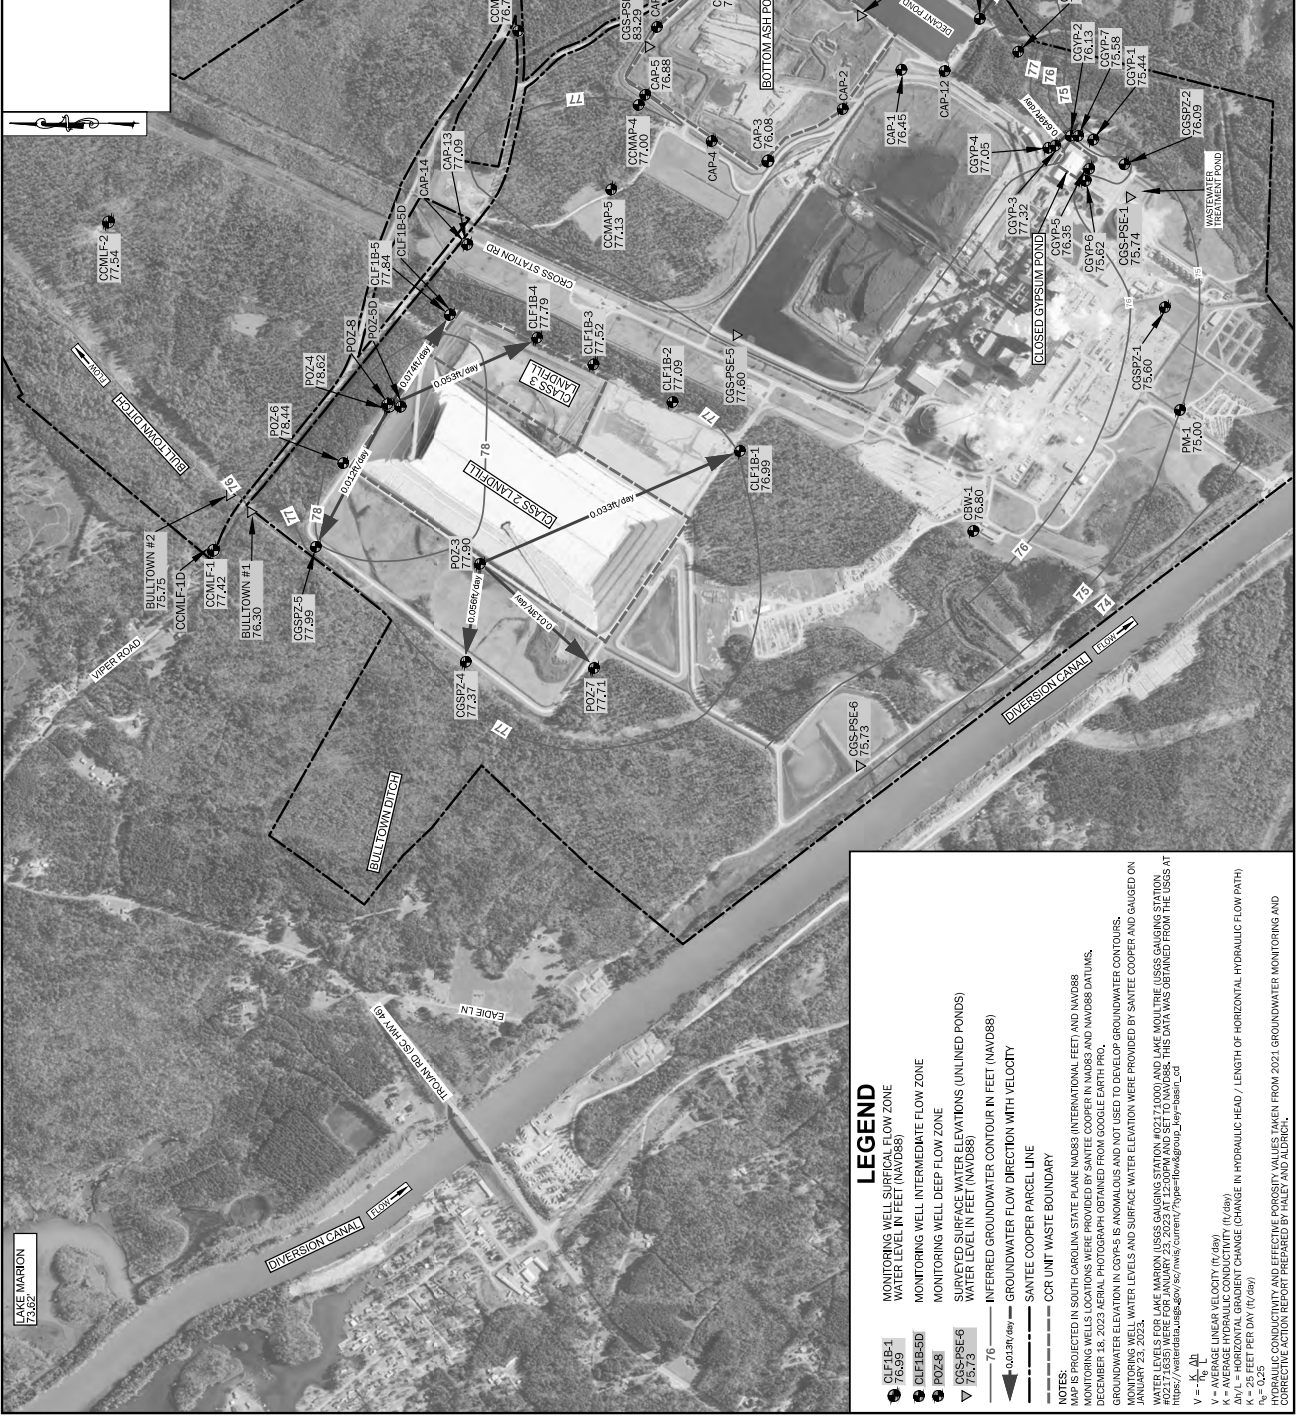

LEGEND

- CLFIB-1 WATER LEVEL IN FEET (NAVD88)
- CLFIB5D MONITORING WELL INTERMEDIATE FLOW ZONE
- POZ-8 MONITORING WELL DEEP FLOW ZONE
- ▽ CGSP-6 SURVEYED SURFACE WATER ELEVATIONS (UNLINED PONDS)
- ▽ CGSP-1 WATER LEVEL IN FEET (NAVD88)
- 76 INFERRED GROUNDWATER CONTOUR IN FEET (NAVD88)
- GROUNDWATER FLOW DIRECTION WITH VELOCITY
- SANTEE COOPER PARCEL LINE
- CCR UNIT WASTE BOUNDARY

NOTES:
 MAP IS PROJECTED IN SOUTH CAROLINA STATE PLANE NAD83 (INTERNATIONAL FEET) AND NAVD88
 MONITORING WELLS LOCATIONS WERE PROVIDED BY SANTEE COOPER IN NAD83 AND NAVD88 DATUMS,
 DECEMBER 18, 2023 AERIAL PHOTOGRAPH OBTAINED FROM GOOGLE EARTH PRO.
 GROUNDWATER ELEVATION IN CGTP-5 IS ANOMALOUS AND NOT USED TO DEVELOP GROUNDWATER CONTOURS.
 MONITORING WELL WATER LEVELS AND SURFACE WATER ELEVATION WERE PROVIDED BY SANTEE COOPER AND GAUGED ON
 WATER LEVELS FOR LAKE MARION (USGS GAGING STATION #0211000) AND LAKE MOULTRIE (USGS GAGING STATION
 #0214535) WERE FOR JANUARY 23, 2023 AT 2:00PM AND SET TO NAVD88. THIS DATA WAS OBTAINED FROM THE USGS AT
https://waterdata.usgs.gov/nc/nwis/current/?type=flow&group_2_key=basin_cd
 $V = \frac{K}{L} \cdot \frac{H}{K} \cdot \frac{L}{K}$
 $V =$ AVERAGE LINEAR VELOCITY (ft/day)
 $K =$ AVERAGE HYDRAULIC CONDUCTIVITY (ft/day)
 $L =$ CHANGE IN HYDRAULIC HEAD / LENGTH OF HORIZONTAL HYDRAULIC FLOW PATH
 $K = 25$ FEET PER DAY (ft/day)
 $H = 0.25$
 HYDRAULIC CONDUCTIVITY AND EFFECTIVE POROSITY VALUES TAKEN FROM 2021 GROUNDWATER MONITORING AND
 POTENTIOMETRIC MAPS FOR PREPARED BY TALEY AND ALBERTA.


GRAPHIC SCALE
 600 9 1200
 IN FEET

DATE: 6/12/2023
 DRAWN BY: J. CHASTAIN
 CHECKED BY: E. VIKROVICH
 DATE: 1/24/2024
 APPROVED BY: J. FERRELL
 DATE: 1/24/2024
 TITLE NAME:
 LAYOUT FIG. 1 (POTENTIAL MAP 2023-04-24)
 LAST SAVED BY: J. CHASTAIN
 DATE: 01/26/2024 9:00 AM
 PLOT DATE: 01/26/2024 9:01 AM

**FIGURE 3
 POTENTIOMETRIC MAP
 APRIL 24, 2023**



santee cooper
 CROSS GENERATING STATION
 PINEVILLE, SOUTH CAROLINA

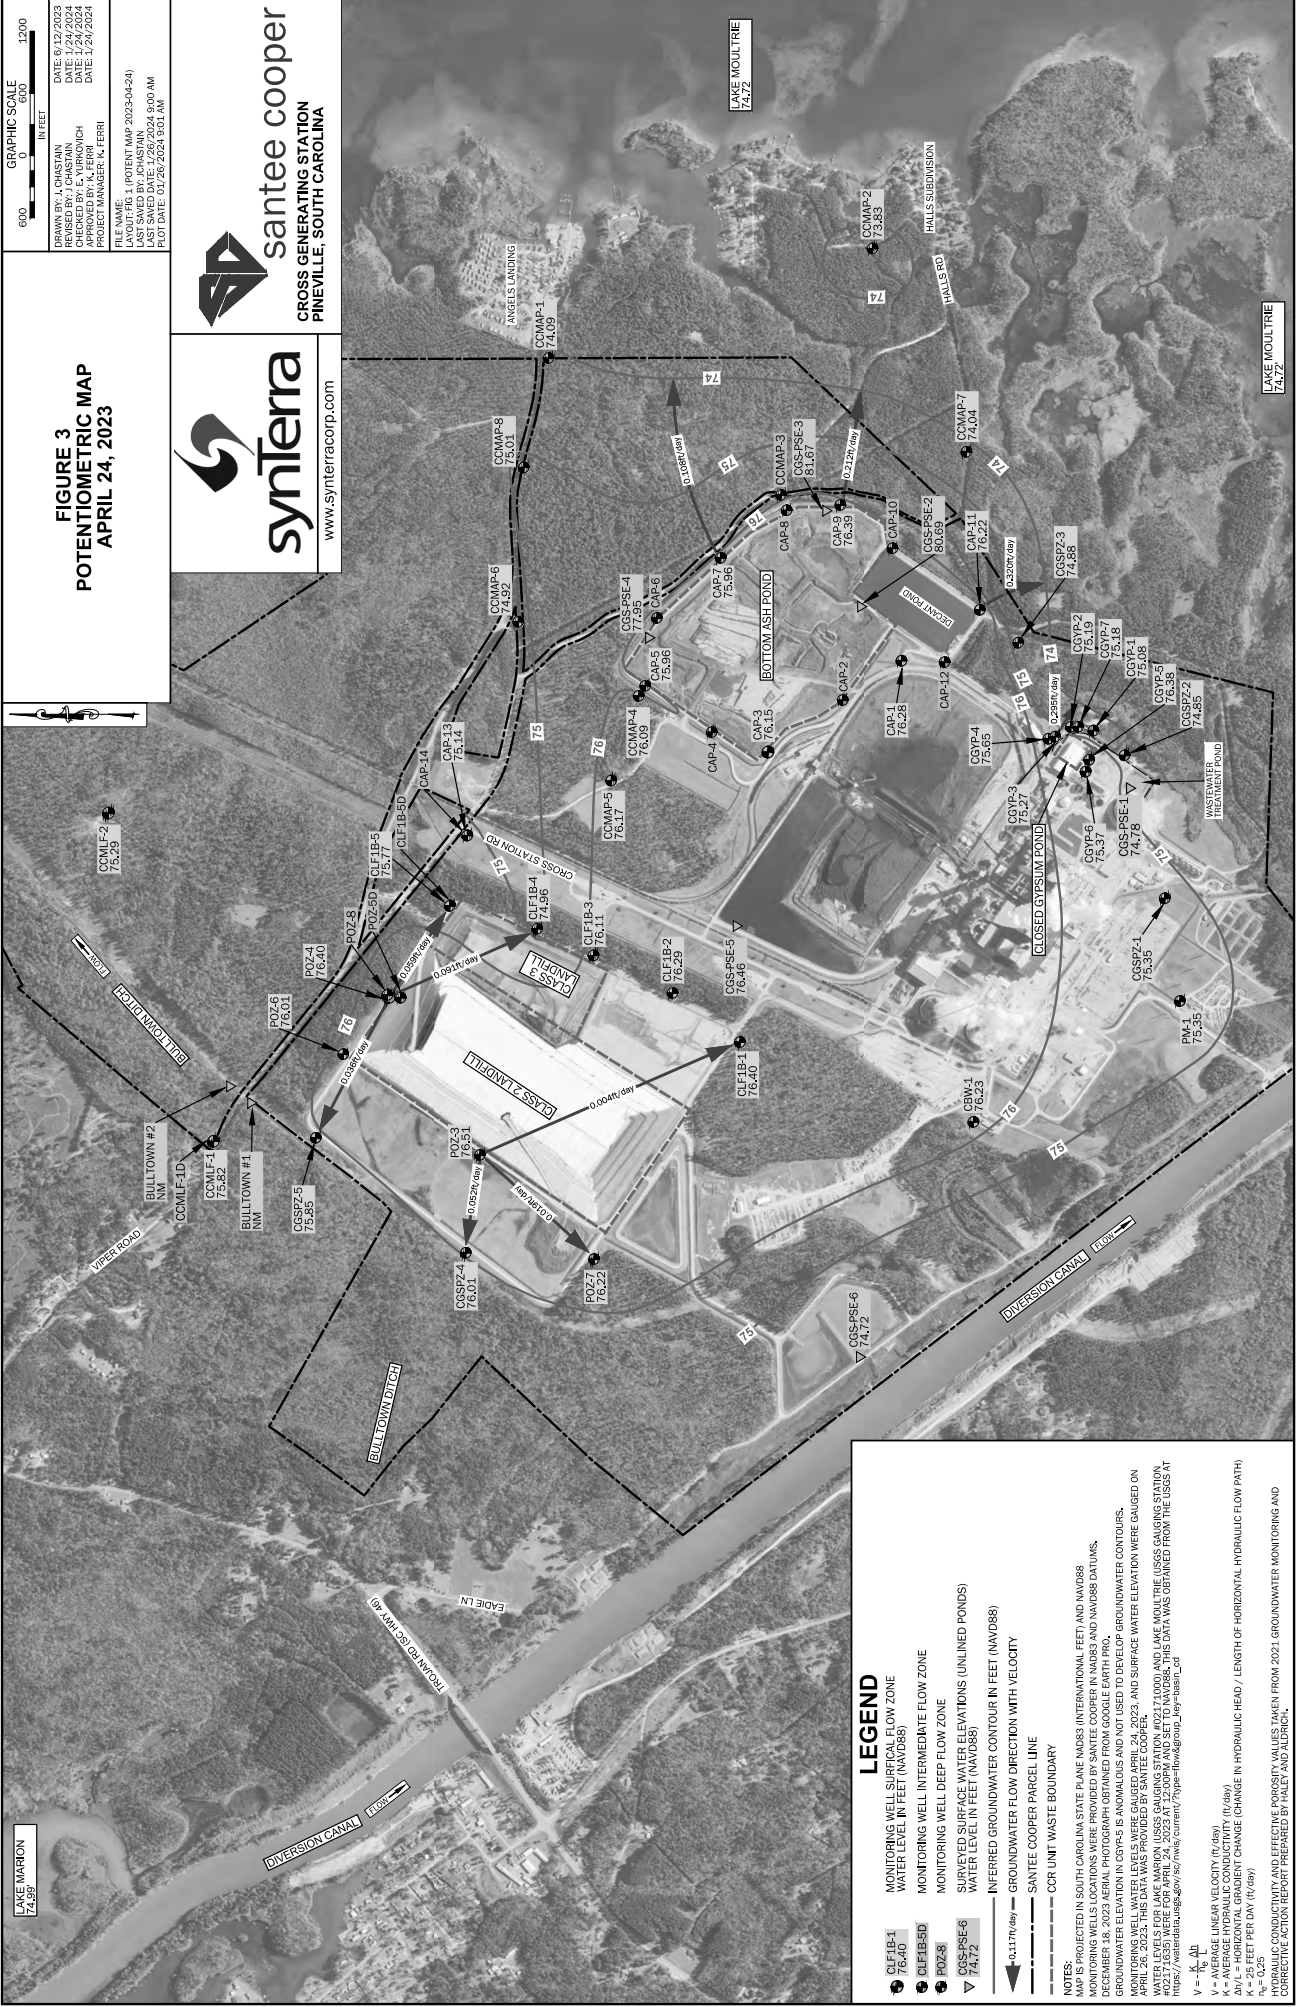

LEGEND

- CLF-IB-1 MONITORING WELL SURFICIAL FLOW ZONE WATER LEVEL IN FEET (NAVD88)
- CLF-IB-50 MONITORING WELL INTERMEDIATE FLOW ZONE WATER LEVEL IN FEET (NAVD88)
- POZ-8 MONITORING WELL DEEP FLOW ZONE WATER LEVEL IN FEET (NAVD88)
- ▽ GSS-PSE-6 SURVEYED SURFACE WATER ELEVATIONS (UNLINED PONDS) WATER LEVEL IN FEET (NAVD88)
- ◀ INFERRED GROUNDWATER CONTOUR IN FEET (NAVD88)
- GROUNDWATER FLOW DIRECTION WITH VELOCITY
- SANTEE COOPER PARCEL LINE
- CCR UNIT WASTE BOUNDARY

NOTES:
 1. DATA OBTAINED IN SOUTH CAROLINA STATE PLANE MASS INTERSECTIONAL FEET AND NAVD88 MONITORING WELLS LOCATIONS WERE PROVIDED BY Santee Cooper in accordance with a letter dated December 18, 2023. AERIAL PHOTOGRAPH OBTAINED FROM GOOGLE EARTH PRO.
 2. GROUNDWATER ELEVATION IN CCR-5 IS ANOMALOUS AND NOT USED TO DEVELOP GROUNDWATER CONTOURS.
 3. MONITORING WELL WATER LEVELS WERE GAUGED APRIL 24, 2023, AND SURFACE WATER ELEVATION WERE GAUGED ON WATER LEVELS FOR LAKE MARION (USGS GAGING STATION #02110000) AND LAKE MOULTRIE (USGS GAGING STATION #02115355) WERE FOR APRIL 24, 2023 AT 12:00 PM AND SET TO NAVD88. THIS DATA WAS OBTAINED FROM THE USGS AT https://waterdata.usgs.gov/nc/nwis/current/?type=flow&group_key=main_Led
 $V = \frac{K}{L} \cdot \Delta H$
 V = AVERAGE LINEAR VELOCITY (ft./day)
 K = AVERAGE HYDRAULIC CONDUCTIVITY (ft./day)
 L = CHANGE IN HYDRAULIC HEAD / LENGTH OF HORIZONTAL HYDRAULIC FLOW PATH
 K = 25 FEET PER DAY (ft./day)
 n_s = 0.25
 HYDRAULIC CONDUCTIVITY AND EFFECTIVE POROSITY VALUES TAKEN FROM 2021 GROUNDWATER MONITORING AND COMPREHENSIVE GROUNDWATER TESTS PREPARED BY TALS AND ALBERTA.


GRAPHIC SCALE
 600 9 1200
 IN FEET

DATE: 6/25/2023
 DRAWN BY: J. CHASTAIN
 CHECKED BY: A. HAMAD
 DATE: 1/24/2024
 APPROVED BY: J. CHASTAIN
 DATE: 1/24/2024
 PROJECT MANAGER: J. FERRI
 FILE NAME:
 LAYOUT FIG. 1 (POTENTIAL MAP 2023-06-05)
 LAST SAVED BY: J. CHASTAIN
 DATE: 6/25/2023 6:10 PM
 PLOT DATE: 01/26/2024 9:02 AM

**FIGURE 4
 POTENTIOMETRIC MAP
 JUNE 5, 2023**



santee cooper
 CROSS GENERATING STATION
 PINEVILLE, SOUTH CAROLINA

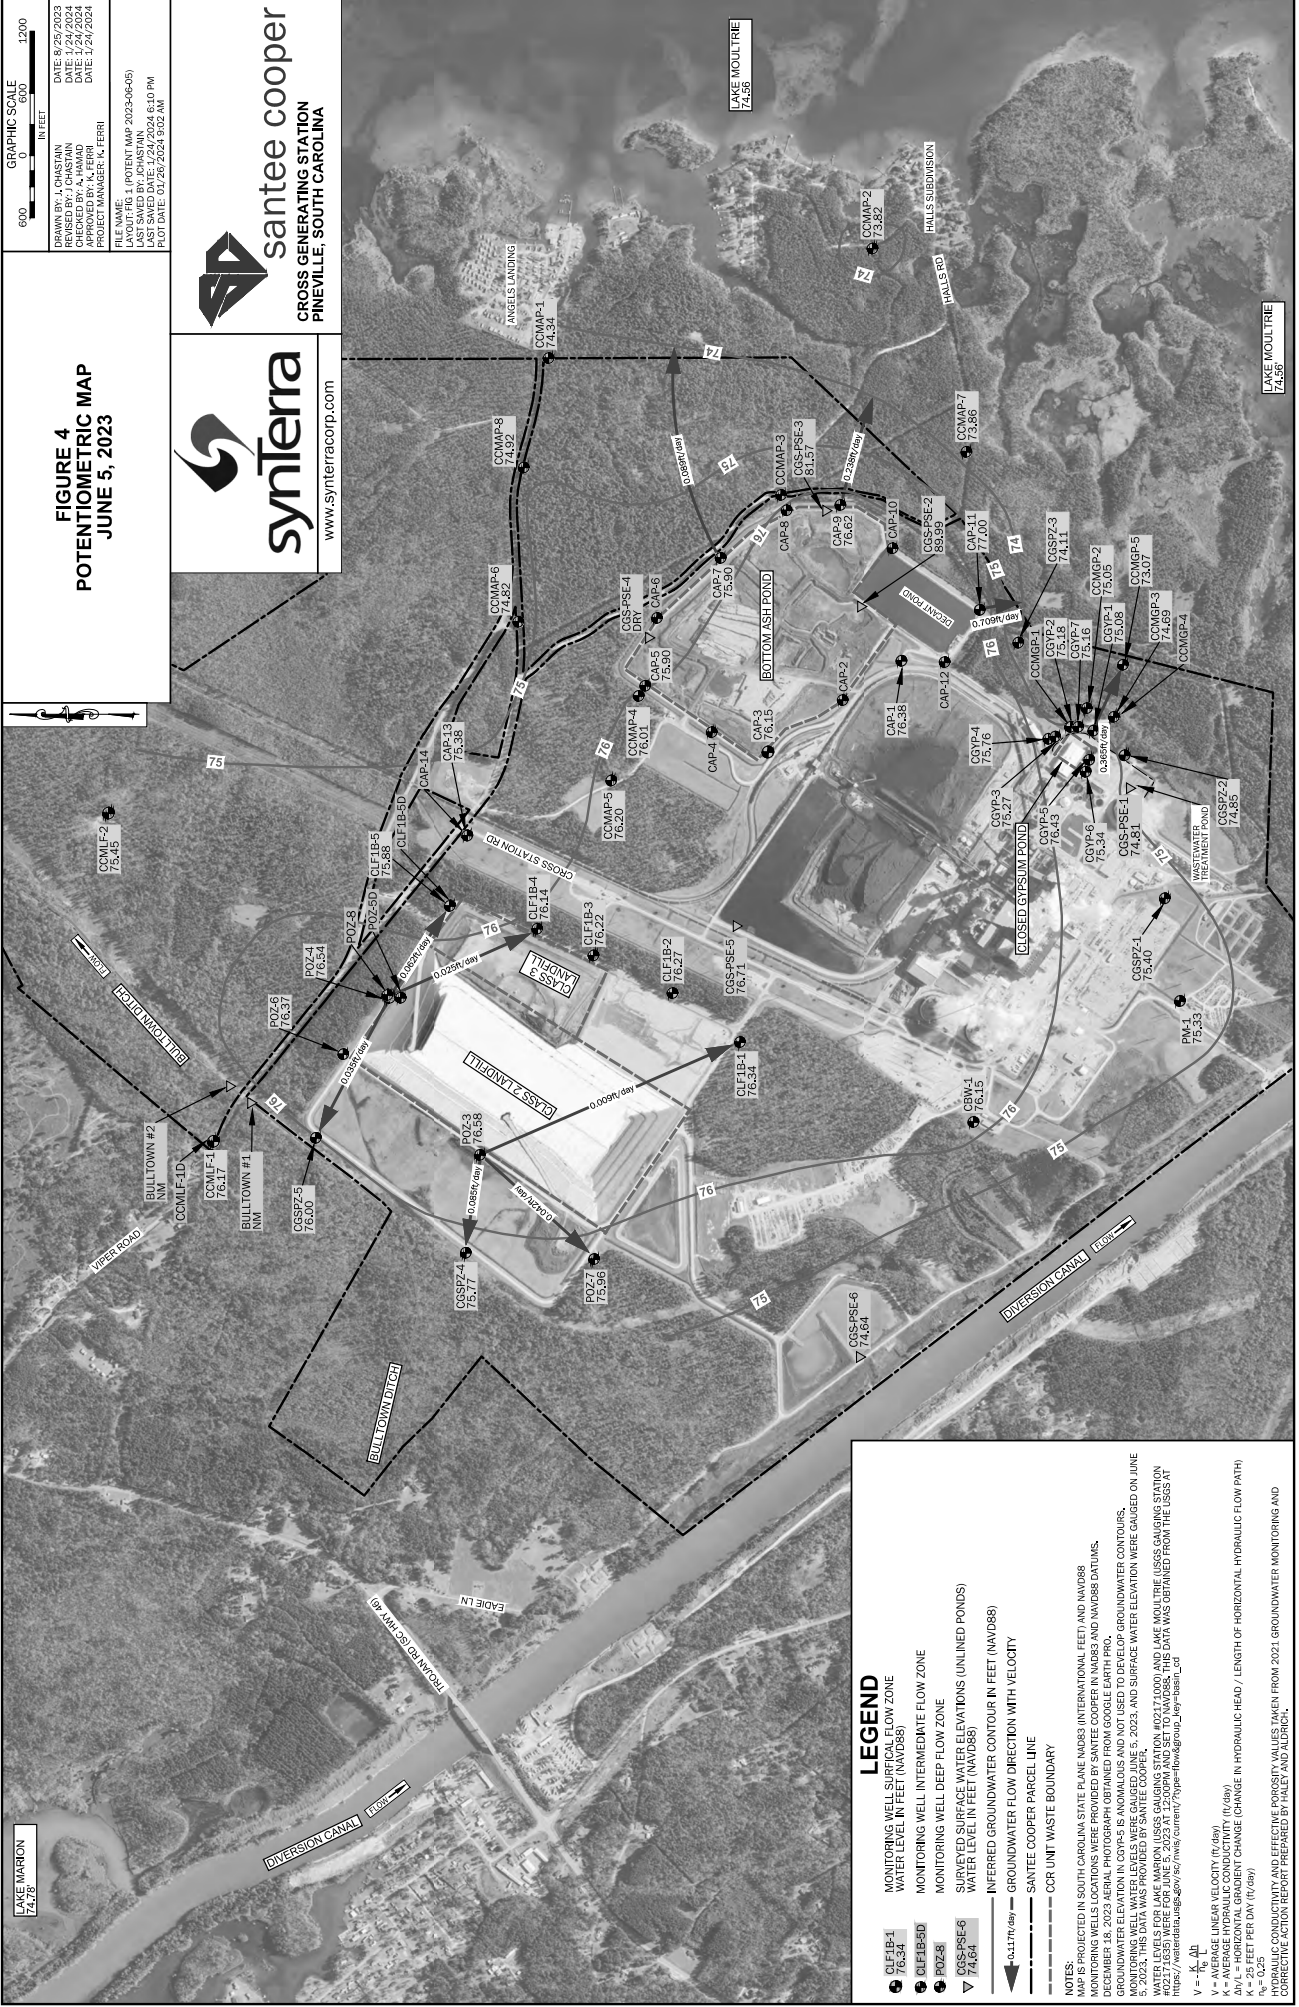

LEGEND

- CLFIB-1
76.54
- CLFIB500
- POZ-8
- GSS-PSE-6
74.64
- 0.11 ft/day
- Santee Cooper Parcel Line
- CCR Unit Waste Boundary

MONITORING WELL SURFACE FLOW ZONE
 WATER LEVEL IN FEET (NAVD88)

MONITORING WELL INTERMEDIATE FLOW ZONE

MONITORING WELL DEEP FLOW ZONE

SURVEYED SURFACE WATER ELEVATIONS (UNLINED PONDS)
 WATER LEVEL IN FEET (NAVD88)

INFERRED GROUNDWATER CONTOUR IN FEET (NAVD88)

GROUNDWATER FLOW DIRECTION WITH VELOCITY

SANTEE COOPER PARCEL LINE

CCR UNIT WASTE BOUNDARY

NOTES:
 MAP IS PROJECTED IN SOUTH CAROLINA STATE PLANE (NAD83) (INTERNATIONAL FEET) AND NAVD88
 MAP SOURCE: 2023 AERIAL PHOTOGRAPH OBTAINED FROM GOOGLE EARTH PRO
 GROUNDWATER ELEVATION IN COG-5 IS ANOMALOUS AND NOT USED TO DEVELOP GROUNDWATER CONTOURS.
 MONITORING WELL WATER LEVELS WERE GAUGED JUNE 5, 2023, AND SURFACE WATER ELEVATION WERE GAUGED ON JUNE
 WATER LEVELS FOR LAKE MARION (USGS GAGING STATION #02110000) AND LAKE MOULTRIE (USGS GAGING STATION
 #02116355) WERE FOR JUNE 6, 2023 AT 12:00PM AND SET TO NAVD88. THIS DATA WAS OBTAINED FROM THE USGS AT
https://waterdata.usgs.gov/nc/nwis/current/?type=flow&group_key=mean_L0
 $V = \frac{K}{n} \cdot \frac{dH}{L}$
 V = AVERAGE LINEAR VELOCITY (ft/day)
 K = AVERAGE HYDRAULIC CONDUCTIVITY (ft/day)
 H = CHANGE IN HYDRAULIC HEAD / LENGTH OF HORIZONTAL HYDRAULIC FLOW PATH
 L = 25 FEET PER DAY (ft/day)
 $n_p = 0.25$
 HYDRAULIC CONDUCTIVITY AND EFFECTIVE POROSITY VALUES TAKEN FROM 2021 GROUNDWATER MONITORING AND
 COMPARATIVE ANALYSIS REPORT PREPARED BY TALLEY AND ASSOCIATES.

**FIGURE 5
POTENTIOMETRIC MAP
NOVEMBER 7, 2023**

GRAPHIC SCALE
600 9 1200
IN FEET

DRAWN BY: J. CHASTAIN
CHECKED BY: K. FERRI
APPROVED BY: K. FERRI
DATE: 12/19/2023
DATE: 1/24/2024
DATE: 1/24/2024

TITLE NAME:
LAYOUT FIG. 1 (POTENT MAP 2023-11-07)

LAST SAVED BY: J. CHASTAIN
DATE: 01/26/2024 9:03 AM
PLOT DATE: 01/26/2024 9:03 AM



www.synterracorp.com



santee cooper
CROSS GENERATING STATION
PINEVILLE, SOUTH CAROLINA



LAKE MARION
73.06

LAKE MOULTRIE
72.91

LAKE MOULTRIE
72.91

LEGEND

- CMLEF-1
76.29
- CMLEF-5D
75.61
- POZ-8
76.21
- GSS-PSE-6
74.52
- ▲ 74.52
- 0.392ft/day
- SATEE COOPER PARCEL LINE
- SATEE COOPER WASTE BOUNDARY


NOTES:
MONITORING WELLS IN SOUTH CAROLINA STATE PLANE NAD83 (INTERSECTION FEET AND INCHES)
MONITORING WELLS LOCATIONS WERE PROVIDED BY Santee Cooper in NAD83 AND NAD88 DATUMS.
DECEMBER 18, 2023 AERIAL PHOTOGRAPH OBTAINED FROM GOOGLE EARTH PRO.
MONITORING WELL WATER LEVELS WERE GAUGED NOVEMBER 7, 2023, AND SURFACE WATER ELEVATION WERE GAUGED ON
NOVEMBER 7, 2023. THIS DATA WAS PROVIDED BY Santee Cooper.
SURVEYED SURFACE WATER ELEVATIONS (UNLINED PONDS)
WATER LEVEL IN FEET (NAVOD88)
INFERRED GROUNDWATER CONTOUR IN FEET (NAVOD88)
GROUNDWATER FLOW DIRECTION WITH VELOCITY
SATEE COOPER PARCEL LINE
SATEE COOPER WASTE BOUNDARY

FORMULAS:
 $V = \frac{K \cdot \Delta H}{L}$
 $K = \text{AVERAGE HYDRAULIC CONDUCTIVITY (ft/day)}$
 $\Delta H = \text{CHANGE IN HYDRAULIC HEAD / LENGTH OF HORIZONTAL HYDRAULIC FLOW PATH}$
 $L = \text{25 FEET PER DAY (ft/day)}$
 $n_p = 0.25$

HYDRAULIC CONDUCTIVITY AND EFFECTIVE POROSITY VALUES TAKEN FROM 2021 GROUNDWATER MONITORING AND
POTENTIOMETRIC MAPS PREPARED BY TALLEY AND ASSOCIATES.

Appendix A – Statistical Analysis

GROUNDWATER STATS CONSULTING

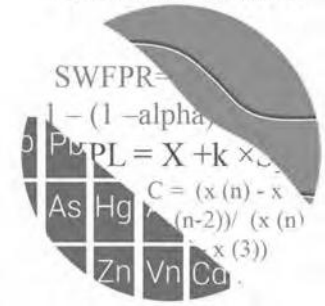

March 9, 2023

SynTerra
Attn: Ms. Kelly Ferri
148 River Street, Suite 220
Greenville, South Carolina 29601

RE: Cross Generating Station Closed Gypsum Pond – 2022 Groundwater Statistical Analysis

Dear Ms. Ferri,

Groundwater Stats Consulting, formerly the statistical consulting division at Sanitas Technologies, is pleased to provide the data screening and statistical analysis of the June and October 2022 sample events of groundwater data at the Cross Generating Station Closed Gypsum Pond for the Coal Combustion Residuals (CCR) program. The analysis complies with the federal rule for the Disposal of Coal Combustion Residuals from Electric Utilities (CCR Rule, 2015) as well as with the United States Environmental Protection Agency (USEPA) Unified Guidance (2009).

Data were sent electronically to Groundwater Stats Consulting, and the statistical analysis was reviewed by Andrew Collins, Project Manager for Groundwater Stats Consulting. The monitoring well network consists of the following wells:

- Upgradient wells: CBW-1 and PM-1
- Downgradient wells: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, and CGYP-7

Sampling began for the CCR program in October 2015 at upgradient wells CBW-1 and PM-1; in May 2020 for downgradient wells CGYP1, CGYP-2, and CGYP-3; in April 2021 for downgradient wells CGYP-4 and CGYP-6; and in October 2022 for downgradient well CGYP-7. All wells are analyzed in this report except for well CGYP-7, which is in the background collection phase and is only included on the time series graphs. The Appendix III constituents are evaluated using prediction limits when a minimum of 8 background samples are available; and confidence intervals are constructed for Appendix IV constituents when a minimum of 4 samples are available.

The following constituents are evaluated:

- **Appendix III:** boron, calcium, chloride, fluoride, pH, sulfate, and TDS
- **Appendix IV:** antimony, arsenic, barium, beryllium, cadmium, chromium, cobalt, combined radium 226 + 228, fluoride, lead, lithium, mercury, molybdenum, selenium, and thallium

Note that the terms “parameters” and “constituents” are interchangeable throughout this report. When there are no detections present in downgradient wells for a given constituent, statistical analyses are not required. A summary of well/constituent pairs containing 100% non-detects follows this letter.

Data at all wells for constituents detected in downgradient wells were evaluated for the following: 1) outliers; 2) trends; 3) most appropriate statistical method based on site characteristics of groundwater data upgradient of the facility; and 4) eligibility of downgradient wells when intrawell statistical methods are recommended. A power curve is provided to demonstrate that the selected statistical method for the Appendix III Detection Monitoring parameters listed above complies with the USEPA Unified Guidance. The EPA suggests the selected statistical method should provide at least 55% power at 3 standard deviations or at least 80% power at 4 standard deviations. Power curves were based on the following statistical methods:

CCR Appendix III Constituents:

- Semi-Annual Sampling
- Interwell Prediction Limits with 1-of-2 resample plan
- # Constituents: 7
- # Downgradient wells: 6

Parametric prediction limits are utilized when the screened historical data follow a normal or transformed-normal distribution. When data cannot be normalized or the majority of data are non-detects, a nonparametric test is utilized. While the false positive rate associated with the parametric limits is based on an annual 10% (5% per semi-annual event) as recommended by the EPA Unified Guidance (2009), the false positive rate associated with the nonparametric limits is dependent upon the available background sample size, number of future comparisons, and verification resample plan. The distribution of data is tested using the Shapiro-Wilk/Shapiro-Francia test for normality. After testing for normality and performing any adjustments as discussed below (US EPA,

2009), data are analyzed using either parametric or non-parametric prediction limits. Non-detects are handled as follows:

- No statistical analyses are required on wells and analytes containing 100% non-detects.
- When data contain <15% non-detects, simple substitution of one-half the reporting limit is utilized in the statistical analysis. The reporting limit utilized for non-detects is the most recent practical quantification limit (PQL) as reported by the laboratory.
- When data contain between 15-50% non-detects, the Kaplan-Meier non-detect adjustment is applied to the background data. This technique adjusts the mean and standard deviation of the historical concentrations to account for concentrations below the reporting limit.
- Nonparametric prediction limits are used on data containing greater than 50% non-detects.

Natural systems continuously evolve due to physical changes made to the environment and unrelated to the site. Examples include capping a landfill, paving areas near a well, or lining a drainage channel to prevent erosion. Periodic updating of background statistical limits is necessary to accommodate these types of changes. Because this site is currently in Assessment Monitoring, upgradient well data for Appendix III constituents will be carefully screened for any new outliers and interwell prediction limits will be updated when a minimum of 4 new samples are available at each upgradient well.

When newer measurements are representative of earlier measurements, the concentrations are incorporated into background. Improved sample size results in statistical limits that provide better representation of the true background population. In some cases, the earlier portion of records may require deselection prior to construction of limits to provide sensitive limits that are representative of present-day groundwater quality conditions and will rapidly detect changes in downgradient wells. Even though the data are excluded from the calculation, the values will continue to be reported and shown in tables and graphs. A summary of records with truncated data sets will be provided.

Summary of 2022 Background Screening - Appendix III Constituents

Time series plots are provided for all well/constituent pairs and are particularly useful for screening data (Figure A). Additionally, a separate section of box plots is included for all constituents at upgradient and downgradient wells (Figure B). The time series plots display concentrations over time for each well and are used to initially screen for suspected outliers and trends, while the box plots provide visual representation of

variation within individual wells and between all wells. Outliers and trends in background data result in increased variation and statistical limits that are not conservative (i.e., lower) from a regulatory perspective, if not addressed. When outliers are confirmed, these values are flagged in the computer database with "o" in order to deselect prior to construction of statistical limits. Values in background which have been flagged as outliers may be seen in a lighter font and as a disconnected symbol on the time series graphs.

Reporting limit changes may occur depending on laboratory capabilities. When varying detection limits are present in background data sets, a substitution of the most recent reporting limit is used for all non-detects for a given constituent.

Outlier Testing

Tukey's box plot method was used to evaluate potential outliers for Appendix III constituents on pooled upgradient well data and at each downgradient well (Figure C). No outliers were identified for any of the Appendix III constituents; therefore, no values were flagged.

Seasonality

No seasonal patterns were visually apparent in the any of the detected data; therefore, no deseasonalizing adjustments were made to the data. When seasonal patterns are observed, data may be optionally deseasonalized so that the resulting limits will correctly account for the seasonality as a predictable pattern rather than random variation or a release.

Determination of Statistical Methods

The Analysis of Variance (ANOVA) was used to identify the most appropriate statistical approach based on observed groundwater quality upgradient of the Closed Gypsum Pond (Figure D). Interwell tests, which compare downgradient well data to statistical limits constructed from pooled upgradient well data, are appropriate when average concentrations are similar across upgradient wells. Intrawell tests, which compare compliance data from a single well to screened historical data within the same well, are appropriate when upgradient wells exhibit spatial variation; when statistical limits constructed from upgradient wells would not be conservative (i.e., lower) from a regulatory perspective; and when downgradient water quality is unimpacted compared to upgradient water quality for the same parameters.

In cases where downgradient concentrations are elevated relative to upgradient concentrations, an independent study and hydrogeological investigation would be required to identify local geochemical conditions and expected groundwater quality for the region to justify an intrawell approach. When an independent study indicates downgradient groundwater quality is not affected by practices at the facility, an intrawell approach may be used if it is determined to be the most appropriate statistical method. Such an assessment is beyond the scope of services provided by Groundwater Stats Consulting.

The ANOVA noted variation in groundwater quality among upgradient wells for boron, calcium, chloride, fluoride, pH, and sulfate. No variation was identified between upgradient wells for TDS, making this constituent eligible for interwell prediction limits. For all other Appendix III constituents, the results of the ANOVA indicated intrawell methods should be considered for these parameters if no pre-existing impacts from the unit are suspected in downgradient wells. Additional testing was conducted as described below to determine intrawell eligibility.

Intrawell limits constructed from carefully screened background data from within each well serve to provide statistical limits that are conservative (i.e., lower) from a regulatory perspective, and that will rapidly identify a change in more recent compliance data from within a given well. This statistical method removes the element of variation from across wells and eliminates the chance of mistaking natural spatial variation for a release from the facility. Prior to performing intrawell prediction limits, it is necessary to demonstrate that groundwater at downgradient wells is not suspected to have existing impacts from the practices of the facility.

In order to establish baseline upgradient well concentrations, tolerance limits (either parametric or nonparametric as appropriate, depending on the distribution of the data sets) were constructed using pooled upgradient well data for each of the Appendix III parameters recommended for intrawell analyses (Figure E). Parametric tolerance limits were constructed with a target of 99% confidence and 95% coverage. The confidence and coverage levels for nonparametric tolerance limits are dependent upon the number of background samples. As more data are collected, the background population is better represented and the confidence and coverage levels increase.

Next, to determine whether average downgradient concentrations are elevated relative to the upgradient well baseline concentrations established by the tolerance limits above, confidence intervals were constructed on downgradient wells for each of the Appendix III

parameters exhibiting spatial variation (Figure F). The results showed that at least one confidence interval exceeded its respective limit for each of the parameters tested.

When the entire confidence interval exceeds a background standard, it is an indication that downgradient concentrations are elevated above background levels. Therefore, interwell methods are recommended initially in lieu of intrawell methods until further research identifies whether the elevated downgradient concentrations are likely the result of natural geological conditions, an off-site source, or may be the result of the facility. After such a study, data would be re-evaluated to determine the most appropriate statistical method.

Trend Testing – Upgradient Wells

The Sen's Slope/Mann Kendall trend test was used to evaluate pooled upgradient well data to identify statistically significant increasing or decreasing trends (Figure G). Statistically significant increasing trending data are typically not included as part of the background data used for construction of interwell prediction limits. Truncating data sets in upgradient wells to eliminate trends reduces variation in background and results in statistical limits representative of present-day groundwater quality concentrations. When statistically significant decreasing trends are present, earlier data are evaluated to determine whether historic concentration levels are significantly higher than current reported concentrations and will be deselected as necessary. When the historical records of data are truncated for the reasons above, a summary report will be provided to show the date ranges used in construction of the statistical limits.

The results of the trend analyses identified the following statistically significant trends:

Increasing:

- Chloride: CBW-1

Decreasing:

- Calcium: PM-1
- Fluoride: CBW-1
- Sulfate: PM-1

These trends are relatively low in magnitude when compared to average concentrations within these wells; therefore, no adjustments were required to the data sets. No other statistically significant trends were identified for any of the Appendix III parameters.

Evaluation of Appendix III Constituents

Interwell Prediction Limits

Interwell prediction limits were constructed as recommended in the CCR Rule (2015) and in the EPA Unified Guidance (2009), based on a 1-of-2 resample plan, using pooled upgradient well data from wells CBW-1 and PM-1 for boron, calcium, chloride, fluoride, pH, sulfate, and TDS through the June and October 2022 sample events (Figures H & I, respectively). The June and October 2022 samples from each downgradient well were compared to the respective statistical limits. In the event of an initial exceedance of compliance well data, a resample may be collected to determine whether the initial exceedance is confirmed, in which case a statistically significant increase (SSI) is identified. If the resample falls within the statistical limit, the initial exceedance is considered to be a false positive result and, therefore, no further action is necessary.

Parametric prediction limits were constructed when background data followed a normal or transformed-normal distribution. Non-parametric prediction limits are provided for data sets with greater than 50% nondetects, and for data sets which do not follow a normal or transformed-normal distribution. Downgradient measurements were compared to these background limits. Exceedances were noted for the majority of interwell prediction limits which may be seen on the summary tables following this letter.

Trend Tests - Exceedances

When an exceedance occurs in a downgradient well, the exceedance is further evaluated using the Sen's Slope/Mann Kendall trend test at the 99% confidence level. Upgradient wells are included in the trend analyses to identify whether similar patterns exist upgradient of the site (Figure J). Statistically significant trends were identified for the following well/constituent pairs:

Increasing

- Chloride: CBW-1 (upgradient)

Decreasing

- Calcium: PM-1 (upgradient), CGYP-2, and CGYP-4
- Chloride: CGYP-4
- Fluoride: CBW-1 (upgradient) and CGYP-4
- Sulfate: PM-1 (upgradient)
- TDS: CGYP-4

Summary of 2022 Background Screening - Appendix IV Constituents

Prior to evaluating Appendix IV parameters, upgradient well data are screened through visual screening to identify whether seasonal patterns or trends are present that would lead to artificially elevated statistical limits. All upgradient well data appear stable for the Appendix IV constituents.

Tukey's outlier test on pooled upgradient well data through October 2022 identified outliers for cobalt and lead; however, these values were not flagged as outliers since the measurements were either similar to remaining measurements within the records or were less than the established Maximum Contaminant Limits (MCLs) (Figure C). The highest reported observation of 16.3 pCi/L for combined radium 226+228 was not identified as an outlier by Tukey's test, therefore, this measurement was not flagged as an outlier at this time. If further research indicates this measurement is not representative of naturally occurring groundwater quality upgradient of the facility it will be flagged as an outlier.

Additionally, downgradient well data through October 2022 were screened through visual screening and Tukey's test. Since the downgradient well data are used to construct confidence intervals, a regulatory conservative approach is taken in that values that are marginally high relative to the rest of the data are retained unless there is particular justification for excluding them. Tukey's test identified a single value of 0.092 mg/L for lead in well CGYP-3 which was flagged as an outlier in the database since all remaining measurements were less than 0.036 mg/L. While the test identified an outlier for mercury in well CGYP-3, this measurement was not flagged as an outlier since the concentration was significantly lower than the established MCL. The test also identified a low outlier for selenium in well CGYP-3 which was a reported trace value; therefore, the measurement was not flagged in the database.

Interwell Upper Tolerance Limits

Interwell upper tolerance limits are used to calculate background limits from all available pooled upgradient well data for Appendix IV parameters to determine the background limit for each constituent. For parametric limits a target of 95% confidence and 95% coverage is used. The confidence and coverage levels for nonparametric tolerance limits are dependent upon the number of background samples. The interwell upper tolerance limits utilized in this analysis were constructed by Haley & Aldrich, Inc. in the 2022 Annual Groundwater Monitoring and Corrective Action Report for the Closed Gypsum Pond Cross Generating Station. Upgradient well data will be re-evaluated in future analyses for construction of interwell tolerance limits.

Groundwater Protection Standards

Interwell upper tolerance limits were compared to the MCLs and CCR-Rule specified levels in the Groundwater Protection Standard (GWPS) table following this letter to determine the highest limit for use as the GWPS in the Confidence Interval comparisons (Figure K).

Evaluation of Appendix IV Parameters – 2022

Confidence Intervals

Confidence intervals were then constructed on downgradient wells with data through October 2022 for each of the Appendix IV parameters using the highest limit of the MCL, the CCR-Rule specified levels, or background limits as discussed above (Figure L). Due to varying reporting limits ranging from 0.01 mg/L to the most recent reporting limit of 0.05 mg/L for selenium in well CGYP-4, which has no detections above the highest reporting limit, no nondetect substitution was performed for this well/constituent pair.

Only when the entire confidence interval is above a GWPS is the well/constituent pair considered to exceed its respective standard and a statistically significant level (SSL) identified. Several confidence interval exceedances were noted and a summary of SSLs follows this letter.

Thank you for the opportunity to assist you in the statistical analysis of groundwater quality for the Closed Gypsum Pond. If you have any questions or comments, please feel free to contact us.

Sincerely,




Kristina L. Rayner
Senior Statistician



Andrew T. Collins
Project Manager

Power Curve

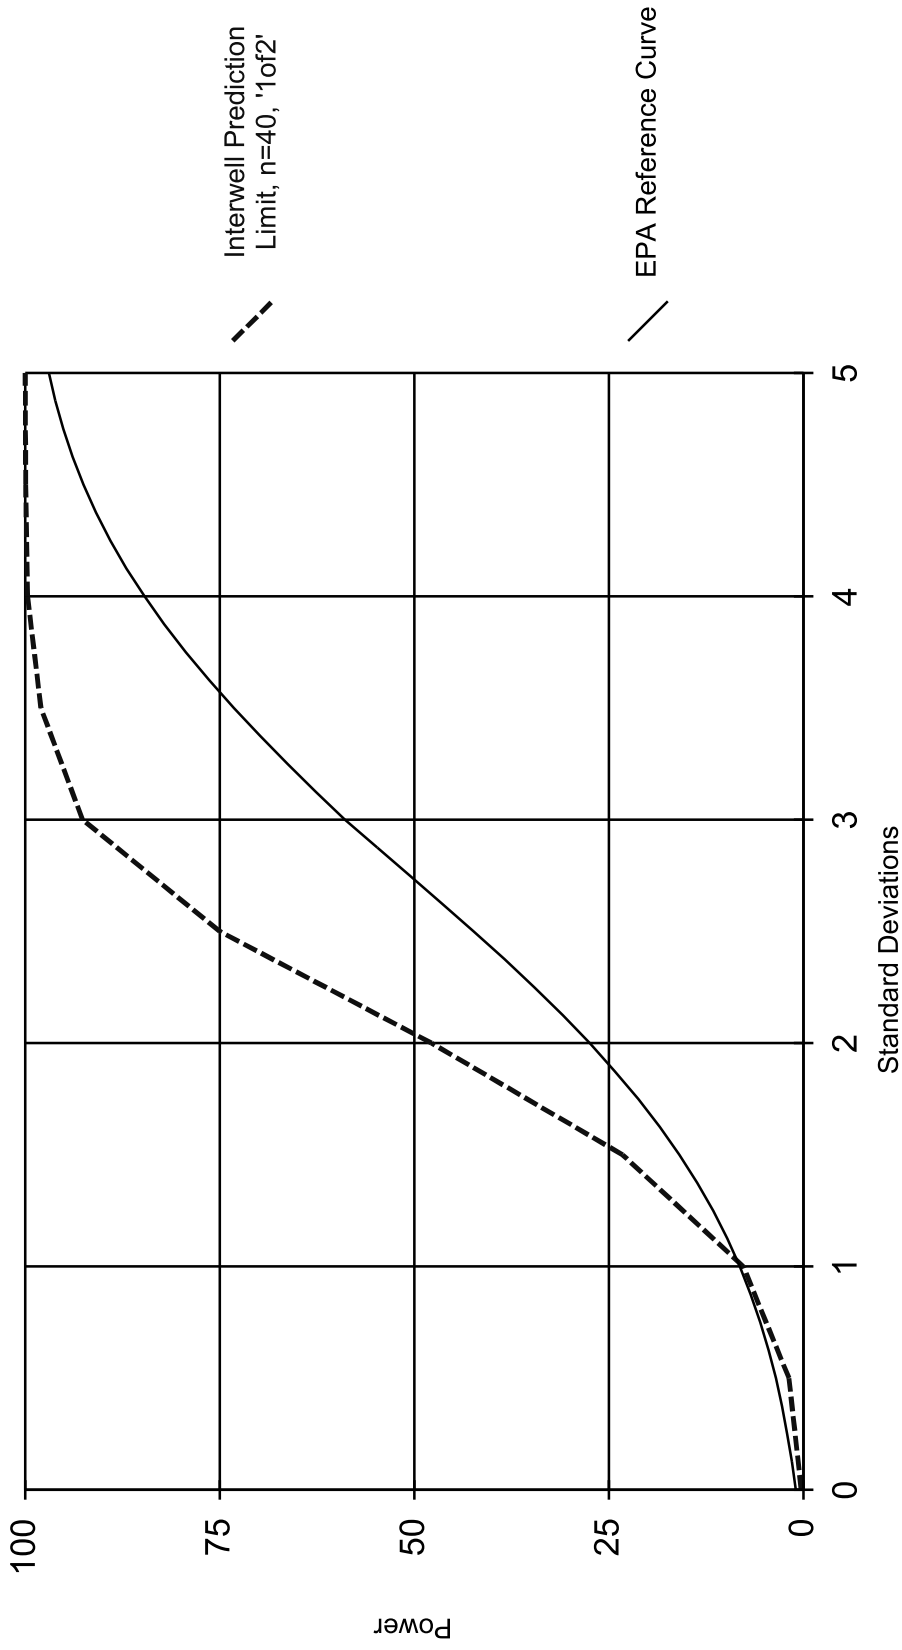

Kappa = 1.932, based on 6 compliance wells and 7 constituents, evaluated semi-annually (this report reflects annual total).

100% Non-Detects

Analysis Run 2/19/2023 3:50 PM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Antimony (ug/L)

CBW-1, PM-1, CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-5

Arsenic (ug/L)

CGYP-6, CGYP-5

Beryllium (ug/L)

PM-1

Cadmium (ug/L)

CBW-1, PM-1, CGYP-5

Chromium (ug/L)

PM-1, CGYP-1, CGYP-2, CGYP-4, CGYP-6, CGYP-5

Fluoride (mg/L)

PM-1

Lead (ug/L)

PM-1

Mercury (ug/L)

CBW-1, PM-1, CGYP-2, CGYP-4, CGYP-6, CGYP-5

Molybdenum (ug/L)

CBW-1, PM-1, CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-5

Selenium (ug/L)

CBW-1, PM-1, CGYP-6, CGYP-5

Thallium (ug/L)

CBW-1, PM-1, CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-5

Outlier Summary

CGYP Client: Santee Cooper Data: CGYP Printed 3/8/2023, 11:44 AM

CGYP-3 Lead (mg/L)

2/10/2021

0.092 (o)

Analysis of Variance - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/19/2023, 4:09 PM

<u>Constituent</u>	<u>Well</u>	<u>Calc.</u>	<u>Crit.</u>	<u>Sig.</u>	<u>Alpha</u>	<u>Bg. Wells</u>	<u>Transform</u>	<u>ANOVA Sig</u>	<u>Calc.</u>	<u>Tab.</u>	<u>Alpha</u>	<u>Method</u>
Boron (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	6.622	3.841	0.05	NP (normality)
Calcium (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	21.1	3.841	0.05	NP (normality)
Chloride (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	4311	4.072	0.05	Param.
Fluoride (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	30.93	3.841	0.05	NP (normality)
pH, Field (pH units)	n/a	n/a	n/a	n/a	n/a	n/a	x^(1/3)	Yes	209.8	4.056	0.05	Param.
Sulfate (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	32.27	3.841	0.05	NP (normality)
Total Dissolved Solids (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	No	0.3267	4.056	0.05	Param.

Upper Tolerance Limits - Appendix III

CGYP Client: Santee Cooper Data: CGYP Printed 2/23/2023, 2:43 PM

<u>Constituent</u>	<u>Well</u>	<u>Upper Lim.</u>	<u>Bq N</u>	<u>Bq Mean</u>	<u>Std. Dev.</u>	<u>%NDs</u>	<u>ND Adj.</u>	<u>Transform</u>	<u>Alpha</u>	<u>Method</u>
Boron (mg/L)	n/a	0.049	41	n/a	n/a	26.83	n/a	n/a	0.1221	NP Inter(normality)
Calcium (mg/L)	n/a	39.3	43	21.94	7.437	0	None	No	0.01	Inter
Chloride (mg/L)	n/a	13.5	44	n/a	n/a	0	n/a	n/a	0.1047	NP Inter(normality)
Fluoride (mg/L)	n/a	0.3	40	n/a	n/a	52.5	n/a	n/a	0.1285	NP Inter(normality)
pH, Field (pH units)	n/a	5.58	48	n/a	n/a	0	n/a	n/a	0.3006	NP Inter(normality)
Sulfate (mg/L)	n/a	115	44	n/a	n/a	0	n/a	n/a	0.1047	NP Inter(normality)

Confidence Intervals Summary Table Appendix III - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/22/2023, 3:11 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig. N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	11.42	8.362	0.049	Yes 15	9.889	2.254	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-2	1.817	1.094	0.049	Yes 15	1.455	0.5331	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-3	21.52	16.48	0.049	Yes 15	19	3.721	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-4	8.003	5.925	0.049	Yes 10	6.964	1.164	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-6	7.054	5.888	0.049	Yes 10	6.471	0.6537	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-1	278.7	212.1	39.3	Yes 15	245.4	49.18	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-2	295.6	255.3	39.3	Yes 15	275.5	29.78	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-3	664.4	525.4	39.3	Yes 15	594.9	102.6	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-4	341.1	267.9	39.3	Yes 10	304.5	41.04	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-6	469.1	393.7	39.3	Yes 10	431.4	42.23	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-1	734.5	663.6	13.5	Yes 15	699.1	52.27	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-2	139.5	83.33	13.5	Yes 15	111.4	41.44	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-3	1238	977.5	13.5	Yes 15	1108	192.3	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-4	664.3	501.7	13.5	Yes 10	583	91.11	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-6	1111	941.7	13.5	Yes 10	1026	94.91	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.174	0.7689	0.3	Yes 15	0.9713	0.2987	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.04	0.4444	0.3	Yes 15	0.742	0.4392	13.33	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.259	1.023	0.3	Yes 15	2.141	1.65	6.667	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.407	0.9649	0.3	Yes 10	1.686	0.8082	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9802	0.5078	0.3	Yes 10	0.744	0.2647	0	None	No	0.01	Param.
pH, Field (pH units)	CGYP-2	3.933	3.733	5.58	Yes 15	3.833	0.1302	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-3	3.86	3.586	5.58	Yes 15	3.723	0.1781	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-4	3.858	3.6	5.58	Yes 10	3.729	0.1253	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-6	3.8	3.544	5.58	Yes 10	3.672	0.1245	0	None	No	0.005	Param.
Sulfate (mg/L)	CGYP-1	506.5	387.3	115	Yes 15	446.9	87.96	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-2	968.5	902.7	115	Yes 15	935.6	48.54	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-3	990.7	937.9	115	Yes 15	964.3	38.94	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-4	622.8	582	115	Yes 10	602.4	22.85	0	None	No	0.01	Param.

Confidence Intervals Summary Table Appendix III - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/22/2023, 3:11 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig. N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	11.42	8.362	0.049	Yes 15	9.889	2.254	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-2	1.817	1.094	0.049	Yes 15	1.455	0.5331	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-3	21.52	16.48	0.049	Yes 15	19	3.721	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-4	8.003	5.925	0.049	Yes 10	6.964	1.164	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-6	7.054	5.888	0.049	Yes 10	6.471	0.6537	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-1	278.7	212.1	39.3	Yes 15	245.4	49.18	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-2	295.6	255.3	39.3	Yes 15	275.5	29.78	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-3	664.4	525.4	39.3	Yes 15	594.9	102.6	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-4	341.1	267.9	39.3	Yes 10	304.5	41.04	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-6	469.1	393.7	39.3	Yes 10	431.4	42.23	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-1	734.5	663.6	13.5	Yes 15	699.1	52.27	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-2	139.5	83.33	13.5	Yes 15	111.4	41.44	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-3	1238	977.5	13.5	Yes 15	1108	192.3	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-4	664.3	501.7	13.5	Yes 10	583	91.11	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-6	1111	941.7	13.5	Yes 10	1026	94.91	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.174	0.7689	0.3	Yes 15	0.9713	0.2987	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.04	0.4444	0.3	Yes 15	0.742	0.4392	13.33	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.259	1.023	0.3	Yes 15	2.141	1.65	6.667	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.407	0.9649	0.3	Yes 10	1.686	0.8082	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9802	0.5078	0.3	Yes 10	0.744	0.2647	0	None	No	0.01	Param.
pH, Field (pH units)	CGYP-1	4.22	3.888	5.58	No 15	4.054	0.2163	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-2	3.933	3.733	5.58	Yes 15	3.833	0.1302	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-3	3.86	3.586	5.58	Yes 15	3.723	0.1781	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-4	3.858	3.6	5.58	Yes 10	3.729	0.1253	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-6	3.8	3.544	5.58	Yes 10	3.672	0.1245	0	None	No	0.005	Param.
Sulfate (mg/L)	CGYP-1	506.5	387.3	115	Yes 15	446.9	87.96	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-2	968.5	902.7	115	Yes 15	935.6	48.54	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-3	990.7	937.9	115	Yes 15	964.3	38.94	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-4	622.8	582	115	Yes 10	602.4	22.85	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-6	106.6	77.87	115	No 10	92.24	16.1	0	None	No	0.01	Param.

Trend Test Summary (Upgradient Wells) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/22/2023, 2:57 PM

<u>Constituent</u>	<u>Well</u>	<u>Slope</u>	<u>Calc.</u>	<u>Critical</u>	<u>Sig.</u>	<u>N</u>	<u>%NDs</u>	<u>Normality</u>	<u>Xform</u>	<u>Alpha</u>	<u>Method</u>
Calcium (mg/L)	PM-1 (bg)	-1.217	-98	-92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1229	96	92	Yes	22	0	n/a	n/a	0.01	NP
Cobalt (mg/L)	CBW-1 (bg)	-0.00009462	-125	-81	Yes	20	5	n/a	n/a	0.01	NP
Cobalt (mg/L)	PM-1 (bg)	0.00002592	86	81	Yes	20	5	n/a	n/a	0.01	NP
Combined Radium 226 & 228 (pci/l)	PM-1 (bg)	-0.2743	-72	-68	Yes	18	33.33	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02097	-132	-81	Yes	20	5	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.329	-110	-92	Yes	22	0	n/a	n/a	0.01	NP

Trend Test Summary (Upgradient Wells) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/22/2023, 2:57 PM

Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Antimony (mg/L)	CBW-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Antimony (mg/L)	PM-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Arsenic (mg/L)	CBW-1 (bg)	0	-50	-81	No	20	85	n/a	n/a	0.01	NP
Arsenic (mg/L)	PM-1 (bg)	0	-37	-81	No	20	90	n/a	n/a	0.01	NP
Barium (mg/L)	CBW-1 (bg)	-0.000399	-45	-81	No	20	0	n/a	n/a	0.01	NP
Barium (mg/L)	PM-1 (bg)	-0.0003559	-24	-81	No	20	0	n/a	n/a	0.01	NP
Beryllium (mg/L)	CBW-1 (bg)	0	-18	-74	No	19	94.74	n/a	n/a	0.01	NP
Beryllium (mg/L)	PM-1 (bg)	0	0	81	No	20	100	n/a	n/a	0.01	NP
Boron (mg/L)	CBW-1 (bg)	-0.001121	-87	-87	No	21	9.524	n/a	n/a	0.01	NP
Boron (mg/L)	PM-1 (bg)	0	-21	-81	No	20	45	n/a	n/a	0.01	NP
Cadmium (mg/L)	CBW-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Cadmium (mg/L)	PM-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Calcium (mg/L)	CBW-1 (bg)	0.3443	41	87	No	21	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-1.217	-98	-92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1229	96	92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	PM-1 (bg)	0	-16	-92	No	22	0	n/a	n/a	0.01	NP
Chromium (mg/L)	CBW-1 (bg)	0	-18	-74	No	19	94.74	n/a	n/a	0.01	NP
Chromium (mg/L)	PM-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Cobalt (mg/L)	CBW-1 (bg)	-0.00009462	-125	-81	Yes	20	5	n/a	n/a	0.01	NP
Cobalt (mg/L)	PM-1 (bg)	0.00002592	86	81	Yes	20	5	n/a	n/a	0.01	NP
Combined Radium 226 & 228 (pci/l)	CBW-1 (bg)	-0.4294	-72	-74	No	19	36.84	n/a	n/a	0.01	NP
Combined Radium 226 & 228 (pci/l)	PM-1 (bg)	-0.2743	-72	-68	Yes	18	33.33	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02097	-132	-81	Yes	20	5	n/a	n/a	0.01	NP
Fluoride (mg/L)	PM-1 (bg)	0	0	81	No	20	100	n/a	n/a	0.01	NP
Lead (mg/L)	CBW-1 (bg)	-0.0001122	-64	-81	No	20	5	n/a	n/a	0.01	NP
Lead (mg/L)	PM-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Lithium (mg/L)	CBW-1 (bg)	0	-15	-81	No	20	95	n/a	n/a	0.01	NP
Lithium (mg/L)	PM-1 (bg)	0	-33	-81	No	20	90	n/a	n/a	0.01	NP
Mercury (mg/L)	CBW-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Mercury (mg/L)	PM-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Molybdenum (mg/L)	CBW-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Molybdenum (mg/L)	PM-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
pH, Field (pH units)	CBW-1 (bg)	0	8	92	No	22	0	n/a	n/a	0.01	NP
pH, Field (pH units)	PM-1 (bg)	0.00185	8	118	No	26	0	n/a	n/a	0.01	NP
Selenium (mg/L)	CBW-1 (bg)	0	0	81	No	20	100	n/a	n/a	0.01	NP
Selenium (mg/L)	PM-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Sulfate (mg/L)	CBW-1 (bg)	0	0	92	No	22	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.329	-110	-92	Yes	22	0	n/a	n/a	0.01	NP
Thallium (mg/L)	CBW-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Thallium (mg/L)	PM-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CBW-1 (bg)	1.733	19	92	No	22	4.545	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	PM-1 (bg)	-3.385	-51	-118	No	26	3.846	n/a	n/a	0.01	NP

Interwell Prediction Limit Summary (June 2022) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:52 PM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bq N	Bq Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	6/21/2022	4.2	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	6/21/2022	0.57	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	6/21/2022	9.9	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	6/21/2022	4.3	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	6/21/2022	6.1	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.37	n/a	6/21/2022	200	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.37	n/a	6/21/2022	240	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.37	n/a	6/21/2022	460	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.37	n/a	6/21/2022	270	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.37	n/a	6/21/2022	430	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	6/21/2022	686	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	6/21/2022	66.4	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	6/21/2022	841	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	6/21/2022	445	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	6/21/2022	1070	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	6/21/2022	0.91	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	6/21/2022	0.93	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	6/21/2022	1.94	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	6/21/2022	1.56	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	6/21/2022	0.93	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	6/21/2022	4.01	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	6/21/2022	3.87	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	6/21/2022	3.89	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	6/21/2022	3.82	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	6/21/2022	359	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	6/21/2022	881	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	6/21/2022	966	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	6/21/2022	576	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	203.8	n/a	6/21/2022	1771	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	203.8	n/a	6/21/2022	1408	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	203.8	n/a	6/21/2022	2952	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	203.8	n/a	6/21/2022	1676	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	203.8	n/a	6/21/2022	3210	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2

Interwell Prediction Limit Summary (June 2022) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:52 PM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bq N	Bq Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	6/21/2022	4.2	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	6/21/2022	0.57	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	6/21/2022	9.9	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	6/21/2022	4.3	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	6/21/2022	6.1	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.37	n/a	6/21/2022	200	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.37	n/a	6/21/2022	240	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.37	n/a	6/21/2022	460	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.37	n/a	6/21/2022	270	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.37	n/a	6/21/2022	430	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	6/21/2022	686	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	6/21/2022	66.4	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	6/21/2022	841	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	6/21/2022	445	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	6/21/2022	1070	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	6/21/2022	0.91	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	6/21/2022	0.93	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	6/21/2022	1.94	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	6/21/2022	1.56	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	6/21/2022	0.93	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	6/21/2022	4.28	No	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	6/21/2022	4.01	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	6/21/2022	3.87	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	6/21/2022	3.89	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	6/21/2022	3.82	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	6/21/2022	359	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	6/21/2022	881	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	6/21/2022	966	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	6/21/2022	576	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	6/21/2022	106	No	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	203.8	n/a	6/21/2022	1771	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	203.8	n/a	6/21/2022	1408	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	203.8	n/a	6/21/2022	2952	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	203.8	n/a	6/21/2022	1676	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	203.8	n/a	6/21/2022	3210	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2

Interwell Prediction Limit Summary (October 2022) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:50 PM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bq N	Bq Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	10/26/2022	12.6	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	10/25/2022	1.14	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	10/25/2022	16.6	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	10/25/2022	6.13	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	10/25/2022	5.71	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.24	n/a	10/26/2022	193	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.24	n/a	10/25/2022	214	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.24	n/a	10/25/2022	415	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.24	n/a	10/25/2022	231	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.24	n/a	10/25/2022	370	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	10/26/2022	733	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	10/25/2022	57.3	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	10/25/2022	842	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	10/25/2022	495	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	10/25/2022	896	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	10/26/2022	0.53	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	10/25/2022	0.42	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	10/25/2022	1.06	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	10/25/2022	0.99	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	10/25/2022	0.49	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	10/26/2022	4.01	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	10/25/2022	3.8	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	10/25/2022	3.56	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	10/25/2022	3.69	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	10/25/2022	3.56	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	10/26/2022	458	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	10/25/2022	914	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	10/25/2022	885	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	10/25/2022	652	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	201.6	n/a	10/26/2022	1894	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	201.6	n/a	10/25/2022	1454	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	201.6	n/a	10/25/2022	2835	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	201.6	n/a	10/25/2022	1585	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	201.6	n/a	10/25/2022	2902	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2

Interwell Prediction Limit Summary (October 2022) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:50 PM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bq N	Bq Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	10/26/2022	12.6	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	10/25/2022	1.14	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	10/25/2022	16.6	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	10/25/2022	6.13	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	10/25/2022	5.71	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.24	n/a	10/26/2022	193	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.24	n/a	10/25/2022	214	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.24	n/a	10/25/2022	415	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.24	n/a	10/25/2022	231	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.24	n/a	10/25/2022	370	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	10/26/2022	733	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	10/25/2022	57.3	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	10/25/2022	842	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	10/25/2022	495	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	10/25/2022	896	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	10/26/2022	0.53	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	10/25/2022	0.42	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	10/25/2022	1.06	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	10/25/2022	0.99	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	10/25/2022	0.49	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	10/26/2022	4.01	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	10/25/2022	3.8	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	10/25/2022	3.56	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	10/25/2022	3.69	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	10/25/2022	3.56	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	10/26/2022	458	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	10/25/2022	914	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	10/25/2022	885	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	10/25/2022	652	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	10/25/2022	89.3	No	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	201.6	n/a	10/26/2022	1894	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	201.6	n/a	10/25/2022	1454	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	201.6	n/a	10/25/2022	2835	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	201.6	n/a	10/25/2022	1585	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	201.6	n/a	10/25/2022	2902	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2

Trend Test Summary (Prediction Limit Exceedances) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:55 PM

<u>Constituent</u>	<u>Well</u>	<u>Slope</u>	<u>Calc.</u>	<u>Critical</u>	<u>Sig.</u>	<u>N</u>	<u>%NDs</u>	<u>Normality</u>	<u>Xform</u>	<u>Alpha</u>	<u>Method</u>
Calcium (mg/L)	PM-1 (bg)	-1.217	-98	-92	Yes	22	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-38.05	-80	-53	Yes	15	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-76.66	-35	-30	Yes	10	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1229	96	92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-236	-43	-30	Yes	10	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02097	-132	-81	Yes	20	5	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-4	-1.419	-33	-30	Yes	10	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.329	-110	-92	Yes	22	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-416.4	-32	-30	Yes	10	0	n/a	n/a	0.01	NP

Trend Test Summary (Prediction Limit Exceedances) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:55 PM

Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CBW-1 (bg)	-0.001121	-87	-87	No	21	9.524	n/a	n/a	0.01	NP
Boron (mg/L)	PM-1 (bg)	0	-21	-81	No	20	45	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-1	0.7087	12	53	No	15	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-2	-0.6201	-51	-53	No	15	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-3	-0.9248	-25	-53	No	15	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-4	-1.747	-28	-30	No	10	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-6	-0.9202	-27	-30	No	10	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CBW-1 (bg)	0.3443	41	87	No	21	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-1.217	-98	-92	Yes	22	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-1	-16.64	-20	-53	No	15	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-38.05	-80	-53	Yes	15	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-3	-65.51	-43	-53	No	15	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-76.66	-35	-30	Yes	10	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-6	-70.94	-27	-30	No	10	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1229	96	92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	PM-1 (bg)	0	-16	-92	No	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-1	37.17	51	53	No	15	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-2	-37.6	-39	-53	No	15	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-3	-94.55	-25	-53	No	15	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-236	-43	-30	Yes	10	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-6	-153.2	-26	-30	No	10	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02097	-132	-81	Yes	20	5	n/a	n/a	0.01	NP
Fluoride (mg/L)	PM-1 (bg)	0	0	81	No	20	100	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-1	0.09837	10	53	No	15	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-2	0	1	53	No	15	13.33	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-3	0.09419	7	53	No	15	6.667	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-4	-1.419	-33	-30	Yes	10	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-6	-0.3934	-23	-30	No	10	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CBW-1 (bg)	0	8	92	No	22	0	n/a	n/a	0.01	NP
pH, Field (pH units)	PM-1 (bg)	0.00185	8	118	No	26	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-2	0.04674	15	53	No	15	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-3	-0.07374	-19	-53	No	15	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-4	0.009035	4	30	No	10	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-6	0	0	30	No	10	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CBW-1 (bg)	0	0	92	No	22	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.329	-110	-92	Yes	22	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-1	-0.9542	-1	-53	No	15	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-2	-2.202	-2	-53	No	15	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-3	10.25	15	53	No	15	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-4	-19.88	-5	-30	No	10	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CBW-1 (bg)	1.733	19	92	No	22	4.545	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	PM-1 (bg)	-3.385	-51	-118	No	26	3.846	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-1	43.97	11	53	No	15	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-2	-53.84	-32	-53	No	15	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-3	-338.9	-35	-53	No	15	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-416.4	-32	-30	Yes	10	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-6	-750.3	-11	-30	No	10	0	n/a	n/a	0.01	NP

CYGP GWPS				
Constituent Name	MCL	CCR-Rule Specified	Background Limit	GWPS
Antimony, Total (mg/L)	0.006		0.025	0.025
Arsenic, Total (mg/L)	0.01		0.016	0.016
Barium, Total (mg/L)	2		0.103	2
Beryllium, Total (mg/L)	0.004		0.00063	0.004
Cadmium, Total (mg/L)	0.005		0.0005	0.005
Chromium, Total (mg/L)	0.1		0.014	0.1
Cobalt, Total (mg/L)		0.006	0.0034	0.006
Combined Radium 226 + 228 (pCi/L)	5		16.3	16.3
Fluoride, Total (mg/L)	4		0.3	4
Lead, Total (mg/L)		0.015	0.011	0.015
Lithium, Total (mg/L)		0.04	0.01	0.04
Mercury, Total (mg/L)	0.002		0.0006	0.002
Molybdenum, Total (mg/L)		0.1	0.01	0.1
Selenium, Total (mg/L)	0.05		0.02	0.05
Thallium, Total (mg/L)	0.002		0.001	0.002

*GWPS = Groundwater Protection Standard

*MCL = Maximum Contaminant Limit

*CCR = Coal Combustion Residuals

Shaded cells indicate background limit is higher than established MCL.

Confidence Intervals Summary Table Appendix IV - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 3/9/2023, 9:51 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig. N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Beryllium (mg/L)	CGYP-1	0.01039	0.006372	0.004	Yes 14	0.008379	0.002833	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03776	0.02535	0.004	Yes 14	0.03155	0.00876	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01731	0.01461	0.004	Yes 10	0.01596	0.001515	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02495	0.01981	0.004	Yes 10	0.02238	0.002883	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.04987	0.03188	0.006	Yes 14	0.04087	0.0127	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.02946	0.0161	0.006	Yes 14	0.0232	0.009849	0	None	sqrt(x)	0.01	Param.
Cobalt (mg/L)	CGYP-3	0.1346	0.08616	0.006	Yes 14	0.1104	0.03418	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.05135	0.03418	0.006	Yes 10	0.04224	0.01147	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1571	0.1258	0.006	Yes 10	0.1415	0.01754	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-2	0.02493	0.01896	0.015	Yes 14	0.02149	0.005549	7.143	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.02959	0.02041	0.015	Yes 13	0.025	0.006168	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-3	0.0972	0.06185	0.04	Yes 14	0.07953	0.02496	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06485	0.05031	0.04	Yes 10	0.05758	0.008143	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1378	0.1112	0.04	Yes 10	0.1245	0.01495	0	None	No	0.01	Param.

Confidence Intervals Summary Table Appendix IV - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 3/9/2023, 9:52 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig. N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Antimony (mg/L)	CGYP-1	0.005	0.005	0.025	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Antimony (mg/L)	CGYP-2	0.005	0.005	0.025	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Antimony (mg/L)	CGYP-3	0.005	0.005	0.025	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Antimony (mg/L)	CGYP-4	0.005	0.005	0.025	No 10	0.005	0	100	None	No	0.011	NP (NDs)
Antimony (mg/L)	CGYP-6	0.005	0.005	0.025	No 10	0.005	0	100	None	No	0.011	NP (NDs)
Arsenic (mg/L)	CGYP-1	0.03333	0.01416	0.016	No 14	0.02374	0.01353	7.143	None	No	0.01	Param.
Arsenic (mg/L)	CGYP-2	0.02233	0.01446	0.016	No 14	0.0174	0.007413	14.29	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-3	0.01935	0.01375	0.016	No 14	0.01613	0.004832	7.143	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-4	0.01152	0.008114	0.016	No 10	0.00951	0.002739	10	None	x^3	0.01	Param.
Arsenic (mg/L)	CGYP-6	0.003	0.003	0.016	No 10	0.003	0	100	None	No	0.011	NP (NDs)
Barium (mg/L)	CGYP-1	0.05743	0.03665	2	No 14	0.04754	0.01544	0	None	sqrt(x)	0.01	Param.
Barium (mg/L)	CGYP-2	0.035	0.01756	2	No 14	0.02628	0.01231	7.143	None	No	0.01	Param.
Barium (mg/L)	CGYP-3	0.05154	0.03457	2	No 14	0.04306	0.01198	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-4	0.04043	0.02705	2	No 10	0.03374	0.007493	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-6	0.6721	0.3327	2	No 10	0.5024	0.1902	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-1	0.01039	0.006372	0.004	Yes 14	0.008379	0.002833	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-2	0.004388	0.003019	0.004	No 14	0.003771	0.001159	0	None	ln(x)	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03776	0.02535	0.004	Yes 14	0.03155	0.00876	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01731	0.01461	0.004	Yes 10	0.01596	0.001515	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02495	0.01981	0.004	Yes 10	0.02238	0.002883	0	None	No	0.01	Param.
Cadmium (mg/L)	CGYP-1	0.004	0.0022	0.005	No 14	0.003871	0.0004811	92.86	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-2	0.004	0.0014	0.005	No 14	0.003814	0.0006949	92.86	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-3	0.004	0.00062	0.005	No 14	0.001974	0.0016	35.71	None	No	0.01	NP (normality)
Cadmium (mg/L)	CGYP-4	0.004	0.004	0.005	No 10	0.00368	0.001012	90	None	No	0.011	NP (NDs)
Cadmium (mg/L)	CGYP-6	0.004	0.004	0.005	No 10	0.00366	0.001075	90	None	No	0.011	NP (NDs)
Chromium (mg/L)	CGYP-1	0.005	0.005	0.1	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Chromium (mg/L)	CGYP-2	0.005	0.005	0.1	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Chromium (mg/L)	CGYP-3	0.0067	0.005	0.1	No 14	0.006021	0.00117	21.43	None	No	0.01	NP (normality)
Chromium (mg/L)	CGYP-4	0.005	0.005	0.1	No 10	0.005	0	100	None	No	0.011	NP (NDs)
Chromium (mg/L)	CGYP-6	0.005	0.005	0.1	No 10	0.005	0	100	None	No	0.011	NP (NDs)
Cobalt (mg/L)	CGYP-1	0.04987	0.03188	0.006	Yes 14	0.04087	0.0127	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.02946	0.0161	0.006	Yes 14	0.0232	0.009849	0	None	sqrt(x)	0.01	Param.
Cobalt (mg/L)	CGYP-3	0.1346	0.08616	0.006	Yes 14	0.1104	0.03418	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.05135	0.03418	0.006	Yes 10	0.04224	0.01147	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1571	0.1258	0.006	Yes 10	0.1415	0.01754	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-1	4.615	3.144	16.3	No 14	3.909	1.115	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-2	3.339	1.869	16.3	No 14	2.604	1.038	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-3	6.489	4.698	16.3	No 14	5.594	1.264	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-4	5.715	3.889	16.3	No 10	4.802	1.024	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-6	7.663	4.259	16.3	No 10	5.961	1.907	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.174	0.7689	4	No 15	0.9713	0.2987	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.04	0.4444	4	No 15	0.742	0.4392	13.33	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.259	1.023	4	No 15	2.141	1.65	6.667	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.407	0.9649	4	No 10	1.686	0.8082	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9802	0.5078	4	No 10	0.744	0.2647	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-1	0.01788	0.007623	0.015	No 14	0.01321	0.008213	7.143	None	sqrt(x)	0.01	Param.
Lead (mg/L)	CGYP-2	0.02493	0.01896	0.015	Yes 14	0.02149	0.005549	7.143	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.02959	0.02041	0.015	Yes 13	0.025	0.006168	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-4	0.01469	0.01043	0.015	No 10	0.01243	0.002945	10	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-6	0.01456	0.006838	0.015	No 10	0.0107	0.004328	10	None	No	0.01	Param.
Lithium (mg/L)	CGYP-1	0.024	0.01	0.04	No 14	0.01673	0.006667	28.57	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-2	0.015	0.01	0.04	No 14	0.01271	0.002405	28.57	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-3	0.0972	0.06185	0.04	Yes 14	0.07953	0.02496	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06485	0.05031	0.04	Yes 10	0.05758	0.008143	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1378	0.1112	0.04	Yes 10	0.1245	0.01495	0	None	No	0.01	Param.

Confidence Intervals Summary Table Appendix IV - All Results Page 2


CGYP Client: Santee Cooper Data: CGYP Printed 3/9/2023, 9:52 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Mercury (mg/L)	CGYP-1	0.0002	0.0002	0.002	No	14	0.0002	1.4e-12	92.86	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-2	0.0002	0.0002	0.002	No	14	0.0002	0	100	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-3	0.00021	0.0002	0.002	No	14	0.0002221	0.00007181	78.57	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-4	0.0004	0.0004	0.002	No	10	0.0004	0	100	None	No	0.011	NP (NDs)
Mercury (mg/L)	CGYP-6	0.0002	0.0002	0.002	No	10	0.0002	0	100	None	No	0.011	NP (NDs)
Molybdenum (mg/L)	CGYP-1	0.005	0.005	0.1	No	14	0.005	0	100	None	No	0.01	NP (NDs)
Molybdenum (mg/L)	CGYP-2	0.005	0.005	0.1	No	14	0.005	0	100	None	No	0.01	NP (NDs)
Molybdenum (mg/L)	CGYP-3	0.005	0.005	0.1	No	14	0.005	0	100	None	No	0.01	NP (NDs)
Molybdenum (mg/L)	CGYP-4	0.005	0.005	0.1	No	10	0.005	0	100	None	No	0.011	NP (NDs)
Molybdenum (mg/L)	CGYP-6	0.005	0.005	0.1	No	10	0.005	0	100	None	No	0.011	NP (NDs)
Selenium (mg/L)	CGYP-1	0.026	0.01	0.05	No	14	0.01749	0.01179	57.14	None	No	0.01	NP (normality)
Selenium (mg/L)	CGYP-2	0.027	0.0078	0.05	No	14	0.01558	0.01223	71.43	None	No	0.01	NP (normality)
Selenium (mg/L)	CGYP-3	0.019	0.0067	0.05	No	14	0.01484	0.01192	78.57	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-4	0.05	0.01	0.05	No	10	0.01786	0.01695	90	None	No	0.011	NP (NDs)
Selenium (mg/L)	CGYP-6	0.05	0.01	0.05	No	10	0.01725	0.01742	100	None	No	0.011	NP (NDs)
Thallium (mg/L)	CGYP-1	0.001	0.001	0.002	No	14	0.001	0	100	None	No	0.01	NP (NDs)
Thallium (mg/L)	CGYP-2	0.001	0.001	0.002	No	14	0.001	0	100	None	No	0.01	NP (NDs)
Thallium (mg/L)	CGYP-3	0.001	0.001	0.002	No	14	0.001	0	100	None	No	0.01	NP (NDs)
Thallium (mg/L)	CGYP-4	0.001	0.001	0.002	No	10	0.001	0	100	None	No	0.011	NP (NDs)
Thallium (mg/L)	CGYP-6	0.001	0.001	0.002	No	10	0.001	0	100	None	No	0.011	NP (NDs)

FIGURE A.

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

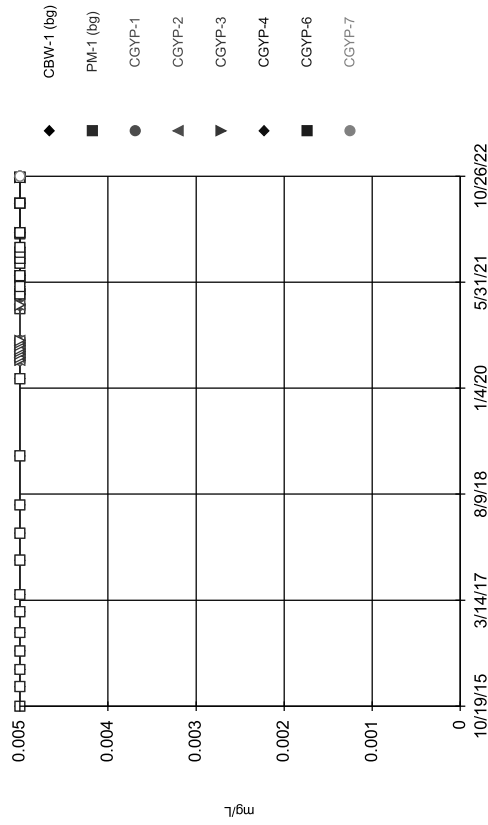

Constituent: Antimony Analysis Run 3/8/2023 11:45 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

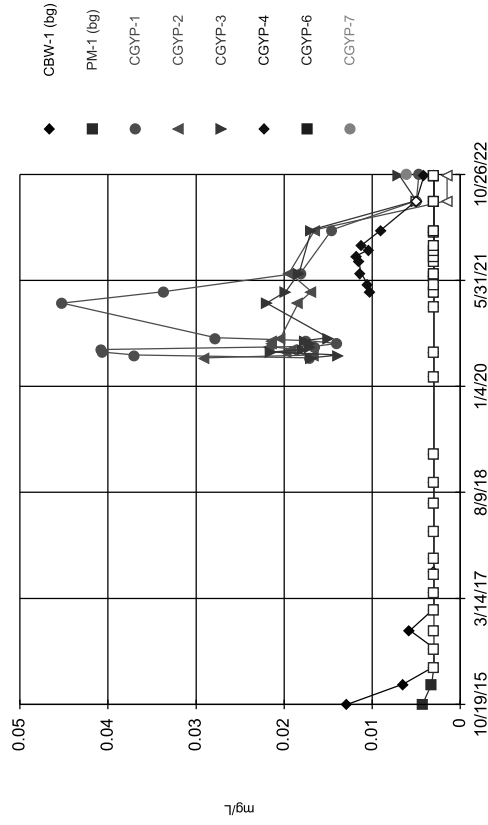

Constituent: Arsenic Analysis Run 3/8/2023 11:45 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

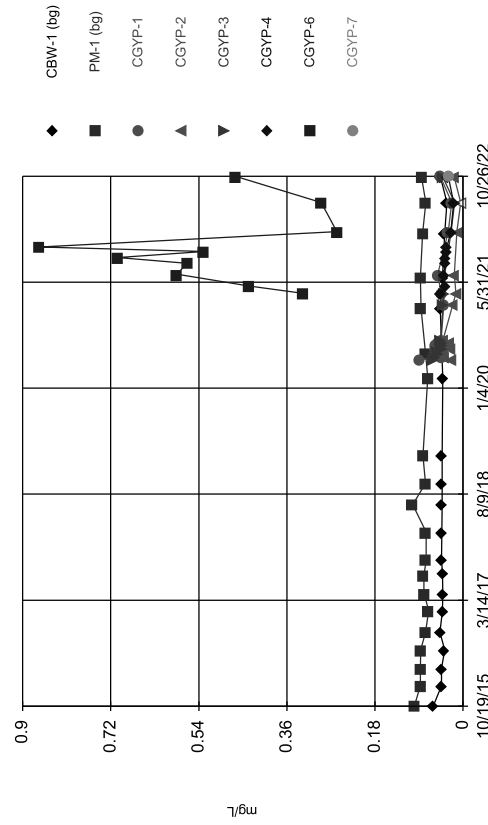

Constituent: Barium Analysis Run 3/8/2023 11:45 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP


Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

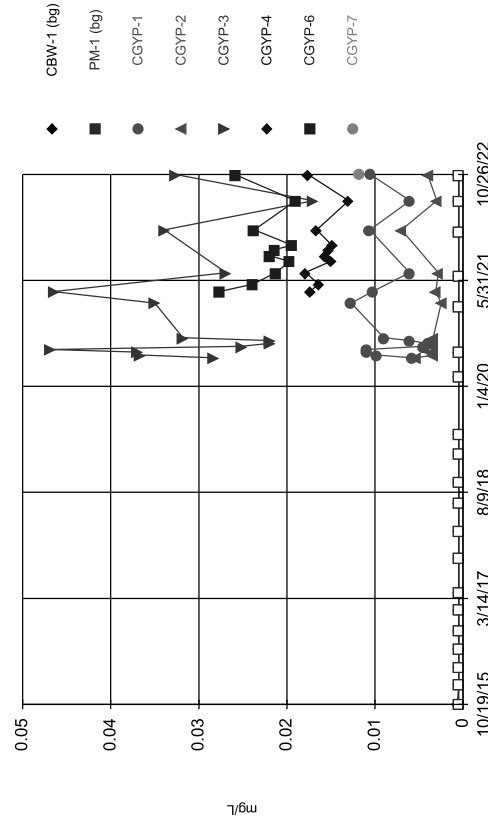


Constituent: Beryllium Analysis Run 3/8/2023 11:45 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP


Time Series

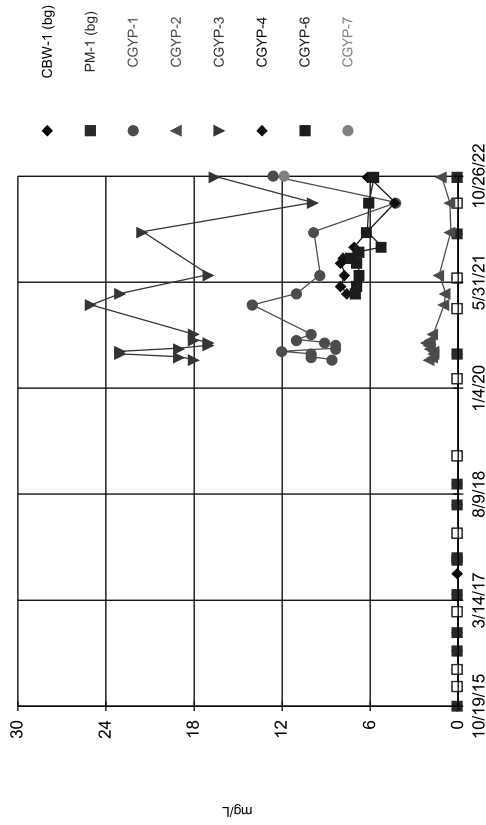


Time Series

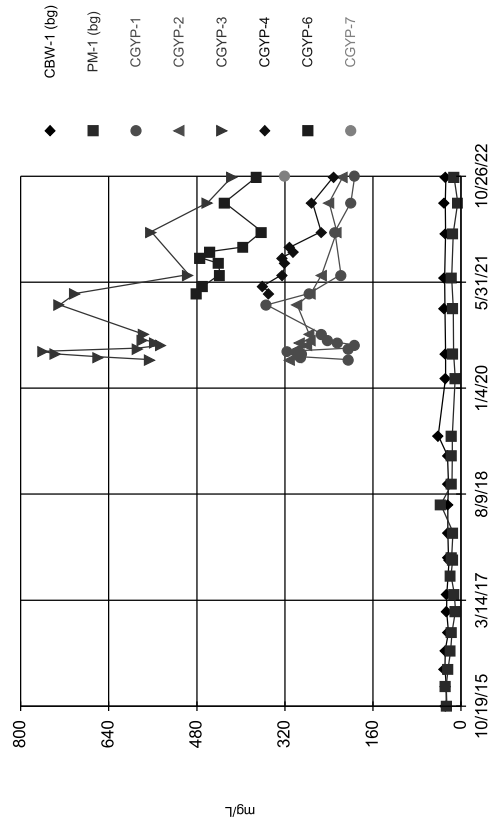

Time Series

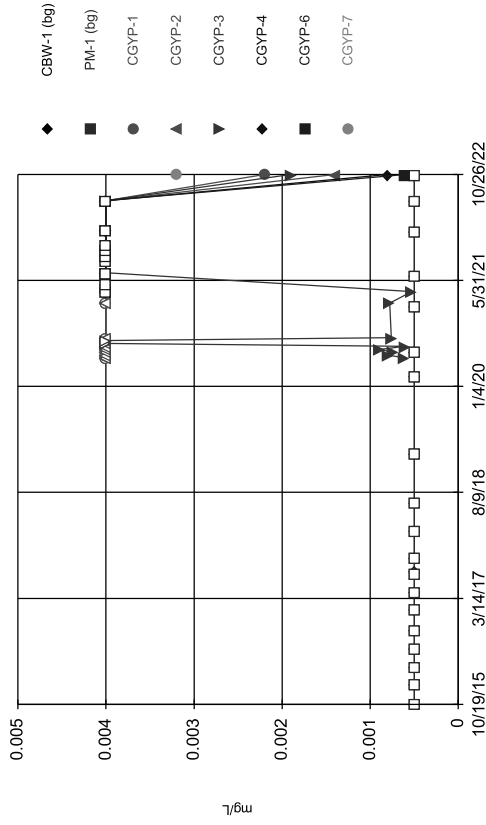


Time Series

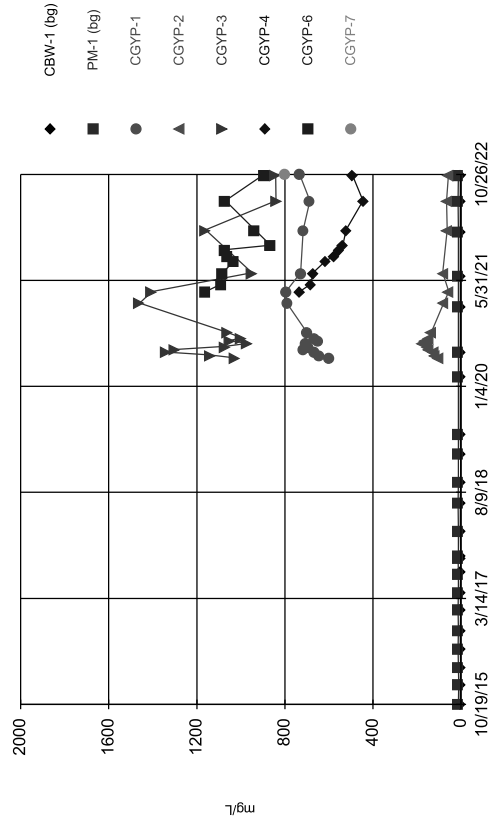


Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

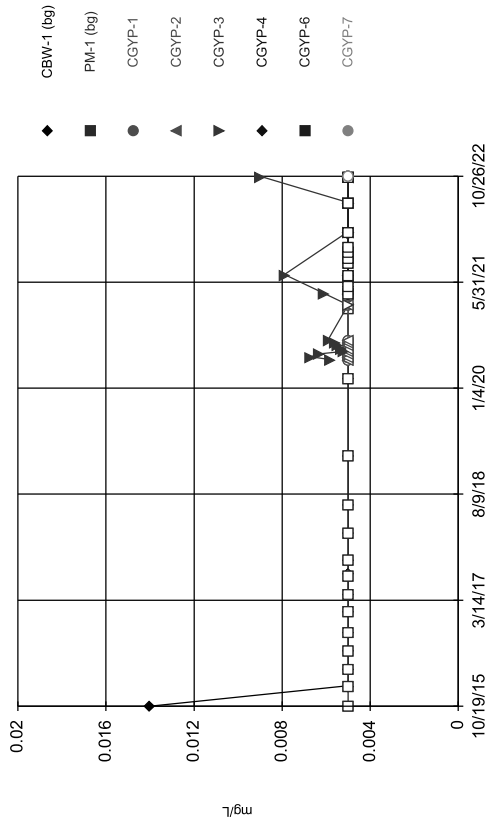


Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

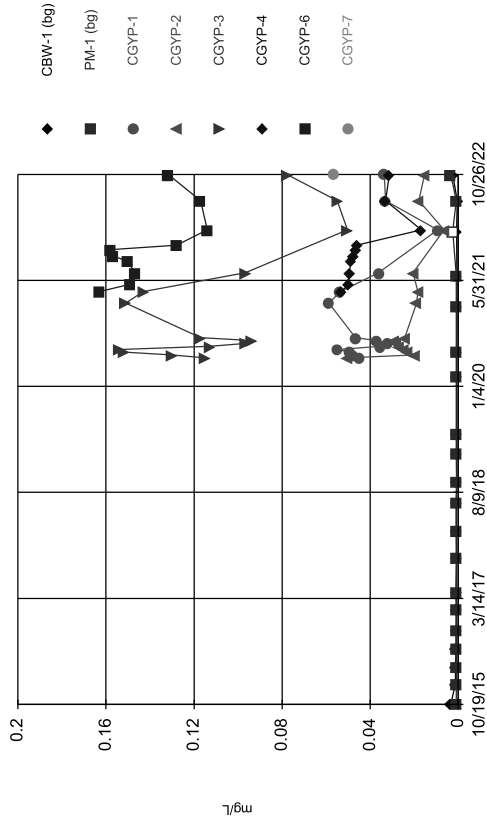


Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

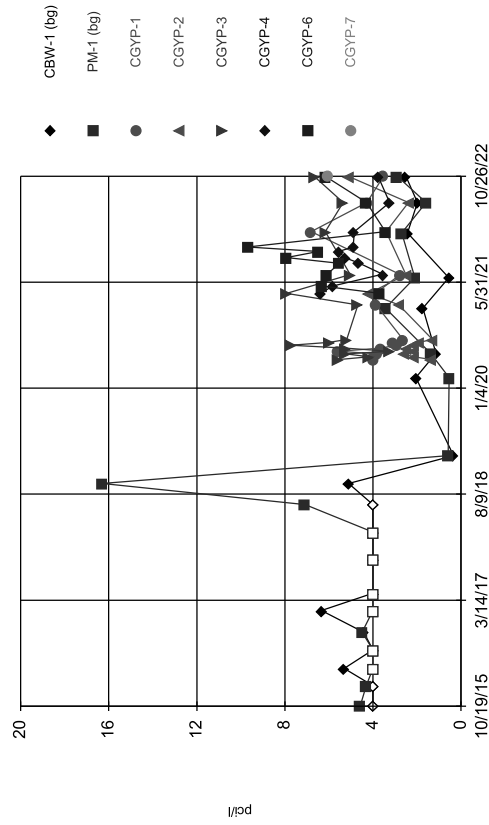


Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

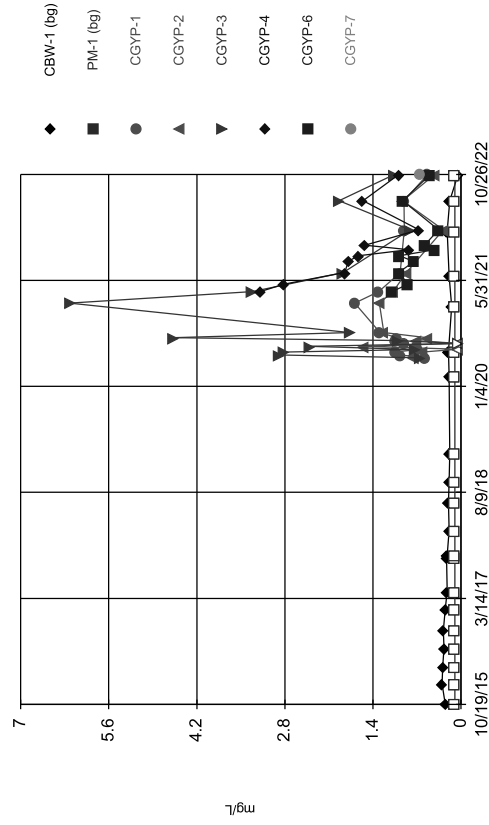

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

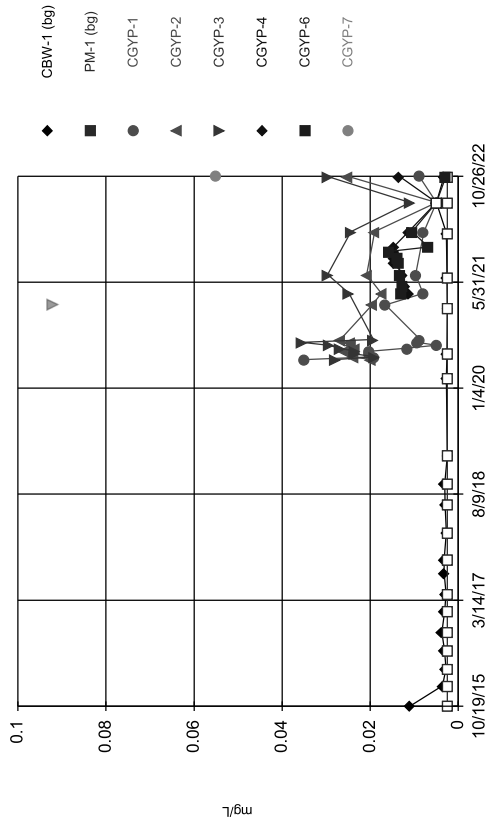

Constituent: Lithium Analysis Run 3/8/2023 11:45 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

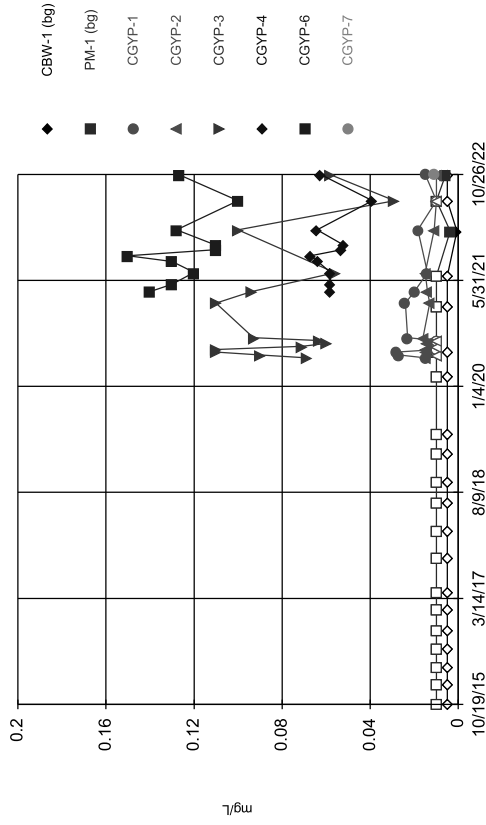

Constituent: Lithium Analysis Run 3/8/2023 11:45 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

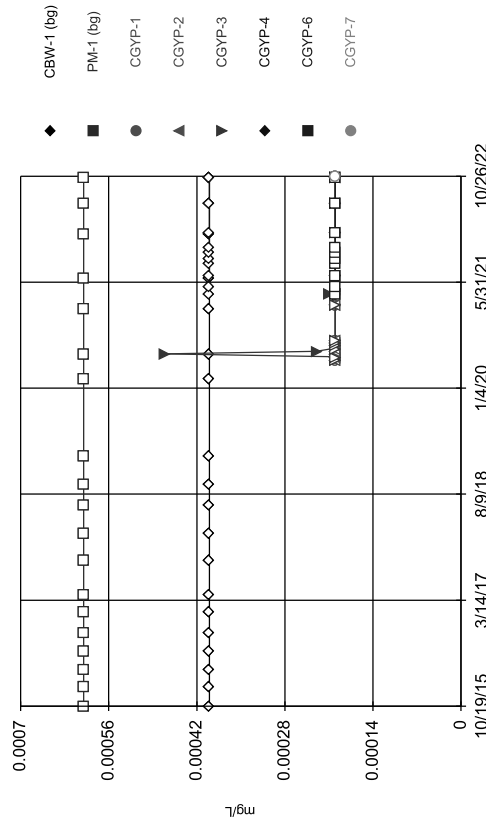

Constituent: Mercury Analysis Run 3/8/2023 11:45 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP


Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

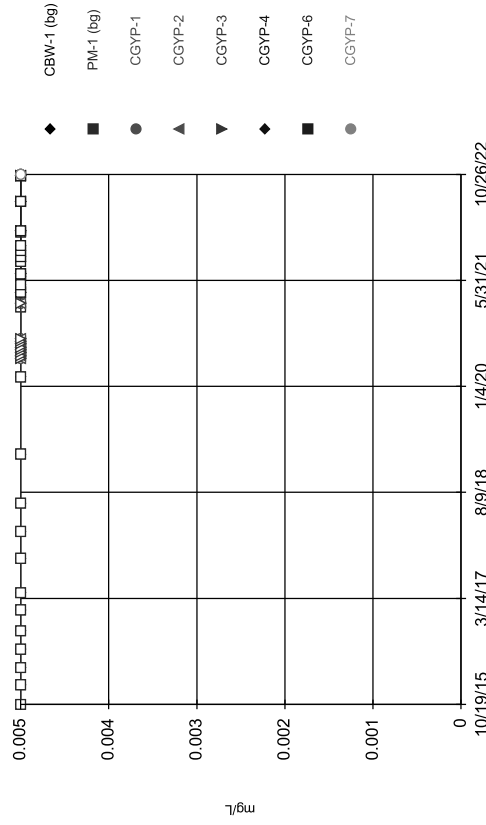


Constituent: Molybdenum Analysis Run 3/8/2023 11:45 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP


Time Series

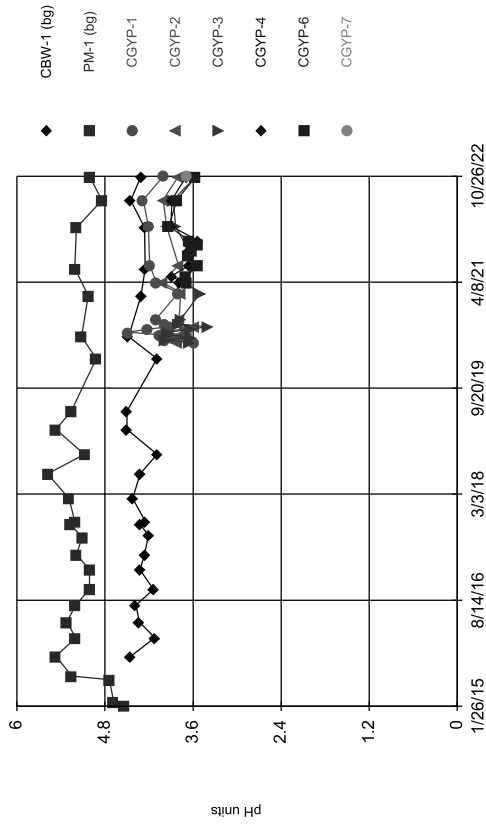


Time Series

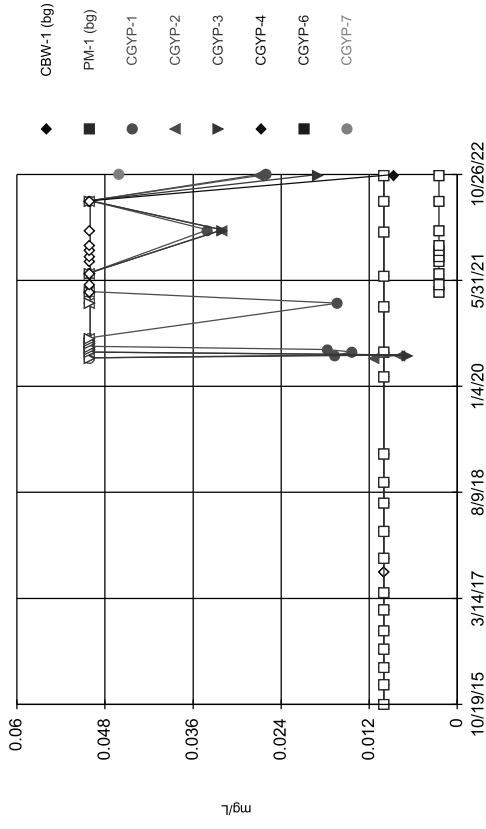


Time Series

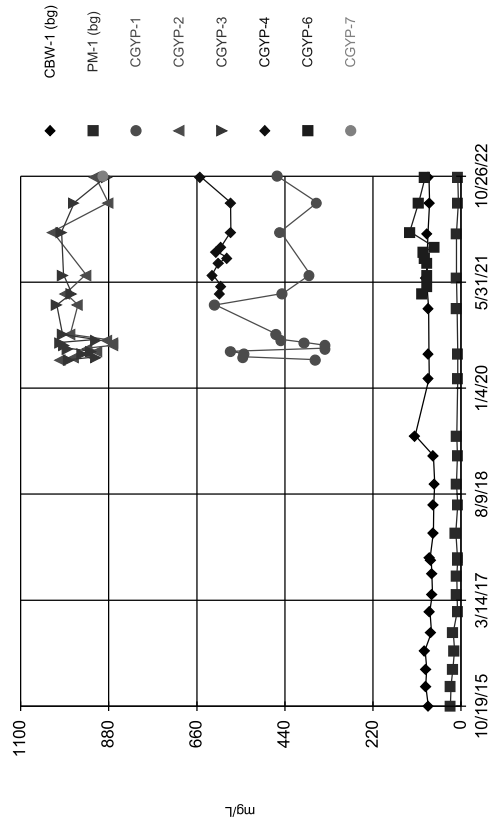

Time Series

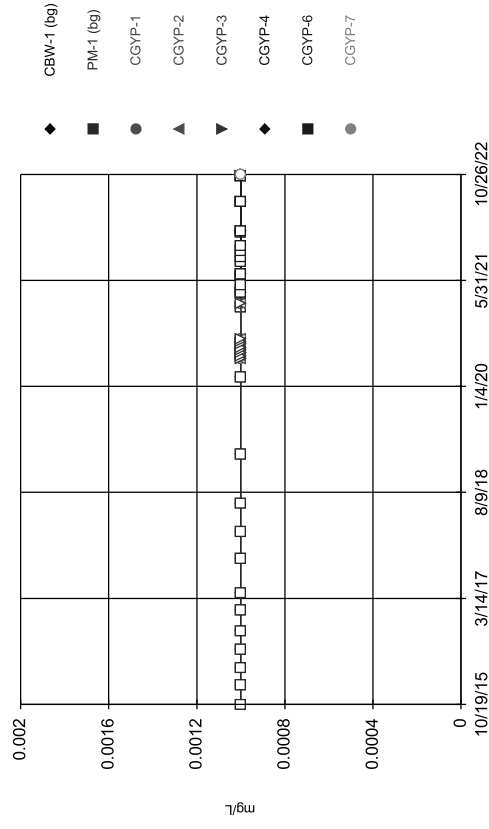

Time Series

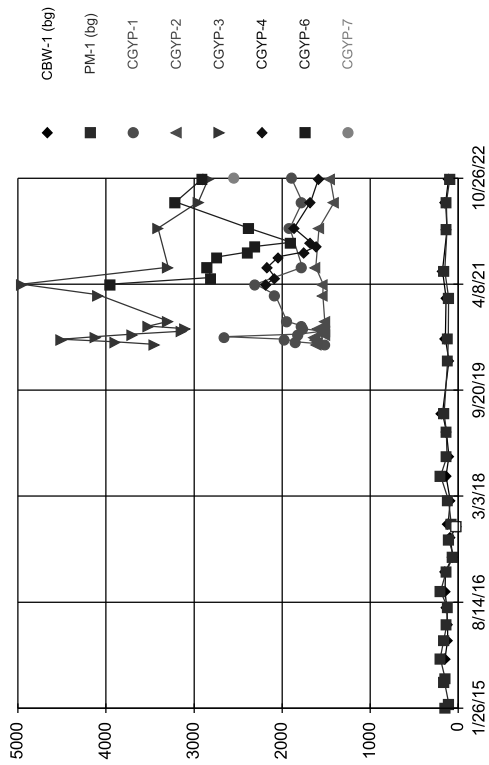

Constituent: Total Dissolved Solids Analysis Run 3/8/2023 11:45 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

Time Series

Constituent: Antimony (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	<0.005	<0.005						
1/26/2016	<0.005	<0.005						
4/19/2016	<0.005	<0.005						
7/18/2016	<0.005	<0.005						
10/11/2016	<0.005	<0.005						
1/23/2017	<0.005	<0.005						
4/17/2017	<0.005	<0.005						
9/25/2017	<0.005	<0.005						
2/7/2018	<0.005	<0.005						
6/20/2018	<0.005	<0.005						
2/12/2019	<0.005	<0.005						
2/24/2020	<0.005	<0.005						
5/21/2020			<0.005	<0.005	<0.005			
6/4/2020			<0.005	<0.005	<0.005			
6/18/2020			<0.005	<0.005	<0.005			
6/22/2020	<0.005	<0.005						
7/1/2020			<0.005		<0.005			
7/2/2020				<0.005				
7/16/2020			<0.005	<0.005	<0.005			
7/30/2020			<0.005	<0.005	<0.005			
8/13/2020			<0.005	<0.005	<0.005			
8/27/2020			<0.005	<0.005	<0.005			
1/26/2021	<0.005	<0.005						
2/10/2021			<0.005	<0.005	<0.005			
4/7/2021			<0.005	<0.005	<0.005	<0.005	<0.005	
5/13/2021						<0.005	<0.005	
6/21/2021	<0.005	<0.005						
7/7/2021			<0.005	<0.005	<0.005			
7/8/2021						<0.005	<0.005	
8/31/2021							<0.005	
9/1/2021						<0.005		
9/27/2021						<0.005	<0.005	
10/26/2021						<0.005	<0.005	
11/17/2021						<0.005	<0.005	
1/24/2022	<0.005	<0.005						
1/31/2022			<0.005 (D)	<0.005 (D)	<0.005 (D)	<0.005 (D)	<0.005 (D)	
6/20/2022	<0.005 (D)	<0.005 (D)						
6/21/2022			<0.005 (D)	<0.005 (D)	<0.005 (D)	<0.005 (D)	<0.005 (D)	
10/25/2022	<0.005	<0.005		<0.005	<0.005	<0.005	<0.005	
10/26/2022			<0.005					<0.005

Time Series

Constituent: Arsenic (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	0.01285 (D)	0.0043 (D)						
1/26/2016	0.00645 (D)	0.00325 (D)						
4/19/2016	<0.003 (D)	<0.003 (D)						
7/18/2016	<0.003 (D)	<0.003 (D)						
10/11/2016	0.005725 (D)	<0.003 (D)						
1/23/2017	<0.003 (D)	<0.003 (D)						
4/17/2017	<0.003 (D)	<0.003 (D)						
7/12/2017		<0.003 (D)						
7/25/2017	<0.003 (D)							
9/25/2017	<0.003 (D)	<0.003 (D)						
2/7/2018	<0.003 (D)	<0.003 (D)						
6/20/2018	<0.003 (D)	<0.003 (D)						
10/1/2018	<0.003	<0.003						
2/12/2019	<0.003	<0.003 (D)						
2/24/2020	<0.003 (D)	<0.003 (D)						
5/21/2020			0.0171	0.029	0.0169			
6/4/2020			0.037	0.0167	0.0138			
6/18/2020			0.0406	0.0197	0.0215			
6/22/2020	<0.003 (D)	<0.003 (D)						
7/1/2020			0.0407		0.0179			
7/2/2020				0.0191				
7/16/2020			0.0165	0.0217	0.017			
7/30/2020			0.014	0.0214	0.0171			
8/13/2020			0.0175	0.0214	0.0176			
8/27/2020			0.0278	0.0204	0.015			
1/26/2021	<0.003 (D)	<0.003 (D)						
2/10/2021			0.0452	0.0184	0.022			
4/7/2021			0.0336	0.0169	0.0198	0.0103	<0.003	
5/13/2021						0.0105	<0.003	
6/21/2021	<0.003 (D)	<0.003 (D)						
7/7/2021			0.0181	0.0194	0.0183			
7/8/2021						0.0113	<0.003	
8/31/2021							<0.003	
9/1/2021						0.0115		
9/27/2021						0.0118	<0.003	
10/26/2021						0.0104	<0.003	
11/17/2021						0.0112	<0.003	
1/24/2022	<0.003 (D)	<0.003 (D)						
1/31/2022			0.0146	0.0165	0.0169	0.009 (D)	<0.003 (D)	
6/20/2022	<0.003 (D)	<0.003 (D)						
6/21/2022			<0.01	<0.003	<0.01	<0.01	<0.003	
10/25/2022	<0.003	<0.003		<0.003	0.007	0.0041	<0.003	
10/26/2022			0.00472					0.006

Time Series

Constituent: Barium (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	0.061	0.1						
1/26/2016	0.044	0.087						
4/19/2016	0.0438	0.0875						
7/18/2016	0.0378	0.0868						
10/11/2016	0.0473	0.077						
1/23/2017	0.0421	0.0703						
4/17/2017	0.0418	0.0802						
7/12/2017		0.0803						
7/25/2017	0.0421							
9/25/2017	0.044	0.0753						
2/7/2018	0.0436	0.0756						
6/20/2018	0.043	0.103						
10/1/2018	0.0428	0.0769						
2/12/2019	0.0427	0.0817						
2/24/2020	0.0413	0.0725						
5/21/2020			0.0899	0.024	0.0621			
6/4/2020			0.0447	0.0378	0.0582			
6/18/2020			0.0403	0.0445	0.0502			
6/22/2020	0.0433	0.0766						
7/1/2020			0.0426		0.0547			
7/2/2020				0.0439				
7/16/2020			0.0574	0.0274	0.0444			
7/30/2020			0.0575	0.0316	0.0437			
8/13/2020			0.0517	0.0289	0.0431			
8/27/2020			0.0447	0.0407	0.0459			
1/26/2021	0.0466	0.0857						
2/10/2021			0.0397	0.021	0.0405			
4/7/2021			0.0448	0.0145	0.0384	0.0454	0.326	
5/13/2021						0.0375	0.437	
6/21/2021	0.0423	0.0873						
7/7/2021			0.0522	0.0178	0.0378			
7/8/2021						0.0395	0.585	
8/31/2021							0.564	
9/1/2021						0.0364		
9/27/2021						0.0371	0.705	
10/26/2021						0.0336	0.529	
11/17/2021						0.0333	0.865	
1/24/2022	0.0377	0.0826						
1/31/2022			0.0301	0.0125	0.0246	0.025	0.258	
6/20/2022	0.033	0.076						
6/21/2022			0.023	<0.01	0.017	0.019	0.29	
10/25/2022	0.0466	0.0851		0.0183	0.0422	0.0306	0.465	
10/26/2022			0.0469					0.0281

Time Series

Constituent: Beryllium (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	0.00063	<0.0005						
1/26/2016	<0.0005	<0.0005						
4/19/2016	<0.0005	<0.0005						
7/18/2016	<0.0005	<0.0005						
10/11/2016	<0.0005	<0.0005						
1/23/2017	<0.0005	<0.0005						
4/17/2017	<0.0005	<0.0005						
9/25/2017	<0.0005	<0.0005						
2/7/2018	<0.0005	<0.0005						
6/20/2018	<0.0005	<0.0005						
10/1/2018	<0.0005	<0.0005						
2/12/2019		<0.0005						
5/20/2019	<0.0005 (D)	<0.0005 (D)						
2/24/2020	<0.0005	<0.0005						
5/21/2020			0.0058	0.0053	0.0283			
6/4/2020			0.0098	0.0034	0.0367			
6/18/2020			0.0109	0.0034	0.037			
6/22/2020	<0.0005	<0.0005						
7/1/2020			0.011		0.0468			
7/2/2020				0.0044				
7/16/2020			0.0045	0.0034	0.0252			
7/30/2020			0.004	0.0035	0.022			
8/13/2020			0.0061	0.0036	0.022			
8/27/2020			0.009	0.0034	0.0318			
1/26/2021	<0.0005	<0.0005						
2/10/2021			0.0127	0.0025	0.035			
4/7/2021			0.0103	0.0031	0.0465	0.0174	0.0277	
5/13/2021						0.0164	0.0239	
6/21/2021	<0.0005	<0.0005						
7/7/2021			0.0061	0.0028	0.0269			
7/8/2021						0.0179	0.0212	
8/31/2021							0.0197	
9/1/2021						0.015		
9/27/2021						0.0156	0.0219	
10/26/2021						0.0152	0.0214	
11/17/2021						0.0149	0.0194	
1/24/2022	<0.0005	<0.0005						
1/31/2022			0.0106 (D)	0.007 (D)	0.0339	0.0166	0.0237	
6/20/2022	<0.0005	<0.0005						
6/21/2022			0.006	0.003	0.017	0.013	0.019	
10/25/2022	<0.0005 (D)	<0.0005 (D)		0.004 (D)	0.03265 (D)	0.0176 (D)	0.0259 (D)	
10/26/2022			0.0105 (D)					0.0117 (D)

Time Series

Constituent: Boron (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	0.032	0.0178						
1/26/2016	0.0218	<0.015						
4/19/2016	0.0183	<0.015						
7/18/2016	0.0217	0.0163						
10/11/2016	0.0302	0.0165						
1/23/2017	0.0249	<0.015						
4/17/2017	0.018	0.019						
7/25/2017	0.022							
9/25/2017	0.024	0.018						
10/9/2017	0.023	0.021						
2/7/2018	0.018	<0.015						
6/20/2018	0.02	0.016						
10/1/2018	0.025	0.015						
2/12/2019	<0.04	<0.015						
2/24/2020	0.017	<0.015						
5/21/2020			8.6	2	18			
6/4/2020			10	1.7	19			
6/18/2020			10	1.6	23			
6/22/2020	0.018	0.049						
7/1/2020			12		23			
7/2/2020				1.6				
7/16/2020			8.3	1.9	19			
7/30/2020			8.3	2	17			
8/13/2020			9.1	2.1	17			
8/27/2020			11	1.9	18			
9/21/2020			10	1.7	18			
1/26/2021	0.018	<0.015						
2/10/2021			14	0.96	25			
4/7/2021			11	0.85	23	7.6	7	
5/13/2021						8	6.9	
6/21/2021	<0.04	<0.015						
7/7/2021			9.4	1.3	17			
7/8/2021						7.7	6.7	
8/31/2021							6.9	
9/1/2021						8		
9/27/2021						7.8	7.3	
10/26/2021						6.8	6.7	
11/17/2021						7.1	5.2	
1/24/2022	0.0139	0.011						
1/31/2022			9.84	0.51	21.5	6.21	6.2	
6/20/2022	0.015	<0.015						
6/21/2022			4.2	0.57	9.9	4.3	6.1	
10/25/2022	0.0203	0.0437		1.14	16.6	6.13	5.71	
10/26/2022			12.6					11.8

Time Series

Constituent: Cadmium (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	<0.0005	<0.0005						
1/26/2016	<0.0005	<0.0005						
4/19/2016	<0.0005	<0.0005						
7/18/2016	<0.0005	<0.0005						
10/11/2016	<0.0005	<0.0005						
1/23/2017	<0.0005	<0.0005						
4/17/2017	<0.0005	<0.0005						
7/12/2017		<0.0005						
7/25/2017	<0.0005							
9/25/2017	<0.0005	<0.0005						
2/7/2018	<0.0005	<0.0005						
6/20/2018	<0.0005	<0.0005						
2/12/2019	<0.0005	<0.0005						
2/24/2020	<0.0005	<0.0005						
5/21/2020			<0.004	<0.004	0.00062			
6/4/2020			<0.004	<0.004	0.0008			
6/18/2020			<0.004	<0.004	0.00074			
6/22/2020	<0.0005	<0.0005						
7/1/2020			<0.004		0.0009			
7/2/2020				<0.004				
7/16/2020			<0.004	<0.004	0.00061			
7/30/2020			<0.004	<0.004	<0.004			
8/13/2020			<0.004	<0.004	<0.004			
8/27/2020			<0.004	<0.004	0.00076			
1/26/2021	<0.0005	<0.0005						
2/10/2021			<0.004	<0.004	0.00078			
4/7/2021			<0.004	<0.004	0.00053	<0.004	<0.004	
5/13/2021						<0.004	<0.004	
6/21/2021	<0.0005	<0.0005						
7/7/2021			<0.004	<0.004	<0.004			
7/8/2021						<0.004	<0.004	
8/31/2021							<0.004	
9/1/2021						<0.004		
9/27/2021						<0.004	<0.004	
10/26/2021						<0.004	<0.004	
11/17/2021						<0.004	<0.004	
1/24/2022	<0.0005	<0.0005						
1/31/2022			<0.004 (D)	<0.004 (D)	<0.004	<0.004 (D)	<0.004 (D)	
6/20/2022	<0.0005	<0.0005						
6/21/2022			<0.004	<0.004	<0.004	<0.004	<0.004	
10/25/2022	<0.0005	<0.0005		0.0014	0.0019	0.0008	0.0006	
10/26/2022			0.0022					0.0032

Time Series

Constituent: Calcium (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	27	26						
1/26/2016	27	27						
4/19/2016	29.4	23.3						
7/18/2016	28.7	18.8						
10/11/2016	22.7	16.4						
1/23/2017	26.2	10.4						
4/17/2017	25.6	12.5						
7/12/2017		18.5						
9/25/2017	21.9	15.4						
10/9/2017	23	17						
2/7/2018	24	14.7						
6/20/2018	24	37						
10/1/2018	22.7	16.6						
2/12/2019	24.4	15.9						
5/20/2019	41.65 (D)	16.1 (D)						
2/24/2020	28.2	11						
5/21/2020			204	311	564			
6/4/2020			290	298	658			
6/18/2020			289	299	737			
6/22/2020	28.4	13.5						
7/1/2020			315		759			
7/2/2020				305				
7/16/2020			204	295	587			
7/30/2020			192	279	545			
8/13/2020			224	293	556			
8/27/2020			242	272	579			
9/21/2020			252	276	576			
1/26/2021	29.2	14.3						
2/10/2021			353	298	729			
4/7/2021			276	273	700	348	480	
5/13/2021						360	468	
6/21/2021	29.9	17						
7/7/2021			218	253	495			
7/8/2021						324	438	
8/31/2021							441	
9/1/2021						319		
9/27/2021						325	474	
10/26/2021						304	455	
11/17/2021						310	396	
1/24/2022	27.9	14.4						
1/31/2022			229	226	563	254	362	
6/20/2022	29	6.2						
6/21/2022			200	240	460	270	430	
10/25/2022	27.5	13.1		214	415	231	370	
10/26/2022			193					320

Time Series

Constituent: Chloride (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	3.21	12.7						
1/26/2016	2.95	11.3						
4/19/2016	2.33	12.1						
7/18/2016	2.95	13.2						
10/11/2016	3	12.8						
1/23/2017	2.45	13.5						
4/17/2017	2.96	12.7						
7/12/2017		12.1						
7/25/2017	2.61							
9/25/2017	2.51	13.3						
10/9/2017	2.73	12.6						
2/7/2018	2.88	12.4						
6/20/2018	3	13.4						
10/1/2018	2.71	12.9						
2/12/2019	2.68	12.1						
5/20/2019	2.9	12.7						
2/24/2020	3.25	12.7						
5/21/2020			600	103	1030			
6/4/2020			644	117	1140			
6/18/2020			666	127	1340			
6/22/2020	3.44	12.67						
7/1/2020			717		1300			
7/2/2020				145				
7/16/2020			694	153	1070			
7/30/2020			703	176	971			
8/13/2020			647	163	1050			
8/27/2020			666	146	998			
9/21/2020			699	136	1060			
1/26/2021	3.22	11.8						
2/10/2021			791	79.5	1460			
4/7/2021			795	55.87	1405	733	1160	
5/13/2021						683	1090	
6/21/2021	3.05	12						
7/7/2021			728	83.1	950			
7/8/2021						670	1082	
8/31/2021							1033	
9/1/2021						617		
9/27/2021						574	1061	
10/26/2021						553	1070	
11/17/2021						537	865	
1/24/2022	3.21	12.1						
1/31/2022			717	63	1160	523	937	
6/20/2022	3.79	13.4						
6/21/2022			686	66.4	841	445	1070	
10/25/2022	3.78	12.7		57.3	842	495	896	
10/26/2022			733					797

Time Series

Constituent: Chromium (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	0.014	<0.005						
1/26/2016	<0.005	<0.005						
4/19/2016	<0.005	<0.005						
7/18/2016	<0.005	<0.005						
10/11/2016	<0.005	<0.005						
1/23/2017	<0.005	<0.005						
4/17/2017	<0.005	<0.005						
7/12/2017		<0.005						
7/25/2017	<0.005							
9/25/2017	<0.005	<0.005						
2/7/2018	<0.005	<0.005						
6/20/2018	<0.005	<0.005						
2/12/2019	<0.005	<0.005						
2/24/2020	<0.005	<0.005						
5/21/2020			<0.005	<0.005	0.0058			
6/4/2020			<0.005	<0.005	0.0067			
6/18/2020			<0.005	<0.005	0.0063			
6/22/2020	<0.005	<0.005						
7/1/2020			<0.005		0.0052			
7/2/2020				<0.005				
7/16/2020			<0.005	<0.005	0.0053			
7/30/2020			<0.005	<0.005	0.0055			
8/13/2020			<0.005	<0.005	0.0056			
8/27/2020			<0.005	<0.005	0.0059			
1/26/2021	<0.005	<0.005						
2/10/2021			<0.005	<0.005	<0.005			
4/7/2021			<0.005	<0.005	0.0061	<0.005	<0.005	
5/13/2021						<0.005	<0.005	
6/21/2021	<0.005	<0.005						
7/7/2021			<0.005	<0.005	0.0079			
7/8/2021						<0.005	<0.005	
8/31/2021							<0.005	
9/1/2021						<0.005		
9/27/2021						<0.005	<0.005	
10/26/2021						<0.005	<0.005	
11/17/2021						<0.005	<0.005	
1/24/2022	<0.005							
1/31/2022			<0.005 (D)	<0.005 (D)	<0.005	<0.005 (D)	<0.005 (D)	
6/20/2022	<0.005	<0.005						
6/21/2022			<0.005	<0.005	<0.005	<0.005	<0.005	
10/25/2022	<0.005	<0.005		<0.005	0.009	<0.005	<0.005	
10/26/2022			<0.005					<0.005

Time Series

Constituent: Cobalt (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	0.0034	0.001						
1/26/2016	0.0013	0.0009						
4/19/2016	0.00116	0.00079						
7/18/2016	0.00115	0.00085						
10/11/2016	0.00109	0.000851						
1/23/2017	0.001	0.00093						
4/17/2017	0.0011	0.00098						
9/25/2017	0.00086	0.00091						
2/7/2018	0.00088	0.00089						
6/20/2018	0.001	0.001						
10/1/2018	0.00076	0.00084						
2/12/2019	0.00084	0.00091						
5/20/2019	0.00077 (D)	0.000895 (D)						
2/24/2020	0.00082	0.001						
5/21/2020			0.0448	0.0506	0.115			
6/4/2020			0.0479	0.0199	0.13			
6/18/2020			0.0492	0.0229	0.152			
6/22/2020	0.0008	0.001						
7/1/2020			0.0548		0.154			
7/2/2020				0.025				
7/16/2020			0.0353	0.027	0.113			
7/30/2020			0.032	0.028	0.0966			
8/13/2020			0.0371	0.0294	0.0936			
8/27/2020			0.0467	0.0244	0.117			
1/26/2021	0.00066	0.001						
2/10/2021			0.0587	0.019	0.151			
4/7/2021			0.0536	0.0183	0.143	0.0532	0.163	
5/13/2021						0.0498	0.149	
6/21/2021	0.0007	0.00094						
7/7/2021			0.0362	0.0206	0.0967			
7/8/2021						0.0494	0.147	
8/31/2021							0.15	
9/1/2021						0.0487		
9/27/2021						0.0478	0.157	
10/26/2021						0.0463	0.158	
11/17/2021						0.0461	0.128	
1/24/2022	0.00073	<0.005						
1/31/2022			0.00931	0.00644	0.0504	0.0168	0.114	
6/20/2022	<0.001	0.001						
6/21/2022			0.033	0.018	0.055	0.033	0.117	
10/25/2022	0.002543 (D)	0.003437 (D)		0.0153 (D)	0.07787 (D)	0.0313 (D)	0.1317 (D)	
10/26/2022			0.03363 (D)					0.05647 (D)

Time Series

Constituent: Combined Radium 226 & 228 (pci/l) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	<4	4.59						
1/26/2016	<4	4.31						
4/19/2016	5.31	<4						
7/18/2016	<4	<4						
10/11/2016	4.43	4.49						
1/23/2017	6.34	<4						
4/17/2017	<4	<4						
9/25/2017	<4	<4						
2/7/2018	<4	<4						
6/20/2018	<4	7.09						
10/1/2018	5.11	16.3						
2/12/2019	0.346	0.585						
2/24/2020	2.06	0.538						
5/21/2020			3.97	1.34	5.59			
6/4/2020			3.96	2.14	4.18			
6/18/2020			3.79	2.61	5.24			
6/22/2020	1.14	1.38						
7/1/2020			5.58		3.26			
7/2/2020				2.13				
7/16/2020			3.65	2.46	5.25			
7/30/2020			2.93	2.15	7.74			
8/13/2020			3.07	1.91	5.99			
8/27/2020			2.64	1.3	5.2			
1/26/2021	1.73	3.44						
2/10/2021			3.86	2.83	4.69			
4/7/2021			3.89	4.18	7.93	6.37	3.68	
5/13/2021						5.84	6.31	
6/21/2021	0.552	2.1						
7/7/2021			2.77	2.5	5.03			
7/8/2021						3.56	6.08	
8/31/2021							5.53	
9/1/2021						4.64		
9/27/2021						5.29	7.93	
10/26/2021						5.56	6.48	
11/17/2021						4.9	9.69	
1/24/2022	2.44	2.69						
1/31/2022			6.81	3.4	6.17	4.85	3.44	
6/20/2022	1.98	1.59						
6/21/2022			4.28	2.39	5.36	3.24	4.3	
10/25/2022	2.51	2.9		5.12	6.68	3.77	6.17	
10/26/2022			3.53					6.04

Time Series

Constituent: Fluoride (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	0.25	<0.1						
1/26/2016	0.3	<0.1						
4/19/2016	0.29	<0.1						
7/18/2016	0.27	<0.1						
10/11/2016	0.28	<0.1						
1/23/2017	0.25	<0.1						
4/17/2017	0.22	<0.1						
9/25/2017	0.23	<0.1						
10/9/2017	0.22	<0.1						
2/7/2018	0.19	<0.1						
6/20/2018	0.2	<0.1						
10/1/2018	0.19	<0.1						
2/12/2019	0.18	<0.1						
2/24/2020	0.19	<0.1						
5/21/2020			0.58	0.75	0.65			
6/4/2020			0.96	0.75	2.89			
6/18/2020			1.05	0.62	2.82			
6/22/2020	0.2	<0.1						
7/1/2020			0.69		0.73			
7/2/2020				<0.1				
7/16/2020			0.72	1.55	2.41			
7/30/2020			0.91	<0.1	<0.1			
8/13/2020			1.04	0.71	1			
8/27/2020			1.02	0.54	4.57			
9/21/2020			1.29	1.23	1.77			
1/26/2021	0.15	<0.1						
2/10/2021			1.69	1.3	6.22			
4/7/2021			1.31	1.08	3.32	3.19	1.1	
5/13/2021						2.82	0.84	
6/21/2021	0.19	<0.1						
7/7/2021			0.97	0.87	1.88			
7/8/2021						1.85	0.99	
8/31/2021							0.75	
9/1/2021						1.79		
9/27/2021						1.63	0.98	
10/26/2021						0.83	0.42	
11/17/2021						1.53	0.58	
1/24/2022	0.22	<0.1						
1/31/2022			0.9	0.28	0.81	0.67	0.36	
6/20/2022	0.18	<0.1						
6/21/2022			0.91	0.93	1.94	1.56	0.93	
10/25/2022	<0.1	<0.1		0.42	1.06	0.99	0.49	
10/26/2022			0.53					0.66

Time Series

Constituent: Lead (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	0.011	<0.0025						
1/26/2016	0.0036	<0.0025						
4/19/2016	0.0028	<0.0025						
7/18/2016	0.00318	<0.0025						
10/11/2016	0.00375	<0.0025						
1/23/2017	0.0031	<0.0025						
4/17/2017	0.0028	<0.0025						
7/25/2017	0.0032							
9/25/2017	0.0032	<0.0025						
2/7/2018	0.0027	<0.0025						
6/20/2018	0.003	<0.0025						
10/1/2018	0.0031	<0.0025						
2/12/2019	0.0025	<0.0025						
2/24/2020	0.0027	<0.0025						
5/21/2020			0.035	0.02	0.0279			
6/4/2020			0.0191	0.0238	0.019			
6/18/2020			0.0201	0.0247	0.0236			
6/22/2020	0.0026	<0.0025						
7/1/2020			0.0202		0.0236			
7/2/2020				0.026				
7/16/2020			0.0116	0.0235	0.0269			
7/30/2020			0.005	0.0244	0.0295			
8/13/2020			0.0093	0.0247	0.0355			
8/27/2020			0.0087	0.0268	0.0193			
1/26/2021	0.0025	<0.0025						
2/10/2021			0.0165	0.0196	0.092 (o)			
4/7/2021			0.008	0.0175	0.0248	0.0113	0.013	
5/13/2021						0.0122	0.0127	
6/21/2021	0.0026	<0.0025						
7/7/2021			0.0097	0.0208	0.0297			
7/8/2021						0.0126	0.0131	
8/31/2021							0.0136	
9/1/2021						0.0146		
9/27/2021						0.0147	0.0137	
10/26/2021						0.0145	0.0158	
11/17/2021						0.0147	0.0068	
1/24/2022	0.0027	<0.0025						
1/31/2022			0.0078 (D)	0.019	0.0244	0.0113	0.0105	
6/20/2022	<0.01	<0.0025						
6/21/2022			<0.01	<0.01	0.011	<0.01	<0.01	
10/25/2022	0.0032	<0.0025		0.0251	0.0298	0.0134	0.0028	
10/26/2022			0.0089					0.0551

Time Series

Constituent: Lithium (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	<0.005	<0.01						
1/26/2016	<0.005	<0.01						
4/19/2016	<0.005	<0.01						
7/18/2016	<0.005	<0.01						
10/11/2016	<0.005	<0.01						
1/23/2017	<0.005	<0.01						
4/17/2017	<0.005	<0.01						
9/25/2017	<0.005	<0.01						
2/7/2018	<0.005	<0.01						
6/20/2018	<0.005	<0.01						
10/1/2018	<0.005	<0.01						
2/12/2019	<0.005	<0.01						
5/20/2019	<0.005 (D)	<0.01 (D)						
2/24/2020	<0.005	<0.01						
5/21/2020			0.015	0.015	0.069			
6/4/2020			0.027	<0.01	0.09			
6/18/2020			0.028	0.015	0.11			
6/22/2020	<0.005	<0.01						
7/1/2020			<0.01		0.11			
7/2/2020				0.015				
7/16/2020			0.01	<0.01	0.071			
7/30/2020			<0.01	0.014	0.06			
8/13/2020			<0.01	<0.01	0.063			
8/27/2020			0.023	0.016	0.093			
1/26/2021	<0.005	<0.01						
2/10/2021			0.024	0.013	0.11			
4/7/2021			0.02	0.014	0.094	0.058	0.14	
5/13/2021						0.058	0.13	
6/21/2021	<0.005	<0.01						
7/7/2021			0.014	0.015	0.056			
7/8/2021						0.058	0.12	
8/31/2021							0.13	
9/1/2021						0.064		
9/27/2021						0.067	0.15	
10/26/2021						0.053	0.11	
11/17/2021						0.052	0.11	
1/24/2022	0.00066	0.0037						
1/31/2022			0.0183	0.0109	0.1	0.0642	0.128	
6/20/2022	<0.005	<0.01						
6/21/2022			<0.01	<0.01	0.029	0.039	0.1	
10/25/2022	<0.005 (D)	0.00572 (D)		0.01 (D)	0.05835 (D)	0.0626 (D)	0.127 (D)	
10/26/2022			0.014965 (D)					0.010925 (D)

Time Series

Constituent: Mercury (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	<0.0004	<0.0006						
1/26/2016	<0.0004	<0.0006						
4/19/2016	<0.0004	<0.0006						
7/18/2016	<0.0004	<0.0006						
10/11/2016	<0.0004	<0.0006						
1/23/2017	<0.0004	<0.0006						
4/17/2017	<0.0004	<0.0006						
9/25/2017	<0.0004	<0.0006						
2/7/2018	<0.0004	<0.0006						
6/20/2018	<0.0004	<0.0006						
10/1/2018	<0.0004	<0.0006						
2/12/2019	<0.0004	<0.0006						
2/24/2020	<0.0004	<0.0006						
5/21/2020			<0.0002	<0.0002	<0.0002			
6/4/2020			<0.0002	<0.0002	<0.0002			
6/18/2020			<0.0002	<0.0002	0.00047			
6/22/2020	<0.0004	<0.0006						
7/1/2020			0.0002		0.00023			
7/2/2020				<0.0002				
7/16/2020			<0.0002	<0.0002	<0.0002			
7/30/2020			<0.0002	<0.0002	<0.0002			
8/13/2020			<0.0002	<0.0002	<0.0002			
8/27/2020			<0.0002	<0.0002	<0.0002			
1/26/2021	<0.0004	<0.0006						
2/10/2021			<0.0002	<0.0002	<0.0002			
4/7/2021			<0.0002	<0.0002	0.00021	<0.0004	<0.0002	
5/13/2021						<0.0004	<0.0002	
6/21/2021	<0.0004	<0.0006						
7/7/2021			<0.0002	<0.0002	<0.0002			
7/8/2021						<0.0004	<0.0002	
8/31/2021							<0.0002	
9/1/2021						<0.0004		
9/27/2021						<0.0004	<0.0002	
10/26/2021						<0.0004	<0.0002	
11/17/2021						<0.0004	<0.0002	
1/24/2022	<0.0004	<0.0006						
1/31/2022			<0.0002	<0.0002	<0.0002	<0.0004	<0.0002	
6/20/2022	<0.0004	<0.0006						
6/21/2022			<0.0002	<0.0002	<0.0002	<0.0004	<0.0002	
10/25/2022	<0.0004	<0.0006		<0.0002	<0.0002	<0.0004	<0.0002	
10/26/2022			<0.0002					<0.0002

Time Series

Constituent: Molybdenum (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	<0.005	<0.005						
1/26/2016	<0.005	<0.005						
4/19/2016	<0.005	<0.005						
7/18/2016	<0.005	<0.005						
10/11/2016	<0.005	<0.005						
1/23/2017	<0.005	<0.005						
4/17/2017	<0.005	<0.005						
9/25/2017	<0.005	<0.005						
2/7/2018	<0.005	<0.005						
6/20/2018	<0.005	<0.005						
2/12/2019	<0.005	<0.005						
2/24/2020	<0.005	<0.005						
5/21/2020			<0.005	<0.005	<0.005			
6/4/2020			<0.005	<0.005	<0.005			
6/18/2020			<0.005	<0.005	<0.005			
6/22/2020	<0.005	<0.005						
7/1/2020			<0.005		<0.005			
7/2/2020				<0.005				
7/16/2020			<0.005	<0.005	<0.005			
7/30/2020			<0.005	<0.005	<0.005			
8/13/2020			<0.005	<0.005	<0.005			
8/27/2020			<0.005	<0.005	<0.005			
1/26/2021	<0.005	<0.005						
2/10/2021			<0.005	<0.005	<0.005			
4/7/2021			<0.005	<0.005	<0.005	<0.005	<0.005	
5/13/2021						<0.005	<0.005	
6/21/2021	<0.005	<0.005						
7/7/2021			<0.005	<0.005	<0.005			
7/8/2021						<0.005	<0.005	
8/31/2021							<0.005	
9/1/2021						<0.005		
9/27/2021						<0.005	<0.005	
10/26/2021						<0.005	<0.005	
11/17/2021						<0.005	<0.005	
1/24/2022	<0.005	<0.005						
1/31/2022			<0.005	<0.005	<0.005	<0.005	<0.005	
6/20/2022	<0.005	<0.005						
6/21/2022			<0.005	<0.005	<0.005	<0.005	<0.005	
10/25/2022	<0.005	<0.005		<0.005	<0.005	<0.005	<0.005	
10/26/2022			<0.005					<0.005

Time Series

Constituent: pH, Field (pH units) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
1/26/2015		4.53						
2/16/2015		4.68						
6/16/2015		4.74						
7/6/2015		5.25						
10/19/2015	4.45	5.47						
1/26/2016	4.12	5.2						
4/19/2016	4.33	5.32						
7/18/2016	4.38	5.2						
10/11/2016	4.14	5.01						
1/23/2017	4.32	5.01						
4/17/2017	4.26	5.19						
7/12/2017		5.11						
7/25/2017	4.21							
9/25/2017	4.32	5.27						
10/9/2017	4.25	5.21						
2/7/2018	4.42	5.29						
6/20/2018	4.32	5.58						
10/1/2018	4.09	5.08						
2/12/2019	4.5	5.47						
5/20/2019	4.5	5.26						
2/24/2020	4.09	4.92						
5/21/2020			3.58	3.82	3.66			
6/4/2020			3.98	3.86	3.99			
6/18/2020			3.89	3.69	3.63			
6/22/2020	4.48	5.12						
7/1/2020			4.06		3.96			
7/2/2020				3.79				
7/16/2020			4.48	4.06	3.93			
7/30/2020			4.22	3.72	3.63			
8/13/2020			3.92	3.59	3.4			
8/27/2020			3.98	3.81	3.81			
9/21/2020			4.11	3.79	3.77			
1/26/2021	4.31	5.03						
2/10/2021			3.8	3.77	3.5			
4/7/2021			4.1	4.02	3.73	3.78	3.68	
5/13/2021						3.88	3.7	
6/21/2021	4.25	5.21						
7/7/2021			4.19	3.8	3.56			
7/8/2021						3.65	3.54	
8/31/2021							3.67	
9/1/2021						3.65		
9/27/2021						3.65	3.62	
10/26/2021						3.66	3.54	
11/17/2021						3.54	3.66	
1/24/2022	4.26	5.19						
1/31/2022			4.21	3.96	3.84	3.9	3.93	
6/20/2022	4.45	4.84						
6/21/2022			4.28	4.01	3.87	3.89	3.82	
10/25/2022	4.31	5.01		3.8	3.56	3.69	3.56	
10/26/2022			4.01					3.69

Time Series

Constituent: Selenium (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	<0.01	<0.01						
1/26/2016	<0.01	<0.01						
4/19/2016	<0.01	<0.01						
7/18/2016	<0.01	<0.01						
10/11/2016	<0.01	<0.01						
1/23/2017	<0.01	<0.01						
4/17/2017	<0.01	<0.01						
7/25/2017	<0.01							
9/25/2017	<0.01	<0.01						
2/7/2018	<0.01	<0.01						
6/20/2018	<0.01	<0.01						
10/1/2018	<0.01	<0.01						
2/12/2019	<0.01	<0.01						
2/24/2020	<0.01	<0.01						
5/21/2020			<0.05	0.0113	<0.05			
6/4/2020			0.0166	0.0078	0.0067			
6/18/2020			0.0143	<0.05	<0.05			
6/22/2020	<0.01	<0.01						
7/1/2020			0.0177		<0.05			
7/2/2020				<0.05				
7/16/2020			<0.05	<0.05	<0.05			
7/30/2020			<0.05	<0.05	<0.05			
8/13/2020			<0.05	<0.05	<0.05			
8/27/2020			<0.05	<0.05	<0.05			
1/26/2021	<0.01	<0.01						
2/10/2021			0.0163	<0.05	<0.05			
4/7/2021			<0.05	<0.05	<0.05	<0.05	<0.0025	
5/13/2021						<0.05	<0.0025	
6/21/2021	<0.01	<0.01						
7/7/2021			<0.05	<0.05	<0.05			
7/8/2021						<0.05	<0.0025	
8/31/2021							<0.0025	
9/1/2021						<0.05		
9/27/2021						<0.05	<0.0025	
10/26/2021						<0.05	<0.0025	
11/17/2021						<0.05	<0.0025	
1/24/2022	<0.01	<0.01						
1/31/2022			0.034 (D)	0.032 (D)	0.032 (D)	<0.05 (D)	<0.0025 (D)	
6/20/2022	<0.01	<0.01						
6/21/2022			<0.05	<0.05	<0.05	<0.05	<0.0025	
10/25/2022	<0.01	<0.01		0.027	0.019	0.00856	<0.0025	
10/26/2022			0.026					0.046

Time Series

Constituent: Sulfate (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	81.5	26.5						
1/26/2016	88.2	25.5						
4/19/2016	86	20.2						
7/18/2016	90.1	16						
10/11/2016	73.7	19.3						
1/23/2017	77.7	8.82						
4/17/2017	71.2	9.71						
7/12/2017		11.1						
7/25/2017	73.3							
9/25/2017	74.5	8.03						
10/9/2017	76.8	8.77						
2/7/2018	69.1	13.5						
6/20/2018	67.9	8.58						
10/1/2018	65.5	11.9						
2/12/2019	69.1	8.96						
5/20/2019	115	10.5						
2/24/2020	79.8	8.36						
5/21/2020			364	1000	978			
6/4/2020			544	968	911			
6/18/2020			540	932	946.1			
6/22/2020	79.9	8.32						
7/1/2020			575		924			
7/2/2020				908				
7/16/2020			338	933	983			
7/30/2020			340	868	991			
8/13/2020			391	868	999			
8/27/2020			448	885	913			
9/21/2020			460	976	995			
1/26/2021	80.7	9.98						
2/10/2021			613	957	1010			
4/7/2021			445	987	972	602	96.3	
5/13/2021						598	83.6	
6/21/2021	86.6	11.9						
7/7/2021			377	937	993			
7/8/2021						621	84.3	
8/31/2021							84.3	
9/1/2021						605		
9/27/2021						584	90.9	
10/26/2021						611	92.7	
11/17/2021						600	67	
1/24/2022	82.8	11.7						
1/31/2022			451	1020	998	575	128	
6/20/2022	78.3	6.59						
6/21/2022			359	881	966	576	106	
10/25/2022	80.4	7.99		914	885	652	89.3	
10/26/2022			458					894

Time Series

Constituent: Thallium (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
10/19/2015	<0.001	<0.001						
1/26/2016	<0.001	<0.001						
4/19/2016	<0.001	<0.001						
7/18/2016	<0.001	<0.001						
10/11/2016	<0.001	<0.001						
1/23/2017	<0.001	<0.001						
4/17/2017	<0.001	<0.001						
9/25/2017	<0.001	<0.001						
2/7/2018	<0.001	<0.001						
6/20/2018	<0.001	<0.001						
2/12/2019	<0.001	<0.001						
2/24/2020	<0.001	<0.001						
5/21/2020			<0.001	<0.001	<0.001			
6/4/2020			<0.001	<0.001	<0.001			
6/18/2020			<0.001	<0.001	<0.001			
6/22/2020	<0.001	<0.001						
7/1/2020			<0.001		<0.001			
7/2/2020				<0.001				
7/16/2020			<0.001	<0.001	<0.001			
7/30/2020			<0.001	<0.001	<0.001			
8/13/2020			<0.001	<0.001	<0.001			
8/27/2020			<0.001	<0.001	<0.001			
1/26/2021	<0.001	<0.001						
2/10/2021			<0.001	<0.001	<0.001			
4/7/2021			<0.001	<0.001	<0.001	<0.001	<0.001	
5/13/2021						<0.001	<0.001	
6/21/2021	<0.001	<0.001						
7/7/2021			<0.001	<0.001	<0.001			
7/8/2021						<0.001	<0.001	
8/31/2021							<0.001	
9/1/2021						<0.001		
9/27/2021						<0.001	<0.001	
10/26/2021						<0.001	<0.001	
11/17/2021						<0.001	<0.001	
1/24/2022	<0.001	<0.001						
1/31/2022			<0.001 (D)	<0.001 (D)	<0.001 (D)	<0.001 (D)	<0.001 (D)	
6/20/2022	<0.001	<0.001						
6/21/2022			<0.001	<0.001	<0.001	<0.001	<0.001	
10/25/2022	<0.001	<0.001		<0.001	<0.001	<0.001	<0.001	
10/26/2022			<0.001					<0.001

Time Series


Constituent: Total Dissolved Solids (mg/L) Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7
1/26/2015		142.5						
2/16/2015		106.2						
6/16/2015		158						
7/6/2015		151						
10/19/2015	150	206						
1/26/2016	120	165						
4/19/2016	120	130						
7/18/2016	132	124						
10/11/2016	151.7	200						
1/23/2017	148	138						
4/17/2017	62	56						
7/12/2017		108						
7/25/2017	92							
9/25/2017	<40	<40						
10/9/2017	115	80						
2/7/2018	92	112						
6/20/2018	138.8	200						
10/1/2018	107.5	130						
2/12/2019	135	136.2						
5/20/2019	181.2	162.5						
2/24/2020	107.5	120						
5/21/2020			1505	1609	3449			
6/4/2020			1839	1589	3895			
6/18/2020			1964	1624	4502			
6/22/2020	147.5	112.5						
7/1/2020			2650		4120			
7/2/2020				1634				
7/16/2020			1811	1512	3700			
7/30/2020			1541	1515	3138			
8/13/2020			1768	1599	3102			
8/27/2020			1772	1526	3519			
9/21/2020			1945	1515	3288			
1/26/2021	138.8	110						
2/10/2021			2081	1538	4090			
4/7/2021			2301	1536	4958	2178	3952	
5/13/2021						2078	2804	
6/21/2021	178.8	155						
7/7/2021			1770	1618	3291			
7/8/2021						2168	2851	
8/31/2021							2740	
9/1/2021						2038		
9/27/2021						1749	2382	
10/26/2021						1614	2306	
11/17/2021						1676	1899	
1/24/2022	130	128.8						
1/31/2022			1912	1582	3410	1864	2379	
6/20/2022	143.8	137.5						
6/21/2022			1771	1408	2952	1676	3210	
10/25/2022	110	96.25		1454	2835	1585	2902	
10/26/2022			1894					2545


FIGURE B.

Box & Whiskers Plot

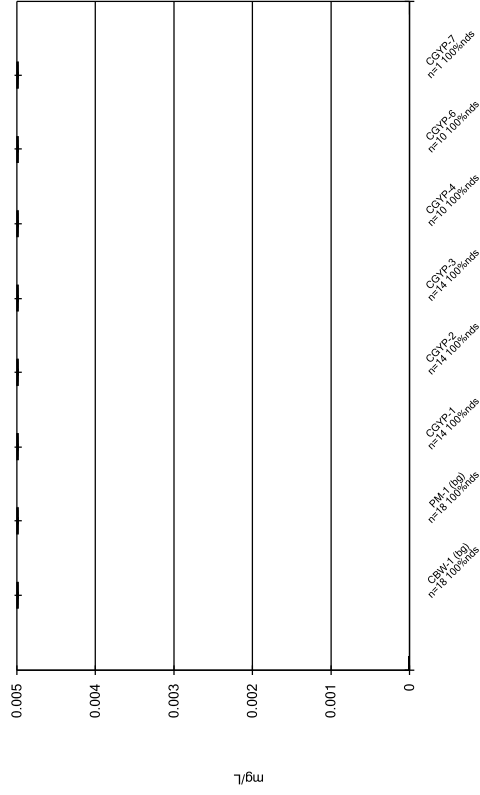


Constituent: Antimony Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

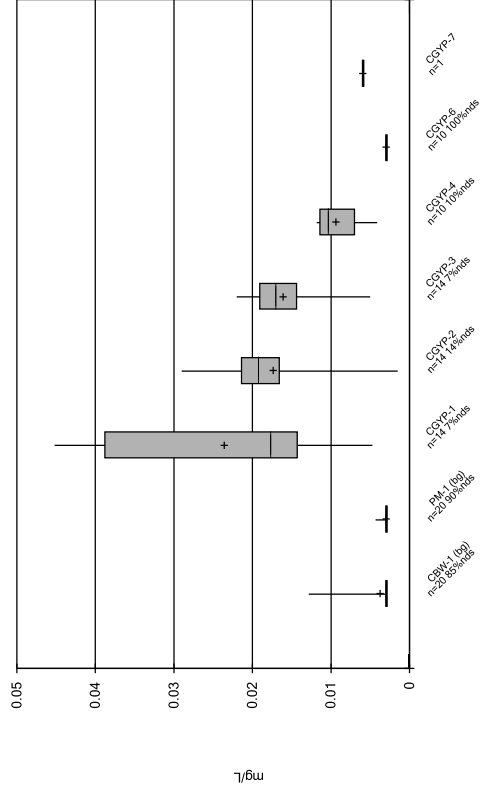


Constituent: Arsenic Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

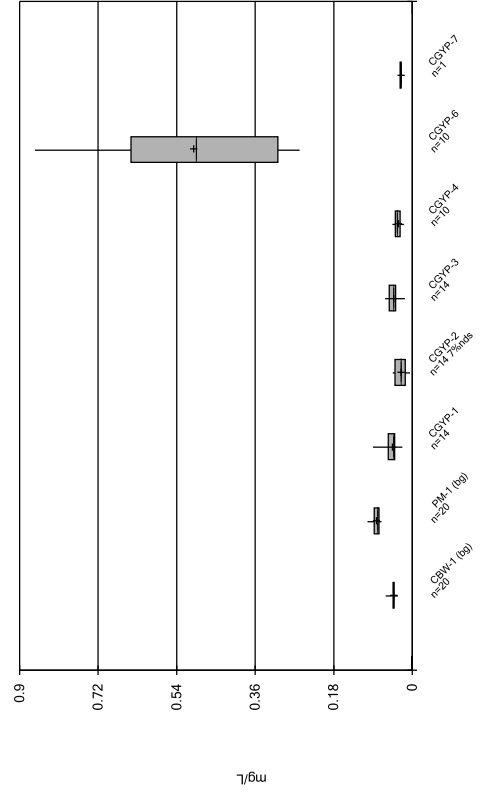


Constituent: Barium Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

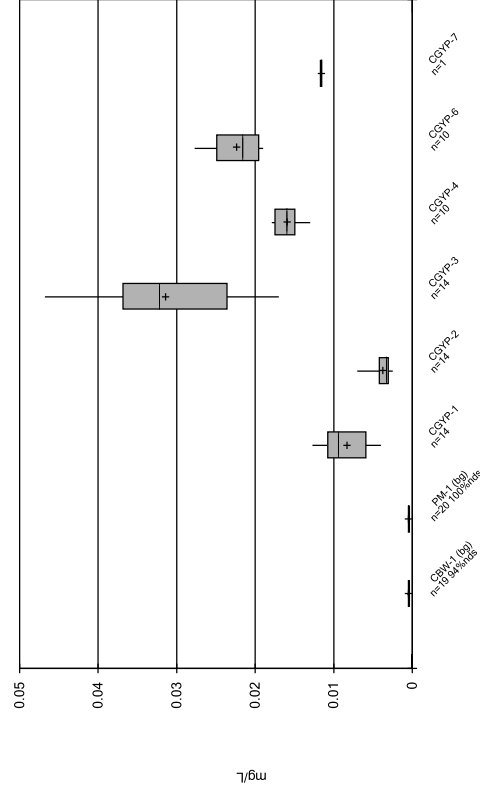


Constituent: Beryllium Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

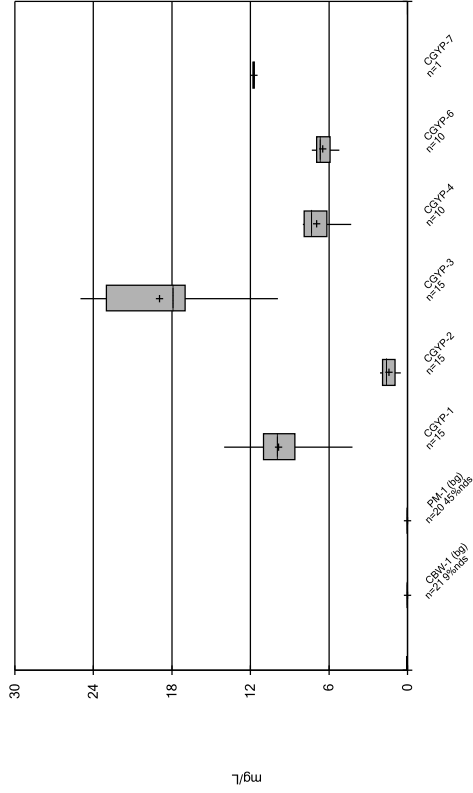


Constituent: Boron Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

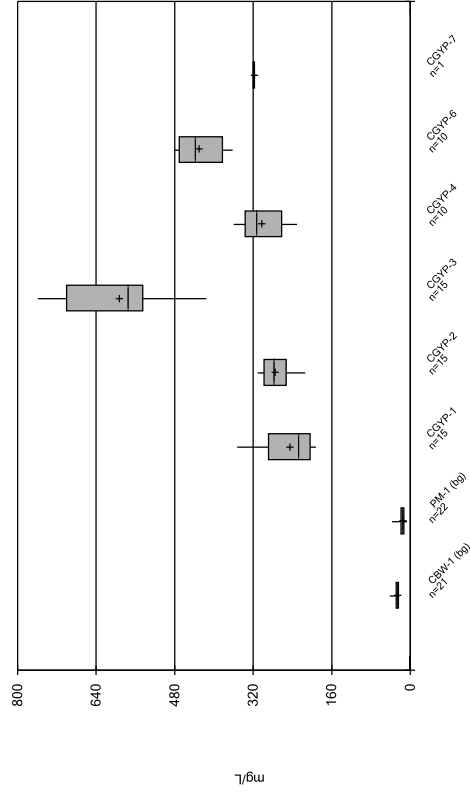


Constituent: Calcium Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

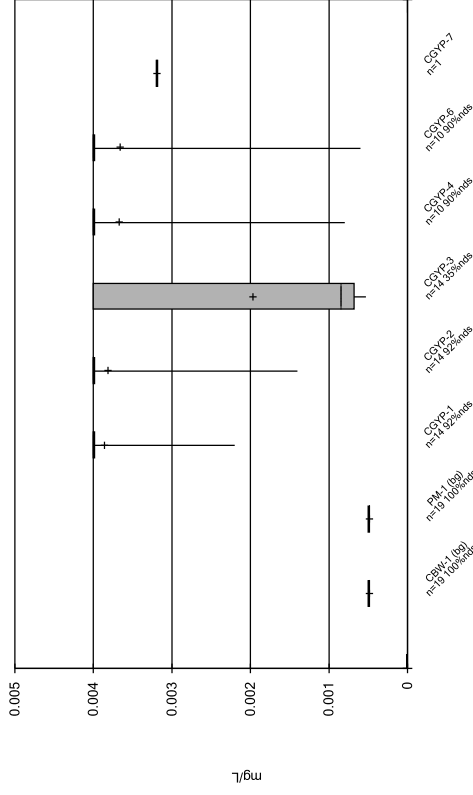


Constituent: Cadmium Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

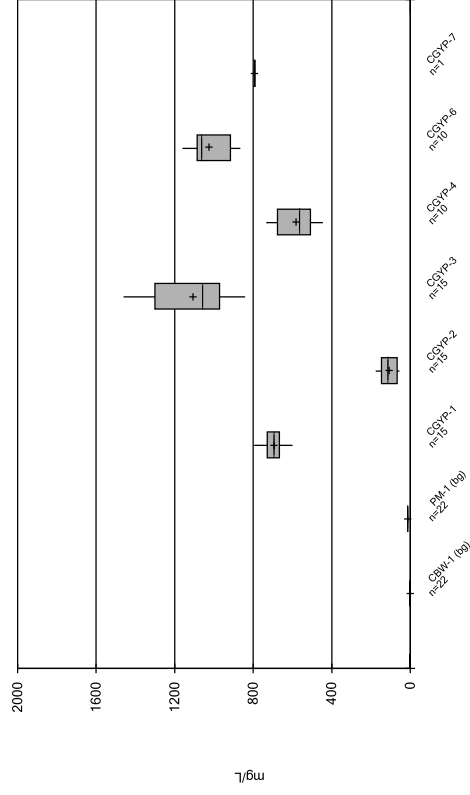


Constituent: Chloride Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP


Box & Whiskers Plot

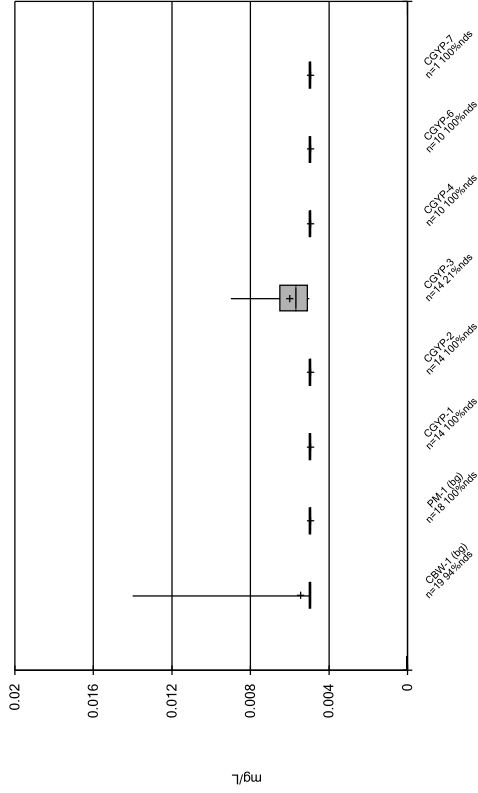


Box & Whiskers Plot

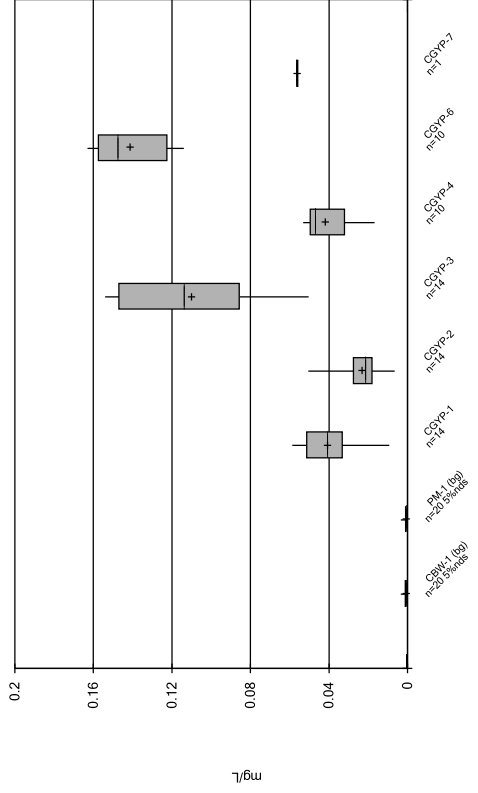


Box & Whiskers Plot

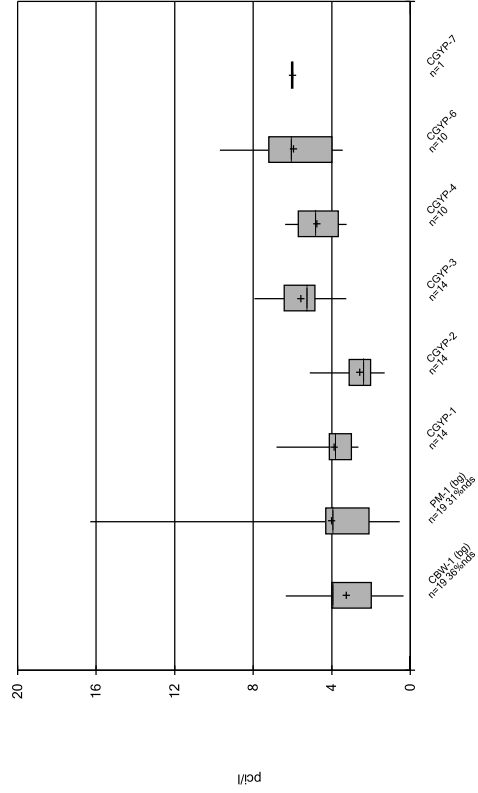

Box & Whiskers Plot

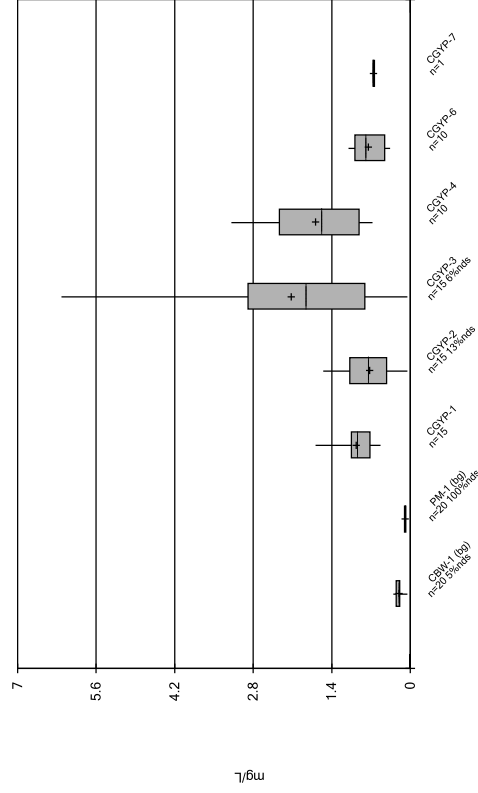


Box & Whiskers Plot

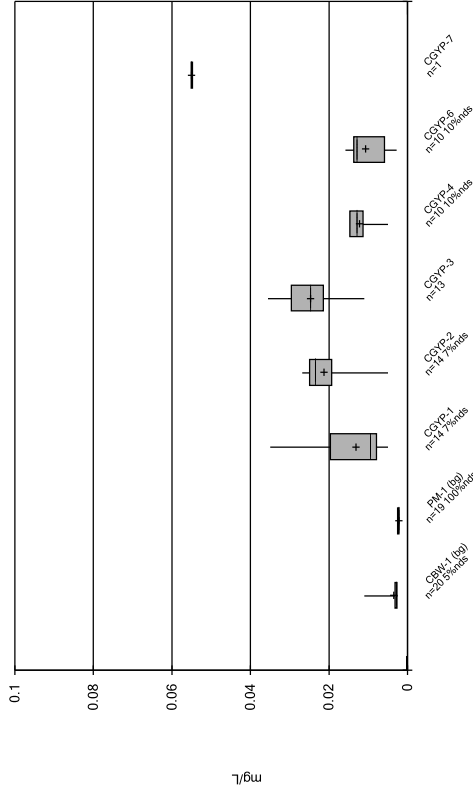


Constituent: Lead Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

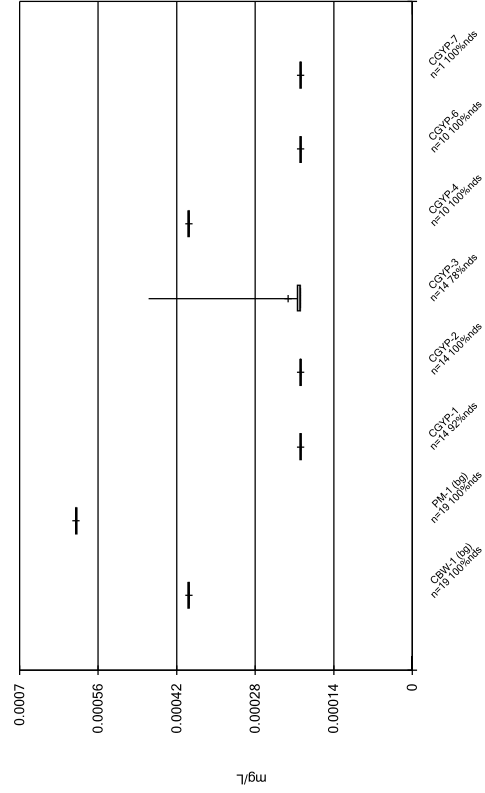


Constituent: Mercury Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

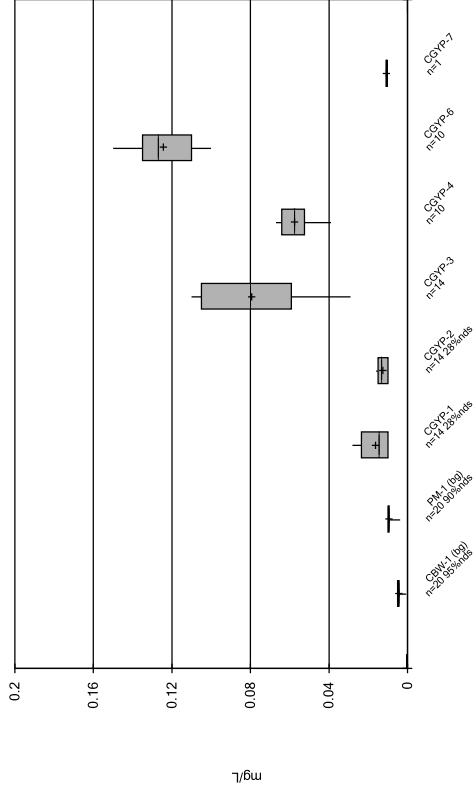


Constituent: Lithium Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

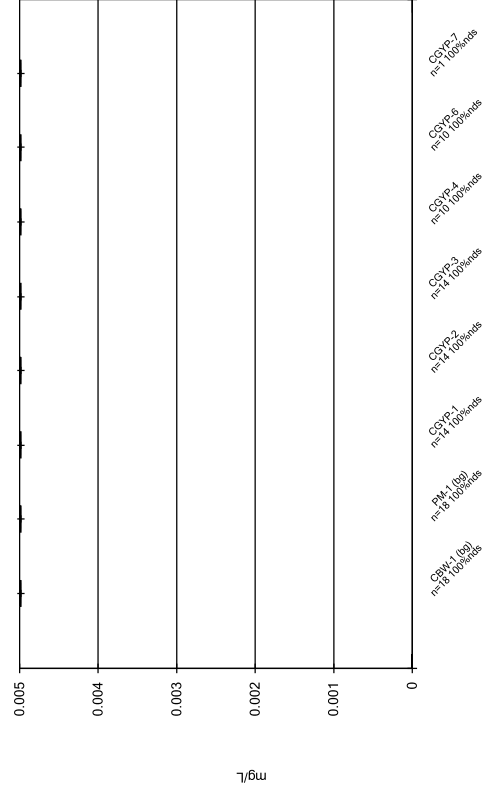


Constituent: Molybdenum Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

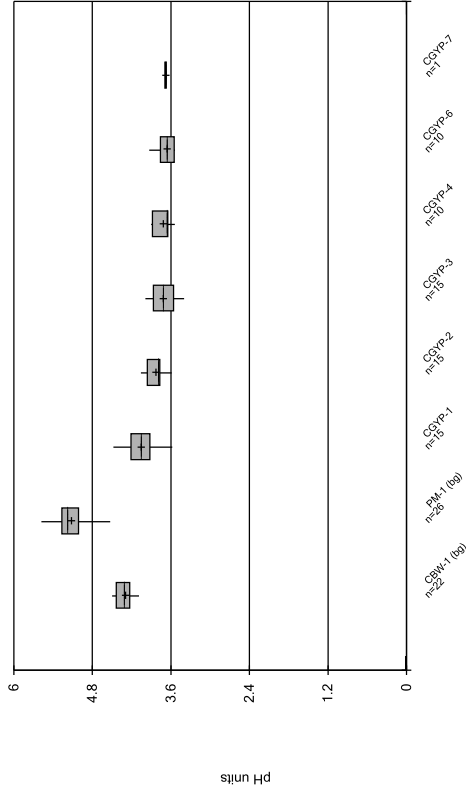


Constituent: pH, Field Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

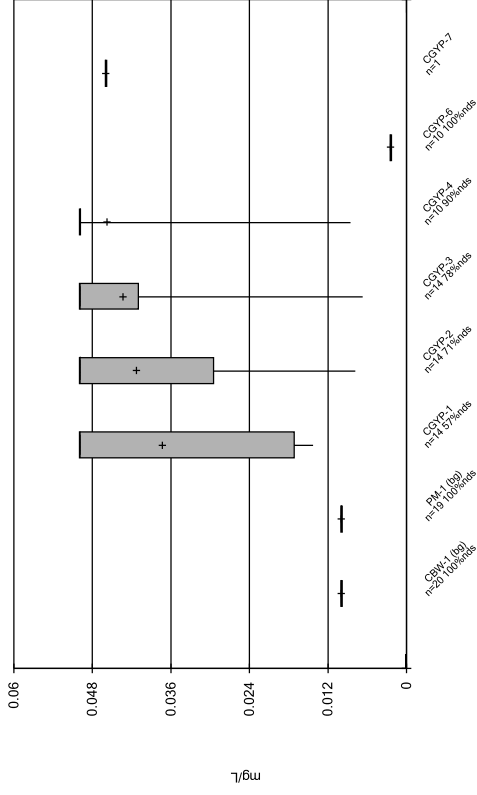


Constituent: Selenium Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

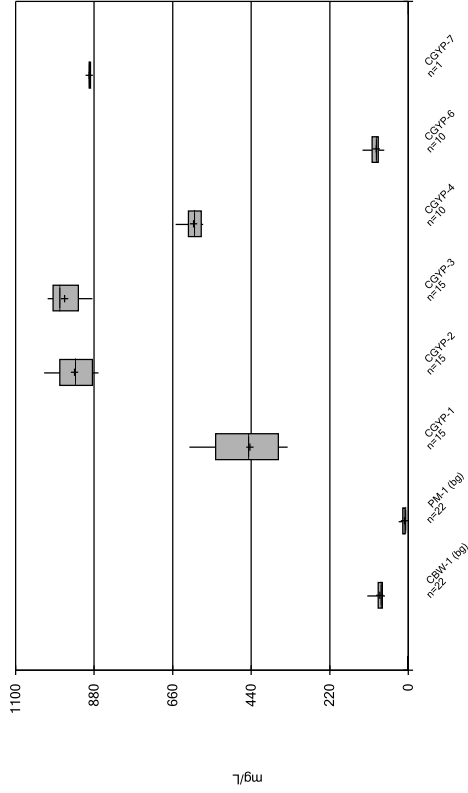


Constituent: Sulfate Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

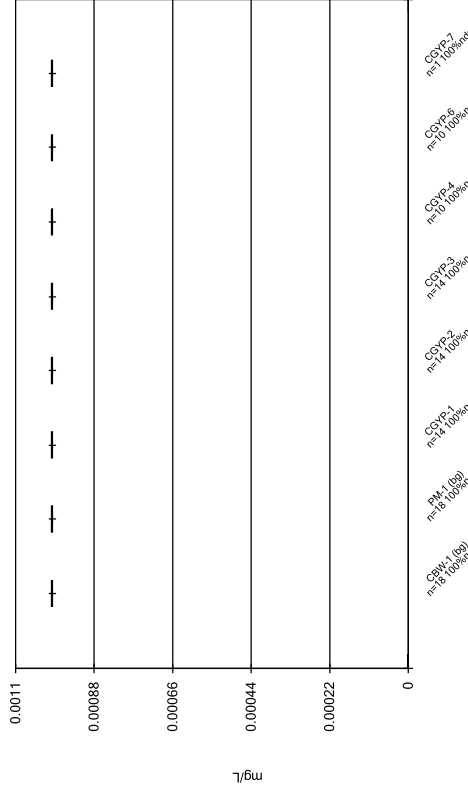

Constituent: Thallium Analysis Run 3/8/2023 11:46 AM View: Descriptive
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

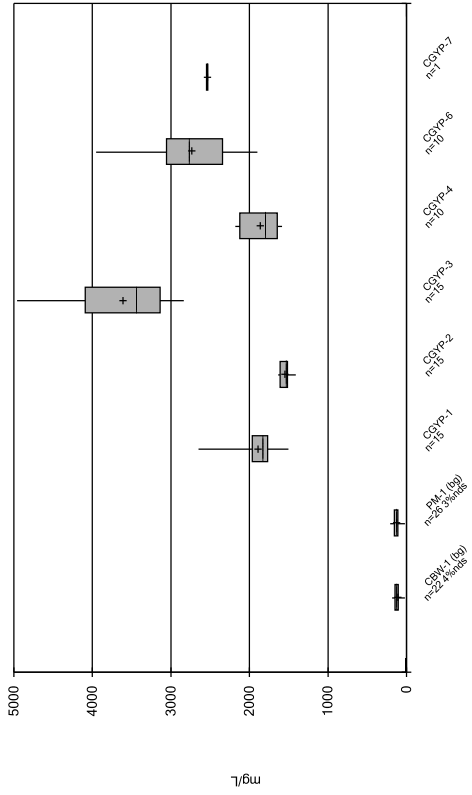

Constituent: Total Dissolved Solids Analysis Run 3/8/2023 11:46 AM View: Descriptive

CGYP Client: Santee Cooper Data: CGYP

FIGURE C.

Outlier Summary

CGYP Client: Santee Cooper Data: CGYP Printed 3/8/2023, 11:44 AM

CGYP-3 Lead (mg/L)

2/10/2021

0.092 (o)

Outlier Analysis (Upgradient) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:20 PM


<u>Constituent</u>	<u>Well</u>	<u>Outlier</u>	<u>Value(s)</u>	<u>Method</u>	<u>Alpha</u>	<u>N</u>	<u>Mean</u>	<u>Std. Dev.</u>	<u>Distribution</u>	<u>Normality Test</u>
Cobalt (mg/L)	CBW-1,PM-1	Yes	0.0034,0.002543,0.003437	NP	NaN	40	0.001067	0.0006253	In(x)	ShapiroWilk
Lead (mg/L)	CBW-1,PM-1	Yes	0.011	NP	NaN	39	0.002929	0.001368	In(x)	ShapiroWilk

Outlier Analysis (Upgradient) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:20 PM

Constituent	Well	Outlier	Value(s)	Method	Alpha	N	Mean	Std. Dev.	Distribution	Normality Test
Antimony (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	36	0.005	0	unknown	ShapiroWilk
Arsenic (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	40	0.003439	0.001682	unknown	ShapiroWilk
Barium (mg/L)	CBW-1,PM-1	No	n/a	NP	NaN	40	0.06286	0.02093	normal	ShapiroWilk
Beryllium (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	39	0.0005033	0.00002082	unknown	ShapiroWilk
Boron (mg/L)	CBW-1,PM-1	No	n/a	NP	NaN	41	0.01974	0.00751	ln(x)	ShapiroWilk
Cadmium (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	38	0.0005	0	unknown	ShapiroWilk
Calcium (mg/L)	CBW-1,PM-1	No	n/a	NP	NaN	43	21.94	7.437	sqrt(x)	ShapiroWilk
Chloride (mg/L)	CBW-1,PM-1	No	n/a	NP	NaN	44	7.79	4.887	x^6	ShapiroWilk
Chromium (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	37	0.005243	0.00148	unknown	ShapiroWilk
Cobalt (mg/L)	CBW-1,PM-1	Yes	0.0034,0.002543,0.003437	NP	NaN	40	0.001067	0.0006253	ln(x)	ShapiroWilk
Combined Radium 226 & 228 (pci/l)	CBW-1,PM-1	No	n/a	NP	NaN	38	3.63	2.647	x^(1/3)	ShapiroWilk
Fluoride (mg/L)	CBW-1,PM-1	No	n/a	NP	NaN	40	0.1575	0.06755	normal	ShapiroWilk
Lead (mg/L)	CBW-1,PM-1	Yes	0.011	NP	NaN	39	0.002929	0.001368	ln(x)	ShapiroWilk
Lithium (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	40	0.004877	0.0007239	unknown	ShapiroWilk
Mercury (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	38	0.0006	0	unknown	ShapiroWilk
Molybdenum (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	36	0.005	0	unknown	ShapiroWilk
pH, Field (pH units)	CBW-1,PM-1	No	n/a	NP	NaN	48	4.749	0.4552	x^(1/3)	ShapiroWilk
Selenium (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	39	0.01	0	unknown	ShapiroWilk
Sulfate (mg/L)	CBW-1,PM-1	No	n/a	NP	NaN	44	45.92	34.93	x^2	ShapiroWilk
Thallium (mg/L)	CBW-1,PM-1	n/a	n/a	NP	NaN	36	0.001	0	unknown	ShapiroWilk
Total Dissolved Solids (mg/L)	CBW-1,PM-1	No	n/a	NP	NaN	48	127.2	38.98	normal	ShapiroWilk


Tukey's Outlier Screening, Pooled Background

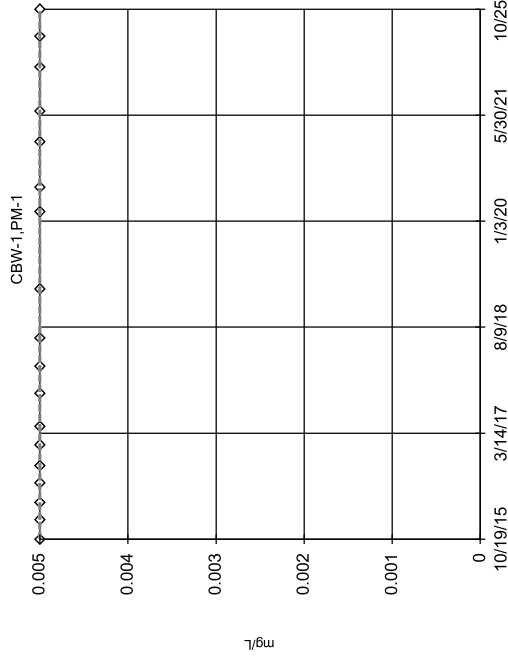

n = 36
 No outliers found. Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 The results were invalid, because the lower and upper quantiles are equal.

Constituent: Antimony Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening, Pooled Background

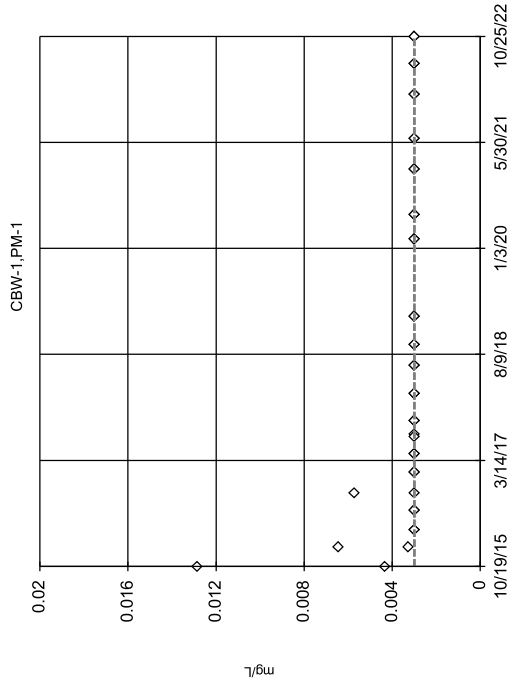

n = 40
 No outliers found. Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 The results were invalid, because the lower and upper quantiles are equal.

Constituent: Arsenic Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening, Pooled Background

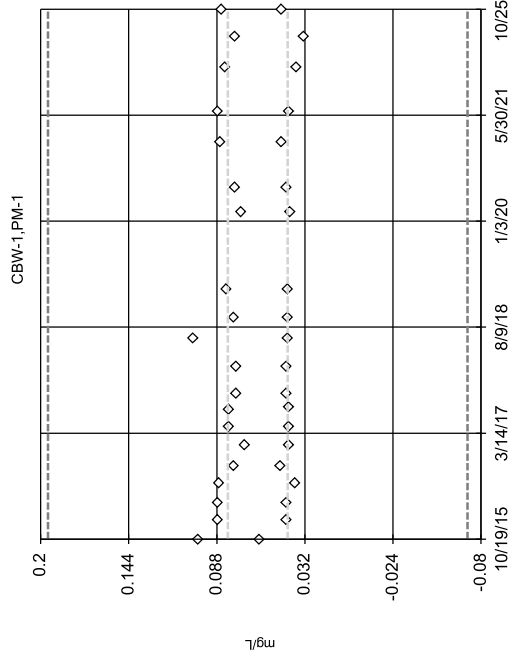

n = 40
 No outliers found. Tukey's method selected by user.
 Leidler of Poiseux transformations did not improve normality; analysis run on raw data.
 High cutoff = 0.1953, low cutoff = -0.0714, based on GKP multiplier of 3.

Constituent: Barium Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening, Pooled Background

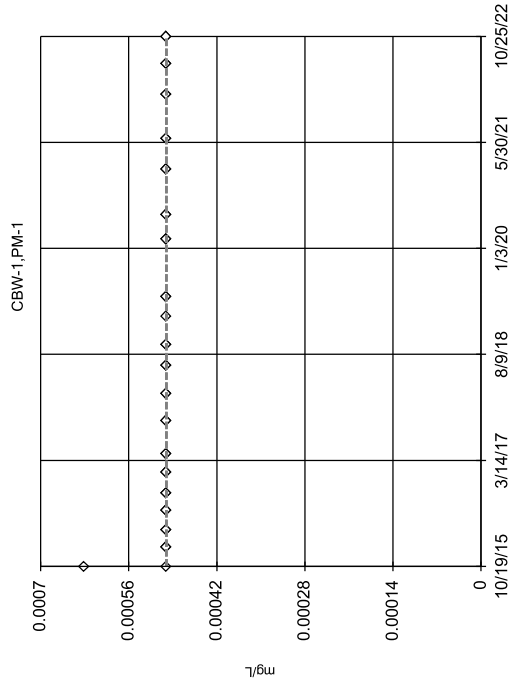

n = 39
 No outliers found. Tukey's method selected by user.
 Data were cube root transformed to achieve best W statistic (graph shown in original units).
 The results were invalid, because the lower and upper quantiles are equal.

Constituent: Beryllium Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening, Pooled Background

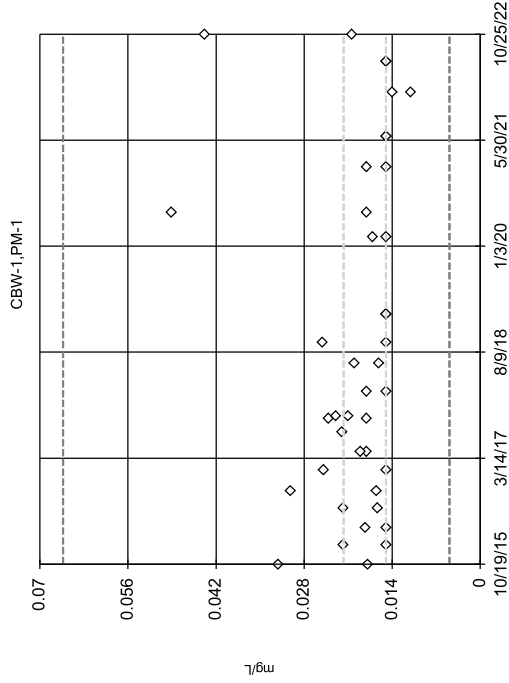

n = 41
 No outliers found.
 Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.06631, low cutoff = 0.00492, based on IQR multiplier of 3.

Constituent: Boron Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening, Pooled Background

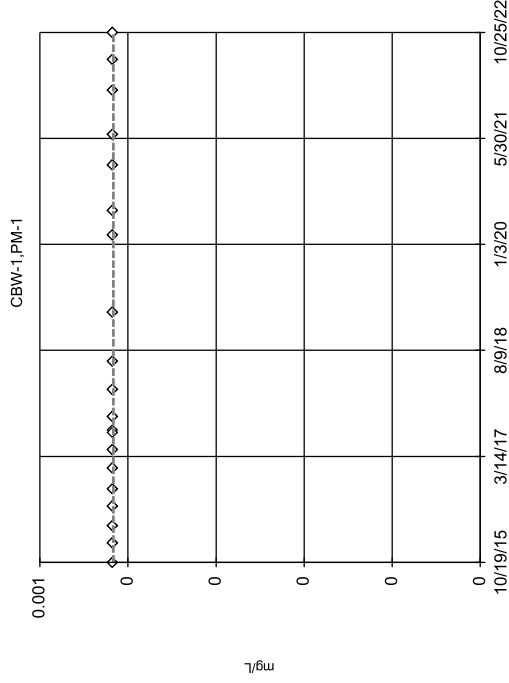

n = 38
 No outliers found.
 Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 The results were inverted, because the lower and upper quartiles are equal.

Constituent: Cadmium Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening, Pooled Background

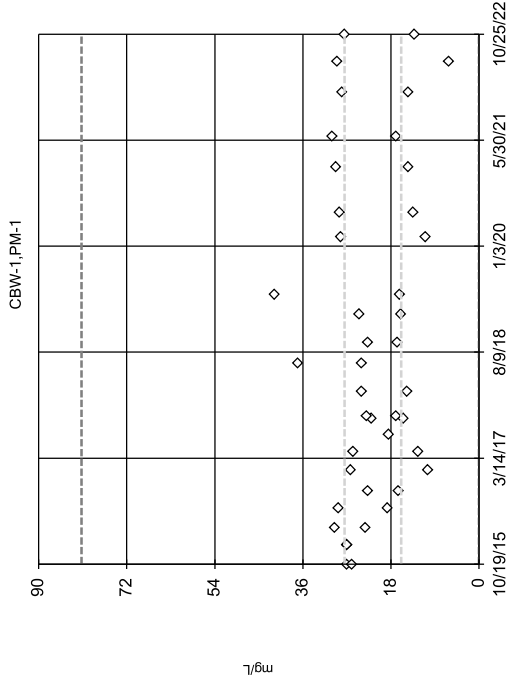

n = 43
 No outliers found.
 Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 81.25, low cutoff = 0.04743, based on IQR multiplier of 3.

Constituent: Calcium Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening, Pooled Background

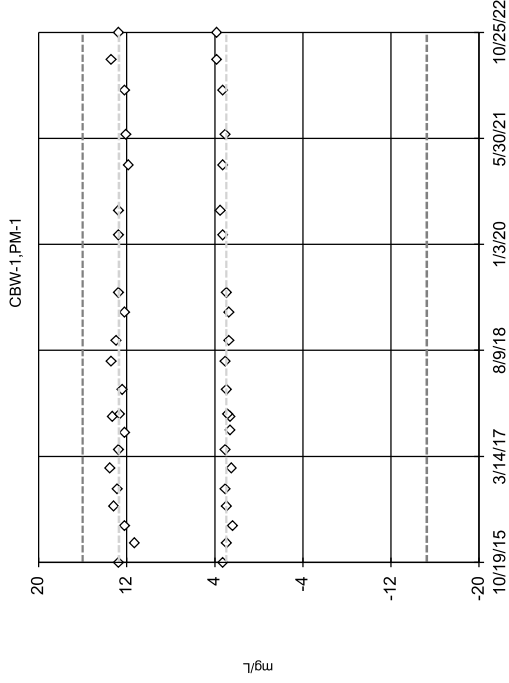

n = 44
 No outliers found.
 Tukey's method selected by user.
 Data were \sqrt{x} transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 16, low cutoff = -15.25, based on IQR multiplier of 3.


Constituent: Chloride Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening, Pooled Background

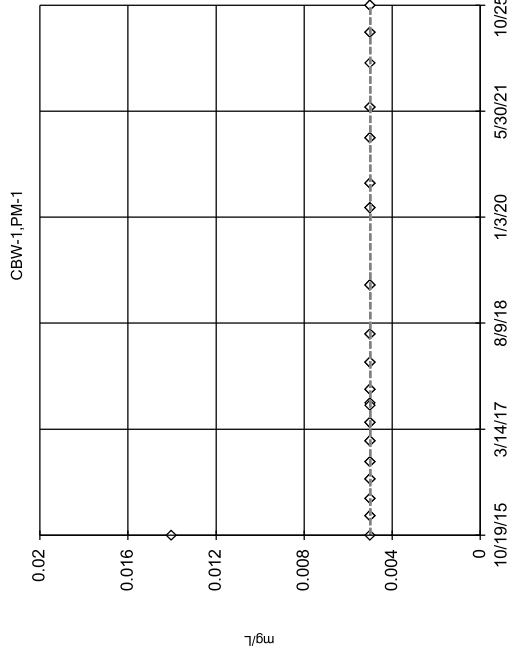


n = 37
 No outliers found.
 Tukey's method selected by user.
 Ladder of Powers transformations did not improve normality; analysis run on raw data.
 The results were invalid, because the lower and upper quantiles are equal.

Tukey's Outlier Screening, Pooled Background

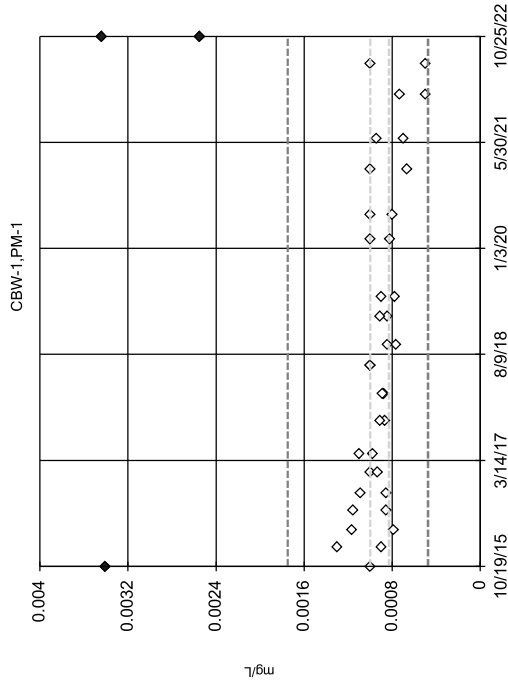


n = 40
 Outliers are drawn as solid.
 Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.001749, low cutoff = 0.0004744, based on IQR multiplier of 3.

Tukey's Outlier Screening, Pooled Background

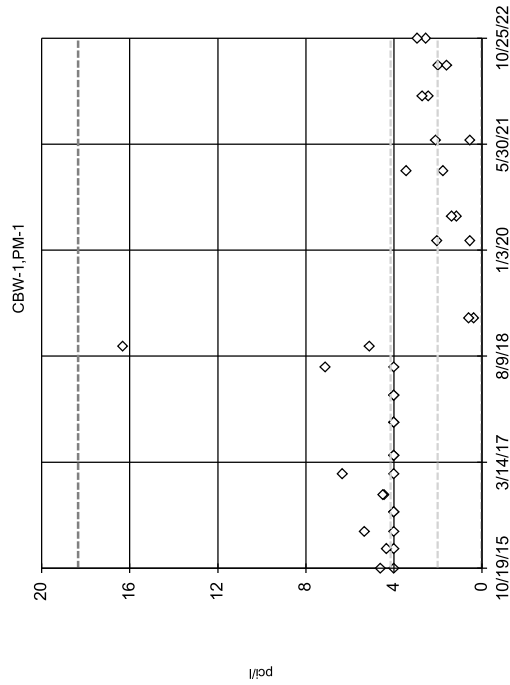


n = 38
 No outliers found.
 Tukey's method selected by user.
 Data were cube root transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 18.35, low cutoff = 0.07282, based on IQR multiplier of 3.

Tukey's Outlier Screening, Pooled Background

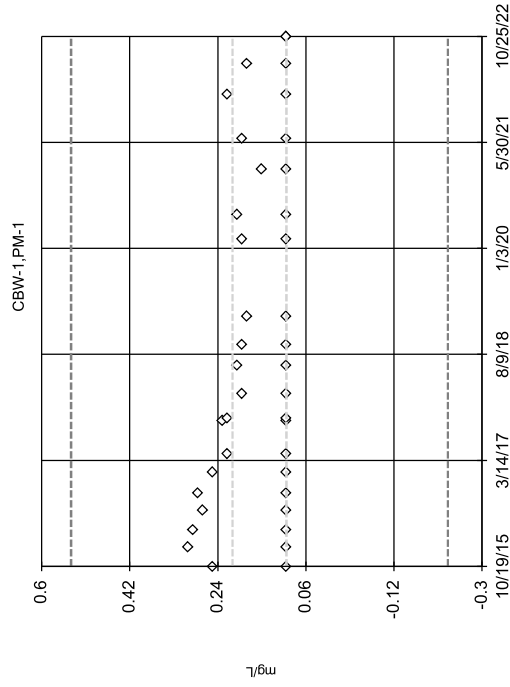


n = 40
 No outliers found.
 Tukey's method selected by user.
 Ladder of Powers transformations did not improve normality; analysis run on raw data.
 High cutoff = 0.54, low cutoff = -0.23, based on IQR multiplier of 3.

Tukey's Outlier Screening, Pooled Background

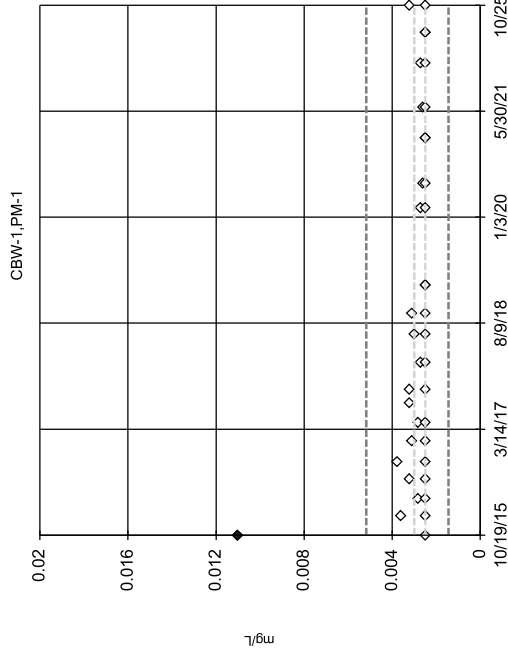


n = 39
 Outlier is drawn as solid. Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.005184, low cutoff = 0.001447 based on IQR multiplier of 3.

Tukey's Outlier Screening, Pooled Background

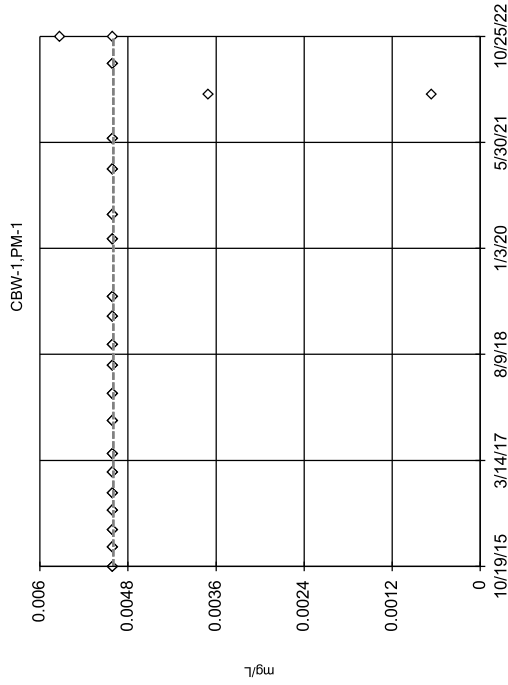


n = 40
 No outliers found. Tukey's method selected by user.
 Data were X²S transformed to achieve best W statistic (graph shown in original units).
 The results were invalidated, because the lower and upper quantiles are equal.

Tukey's Outlier Screening, Pooled Background

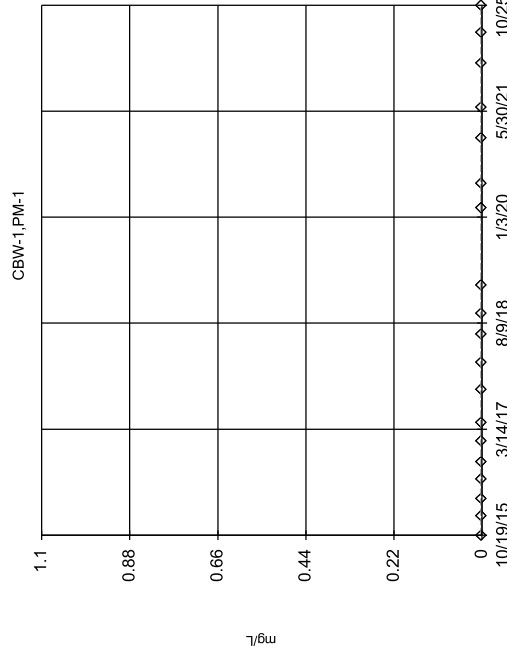


n = 38
 No outliers found. Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 The results were invalidated, because the lower and upper quantiles are equal.

Tukey's Outlier Screening, Pooled Background

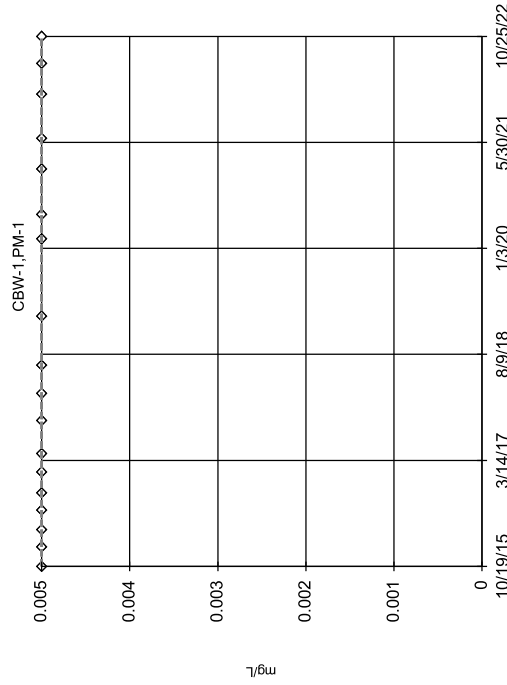


n = 36
 No outliers found. Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 The results were invalidated, because the lower and upper quantiles are equal.

Tukey's Outlier Screening, Pooled Background

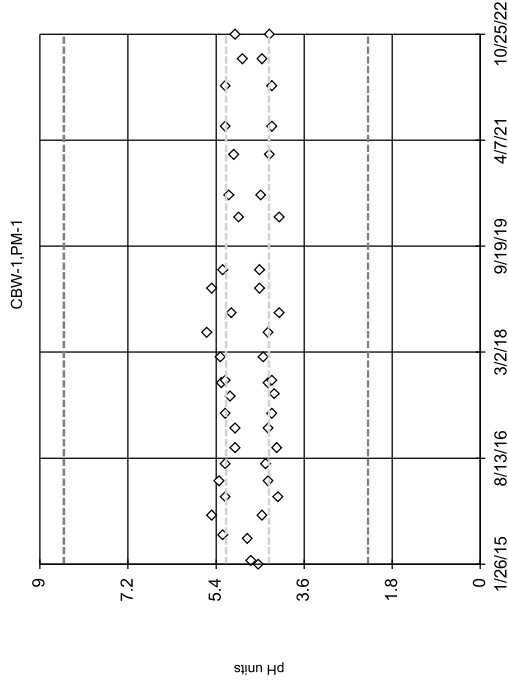


Constituent: pH, Field Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening, Pooled Background

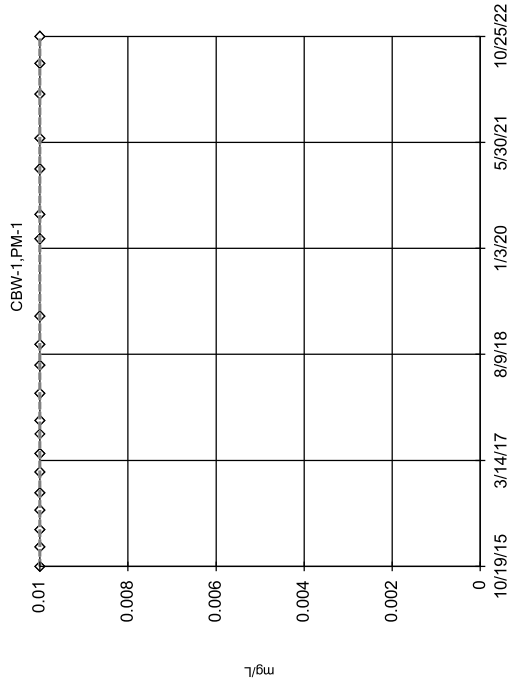


Constituent: Selenium Analysis Run 2/21/2023 1:16 PM View: Outlier Screening - Upgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening, Pooled Background

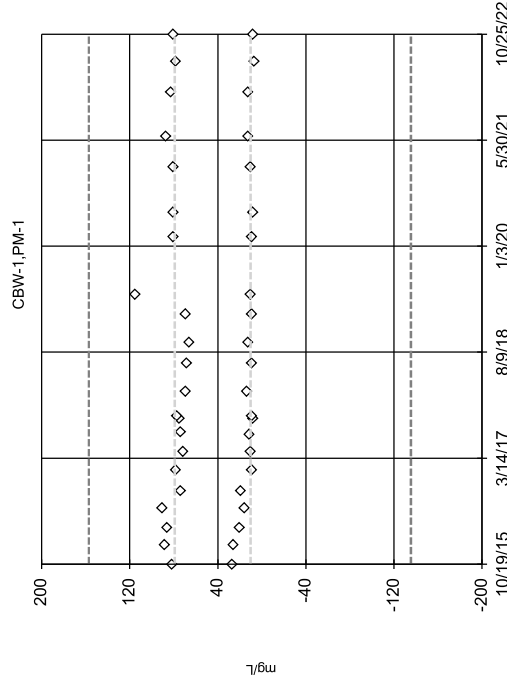


Constituent: Sulfate Analysis Run 2/21/2023 1:17 PM View: Outlier Screening - Upgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening, Pooled Background

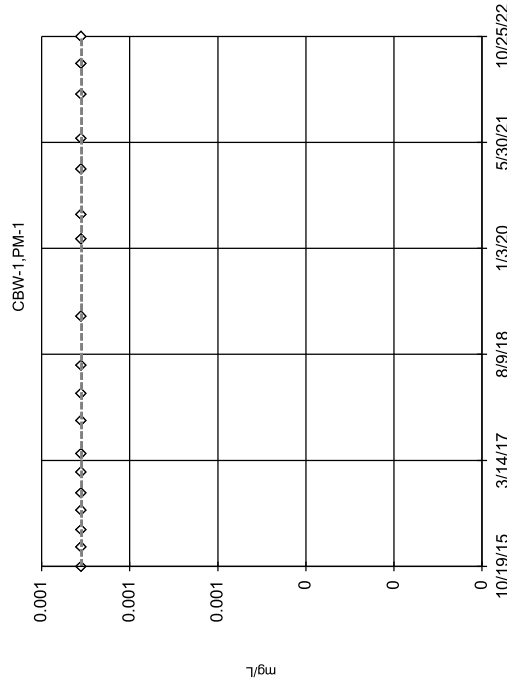

Constituent: Thallium Analysis Run 2/21/2023 1:17 PM View: Outlier Screening - Upgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening, Pooled Background

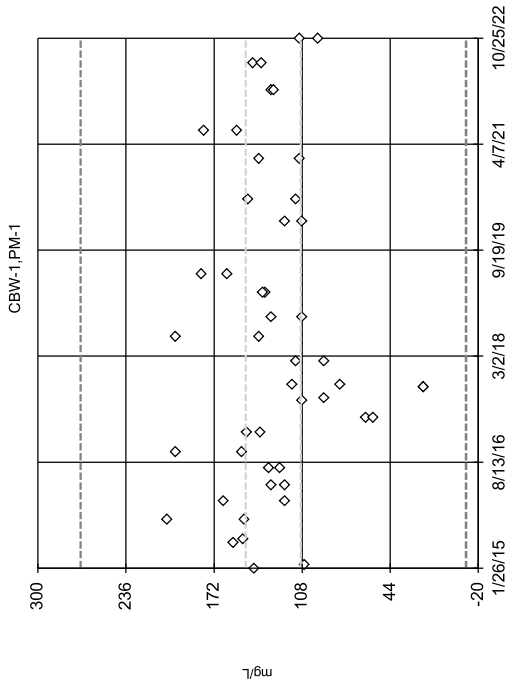

n = 48
No outliers found.
Tukey's method selected by user.
Ladder of Powers transformations did not improve normality; analysis run on raw data.
High cutoff = 269, low cutoff = -11, based on IQR multiplier of 3.

Constituent: Total Dissolved Solids - Analysis Run 2/21/2023 1:17 PM View: Outlier Screening - Upgradient
CGYP Client: Santee Cooper Data: CGYP

Outlier Analysis (Downgradient) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:39 PM

<u>Constituent</u>	<u>Well</u>	<u>Outlier</u>	<u>Value(s)</u>	<u>Method</u>	<u>Alpha</u>	<u>N</u>	<u>Mean</u>	<u>Std. Dev.</u>	<u>Distribution</u>	<u>Normality Test</u>
Lead (mg/L)	CGYP-3	Yes	0.092	NP	NaN	14	0.02979	0.01886	ln(x)	ShapiroWilk
Mercury (mg/L)	CGYP-3	Yes	0.00047,0.00023	NP	NaN	14	0.0002221	0.00007181	ln(x)	ShapiroWilk
Selenium (mg/L)	CGYP-3	Yes	0.0067	NP	NaN	14	0.04341	0.01401	normal	ShapiroWilk

Outlier Analysis (Downgradient) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:39 PM

Constituent	Well	Outlier	Value(s)	Method	Alpha	N	Mean	Std. Dev.	Distribution	Normality Test
Arsenic (mg/L)	CGYP-1	No	n/a	NP	NaN	14	0.02374	0.01353	sqrt(x)	ShapiroWilk
Arsenic (mg/L)	CGYP-2	No	n/a	NP	NaN	14	0.0174	0.007413	x^2	ShapiroWilk
Arsenic (mg/L)	CGYP-3	No	n/a	NP	NaN	14	0.01613	0.004832	x^3	ShapiroWilk
Arsenic (mg/L)	CGYP-4	No	n/a	NP	NaN	10	0.00951	0.002739	x^6	ShapiroWilk
Barium (mg/L)	CGYP-1	No	n/a	NP	NaN	14	0.04754	0.01544	ln(x)	ShapiroWilk
Barium (mg/L)	CGYP-2	No	n/a	NP	NaN	14	0.02628	0.01231	normal	ShapiroWilk
Barium (mg/L)	CGYP-3	No	n/a	NP	NaN	14	0.04306	0.01198	x^2	ShapiroWilk
Barium (mg/L)	CGYP-4	No	n/a	NP	NaN	10	0.03374	0.007493	x^2	ShapiroWilk
Barium (mg/L)	CGYP-6	No	n/a	NP	NaN	10	0.5024	0.1902	x^(1/3)	ShapiroWilk
Beryllium (mg/L)	CGYP-1	No	n/a	NP	NaN	14	0.008379	0.002833	x^2	ShapiroWilk
Beryllium (mg/L)	CGYP-2	No	n/a	NP	NaN	14	0.003771	0.001159	ln(x)	ShapiroWilk
Beryllium (mg/L)	CGYP-3	No	n/a	NP	NaN	14	0.03155	0.00876	x^(1/3)	ShapiroWilk
Beryllium (mg/L)	CGYP-4	No	n/a	NP	NaN	10	0.01596	0.001515	x^3	ShapiroWilk
Beryllium (mg/L)	CGYP-6	No	n/a	NP	NaN	10	0.02238	0.002883	ln(x)	ShapiroWilk
Boron (mg/L)	CGYP-1	No	n/a	NP	NaN	15	9.889	2.254	x^2	ShapiroWilk
Boron (mg/L)	CGYP-2	No	n/a	NP	NaN	15	1.455	0.5331	x^2	ShapiroWilk
Boron (mg/L)	CGYP-3	No	n/a	NP	NaN	15	19	3.721	x^2	ShapiroWilk
Boron (mg/L)	CGYP-4	No	n/a	NP	NaN	10	6.964	1.164	x^5	ShapiroWilk
Boron (mg/L)	CGYP-6	No	n/a	NP	NaN	10	6.471	0.6537	x^6	ShapiroWilk
Cadmium (mg/L)	CGYP-1	n/a	n/a	NP	NaN	14	0.003871	0.0004811	unknown	ShapiroWilk
Cadmium (mg/L)	CGYP-2	n/a	n/a	NP	NaN	14	0.003814	0.0006949	unknown	ShapiroWilk
Cadmium (mg/L)	CGYP-3	No	n/a	NP	NaN	14	0.001974	0.0016	ln(x)	ShapiroWilk
Cadmium (mg/L)	CGYP-4	n/a	n/a	NP	NaN	10	0.00368	0.001012	unknown	ShapiroWilk
Cadmium (mg/L)	CGYP-6	n/a	n/a	NP	NaN	10	0.00366	0.001075	unknown	ShapiroWilk
Calcium (mg/L)	CGYP-1	No	n/a	NP	NaN	15	245.4	49.18	ln(x)	ShapiroWilk
Calcium (mg/L)	CGYP-2	No	n/a	NP	NaN	15	275.5	29.78	x^6	ShapiroWilk
Calcium (mg/L)	CGYP-3	No	n/a	NP	NaN	15	594.9	102.6	x^(1/3)	ShapiroWilk
Calcium (mg/L)	CGYP-4	No	n/a	NP	NaN	10	304.5	41.04	x^4	ShapiroWilk
Calcium (mg/L)	CGYP-6	No	n/a	NP	NaN	10	431.4	42.23	x^6	ShapiroWilk
Chloride (mg/L)	CGYP-1	No	n/a	NP	NaN	15	699.1	52.27	ln(x)	ShapiroWilk
Chloride (mg/L)	CGYP-2	No	n/a	NP	NaN	15	111.4	41.44	normal	ShapiroWilk
Chloride (mg/L)	CGYP-3	No	n/a	NP	NaN	15	1108	192.3	ln(x)	ShapiroWilk
Chloride (mg/L)	CGYP-4	No	n/a	NP	NaN	10	583	91.11	ln(x)	ShapiroWilk
Chloride (mg/L)	CGYP-6	No	n/a	NP	NaN	10	1026	94.91	x^6	ShapiroWilk
Chromium (mg/L)	CGYP-3	No	n/a	NP	NaN	14	0.006021	0.00117	ln(x)	ShapiroWilk
Cobalt (mg/L)	CGYP-1	No	n/a	NP	NaN	14	0.04087	0.0127	x^2	ShapiroWilk
Cobalt (mg/L)	CGYP-2	No	n/a	NP	NaN	14	0.0232	0.009849	sqrt(x)	ShapiroWilk
Cobalt (mg/L)	CGYP-3	No	n/a	NP	NaN	14	0.1104	0.03418	normal	ShapiroWilk
Cobalt (mg/L)	CGYP-4	No	n/a	NP	NaN	10	0.04224	0.01147	x^6	ShapiroWilk
Cobalt (mg/L)	CGYP-6	No	n/a	NP	NaN	10	0.1415	0.01754	x^6	ShapiroWilk
Combined Radium 226 & 228 (pci/l)	CGYP-1	No	n/a	NP	NaN	14	3.909	1.115	ln(x)	ShapiroWilk
Combined Radium 226 & 228 (pci/l)	CGYP-2	No	n/a	NP	NaN	14	2.604	1.038	ln(x)	ShapiroWilk
Combined Radium 226 & 228 (pci/l)	CGYP-3	No	n/a	NP	NaN	14	5.594	1.264	sqrt(x)	ShapiroWilk
Combined Radium 226 & 228 (pci/l)	CGYP-4	No	n/a	NP	NaN	10	4.802	1.024	x^2	ShapiroWilk
Combined Radium 226 & 228 (pci/l)	CGYP-6	No	n/a	NP	NaN	10	5.961	1.907	x^(1/3)	ShapiroWilk
Fluoride (mg/L)	CGYP-1	No	n/a	NP	NaN	15	0.9713	0.2987	ln(x)	ShapiroWilk
Fluoride (mg/L)	CGYP-2	No	n/a	NP	NaN	15	0.742	0.4392	normal	ShapiroWilk
Fluoride (mg/L)	CGYP-3	No	n/a	NP	NaN	15	2.141	1.65	sqrt(x)	ShapiroWilk
Fluoride (mg/L)	CGYP-4	No	n/a	NP	NaN	10	1.686	0.8082	x^(1/3)	ShapiroWilk
Fluoride (mg/L)	CGYP-6	No	n/a	NP	NaN	10	0.744	0.2647	x^2	ShapiroWilk
Lead (mg/L)	CGYP-1	No	n/a	NP	NaN	14	0.01321	0.008213	ln(x)	ShapiroWilk
Lead (mg/L)	CGYP-2	No	n/a	NP	NaN	14	0.02149	0.005549	x^4	ShapiroWilk
Lead (mg/L)	CGYP-3	Yes	0.092	NP	NaN	14	0.02979	0.01886	ln(x)	ShapiroWilk
Lead (mg/L)	CGYP-4	No	n/a	NP	NaN	10	0.01243	0.002945	x^4	ShapiroWilk
Lead (mg/L)	CGYP-6	No	n/a	NP	NaN	10	0.0107	0.004328	x^3	ShapiroWilk


Outlier Analysis (Downgradient) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:39 PM

Constituent	Well	Outlier	Value(s)	Method	Alpha	N	Mean	Std. Dev.	Distribution	Normality Test
Lithium (mg/L)	CGYP-1	No	n/a	NP	NaN	14	0.01673	0.006667	sqrt(x)	ShapiroWilk
Lithium (mg/L)	CGYP-2	No	n/a	NP	NaN	14	0.01271	0.002405	x^6	ShapiroWilk
Lithium (mg/L)	CGYP-3	No	n/a	NP	NaN	14	0.07953	0.02496	normal	ShapiroWilk
Lithium (mg/L)	CGYP-4	No	n/a	NP	NaN	10	0.05758	0.008143	x^5	ShapiroWilk
Lithium (mg/L)	CGYP-6	No	n/a	NP	NaN	10	0.1245	0.01495	normal	ShapiroWilk
Mercury (mg/L)	CGYP-1	n/a	n/a	NP	NaN	14	0.0002	1.4e-12	unknown	ShapiroWilk
Mercury (mg/L)	CGYP-3	Yes	0.00047,0.00023	NP	NaN	14	0.0002221	0.00007181	ln(x)	ShapiroWilk
pH, Field (pH units)	CGYP-1	No	n/a	NP	NaN	15	4.054	0.2163	x^2	ShapiroWilk
pH, Field (pH units)	CGYP-2	No	n/a	NP	NaN	15	3.833	0.1302	ln(x)	ShapiroWilk
pH, Field (pH units)	CGYP-3	No	n/a	NP	NaN	15	3.723	0.1781	normal	ShapiroWilk
pH, Field (pH units)	CGYP-4	No	n/a	NP	NaN	10	3.729	0.1253	ln(x)	ShapiroWilk
pH, Field (pH units)	CGYP-6	No	n/a	NP	NaN	10	3.672	0.1245	ln(x)	ShapiroWilk
Selenium (mg/L)	CGYP-1	No	n/a	NP	NaN	14	0.03749	0.01572	ln(x)	ShapiroWilk
Selenium (mg/L)	CGYP-2	No	n/a	NP	NaN	14	0.04129	0.01537	normal	ShapiroWilk
Selenium (mg/L)	CGYP-3	Yes	0.0067	NP	NaN	14	0.04341	0.01401	normal	ShapiroWilk
Selenium (mg/L)	CGYP-4	n/a	n/a	NP	NaN	10	0.04586	0.0131	unknown	ShapiroWilk
Sulfate (mg/L)	CGYP-1	No	n/a	NP	NaN	15	446.9	87.96	ln(x)	ShapiroWilk
Sulfate (mg/L)	CGYP-2	No	n/a	NP	NaN	15	935.6	48.54	normal	ShapiroWilk
Sulfate (mg/L)	CGYP-3	No	n/a	NP	NaN	15	964.3	38.94	x^6	ShapiroWilk
Sulfate (mg/L)	CGYP-4	No	n/a	NP	NaN	10	602.4	22.85	ln(x)	ShapiroWilk
Sulfate (mg/L)	CGYP-6	No	n/a	NP	NaN	10	92.24	16.1	ln(x)	ShapiroWilk
Total Dissolved Solids (mg/L)	CGYP-1	No	n/a	NP	NaN	15	1902	283.6	ln(x)	ShapiroWilk
Total Dissolved Solids (mg/L)	CGYP-2	No	n/a	NP	NaN	15	1551	65.34	x^6	ShapiroWilk
Total Dissolved Solids (mg/L)	CGYP-3	No	n/a	NP	NaN	15	3617	596.8	ln(x)	ShapiroWilk
Total Dissolved Solids (mg/L)	CGYP-4	No	n/a	NP	NaN	10	1863	233.6	ln(x)	ShapiroWilk
Total Dissolved Solids (mg/L)	CGYP-6	No	n/a	NP	NaN	10	2743	566.3	ln(x)	ShapiroWilk

Tukey's Outlier Screening

CGYP-2

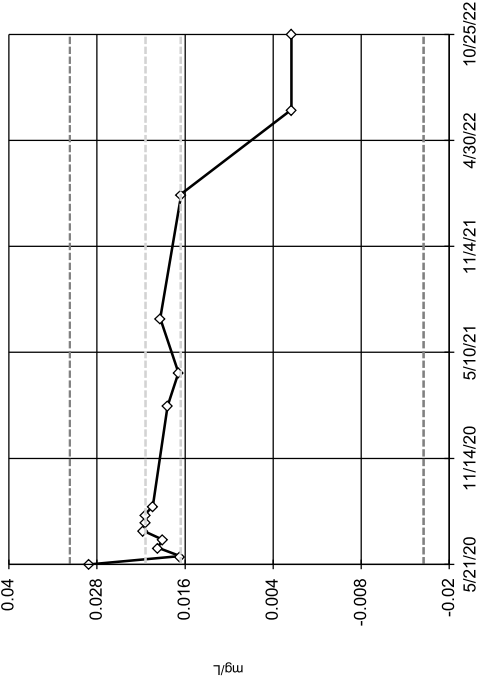

n = 14

No outliers found.
Tukey's method selected by user.


Data were square root transformed to achieve best W statistic (graph shown in original units).

High cutoff = 0.0317
low cutoff = -0.01648, based on IQR multiplier of 3.

Constituent: Arsenic Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-1

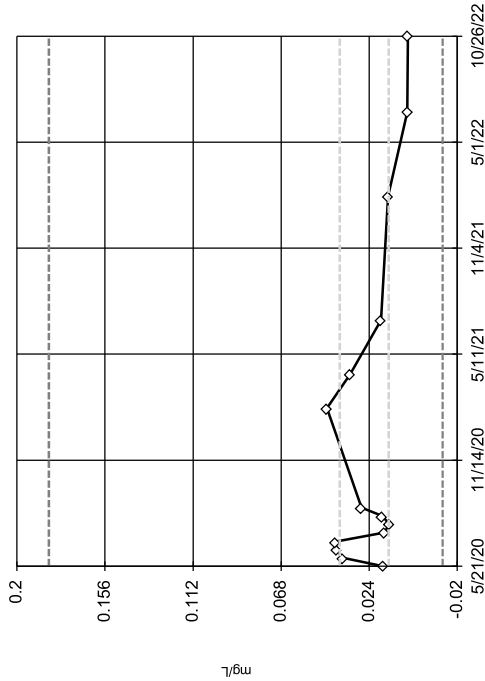

n = 14

No outliers found.
Tukey's method selected by user.


Data were square root transformed to achieve best W statistic (graph shown in original units).

High cutoff = 0.184
low cutoff = -0.01265, based on IQR multiplier of 3.

Constituent: Arsenic Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-4

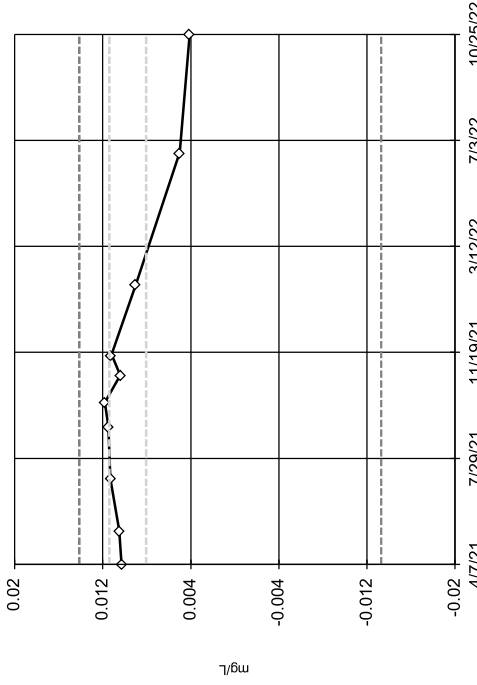

n = 10

No outliers found.
Tukey's method selected by user.


Data were cube transformed to achieve best W statistic (graph shown in original units).

High cutoff = 0.01413
low cutoff = -0.01329, based on IQR multiplier of 3.

Constituent: Arsenic Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-3

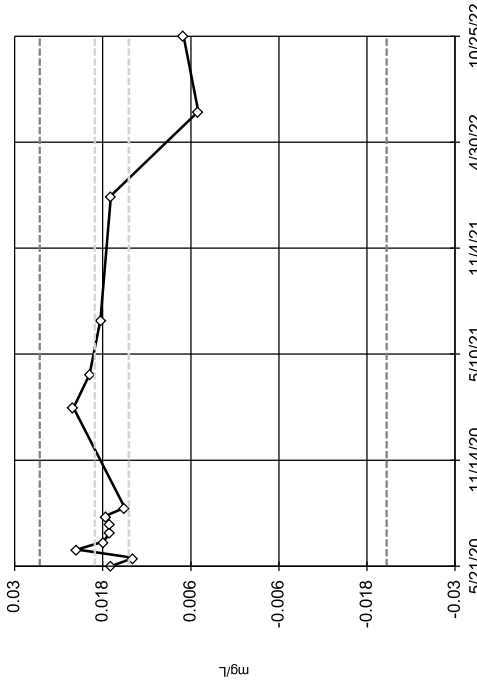

n = 14

No outliers found.
Tukey's method selected by user.


Data were cube transformed to achieve best W statistic (graph shown in original units).

High cutoff = 0.02658
low cutoff = -0.02067, based on IQR multiplier of 3.

Constituent: Arsenic Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-1

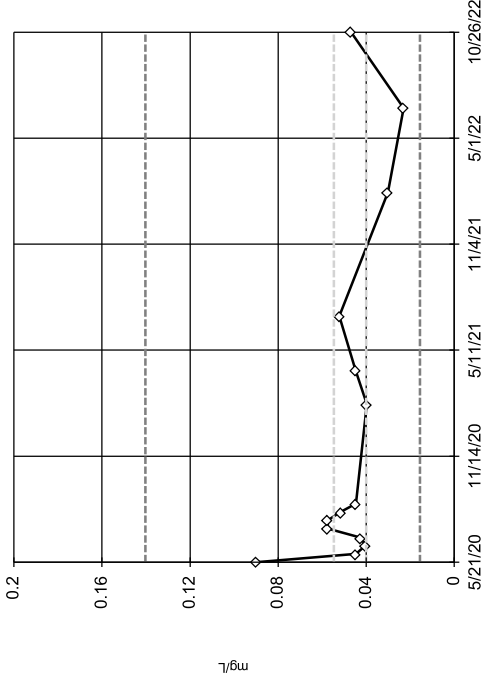


n = 14
 No outliers found.
 Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.1403.
 Low cutoff = 0.01561.
 based on IQR multiplier of 3.

Constituent: Barium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-2

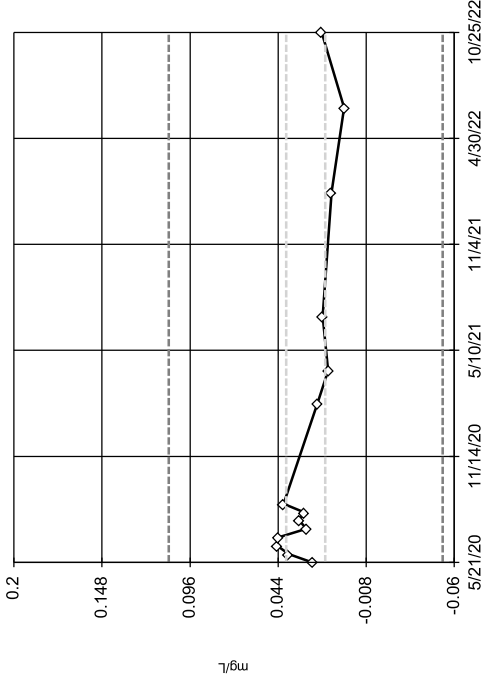


n = 14
 No outliers found.
 Tukey's method selected by user.
 Ladder of Powers transformations did not improve normality; analysis run on raw data.
 High cutoff = 0.1086.
 Low cutoff = -0.05315.
 based on IQR multiplier of 3.

Constituent: Barium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-3

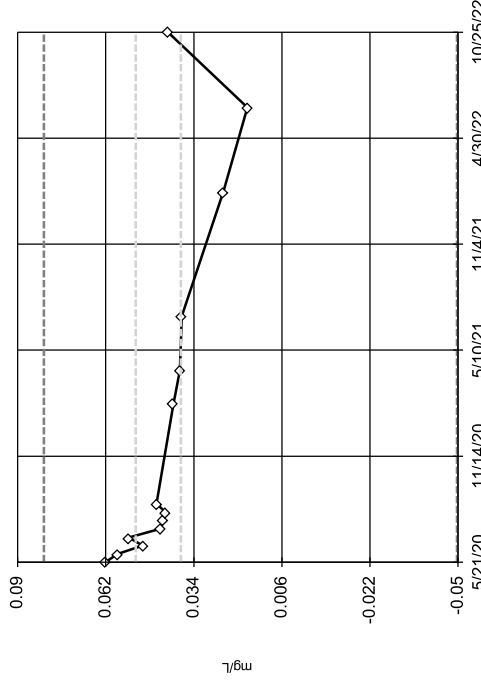


n = 14
 No outliers found.
 Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.08166.
 Low cutoff = -0.04961.
 based on IQR multiplier of 3.

Constituent: Barium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-4

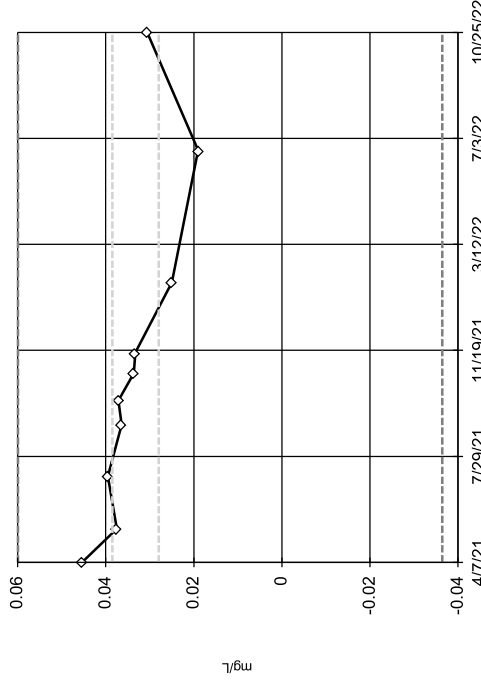

n = 10
 No outliers found.
 Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.00992.
 Low cutoff = -0.03643.
 based on IQR multiplier of 3.


Constituent: Barium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

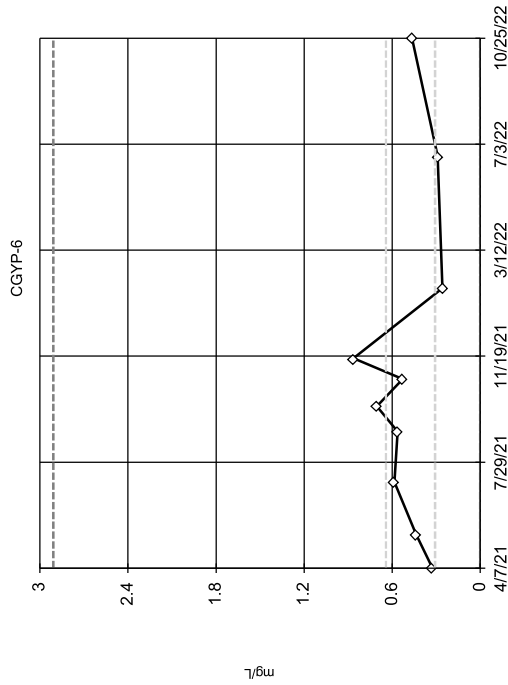


Constituent: Barium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

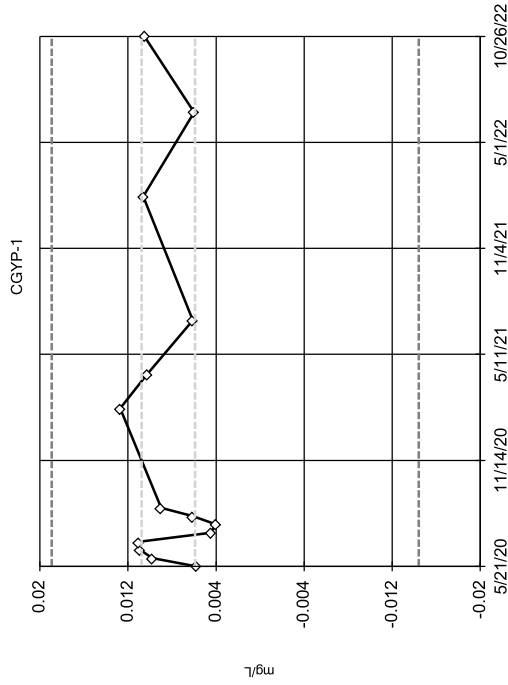


Constituent: Beryllium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

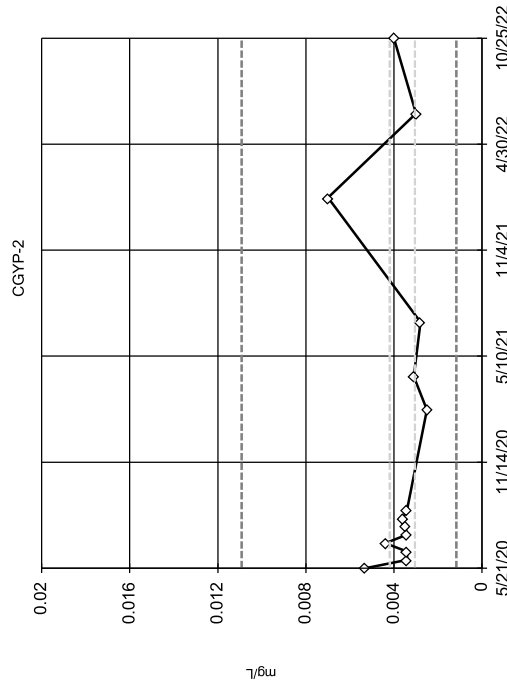


Constituent: Beryllium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

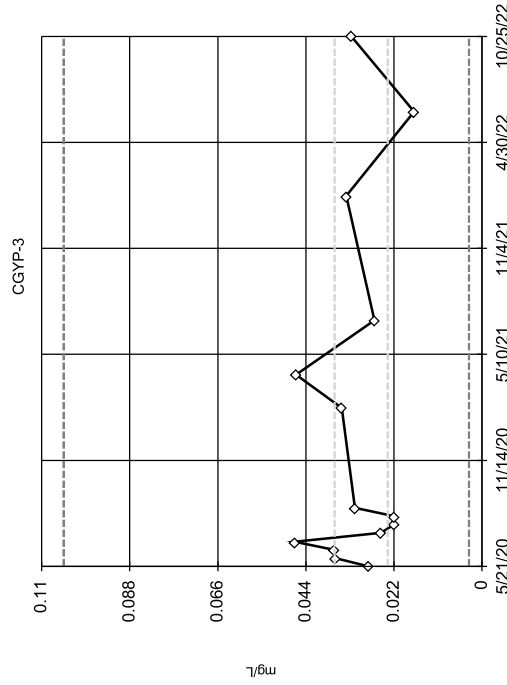


Constituent: Beryllium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

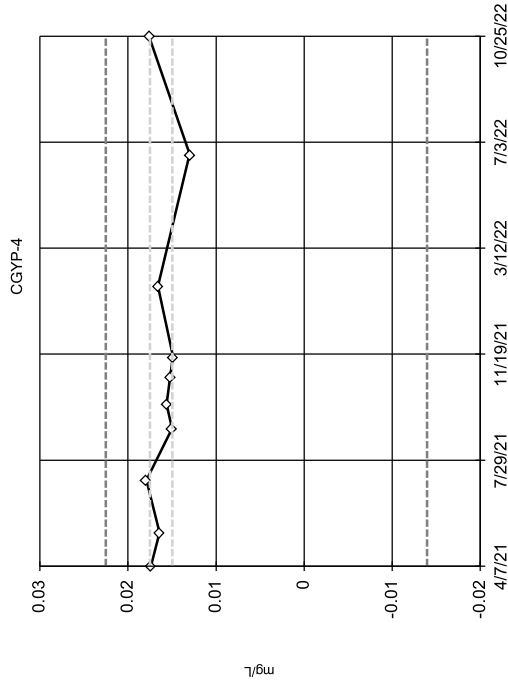


Constituent: Beryllium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

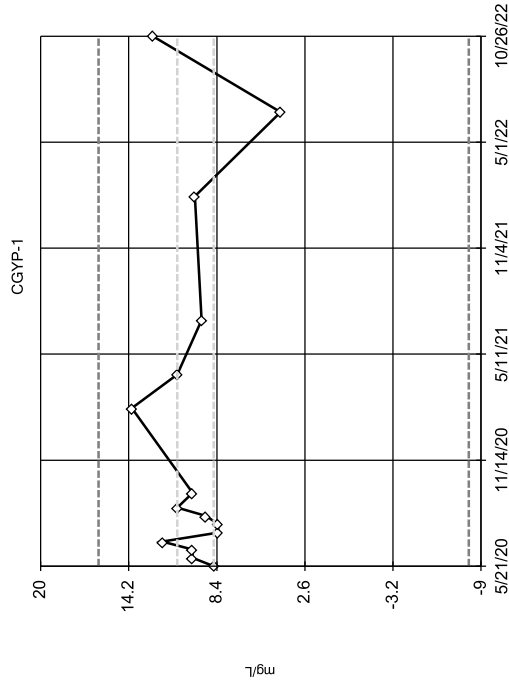


Constituent: Boron Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

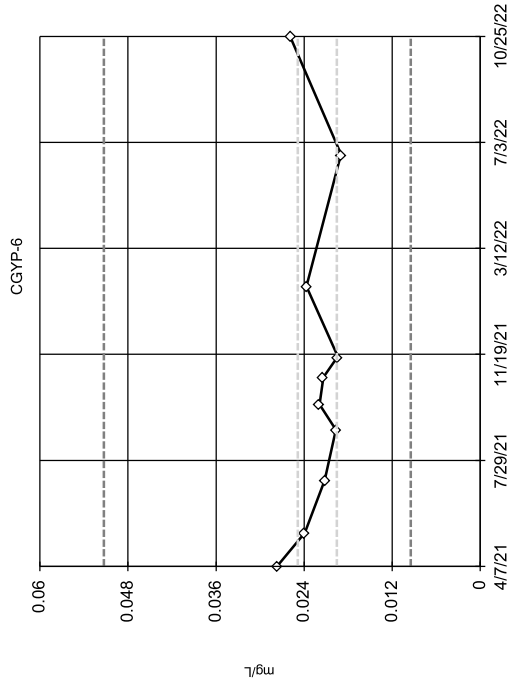


Constituent: Beryllium Analysis Run 2/21/2023 1:36 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

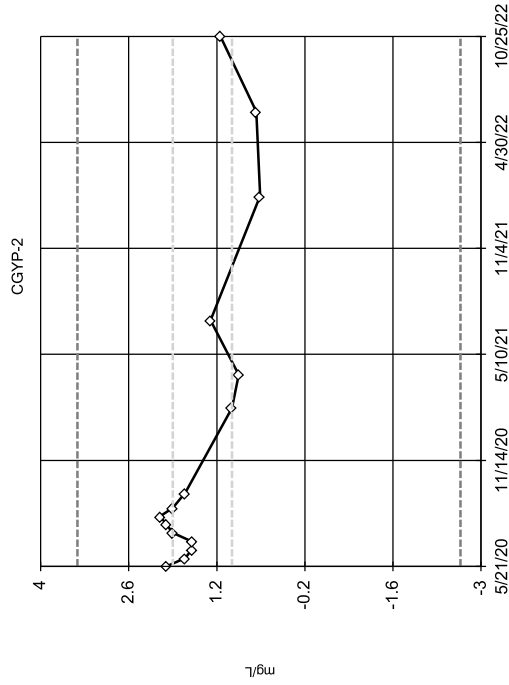

Constituent: Boron Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening CGYP-3

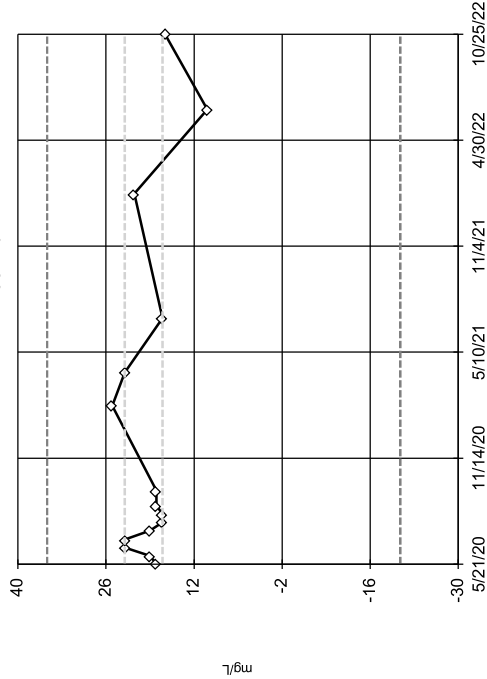

n = 15
No outliers found.
Tukey's method selected by user.
Data were square transformed to achieve best W statistic (graph shown in original units).
High cutoff = 35.34, low cutoff = -20.76, based on IQR multiplier of 3.

Constituent: Boron Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening CGYP-6

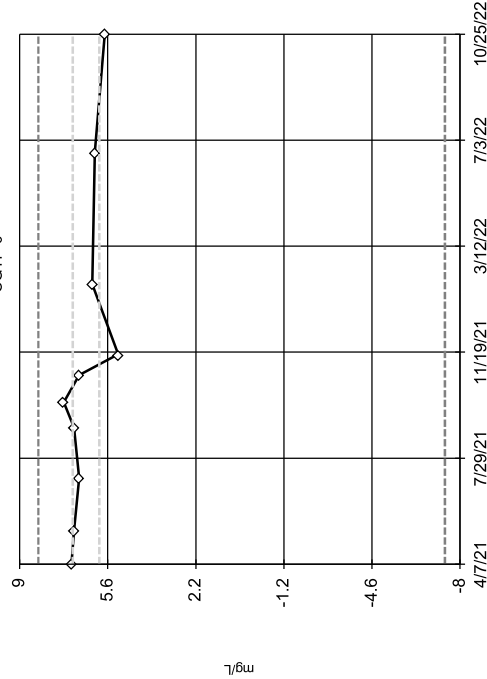

n = 10
No outliers found.
Tukey's method selected by user.
Data were $\sqrt{x^5}$ transformed to achieve best W statistic (graph shown in original units).
High cutoff = 8.278, low cutoff = -7.413, based on IQR multiplier of 3.

Constituent: Boron Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening CGYP-4

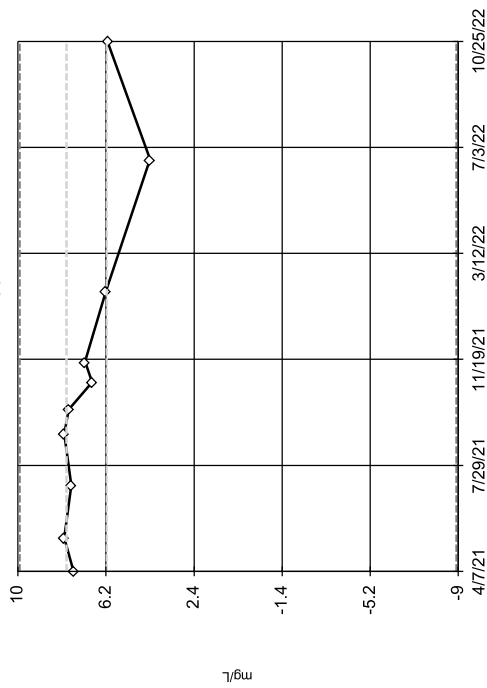

n = 10
No outliers found.
Tukey's method selected by user.
Data were $\sqrt{x^5}$ transformed to achieve best W statistic (graph shown in original units).
High cutoff = 9.928, low cutoff = -8.927, based on IQR multiplier of 3.

Constituent: Boron Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening CGYP-1

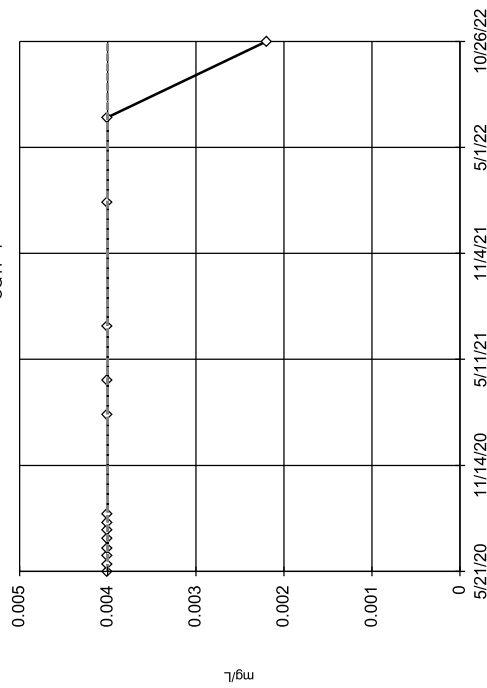


n = 14
No outliers found.
Tukey's method selected by user.
Data were $\sqrt{x^5}$ transformed to achieve best W statistic (graph shown in original units).
The results were invalid, because the lower and upper quantiles are equal.

Constituent: Cadmium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-2

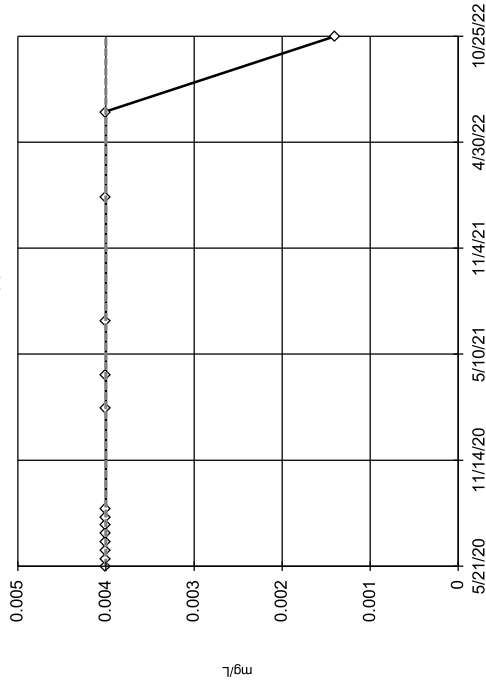

Constituent: Cadmium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-4

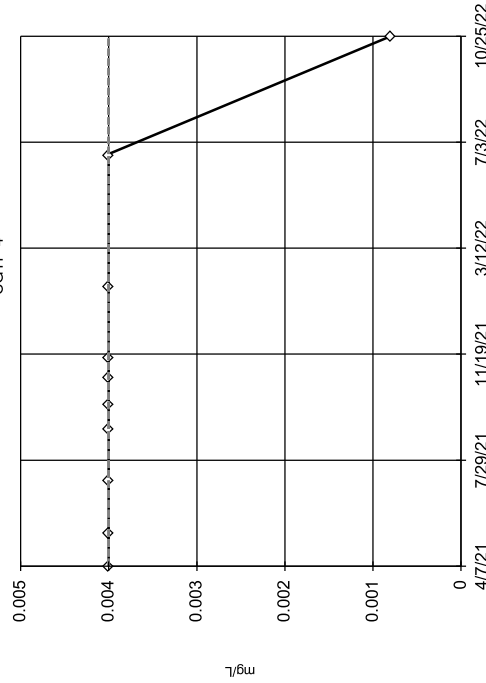

Constituent: Cadmium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-3

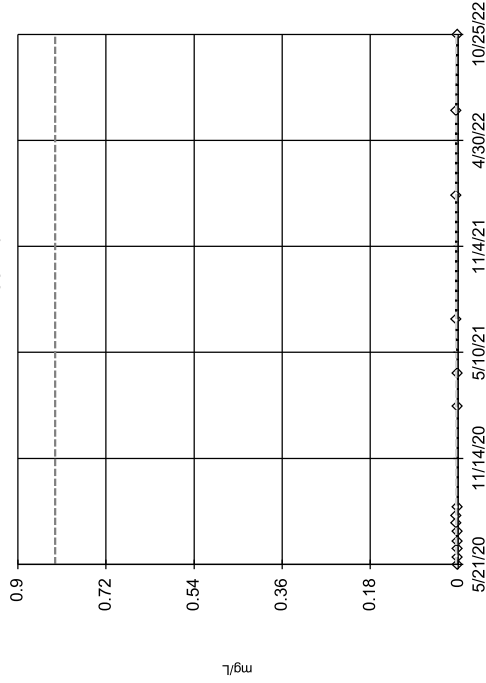

Constituent: Cadmium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening

CGYP-6

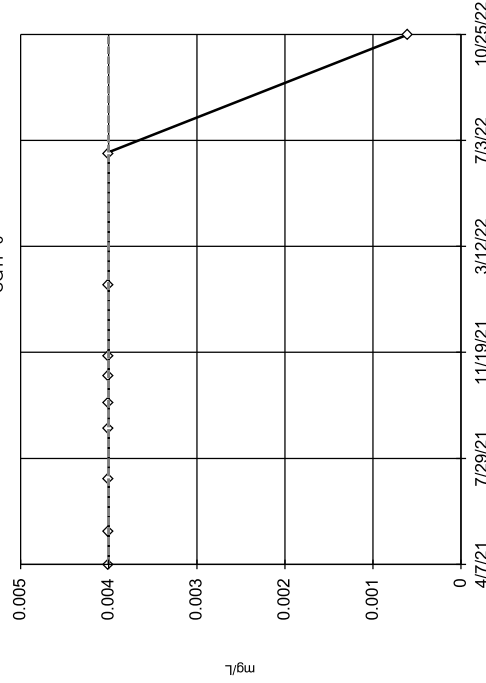

Constituent: Cadmium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening

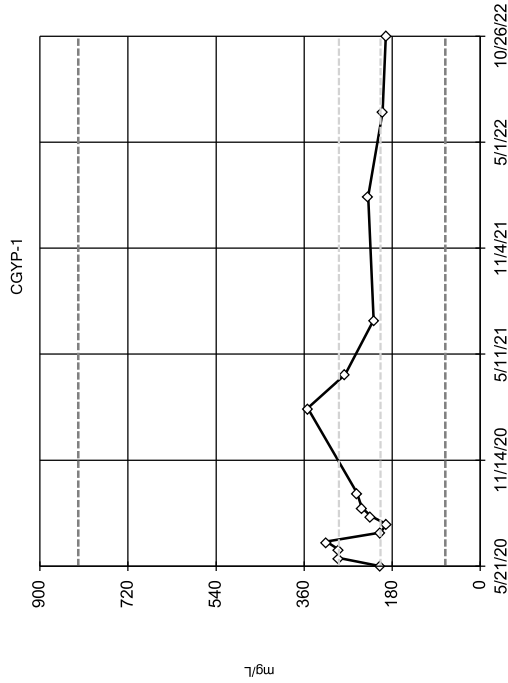

n = 15
 No outliers found.
 Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 821.7, low cutoff = 71.75, based on IQR multiplier of 3.

Constituent: Calcium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening

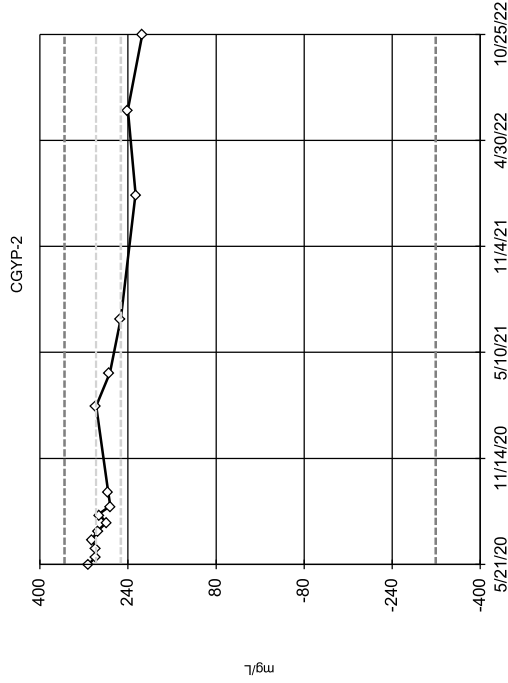

n = 15
 No outliers found.
 Tukey's method selected by user.
 Data were x*6 transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 365.4, low cutoff = -318.2, based on IQR multiplier of 3.

Constituent: Calcium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening

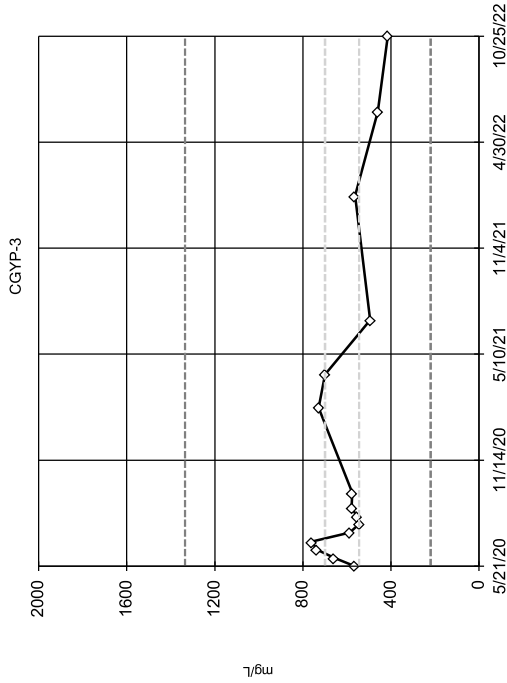

n = 15
 No outliers found.
 Tukey's method selected by user.
 Data were cube root transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 1335, low cutoff = 219.9, based on IQR multiplier of 3.

Constituent: Calcium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening

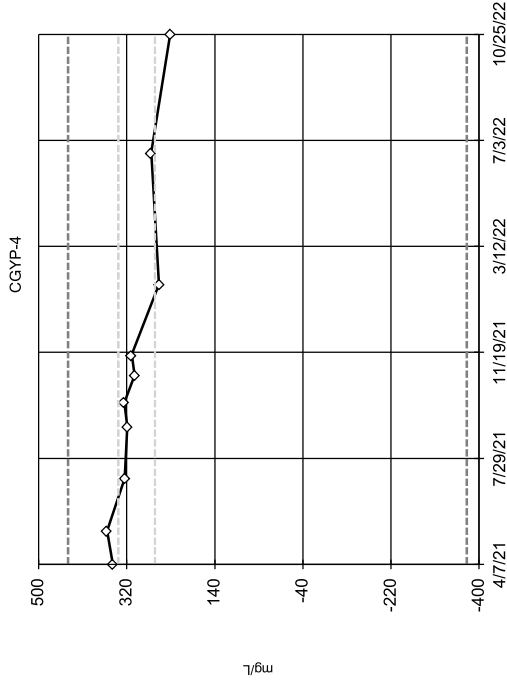

n = 10
 No outliers found.
 Tukey's method selected by user.
 Data were x*4 transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 439.9, low cutoff = -375, based on IQR multiplier of 3.


Constituent: Calcium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

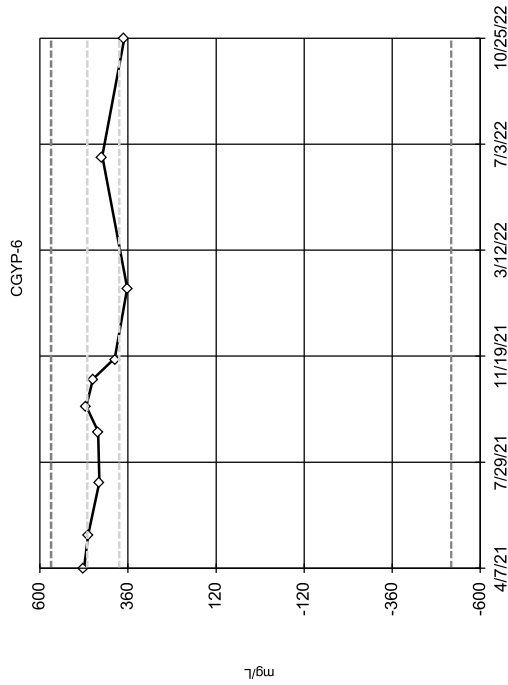


Constituent: Calcium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

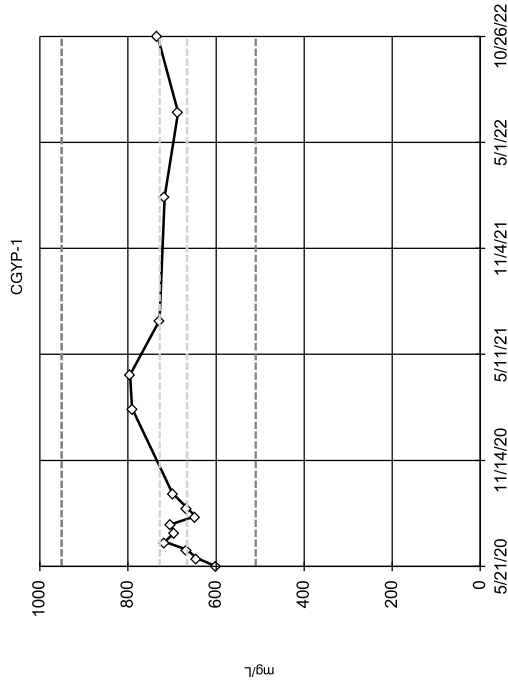


Constituent: Chloride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

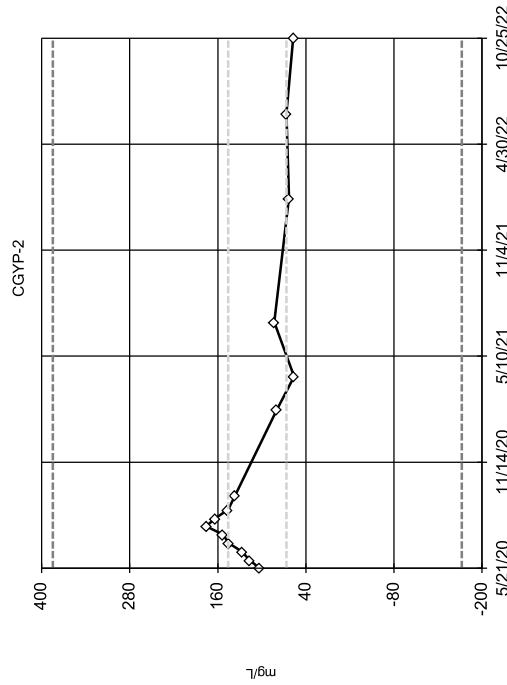

Constituent: Chloride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening

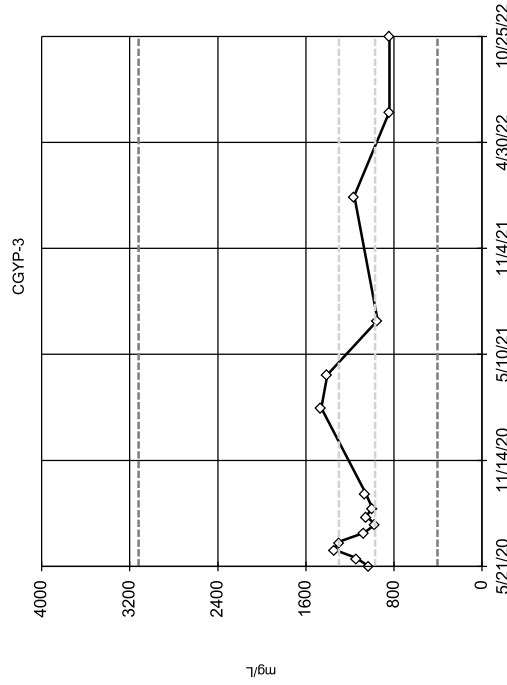

Constituent: Chloride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-4

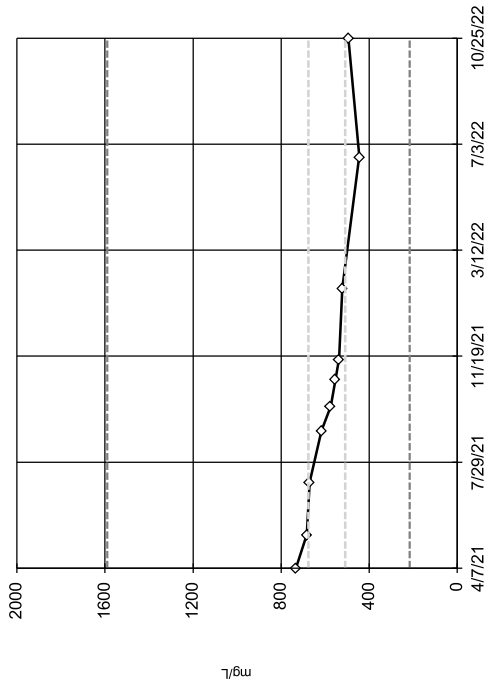

Constituent: Chloride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-6

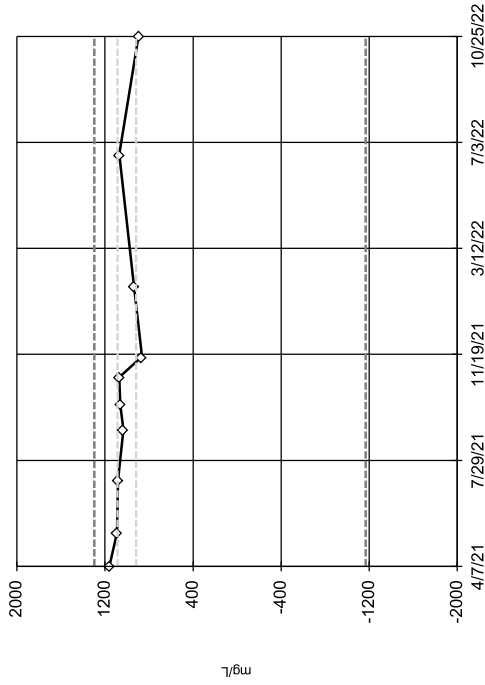

Constituent: Chloride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-3

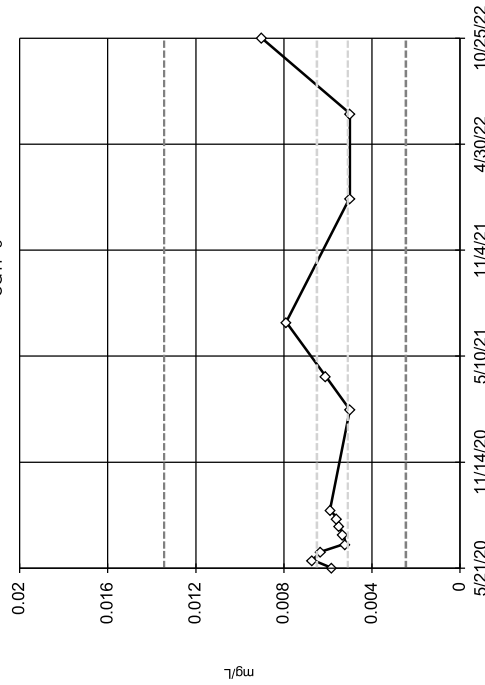

Constituent: Chromium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-1

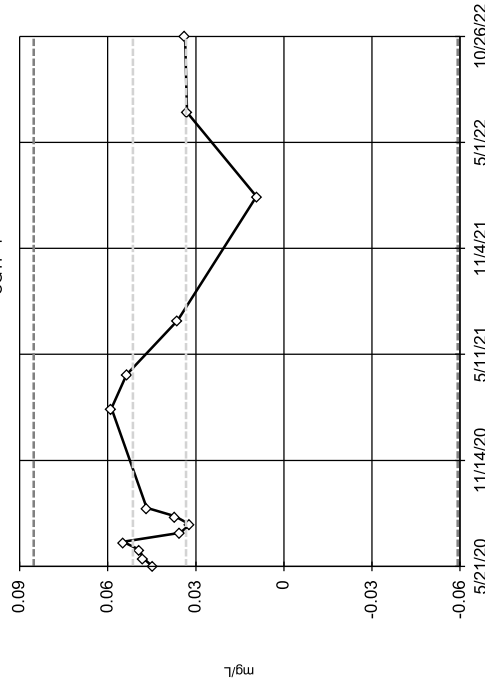

Constituent: Cobalt Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-2

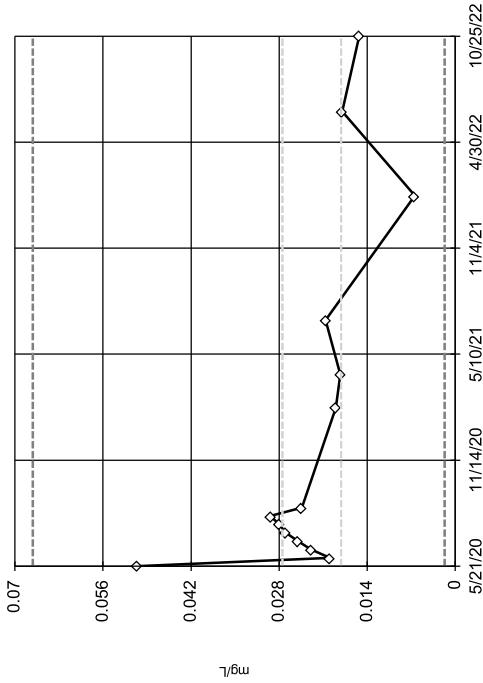

n = 14

No outliers found.
Tukey's method selected by user.


Data were square root transformed to achieve best W statistic (graph shown in original units).

High cutoff = 0.06715,
low cutoff = 0.001715,
based on IQR multiplier of 3.

Constituent: Cobalt Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-3

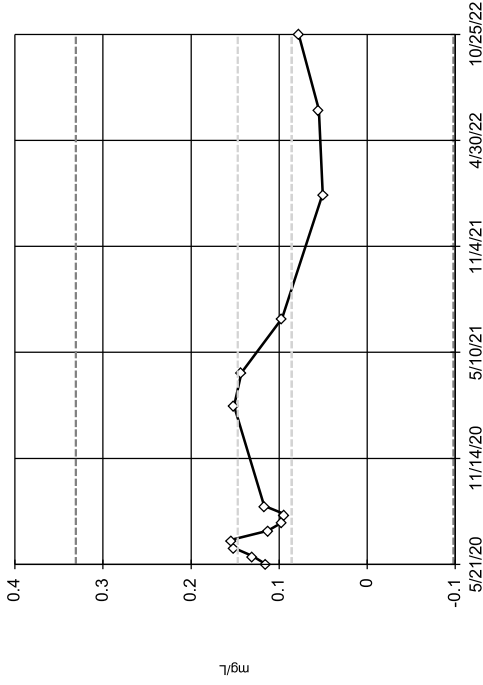

n = 14

No outliers found.
Tukey's method selected by user.


Ladder of Powers transformations did not improve normality; analysis run on raw data.

High cutoff = 0.3108,
low cutoff = -0.09807,
based on IQR multiplier of 3.

Constituent: Cobalt Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-4

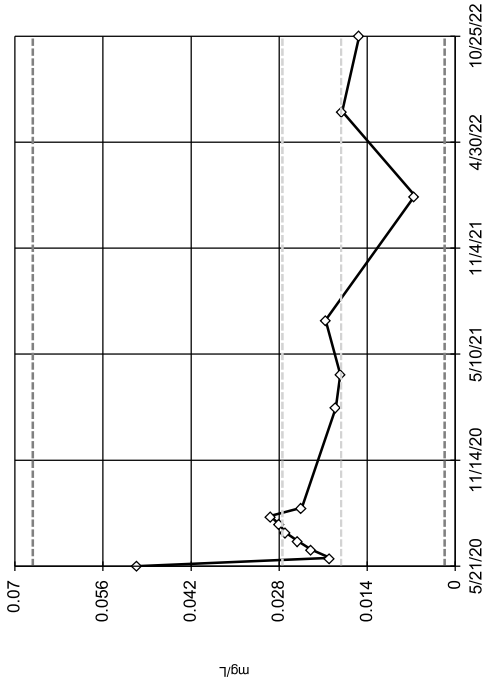

n = 10

No outliers found.
Tukey's method selected by user.


Data were \sqrt{x} transformed to achieve best W statistic (graph shown in original units).

High cutoff = 0.0619,
low cutoff = -0.05853,
based on IQR multiplier of 3.

Constituent: Cobalt Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-6

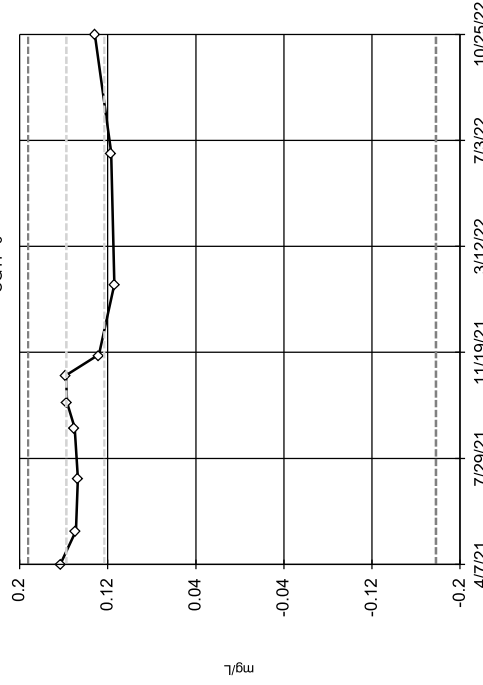

n = 10

No outliers found.
Tukey's method selected by user.


Data were \sqrt{x} transformed to achieve best W statistic (graph shown in original units).

High cutoff = 0.1923,
low cutoff = -0.1781,
based on IQR multiplier of 3.

Constituent: Cobalt Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-1

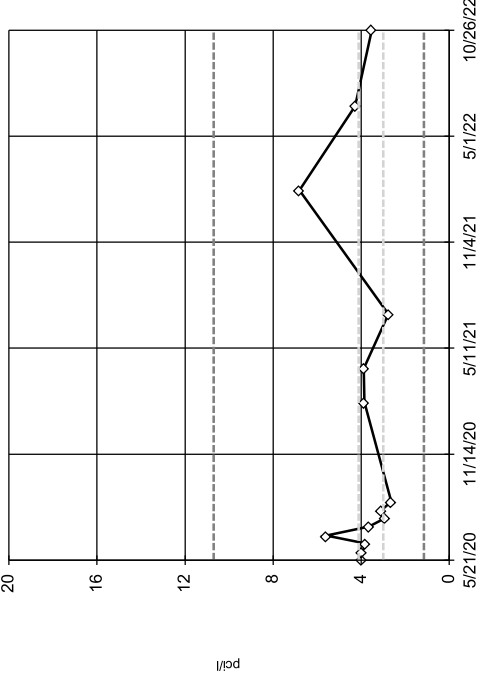


n = 14
No outliers found.
Tukey's method selected by user.
Data were natural log transformed to achieve best W statistic (graph shown in original units).
High cutoff = 10.7, low cutoff = 1.155, based on IQR multiplier of 3.

Constituent: Combined Radium 226 & 228 Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Do CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-2

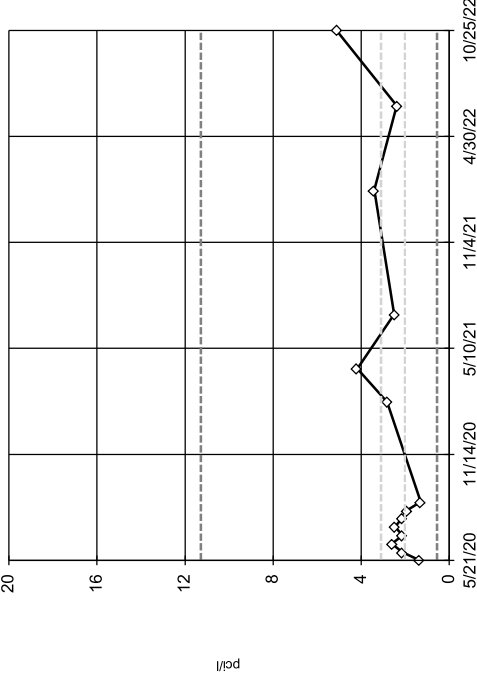


n = 14
No outliers found.
Tukey's method selected by user.
Data were natural log transformed to achieve best W statistic (graph shown in original units).
High cutoff = 11.28, low cutoff = 0.5545, based on IQR multiplier of 3.

Constituent: Combined Radium 226 & 228 Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Do CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-3

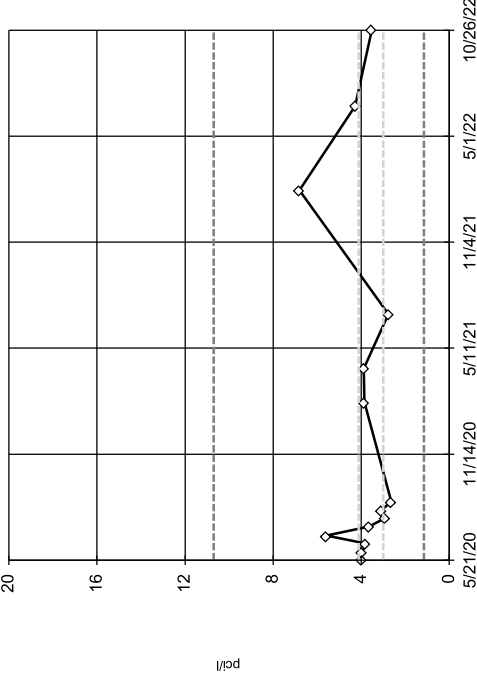


n = 14
No outliers found.
Tukey's method selected by user.
Data were square root transformed to achieve best W statistic (graph shown in original units).
High cutoff = 12.42, low cutoff = 1.474, based on IQR multiplier of 3.

Constituent: Combined Radium 226 & 228 Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Do CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-4

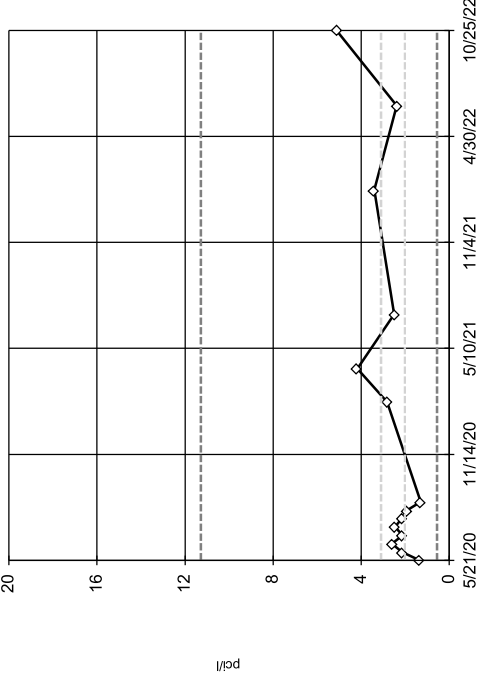


n = 10
No outliers found.
Tukey's method selected by user.
Data were square transformed to achieve best W statistic (graph shown in original units).
High cutoff = 9.471, low cutoff = -8.615, based on IQR multiplier of 3.

Constituent: Combined Radium 226 & 228 Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Do CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-6

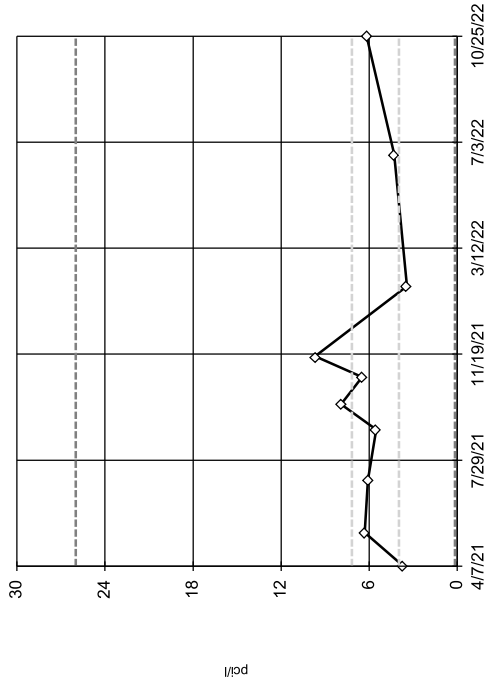


n = 10

No outliers found.
 Tukey's method selected by user.
 Data were cube root transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 25.99, low cutoff = 0.1665, based on IQR multiplier of 3.

Constituent: Combined Radium 226 & 228 Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Do
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-1

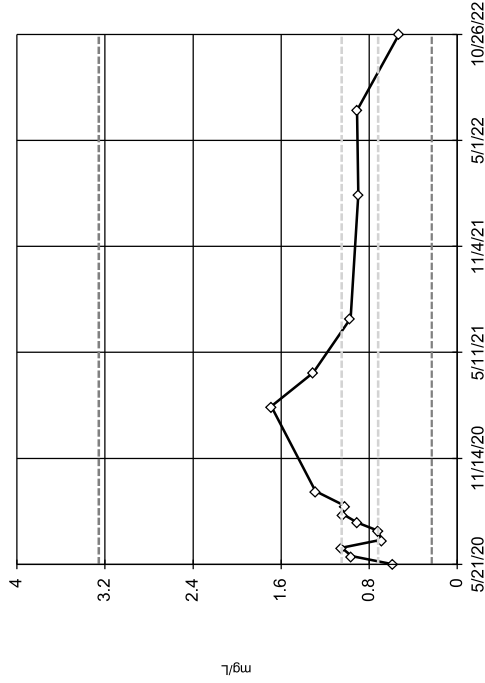


n = 15

No outliers found.
 Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 3.257, low cutoff = 0.2321, based on IQR multiplier of 3.

Constituent: Fluoride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-2

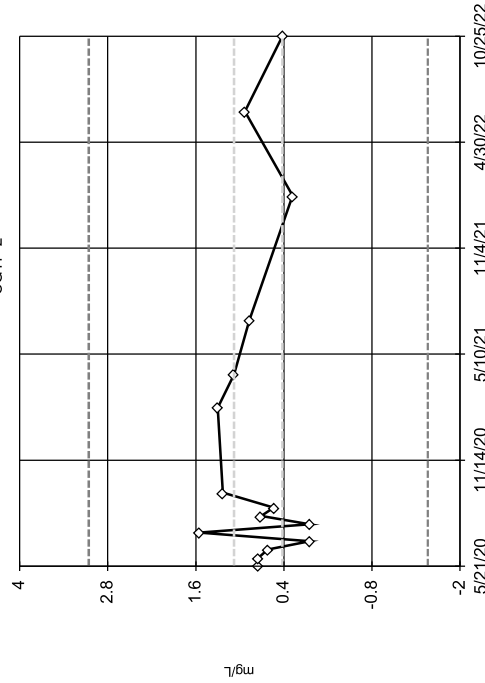


n = 15

No outliers found.
 Tukey's method selected by user.
 Leidler of Poiseux transformations did not improve normality; analysis run on raw data.
 High cutoff = 3.06, low cutoff = -1.96, based on IQR multiplier of 3.

Constituent: Fluoride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-3

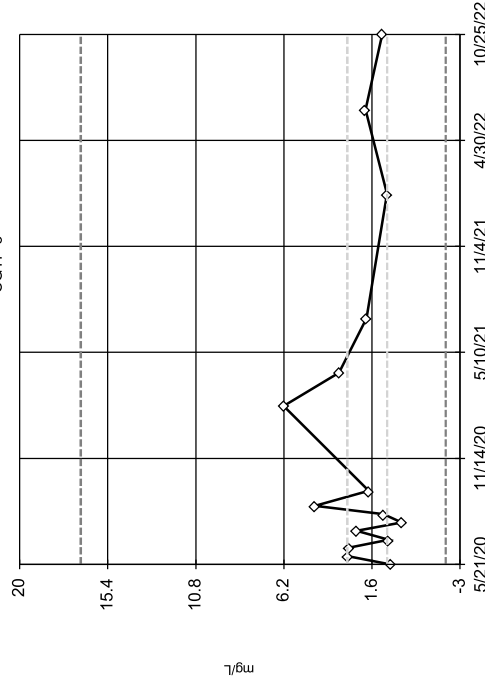


n = 15

No outliers found.
 Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 16.81, low cutoff = -2.25, based on IQR multiplier of 3.

Constituent: Fluoride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-4

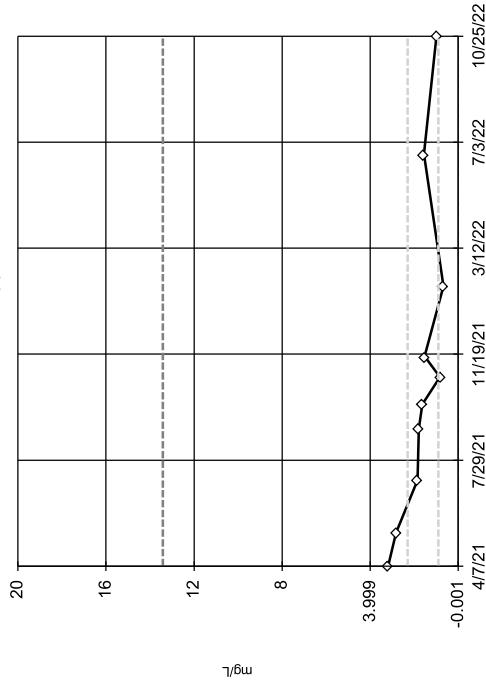

Constituent: Fluoride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-6

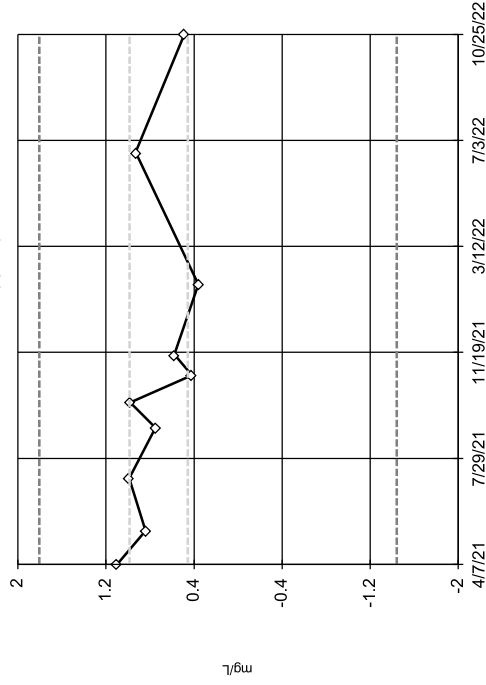

Constituent: Fluoride Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-1

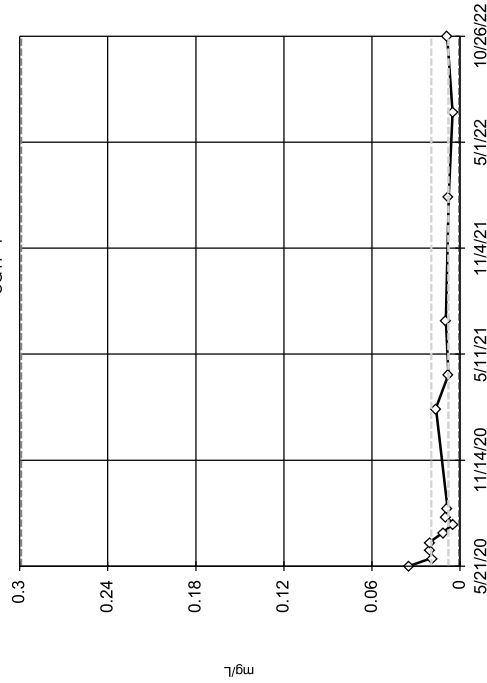

Constituent: Lead Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-2

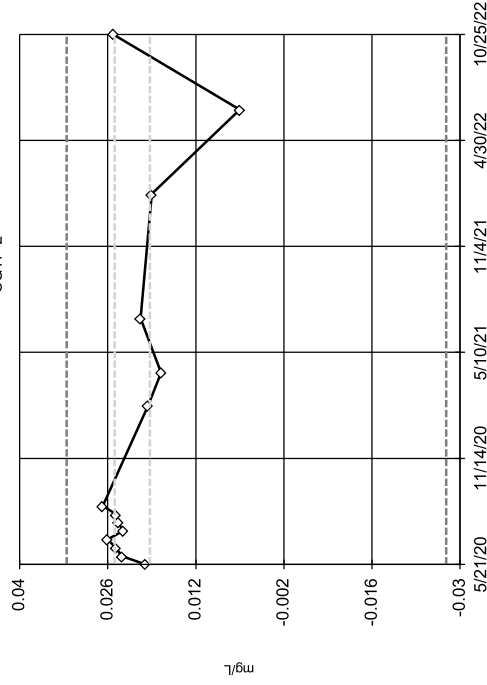

Constituent: Lead Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-3

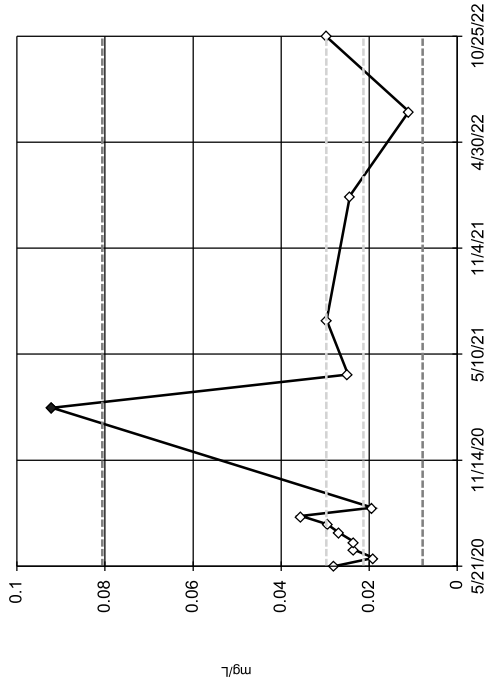

n = 14
 Outlier is drawn as solid. Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.09058, low cutoff = 0.007879, based on IQR multiplier of 3.

Tukey's Outlier Screening

CGYP-4

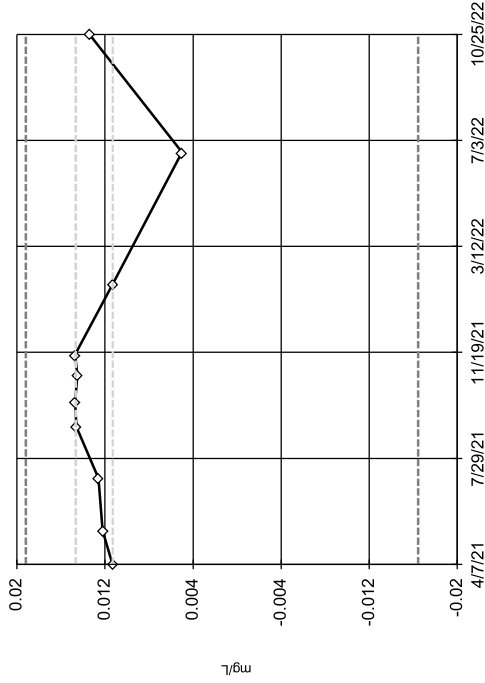


n = 10
 No outliers found. Tukey's method selected by user.
 Data were X^4 transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.01918, low cutoff = -0.01644, based on IQR multiplier of 3.

Constituent: Lead Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-6

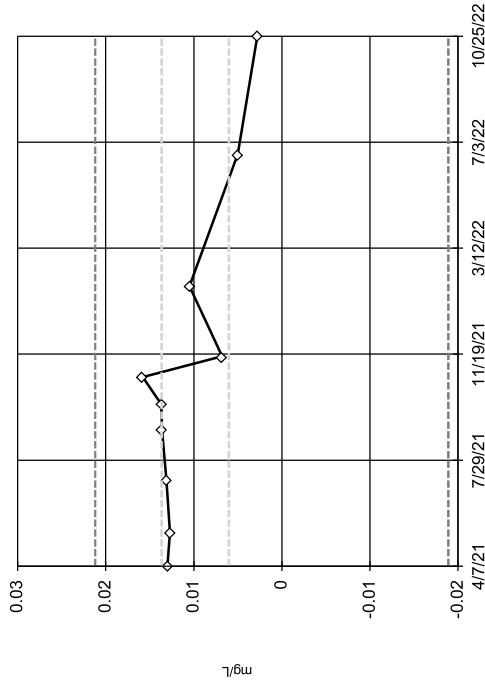


n = 10
 No outliers found. Tukey's method selected by user.
 Data were cube transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.02119, low cutoff = -0.01689, based on IQR multiplier of 3.

Constituent: Lead Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-1

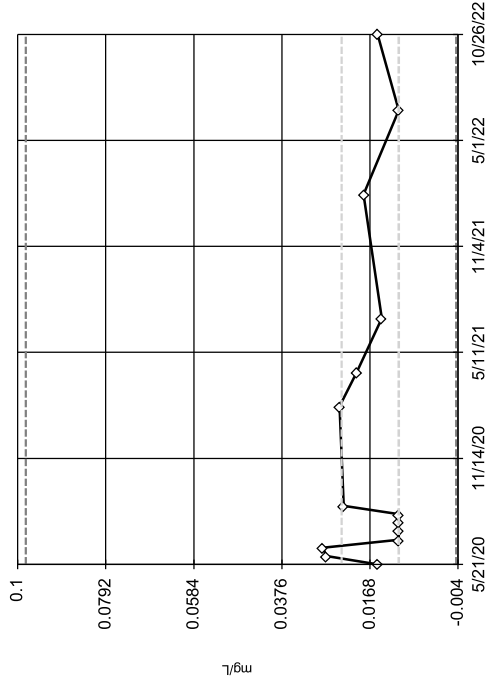


n = 14
 No outliers found. Tukey's method selected by user.
 Data were square root transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 0.09807, low cutoff = -0.003584, based on IQR multiplier of 3.

Constituent: Lithium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-2

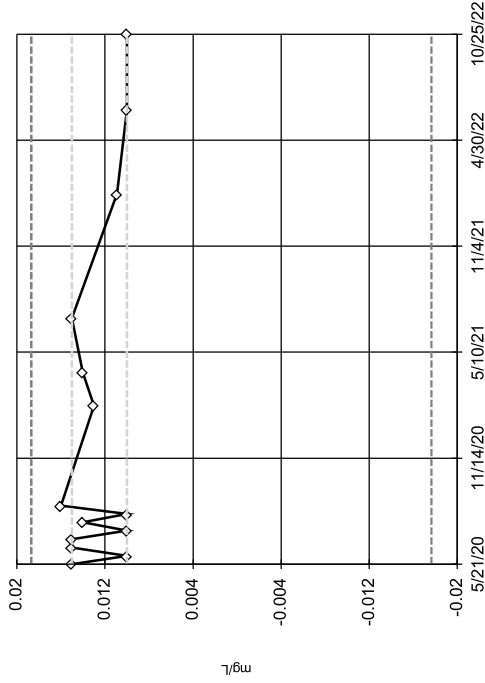

Constituent: Lithium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-3

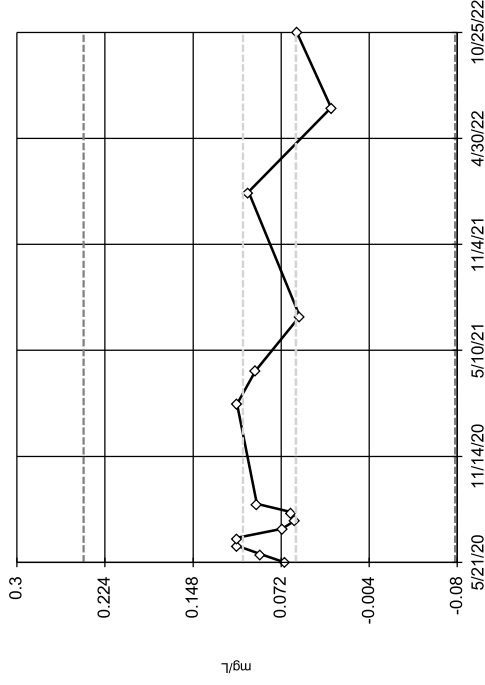

Constituent: Lithium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-4

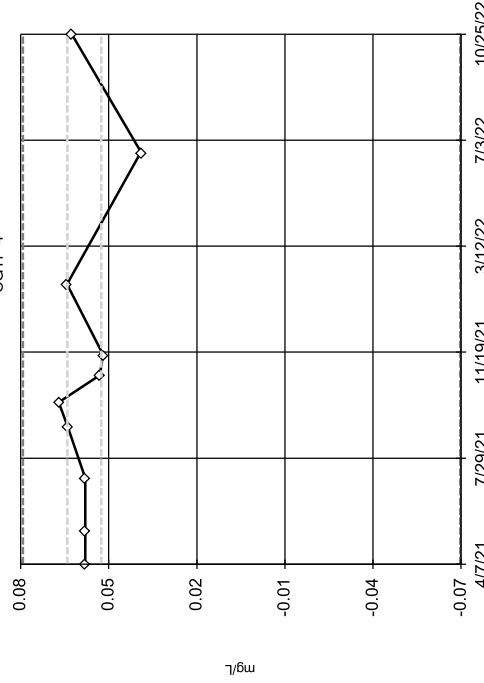

Constituent: Lithium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-6

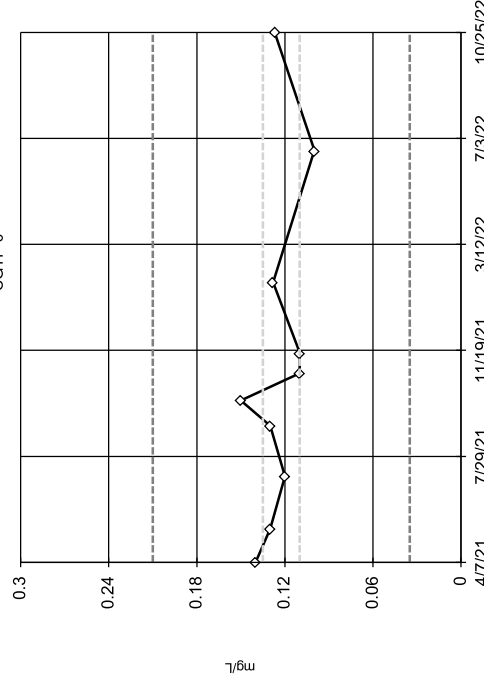

Constituent: Lithium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-1

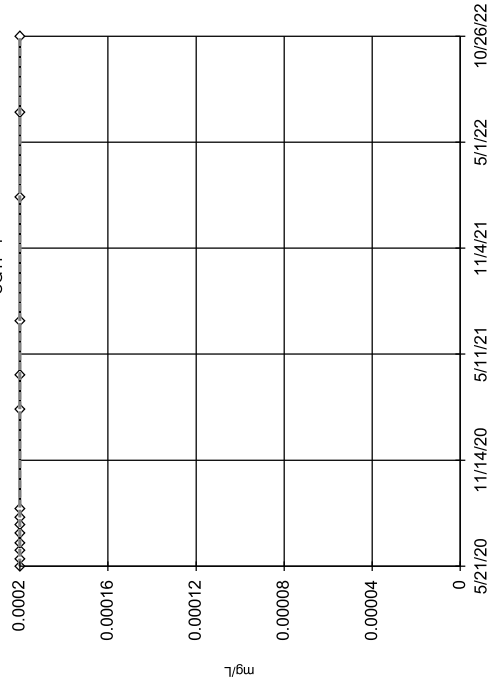

Constituent: Mercury Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-3

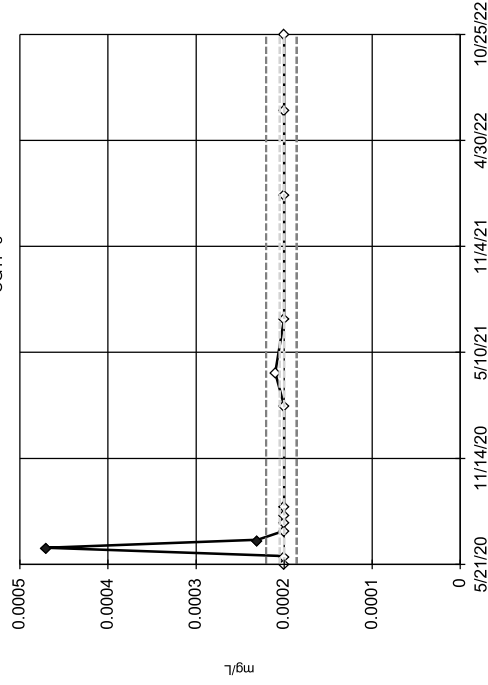

Constituent: Mercury Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-1

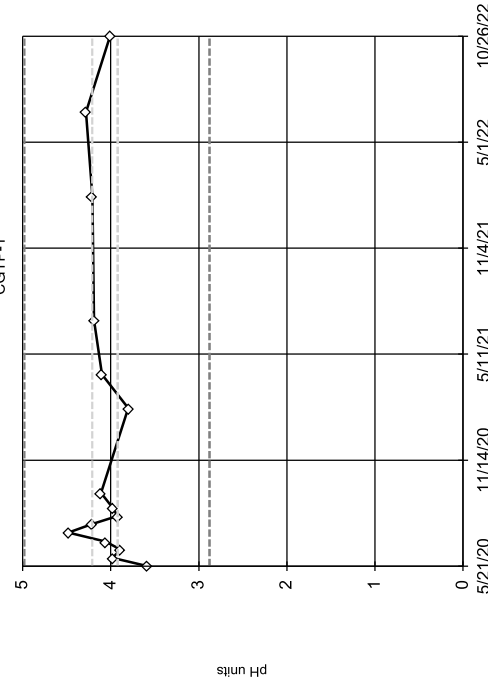

Constituent: pH, Field Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening

CGYP-2

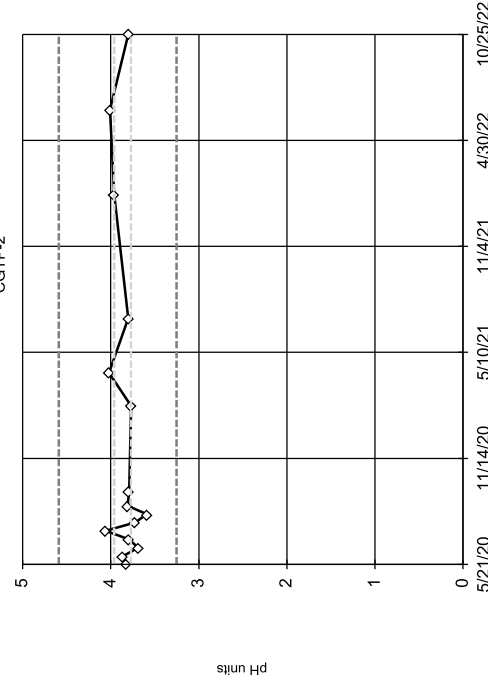


Constituent: pH, Field Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

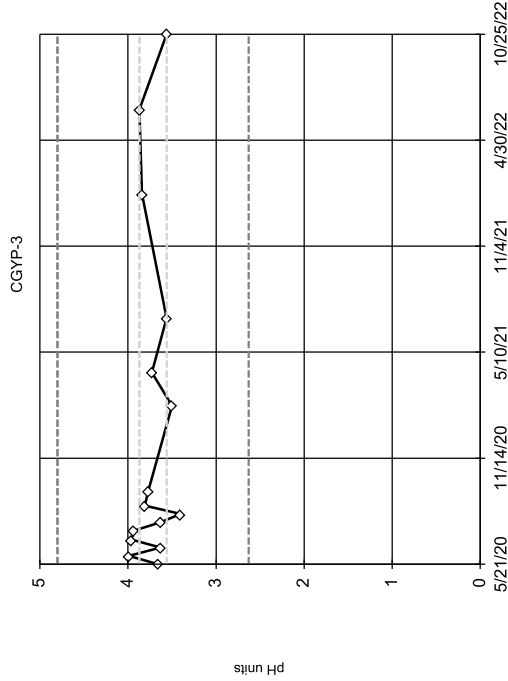


Constituent: pH, Field Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

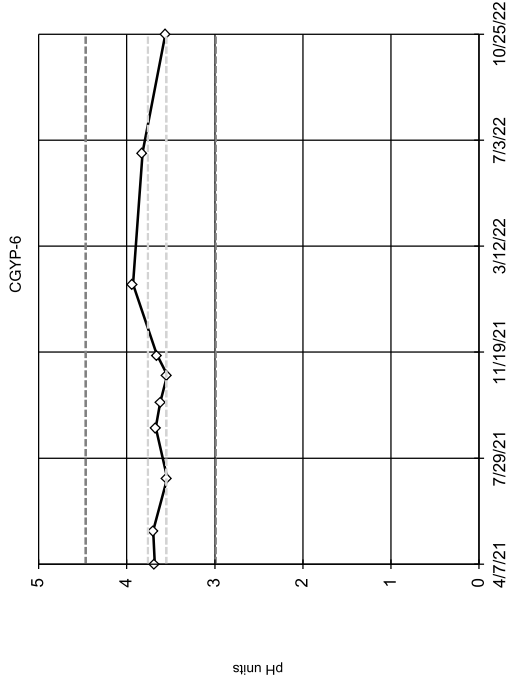


Constituent: pH, Field Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

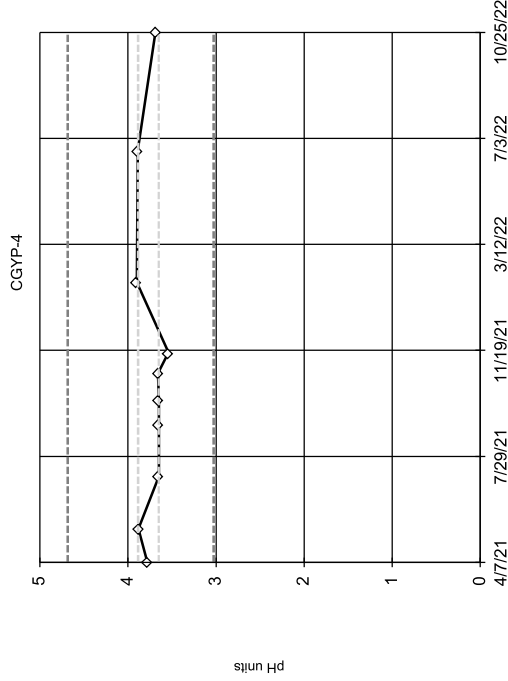

Constituent: pH, Field Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP


Tukey's Outlier Screening

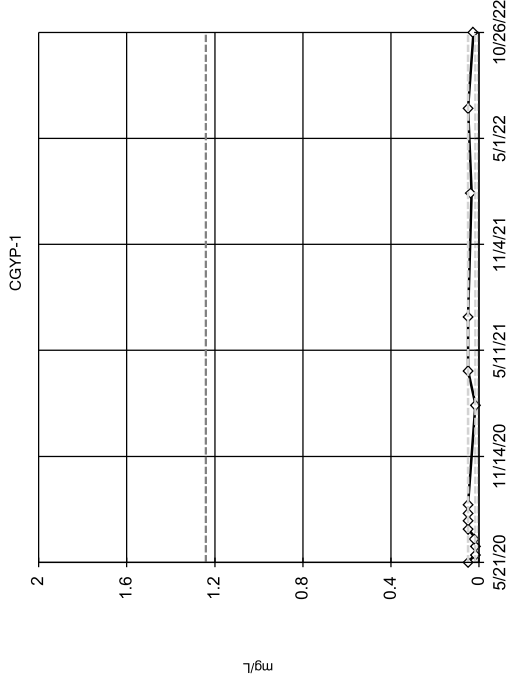

Constituent: Selenium Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-2

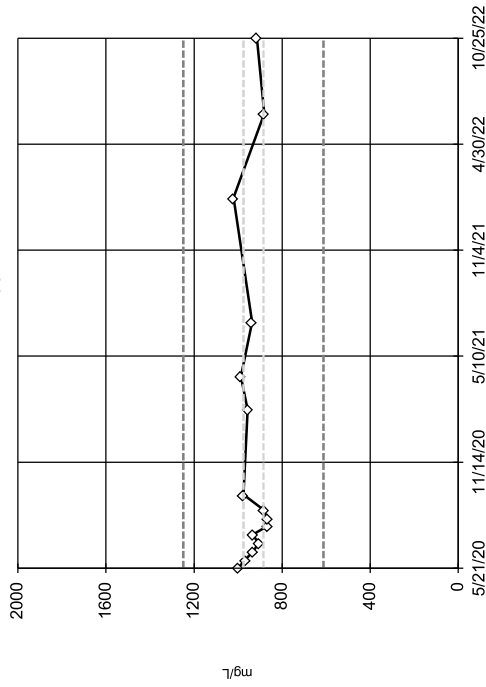


n = 15
 No outliers found.
 Tukey's method selected by user.
 Ladder of Powers transformations did not improve normality; analysis run on raw data.
 High cutoff = 1249, low cutoff = 612, based on IQR multiplier of 3.

Constituent: Sulfate Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-3

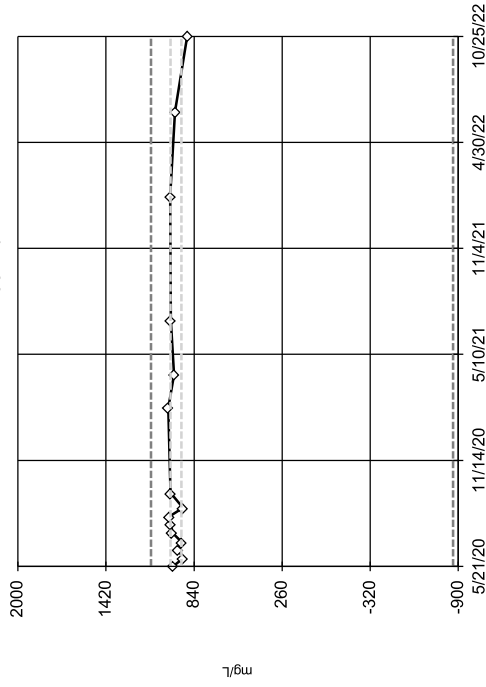


n = 15
 No outliers found.
 Tukey's method selected by user.
 Data were $\times 6$ transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 1124, low cutoff = -866, based on IQR multiplier of 3.

Constituent: Sulfate Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

CGYP-4

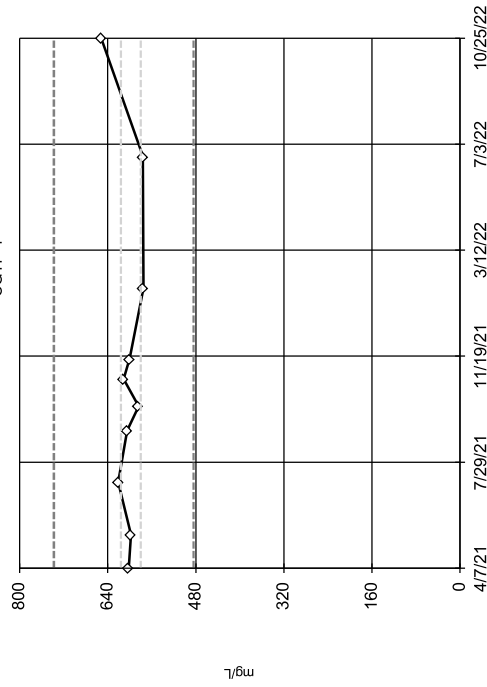


n = 10
 No outliers found.
 Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 737.9, low cutoff = 484.1, based on IQR multiplier of 3.

Constituent: Sulfate Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening


CGYP-6

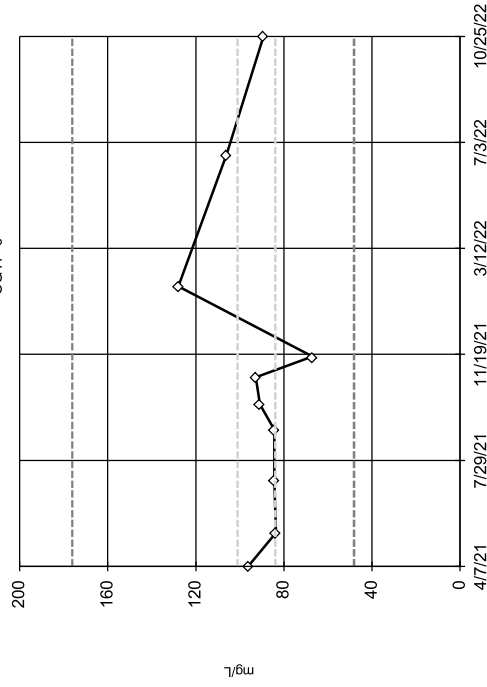

n = 10
 No outliers found.
 Tukey's method selected by user.
 Data were natural log transformed to achieve best W statistic (graph shown in original units).
 High cutoff = 176.1, low cutoff = 48.16, based on IQR multiplier of 3.


Constituent: Sulfate Analysis Run 2/21/2023 1:37 PM View: Outlier Screening - Downgradient Wells
 CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

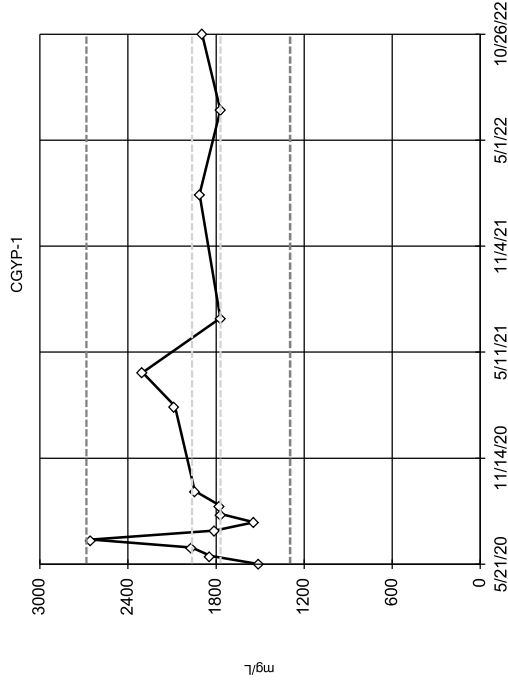


Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:38 PM View: Outlier Screening - Downgradi
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

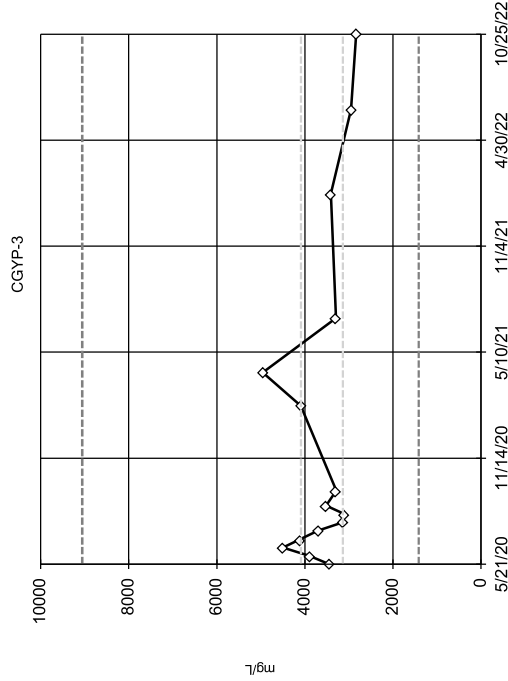


Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:38 PM View: Outlier Screening - Downgradi
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

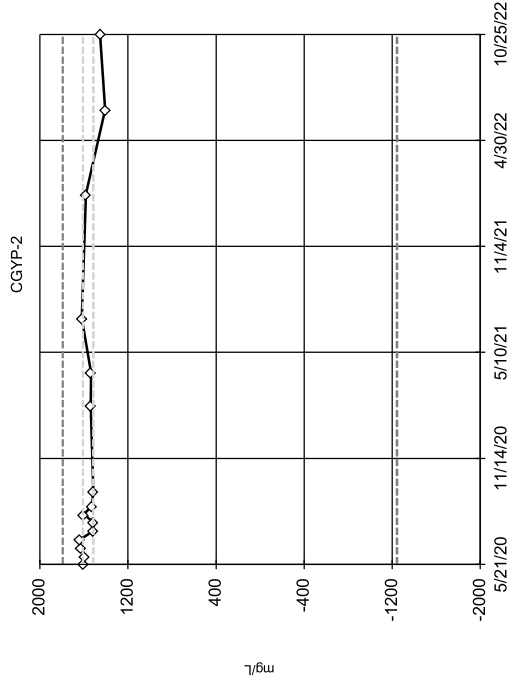


Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:38 PM View: Outlier Screening - Downgradi
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

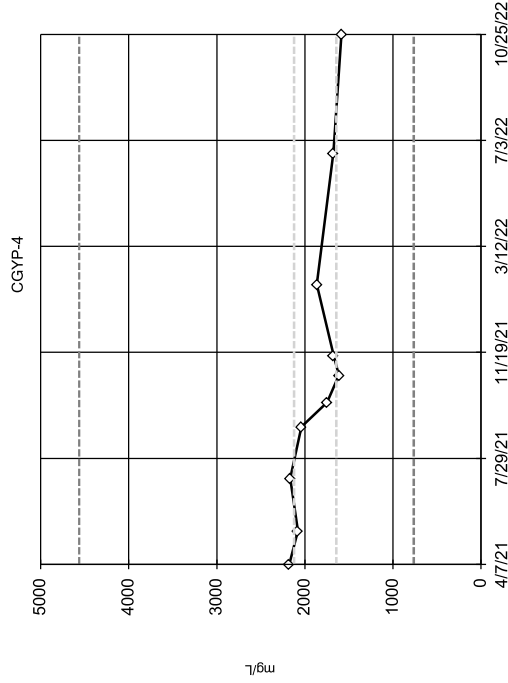

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:38 PM View: Outlier Screening - Downgradi
CGYP Client: Santee Cooper Data: CGYP

Tukey's Outlier Screening

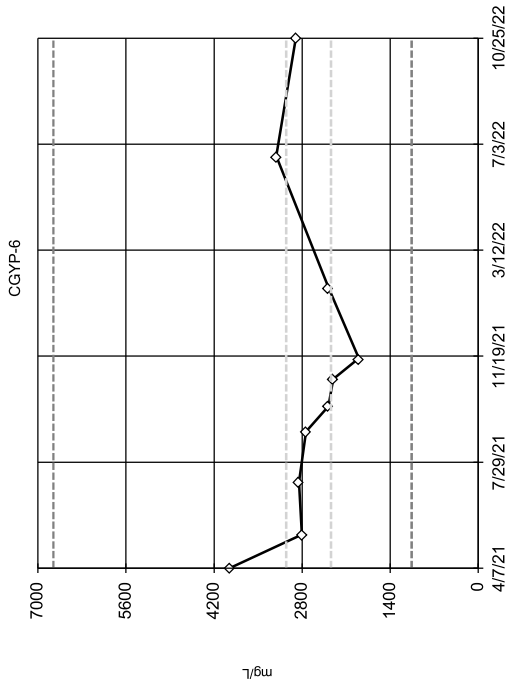

n = 10

No outliers found.
Tukey's method selected by user.

Data were natural log transformed to achieve best W statistic (graph shown in original units).

High cutoff = 6753, low cutoff = 1059, based on IQR multiplier of 3.

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:38 PM View: Outlier Screening - Downgraded
CGYP Client: Santee Cooper Data: CGYP

FIGURE D.

Analysis of Variance - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/19/2023, 4:09 PM

<u>Constituent</u>	<u>Well</u>	<u>Calc.</u>	<u>Crit.</u>	<u>Sig.</u>	<u>Alpha</u>	<u>Bg. Wells</u>	<u>Transform</u>	<u>ANOVA Sig</u>	<u>Calc.</u>	<u>Tab.</u>	<u>Alpha</u>	<u>Method</u>
Boron (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	6.622	3.841	0.05	NP (normality)
Calcium (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	21.1	3.841	0.05	NP (normality)
Chloride (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	4311	4.072	0.05	Param.
Fluoride (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	30.93	3.841	0.05	NP (normality)
pH, Field (pH units)	n/a	n/a	n/a	n/a	n/a	n/a	x^(1/3)	Yes	209.8	4.056	0.05	Param.
Sulfate (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	Yes	32.27	3.841	0.05	NP (normality)
Total Dissolved Solids (mg/L)	n/a	n/a	n/a	n/a	n/a	n/a	No	No	0.3267	4.056	0.05	Param.

Non-Parametric ANOVA

Constituent: Boron Analysis Run 2/19/2023 4:09 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

For observations made between 10/19/2015 and 10/25/2022, the non-parametric analysis of variance test indicates a DIFFERENCE between the medians of the groups tested at the 5% significance level. Because the calculated Kruskal-Wallis statistic is greater than the Chi-squared value, we conclude that at least one group has a significantly different median concentration of this constituent when compared to another group.

Calculated Kruskal-Wallis statistic = 6.622

Tabulated Chi-Squared value = 3.841 with 1 degree of freedom at the 5% significance level.

There were 2 groups of ties in the data, consequently the Kruskal-Wallis statistic (H) was adjusted. The adjusted statistic (H') was utilized to determine if the medians were equal.

Kruskal-Wallis statistic (H) = 6.401

Adjusted Kruskal-Wallis statistic (H') = 6.622

Non-Parametric ANOVA

Constituent: Calcium Analysis Run 2/19/2023 4:09 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

For observations made between 10/19/2015 and 10/25/2022, the non-parametric analysis of variance test indicates a DIFFERENCE between the medians of the groups tested at the 5% significance level. Because the calculated Kruskal-Wallis statistic is greater than the Chi-squared value, we conclude that at least one group has a significantly different median concentration of this constituent when compared to another group.

Calculated Kruskal-Wallis statistic = 21.1

Tabulated Chi-Squared value = 3.841 with 1 degree of freedom at the 5% significance level.

There were 4 groups of ties in the data, consequently the Kruskal-Wallis statistic (H) was adjusted. The adjusted statistic (H') was utilized to determine if the medians were equal.

Kruskal-Wallis statistic (H) = 21.09

Adjusted Kruskal-Wallis statistic (H') = 21.1

Parametric ANOVA

Constituent: Chloride Analysis Run 2/19/2023 4:09 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

For observations made between 10/19/2015 and 10/25/2022 the parametric analysis of variance test indicates VARIATION at the 5% significance level. Because the calculated F statistic is greater than the tabulated F statistic, the hypothesis of a single homogeneous population is rejected.

Calculated F statistic = 4311

Tabulated F statistic = 4.072 with 1 and 42 degrees of freedom at the 5% significance level.

ONE-WAY PARAMETRIC ANOVA TABLE

Source of Variation	Sum of Squares	Degrees of Freedom	Mean Squares	F
Between Groups	1017	1	1017	4311
Error Within Groups	9.91	42	0.2359	
Total	1027	43		

The Shapiro Wilk normality test on the residuals passed on the raw data. Alpha = 0.01, calculated = 0.9656, critical = 0.924. Levene's Equality of Variance test passed. Calculated = 3.131, tabulated = 4.072.

Non-Parametric ANOVA

Constituent: Fluoride Analysis Run 2/19/2023 4:09 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

For observations made between 10/19/2015 and 10/25/2022, the non-parametric analysis of variance test indicates a DIFFERENCE between the medians of the groups tested at the 5% significance level. Because the calculated Kruskal-Wallis statistic is greater than the Chi-squared value, we conclude that at least one group has a significantly different median concentration of this constituent when compared to another group.

Calculated Kruskal-Wallis statistic = 30.93

Tabulated Chi-Squared value = 3.841 with 1 degree of freedom at the 5% significance level.

There were 6 groups of ties in the data, consequently the Kruskal-Wallis statistic (H) was adjusted. The adjusted statistic (H') was utilized to determine if the medians were equal.

Kruskal-Wallis statistic (H) = 26.41

Adjusted Kruskal-Wallis statistic (H') = 30.93

Parametric ANOVA

Constituent: pH, Field Analysis Run 2/19/2023 4:09 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

For observations made between 1/26/2015 and 10/25/2022 the parametric analysis of variance test (after cube root transformation) indicates VARIATION at the 5% significance level. Because the calculated F statistic is greater than the tabulated F statistic, the hypothesis of a single homogeneous population is rejected.

Calculated F statistic = 209.8

Tabulated F statistic = 4.056 with 1 and 46 degrees of freedom at the 5% significance level.

ONE-WAY PARAMETRIC ANOVA TABLE

Source of Variation	Sum of Squares	Degrees of Freedom	Mean Squares	F
Between Groups	0.111	1	0.111	209.8
Error Within Groups	0.02434	46	0.0005292	
Total	0.1354	47		

The Shapiro Wilk normality test on the residuals passed after cube root transformation. Alpha = 0.01, calculated = 0.9711, critical = 0.929. Levene's Equality of Variance test passed. Calculated = 3.818, tabulated = 4.056.

Non-Parametric ANOVA

Constituent: Sulfate Analysis Run 2/19/2023 4:09 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

For observations made between 10/19/2015 and 10/25/2022, the non-parametric analysis of variance test indicates a DIFFERENCE between the medians of the groups tested at the 5% significance level. Because the calculated Kruskal-Wallis statistic is greater than the Chi-squared value, we conclude that at least one group has a significantly different median concentration of this constituent when compared to another group.

Calculated Kruskal-Wallis statistic = 32.27

Tabulated Chi-Squared value = 3.841 with 1 degree of freedom at the 5% significance level.

There were 2 groups of ties in the data, consequently the Kruskal-Wallis statistic (H) was adjusted. The adjusted statistic (H') was utilized to determine if the medians were equal.

Kruskal-Wallis statistic (H) = 32.27

Adjusted Kruskal-Wallis statistic (H') = 32.27

Parametric ANOVA

Constituent: Total Dissolved Solids Analysis Run 2/19/2023 4:09 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

For observations made between 1/26/2015 and 10/25/2022 the parametric analysis of variance test indicates NO VARIATION at the 5% significance level. Because the calculated F statistic is less than or equal to the tabulated F statistic, the hypothesis of a single homogeneous population is accepted.

Calculated F statistic = 0.3267

Tabulated F statistic = 4.056 with 1 and 46 degrees of freedom at the 5% significance level.

ONE-WAY PARAMETRIC ANOVA TABLE

Source of Variation	Sum of Squares	Degrees of Freedom	Mean Squares	F
Between Groups	503.6	1	503.6	0.3267
Error Within Groups	70911	46	1542	
Total	71415	47		

The Shapiro Wilk normality test on the residuals passed on the raw data. Alpha = 0.01, calculated = 0.9508, critical = 0.929. Levene's Equality of Variance test passed. Calculated = 0.2055, tabulated = 4.056.


FIGURE E.

Upper Tolerance Limits - Appendix III

CGYP Client: Santee Cooper Data: CGYP Printed 2/23/2023, 2:43 PM

<u>Constituent</u>	<u>Well</u>	<u>Upper Lim.</u>	<u>Bq N</u>	<u>Bq Mean</u>	<u>Std. Dev.</u>	<u>%NDs</u>	<u>ND Adj.</u>	<u>Transform</u>	<u>Alpha</u>	<u>Method</u>
Boron (mg/L)	n/a	0.049	41	n/a	n/a	26.83	n/a	n/a	0.1221	NP Inter(normality)
Calcium (mg/L)	n/a	39.3	43	21.94	7.437	0	None	No	0.01	Inter
Chloride (mg/L)	n/a	13.5	44	n/a	n/a	0	n/a	n/a	0.1047	NP Inter(normality)
Fluoride (mg/L)	n/a	0.3	40	n/a	n/a	52.5	n/a	n/a	0.1285	NP Inter(normality)
pH, Field (pH units)	n/a	5.58	48	n/a	n/a	0	n/a	n/a	0.3006	NP Inter(normality)
Sulfate (mg/L)	n/a	115	44	n/a	n/a	0	n/a	n/a	0.1047	NP Inter(normality)


Tolerance Limit Interwell Non-parametric

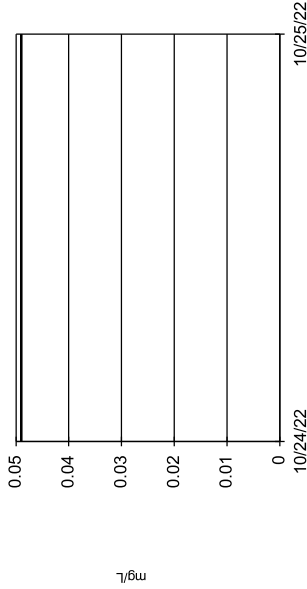

Non-parametric test used in lieu of parametric tolerance limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 41 background values. 26.83% NDs. 89.26% coverage at alpha=0.01; 92.77% coverage at alpha=0.05; 96.24% coverage at alpha=0.5. Report alpha = 0.1221.

Constituent: Boron Analysis Run 2/23/2023 2:42 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP


Tolerance Limit Interwell Non-parametric

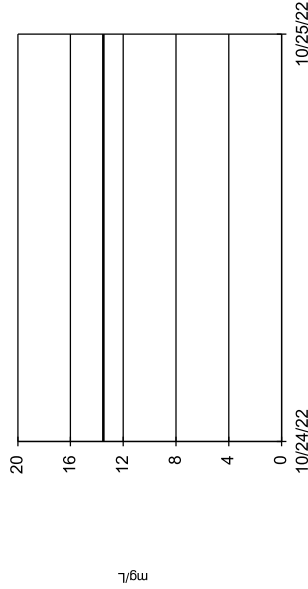

Non-parametric test used in lieu of parametric tolerance limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 44 background values. 90.04% coverage at alpha=0.01; 93.55% coverage at alpha=0.05; 98.24% coverage at alpha=0.5. Report alpha = 0.1047.

Constituent: Chloride Analysis Run 2/23/2023 2:42 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP


Tolerance Limit Interwell Parametric

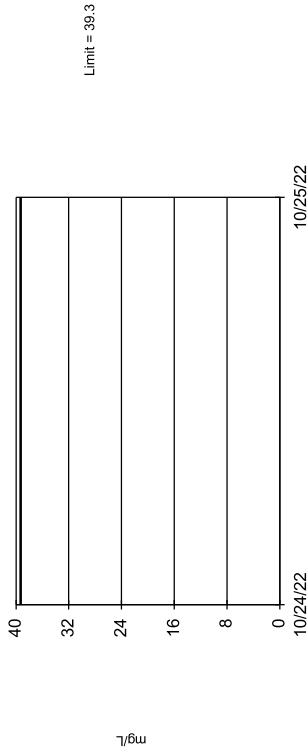

95% coverage. Background Data Summary: Mean=21.94, Std. Dev.=7.437, n=43. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9638, critical = 0.923. Report alpha = 0.01.

Constituent: Calcium Analysis Run 2/23/2023 2:42 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP


Tolerance Limit Interwell Non-parametric

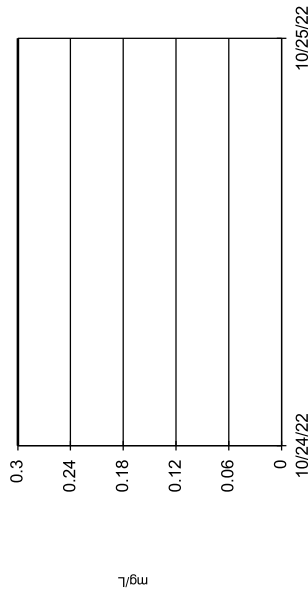

Non-parametric test used in lieu of parametric tolerance limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 40 background values. 52.5% NDs. 89.26% coverage at alpha=0.01; 92.77% coverage at alpha=0.05; 98.24% coverage at alpha=0.5. Report alpha = 0.1285.

Constituent: Fluoride Analysis Run 2/23/2023 2:42 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP


Tolerance Limit Interwell Non-parametric

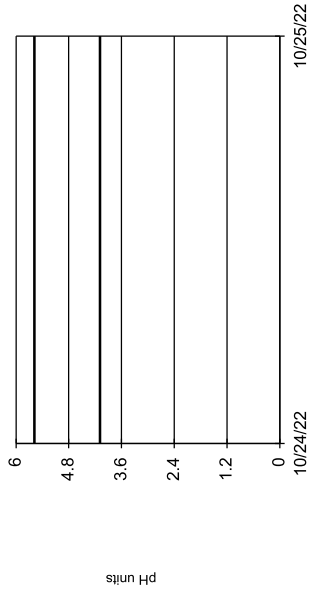

Non-parametric test used in lieu of parametric tolerance limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limits are highest and lowest of 48 background values. 86.91% coverage at alpha=0.01; 90.43% coverage at alpha=0.05; 96.68% coverage at alpha=0.5. Report alpha = 0.3006 (0.1503 per tail).

Constituent: pH, Field Analysis Run 2/23/2023 2:42 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP


Tolerance Limit Interwell Non-parametric

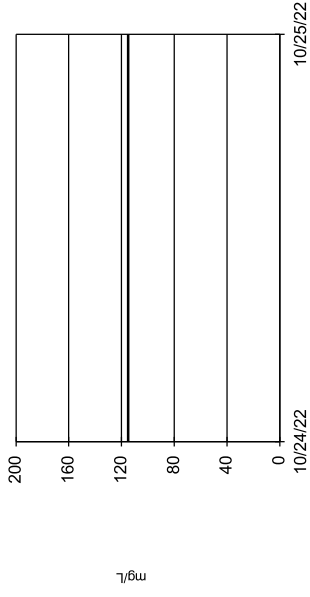

Non-parametric test used in lieu of parametric tolerance limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 44 background values. 90.04% coverage at alpha=0.01; 93.55% coverage at alpha=0.05; 98.24% coverage at alpha=0.5. Report alpha = 0.1047.


Constituent: Sulfate Analysis Run 2/23/2023 2:42 PM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

Time Series

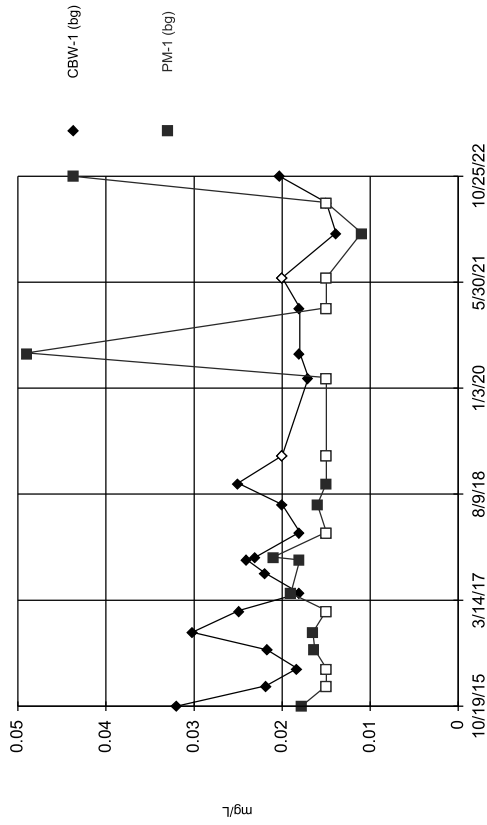


Constituent: Boron Analysis Run 2/23/2023 11:10 AM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

Time Series

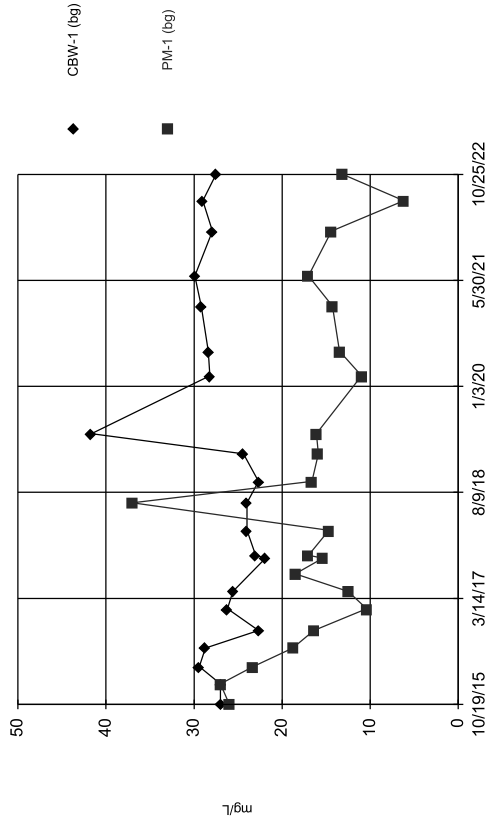


Constituent: Calcium Analysis Run 2/23/2023 11:10 AM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

Time Series

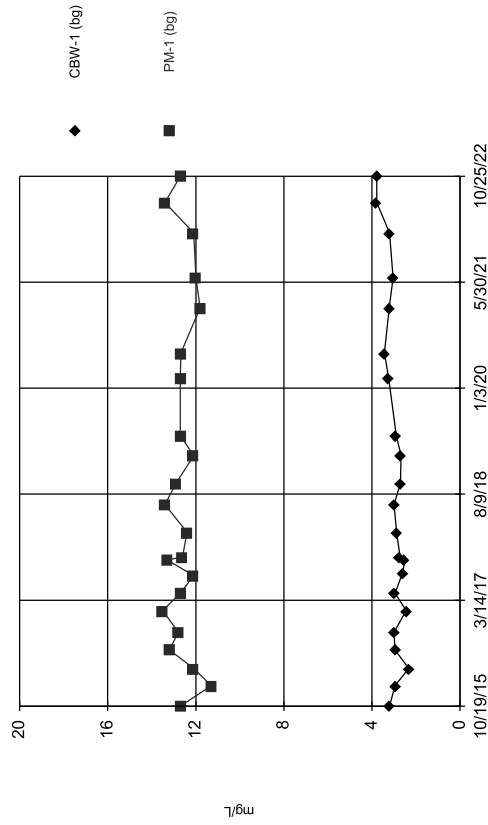


Constituent: Chloride Analysis Run 2/23/2023 11:10 AM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

Time Series

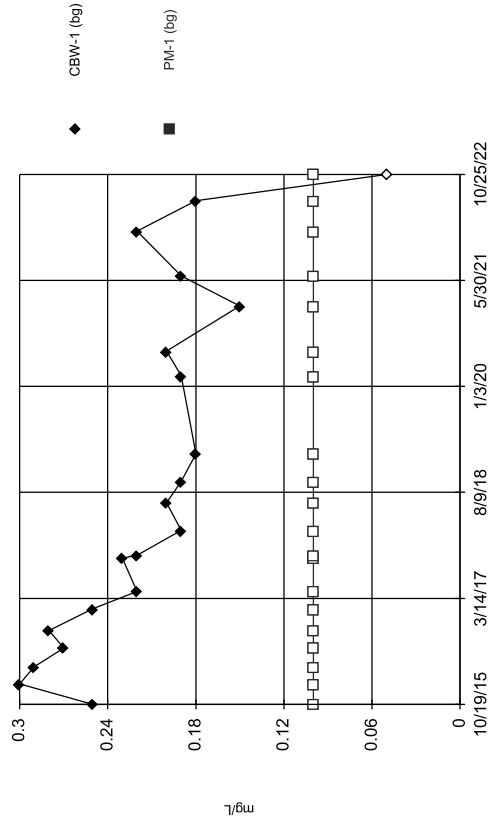


Constituent: Fluoride Analysis Run 2/23/2023 11:10 AM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

Time Series

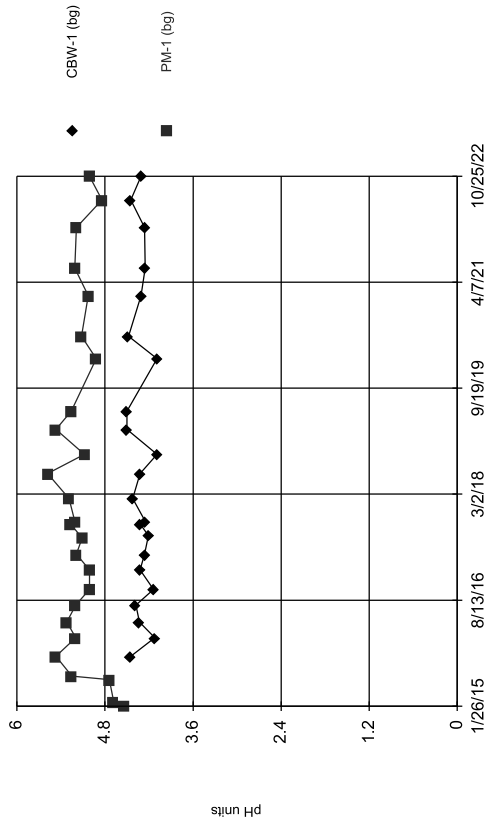

Constituent: pH, Field Analysis Run 2/23/2023 11:10 AM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

Time Series

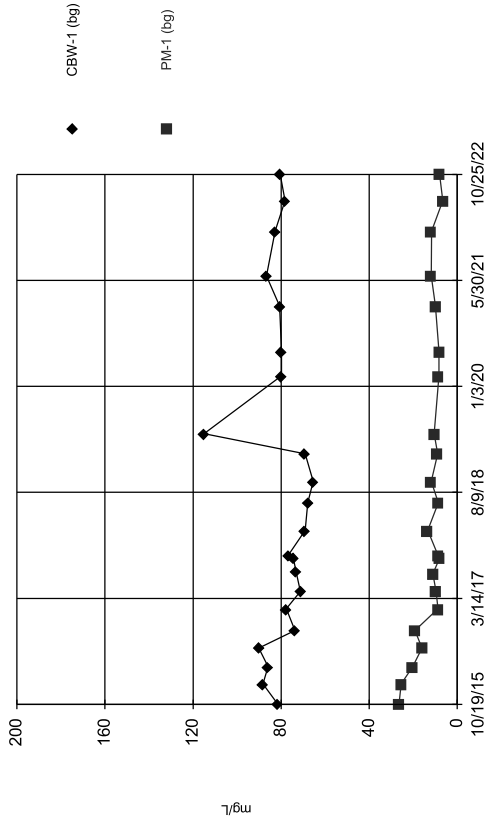

Constituent: Sulfate Analysis Run 2/23/2023 11:10 AM View: UTLs App III
CGYP Client: Santee Cooper Data: CGYP

FIGURE F.

Confidence Intervals Summary Table Appendix III - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/22/2023, 3:11 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig. N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	11.42	8.362	0.049	Yes 15	9.889	2.254	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-2	1.817	1.094	0.049	Yes 15	1.455	0.5331	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-3	21.52	16.48	0.049	Yes 15	19	3.721	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-4	8.003	5.925	0.049	Yes 10	6.964	1.164	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-6	7.054	5.888	0.049	Yes 10	6.471	0.6537	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-1	278.7	212.1	39.3	Yes 15	245.4	49.18	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-2	295.6	255.3	39.3	Yes 15	275.5	29.78	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-3	664.4	525.4	39.3	Yes 15	594.9	102.6	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-4	341.1	267.9	39.3	Yes 10	304.5	41.04	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-6	469.1	393.7	39.3	Yes 10	431.4	42.23	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-1	734.5	663.6	13.5	Yes 15	699.1	52.27	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-2	139.5	83.33	13.5	Yes 15	111.4	41.44	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-3	1238	977.5	13.5	Yes 15	1108	192.3	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-4	664.3	501.7	13.5	Yes 10	583	91.11	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-6	1111	941.7	13.5	Yes 10	1026	94.91	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.174	0.7689	0.3	Yes 15	0.9713	0.2987	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.04	0.4444	0.3	Yes 15	0.742	0.4392	13.33	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.259	1.023	0.3	Yes 15	2.141	1.65	6.667	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.407	0.9649	0.3	Yes 10	1.686	0.8082	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9802	0.5078	0.3	Yes 10	0.744	0.2647	0	None	No	0.01	Param.
pH, Field (pH units)	CGYP-2	3.933	3.733	5.58	Yes 15	3.833	0.1302	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-3	3.86	3.586	5.58	Yes 15	3.723	0.1781	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-4	3.858	3.6	5.58	Yes 10	3.729	0.1253	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-6	3.8	3.544	5.58	Yes 10	3.672	0.1245	0	None	No	0.005	Param.
Sulfate (mg/L)	CGYP-1	506.5	387.3	115	Yes 15	446.9	87.96	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-2	968.5	902.7	115	Yes 15	935.6	48.54	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-3	990.7	937.9	115	Yes 15	964.3	38.94	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-4	622.8	582	115	Yes 10	602.4	22.85	0	None	No	0.01	Param.


Confidence Intervals Summary Table Appendix III - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/22/2023, 3:11 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig. N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	11.42	8.362	0.049	Yes 15	9.889	2.254	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-2	1.817	1.094	0.049	Yes 15	1.455	0.5331	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-3	21.52	16.48	0.049	Yes 15	19	3.721	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-4	8.003	5.925	0.049	Yes 10	6.964	1.164	0	None	No	0.01	Param.
Boron (mg/L)	CGYP-6	7.054	5.888	0.049	Yes 10	6.471	0.6537	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-1	278.7	212.1	39.3	Yes 15	245.4	49.18	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-2	295.6	255.3	39.3	Yes 15	275.5	29.78	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-3	664.4	525.4	39.3	Yes 15	594.9	102.6	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-4	341.1	267.9	39.3	Yes 10	304.5	41.04	0	None	No	0.01	Param.
Calcium (mg/L)	CGYP-6	469.1	393.7	39.3	Yes 10	431.4	42.23	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-1	734.5	663.6	13.5	Yes 15	699.1	52.27	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-2	139.5	83.33	13.5	Yes 15	111.4	41.44	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-3	1238	977.5	13.5	Yes 15	1108	192.3	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-4	664.3	501.7	13.5	Yes 10	583	91.11	0	None	No	0.01	Param.
Chloride (mg/L)	CGYP-6	1111	941.7	13.5	Yes 10	1026	94.91	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.174	0.7689	0.3	Yes 15	0.9713	0.2987	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.04	0.4444	0.3	Yes 15	0.742	0.4392	13.33	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.259	1.023	0.3	Yes 15	2.141	1.65	6.667	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.407	0.9649	0.3	Yes 10	1.686	0.8082	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9802	0.5078	0.3	Yes 10	0.744	0.2647	0	None	No	0.01	Param.
pH, Field (pH units)	CGYP-1	4.22	3.888	5.58	No 15	4.054	0.2163	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-2	3.933	3.733	5.58	Yes 15	3.833	0.1302	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-3	3.86	3.586	5.58	Yes 15	3.723	0.1781	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-4	3.858	3.6	5.58	Yes 10	3.729	0.1253	0	None	No	0.005	Param.
pH, Field (pH units)	CGYP-6	3.8	3.544	5.58	Yes 10	3.672	0.1245	0	None	No	0.005	Param.
Sulfate (mg/L)	CGYP-1	506.5	387.3	115	Yes 15	446.9	87.96	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-2	968.5	902.7	115	Yes 15	935.6	48.54	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-3	990.7	937.9	115	Yes 15	964.3	38.94	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-4	622.8	582	115	Yes 10	602.4	22.85	0	None	No	0.01	Param.
Sulfate (mg/L)	CGYP-6	106.6	77.87	115	No 10	92.24	16.1	0	None	No	0.01	Param.

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

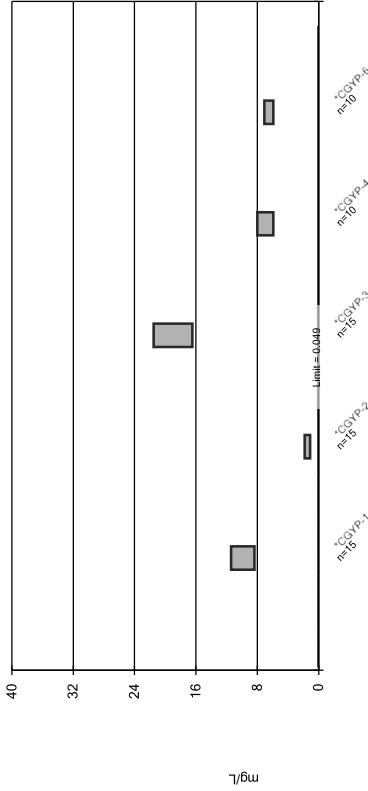

Constituent: Boron Analysis Run 2/22/2023 3:10 PM View: Confidence Intervals - App III
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

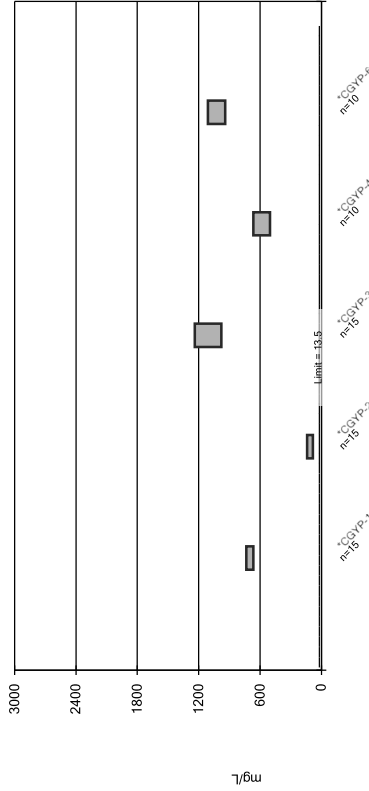

Constituent: Chloride Analysis Run 2/22/2023 3:10 PM View: Confidence Intervals - App III
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

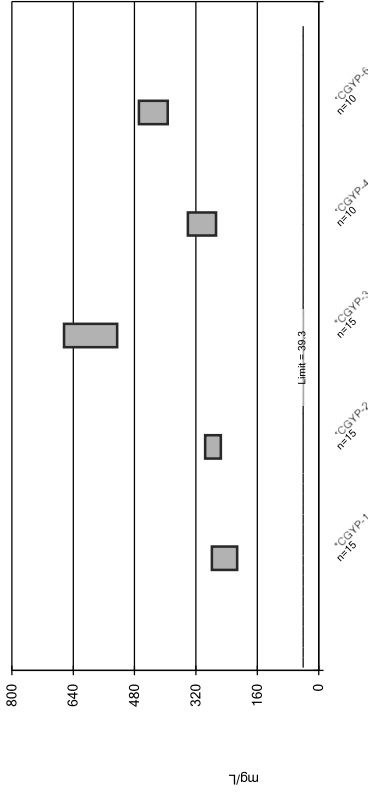

Constituent: Calcium Analysis Run 2/22/2023 3:10 PM View: Confidence Intervals - App III
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

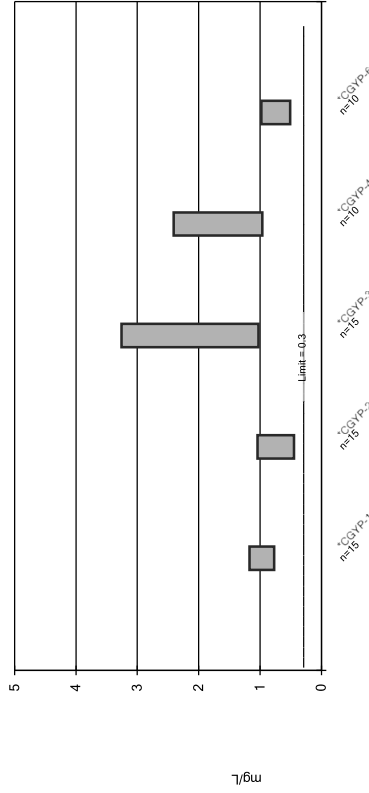

Constituent: Fluoride Analysis Run 2/22/2023 3:10 PM View: Confidence Intervals - App III
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Normality Test: Shapiro Wilk, alpha based on n.

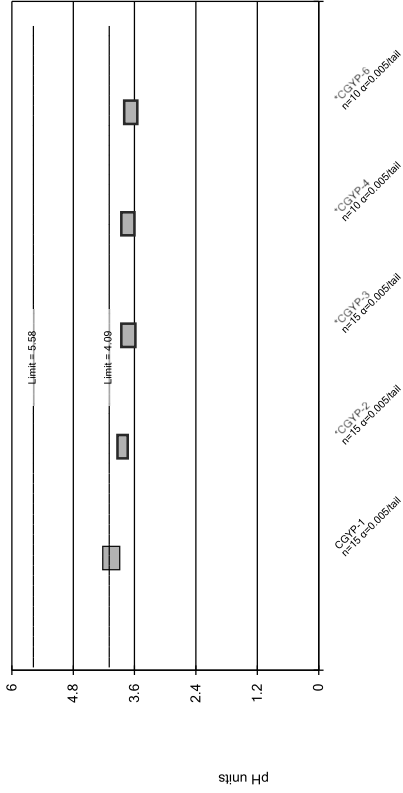

Constituent: pH Field Analysis Run 2/22/2023 3:10 PM View: Confidence Intervals - App III
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval

Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

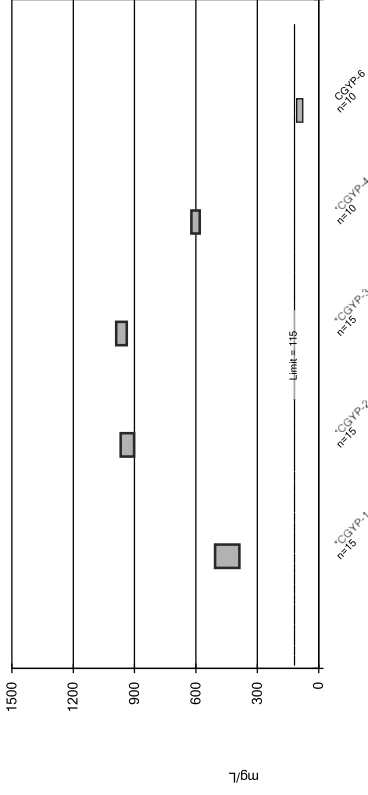

Constituent: Sulfate Analysis Run 2/22/2023 3:10 PM View: Confidence Intervals - App III
CGYP Client: Santee Cooper Data: CGYP

Confidence Interval

Constituent: Boron (mg/L) Analysis Run 2/22/2023 3:11 PM View: Confidence Intervals - App III

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	8.6	2	18		
6/4/2020	10	1.7	19		
6/18/2020	10	1.6	23		
7/1/2020	12		23		
7/2/2020		1.6			
7/16/2020	8.3	1.9	19		
7/30/2020	8.3	2	17		
8/13/2020	9.1	2.1	17		
8/27/2020	11	1.9	18		
9/21/2020	10	1.7	18		
2/10/2021	14	0.96	25		
4/7/2021	11	0.85	23	7.6	7
5/13/2021				8	6.9
7/7/2021	9.4	1.3	17		
7/8/2021				7.7	6.7
8/31/2021					6.9
9/1/2021				8	
9/27/2021				7.8	7.3
10/26/2021				6.8	6.7
11/17/2021				7.1	5.2
1/31/2022	9.84	0.51	21.5	6.21	6.2
6/21/2022	4.2	0.57	9.9	4.3	6.1
10/25/2022		1.14	16.6	6.13	5.71
10/26/2022	12.6				
Mean	9.889	1.455	19	6.964	6.471
Std. Dev.	2.254	0.5331	3.721	1.164	0.6537
Upper Lim.	11.42	1.817	21.52	8.003	7.054
Lower Lim.	8.362	1.094	16.48	5.925	5.888

Confidence Interval

Constituent: Calcium (mg/L) Analysis Run 2/22/2023 3:11 PM View: Confidence Intervals - App III

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	204	311	564		
6/4/2020	290	298	658		
6/18/2020	289	299	737		
7/1/2020	315		759		
7/2/2020		305			
7/16/2020	204	295	587		
7/30/2020	192	279	545		
8/13/2020	224	293	556		
8/27/2020	242	272	579		
9/21/2020	252	276	576		
2/10/2021	353	298	729		
4/7/2021	276	273	700	348	480
5/13/2021				360	468
7/7/2021	218	253	495		
7/8/2021				324	438
8/31/2021					441
9/1/2021				319	
9/27/2021				325	474
10/26/2021				304	455
11/17/2021				310	396
1/31/2022	229	226	563	254	362
6/21/2022	200	240	460	270	430
10/25/2022		214	415	231	370
10/26/2022	193				
Mean	245.4	275.5	594.9	304.5	431.4
Std. Dev.	49.18	29.78	102.6	41.04	42.23
Upper Lim.	278.7	295.6	664.4	341.1	469.1
Lower Lim.	212.1	255.3	525.4	267.9	393.7

Confidence Interval

Constituent: Chloride (mg/L) Analysis Run 2/22/2023 3:11 PM View: Confidence Intervals - App III

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	600	103	1030		
6/4/2020	644	117	1140		
6/18/2020	666	127	1340		
7/1/2020	717		1300		
7/2/2020		145			
7/16/2020	694	153	1070		
7/30/2020	703	176	971		
8/13/2020	647	163	1050		
8/27/2020	666	146	998		
9/21/2020	699	136	1060		
2/10/2021	791	79.5	1460		
4/7/2021	795	55.87	1405	733	1160
5/13/2021				683	1090
7/7/2021	728	83.1	950		
7/8/2021				670	1082
8/31/2021					1033
9/1/2021				617	
9/27/2021				574	1061
10/26/2021				553	1070
11/17/2021				537	865
1/31/2022	717	63	1160	523	937
6/21/2022	686	66.4	841	445	1070
10/25/2022		57.3	842	495	896
10/26/2022	733				
Mean	699.1	111.4	1108	583	1026
Std. Dev.	52.27	41.44	192.3	91.11	94.91
Upper Lim.	734.5	139.5	1238	664.3	1111
Lower Lim.	663.6	83.33	977.5	501.7	941.7

Confidence Interval

Constituent: Fluoride (mg/L) Analysis Run 2/22/2023 3:11 PM View: Confidence Intervals - App III

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.58	0.75	0.65		
6/4/2020	0.96	0.75	2.89		
6/18/2020	1.05	0.62	2.82		
7/1/2020	0.69		0.73		
7/2/2020		<0.1			
7/16/2020	0.72	1.55	2.41		
7/30/2020	0.91	<0.1	<0.1		
8/13/2020	1.04	0.71	1		
8/27/2020	1.02	0.54	4.57		
9/21/2020	1.29	1.23	1.77		
2/10/2021	1.69	1.3	6.22		
4/7/2021	1.31	1.08	3.32	3.19	1.1
5/13/2021				2.82	0.84
7/7/2021	0.97	0.87	1.88		
7/8/2021				1.85	0.99
8/31/2021					0.75
9/1/2021				1.79	
9/27/2021				1.63	0.98
10/26/2021				0.83	0.42
11/17/2021				1.53	0.58
1/31/2022	0.9	0.28	0.81	0.67	0.36
6/21/2022	0.91	0.93	1.94	1.56	0.93
10/25/2022		0.42	1.06	0.99	0.49
10/26/2022	0.53				
Mean	0.9713	0.742	2.141	1.686	0.744
Std. Dev.	0.2987	0.4392	1.65	0.8082	0.2647
Upper Lim.	1.174	1.04	3.259	2.407	0.9802
Lower Lim.	0.7689	0.4444	1.023	0.9649	0.5078

Confidence Interval

Constituent: pH, Field (pH units) Analysis Run 2/22/2023 3:11 PM View: Confidence Intervals - App III

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	3.58	3.82	3.66		
6/4/2020	3.98	3.86	3.99		
6/18/2020	3.89	3.69	3.63		
7/1/2020	4.06		3.96		
7/2/2020		3.79			
7/16/2020	4.48	4.06	3.93		
7/30/2020	4.22	3.72	3.63		
8/13/2020	3.92	3.59	3.4		
8/27/2020	3.98	3.81	3.81		
9/21/2020	4.11	3.79	3.77		
2/10/2021	3.8	3.77	3.5		
4/7/2021	4.1	4.02	3.73	3.78	3.68
5/13/2021				3.88	3.7
7/7/2021	4.19	3.8	3.56		
7/8/2021				3.65	3.54
8/31/2021					3.67
9/1/2021				3.65	
9/27/2021				3.65	3.62
10/26/2021				3.66	3.54
11/17/2021				3.54	3.66
1/31/2022	4.21	3.96	3.84	3.9	3.93
6/21/2022	4.28	4.01	3.87	3.89	3.82
10/25/2022		3.8	3.56	3.69	3.56
10/26/2022	4.01				
Mean	4.054	3.833	3.723	3.729	3.672
Std. Dev.	0.2163	0.1302	0.1781	0.1253	0.1245
Upper Lim.	4.22	3.933	3.86	3.858	3.8
Lower Lim.	3.888	3.733	3.586	3.6	3.544

Confidence Interval

Constituent: Sulfate (mg/L) Analysis Run 2/22/2023 3:11 PM View: Confidence Intervals - App III

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	364	1000	978		
6/4/2020	544	968	911		
6/18/2020	540	932	946.1		
7/1/2020	575		924		
7/2/2020		908			
7/16/2020	338	933	983		
7/30/2020	340	868	991		
8/13/2020	391	868	999		
8/27/2020	448	885	913		
9/21/2020	460	976	995		
2/10/2021	613	957	1010		
4/7/2021	445	987	972	602	96.3
5/13/2021				598	83.6
7/7/2021	377	937	993		
7/8/2021				621	84.3
8/31/2021					84.3
9/1/2021				605	
9/27/2021				584	90.9
10/26/2021				611	92.7
11/17/2021				600	67
1/31/2022	451	1020	998	575	128
6/21/2022	359	881	966	576	106
10/25/2022		914	885	652	89.3
10/26/2022	458				
Mean	446.9	935.6	964.3	602.4	92.24
Std. Dev.	87.96	48.54	38.94	22.85	16.1
Upper Lim.	506.5	968.5	990.7	622.8	106.6
Lower Lim.	387.3	902.7	937.9	582	77.87

FIGURE G.

Trend Test Summary (Upgradient Wells) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/22/2023, 2:57 PM

<u>Constituent</u>	<u>Well</u>	<u>Slope</u>	<u>Calc.</u>	<u>Critical</u>	<u>Sig.</u>	<u>N</u>	<u>%NDs</u>	<u>Normality</u>	<u>Xform</u>	<u>Alpha</u>	<u>Method</u>
Calcium (mg/L)	PM-1 (bg)	-1.217	-98	-92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1229	96	92	Yes	22	0	n/a	n/a	0.01	NP
Cobalt (mg/L)	CBW-1 (bg)	-0.00009462	-125	-81	Yes	20	5	n/a	n/a	0.01	NP
Cobalt (mg/L)	PM-1 (bg)	0.00002592	86	81	Yes	20	5	n/a	n/a	0.01	NP
Combined Radium 226 & 228 (pci/l)	PM-1 (bg)	-0.2743	-72	-68	Yes	18	33.33	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02097	-132	-81	Yes	20	5	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.329	-110	-92	Yes	22	0	n/a	n/a	0.01	NP


Trend Test Summary (Upgradient Wells) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/22/2023, 2:57 PM

Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Antimony (mg/L)	CBW-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Antimony (mg/L)	PM-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Arsenic (mg/L)	CBW-1 (bg)	0	-50	-81	No	20	85	n/a	n/a	0.01	NP
Arsenic (mg/L)	PM-1 (bg)	0	-37	-81	No	20	90	n/a	n/a	0.01	NP
Barium (mg/L)	CBW-1 (bg)	-0.000399	-45	-81	No	20	0	n/a	n/a	0.01	NP
Barium (mg/L)	PM-1 (bg)	-0.0003559	-24	-81	No	20	0	n/a	n/a	0.01	NP
Beryllium (mg/L)	CBW-1 (bg)	0	-18	-74	No	19	94.74	n/a	n/a	0.01	NP
Beryllium (mg/L)	PM-1 (bg)	0	0	81	No	20	100	n/a	n/a	0.01	NP
Boron (mg/L)	CBW-1 (bg)	-0.001121	-87	-87	No	21	9.524	n/a	n/a	0.01	NP
Boron (mg/L)	PM-1 (bg)	0	-21	-81	No	20	45	n/a	n/a	0.01	NP
Cadmium (mg/L)	CBW-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Cadmium (mg/L)	PM-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Calcium (mg/L)	CBW-1 (bg)	0.3443	41	87	No	21	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-1.217	-98	-92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1229	96	92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	PM-1 (bg)	0	-16	-92	No	22	0	n/a	n/a	0.01	NP
Chromium (mg/L)	CBW-1 (bg)	0	-18	-74	No	19	94.74	n/a	n/a	0.01	NP
Chromium (mg/L)	PM-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Cobalt (mg/L)	CBW-1 (bg)	-0.00009462	-125	-81	Yes	20	5	n/a	n/a	0.01	NP
Cobalt (mg/L)	PM-1 (bg)	0.00002592	86	81	Yes	20	5	n/a	n/a	0.01	NP
Combined Radium 226 & 228 (pci/l)	CBW-1 (bg)	-0.4294	-72	-74	No	19	36.84	n/a	n/a	0.01	NP
Combined Radium 226 & 228 (pci/l)	PM-1 (bg)	-0.2743	-72	-68	Yes	18	33.33	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02097	-132	-81	Yes	20	5	n/a	n/a	0.01	NP
Fluoride (mg/L)	PM-1 (bg)	0	0	81	No	20	100	n/a	n/a	0.01	NP
Lead (mg/L)	CBW-1 (bg)	-0.0001122	-64	-81	No	20	5	n/a	n/a	0.01	NP
Lead (mg/L)	PM-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Lithium (mg/L)	CBW-1 (bg)	0	-15	-81	No	20	95	n/a	n/a	0.01	NP
Lithium (mg/L)	PM-1 (bg)	0	-33	-81	No	20	90	n/a	n/a	0.01	NP
Mercury (mg/L)	CBW-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Mercury (mg/L)	PM-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Molybdenum (mg/L)	CBW-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Molybdenum (mg/L)	PM-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
pH, Field (pH units)	CBW-1 (bg)	0	8	92	No	22	0	n/a	n/a	0.01	NP
pH, Field (pH units)	PM-1 (bg)	0.00185	8	118	No	26	0	n/a	n/a	0.01	NP
Selenium (mg/L)	CBW-1 (bg)	0	0	81	No	20	100	n/a	n/a	0.01	NP
Selenium (mg/L)	PM-1 (bg)	0	0	74	No	19	100	n/a	n/a	0.01	NP
Sulfate (mg/L)	CBW-1 (bg)	0	0	92	No	22	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.329	-110	-92	Yes	22	0	n/a	n/a	0.01	NP
Thallium (mg/L)	CBW-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Thallium (mg/L)	PM-1 (bg)	0	0	68	No	18	100	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CBW-1 (bg)	1.733	19	92	No	22	4.545	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	PM-1 (bg)	-3.385	-51	-118	No	26	3.846	n/a	n/a	0.01	NP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

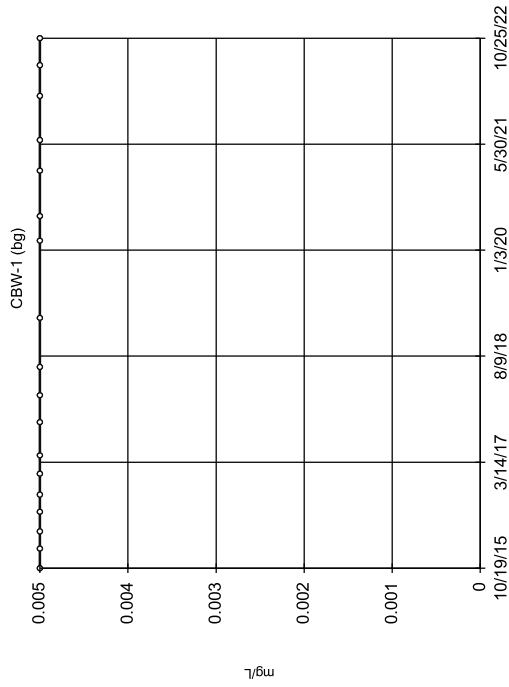


n = 18
Slope = 0
units per year.
Mann-Kendall
statistic = 0
critical = 68
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Antimony Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

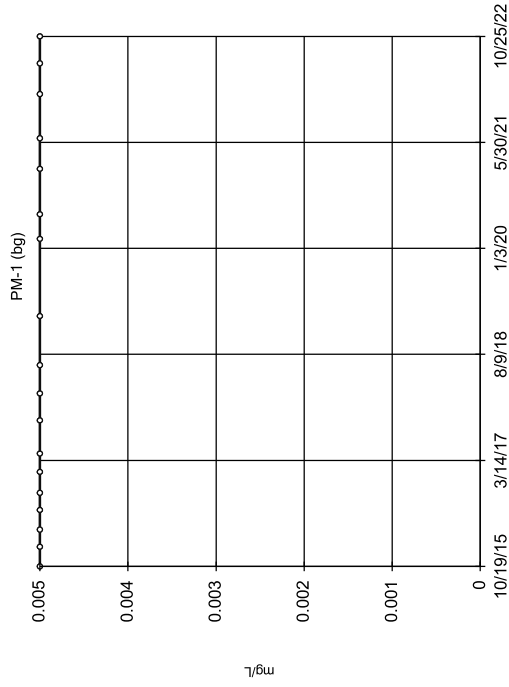


n = 18
Slope = 0
units per year.
Mann-Kendall
statistic = 0
critical = 68
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Antimony Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

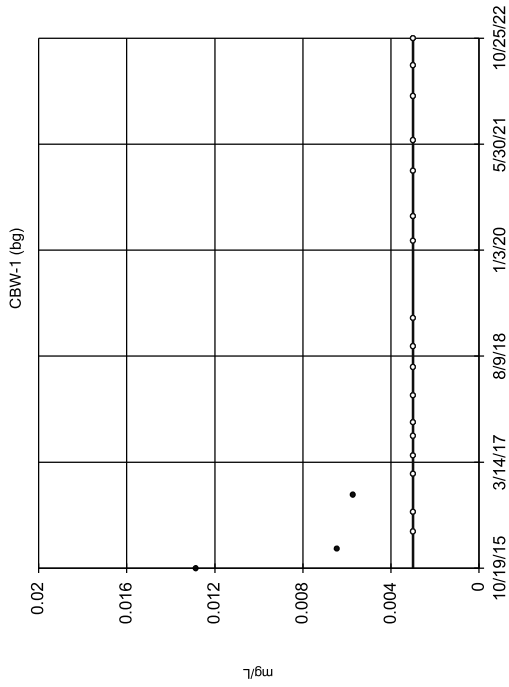


n = 20
Slope = 0
units per year.
Mann-Kendall
statistic = -50
critical = -81
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Arsenic Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

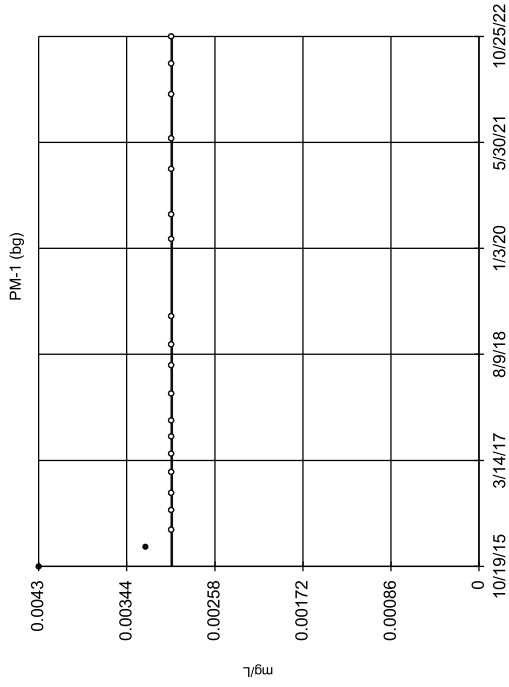

n = 20
Slope = 0
units per year.
Mann-Kendall
statistic = -37
critical = -81
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).


Constituent: Arsenic Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

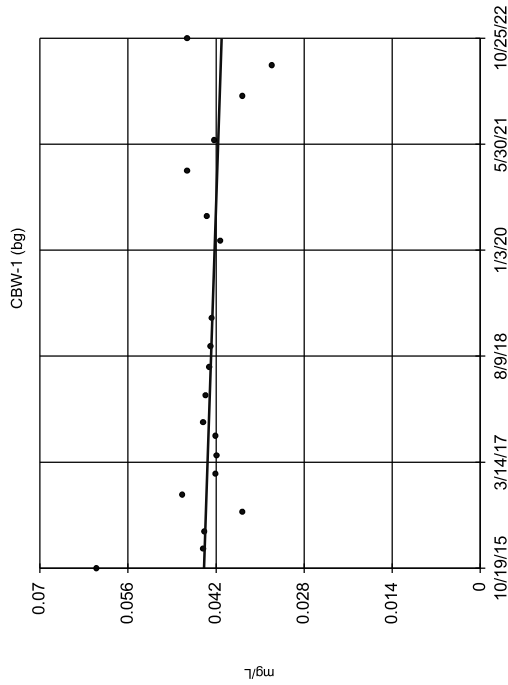


Constituent: Barium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

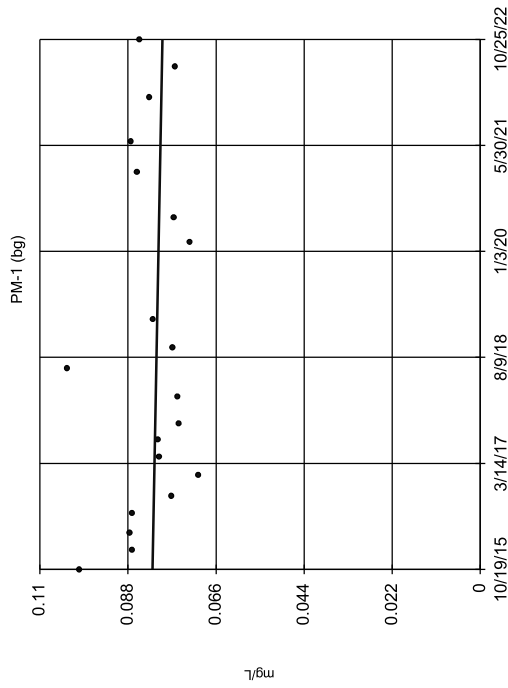


Constituent: Barium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

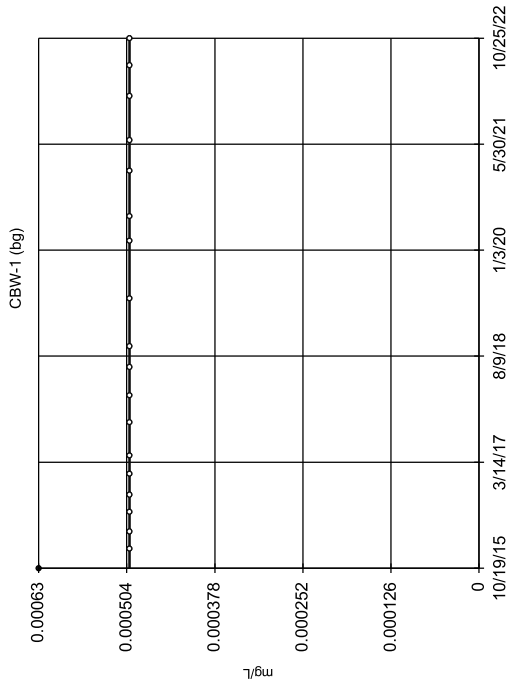

Constituent: Beryllium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

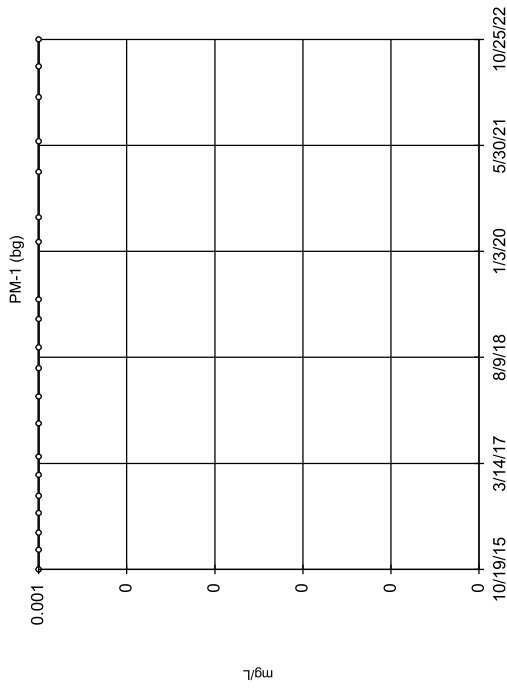

Constituent: Beryllium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

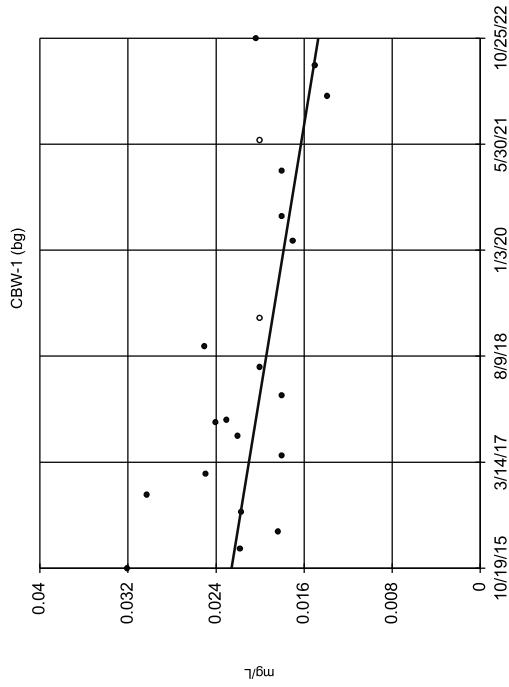

Constituent: Boron Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

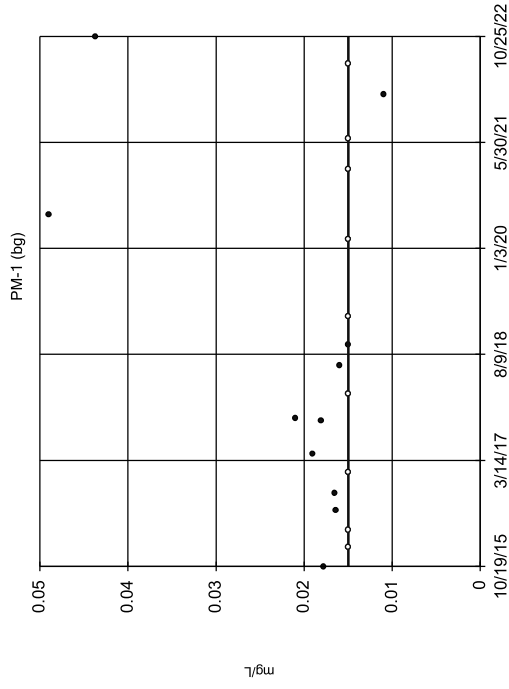

Constituent: Boron Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

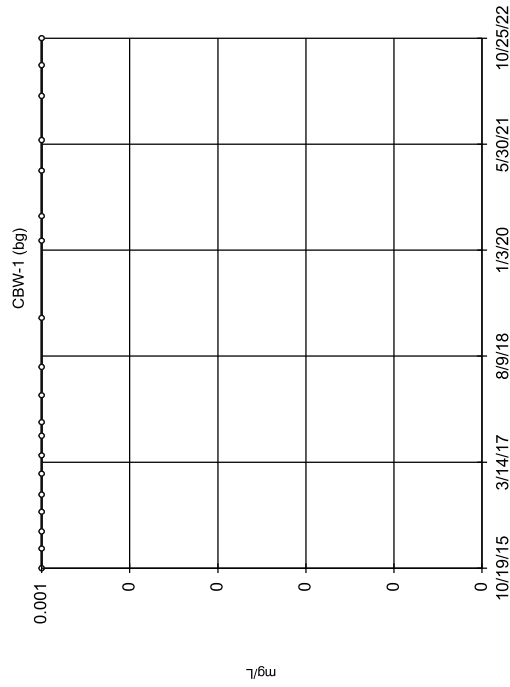

Constituent: Cadmium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

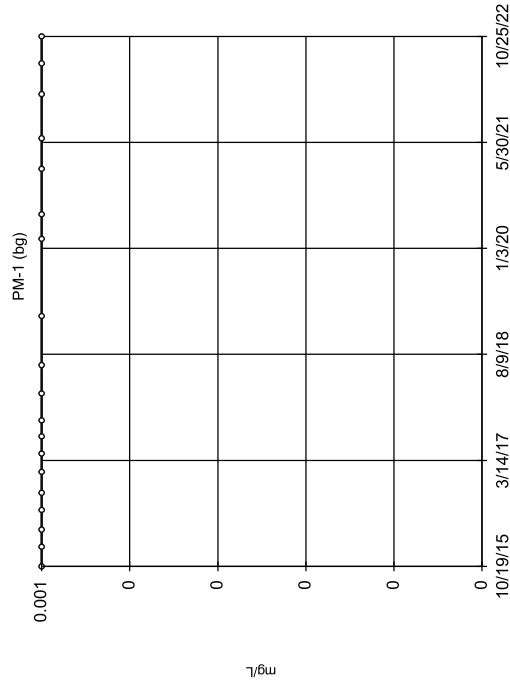


Constituent: Cadmium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

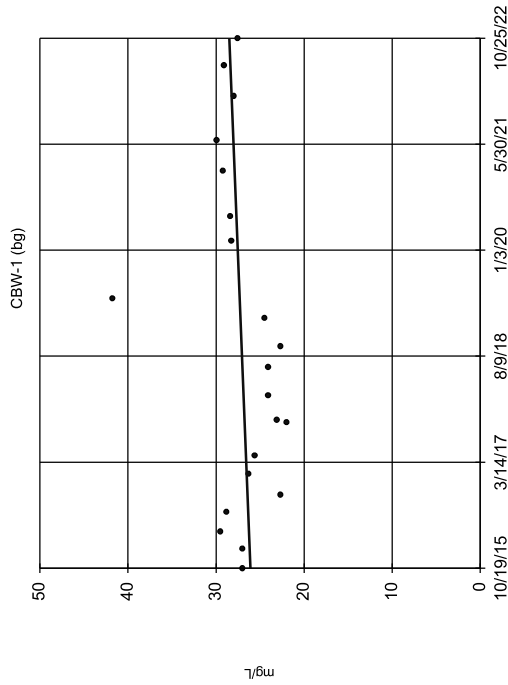


Constituent: Calcium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

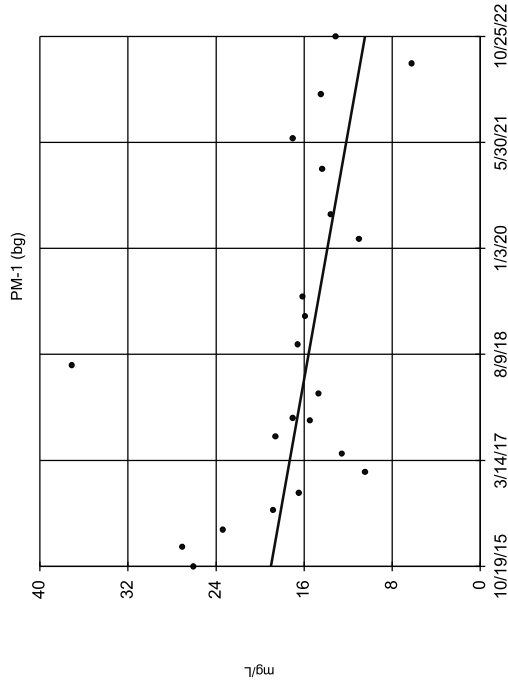


Constituent: Calcium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

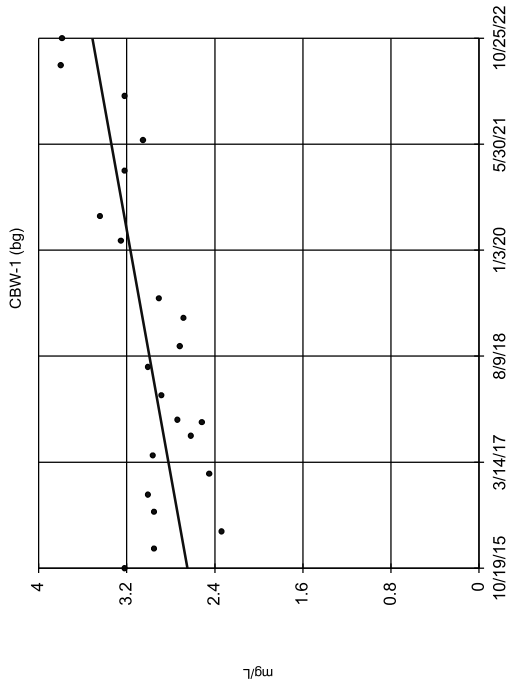

Constituent: Chloride Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

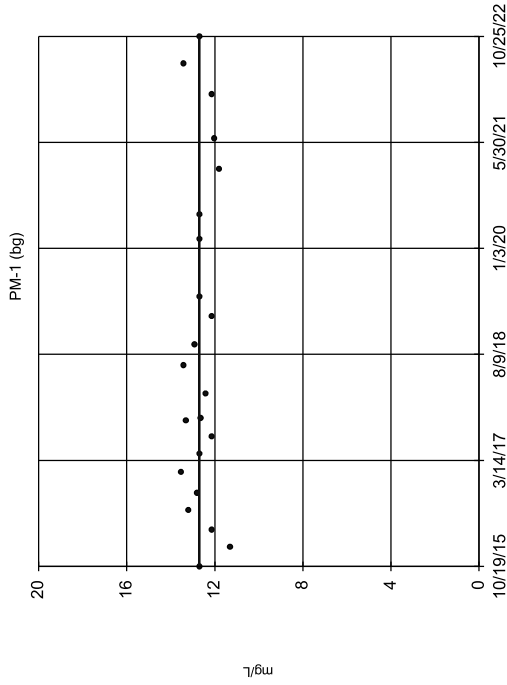

Constituent: Chloride Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

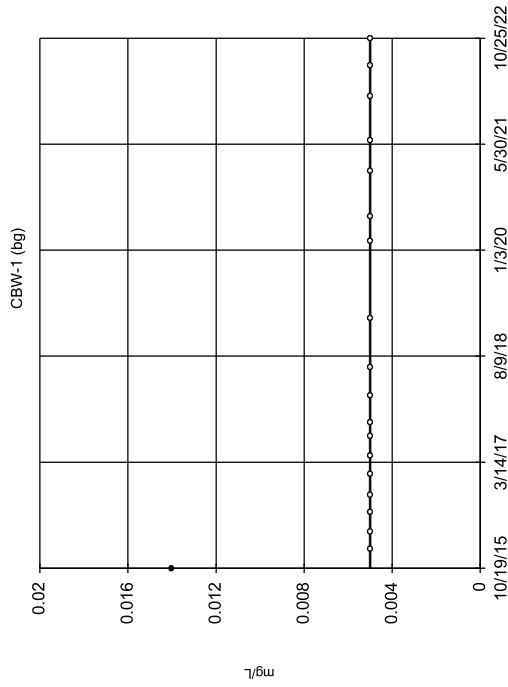


n = 19
Slope = 0
units per year.
Mann-Kendall
statistic = -18
critical = -74
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Chromium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

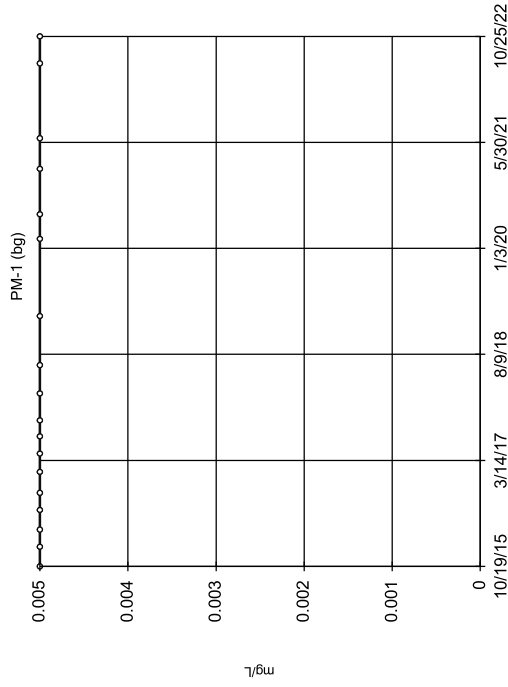


n = 18
Slope = 0
units per year.
Mann-Kendall
statistic = 0
critical = 68
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Chromium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

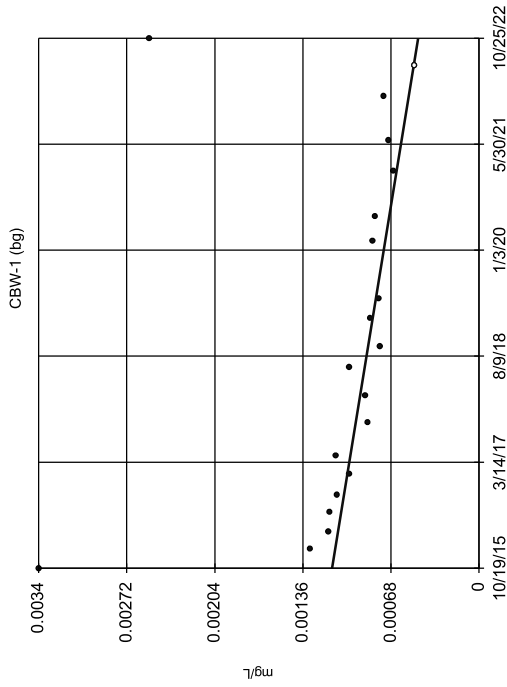


n = 20
Slope = -0.00009462
units per year.
Mann-Kendall
statistic = -125
critical = -81
Decreasing trend
significant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Cobalt Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

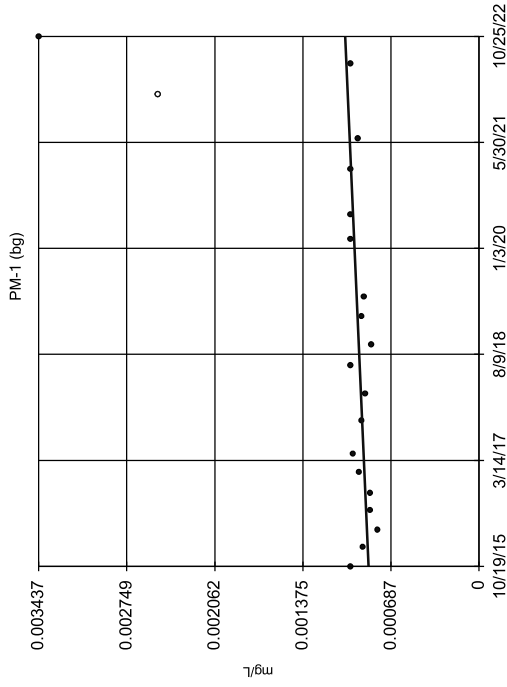


n = 20
Slope = 0.00002592
units per year.
Mann-Kendall
statistic = 85
critical = 81
Increasing trend
significant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Cobalt Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

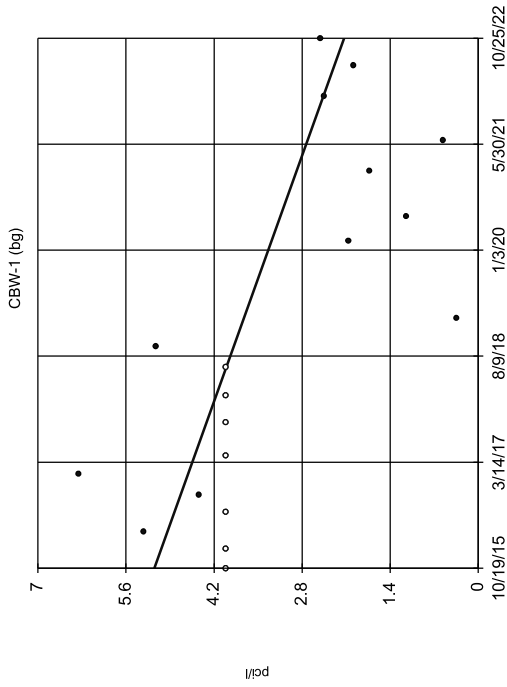


Constituent: Combined Radium 226 & 228 Analysis Run 2/22/2023 2:47 PM View: Trend Tests

CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

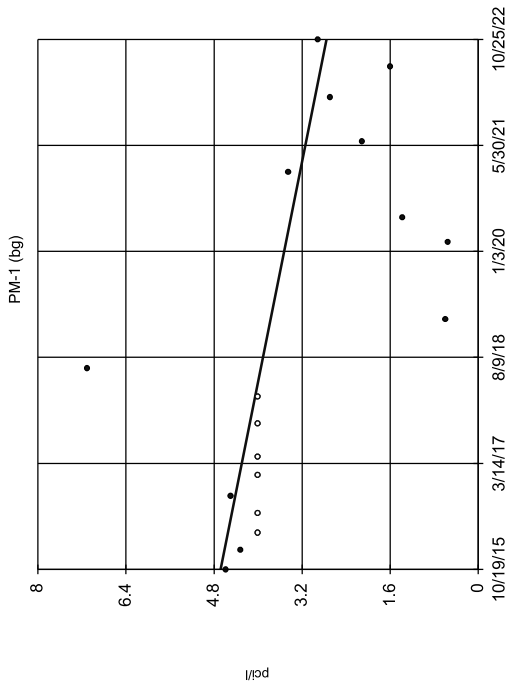


Constituent: Combined Radium 226 & 228 Analysis Run 2/22/2023 2:47 PM View: Trend Tests

CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

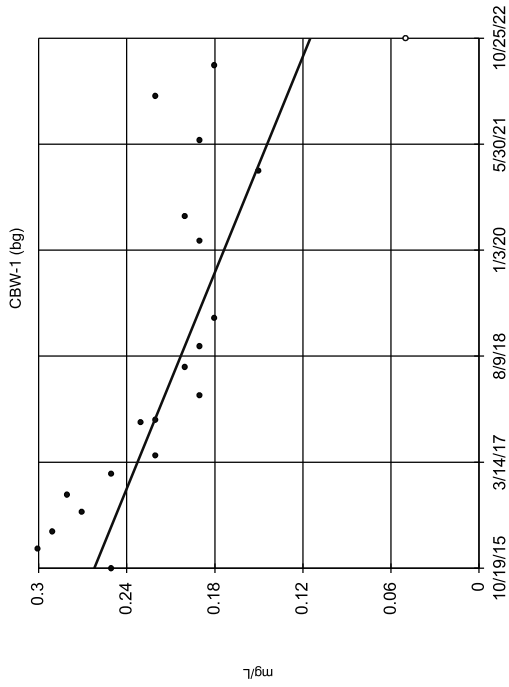


Constituent: Fluoride Analysis Run 2/22/2023 2:47 PM View: Trend Tests

CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

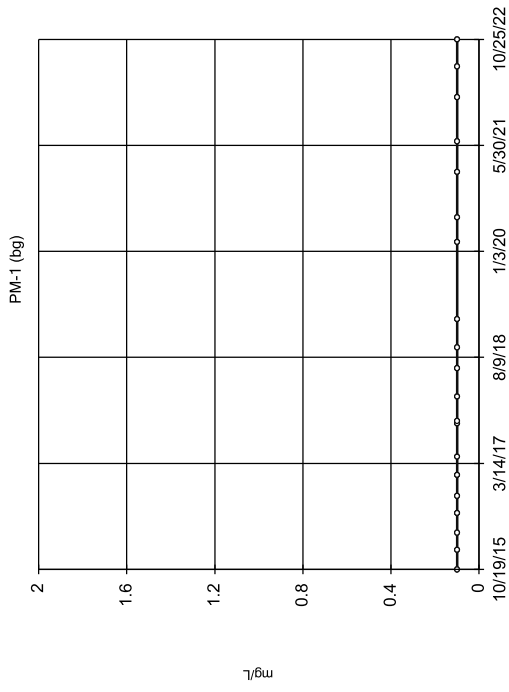


Constituent: Fluoride Analysis Run 2/22/2023 2:47 PM View: Trend Tests

CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

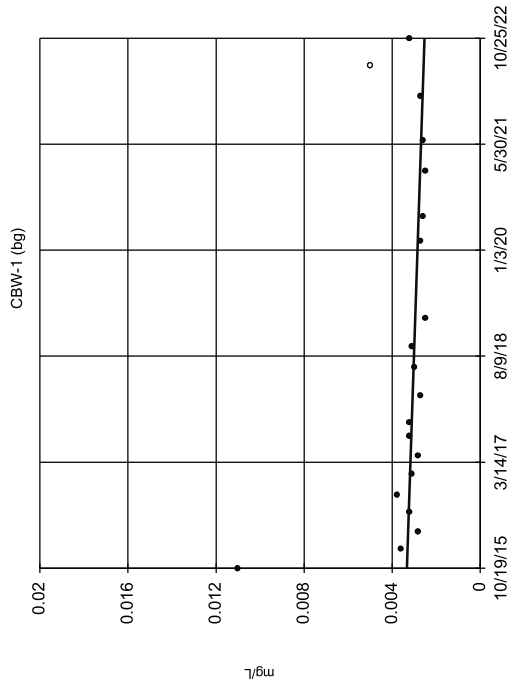

Constituent: Lead Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

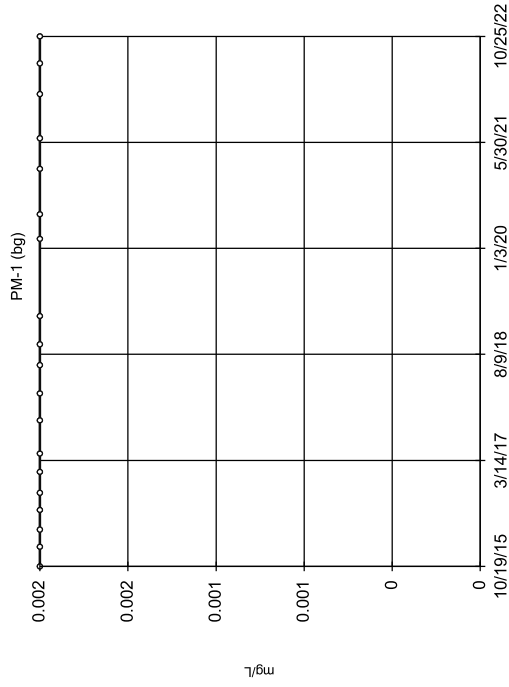

Constituent: Lead Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

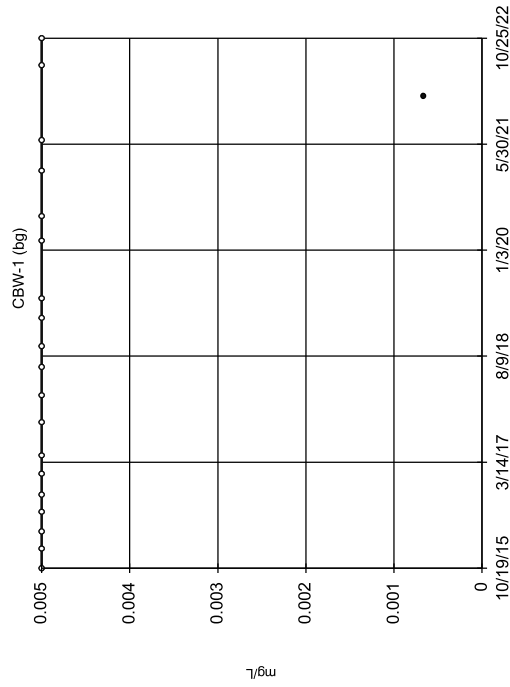

Constituent: Lithium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

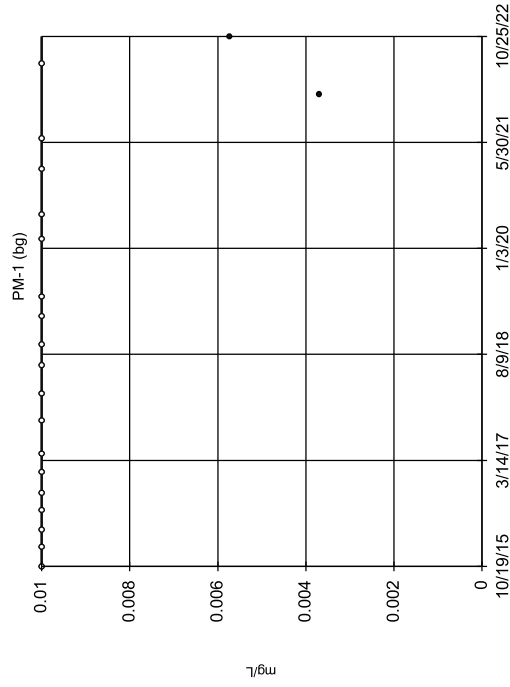

Constituent: Lithium Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

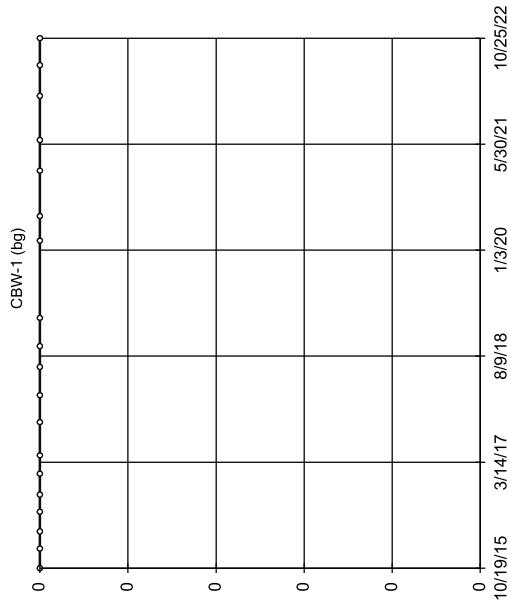


n = 19
Slope = 0
units per year.
Mann-Kendall
statistic = 0
critical = 74
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Mercury Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

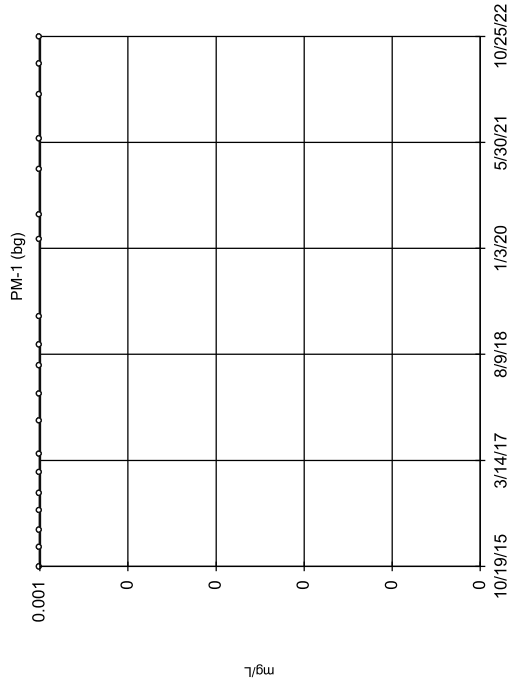


n = 19
Slope = 0
units per year.
Mann-Kendall
statistic = 0
critical = 74
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Mercury Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

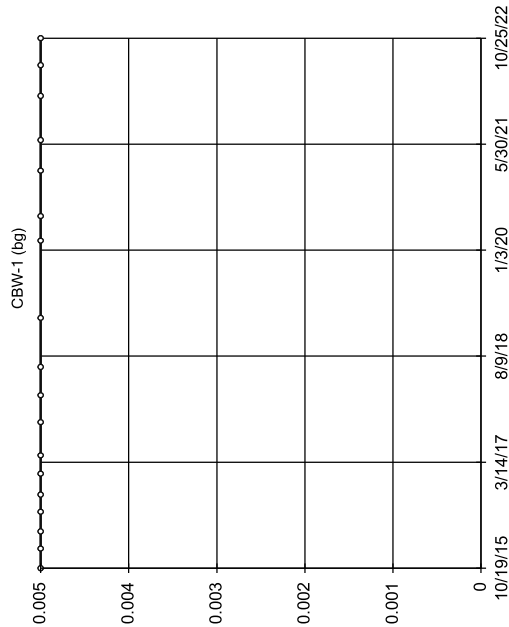


n = 18
Slope = 0
units per year.
Mann-Kendall
statistic = 0
critical = 68
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Molybdenum Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sanitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

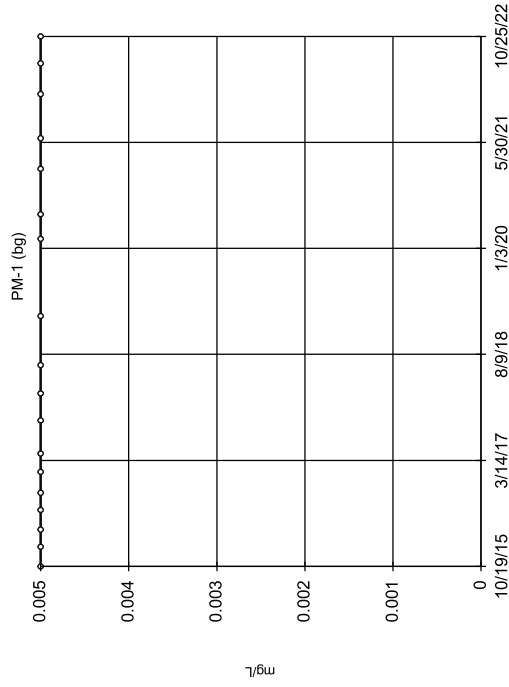

n = 18
Slope = 0
units per year.
Mann-Kendall
statistic = 0
critical = 68
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).


Constituent: Molybdenum Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

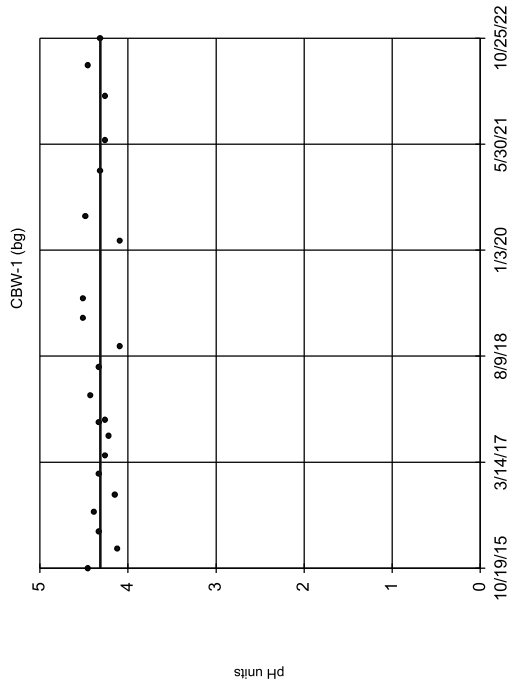


Constituent: pH, Field Analysis Run 2/22/2023 2:47 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

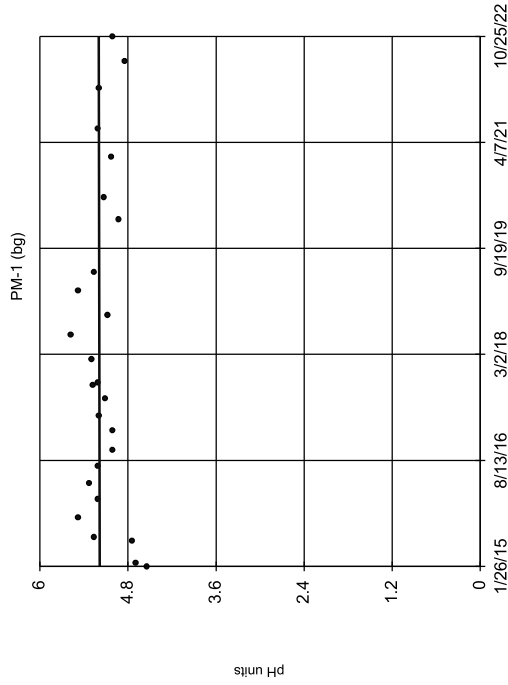


Constituent: pH, Field Analysis Run 2/22/2023 2:48 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

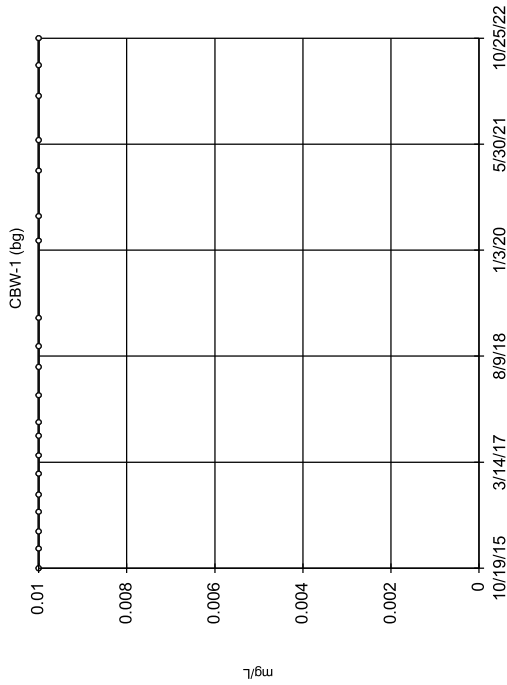


Constituent: Selenium Analysis Run 2/22/2023 2:48 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

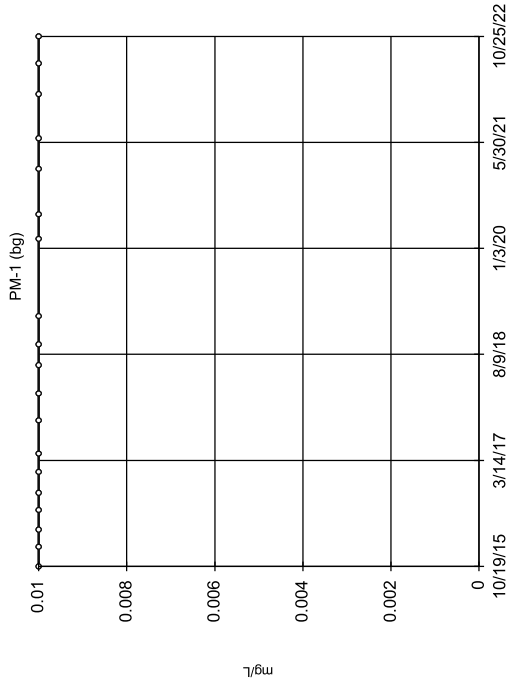

Constituent: Selenium Analysis Run 2/22/2023 2:48 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

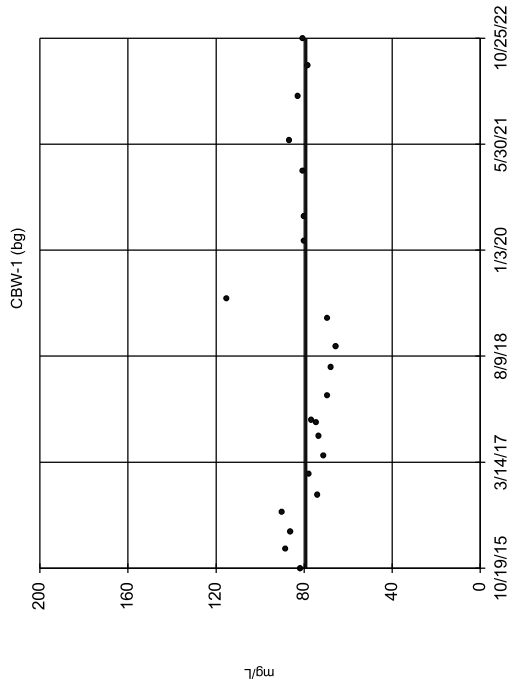

n = 22
 Slope = 0
 units per year.
 Mann-Kendall
 statistic = 0
 critical = 92
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Sulfate Analysis Run 2/22/2023 2:48 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

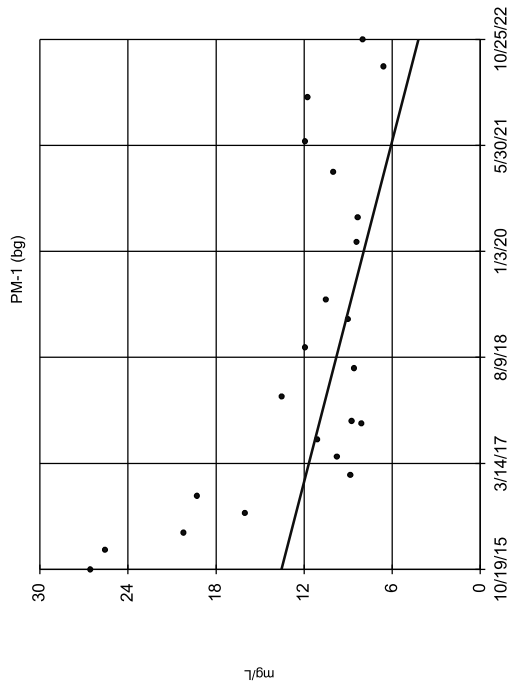

n = 22
 Slope = -1.329
 units per year.
 Mann-Kendall
 statistic = -110
 critical = -92
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Sulfate Analysis Run 2/22/2023 2:48 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

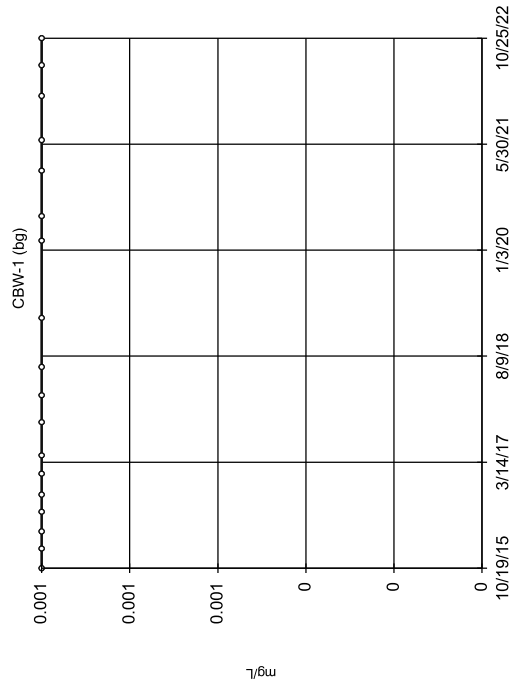

n = 18
 Slope = 0
 units per year.
 Mann-Kendall
 statistic = 0
 critical = 68
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Thallium Analysis Run 2/22/2023 2:48 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

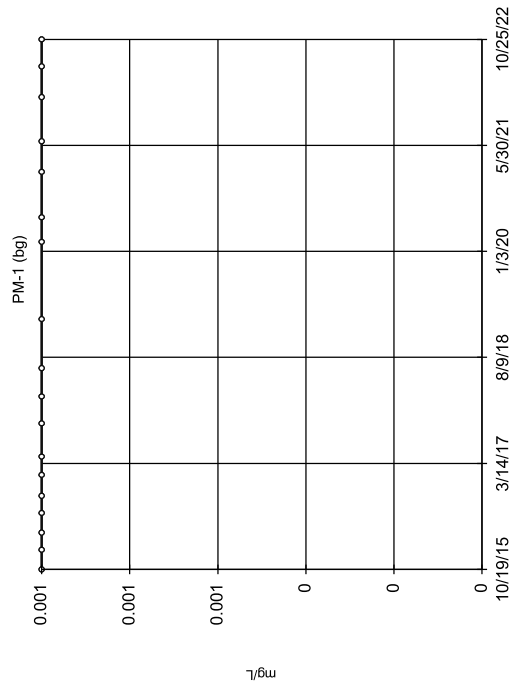


n = 18
 Slope = 0
 units per year.
 Mann-Kendall
 statistic = 0
 critical = 68
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Thallium Analysis Run 2/22/2023 2:48 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

CBW-1 (bg)

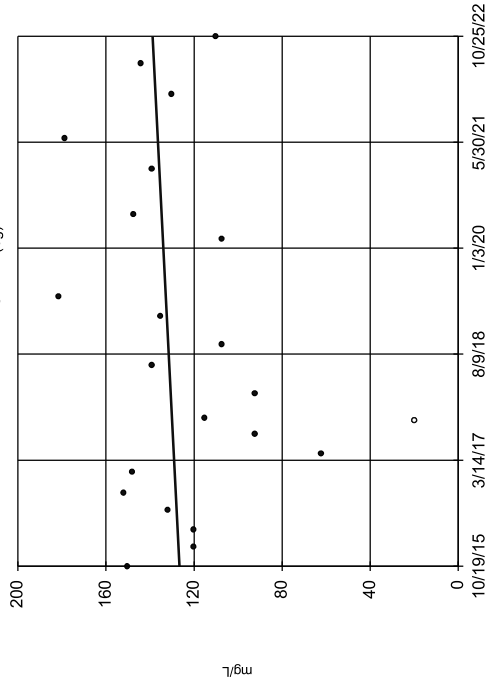


n = 22
Slope = 1.723
units per year.
Mann-Kendall
statistic = 19
critical = 92
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Total Dissolved Solids Analysis Run 2/22/2023 2:48 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

PM-1 (bg)

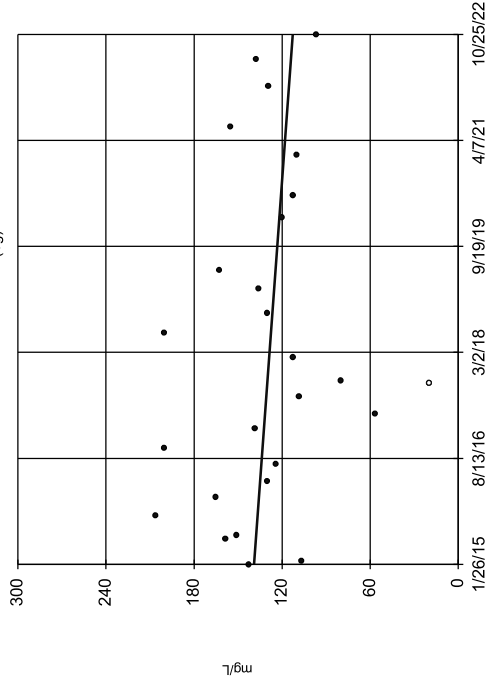

n = 26
Slope = -3.385
units per year.
Mann-Kendall
statistic = -51
critical = -118
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Total Dissolved Solids Analysis Run 2/22/2023 2:48 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

FIGURE H.

Interwell Prediction Limit Summary (June 2022) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:52 PM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bq N	Bq Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	6/21/2022	4.2	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	6/21/2022	0.57	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	6/21/2022	9.9	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	6/21/2022	4.3	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	6/21/2022	6.1	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.37	n/a	6/21/2022	200	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.37	n/a	6/21/2022	240	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.37	n/a	6/21/2022	460	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.37	n/a	6/21/2022	270	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.37	n/a	6/21/2022	430	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	6/21/2022	686	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	6/21/2022	66.4	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	6/21/2022	841	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	6/21/2022	445	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	6/21/2022	1070	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	6/21/2022	0.91	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	6/21/2022	0.93	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	6/21/2022	1.94	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	6/21/2022	1.56	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	6/21/2022	0.93	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	6/21/2022	4.01	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	6/21/2022	3.87	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	6/21/2022	3.89	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	6/21/2022	3.82	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	6/21/2022	359	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	6/21/2022	881	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	6/21/2022	966	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	6/21/2022	576	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	203.8	n/a	6/21/2022	1771	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	203.8	n/a	6/21/2022	1408	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	203.8	n/a	6/21/2022	2952	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	203.8	n/a	6/21/2022	1676	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	203.8	n/a	6/21/2022	3210	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2


Interwell Prediction Limit Summary (June 2022) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:52 PM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bq N	Bq Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	6/21/2022	4.2	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	6/21/2022	0.57	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	6/21/2022	9.9	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	6/21/2022	4.3	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	6/21/2022	6.1	Yes	39	n/a	n/a	28.21	n/a	n/a	0.001193	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.37	n/a	6/21/2022	200	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.37	n/a	6/21/2022	240	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.37	n/a	6/21/2022	460	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.37	n/a	6/21/2022	270	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.37	n/a	6/21/2022	430	Yes	41	22.02	7.44	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	6/21/2022	686	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	6/21/2022	66.4	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	6/21/2022	841	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	6/21/2022	445	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	6/21/2022	1070	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	6/21/2022	0.91	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	6/21/2022	0.93	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	6/21/2022	1.94	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	6/21/2022	1.56	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	6/21/2022	0.93	Yes	38	n/a	n/a	50	n/a	n/a	0.001257	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	6/21/2022	4.28	No	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	6/21/2022	4.01	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	6/21/2022	3.87	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	6/21/2022	3.89	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	6/21/2022	3.82	Yes	46	n/a	n/a	0	n/a	n/a	0.001792	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	6/21/2022	359	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	6/21/2022	881	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	6/21/2022	966	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	6/21/2022	576	Yes	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	6/21/2022	106	No	42	n/a	n/a	0	n/a	n/a	0.001052	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	203.8	n/a	6/21/2022	1771	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	203.8	n/a	6/21/2022	1408	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	203.8	n/a	6/21/2022	2952	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	203.8	n/a	6/21/2022	1676	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	203.8	n/a	6/21/2022	3210	Yes	46	128.3	39.47	4.348	None	No	0.001254	Param Inter 1 of 2

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

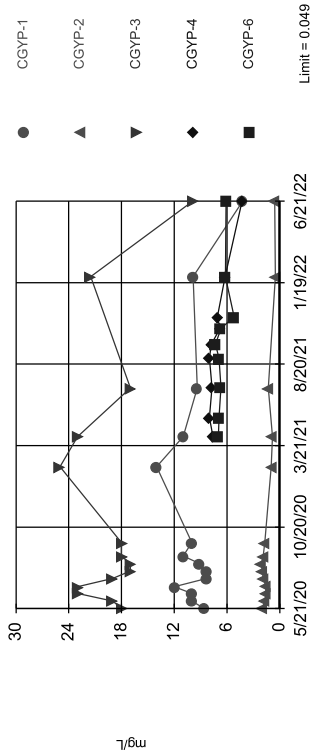


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 39 background values. 28.21% NDs. Annual per-constituent alpha = 0.01423. Individual comparison alpha = 0.001193 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: Boron Analysis Run 2/21/2023 1:51 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

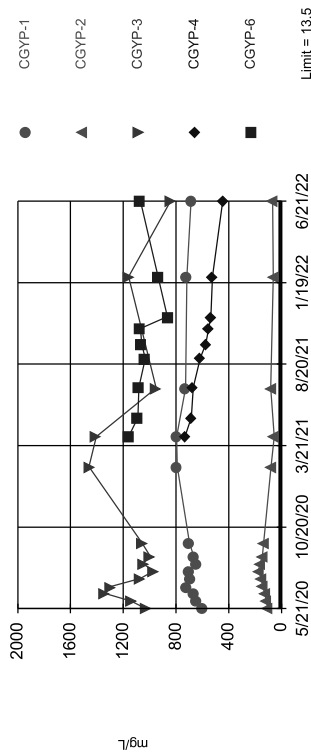


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 42 background values. Annual per-constituent alpha = 0.01255. Individual comparison alpha = 0.001052 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: Chloride Analysis Run 2/21/2023 1:51 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Parametric

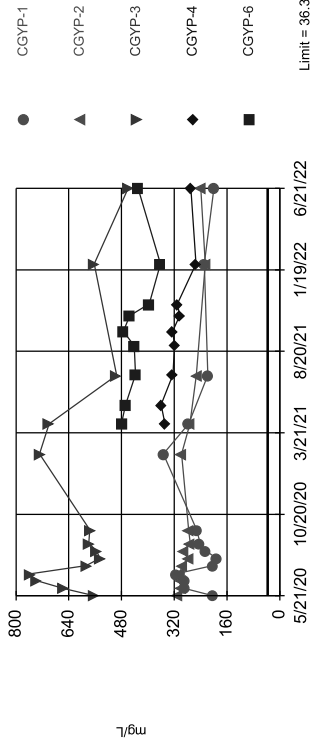


Background Data Summary: Mean=22.02, Std. Dev.=7.44, n=41. Seasonality was not detected with 95% confidence. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9677, critical = 0.92. Kappa = 1.929 (c=7, w=6, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.001254. Comparing 5 points to limit. Assumes 1 future value.

Constituent: Calcium Analysis Run 2/21/2023 1:51 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

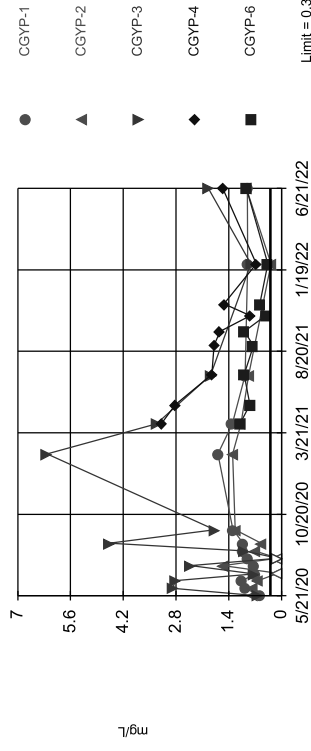


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 38 background values. 50% NDs. Annual per-constituent alpha = 0.01499. Individual comparison alpha = 0.001257 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: Fluoride Analysis Run 2/21/2023 1:51 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limits: CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

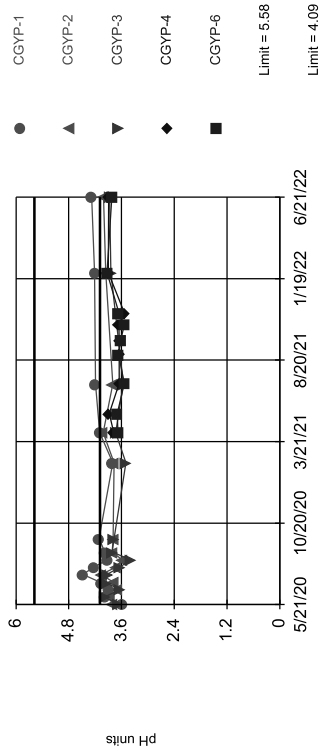


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limits are highest and lowest of 46 background values. Annual per-constituent alpha = 0.02139. Individual comparison alpha = 0.001792 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: pH, Field Analysis Run 2/21/2023 1:51 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Parametric

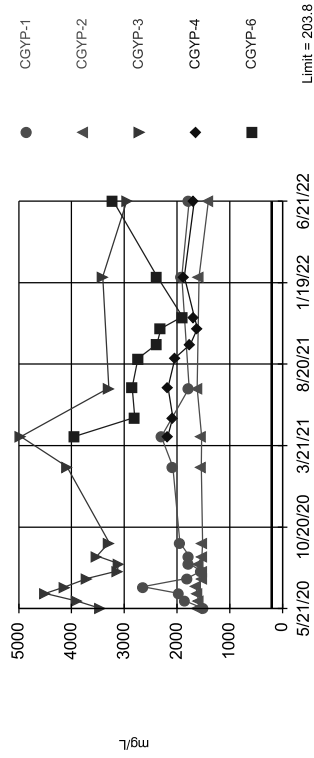


Background Data Summary: Mean=128.3, Std. Dev.=39.47, n=46, 4.348% NDs. Seasonality was not detected with 95% confidence. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9437, critical = 0.927. Kappa = 1.913 (c=7, w=6, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.001254. Comparing 5 points to limit. Assumes 1 future value.

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:51 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4

Prediction Limit
Interwell Non-parametric

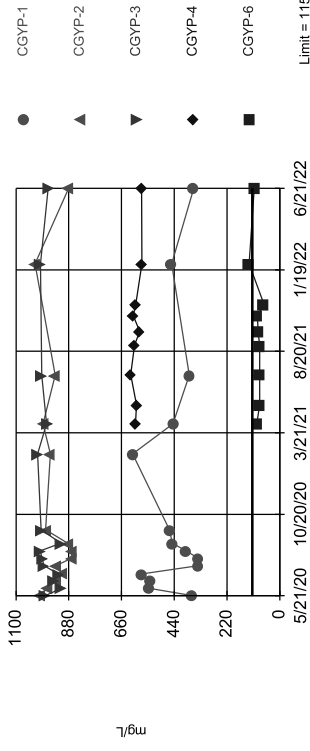

Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 42 background values. Annual per-constituent alpha = 0.01256. Individual comparison alpha = 0.001052 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: Sulfate Analysis Run 2/21/2023 1:51 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Prediction Limit

Constituent: Boron (mg/L) Analysis Run 2/21/2023 1:52 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-3	CGYP-2	CGYP-1	CGYP-6	CGYP-4
10/19/2015	0.032	0.0178					
1/26/2016	0.0218	<0.015					
4/19/2016	0.0183	<0.015					
7/18/2016	0.0217	0.0163					
10/11/2016	0.0302	0.0165					
1/23/2017	0.0249	<0.015					
4/17/2017	0.018	0.019					
7/25/2017	0.022						
9/25/2017	0.024	0.018					
10/9/2017	0.023	0.021					
2/7/2018	0.018	<0.015					
6/20/2018	0.02	0.016					
10/1/2018	0.025	0.015					
2/12/2019	<0.015	<0.015					
2/24/2020	0.017	<0.015					
5/21/2020			18	2	8.6		
6/4/2020			19	1.7	10		
6/18/2020			23	1.6	10		
6/22/2020	0.018	0.049					
7/1/2020			23		12		
7/2/2020				1.6			
7/16/2020			19	1.9	8.3		
7/30/2020			17	2	8.3		
8/13/2020			17	2.1	9.1		
8/27/2020			18	1.9	11		
9/21/2020			18	1.7	10		
1/26/2021	0.018	<0.015					
2/10/2021			25	0.96	14		
4/7/2021			23	0.85	11	7	7.6
5/13/2021						6.9	8
6/21/2021	<0.015	<0.015					
7/7/2021			17	1.3	9.4		
7/8/2021						6.7	7.7
8/31/2021						6.9	
9/1/2021							8
9/27/2021						7.3	7.8
10/26/2021						6.7	6.8
11/17/2021						5.2	7.1
1/24/2022	0.0139	0.011					
1/31/2022			21.5	0.51	9.84	6.2	6.21
6/20/2022	0.015	<0.015					
6/21/2022			9.9	0.57	4.2	6.1	4.3

Prediction Limit

Constituent: Calcium (mg/L) Analysis Run 2/21/2023 1:52 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
10/19/2015	27	26					
1/26/2016	27	27					
4/19/2016	29.4	23.3					
7/18/2016	28.7	18.8					
10/11/2016	22.7	16.4					
1/23/2017	26.2	10.4					
4/17/2017	25.6	12.5					
7/12/2017		18.5					
9/25/2017	21.9	15.4					
10/9/2017	23	17					
2/7/2018	24	14.7					
6/20/2018	24	37					
10/1/2018	22.7	16.6					
2/12/2019	24.4	15.9					
5/20/2019	41.65 (D)	16.1 (D)					
2/24/2020	28.2	11					
5/21/2020			204	311	564		
6/4/2020			290	298	658		
6/18/2020			289	299	737		
6/22/2020	28.4	13.5					
7/1/2020			315		759		
7/2/2020				305			
7/16/2020			204	295	587		
7/30/2020			192	279	545		
8/13/2020			224	293	556		
8/27/2020			242	272	579		
9/21/2020			252	276	576		
1/26/2021	29.2	14.3					
2/10/2021			353	298	729		
4/7/2021			276	273	700	348	480
5/13/2021						360	468
6/21/2021	29.9	17					
7/7/2021			218	253	495		
7/8/2021						324	438
8/31/2021							441
9/1/2021						319	
9/27/2021						325	474
10/26/2021						304	455
11/17/2021						310	396
1/24/2022	27.9	14.4					
1/31/2022			229	226	563	254	362
6/20/2022	29	6.2					
6/21/2022			200	240	460	270	430

Prediction Limit

Constituent: Chloride (mg/L) Analysis Run 2/21/2023 1:52 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-3	CGYP-2	CGYP-4	CGYP-6
10/19/2015	3.21	12.7					
1/26/2016	2.95	11.3					
4/19/2016	2.33	12.1					
7/18/2016	2.95	13.2					
10/11/2016	3	12.8					
1/23/2017	2.45	13.5					
4/17/2017	2.96	12.7					
7/12/2017		12.1					
7/25/2017	2.61						
9/25/2017	2.51	13.3					
10/9/2017	2.73	12.6					
2/7/2018	2.88	12.4					
6/20/2018	3	13.4					
10/1/2018	2.71	12.9					
2/12/2019	2.68	12.1					
5/20/2019	2.9	12.7					
2/24/2020	3.25	12.7					
5/21/2020			600	1030	103		
6/4/2020			644	1140	117		
6/18/2020			666	1340	127		
6/22/2020	3.44	12.67					
7/1/2020			717	1300			
7/2/2020					145		
7/16/2020			694	1070	153		
7/30/2020			703	971	176		
8/13/2020			647	1050	163		
8/27/2020			666	998	146		
9/21/2020			699	1060	136		
1/26/2021	3.22	11.8					
2/10/2021			791	1460	79.5		
4/7/2021			795	1405	55.87	733	1160
5/13/2021						683	1090
6/21/2021	3.05	12					
7/7/2021			728	950	83.1		
7/8/2021						670	1082
8/31/2021							1033
9/1/2021						617	
9/27/2021						574	1061
10/26/2021						553	1070
11/17/2021						537	865
1/24/2022	3.21	12.1					
1/31/2022			717	1160	63	523	937
6/20/2022	3.79	13.4					
6/21/2022			686	841	66.4	445	1070

Prediction Limit

Constituent: Fluoride (mg/L) Analysis Run 2/21/2023 1:52 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-3	CGYP-2	CGYP-1	CGYP-6	CGYP-4
10/19/2015	0.25	<0.1					
1/26/2016	0.3	<0.1					
4/19/2016	0.29	<0.1					
7/18/2016	0.27	<0.1					
10/11/2016	0.28	<0.1					
1/23/2017	0.25	<0.1					
4/17/2017	0.22	<0.1					
9/25/2017	0.23	<0.1					
10/9/2017	0.22	<0.1					
2/7/2018	0.19	<0.1					
6/20/2018	0.2	<0.1					
10/1/2018	0.19	<0.1					
2/12/2019	0.18	<0.1					
2/24/2020	0.19	<0.1					
5/21/2020			0.65	0.75	0.58		
6/4/2020			2.89	0.75	0.96		
6/18/2020			2.82	0.62	1.05		
6/22/2020	0.2	<0.1					
7/1/2020			0.73		0.69		
7/2/2020				<0.1			
7/16/2020			2.41	1.55	0.72		
7/30/2020			<0.1	<0.1	0.91		
8/13/2020			1	0.71	1.04		
8/27/2020			4.57	0.54	1.02		
9/21/2020			1.77	1.23	1.29		
1/26/2021	0.15	<0.1					
2/10/2021			6.22	1.3	1.69		
4/7/2021			3.32	1.08	1.31	1.1	3.19
5/13/2021						0.84	2.82
6/21/2021	0.19	<0.1					
7/7/2021			1.88	0.87	0.97		
7/8/2021						0.99	1.85
8/31/2021						0.75	
9/1/2021							1.79
9/27/2021						0.98	1.63
10/26/2021						0.42	0.83
11/17/2021						0.58	1.53
1/24/2022	0.22	<0.1					
1/31/2022			0.81	0.28	0.9	0.36	0.67
6/20/2022	0.18	<0.1					
6/21/2022			1.94	0.93	0.91	0.93	1.56

Prediction Limit

Constituent: pH, Field (pH units) Analysis Run 2/21/2023 1:52 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-1	CGYP-3	CGYP-6	CGYP-4
1/26/2015	4.53						
2/16/2015	4.68						
6/16/2015	4.74						
7/6/2015	5.25						
10/19/2015	5.47	4.45					
1/26/2016	5.2	4.12					
4/19/2016	5.32	4.33					
7/18/2016	5.2	4.38					
10/11/2016	5.01	4.14					
1/23/2017	5.01	4.32					
4/17/2017	5.19	4.26					
7/12/2017	5.11						
7/25/2017		4.21					
9/25/2017	5.27	4.32					
10/9/2017	5.21	4.25					
2/7/2018	5.29	4.42					
6/20/2018	5.58	4.32					
10/1/2018	5.08	4.09					
2/12/2019	5.47	4.5					
5/20/2019	5.26	4.5					
2/24/2020	4.92	4.09					
5/21/2020			3.82	3.58	3.66		
6/4/2020			3.86	3.98	3.99		
6/18/2020			3.69	3.89	3.63		
6/22/2020	5.12	4.48					
7/1/2020				4.06	3.96		
7/2/2020			3.79				
7/16/2020			4.06	4.48	3.93		
7/30/2020			3.72	4.22	3.63		
8/13/2020			3.59	3.92	3.4		
8/27/2020			3.81	3.98	3.81		
9/21/2020			3.79	4.11	3.77		
1/26/2021	5.03	4.31					
2/10/2021			3.77	3.8	3.5		
4/7/2021			4.02	4.1	3.73	3.68	3.78
5/13/2021						3.7	3.88
6/21/2021	5.21	4.25					
7/7/2021			3.8	4.19	3.56		
7/8/2021						3.54	3.65
8/31/2021						3.67	
9/1/2021							3.65
9/27/2021						3.62	3.65
10/26/2021						3.54	3.66
11/17/2021						3.66	3.54
1/24/2022	5.19	4.26					
1/31/2022			3.96	4.21	3.84	3.93	3.9
6/20/2022	4.84	4.45					
6/21/2022			4.01	4.28	3.87	3.82	3.89

Prediction Limit

Constituent: Sulfate (mg/L) Analysis Run 2/21/2023 1:52 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-3	CGYP-2	CGYP-4	CGYP-6
10/19/2015	81.5	26.5					
1/26/2016	88.2	25.5					
4/19/2016	86	20.2					
7/18/2016	90.1	16					
10/11/2016	73.7	19.3					
1/23/2017	77.7	8.82					
4/17/2017	71.2	9.71					
7/12/2017		11.1					
7/25/2017	73.3						
9/25/2017	74.5	8.03					
10/9/2017	76.8	8.77					
2/7/2018	69.1	13.5					
6/20/2018	67.9	8.58					
10/1/2018	65.5	11.9					
2/12/2019	69.1	8.96					
5/20/2019	115	10.5					
2/24/2020	79.8	8.36					
5/21/2020			364	978	1000		
6/4/2020			544	911	968		
6/18/2020			540	946.1	932		
6/22/2020	79.9	8.32					
7/1/2020			575	924			
7/2/2020					908		
7/16/2020			338	983	933		
7/30/2020			340	991	868		
8/13/2020			391	999	868		
8/27/2020			448	913	885		
9/21/2020			460	995	976		
1/26/2021	80.7	9.98					
2/10/2021			613	1010	957		
4/7/2021			445	972	987	602	96.3
5/13/2021						598	83.6
6/21/2021	86.6	11.9					
7/7/2021			377	993	937		
7/8/2021						621	84.3
8/31/2021							84.3
9/1/2021						605	
9/27/2021						584	90.9
10/26/2021						611	92.7
11/17/2021						600	67
1/24/2022	82.8	11.7					
1/31/2022			451	998	1020	575	128
6/20/2022	78.3	6.59					
6/21/2022			359	966	881	576	106

Prediction Limit

Constituent: Total Dissolved Solids (mg/L) Analysis Run 2/21/2023 1:52 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
1/26/2015		142.5					
2/16/2015		106.2					
6/16/2015		158					
7/6/2015		151					
10/19/2015	150	206					
1/26/2016	120	165					
4/19/2016	120	130					
7/18/2016	132	124					
10/11/2016	151.7	200					
1/23/2017	148	138					
4/17/2017	62	56					
7/12/2017		108					
7/25/2017	92						
9/25/2017	<40	<40					
10/9/2017	115	80					
2/7/2018	92	112					
6/20/2018	138.8	200					
10/1/2018	107.5	130					
2/12/2019	135	136.2					
5/20/2019	181.2	162.5					
2/24/2020	107.5	120					
5/21/2020			1505	1609	3449		
6/4/2020			1839	1589	3895		
6/18/2020			1964	1624	4502		
6/22/2020	147.5	112.5					
7/1/2020			2650		4120		
7/2/2020				1634			
7/16/2020			1811	1512	3700		
7/30/2020			1541	1515	3138		
8/13/2020			1768	1599	3102		
8/27/2020			1772	1526	3519		
9/21/2020			1945	1515	3288		
1/26/2021	138.8	110					
2/10/2021			2081	1538	4090		
4/7/2021			2301	1536	4958	2178	3952
5/13/2021						2078	2804
6/21/2021	178.8	155					
7/7/2021			1770	1618	3291		
7/8/2021						2168	2851
8/31/2021							2740
9/1/2021						2038	
9/27/2021						1749	2382
10/26/2021						1614	2306
11/17/2021						1676	1899
1/24/2022	130	128.8					
1/31/2022			1912	1582	3410	1864	2379
6/20/2022	143.8	137.5					
6/21/2022			1771	1408	2952	1676	3210

FIGURE I.

Interwell Prediction Limit Summary (October 2022) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:50 PM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bq N	Bq Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	10/26/2022	12.6	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	10/25/2022	1.14	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	10/25/2022	16.6	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	10/25/2022	6.13	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	10/25/2022	5.71	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.24	n/a	10/26/2022	193	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.24	n/a	10/25/2022	214	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.24	n/a	10/25/2022	415	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.24	n/a	10/25/2022	231	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.24	n/a	10/25/2022	370	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	10/26/2022	733	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	10/25/2022	57.3	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	10/25/2022	842	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	10/25/2022	495	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	10/25/2022	896	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	10/26/2022	0.53	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	10/25/2022	0.42	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	10/25/2022	1.06	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	10/25/2022	0.99	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	10/25/2022	0.49	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	10/26/2022	4.01	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	10/25/2022	3.8	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	10/25/2022	3.56	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	10/25/2022	3.69	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	10/25/2022	3.56	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	10/26/2022	458	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	10/25/2022	914	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	10/25/2022	885	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	10/25/2022	652	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	201.6	n/a	10/26/2022	1894	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	201.6	n/a	10/25/2022	1454	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	201.6	n/a	10/25/2022	2835	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	201.6	n/a	10/25/2022	1585	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	201.6	n/a	10/25/2022	2902	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2


Interwell Prediction Limit Summary (October 2022) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:50 PM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bq N	Bq Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	10/26/2022	12.6	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	10/25/2022	1.14	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	10/25/2022	16.6	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	10/25/2022	6.13	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	10/25/2022	5.71	Yes	41	n/a	n/a	26.83	n/a	n/a	0.001091	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.24	n/a	10/26/2022	193	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.24	n/a	10/25/2022	214	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.24	n/a	10/25/2022	415	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.24	n/a	10/25/2022	231	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.24	n/a	10/25/2022	370	Yes	43	21.94	7.437	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	10/26/2022	733	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	10/25/2022	57.3	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	10/25/2022	842	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	10/25/2022	495	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	10/25/2022	896	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	10/26/2022	0.53	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	10/25/2022	0.42	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	10/25/2022	1.06	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	10/25/2022	0.99	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	10/25/2022	0.49	Yes	40	n/a	n/a	52.5	n/a	n/a	0.001129	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	10/26/2022	4.01	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	10/25/2022	3.8	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	10/25/2022	3.56	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	10/25/2022	3.69	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	10/25/2022	3.56	Yes	48	n/a	n/a	0	n/a	n/a	0.001636	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	10/26/2022	458	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	10/25/2022	914	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	10/25/2022	885	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	10/25/2022	652	Yes	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	10/25/2022	89.3	No	44	n/a	n/a	0	n/a	n/a	0.0009736	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	201.6	n/a	10/26/2022	1894	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	201.6	n/a	10/25/2022	1454	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	201.6	n/a	10/25/2022	2835	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	201.6	n/a	10/25/2022	1585	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	201.6	n/a	10/25/2022	2902	Yes	48	127.2	38.98	4.167	None	No	0.001254	Param Inter 1 of 2

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

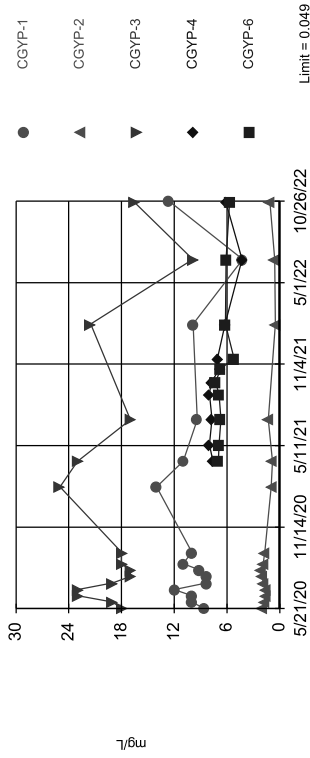


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 41 background values. 26.83% NDs. Annual per-constituent alpha = 0.01301. Individual comparison alpha = 0.001091 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: Boron Analysis Run 2/21/2023 1:46 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

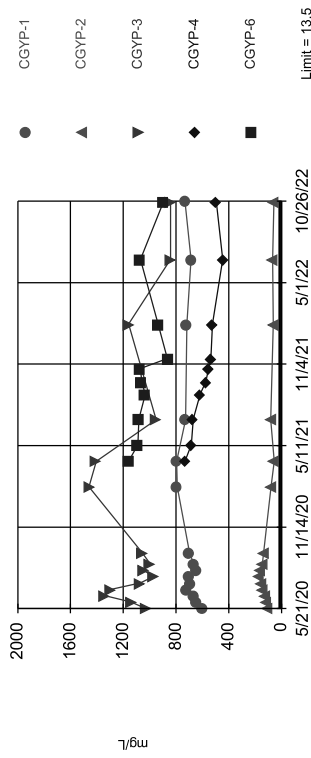


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 44 background values. Annual per-constituent alpha = 0.01162. Individual comparison alpha = 0.0009736 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: Chloride Analysis Run 2/21/2023 1:46 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Parametric

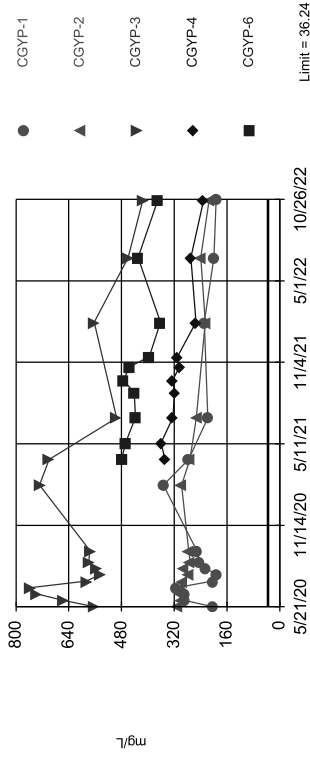


Background Data Summary: Mean=21.94, Std. Dev.=7.437, n=43. Seasonality was not detected with 95% confidence. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9638, critical = 0.923. Kappa = 1.922 (c=7, w=6, 1 of 2; event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.001294. Comparing 5 points to limit. Assumes 1 future value.

Constituent: Calcium Analysis Run 2/21/2023 1:46 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

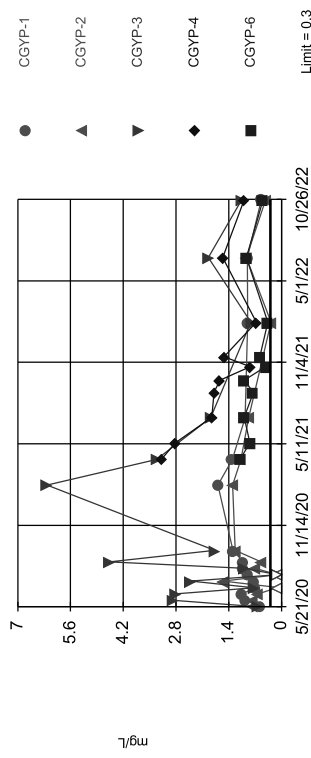


Non-parametric test used in lieu of parametric prediction limit because censored data exceeded 50%. Limit is highest of 40 background values. 52.5% NDs. Annual per-constituent alpha = 0.01347. Individual comparison alpha = 0.001129 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: Fluoride Analysis Run 2/21/2023 1:46 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limits: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

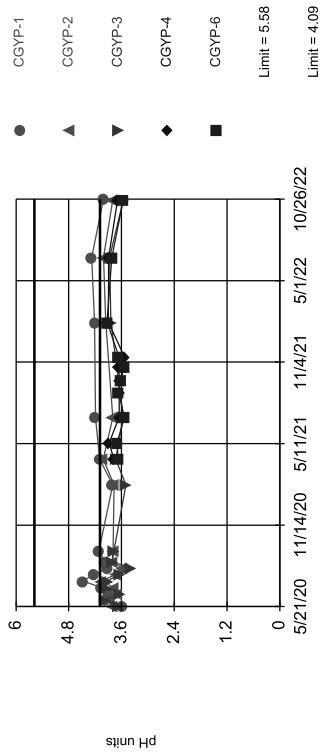


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limits are highest and lowest of 48 background values. Annual per-constituent alpha = 0.01954. Individual comparison alpha = 0.001636 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: pH, Field Analysis Run 2/21/2023 1:46 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Parametric

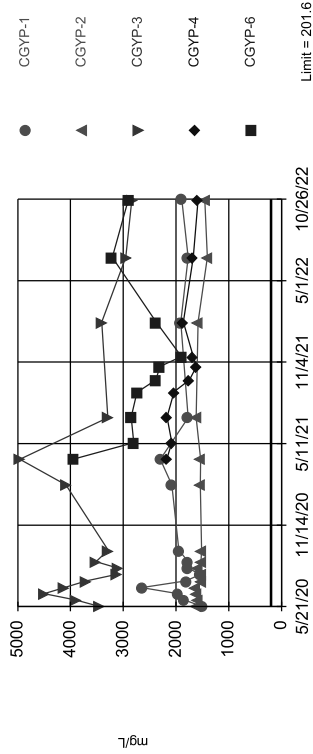


Background Data Summary: Mean=127.2, Std. Dev.=38.98, n=48, 4.167% NDs. Seasonality was not detected with 95% confidence. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9497, critical = 0.929. Kappa = 1.908 (c=7, w=6, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.001254. Comparing 5 points to limit. Assumes 1 future value.

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:46 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4

Prediction Limit
Interwell Non-parametric

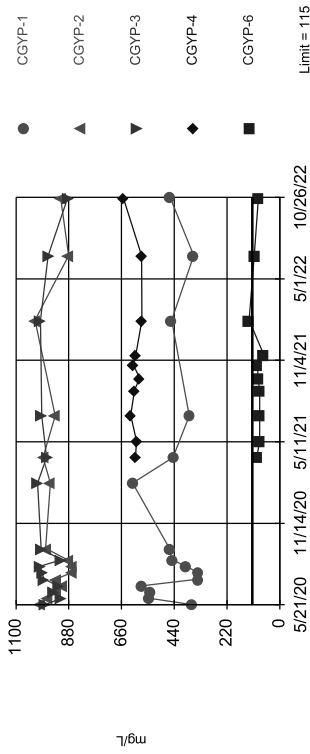

Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 44 background values. Annual per-constituent alpha = 0.01162. Individual comparison alpha = 0.0009736 (1 of 2). Comparing 5 points to limit. Assumes 1 future value. Seasonality was not detected with 95% confidence.

Constituent: Sulfate Analysis Run 2/21/2023 1:46 PM View: PLs Interwell
CGYP Client: Santee Cooper Data: CGYP

Prediction Limit

Constituent: Boron (mg/L) Analysis Run 2/21/2023 1:50 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-3	CGYP-1	CGYP-2	CGYP-4	CGYP-6
10/19/2015	0.032	0.0178					
1/26/2016	0.0218	<0.015					
4/19/2016	0.0183	<0.015					
7/18/2016	0.0217	0.0163					
10/11/2016	0.0302	0.0165					
1/23/2017	0.0249	<0.015					
4/17/2017	0.018	0.019					
7/25/2017	0.022						
9/25/2017	0.024	0.018					
10/9/2017	0.023	0.021					
2/7/2018	0.018	<0.015					
6/20/2018	0.02	0.016					
10/1/2018	0.025	0.015					
2/12/2019	<0.015	<0.015					
2/24/2020	0.017	<0.015					
5/21/2020			18	8.6	2		
6/4/2020			19	10	1.7		
6/18/2020			23	10	1.6		
6/22/2020	0.018	0.049					
7/1/2020			23	12			
7/2/2020					1.6		
7/16/2020			19	8.3	1.9		
7/30/2020			17	8.3	2		
8/13/2020			17	9.1	2.1		
8/27/2020			18	11	1.9		
9/21/2020			18	10	1.7		
1/26/2021	0.018	<0.015					
2/10/2021			25	14	0.96		
4/7/2021			23	11	0.85	7.6	7
5/13/2021						8	6.9
6/21/2021	<0.015	<0.015					
7/7/2021			17	9.4	1.3		
7/8/2021						7.7	6.7
8/31/2021							6.9
9/1/2021						8	
9/27/2021						7.8	7.3
10/26/2021						6.8	6.7
11/17/2021						7.1	5.2
1/24/2022	0.0139	0.011					
1/31/2022			21.5	9.84	0.51	6.21	6.2
6/20/2022	0.015	<0.015					
6/21/2022			9.9	4.2	0.57	4.3	6.1
10/25/2022	0.0203	0.0437	16.6		1.14	6.13	5.71
10/26/2022				12.6			

Prediction Limit

Constituent: Calcium (mg/L) Analysis Run 2/21/2023 1:50 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
10/19/2015	27	26					
1/26/2016	27	27					
4/19/2016	29.4	23.3					
7/18/2016	28.7	18.8					
10/11/2016	22.7	16.4					
1/23/2017	26.2	10.4					
4/17/2017	25.6	12.5					
7/12/2017		18.5					
9/25/2017	21.9	15.4					
10/9/2017	23	17					
2/7/2018	24	14.7					
6/20/2018	24	37					
10/1/2018	22.7	16.6					
2/12/2019	24.4	15.9					
5/20/2019	41.65 (D)	16.1 (D)					
2/24/2020	28.2	11					
5/21/2020			204	311	564		
6/4/2020			290	298	658		
6/18/2020			289	299	737		
6/22/2020	28.4	13.5					
7/1/2020			315		759		
7/2/2020				305			
7/16/2020			204	295	587		
7/30/2020			192	279	545		
8/13/2020			224	293	556		
8/27/2020			242	272	579		
9/21/2020			252	276	576		
1/26/2021	29.2	14.3					
2/10/2021			353	298	729		
4/7/2021			276	273	700	348	480
5/13/2021						360	468
6/21/2021	29.9	17					
7/7/2021			218	253	495		
7/8/2021						324	438
8/31/2021							441
9/1/2021						319	
9/27/2021						325	474
10/26/2021						304	455
11/17/2021						310	396
1/24/2022	27.9	14.4					
1/31/2022			229	226	563	254	362
6/20/2022	29	6.2					
6/21/2022			200	240	460	270	430
10/25/2022	27.5	13.1		214	415	231	370
10/26/2022			193				

Prediction Limit

Constituent: Chloride (mg/L) Analysis Run 2/21/2023 1:50 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-6	CGYP-4
10/19/2015	3.21	12.7					
1/26/2016	2.95	11.3					
4/19/2016	2.33	12.1					
7/18/2016	2.95	13.2					
10/11/2016	3	12.8					
1/23/2017	2.45	13.5					
4/17/2017	2.96	12.7					
7/12/2017		12.1					
7/25/2017	2.61						
9/25/2017	2.51	13.3					
10/9/2017	2.73	12.6					
2/7/2018	2.88	12.4					
6/20/2018	3	13.4					
10/1/2018	2.71	12.9					
2/12/2019	2.68	12.1					
5/20/2019	2.9	12.7					
2/24/2020	3.25	12.7					
5/21/2020			600	103	1030		
6/4/2020			644	117	1140		
6/18/2020			666	127	1340		
6/22/2020	3.44	12.67					
7/1/2020			717		1300		
7/2/2020				145			
7/16/2020			694	153	1070		
7/30/2020			703	176	971		
8/13/2020			647	163	1050		
8/27/2020			666	146	998		
9/21/2020			699	136	1060		
1/26/2021	3.22	11.8					
2/10/2021			791	79.5	1460		
4/7/2021			795	55.87	1405	1160	733
5/13/2021						1090	683
6/21/2021	3.05	12					
7/7/2021			728	83.1	950		
7/8/2021						1082	670
8/31/2021						1033	
9/1/2021							617
9/27/2021						1061	574
10/26/2021						1070	553
11/17/2021						865	537
1/24/2022	3.21	12.1					
1/31/2022			717	63	1160	937	523
6/20/2022	3.79	13.4					
6/21/2022			686	66.4	841	1070	445
10/25/2022	3.78	12.7		57.3	842	896	495
10/26/2022			733				

Prediction Limit

Constituent: Fluoride (mg/L) Analysis Run 2/21/2023 1:50 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-2	CGYP-1	CGYP-3	CGYP-6	CGYP-4
10/19/2015	0.25	<0.1					
1/26/2016	0.3	<0.1					
4/19/2016	0.29	<0.1					
7/18/2016	0.27	<0.1					
10/11/2016	0.28	<0.1					
1/23/2017	0.25	<0.1					
4/17/2017	0.22	<0.1					
9/25/2017	0.23	<0.1					
10/9/2017	0.22	<0.1					
2/7/2018	0.19	<0.1					
6/20/2018	0.2	<0.1					
10/1/2018	0.19	<0.1					
2/12/2019	0.18	<0.1					
2/24/2020	0.19	<0.1					
5/21/2020			0.75	0.58	0.65		
6/4/2020			0.75	0.96	2.89		
6/18/2020			0.62	1.05	2.82		
6/22/2020	0.2	<0.1					
7/1/2020				0.69	0.73		
7/2/2020			<0.1				
7/16/2020			1.55	0.72	2.41		
7/30/2020			<0.1	0.91	<0.1		
8/13/2020			0.71	1.04	1		
8/27/2020			0.54	1.02	4.57		
9/21/2020			1.23	1.29	1.77		
1/26/2021	0.15	<0.1					
2/10/2021			1.3	1.69	6.22		
4/7/2021			1.08	1.31	3.32	1.1	3.19
5/13/2021						0.84	2.82
6/21/2021	0.19	<0.1					
7/7/2021			0.87	0.97	1.88		
7/8/2021						0.99	1.85
8/31/2021						0.75	
9/1/2021							1.79
9/27/2021						0.98	1.63
10/26/2021						0.42	0.83
11/17/2021						0.58	1.53
1/24/2022	0.22	<0.1					
1/31/2022			0.28	0.9	0.81	0.36	0.67
6/20/2022	0.18	<0.1					
6/21/2022			0.93	0.91	1.94	0.93	1.56
10/25/2022	<0.1	<0.1	0.42		1.06	0.49	0.99
10/26/2022				0.53			

Prediction Limit

Constituent: pH, Field (pH units) Analysis Run 2/21/2023 1:50 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-1	CGYP-3	CGYP-4	CGYP-6
1/26/2015	4.53						
2/16/2015	4.68						
6/16/2015	4.74						
7/6/2015	5.25						
10/19/2015	5.47	4.45					
1/26/2016	5.2	4.12					
4/19/2016	5.32	4.33					
7/18/2016	5.2	4.38					
10/11/2016	5.01	4.14					
1/23/2017	5.01	4.32					
4/17/2017	5.19	4.26					
7/12/2017	5.11						
7/25/2017		4.21					
9/25/2017	5.27	4.32					
10/9/2017	5.21	4.25					
2/7/2018	5.29	4.42					
6/20/2018	5.58	4.32					
10/1/2018	5.08	4.09					
2/12/2019	5.47	4.5					
5/20/2019	5.26	4.5					
2/24/2020	4.92	4.09					
5/21/2020			3.82	3.58	3.66		
6/4/2020			3.86	3.98	3.99		
6/18/2020			3.69	3.89	3.63		
6/22/2020	5.12	4.48					
7/1/2020				4.06	3.96		
7/2/2020			3.79				
7/16/2020			4.06	4.48	3.93		
7/30/2020			3.72	4.22	3.63		
8/13/2020			3.59	3.92	3.4		
8/27/2020			3.81	3.98	3.81		
9/21/2020			3.79	4.11	3.77		
1/26/2021	5.03	4.31					
2/10/2021			3.77	3.8	3.5		
4/7/2021			4.02	4.1	3.73	3.78	3.68
5/13/2021						3.88	3.7
6/21/2021	5.21	4.25					
7/7/2021			3.8	4.19	3.56		
7/8/2021						3.65	3.54
8/31/2021							3.67
9/1/2021						3.65	
9/27/2021						3.65	3.62
10/26/2021						3.66	3.54
11/17/2021						3.54	3.66
1/24/2022	5.19	4.26					
1/31/2022			3.96	4.21	3.84	3.9	3.93
6/20/2022	4.84	4.45					
6/21/2022			4.01	4.28	3.87	3.89	3.82
10/25/2022	5.01	4.31	3.8		3.56	3.69	3.56
10/26/2022				4.01			

Prediction Limit

Constituent: Sulfate (mg/L) Analysis Run 2/21/2023 1:50 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-6	CGYP-4
10/19/2015	81.5	26.5					
1/26/2016	88.2	25.5					
4/19/2016	86	20.2					
7/18/2016	90.1	16					
10/11/2016	73.7	19.3					
1/23/2017	77.7	8.82					
4/17/2017	71.2	9.71					
7/12/2017		11.1					
7/25/2017	73.3						
9/25/2017	74.5	8.03					
10/9/2017	76.8	8.77					
2/7/2018	69.1	13.5					
6/20/2018	67.9	8.58					
10/1/2018	65.5	11.9					
2/12/2019	69.1	8.96					
5/20/2019	115	10.5					
2/24/2020	79.8	8.36					
5/21/2020			364	1000	978		
6/4/2020			544	968	911		
6/18/2020			540	932	946.1		
6/22/2020	79.9	8.32					
7/1/2020			575		924		
7/2/2020				908			
7/16/2020			338	933	983		
7/30/2020			340	868	991		
8/13/2020			391	868	999		
8/27/2020			448	885	913		
9/21/2020			460	976	995		
1/26/2021	80.7	9.98					
2/10/2021			613	957	1010		
4/7/2021			445	987	972	96.3	602
5/13/2021						83.6	598
6/21/2021	86.6	11.9					
7/7/2021			377	937	993		
7/8/2021						84.3	621
8/31/2021						84.3	
9/1/2021							605
9/27/2021						90.9	584
10/26/2021						92.7	611
11/17/2021						67	600
1/24/2022	82.8	11.7					
1/31/2022			451	1020	998	128	575
6/20/2022	78.3	6.59					
6/21/2022			359	881	966	106	576
10/25/2022	80.4	7.99		914	885	89.3	652
10/26/2022			458				

Prediction Limit

Constituent: Total Dissolved Solids (mg/L) Analysis Run 2/21/2023 1:50 PM View: PLs Interwell

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
1/26/2015		142.5					
2/16/2015		106.2					
6/16/2015		158					
7/6/2015		151					
10/19/2015	150	206					
1/26/2016	120	165					
4/19/2016	120	130					
7/18/2016	132	124					
10/11/2016	151.7	200					
1/23/2017	148	138					
4/17/2017	62	56					
7/12/2017		108					
7/25/2017	92						
9/25/2017	<40	<40					
10/9/2017	115	80					
2/7/2018	92	112					
6/20/2018	138.8	200					
10/1/2018	107.5	130					
2/12/2019	135	136.2					
5/20/2019	181.2	162.5					
2/24/2020	107.5	120					
5/21/2020			1505	1609	3449		
6/4/2020			1839	1589	3895		
6/18/2020			1964	1624	4502		
6/22/2020	147.5	112.5					
7/1/2020			2650		4120		
7/2/2020				1634			
7/16/2020			1811	1512	3700		
7/30/2020			1541	1515	3138		
8/13/2020			1768	1599	3102		
8/27/2020			1772	1526	3519		
9/21/2020			1945	1515	3288		
1/26/2021	138.8	110					
2/10/2021			2081	1538	4090		
4/7/2021			2301	1536	4958	2178	3952
5/13/2021						2078	2804
6/21/2021	178.8	155					
7/7/2021			1770	1618	3291		
7/8/2021						2168	2851
8/31/2021							2740
9/1/2021						2038	
9/27/2021						1749	2382
10/26/2021						1614	2306
11/17/2021						1676	1899
1/24/2022	130	128.8					
1/31/2022			1912	1582	3410	1864	2379
6/20/2022	143.8	137.5					
6/21/2022			1771	1408	2952	1676	3210
10/25/2022	110	96.25		1454	2835	1585	2902
10/26/2022			1894				

FIGURE J.

Trend Test Summary (Prediction Limit Exceedances) - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:55 PM


<u>Constituent</u>	<u>Well</u>	<u>Slope</u>	<u>Calc.</u>	<u>Critical</u>	<u>Sig.</u>	<u>N</u>	<u>%NDs</u>	<u>Normality</u>	<u>Xform</u>	<u>Alpha</u>	<u>Method</u>
Calcium (mg/L)	PM-1 (bg)	-1.217	-98	-92	Yes	22	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-38.05	-80	-53	Yes	15	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-76.66	-35	-30	Yes	10	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1229	96	92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-236	-43	-30	Yes	10	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02097	-132	-81	Yes	20	5	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-4	-1.419	-33	-30	Yes	10	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.329	-110	-92	Yes	22	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-416.4	-32	-30	Yes	10	0	n/a	n/a	0.01	NP

Trend Test Summary (Prediction Limit Exceedances) - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 2/21/2023, 1:55 PM


Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CBW-1 (bg)	-0.001121	-87	-87	No	21	9.524	n/a	n/a	0.01	NP
Boron (mg/L)	PM-1 (bg)	0	-21	-81	No	20	45	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-1	0.7087	12	53	No	15	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-2	-0.6201	-51	-53	No	15	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-3	-0.9248	-25	-53	No	15	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-4	-1.747	-28	-30	No	10	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-6	-0.9202	-27	-30	No	10	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CBW-1 (bg)	0.3443	41	87	No	21	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-1.217	-98	-92	Yes	22	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-1	-16.64	-20	-53	No	15	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-38.05	-80	-53	Yes	15	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-3	-65.51	-43	-53	No	15	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-76.66	-35	-30	Yes	10	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-6	-70.94	-27	-30	No	10	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1229	96	92	Yes	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	PM-1 (bg)	0	-16	-92	No	22	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-1	37.17	51	53	No	15	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-2	-37.6	-39	-53	No	15	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-3	-94.55	-25	-53	No	15	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-236	-43	-30	Yes	10	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-6	-153.2	-26	-30	No	10	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02097	-132	-81	Yes	20	5	n/a	n/a	0.01	NP
Fluoride (mg/L)	PM-1 (bg)	0	0	81	No	20	100	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-1	0.09837	10	53	No	15	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-2	0	1	53	No	15	13.33	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-3	0.09419	7	53	No	15	6.667	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-4	-1.419	-33	-30	Yes	10	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-6	-0.3934	-23	-30	No	10	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CBW-1 (bg)	0	8	92	No	22	0	n/a	n/a	0.01	NP
pH, Field (pH units)	PM-1 (bg)	0.00185	8	118	No	26	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-2	0.04674	15	53	No	15	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-3	-0.07374	-19	-53	No	15	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-4	0.009035	4	30	No	10	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-6	0	0	30	No	10	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CBW-1 (bg)	0	0	92	No	22	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.329	-110	-92	Yes	22	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-1	-0.9542	-1	-53	No	15	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-2	-2.202	-2	-53	No	15	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-3	10.25	15	53	No	15	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-4	-19.88	-5	-30	No	10	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CBW-1 (bg)	1.733	19	92	No	22	4.545	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	PM-1 (bg)	-3.385	-51	-118	No	26	3.846	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-1	43.97	11	53	No	15	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-2	-53.84	-32	-53	No	15	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-3	-338.9	-35	-53	No	15	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-416.4	-32	-30	Yes	10	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-6	-750.3	-11	-30	No	10	0	n/a	n/a	0.01	NP

Sen's Slope Estimator

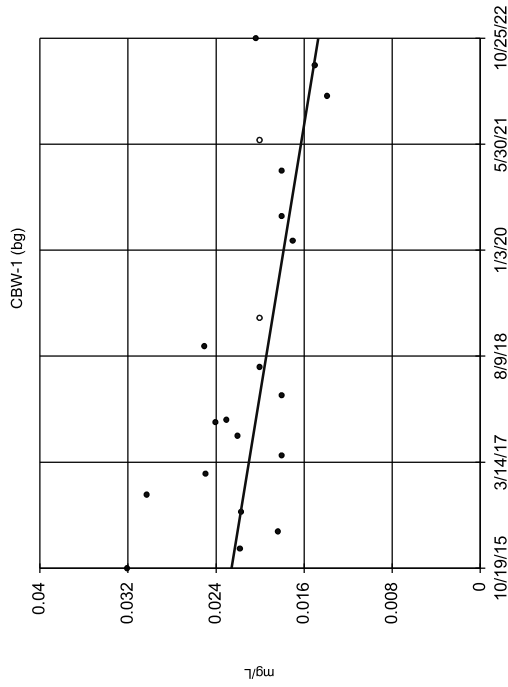


Constituent: Boron Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

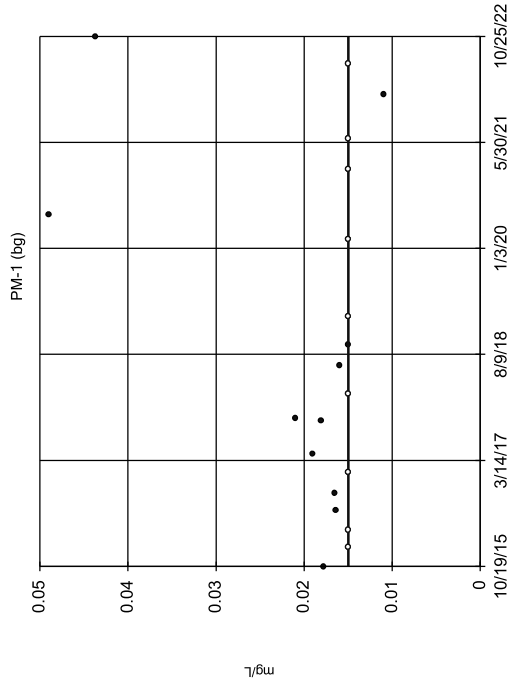


Constituent: Boron Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

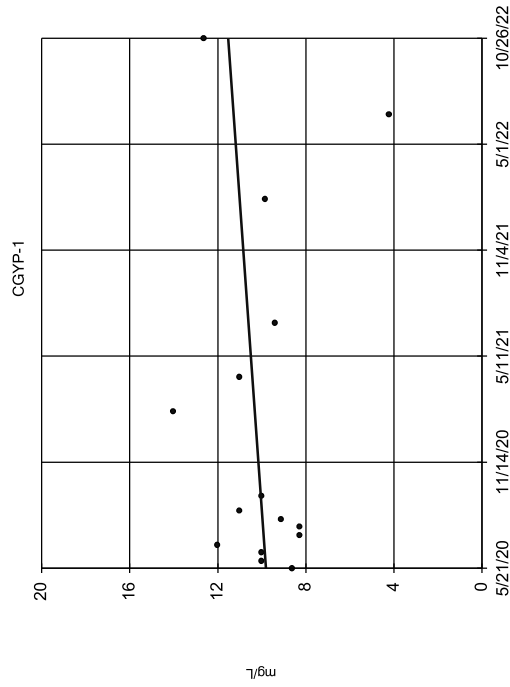


Constituent: Boron Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

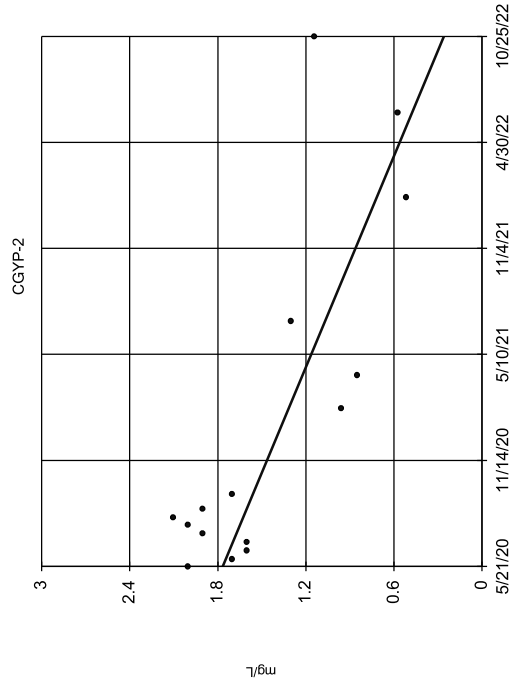


Constituent: Boron Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

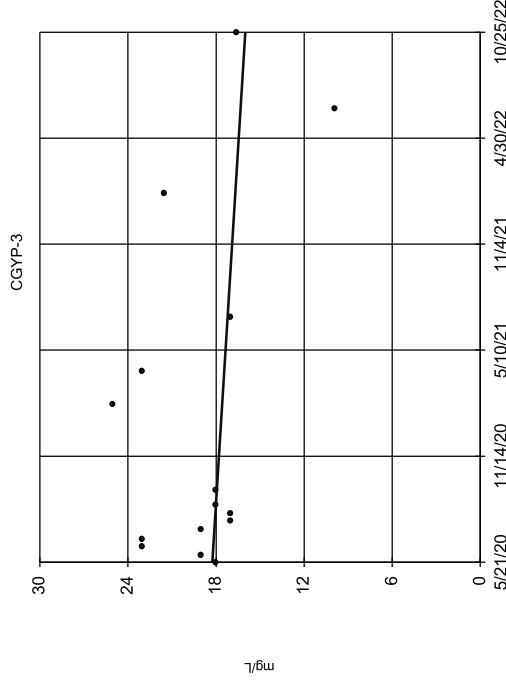


Constituent: Boron Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

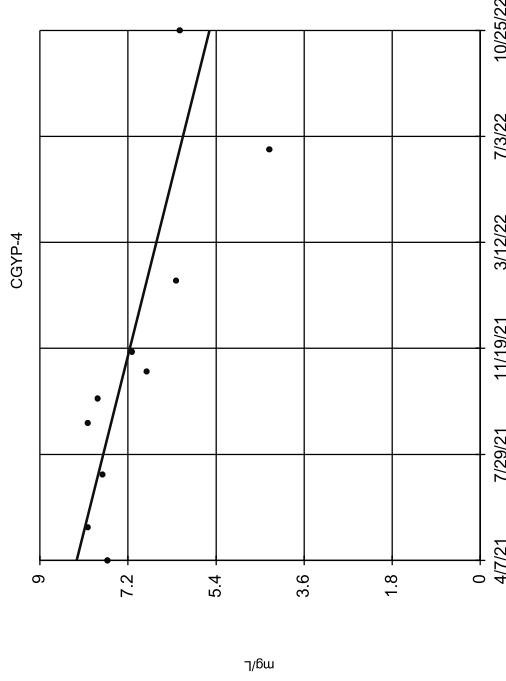


Constituent: Boron Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

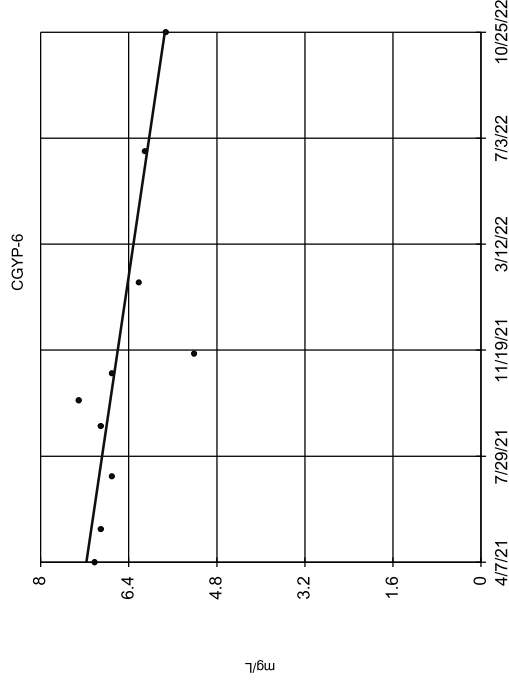


Constituent: Boron Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

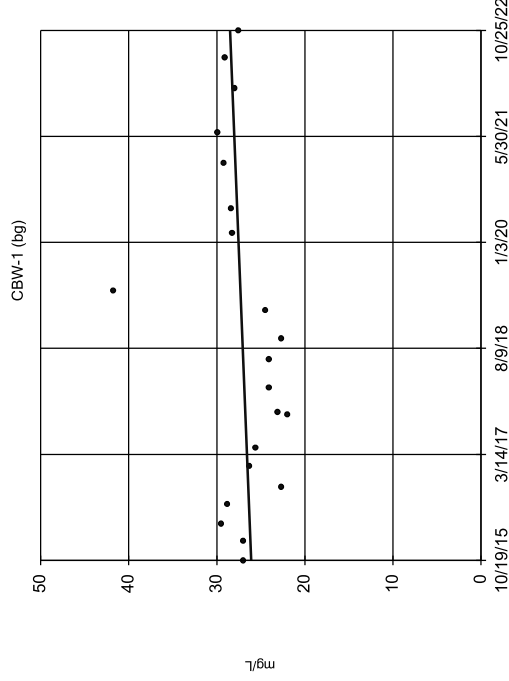


Constituent: Calcium Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

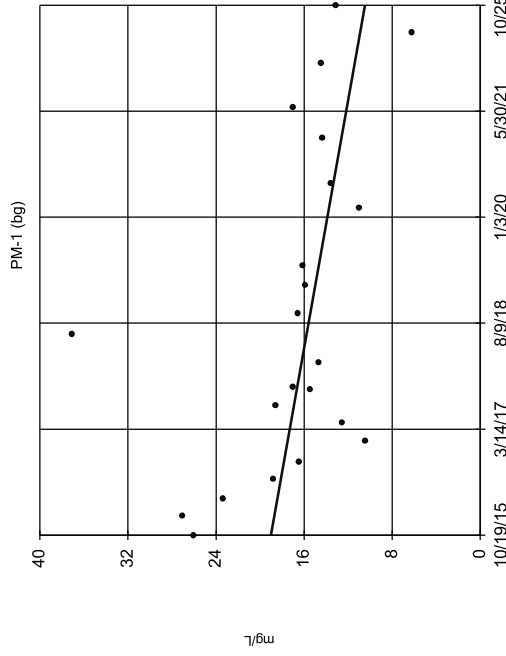


Constituent: Calcium Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

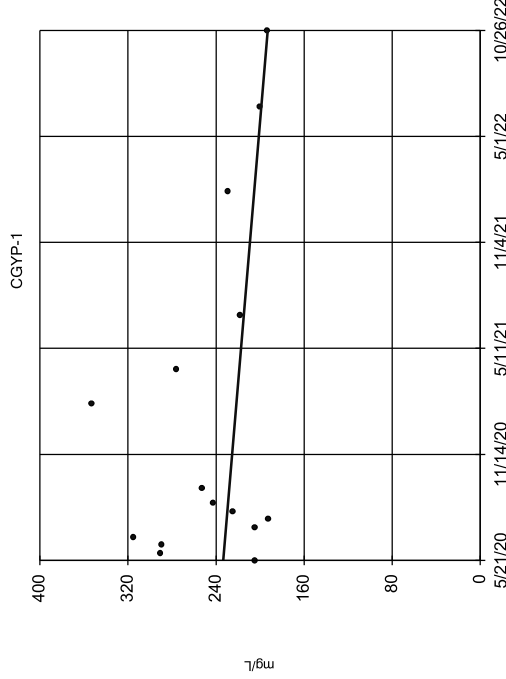


Constituent: Calcium Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

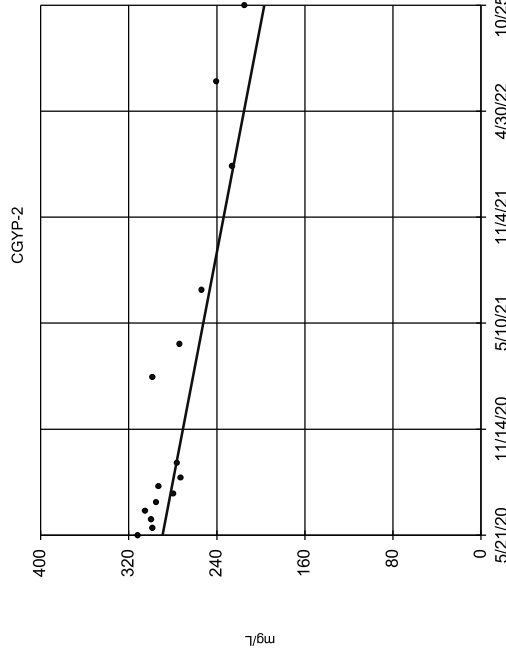


Constituent: Calcium Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

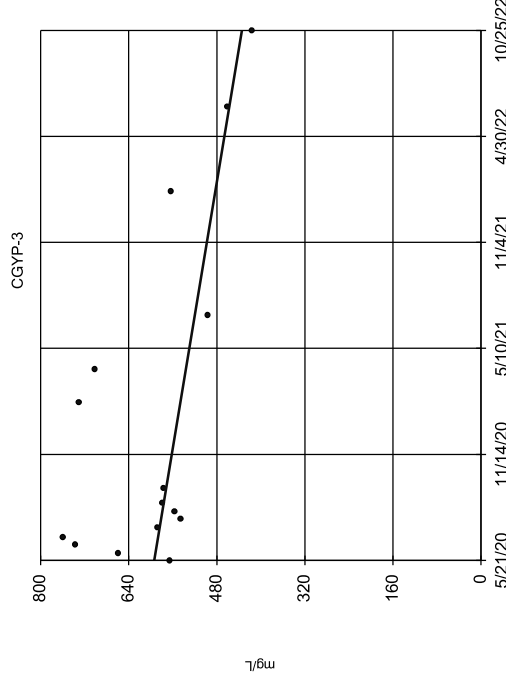

Constituent: Calcium Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

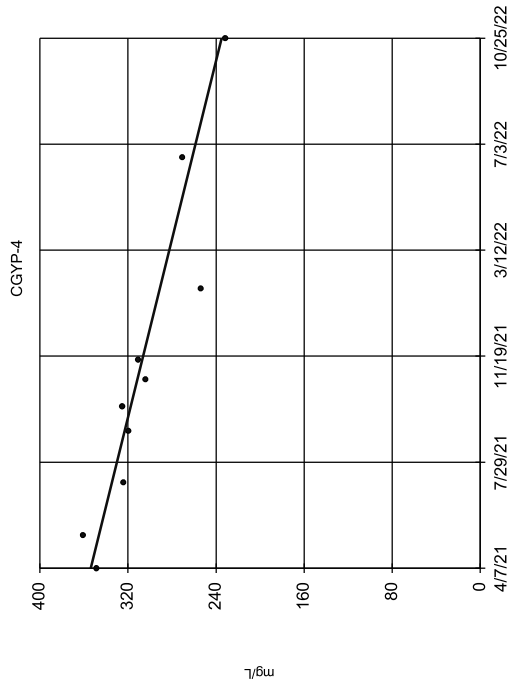

n = 10
 Slope = -76.66
 units per year.
 Mann-Kendall
 statistic = -35
 critical = -30
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

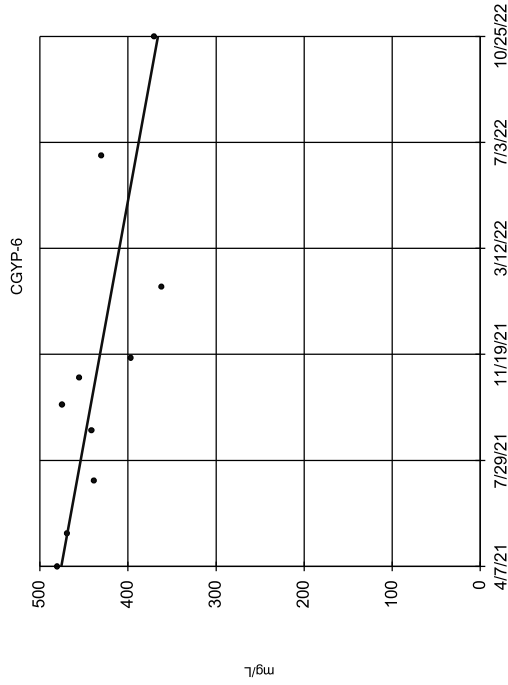

n = 10
 Slope = 70.94
 units per year.
 Mann-Kendall
 statistic = -27
 critical = -30
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

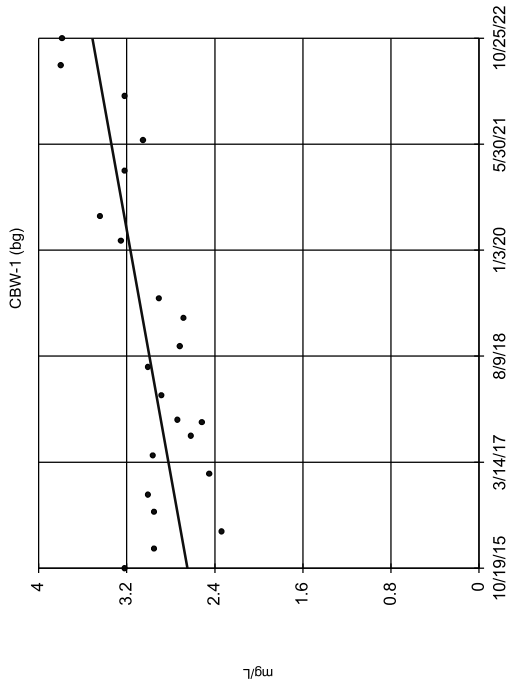

n = 22
 Slope = 0.1229
 units per year.
 Mann-Kendall
 statistic = 95
 critical = 92
 Increasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Chloride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

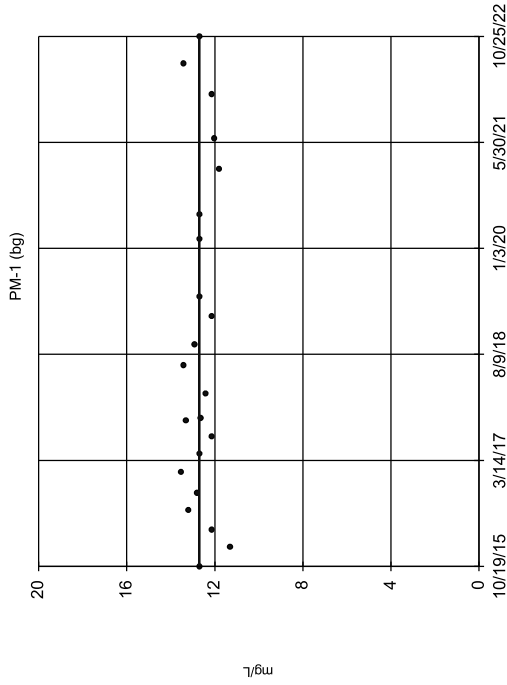

n = 22
 Slope = 0
 units per year.
 Mann-Kendall
 statistic = -16
 critical = -92
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).


Constituent: Chloride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

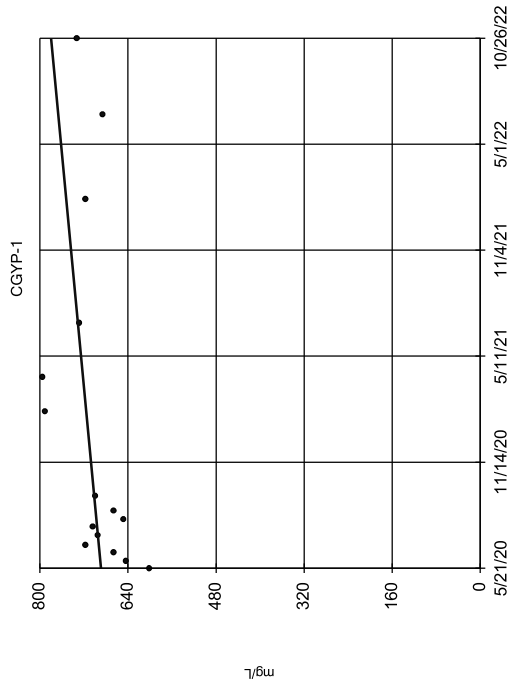


Constituent: Chloride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

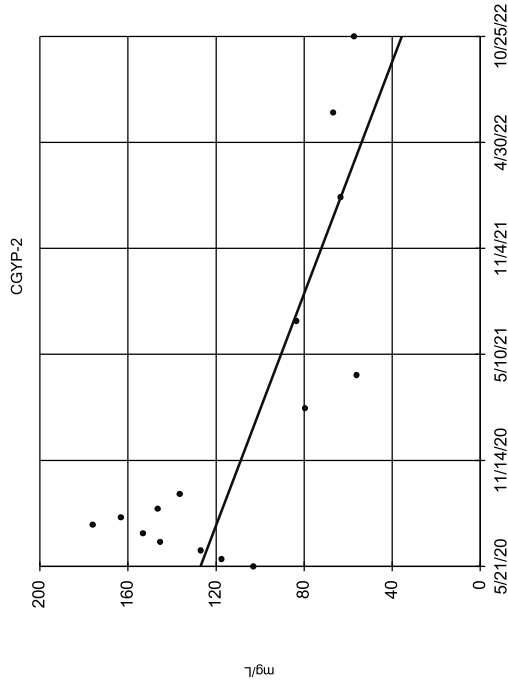


Constituent: Chloride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

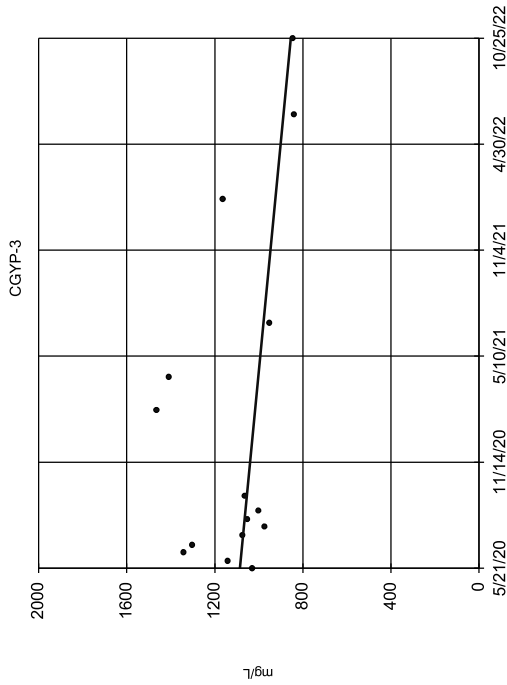

Constituent: Chloride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

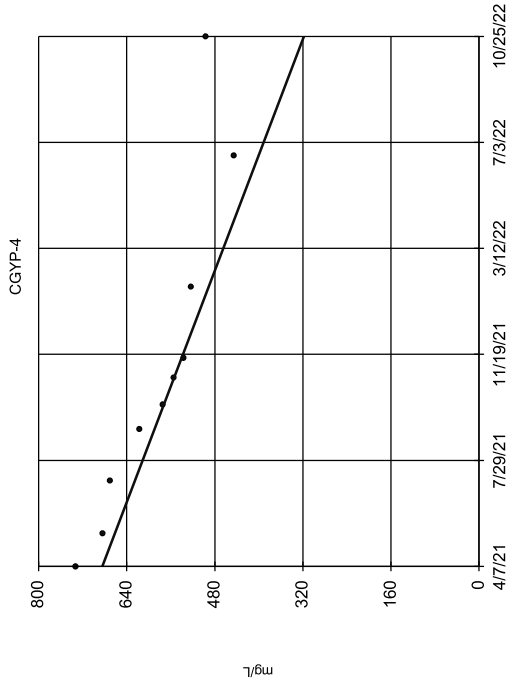

Constituent: Chloride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-6

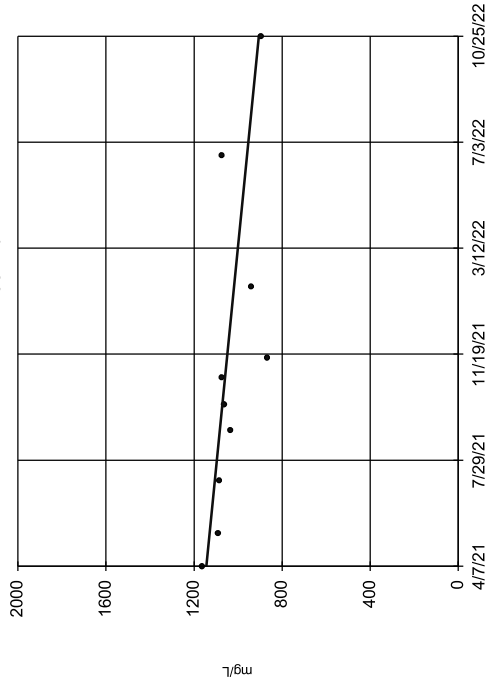

Constituent: Chloride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CBW-1 (bg)

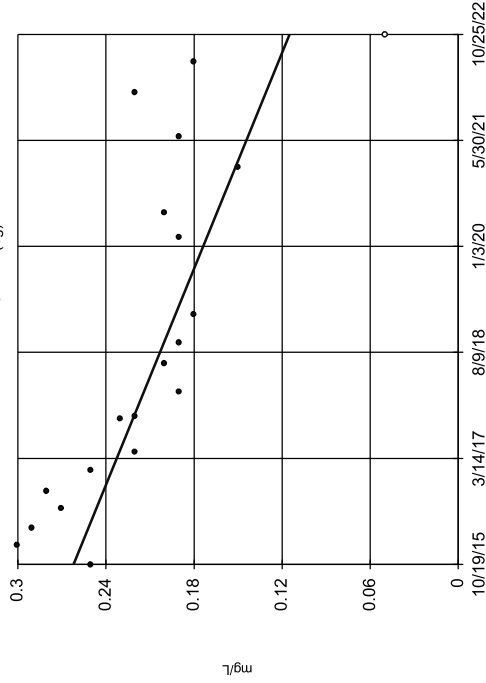

Constituent: Fluoride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


PM-1 (bg)

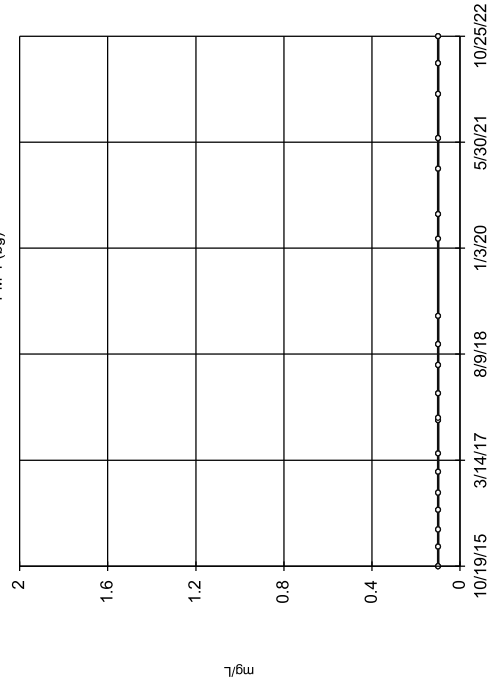

Constituent: Fluoride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-1

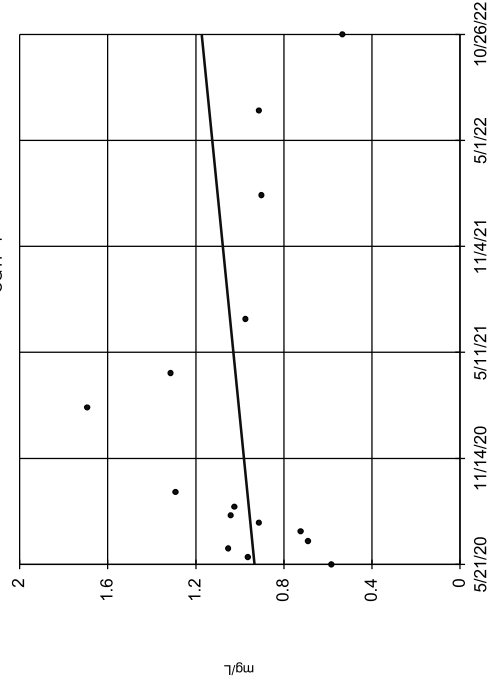


Constituent: Fluoride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

CGYP-2

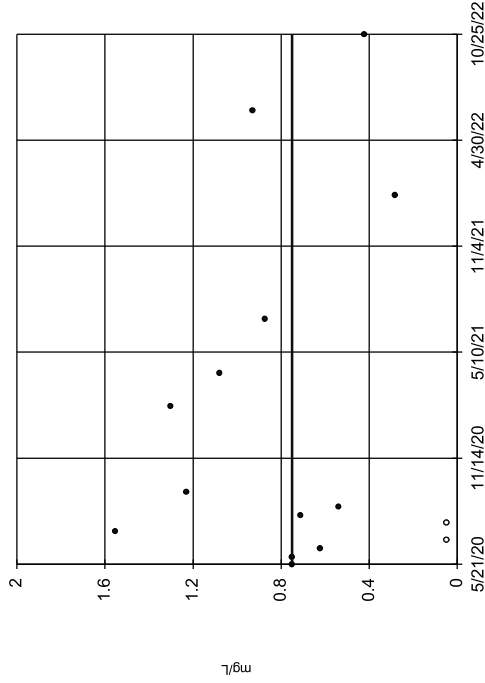


n = 15
Slope = 0
units per year.
Mann-Kendall
statistic = 1
critical = 53
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Fluoride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

CGYP-3

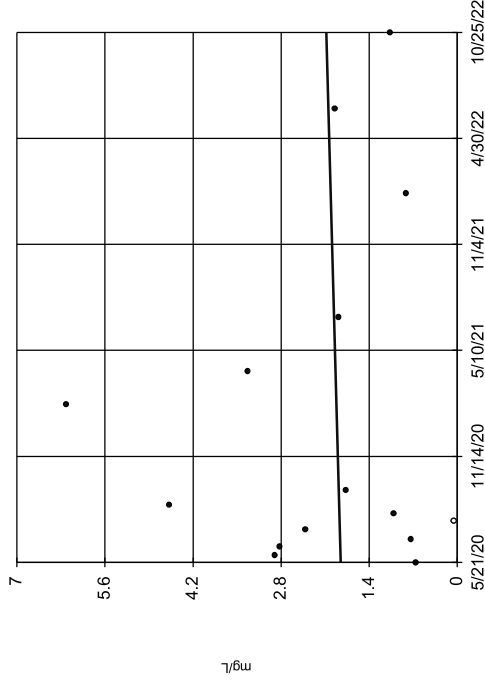


n = 15
Slope = 0.09419
units per year.
Mann-Kendall
statistic = 7
critical = 53
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Fluoride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Sen's Slope Estimator

CGYP-4

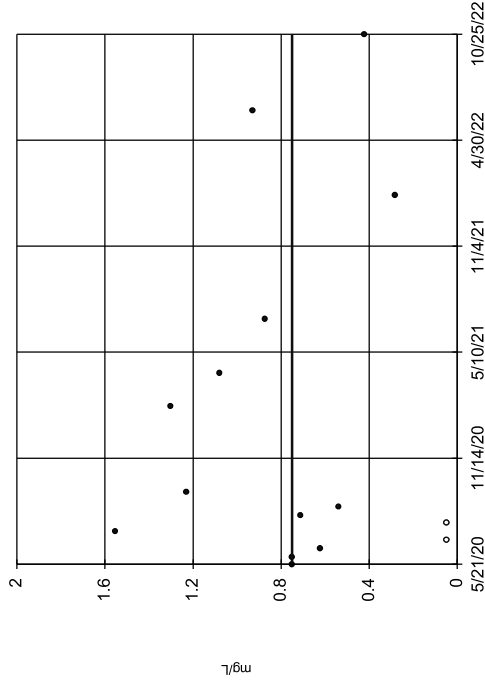


n = 10
Slope = -1.419
units per year.
Mann-Kendall
statistic = -33
critical = -30
Decreasing trend
significant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Fluoride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG

Sen's Slope Estimator


CGYP-6

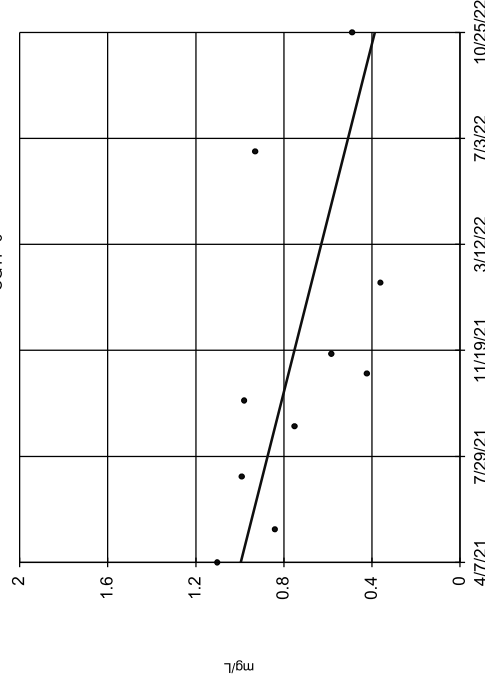

n = 10
Slope = -0.3934
units per year.
Mann-Kendall
statistic = -23
critical = -30
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).


Constituent: Fluoride Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

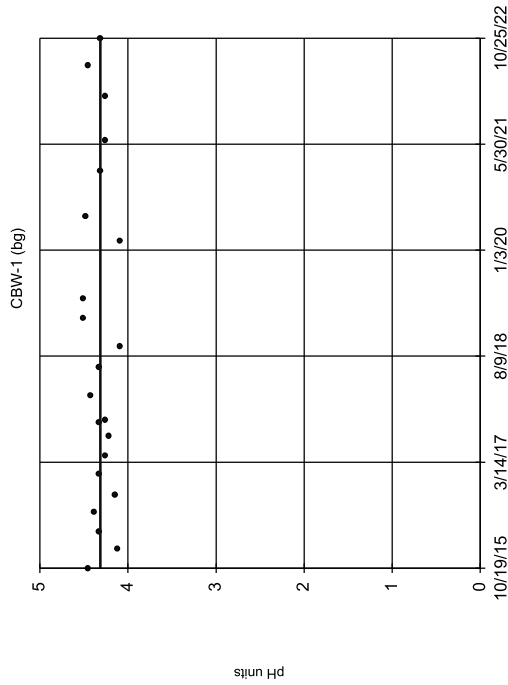


Constituent: pH, Field Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

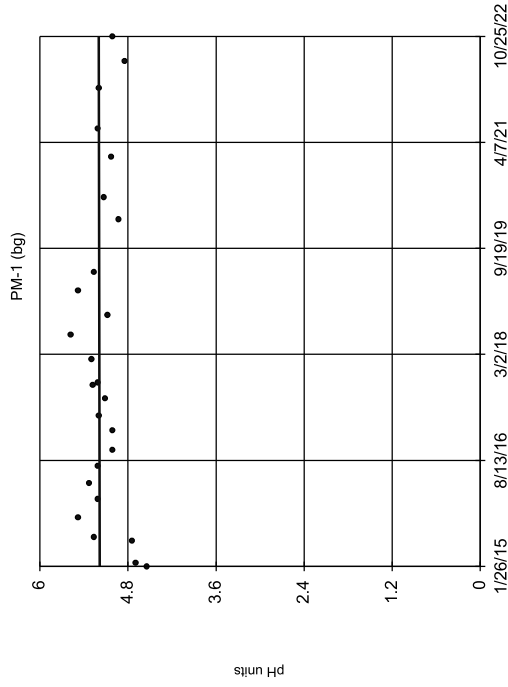


Constituent: pH, Field Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

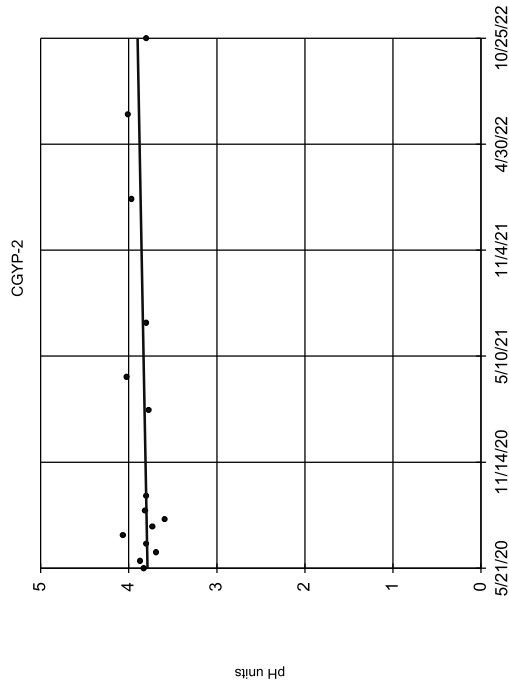


Constituent: pH, Field Analysis Run 2/21/2023 1:53 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

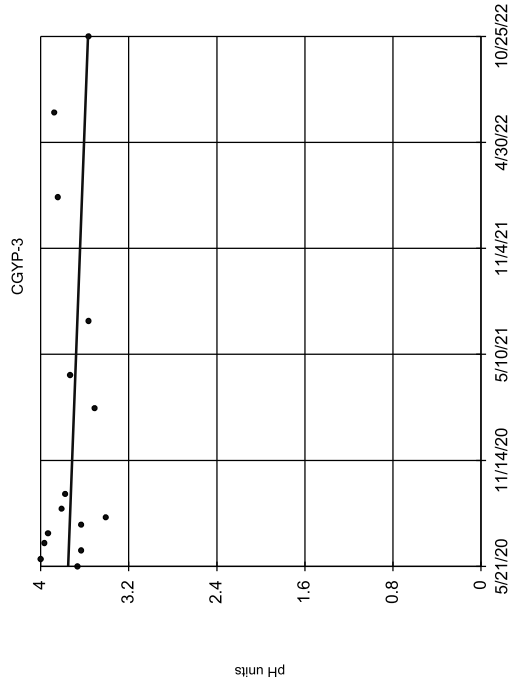

Constituent: pH, Field Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

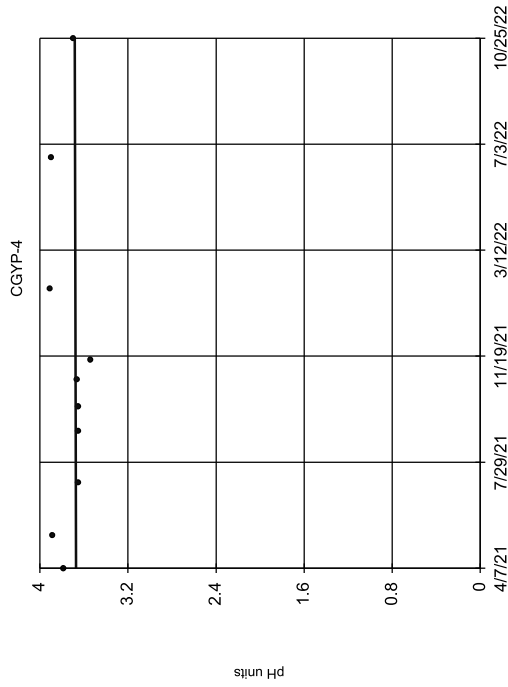

n = 10
 Slope = 0.009035
 units per year.
 Mann-Kendall
 statistic = 4
 critical = 30
 Trend not sig-
 nificant at 99%
 confidence level
 ($\alpha = 0.005$ per
 tail).

Constituent: pH, Field Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

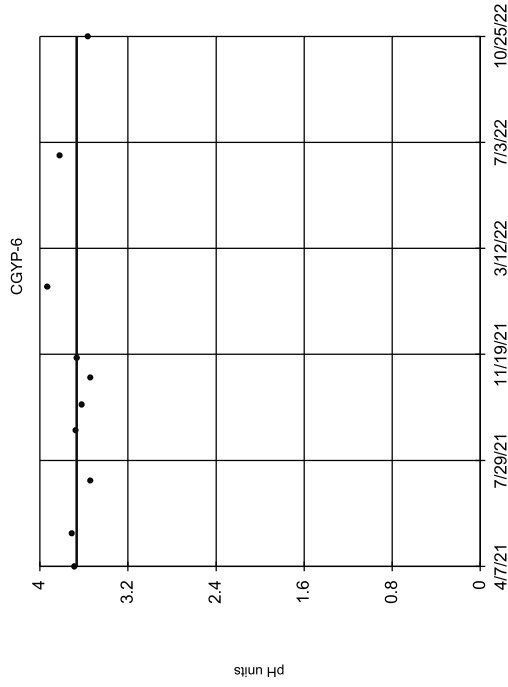

n = 10
 Slope = 0
 units per year.
 Mann-Kendall
 statistic = 0
 critical = 30
 Trend not sig-
 nificant at 99%
 confidence level
 ($\alpha = 0.005$ per
 tail).

Constituent: pH, Field Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

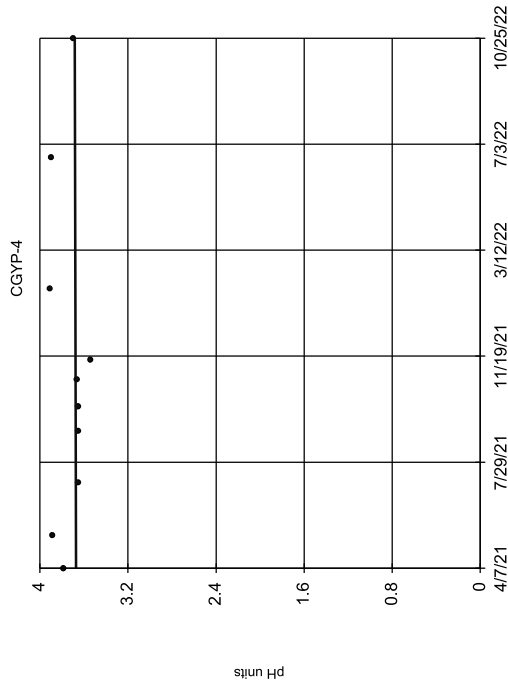

n = 10
 Slope = 0.009035
 units per year.
 Mann-Kendall
 statistic = 4
 critical = 30
 Trend not sig-
 nificant at 99%
 confidence level
 ($\alpha = 0.005$ per
 tail).

Constituent: pH, Field Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

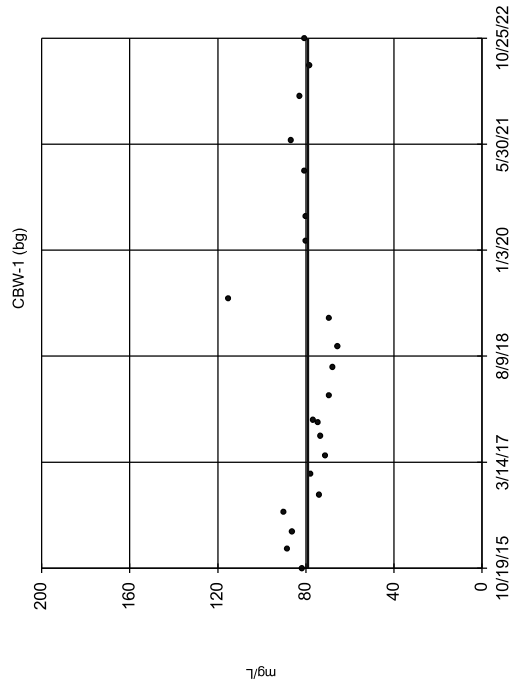

n = 22
 Slope = 0
 units per year.
 Mann-Kendall
 statistic = 0
 critical = 92
 Trend not sig-
 nificant at 99%
 confidence level
 ($\alpha = 0.005$ per
 tail).

Constituent: Sulfate Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

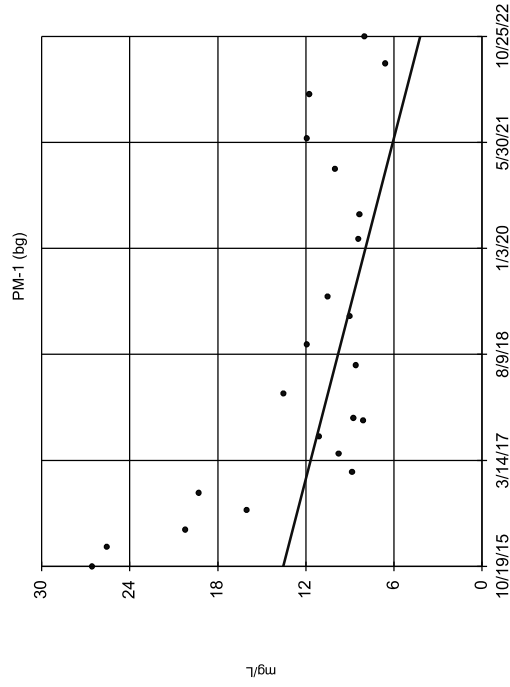


n = 22
 Slope = -1.329
 units per year.
 Mann-Kendall
 statistic = -110
 critical = -92
 Decreasing trend
 significant at 99%
 confidence level
 ($\alpha = 0.005$ per
 tail).

Constituent: Sulfate Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-1

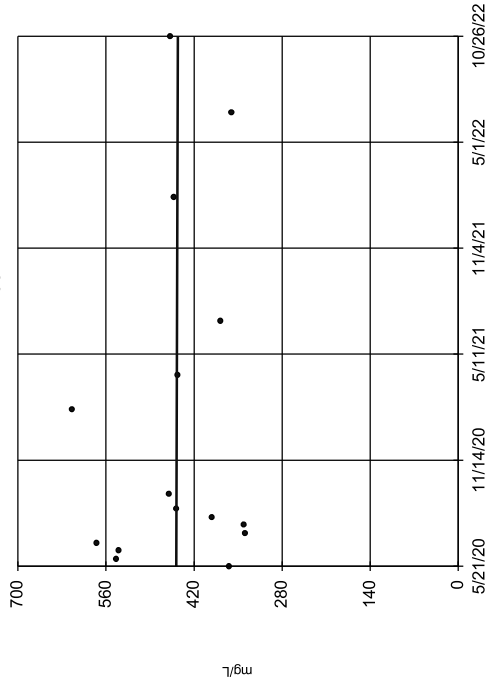

Constituent: Sulfate Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-2

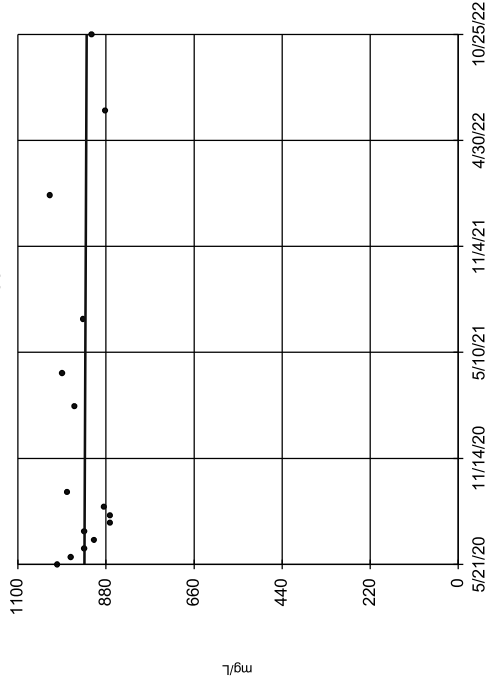

Constituent: Sulfate Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-3

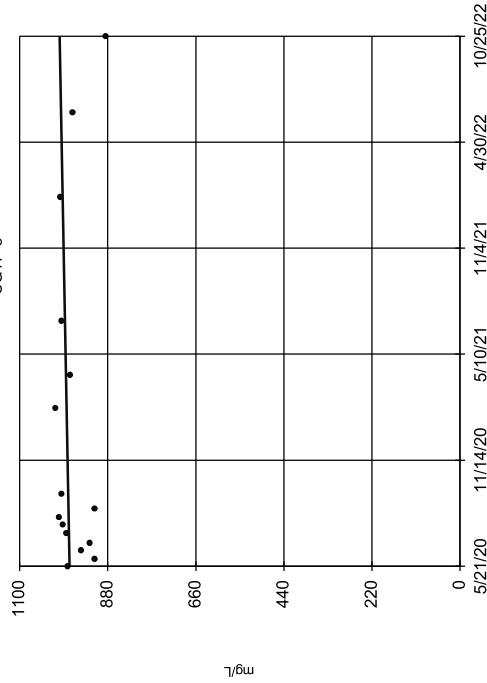

Constituent: Sulfate Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-4

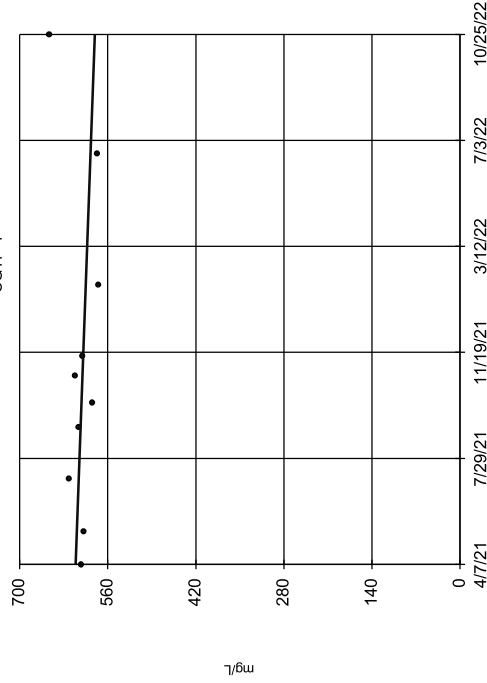

Constituent: Sulfate Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

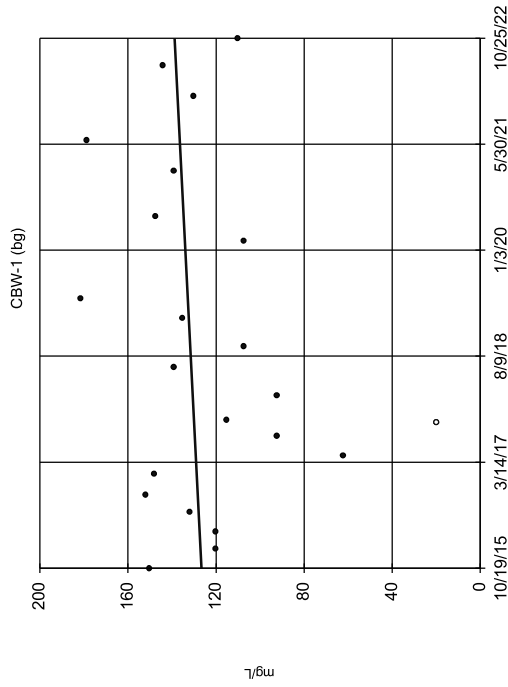

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG


Sen's Slope Estimator

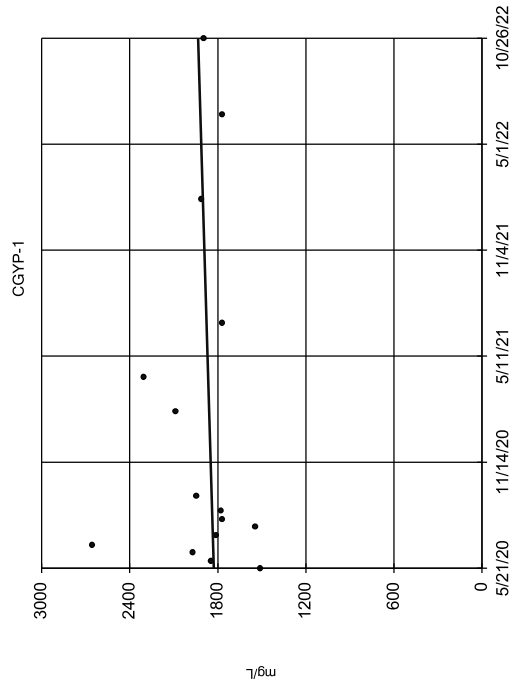

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.36b Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Sen's Slope Estimator

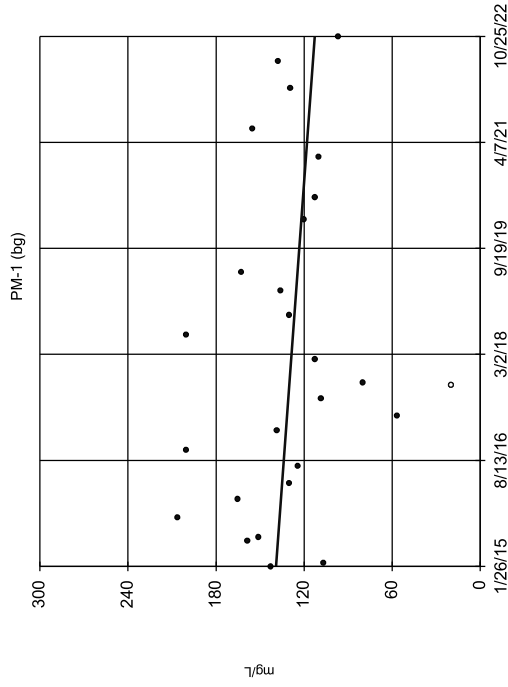

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP


Santitas™ v.9.6.36b Groundwater Stats Consulting, UG

Sen's Slope Estimator

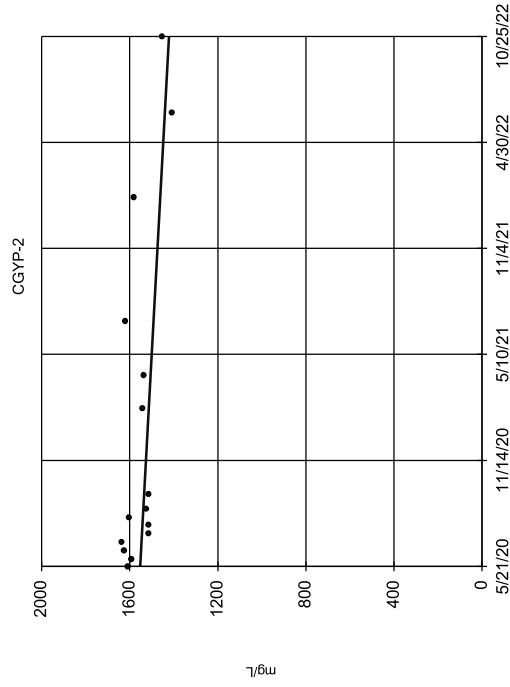

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

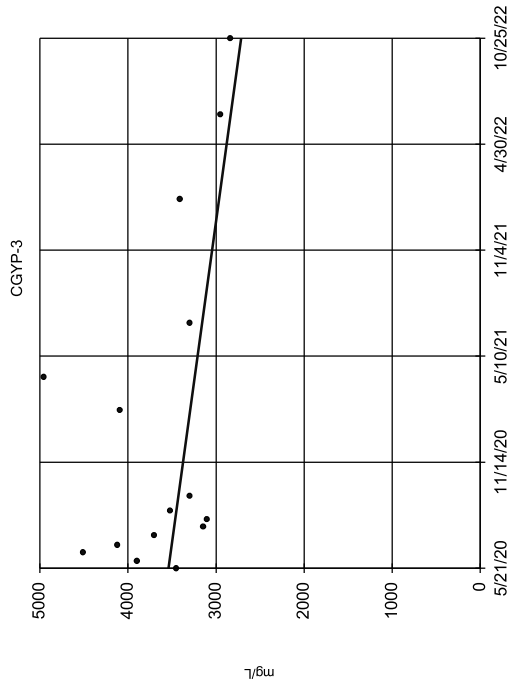

n = 15
 Slope = -338.9
 units per year.
 Mann-Kendall
 statistic = -53
 critical = -53
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

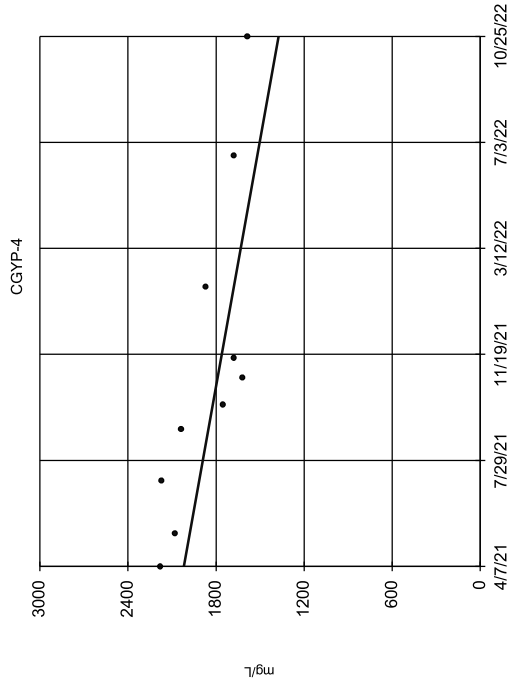

n = 10
 Slope = 416.4
 units per year.
 Mann-Kendall
 statistic = -32
 critical = -30
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

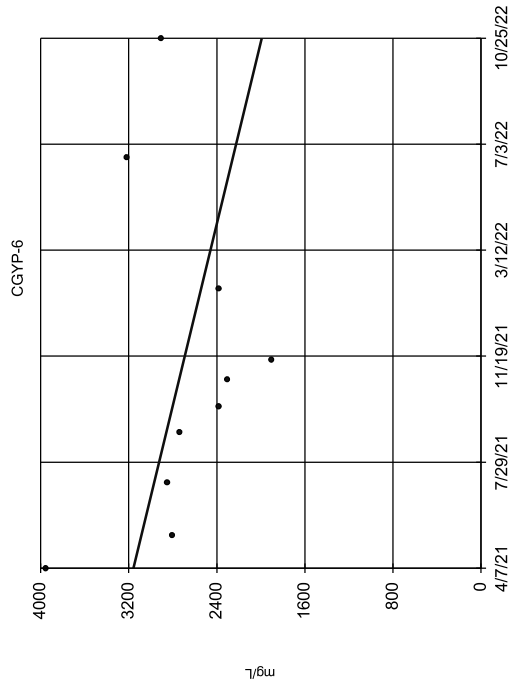

n = 10
 Slope = -750.3
 units per year.
 Mann-Kendall
 statistic = -11
 critical = -30
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Total Dissolved Solids Analysis Run 2/21/2023 1:54 PM View: Trend Tests - App III
 CGYP Client: Santee Cooper Data: CGYP

FIGURE K.

CYGP GWPS				
Constituent Name	MCL	CCR-Rule Specified	Background Limit	GWPS
Antimony, Total (mg/L)	0.006		0.025	0.025
Arsenic, Total (mg/L)	0.01		0.016	0.016
Barium, Total (mg/L)	2		0.103	2
Beryllium, Total (mg/L)	0.004		0.00063	0.004
Cadmium, Total (mg/L)	0.005		0.0005	0.005
Chromium, Total (mg/L)	0.1		0.014	0.1
Cobalt, Total (mg/L)		0.006	0.0034	0.006
Combined Radium 226 + 228 (pCi/L)	5		16.3	16.3
Fluoride, Total (mg/L)	4		0.3	4
Lead, Total (mg/L)		0.015	0.011	0.015
Lithium, Total (mg/L)		0.04	0.01	0.04
Mercury, Total (mg/L)	0.002		0.0006	0.002
Molybdenum, Total (mg/L)		0.1	0.01	0.1
Selenium, Total (mg/L)	0.05		0.02	0.05
Thallium, Total (mg/L)	0.002		0.001	0.002

*GWPS = Groundwater Protection Standard

*MCL = Maximum Contaminant Limit

*CCR = Coal Combustion Residuals

Shaded cells indicate background limit is higher than established MCL.

FIGURE L.

Confidence Intervals Summary Table Appendix IV - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 3/9/2023, 9:51 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig. N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Beryllium (mg/L)	CGYP-1	0.01039	0.006372	0.004	Yes 14	0.008379	0.002833	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03776	0.02535	0.004	Yes 14	0.03155	0.00876	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01731	0.01461	0.004	Yes 10	0.01596	0.001515	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02495	0.01981	0.004	Yes 10	0.02238	0.002883	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.04987	0.03188	0.006	Yes 14	0.04087	0.0127	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.02946	0.0161	0.006	Yes 14	0.0232	0.009849	0	None	sqrt(x)	0.01	Param.
Cobalt (mg/L)	CGYP-3	0.1346	0.08616	0.006	Yes 14	0.1104	0.03418	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.05135	0.03418	0.006	Yes 10	0.04224	0.01147	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1571	0.1258	0.006	Yes 10	0.1415	0.01754	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-2	0.02493	0.01896	0.015	Yes 14	0.02149	0.005549	7.143	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.02959	0.02041	0.015	Yes 13	0.025	0.006168	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-3	0.0972	0.06185	0.04	Yes 14	0.07953	0.02496	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06485	0.05031	0.04	Yes 10	0.05758	0.008143	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1378	0.1112	0.04	Yes 10	0.1245	0.01495	0	None	No	0.01	Param.

Confidence Intervals Summary Table Appendix IV - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 3/9/2023, 9:52 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig. N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Antimony (mg/L)	CGYP-1	0.005	0.005	0.025	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Antimony (mg/L)	CGYP-2	0.005	0.005	0.025	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Antimony (mg/L)	CGYP-3	0.005	0.005	0.025	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Antimony (mg/L)	CGYP-4	0.005	0.005	0.025	No 10	0.005	0	100	None	No	0.011	NP (NDs)
Antimony (mg/L)	CGYP-6	0.005	0.005	0.025	No 10	0.005	0	100	None	No	0.011	NP (NDs)
Arsenic (mg/L)	CGYP-1	0.03333	0.01416	0.016	No 14	0.02374	0.01353	7.143	None	No	0.01	Param.
Arsenic (mg/L)	CGYP-2	0.02233	0.01446	0.016	No 14	0.0174	0.007413	14.29	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-3	0.01935	0.01375	0.016	No 14	0.01613	0.004832	7.143	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-4	0.01152	0.008114	0.016	No 10	0.00951	0.002739	10	None	x^3	0.01	Param.
Arsenic (mg/L)	CGYP-6	0.003	0.003	0.016	No 10	0.003	0	100	None	No	0.011	NP (NDs)
Barium (mg/L)	CGYP-1	0.05743	0.03665	2	No 14	0.04754	0.01544	0	None	sqrt(x)	0.01	Param.
Barium (mg/L)	CGYP-2	0.035	0.01756	2	No 14	0.02628	0.01231	7.143	None	No	0.01	Param.
Barium (mg/L)	CGYP-3	0.05154	0.03457	2	No 14	0.04306	0.01198	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-4	0.04043	0.02705	2	No 10	0.03374	0.007493	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-6	0.6721	0.3327	2	No 10	0.5024	0.1902	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-1	0.01039	0.006372	0.004	Yes 14	0.008379	0.002833	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-2	0.004388	0.003019	0.004	No 14	0.003771	0.001159	0	None	ln(x)	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03776	0.02535	0.004	Yes 14	0.03155	0.00876	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01731	0.01461	0.004	Yes 10	0.01596	0.001515	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02495	0.01981	0.004	Yes 10	0.02238	0.002883	0	None	No	0.01	Param.
Cadmium (mg/L)	CGYP-1	0.004	0.0022	0.005	No 14	0.003871	0.0004811	92.86	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-2	0.004	0.0014	0.005	No 14	0.003814	0.0006949	92.86	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-3	0.004	0.00062	0.005	No 14	0.001974	0.0016	35.71	None	No	0.01	NP (normality)
Cadmium (mg/L)	CGYP-4	0.004	0.004	0.005	No 10	0.00368	0.001012	90	None	No	0.011	NP (NDs)
Cadmium (mg/L)	CGYP-6	0.004	0.004	0.005	No 10	0.00366	0.001075	90	None	No	0.011	NP (NDs)
Chromium (mg/L)	CGYP-1	0.005	0.005	0.1	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Chromium (mg/L)	CGYP-2	0.005	0.005	0.1	No 14	0.005	0	100	None	No	0.01	NP (NDs)
Chromium (mg/L)	CGYP-3	0.0067	0.005	0.1	No 14	0.006021	0.00117	21.43	None	No	0.01	NP (normality)
Chromium (mg/L)	CGYP-4	0.005	0.005	0.1	No 10	0.005	0	100	None	No	0.011	NP (NDs)
Chromium (mg/L)	CGYP-6	0.005	0.005	0.1	No 10	0.005	0	100	None	No	0.011	NP (NDs)
Cobalt (mg/L)	CGYP-1	0.04987	0.03188	0.006	Yes 14	0.04087	0.0127	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.02946	0.0161	0.006	Yes 14	0.0232	0.009849	0	None	sqrt(x)	0.01	Param.
Cobalt (mg/L)	CGYP-3	0.1346	0.08616	0.006	Yes 14	0.1104	0.03418	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.05135	0.03418	0.006	Yes 10	0.04224	0.01147	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1571	0.1258	0.006	Yes 10	0.1415	0.01754	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-1	4.615	3.144	16.3	No 14	3.909	1.115	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-2	3.339	1.869	16.3	No 14	2.604	1.038	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-3	6.489	4.698	16.3	No 14	5.594	1.264	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-4	5.715	3.889	16.3	No 10	4.802	1.024	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-6	7.663	4.259	16.3	No 10	5.961	1.907	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.174	0.7689	4	No 15	0.9713	0.2987	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.04	0.4444	4	No 15	0.742	0.4392	13.33	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.259	1.023	4	No 15	2.141	1.65	6.667	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.407	0.9649	4	No 10	1.686	0.8082	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9802	0.5078	4	No 10	0.744	0.2647	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-1	0.01788	0.007623	0.015	No 14	0.01321	0.008213	7.143	None	sqrt(x)	0.01	Param.
Lead (mg/L)	CGYP-2	0.02493	0.01896	0.015	Yes 14	0.02149	0.005549	7.143	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.02959	0.02041	0.015	Yes 13	0.025	0.006168	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-4	0.01469	0.01043	0.015	No 10	0.01243	0.002945	10	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-6	0.01456	0.006838	0.015	No 10	0.0107	0.004328	10	None	No	0.01	Param.
Lithium (mg/L)	CGYP-1	0.024	0.01	0.04	No 14	0.01673	0.006667	28.57	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-2	0.015	0.01	0.04	No 14	0.01271	0.002405	28.57	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-3	0.0972	0.06185	0.04	Yes 14	0.07953	0.02496	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06485	0.05031	0.04	Yes 10	0.05758	0.008143	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1378	0.1112	0.04	Yes 10	0.1245	0.01495	0	None	No	0.01	Param.


Confidence Intervals Summary Table Appendix IV - All Results Page 2

CGYP Client: Santee Cooper Data: CGYP Printed 3/9/2023, 9:52 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Mercury (mg/L)	CGYP-1	0.0002	0.0002	0.002	No	14	0.0002	1.4e-12	92.86	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-2	0.0002	0.0002	0.002	No	14	0.0002	0	100	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-3	0.00021	0.0002	0.002	No	14	0.0002221	0.00007181	78.57	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-4	0.0004	0.0004	0.002	No	10	0.0004	0	100	None	No	0.011	NP (NDs)
Mercury (mg/L)	CGYP-6	0.0002	0.0002	0.002	No	10	0.0002	0	100	None	No	0.011	NP (NDs)
Molybdenum (mg/L)	CGYP-1	0.005	0.005	0.1	No	14	0.005	0	100	None	No	0.01	NP (NDs)
Molybdenum (mg/L)	CGYP-2	0.005	0.005	0.1	No	14	0.005	0	100	None	No	0.01	NP (NDs)
Molybdenum (mg/L)	CGYP-3	0.005	0.005	0.1	No	14	0.005	0	100	None	No	0.01	NP (NDs)
Molybdenum (mg/L)	CGYP-4	0.005	0.005	0.1	No	10	0.005	0	100	None	No	0.011	NP (NDs)
Molybdenum (mg/L)	CGYP-6	0.005	0.005	0.1	No	10	0.005	0	100	None	No	0.011	NP (NDs)
Selenium (mg/L)	CGYP-1	0.026	0.01	0.05	No	14	0.01749	0.01179	57.14	None	No	0.01	NP (normality)
Selenium (mg/L)	CGYP-2	0.027	0.0078	0.05	No	14	0.01558	0.01223	71.43	None	No	0.01	NP (normality)
Selenium (mg/L)	CGYP-3	0.019	0.0067	0.05	No	14	0.01484	0.01192	78.57	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-4	0.05	0.01	0.05	No	10	0.01786	0.01695	90	None	No	0.011	NP (NDs)
Selenium (mg/L)	CGYP-6	0.05	0.01	0.05	No	10	0.01725	0.01742	100	None	No	0.011	NP (NDs)
Thallium (mg/L)	CGYP-1	0.001	0.001	0.002	No	14	0.001	0	100	None	No	0.01	NP (NDs)
Thallium (mg/L)	CGYP-2	0.001	0.001	0.002	No	14	0.001	0	100	None	No	0.01	NP (NDs)
Thallium (mg/L)	CGYP-3	0.001	0.001	0.002	No	14	0.001	0	100	None	No	0.01	NP (NDs)
Thallium (mg/L)	CGYP-4	0.001	0.001	0.002	No	10	0.001	0	100	None	No	0.011	NP (NDs)
Thallium (mg/L)	CGYP-6	0.001	0.001	0.002	No	10	0.001	0	100	None	No	0.011	NP (NDs)

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

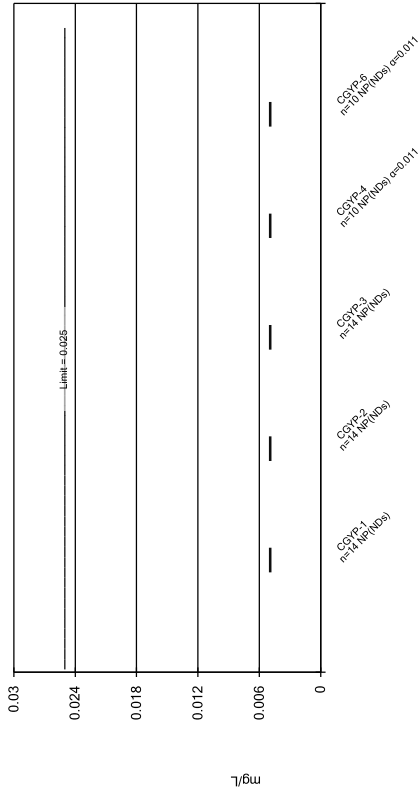

Constituent: Antimony Analysis Run 3/8/2023 12:09 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

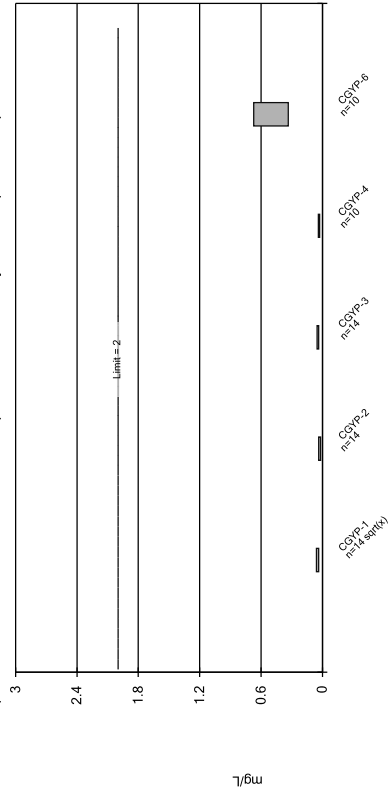

Constituent: Barium Analysis Run 3/8/2023 12:09 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

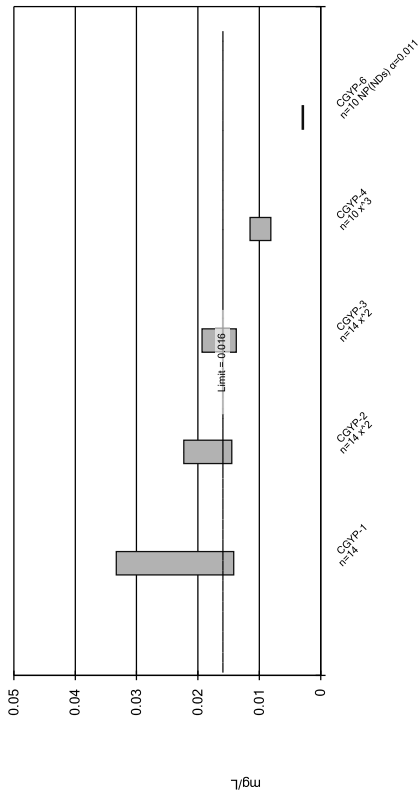

Constituent: Arsenic Analysis Run 3/8/2023 12:09 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded. * Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

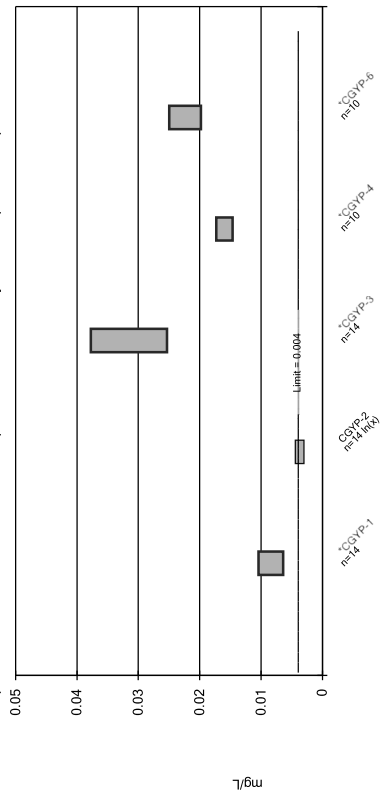

Constituent: Beryllium Analysis Run 3/8/2023 12:09 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

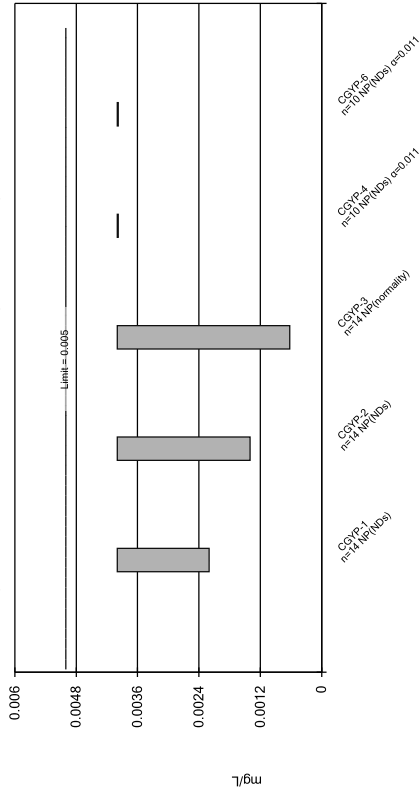

Constituent: Cadmium Analysis Run 3/8/2023 12:09 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

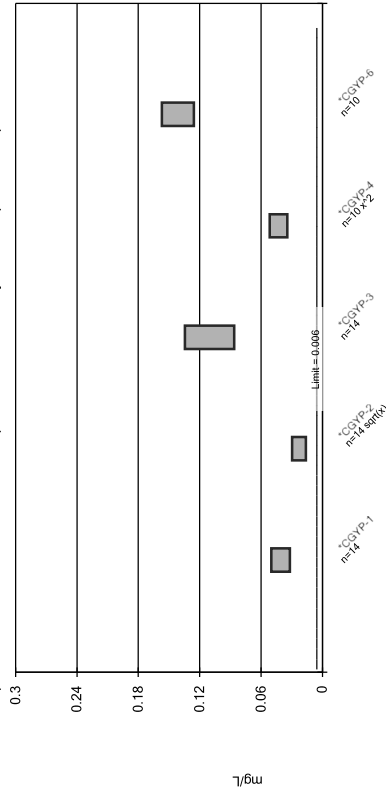

Constituent: Cobalt Analysis Run 3/8/2023 12:10 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

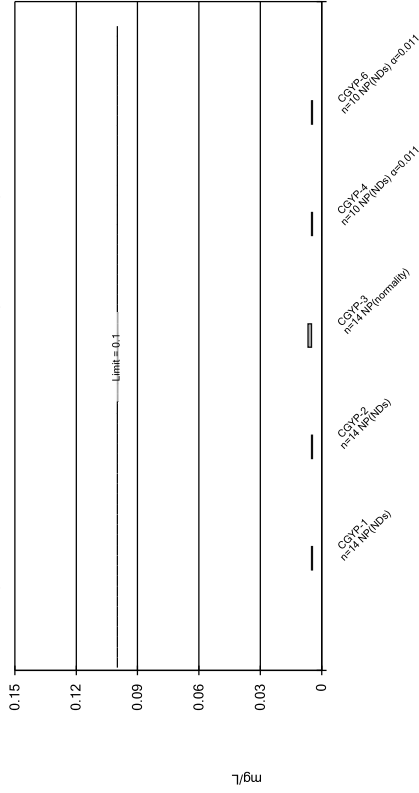

Constituent: Chromium Analysis Run 3/8/2023 12:09 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

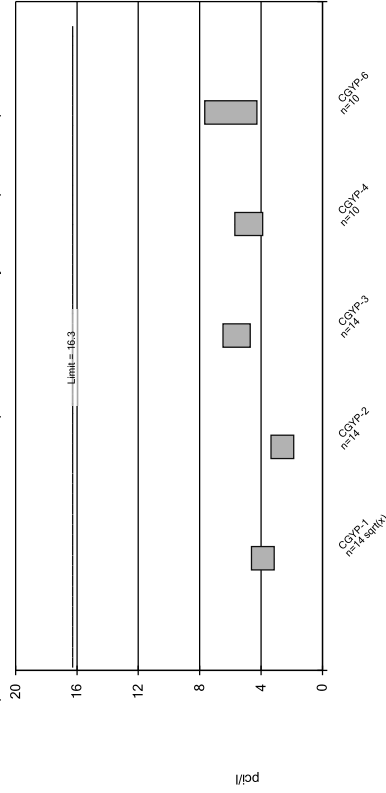

Constituent: Combined Radium 226 & 228 Analysis Run 3/8/2023 12:10 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

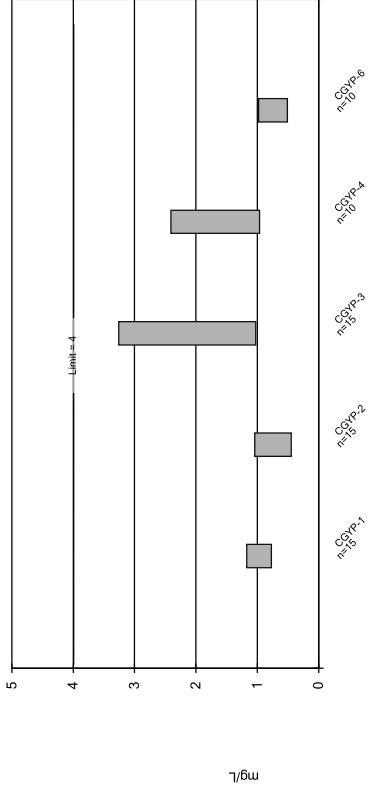

Constituent: Fluoride Analysis Run 3/8/2023 12:10 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

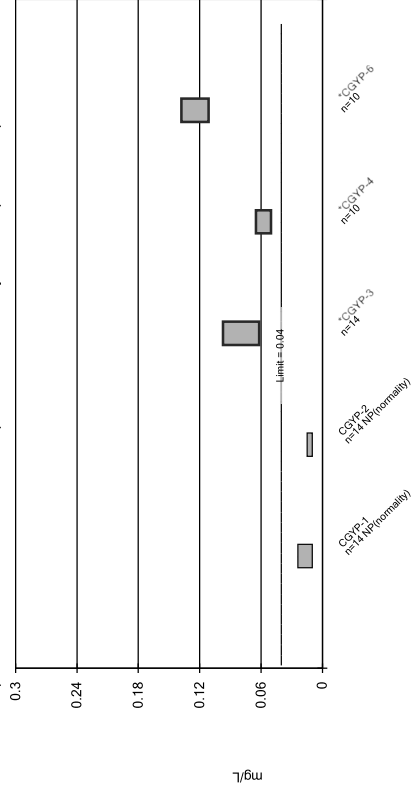

Constituent: Lithium Analysis Run 3/8/2023 12:10 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

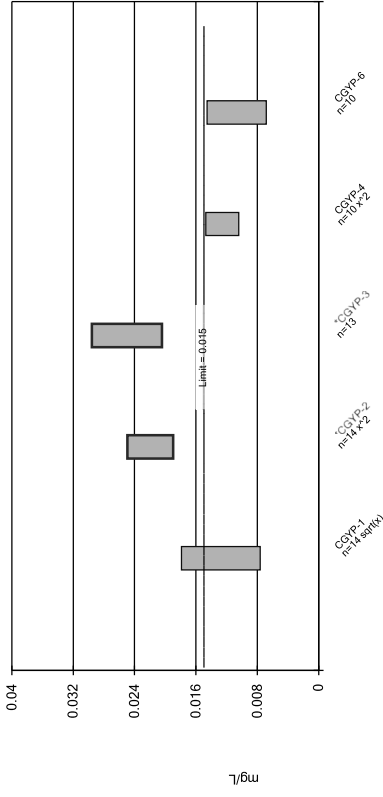

Constituent: Lead Analysis Run 3/8/2023 12:10 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

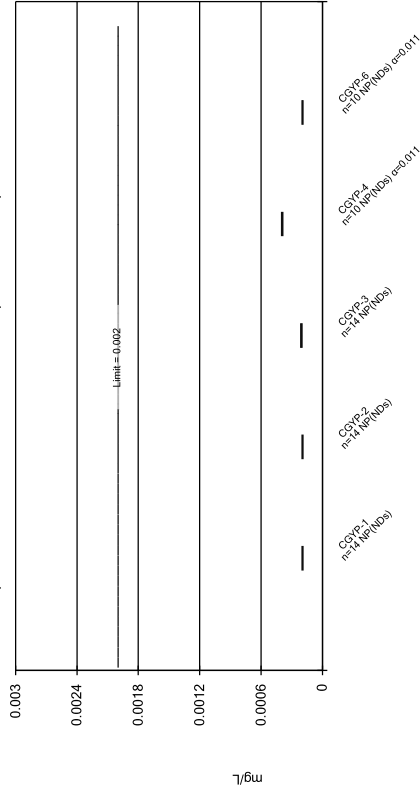

Constituent: Mercury Analysis Run 3/8/2023 12:10 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

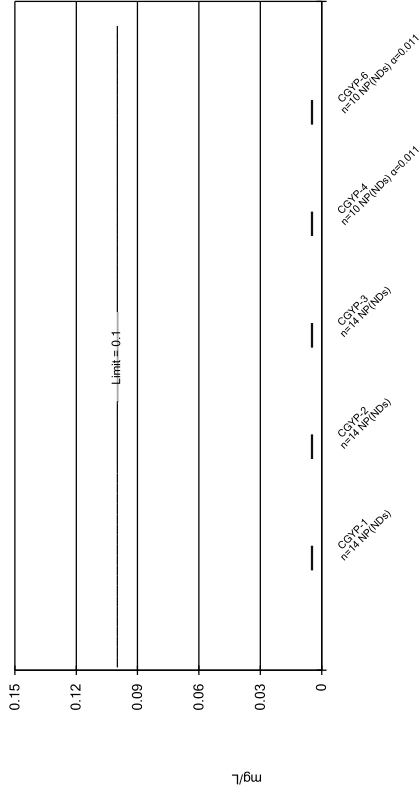

Constituent: Molybdenum Analysis Run 3/9/2023 9:47 AM
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

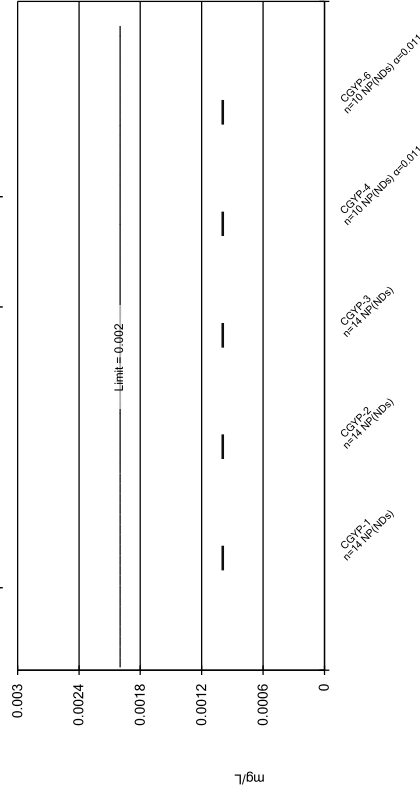

Constituent: Thallium Analysis Run 3/9/2023 9:49 AM
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

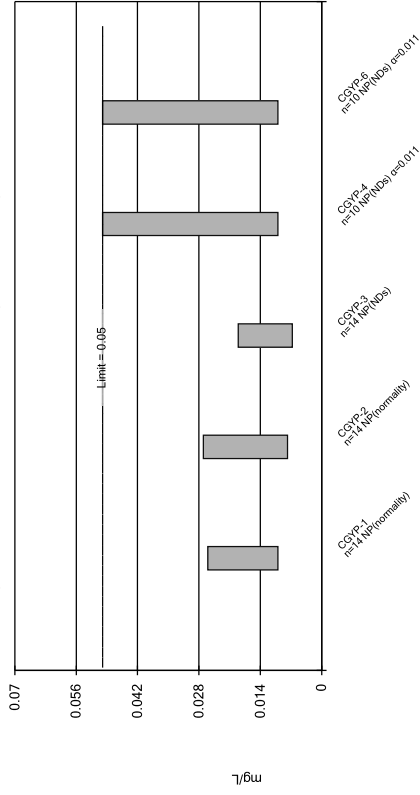

Constituent: Selenium Analysis Run 3/9/2023 9:48 AM
CGYP Client: Santee Cooper Data: CGYP

Confidence Interval

Constituent: Antimony (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.005	<0.005	<0.005		
6/4/2020	<0.005	<0.005	<0.005		
6/18/2020	<0.005	<0.005	<0.005		
7/1/2020	<0.005		<0.005		
7/2/2020		<0.005			
7/16/2020	<0.005	<0.005	<0.005		
7/30/2020	<0.005	<0.005	<0.005		
8/13/2020	<0.005	<0.005	<0.005		
8/27/2020	<0.005	<0.005	<0.005		
2/10/2021	<0.005	<0.005	<0.005		
4/7/2021	<0.005	<0.005	<0.005	<0.005	<0.005
5/13/2021				<0.005	<0.005
7/7/2021	<0.005	<0.005	<0.005		
7/8/2021				<0.005	<0.005
8/31/2021					<0.005
9/1/2021				<0.005	
9/27/2021				<0.005	<0.005
10/26/2021				<0.005	<0.005
11/17/2021				<0.005	<0.005
1/31/2022	<0.005 (D)	<0.005 (D)	<0.005 (D)	<0.005 (D)	<0.005 (D)
6/21/2022	<0.005 (D)	<0.005 (D)	<0.005 (D)	<0.005 (D)	<0.005 (D)
10/25/2022		<0.005	<0.005	<0.005	<0.005
10/26/2022	<0.005				
Mean	0.005	0.005	0.005	0.005	0.005
Std. Dev.	0	0	0	0	0
Upper Lim.	0.005	0.005	0.005	0.005	0.005
Lower Lim.	0.005	0.005	0.005	0.005	0.005

Confidence Interval

Constituent: Arsenic (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV
 CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0171	0.029	0.0169		
6/4/2020	0.037	0.0167	0.0138		
6/18/2020	0.0406	0.0197	0.0215		
7/1/2020	0.0407		0.0179		
7/2/2020		0.0191			
7/16/2020	0.0165	0.0217	0.017		
7/30/2020	0.014	0.0214	0.0171		
8/13/2020	0.0175	0.0214	0.0176		
8/27/2020	0.0278	0.0204	0.015		
2/10/2021	0.0452	0.0184	0.022		
4/7/2021	0.0336	0.0169	0.0198	0.0103	<0.003
5/13/2021				0.0105	<0.003
7/7/2021	0.0181	0.0194	0.0183		
7/8/2021				0.0113	<0.003
8/31/2021					<0.003
9/1/2021				0.0115	
9/27/2021				0.0118	<0.003
10/26/2021				0.0104	<0.003
11/17/2021				0.0112	<0.003
1/31/2022	0.0146	0.0165	0.0169	0.009 (D)	<0.003 (D)
6/21/2022	<0.01	<0.003	<0.01	<0.01	<0.003
10/25/2022		<0.003	0.007	0.0041	<0.003
10/26/2022	0.00472				
Mean	0.02374	0.0174	0.01613	0.00951	0.003
Std. Dev.	0.01353	0.007413	0.004832	0.002739	0
Upper Lim.	0.03333	0.02233	0.01935	0.01152	0.003
Lower Lim.	0.01416	0.01446	0.01375	0.008114	0.003

Confidence Interval

Constituent: Barium (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0899	0.024	0.0621		
6/4/2020	0.0447	0.0378	0.0582		
6/18/2020	0.0403	0.0445	0.0502		
7/1/2020	0.0426		0.0547		
7/2/2020		0.0439			
7/16/2020	0.0574	0.0274	0.0444		
7/30/2020	0.0575	0.0316	0.0437		
8/13/2020	0.0517	0.0289	0.0431		
8/27/2020	0.0447	0.0407	0.0459		
2/10/2021	0.0397	0.021	0.0405		
4/7/2021	0.0448	0.0145	0.0384	0.0454	0.326
5/13/2021				0.0375	0.437
7/7/2021	0.0522	0.0178	0.0378		
7/8/2021				0.0395	0.585
8/31/2021					0.564
9/1/2021				0.0364	
9/27/2021				0.0371	0.705
10/26/2021				0.0336	0.529
11/17/2021				0.0333	0.865
1/31/2022	0.0301	0.0125	0.0246	0.025	0.258
6/21/2022	0.023	<0.01	0.017	0.019	0.29
10/25/2022		0.0183	0.0422	0.0306	0.465
10/26/2022	0.0469				
Mean	0.04754	0.02628	0.04306	0.03374	0.5024
Std. Dev.	0.01544	0.01231	0.01198	0.007493	0.1902
Upper Lim.	0.05743	0.035	0.05154	0.04043	0.6721
Lower Lim.	0.03665	0.01756	0.03457	0.02705	0.3327

Confidence Interval

Constituent: Beryllium (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0058	0.0053	0.0283		
6/4/2020	0.0098	0.0034	0.0367		
6/18/2020	0.0109	0.0034	0.037		
7/1/2020	0.011		0.0468		
7/2/2020		0.0044			
7/16/2020	0.0045	0.0034	0.0252		
7/30/2020	0.004	0.0035	0.022		
8/13/2020	0.0061	0.0036	0.022		
8/27/2020	0.009	0.0034	0.0318		
2/10/2021	0.0127	0.0025	0.035		
4/7/2021	0.0103	0.0031	0.0465	0.0174	0.0277
5/13/2021				0.0164	0.0239
7/7/2021	0.0061	0.0028	0.0269		
7/8/2021				0.0179	0.0212
8/31/2021					0.0197
9/1/2021				0.015	
9/27/2021				0.0156	0.0219
10/26/2021				0.0152	0.0214
11/17/2021				0.0149	0.0194
1/31/2022	0.0106 (D)	0.007 (D)	0.0339	0.0166	0.0237
6/21/2022	0.006	0.003	0.017	0.013	0.019
10/25/2022		0.004 (D)	0.03265 (D)	0.0176 (D)	0.0259 (D)
10/26/2022	0.0105 (D)				
Mean	0.008379	0.003771	0.03155	0.01596	0.02238
Std. Dev.	0.002833	0.001159	0.00876	0.001515	0.002883
Upper Lim.	0.01039	0.004388	0.03776	0.01731	0.02495
Lower Lim.	0.006372	0.003019	0.02535	0.01461	0.01981

Confidence Interval

Constituent: Cadmium (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.004	<0.004	0.00062		
6/4/2020	<0.004	<0.004	0.0008		
6/18/2020	<0.004	<0.004	0.00074		
7/1/2020	<0.004		0.0009		
7/2/2020		<0.004			
7/16/2020	<0.004	<0.004	0.00061		
7/30/2020	<0.004	<0.004	<0.004		
8/13/2020	<0.004	<0.004	<0.004		
8/27/2020	<0.004	<0.004	0.00076		
2/10/2021	<0.004	<0.004	0.00078		
4/7/2021	<0.004	<0.004	0.00053	<0.004	<0.004
5/13/2021				<0.004	<0.004
7/7/2021	<0.004	<0.004	<0.004		
7/8/2021				<0.004	<0.004
8/31/2021					<0.004
9/1/2021				<0.004	
9/27/2021				<0.004	<0.004
10/26/2021				<0.004	<0.004
11/17/2021				<0.004	<0.004
1/31/2022	<0.004 (D)	<0.004 (D)	<0.004	<0.004 (D)	<0.004 (D)
6/21/2022	<0.004	<0.004	<0.004	<0.004	<0.004
10/25/2022		0.0014	0.0019	0.0008	0.0006
10/26/2022	0.0022				
Mean	0.003871	0.003814	0.001974	0.00368	0.00366
Std. Dev.	0.0004811	0.0006949	0.0016	0.001012	0.001075
Upper Lim.	0.004	0.004	0.004	0.004	0.004
Lower Lim.	0.0022	0.0014	0.00062	0.004	0.004

Confidence Interval

Constituent: Chromium (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.005	<0.005	0.0058		
6/4/2020	<0.005	<0.005	0.0067		
6/18/2020	<0.005	<0.005	0.0063		
7/1/2020	<0.005		0.0052		
7/2/2020		<0.005			
7/16/2020	<0.005	<0.005	0.0053		
7/30/2020	<0.005	<0.005	0.0055		
8/13/2020	<0.005	<0.005	0.0056		
8/27/2020	<0.005	<0.005	0.0059		
2/10/2021	<0.005	<0.005	<0.005		
4/7/2021	<0.005	<0.005	0.0061	<0.005	<0.005
5/13/2021				<0.005	<0.005
7/7/2021	<0.005	<0.005	0.0079		
7/8/2021				<0.005	<0.005
8/31/2021					<0.005
9/1/2021				<0.005	
9/27/2021				<0.005	<0.005
10/26/2021				<0.005	<0.005
11/17/2021				<0.005	<0.005
1/31/2022	<0.005 (D)	<0.005 (D)	<0.005	<0.005 (D)	<0.005 (D)
6/21/2022	<0.005	<0.005	<0.005	<0.005	<0.005
10/25/2022		<0.005	0.009	<0.005	<0.005
10/26/2022	<0.005				
Mean	0.005	0.005	0.006021	0.005	0.005
Std. Dev.	0	0	0.00117	0	0
Upper Lim.	0.005	0.005	0.0067	0.005	0.005
Lower Lim.	0.005	0.005	0.005	0.005	0.005

Confidence Interval

Constituent: Cobalt (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0448	0.0506	0.115		
6/4/2020	0.0479	0.0199	0.13		
6/18/2020	0.0492	0.0229	0.152		
7/1/2020	0.0548		0.154		
7/2/2020		0.025			
7/16/2020	0.0353	0.027	0.113		
7/30/2020	0.032	0.028	0.0966		
8/13/2020	0.0371	0.0294	0.0936		
8/27/2020	0.0467	0.0244	0.117		
2/10/2021	0.0587	0.019	0.151		
4/7/2021	0.0536	0.0183	0.143	0.0532	0.163
5/13/2021				0.0498	0.149
7/7/2021	0.0362	0.0206	0.0967		
7/8/2021				0.0494	0.147
8/31/2021					0.15
9/1/2021				0.0487	
9/27/2021				0.0478	0.157
10/26/2021				0.0463	0.158
11/17/2021				0.0461	0.128
1/31/2022	0.00931	0.00644	0.0504	0.0168	0.114
6/21/2022	0.033	0.018	0.055	0.033	0.117
10/25/2022		0.0153 (D)	0.07787 (D)	0.0313 (D)	0.1317 (D)
10/26/2022	0.03363 (D)				
Mean	0.04087	0.0232	0.1104	0.04224	0.1415
Std. Dev.	0.0127	0.009849	0.03418	0.01147	0.01754
Upper Lim.	0.04987	0.02946	0.1346	0.05135	0.1571
Lower Lim.	0.03188	0.0161	0.08616	0.03418	0.1258

Confidence Interval

Constituent: Combined Radium 226 & 228 (pci/l) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	3.97	1.34	5.59		
6/4/2020	3.96	2.14	4.18		
6/18/2020	3.79	2.61	5.24		
7/1/2020	5.58		3.26		
7/2/2020		2.13			
7/16/2020	3.65	2.46	5.25		
7/30/2020	2.93	2.15	7.74		
8/13/2020	3.07	1.91	5.99		
8/27/2020	2.64	1.3	5.2		
2/10/2021	3.86	2.83	4.69		
4/7/2021	3.89	4.18	7.93	6.37	3.68
5/13/2021				5.84	6.31
7/7/2021	2.77	2.5	5.03		
7/8/2021				3.56	6.08
8/31/2021					5.53
9/1/2021				4.64	
9/27/2021				5.29	7.93
10/26/2021				5.56	6.48
11/17/2021				4.9	9.69
1/31/2022	6.81	3.4	6.17	4.85	3.44
6/21/2022	4.28	2.39	5.36	3.24	4.3
10/25/2022		5.12	6.68	3.77	6.17
10/26/2022	3.53				
Mean	3.909	2.604	5.594	4.802	5.961
Std. Dev.	1.115	1.038	1.264	1.024	1.907
Upper Lim.	4.615	3.339	6.489	5.715	7.663
Lower Lim.	3.144	1.869	4.698	3.889	4.259

Confidence Interval

Constituent: Fluoride (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV
CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.58	0.75	0.65		
6/4/2020	0.96	0.75	2.89		
6/18/2020	1.05	0.62	2.82		
7/1/2020	0.69		0.73		
7/2/2020		<0.1			
7/16/2020	0.72	1.55	2.41		
7/30/2020	0.91	<0.1	<0.1		
8/13/2020	1.04	0.71	1		
8/27/2020	1.02	0.54	4.57		
9/21/2020	1.29	1.23	1.77		
2/10/2021	1.69	1.3	6.22		
4/7/2021	1.31	1.08	3.32	3.19	1.1
5/13/2021				2.82	0.84
7/7/2021	0.97	0.87	1.88		
7/8/2021				1.85	0.99
8/31/2021					0.75
9/1/2021				1.79	
9/27/2021				1.63	0.98
10/26/2021				0.83	0.42
11/17/2021				1.53	0.58
1/31/2022	0.9	0.28	0.81	0.67	0.36
6/21/2022	0.91	0.93	1.94	1.56	0.93
10/25/2022		0.42	1.06	0.99	0.49
10/26/2022	0.53				
Mean	0.9713	0.742	2.141	1.686	0.744
Std. Dev.	0.2987	0.4392	1.65	0.8082	0.2647
Upper Lim.	1.174	1.04	3.259	2.407	0.9802
Lower Lim.	0.7689	0.4444	1.023	0.9649	0.5078

Confidence Interval

Constituent: Lead (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV
 CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.035	0.02	0.0279		
6/4/2020	0.0191	0.0238	0.019		
6/18/2020	0.0201	0.0247	0.0236		
7/1/2020	0.0202		0.0236		
7/2/2020		0.026			
7/16/2020	0.0116	0.0235	0.0269		
7/30/2020	0.005	0.0244	0.0295		
8/13/2020	0.0093	0.0247	0.0355		
8/27/2020	0.0087	0.0268	0.0193		
2/10/2021	0.0165	0.0196	0.092 (o)		
4/7/2021	0.008	0.0175	0.0248	0.0113	0.013
5/13/2021				0.0122	0.0127
7/7/2021	0.0097	0.0208	0.0297		
7/8/2021				0.0126	0.0131
8/31/2021					0.0136
9/1/2021				0.0146	
9/27/2021				0.0147	0.0137
10/26/2021				0.0145	0.0158
11/17/2021				0.0147	0.0068
1/31/2022	0.0078 (D)	0.019	0.0244	0.0113	0.0105
6/21/2022	<0.01	<0.01	0.011	<0.01	<0.01
10/25/2022		0.0251	0.0298	0.0134	0.0028
10/26/2022	0.0089				
Mean	0.01321	0.02149	0.025	0.01243	0.0107
Std. Dev.	0.008213	0.005549	0.006168	0.002945	0.004328
Upper Lim.	0.01788	0.02493	0.02959	0.01469	0.01456
Lower Lim.	0.007623	0.01896	0.02041	0.01043	0.006838

Confidence Interval

Constituent: Lithium (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV
 CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.015	0.015	0.069		
6/4/2020	0.027	<0.01	0.09		
6/18/2020	0.028	0.015	0.11		
7/1/2020	<0.01		0.11		
7/2/2020		0.015			
7/16/2020	0.01	<0.01	0.071		
7/30/2020	<0.01	0.014	0.06		
8/13/2020	<0.01	<0.01	0.063		
8/27/2020	0.023	0.016	0.093		
2/10/2021	0.024	0.013	0.11		
4/7/2021	0.02	0.014	0.094	0.058	0.14
5/13/2021				0.058	0.13
7/7/2021	0.014	0.015	0.056		
7/8/2021				0.058	0.12
8/31/2021					0.13
9/1/2021				0.064	
9/27/2021				0.067	0.15
10/26/2021				0.053	0.11
11/17/2021				0.052	0.11
1/31/2022	0.0183	0.0109	0.1	0.0642	0.128
6/21/2022	<0.01	<0.01	0.029	0.039	0.1
10/25/2022		0.01 (D)	0.05835 (D)	0.0626 (D)	0.127 (D)
10/26/2022	0.014965 (D)				
Mean	0.01673	0.01271	0.07953	0.05758	0.1245
Std. Dev.	0.006667	0.002405	0.02496	0.008143	0.01495
Upper Lim.	0.024	0.015	0.0972	0.06485	0.1378
Lower Lim.	0.01	0.01	0.06185	0.05031	0.1112

Confidence Interval

Constituent: Mercury (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV
 CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.0002	<0.0002	<0.0002		
6/4/2020	<0.0002	<0.0002	<0.0002		
6/18/2020	<0.0002	<0.0002	0.00047		
7/1/2020	0.0002		0.00023		
7/2/2020		<0.0002			
7/16/2020	<0.0002	<0.0002	<0.0002		
7/30/2020	<0.0002	<0.0002	<0.0002		
8/13/2020	<0.0002	<0.0002	<0.0002		
8/27/2020	<0.0002	<0.0002	<0.0002		
2/10/2021	<0.0002	<0.0002	<0.0002		
4/7/2021	<0.0002	<0.0002	0.00021	<0.0004	<0.0002
5/13/2021				<0.0004	<0.0002
7/7/2021	<0.0002	<0.0002	<0.0002		
7/8/2021				<0.0004	<0.0002
8/31/2021					<0.0002
9/1/2021				<0.0004	
9/27/2021				<0.0004	<0.0002
10/26/2021				<0.0004	<0.0002
11/17/2021				<0.0004	<0.0002
1/31/2022	<0.0002	<0.0002	<0.0002	<0.0004	<0.0002
6/21/2022	<0.0002	<0.0002	<0.0002	<0.0004	<0.0002
10/25/2022		<0.0002	<0.0002	<0.0004	<0.0002
10/26/2022	<0.0002				
Mean	0.0002	0.0002	0.0002221	0.0004	0.0002
Std. Dev.	1.4E-12	0	7.181E-05	0	0
Upper Lim.	0.0002	0.0002	0.00021	0.0004	0.0002
Lower Lim.	0.0002	0.0002	0.0002	0.0004	0.0002

Confidence Interval

Constituent: Molybdenum (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.005	<0.005	<0.005		
6/4/2020	<0.005	<0.005	<0.005		
6/18/2020	<0.005	<0.005	<0.005		
7/1/2020	<0.005		<0.005		
7/2/2020		<0.005			
7/16/2020	<0.005	<0.005	<0.005		
7/30/2020	<0.005	<0.005	<0.005		
8/13/2020	<0.005	<0.005	<0.005		
8/27/2020	<0.005	<0.005	<0.005		
2/10/2021	<0.005	<0.005	<0.005		
4/7/2021	<0.005	<0.005	<0.005	<0.005	<0.005
5/13/2021				<0.005	<0.005
7/7/2021	<0.005	<0.005	<0.005		
7/8/2021				<0.005	<0.005
8/31/2021					<0.005
9/1/2021				<0.005	
9/27/2021				<0.005	<0.005
10/26/2021				<0.005	<0.005
11/17/2021				<0.005	<0.005
1/31/2022	<0.005	<0.005	<0.005	<0.005	<0.005
6/21/2022	<0.005	<0.005	<0.005	<0.005	<0.005
10/25/2022		<0.005	<0.005	<0.005	<0.005
10/26/2022	<0.005				
Mean	0.005	0.005	0.005	0.005	0.005
Std. Dev.	0	0	0	0	0
Upper Lim.	0.005	0.005	0.005	0.005	0.005
Lower Lim.	0.005	0.005	0.005	0.005	0.005

Confidence Interval

Constituent: Selenium (mg/L) Analysis Run 3/9/2023 9:49 AM

CGYP Client: Santee Cooper Data: CGYP


	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.01	0.0113	<0.01		
6/4/2020	0.0166	0.0078	0.0067		
6/18/2020	0.0143	<0.01	<0.01		
7/1/2020	0.0177		<0.01		
7/2/2020		<0.01			
7/16/2020	<0.01	<0.01	<0.01		
7/30/2020	<0.01	<0.01	<0.01		
8/13/2020	<0.01	<0.01	<0.01		
8/27/2020	<0.01	<0.01	<0.01		
2/10/2021	0.0163	<0.01	<0.01		
4/7/2021	<0.01	<0.01	<0.01	<0.01	<0.01
5/13/2021				<0.01	<0.01
7/7/2021	<0.01	<0.01	<0.01		
7/8/2021				<0.01	<0.01
8/31/2021					<0.01
9/1/2021				<0.01	
9/27/2021				<0.01	<0.01
10/26/2021				<0.01	<0.01
11/17/2021				<0.01	<0.01
1/31/2022	0.034 (D)	0.032 (D)	0.032 (D)	<0.05 (D)	<0.05 (D)
6/21/2022	<0.05	<0.05	<0.05	<0.05	<0.05
10/25/2022		0.027	0.019	0.00856	<0.0025
10/26/2022	0.026				
Mean	0.01749	0.01558	0.01484	0.01786	0.01725
Std. Dev.	0.01179	0.01223	0.01192	0.01695	0.01742
Upper Lim.	0.026	0.027	0.019	0.05	0.05
Lower Lim.	0.01	0.0078	0.0067	0.01	0.01

Confidence Interval

Constituent: Thallium (mg/L) Analysis Run 3/8/2023 12:11 PM View: Confidence Intervals - Appendix IV
 CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.001	<0.001	<0.001		
6/4/2020	<0.001	<0.001	<0.001		
6/18/2020	<0.001	<0.001	<0.001		
7/1/2020	<0.001		<0.001		
7/2/2020		<0.001			
7/16/2020	<0.001	<0.001	<0.001		
7/30/2020	<0.001	<0.001	<0.001		
8/13/2020	<0.001	<0.001	<0.001		
8/27/2020	<0.001	<0.001	<0.001		
2/10/2021	<0.001	<0.001	<0.001		
4/7/2021	<0.001	<0.001	<0.001	<0.001	<0.001
5/13/2021				<0.001	<0.001
7/7/2021	<0.001	<0.001	<0.001		
7/8/2021				<0.001	<0.001
8/31/2021					<0.001
9/1/2021				<0.001	
9/27/2021				<0.001	<0.001
10/26/2021				<0.001	<0.001
11/17/2021				<0.001	<0.001
1/31/2022	<0.001 (D)	<0.001 (D)	<0.001 (D)	<0.001 (D)	<0.001 (D)
6/21/2022	<0.001	<0.001	<0.001	<0.001	<0.001
10/25/2022		<0.001	<0.001	<0.001	<0.001
10/26/2022	<0.001				
Mean	0.001	0.001	0.001	0.001	0.001
Std. Dev.	0	0	0	0	0
Upper Lim.	0.001	0.001	0.001	0.001	0.001
Lower Lim.	0.001	0.001	0.001	0.001	0.001

GROUNDWATER STATS CONSULTING

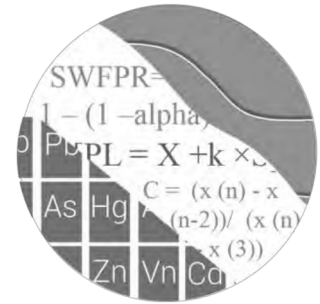

October 24, 2023

SynTerra
Attn: Ms. Kelly Ferri
148 River Street, Suite 220
Greenville, South Carolina 29601

RE:
Cross Generating Station Closed Gypsum Pond –
June 2023 Groundwater Statistical Analysis

Dear Ms. Ferri,

Groundwater Stats Consulting, formerly the statistical consulting division at Sanitas Technologies, is pleased to provide the data screening and statistical analysis of the June 2023 sample event of groundwater data at the Cross Generating Station Closed Gypsum Pond for the Coal Combustion Residuals (CCR) program. The analysis complies with the federal rule for the Disposal of Coal Combustion Residuals from Electric Utilities (CCR Rule, 2015) as well as with the United States Environmental Protection Agency (USEPA) Unified Guidance (2009).

Data were sent electronically to Groundwater Stats Consulting, and the statistical analysis was reviewed by Kristina Rayner, Founder and Senior Statistician for Groundwater Stats Consulting. The monitoring well network consists of the following wells:

- Upgradient wells: CBW-1 and PM-1
- Downgradient wells: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-7, CCMGP-1, CCMGP-2, CCMGP-3, CCMGP-4, and CCMGP-5

Sampling began for the CCR program in October 2015 at upgradient wells CBW-1 and PM-1; in May 2020 for downgradient wells CGYP1, CGYP-2, and CGYP-3; in April 2021 for downgradient wells CGYP-4 and CGYP-6; and in October 2022 for downgradient well CGYP-7. All wells are analyzed in this report except for well CGYP-7, which is in the baseline collection phase, and is only included on the time series graphs and box plots.

New wells CCMGP-1, CCMGP-2, CCMGP-3, CCMGP-4, and CCMGP-5 were installed in June 2023 for nature and extent characterization. The nature and extent wells were sampled in June and August 2023; however, only the June 2023 data were available at the time this report was prepared. Similarly, these wells were only included on time series graphs and box plots. The Appendix III and IV constituents are evaluated using prediction limits and confidence intervals, respectively, when a minimum of 8 background samples are available.

The following constituents are evaluated:

- **Appendix III:** boron, calcium, chloride, fluoride, pH, sulfate, and TDS
- **Appendix IV:** antimony, arsenic, barium, beryllium, cadmium, chromium, cobalt, combined radium 226 + 228, fluoride, lead, lithium, mercury, molybdenum, selenium, and thallium

Note that the terms “parameters” and “constituents” are interchangeable throughout this report. When there are no detections present in downgradient wells for a given constituent, statistical analyses are not required. A summary of well/constituent pairs containing 100% non-detects follows this letter.

Time series plots are provided for all well/constituent pairs and are particularly useful for screening data (Figure A). Additionally, a separate section of box plots is included for all constituents at upgradient and downgradient wells (Figure B). The time series plots display concentrations over time for each well and are used to initially screen for suspected outliers and trends, while the box plots provide visual representation of variation within individual wells and between all wells. Outliers and trends in background data result in increased variation and statistical limits that are not conservative (i.e., lower) from a regulatory perspective, if not addressed. When outliers are confirmed, these values are flagged in the computer database with “o” in order to deselect prior to construction of statistical limits. Values in background which have been flagged as outliers may be seen in a lighter font and as a disconnected symbol on the time series graphs. A list of flagged values follows this report (Figure C).

Reporting limit changes may occur depending on laboratory capabilities. A substitution of the most recent reporting limit is used for all non-detects for a given constituent to account for any varying detection limits in background data sets.

Data at all wells for constituents detected in downgradient wells were evaluated for the following: 1) outliers; 2) trends; 3) most appropriate statistical method based on site

characteristics of groundwater data upgradient of the facility; and 4) eligibility of downgradient wells when intrawell statistical methods are recommended. A power curve is provided to demonstrate that the selected statistical method for the Appendix III Detection Monitoring parameters listed above complies with the USEPA Unified Guidance. The EPA suggests the selected statistical method should provide at least 55% power at 3 standard deviations or at least 80% power at 4 standard deviations. Power curves were based on the following statistical methods:

CCR Appendix III Constituents:

- Semi-Annual Sampling
- Interwell Prediction Limits with 1-of-2 resample plan
- # Constituents: 7
- # Downgradient wells: 5

Parametric prediction limits are utilized when the screened historical data follow a normal or transformed-normal distribution. When data cannot be normalized or the majority of data are non-detects, a nonparametric test is utilized. While the false positive rate associated with the parametric limits is based on an annual 10% (5% per semi-annual event) as recommended by the EPA Unified Guidance (2009), the false positive rate associated with the nonparametric limits is dependent upon the available background sample size, number of future comparisons, and verification resample plan. The distribution of data is tested using the Shapiro-Wilk/Shapiro-Francia test for normality. After testing for normality and performing any adjustments as discussed below (US EPA, 2009), data are analyzed using either parametric or non-parametric prediction limits. Non-detects are handled as follows:

- No statistical analyses are required on wells and analytes containing 100% non-detects.
- When data contain <15% non-detects, simple substitution of one-half the reporting limit is utilized in the statistical analysis. The reporting limit utilized for non-detects is the most recent practical quantification limit (PQL) as reported by the laboratory.
- When data contain between 15-50% non-detects, the Kaplan-Meier non-detect adjustment is applied to the background data for parametric limits. This technique adjusts the mean and standard deviation of the historical concentrations to account for concentrations below the reporting limit.
- Nonparametric prediction limits are used on data containing greater than 50% non-detects.

Natural systems continuously evolve due to physical changes made to the environment and unrelated to the site. Examples include capping a landfill, paving areas near a well, or lining a drainage channel to prevent erosion. Periodic updating of background statistical limits is necessary to accommodate these types of changes. Because this site is currently in Assessment Monitoring, upgradient well data for Appendix III constituents are carefully screened for any new outliers and interwell prediction limits are updated each sample event.

When newer measurements are representative of earlier measurements, the concentrations are incorporated into background. Improved sample size results in statistical limits that provide better representation of the true background population. In some cases, the earlier portion of records may require deselection prior to construction of limits to provide sensitive limits that are representative of present-day groundwater quality conditions and will rapidly detect changes in downgradient wells. Even though the data are excluded from the calculation, the values will continue to be reported and shown in tables and graphs. A summary of records with truncated data sets will be provided should this step be necessary in the future.

Summary of Background Screening through October 2022 – Appendix III Constituents

Outlier Testing

During the initial background screening conducted in February 2023, Tukey's box plot method was used to evaluate potential outliers through the October 2022 sample event for Appendix III constituents on pooled upgradient well data and at each downgradient well. No outliers were identified for any of the Appendix III constituents; therefore, no values were flagged.

Seasonality

No seasonal patterns were visually apparent in any of the detected data; therefore, no deseasonalizing adjustments were made to the data. When seasonal patterns are observed, data may be optionally deseasonalized so that the resulting limits will correctly account for the seasonality as a predictable pattern rather than random variation or a release.

Determination of Statistical Methods

The Analysis of Variance (ANOVA) was used to identify the most appropriate statistical approach based on observed groundwater quality upgradient of the Closed Gypsum Pond. Interwell tests, which compare downgradient well data to statistical limits constructed from pooled upgradient well data, are appropriate when average concentrations are similar across upgradient wells. Intrawell tests, which compare compliance data from a single well to screened historical data within the same well, are appropriate when upgradient wells exhibit spatial variation; when statistical limits constructed from upgradient wells would not be conservative (i.e., lower) from a regulatory perspective; and when downgradient water quality is unimpacted compared to upgradient water quality for the same parameters.

In cases where downgradient concentrations are elevated relative to upgradient concentrations, an independent study and hydrogeological investigation would be required to identify local geochemical conditions and expected groundwater quality for the region to justify an intrawell approach. Such an assessment is beyond the scope of services provided by Groundwater Stats Consulting.

The ANOVA noted variation in groundwater quality among upgradient wells for boron, calcium, chloride, fluoride, pH, and sulfate. No variation was identified between upgradient wells for TDS, making this constituent eligible for interwell prediction limits. For all other Appendix III constituents, the results of the ANOVA indicated intrawell methods should be considered for these parameters if no pre-existing impacts from the unit are suspected in downgradient wells. Additional testing was conducted as described below to determine intrawell eligibility.

Intrawell limits constructed from carefully screened background data from within each well serve to provide statistical limits that are conservative (i.e., lower) from a regulatory perspective, and that will rapidly identify a change in more recent compliance data from within a given well. This statistical method removes the element of variation from across wells and eliminates the chance of mistaking spatial variation for a release from the facility. Prior to performing intrawell prediction limits, it is necessary to demonstrate that groundwater at downgradient wells is not suspected to have existing impacts from the practices of the facility.

In order to establish baseline upgradient well concentrations, tolerance limits (either parametric or nonparametric as appropriate, depending on the distribution of the data sets) were constructed using pooled upgradient well data for each of the Appendix III

parameters recommended for intrawell analyses. Parametric tolerance limits were constructed with a target of 99% confidence and 95% coverage. The confidence and coverage levels for nonparametric tolerance limits are dependent upon the number of background samples. As more data are collected, the background population is better represented and the confidence and coverage levels increase.

To determine whether average downgradient concentrations are elevated relative to the upgradient well baseline concentrations established by the tolerance limits above, confidence intervals were constructed on downgradient wells for each of the Appendix III parameters exhibiting spatial variation. The results showed that at least one confidence interval exceeded its respective limit for each of the parameters tested.

When the entire confidence interval exceeds a background standard, it is an indication that downgradient concentrations are elevated above background levels. Therefore, interwell methods are recommended initially in lieu of intrawell methods until further research identifies whether the elevated downgradient concentrations are likely the result of natural geological conditions, an off-site source, or may be the result of the facility. After such a study, data would be re-evaluated to determine the most appropriate statistical method.

Trend Testing – Upgradient Wells

The Sen's Slope/Mann Kendall trend test was used to evaluate pooled upgradient well data to identify statistically significant increasing or decreasing trends. Statistically significant increasing trending data are typically not included as part of the background data used for construction of interwell prediction limits. Truncating data sets in upgradient wells to eliminate trends reduces variation in background and results in statistical limits representative of present-day groundwater quality concentrations. When statistically significant decreasing trends are present, earlier data are evaluated to determine whether historic concentration levels are significantly higher than current reported concentrations and will be deselected as necessary. When the historical records of data are truncated for the reasons above, a summary report will be provided to show the date ranges used in construction of the statistical limits.

The results of the trend analyses identified the following statistically significant trends:

Increasing:

- Chloride: CBW-1

Decreasing:

- Calcium: PM-1
- Fluoride: CBW-1
- Sulfate: PM-1

These trends are relatively low in magnitude when compared to average concentrations within these wells; therefore, no adjustments were required to the data sets. No other statistically significant trends were identified for any of the Appendix III parameters.

Evaluation of Appendix III Constituents – June 2023 Event

Interwell Prediction Limits

Interwell prediction limits were constructed as recommended in the CCR Rule (2015) and in the EPA Unified Guidance (2009), based on a 1-of-2 resample plan, using pooled upgradient well data from wells CBW-1 and PM-1 for boron, calcium, chloride, fluoride, pH, sulfate, and TDS through June 2023 sample event (Figure D).

The June 2023 samples from each downgradient well were compared to the respective statistical limits. In the event of an initial exceedance of compliance well data, a resample may be collected to determine whether the initial exceedance is confirmed, in which case a statistically significant increase (SSI) is identified. If the resample falls within the statistical limit, the initial exceedance is considered to be a false positive result; therefore, no further action is necessary.

Parametric prediction limits were constructed when background data followed a normal or transformed-normal distribution. Non-parametric prediction limits are provided for data sets with greater than 50% non-detects, and for data sets which do not follow a normal or transformed-normal distribution. Downgradient measurements were compared to these background limits. Exceedances were noted for the majority of interwell prediction limits which may be seen on the summary tables following this letter.

Trend Tests - Exceedances

When an exceedance occurs in a downgradient well, the exceedance is further evaluated using the Sen's Slope/Mann Kendall trend test at the 99% confidence level. Upgradient wells are included in the trend analyses to identify whether similar patterns exist upgradient of the site (Figure E). Statistically significant trends were identified for the following well/constituent pairs:

Increasing

- Chloride: CBW-1 (upgradient)

Decreasing

- Boron: CGYP-4
- Calcium: PM-1 (upgradient), CGYP-2, and CGYP-4
- Chloride: CGYP-2 and CGYP-4
- Fluoride: CBW-1 (upgradient)
- Sulfate: PM-1 (upgradient)
- TDS: CGYP-4

Summary of Background Screening through October 2022 – Appendix IV Constituents

During the initial background screening conducted in February 2023, upgradient well data were screened through October 2022 for Appendix IV constituents using visual screening to identify whether seasonal patterns or trends are present that would lead to artificially elevated statistical limits. All upgradient well data appear stable for the Appendix IV constituents.

Tukey's outlier test on pooled upgradient well data through October 2022 identified outliers for cobalt and lead; however, these values were not flagged as outliers since the measurements were either similar to remaining measurements within the records or were less than the established Maximum Contaminant Limits (MCLs). The highest reported observation of 16.3 pCi/L for combined radium 226+228 was not identified as an outlier by Tukey's test, therefore, this measurement was not flagged as an outlier at the time of the screening. If further research indicates this measurement is not representative of groundwater quality upgradient of the facility it will be flagged as an outlier.

Additionally, downgradient well data through October 2022 were screened through visual screening and Tukey's test. Since the downgradient well data are used to construct confidence intervals, a regulatory conservative approach is taken in that values that are marginally high relative to the rest of the data are retained unless there is particular justification for excluding them. Tukey's test identified a single value of 0.092 mg/L for lead in well CGYP-3 which was flagged as an outlier in the database since all remaining measurements were less than 0.036 mg/L. While the test identified an outlier for mercury in well CGYP-3, this measurement was not flagged as an outlier since the concentration was significantly lower than the established MCL. The test also identified a low outlier for

selenium in well CGYP-3 which was a reported trace value; therefore, the measurement was not flagged in the database.

Interwell Upper Tolerance Limits

Interwell upper tolerance limits are used to calculate background limits from all available pooled upgradient well data for Appendix IV parameters to determine the background limit for each constituent. Per your request, the interwell upper tolerance limits utilized in this analysis were constructed by Haley & Aldrich, Inc. in the 2022 Annual Groundwater Monitoring and Corrective Action Report for the Closed Gypsum Pond Cross Generating Station. Upgradient well data will be re-evaluated in future analyses for construction of interwell tolerance limits.

Groundwater Protection Standards

Interwell upper tolerance limits were compared to the MCLs and CCR-Rule specified levels in the Groundwater Protection Standard (GWPS) table following this letter to determine the highest limit for use as the GWPS in the Confidence Interval comparisons (Figure F).

Evaluation of Appendix IV Parameters – June 2023 Event

Prior to evaluating Appendix IV parameters, background data were reviewed through visual screening at upgradient wells for potential outliers and extreme trending patterns that would lead to artificially elevated statistical limits. No additional outliers were flagged during this analysis and a list of outliers follows this report (Figure C).

Confidence Intervals

Confidence intervals were then constructed on downgradient wells with data through June 2023 for each of the Appendix IV parameters using the highest limit of the MCL, the CCR-Rule specified levels, or background limits as discussed above (Figure G). Well/constituent pairs containing 100% non-detects do not require statistical analyses; therefore, no confidence intervals were required for antimony, molybdenum, and thallium. As mentioned above, well CGYP-7 was not evaluated with confidence intervals due to not having the required number of observations.

These intervals were constructed as either parametric or nonparametric confidence intervals depending on the data distribution and percentage of non-detects. When data followed a normal or transformed-normal distribution, parametric confidence intervals

were used for Appendix IV parameters. The lower confidence limit, which is constructed with 99% confidence for parametric confidence intervals, is compared to the GWPS prepared as described above. Nonparametric confidence intervals were constructed when data did not follow a normal or transformed-normal distribution or when there were greater than 50% non-detects. The confidence level associated with nonparametric confidence intervals is dependent upon the number samples available.

Only when the entire confidence interval is above a GWPS is the well/constituent pair considered to exceed its respective standard. A summary of the confidence interval results follows this letter. Exceedances were identified for the following well/constituent pairs:

- Beryllium: CGYP-1, CGYP-3, CGYP-4, and CGYP-6
- Cobalt: CGYP-1, CGYP-2, CGYP-3, CGYP-4, and CGYP-6
- Lead: CGYP-2 and CGYP-3
- Lithium: CGYP-3, CGYP-4, and CGYP-6

Thank you for the opportunity to assist you in the statistical analysis of groundwater quality for the Closed Gypsum Pond. If you have any questions or comments, please feel free to contact us.

Sincerely,



Andrew T. Collins
Project Manager



Kristina L. Rayner
Senior Statistician

100% Non-Detects: Appendix IV Downgradient

Analysis Run 9/13/2023 12:00 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Antimony (mg/L)

CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-7

Arsenic (mg/L)

CGYP-6

Chromium (mg/L)

CGYP-1, CGYP-2, CGYP-4, CGYP-6, CGYP-7

Mercury (mg/L)

CGYP-2, CGYP-4, CGYP-6, CGYP-7

Molybdenum (mg/L)

CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-7

Selenium (mg/L)

CGYP-6

Thallium (mg/L)

CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-7

Appendix III Intrawell Prediction Limits - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 10/24/2023, 10:35 AM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-3	0.836	n/a	6/7/2023	16.7	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.836	n/a	6/7/2023	5.53	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.836	n/a	6/7/2023	8.85	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.33	n/a	6/6/2023	181	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.33	n/a	6/7/2023	254	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.33	n/a	6/7/2023	508	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.33	n/a	6/7/2023	254	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.33	n/a	6/7/2023	486	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	6/6/2023	679	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	6/7/2023	55.9	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	6/7/2023	872	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	6/7/2023	353	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	6/7/2023	1070	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	6/6/2023	0.89	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	6/7/2023	0.53	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	6/7/2023	1.6	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	6/7/2023	1.16	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	6/7/2023	0.68	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	6/7/2023	4	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	6/7/2023	3.67	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	6/7/2023	3.74	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	6/6/2023	282	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	6/7/2023	904	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	6/7/2023	964	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	6/7/2023	538	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	6/7/2023	129	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	199.3	n/a	6/6/2023	1584	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	199.3	n/a	6/7/2023	1451	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	199.3	n/a	6/7/2023	2906	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	199.3	n/a	6/7/2023	1445	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	199.3	n/a	6/7/2023	2774	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2

Appendix III Intrawell Prediction Limits - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 10/24/2023, 10:35 AM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.836	n/a	6/6/2023	0.191	No	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.836	n/a	6/7/2023	0.781	No	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.836	n/a	6/7/2023	16.7	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.836	n/a	6/7/2023	5.53	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.836	n/a	6/7/2023	8.85	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.33	n/a	6/6/2023	181	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.33	n/a	6/7/2023	254	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.33	n/a	6/7/2023	508	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.33	n/a	6/7/2023	254	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.33	n/a	6/7/2023	486	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	6/6/2023	679	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	6/7/2023	55.9	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	6/7/2023	872	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	6/7/2023	353	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	6/7/2023	1070	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	6/6/2023	0.89	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	6/7/2023	0.53	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	6/7/2023	1.6	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	6/7/2023	1.16	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	6/7/2023	0.68	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	6/6/2023	4.66	No	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	6/7/2023	4	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	6/7/2023	3.67	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	6/7/2023	4.13	No	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	6/7/2023	3.74	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	6/6/2023	282	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	6/7/2023	904	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	6/7/2023	964	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	6/7/2023	538	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	6/7/2023	129	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	199.3	n/a	6/6/2023	1584	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	199.3	n/a	6/7/2023	1451	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	199.3	n/a	6/7/2023	2906	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	199.3	n/a	6/7/2023	1445	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	199.3	n/a	6/7/2023	2774	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2

Appendix III Trend Tests Summary - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 9/13/2023, 11:48 AM

Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CGYP-4	-1.341	-45	-38	Yes	12	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-29.67	-77	-63	Yes	17	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-58.84	-49	-38	Yes	12	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-0.9956	-124	-105	Yes	24	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1118	119	105	Yes	24	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-2	-31.73	-66	-63	Yes	17	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-175.8	-64	-38	Yes	12	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.0184	-141	-92	Yes	22	4.545	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-0.9811	-129	-105	Yes	24	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-337.2	-45	-38	Yes	12	0	n/a	n/a	0.01	NP

Appendix III Trend Tests Summary - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 9/13/2023, 11:48 AM

Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CBW-1 (bg)	-0.0008105	-80	-98	No	23	8.696	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-3	-0.4473	-24	-63	No	17	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-4	-1.341	-45	-38	Yes	12	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-6	-0.4909	-8	-38	No	12	0	n/a	n/a	0.01	NP
Boron (mg/L)	PM-1 (bg)	0	-26	-92	No	22	40.91	n/a	n/a	0.01	NP
Calcium (mg/L)	CBW-1 (bg)	0.616	76	98	No	23	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-1	-15.74	-31	-63	No	17	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-29.67	-77	-63	Yes	17	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-3	-49.87	-41	-63	No	17	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-58.84	-49	-38	Yes	12	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-6	-28.17	-8	-38	No	12	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-0.9956	-124	-105	Yes	24	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1118	119	105	Yes	24	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-1	16.67	32	63	No	17	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-2	-31.73	-66	-63	Yes	17	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-3	-71.52	-30	-63	No	17	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-175.8	-64	-38	Yes	12	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-6	-42.75	-17	-38	No	12	0	n/a	n/a	0.01	NP
Chloride (mg/L)	PM-1 (bg)	-0.02275	-30	-105	No	24	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.0184	-141	-92	Yes	22	4.545	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-1	0.06613	11	63	No	17	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-2	0.0109	2	63	No	17	11.76	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-3	0.0979	12	63	No	17	5.882	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-4	-0.7591	-38	-38	No	12	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-6	-0.1695	-24	-38	No	12	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	PM-1 (bg)	0	0	92	No	22	100	n/a	n/a	0.01	NP
pH, Field (pH units)	CBW-1 (bg)	0	5	105	No	24	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-2	0.07081	33	63	No	17	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-3	-0.04801	-19	-63	No	17	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-6	0.04556	11	38	No	12	0	n/a	n/a	0.01	NP
pH, Field (pH units)	PM-1 (bg)	-0.005573	-17	-131	No	28	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CBW-1 (bg)	0.8675	33	105	No	24	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-1	-16.42	-10	-63	No	17	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-2	-2.969	-5	-63	No	17	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-3	2.169	4	63	No	17	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-4	-29.27	-26	-38	No	12	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-6	22.22	29	38	No	12	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-0.9811	-129	-105	Yes	24	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CBW-1 (bg)	3.648	47	105	No	24	4.167	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-1	-14.69	-12	-63	No	17	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-2	-47.58	-57	-63	No	17	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-3	-245	-44	-63	No	17	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-337.2	-45	-38	Yes	12	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-6	-123.9	-6	-38	No	12	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	PM-1 (bg)	-2.923	-62	-131	No	28	3.571	n/a	n/a	0.01	NP

CYGP GWPS				
Constituent Name	MCL	CCR-Rule Specified	Background Limit	GWPS
Antimony, Total (mg/L)	0.006		0.025	0.025
Arsenic, Total (mg/L)	0.01		0.016	0.016
Barium, Total (mg/L)	2		0.103	2
Beryllium, Total (mg/L)	0.004		0.00063	0.004
Cadmium, Total (mg/L)	0.005		0.0005	0.005
Chromium, Total (mg/L)	0.1		0.014	0.1
Cobalt, Total (mg/L)		0.006	0.0034	0.006
Combined Radium 226 + 228 (pCi/L)	5		16.3	16.3
Fluoride, Total (mg/L)	4		0.3	4
Lead, Total (mg/L)		0.015	0.011	0.015
Lithium, Total (mg/L)		0.04	0.01	0.04
Mercury, Total (mg/L)	0.002		0.0006	0.002
Molybdenum, Total (mg/L)		0.1	0.01	0.1
Selenium, Total (mg/L)	0.05		0.02	0.05
Thallium, Total (mg/L)	0.002		0.001	0.002

*GWPS = Groundwater Protection Standard

*MCL = Maximum Contaminant Limit

*CCR = Coal Combustion Residuals

Shaded cells indicate background limit is higher than established MCL.

Appendix IV Confidence Intervals - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 10/16/2023, 1:16 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	%NDs	ND Adj.	Transform	Alpha	Method
Beryllium (mg/L)	CGYP-1	0.0112	0.0045	0.004	Yes	16	0	None	No	0.01	NP (normality)
Beryllium (mg/L)	CGYP-3	0.03854	0.02589	0.004	Yes	16	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01723	0.01478	0.004	Yes	12	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02679	0.02056	0.004	Yes	12	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.04995	0.03385	0.006	Yes	16	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.028	0.0183	0.006	Yes	16	0	None	No	0.01	NP (normality)
Cobalt (mg/L)	CGYP-3	0.1331	0.0838	0.006	Yes	16	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.04963	0.03411	0.006	Yes	12	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1656	0.1302	0.006	Yes	12	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-2	0.02447	0.01904	0.015	Yes	16	6.25	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.02936	0.02076	0.015	Yes	15	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-3	0.09312	0.05577	0.04	Yes	16	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06872	0.0529	0.04	Yes	12	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1598	0.1143	0.04	Yes	12	0	None	No	0.01	Param.

Appendix IV Confidence Intervals - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 10/16/2023, 1:16 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	%NDs	ND Adj.	Transform	Alpha	Method
Arsenic (mg/L)	CGYP-1	0.03073	0.01306	0.016	No	16	6.25	None	No	0.01	Param.
Arsenic (mg/L)	CGYP-2	0.02144	0.01385	0.016	No	16	12.5	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-3	0.01861	0.01204	0.016	No	16	6.25	None	No	0.01	Param.
Arsenic (mg/L)	CGYP-4	0.01107	0.007594	0.016	No	12	8.333	None	x^4	0.01	Param.
Barium (mg/L)	CGYP-1	0.0549	0.037	2	No	16	0	None	sqrt(x)	0.01	Param.
Barium (mg/L)	CGYP-2	0.0327	0.01664	2	No	16	6.25	None	No	0.01	Param.
Barium (mg/L)	CGYP-3	0.04929	0.03335	2	No	16	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-4	0.03835	0.0269	2	No	12	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-6	0.6159	0.2819	2	No	12	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-1	0.0112	0.0045	0.004	Yes	16	0	None	No	0.01	NP (normality)
Beryllium (mg/L)	CGYP-2	0.004062	0.003157	0.004	No	16	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03854	0.02589	0.004	Yes	16	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01723	0.01478	0.004	Yes	12	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02679	0.02056	0.004	Yes	12	0	None	No	0.01	Param.
Cadmium (mg/L)	CGYP-1	0.0013	0.0005	0.005	No	16	87.5	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-2	0.001	0.0005	0.005	No	16	87.5	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-3	0.0009	0.0005	0.005	No	16	37.5	None	No	0.01	NP (normality)
Cadmium (mg/L)	CGYP-4	0.0008	0.0005	0.005	No	12	91.67	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-6	0.0006	0.0005	0.005	No	12	91.67	None	No	0.01	NP (NDs)
Chromium (mg/L)	CGYP-3	0.007021	0.005532	0.1	No	16	18.75	Kaplan-Meier	sqrt(x)	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.04995	0.03385	0.006	Yes	16	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.028	0.0183	0.006	Yes	16	0	None	No	0.01	NP (normality)
Cobalt (mg/L)	CGYP-3	0.1331	0.0838	0.006	Yes	16	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.04963	0.03411	0.006	Yes	12	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1656	0.1302	0.006	Yes	12	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-1	4.442	3.195	16.3	No	16	0	None	x^(1/3)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-2	3.1	1.907	16.3	No	16	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-3	6.288	4.689	16.3	No	16	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-4	5.476	3.107	16.3	No	12	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-6	7.227	4.003	16.3	No	12	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.167	0.8028	4	No	17	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.018	0.4856	4	No	17	11.76	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.146	1.183	4	No	17	5.882	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.219	1.047	4	No	12	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9424	0.5593	4	No	12	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-1	0.01613	0.006294	0.015	No	16	6.25	None	sqrt(x)	0.01	Param.
Lead (mg/L)	CGYP-2	0.02447	0.01904	0.015	Yes	16	6.25	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.02936	0.02076	0.015	Yes	15	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-4	0.0142	0.009554	0.015	No	12	8.333	None	No	0.01	Param.
Lead (mg/L)	CGYP-6	0.01391	0.008813	0.015	No	12	8.333	None	x^2	0.01	Param.
Lithium (mg/L)	CGYP-1	0.0247	0.01	0.04	No	16	25	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-2	0.015	0.005	0.04	No	16	31.25	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-3	0.09312	0.05577	0.04	Yes	16	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06872	0.0529	0.04	Yes	12	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1598	0.1143	0.04	Yes	12	0	None	No	0.01	Param.
Mercury (mg/L)	CGYP-1	0.0002	0.0002	0.002	No	16	93.75	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-3	0.00021	0.0002	0.002	No	16	81.25	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-1	0.0177	0.01	0.05	No	16	62.5	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-2	0.0113	0.0078	0.05	No	16	75	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-3	0.014	0.0067	0.05	No	16	81.25	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-4	0.01	0.00856	0.05	No	12	91.67	None	No	0.01	NP (NDs)


Table of Contents

Figure A. Time Series	20
Figure B. Box Plots	78
Figure C. Outlier Summary	90
Figure D. Appendix III Interwell Prediction Limits	92
Figure E. Appendix III Trend Tests	106
Figure F. GWPS Table	121
Figure G. Appendix IV Confidence Intervals	123

FIGURE A.


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

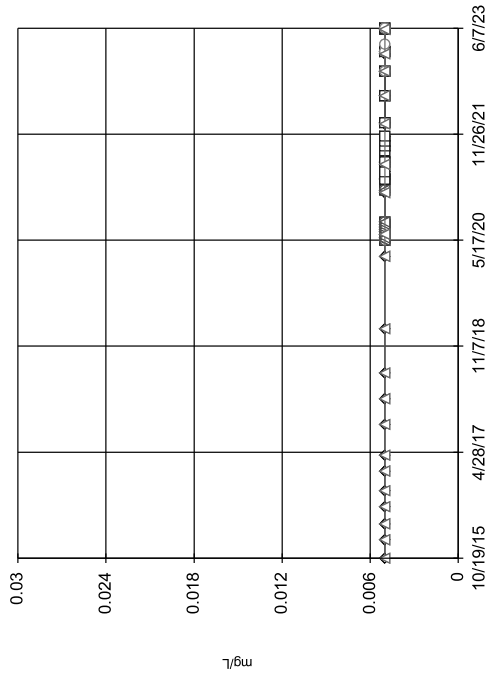


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

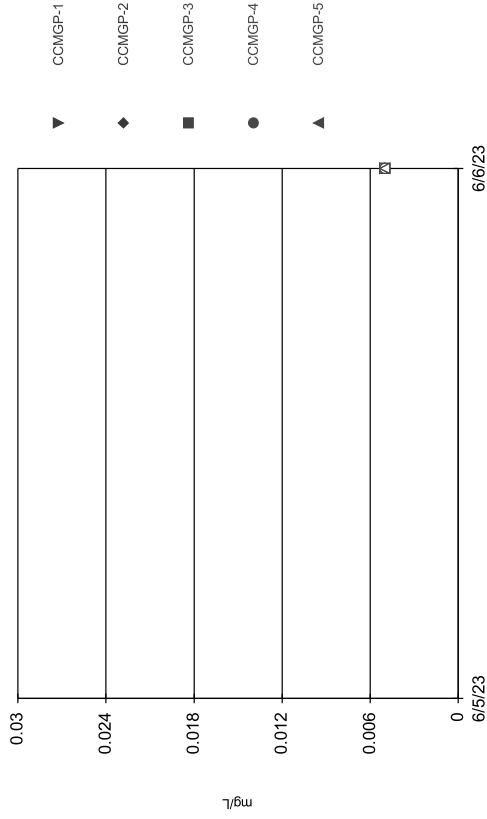


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

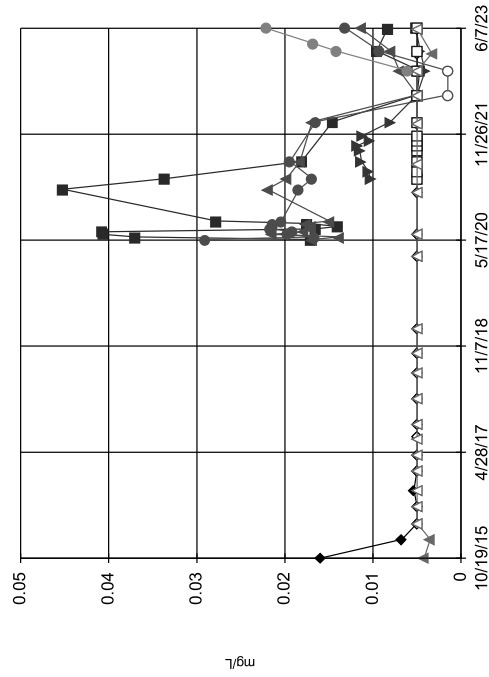


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

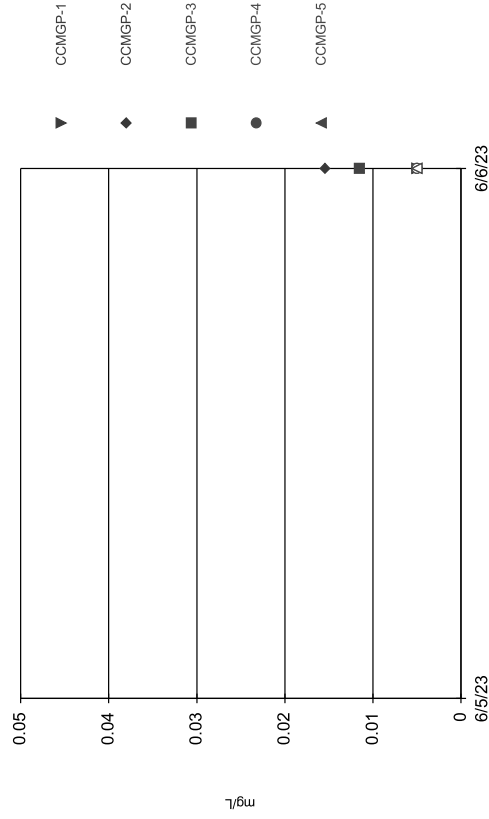


Time Series

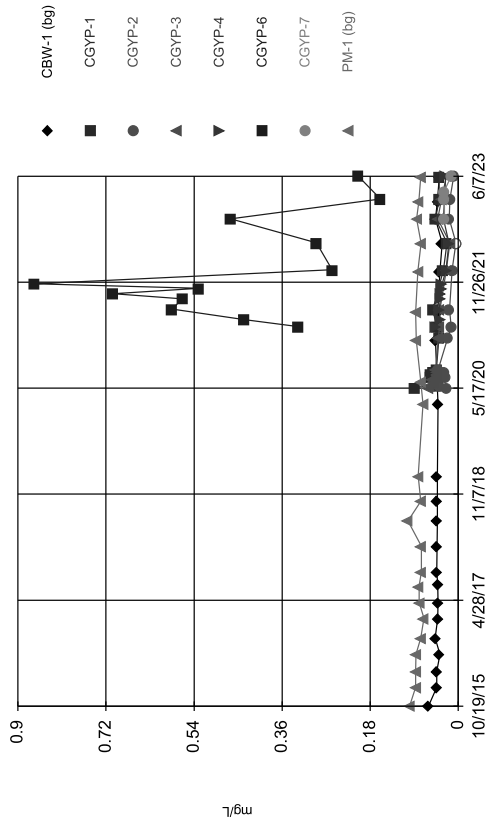


Constituent: Barium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

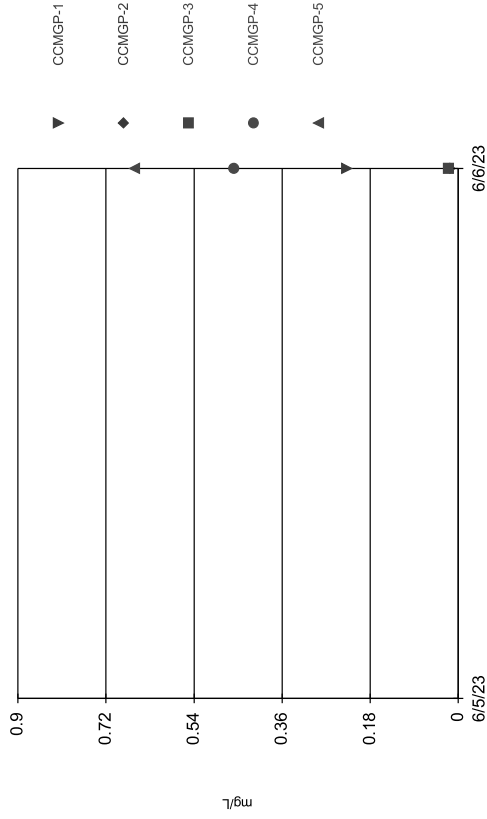


Constituent: Barium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

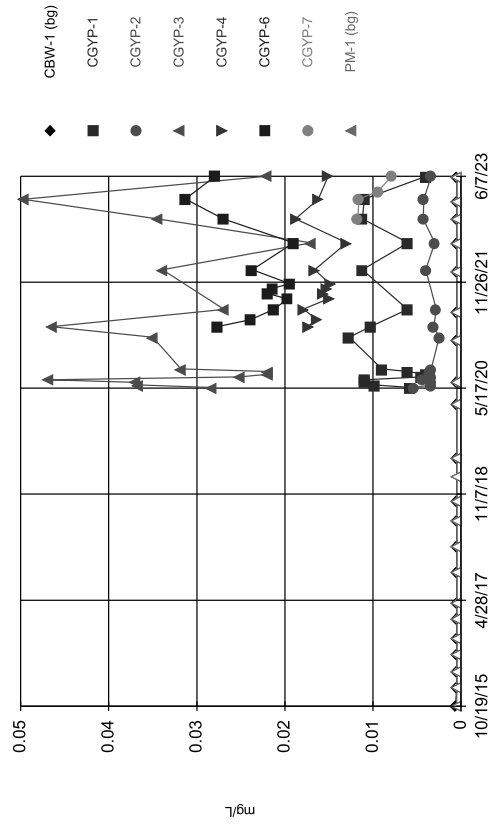


Constituent: Beryllium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

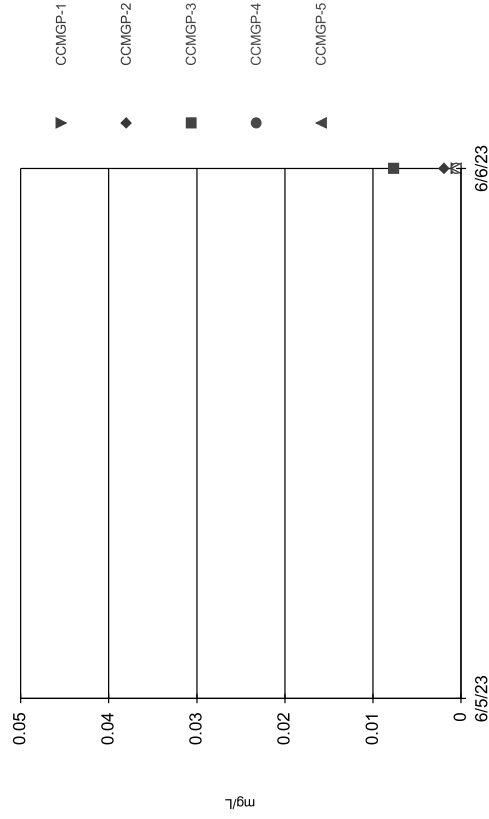


Constituent: Beryllium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

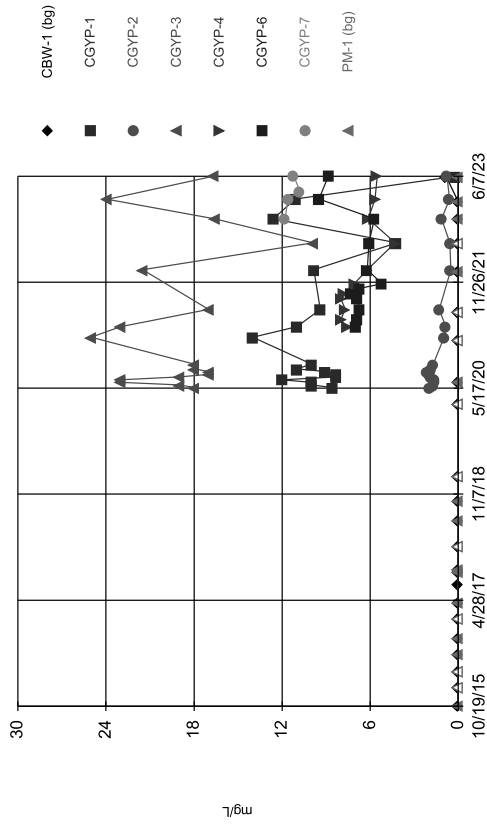


Constituent: Boron Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

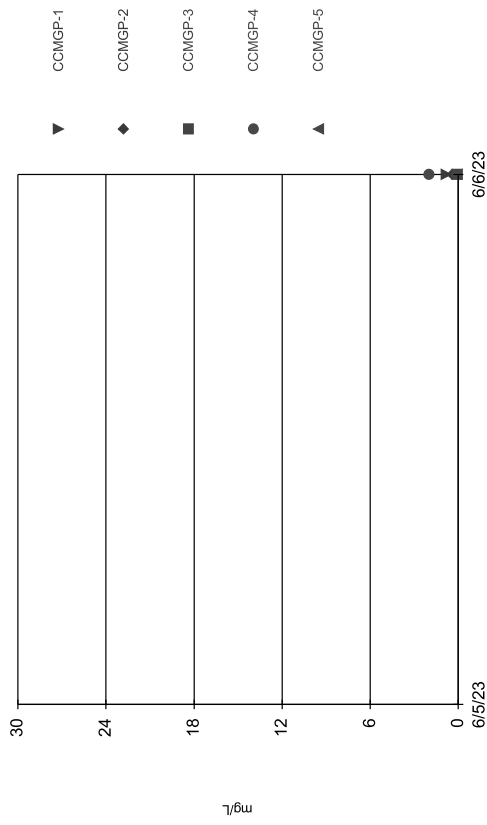


Constituent: Boron Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

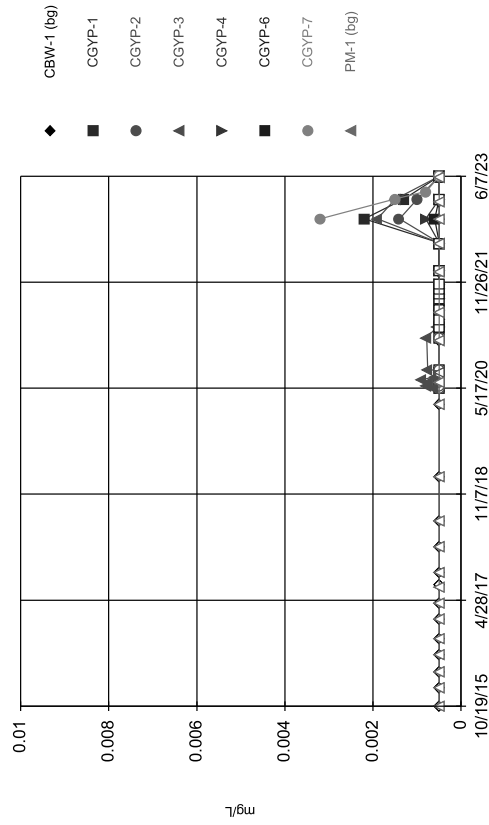


Constituent: Cadmium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

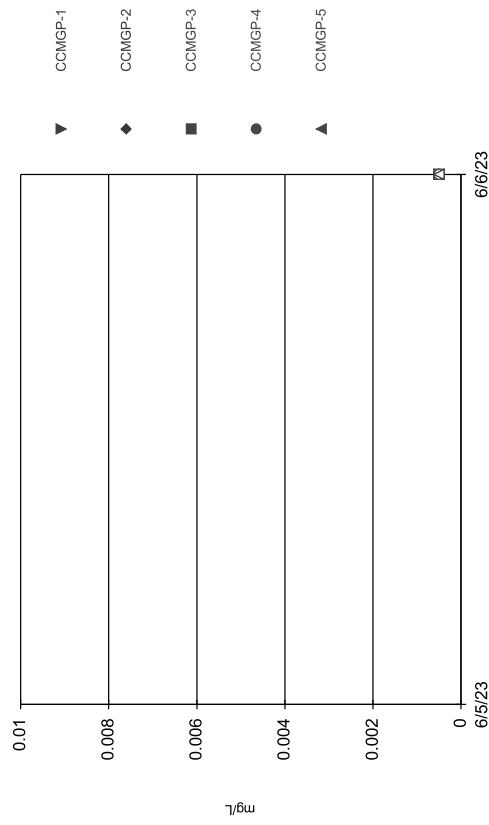


Constituent: Cadmium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

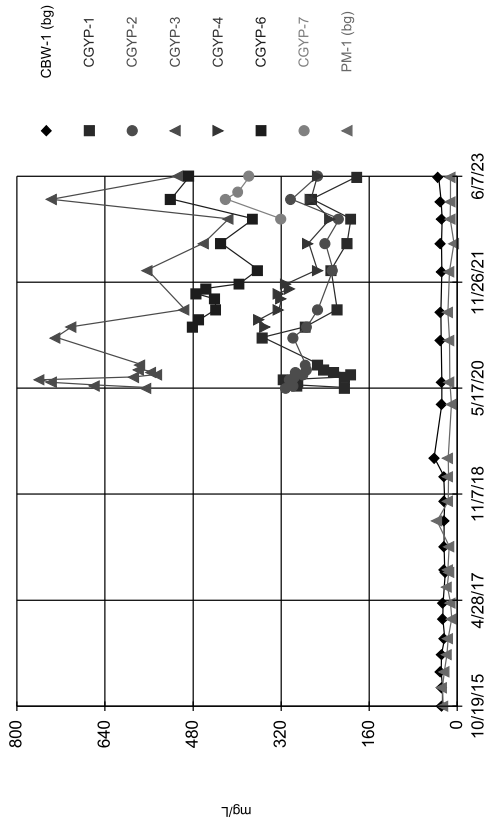


Constituent: Calcium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

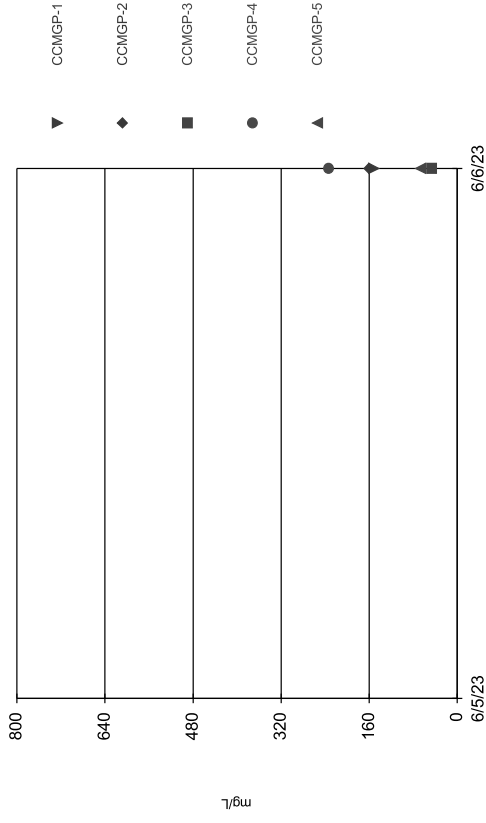


Constituent: Calcium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

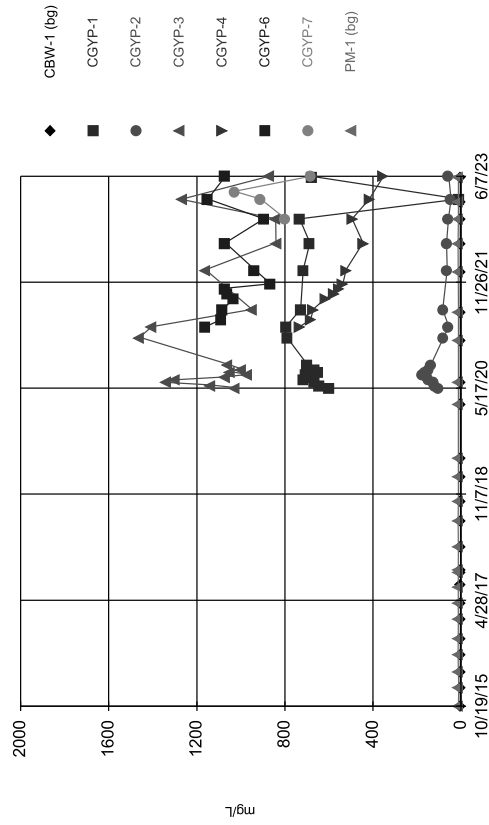

Constituent: Chloride Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP


Time Series

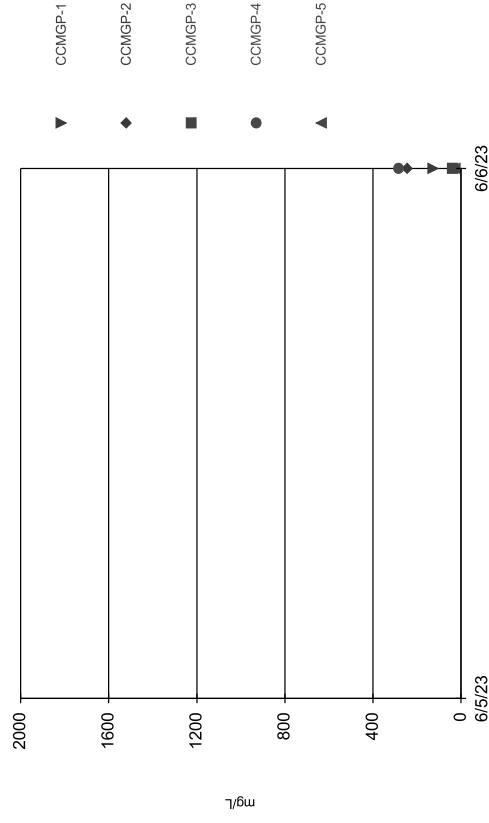

Constituent: Chloride Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

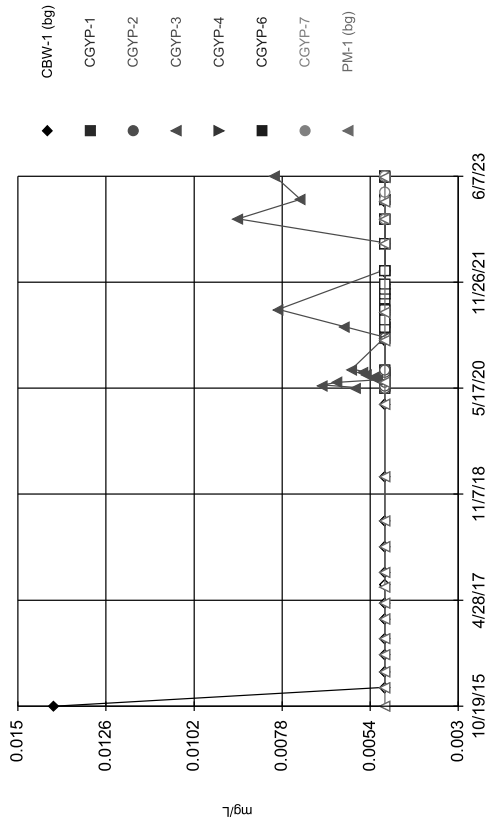


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

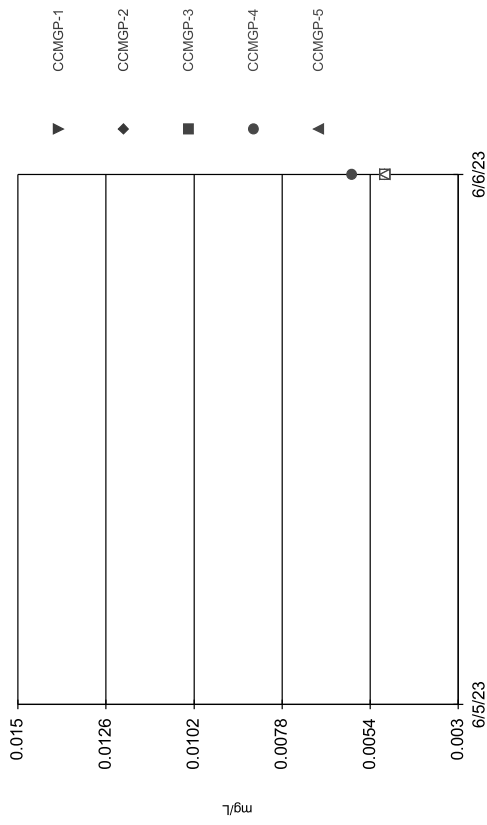


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

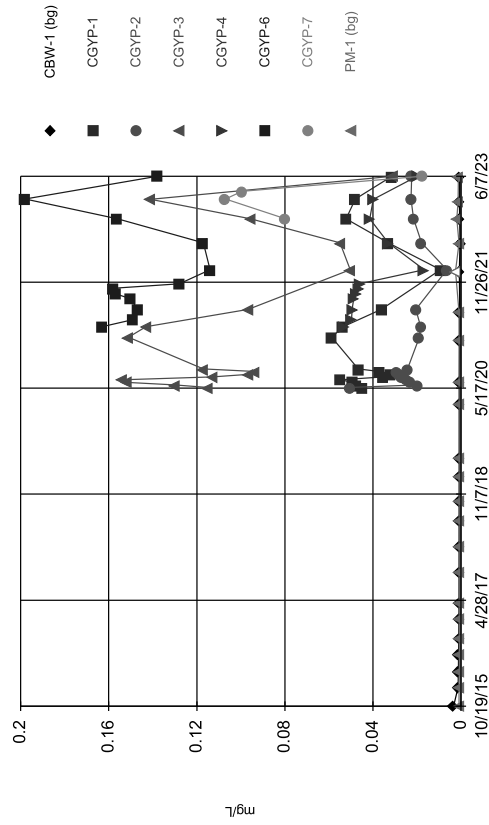


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

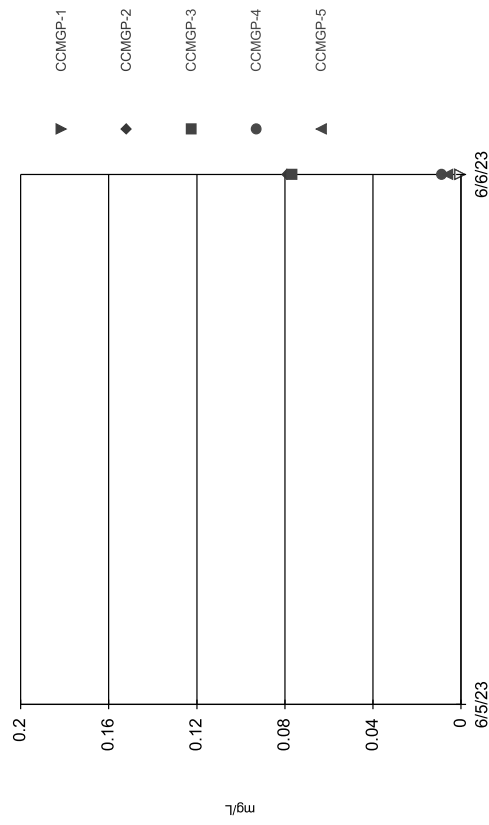


Time Series

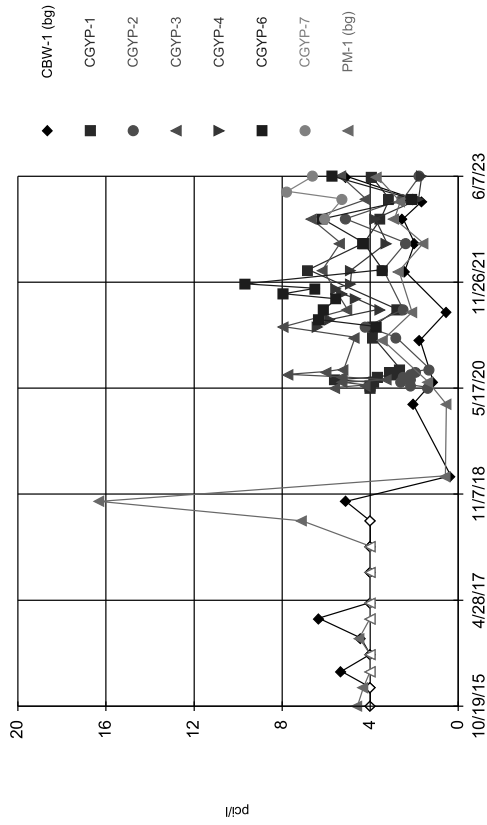


Constituent: Combined Radium 226 & 228 Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

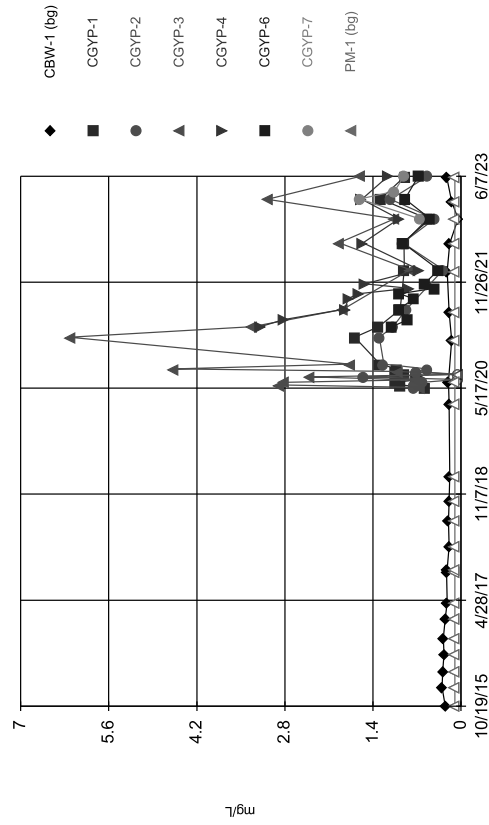


Constituent: Fluoride Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

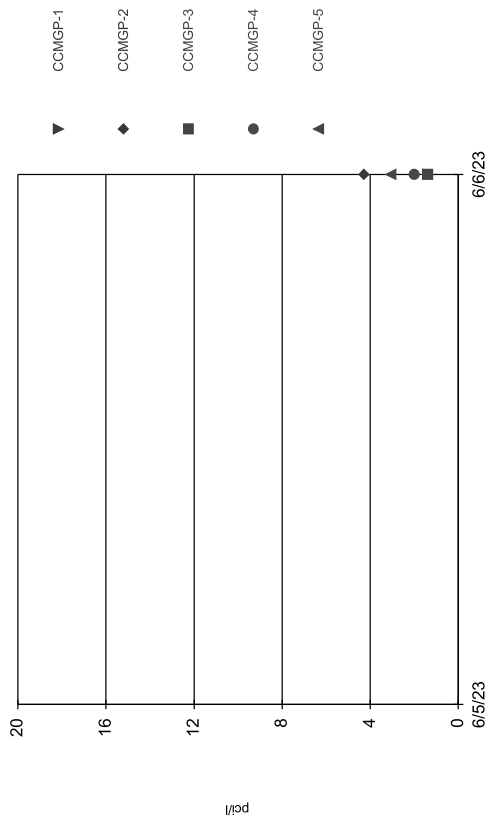

Constituent: Combined Radium 226 & 228 Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP


Time Series

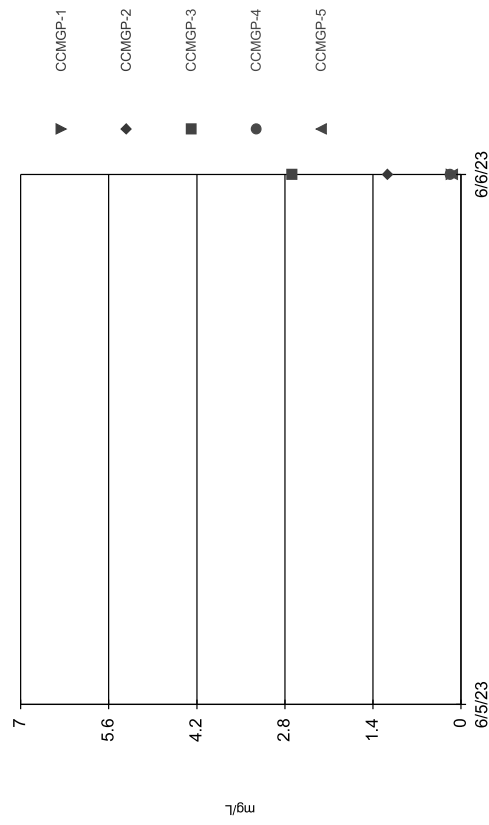

Constituent: Fluoride Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

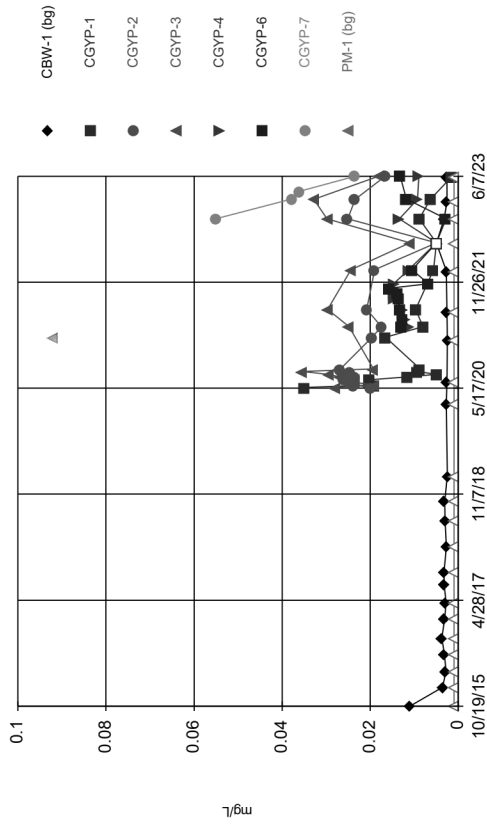


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

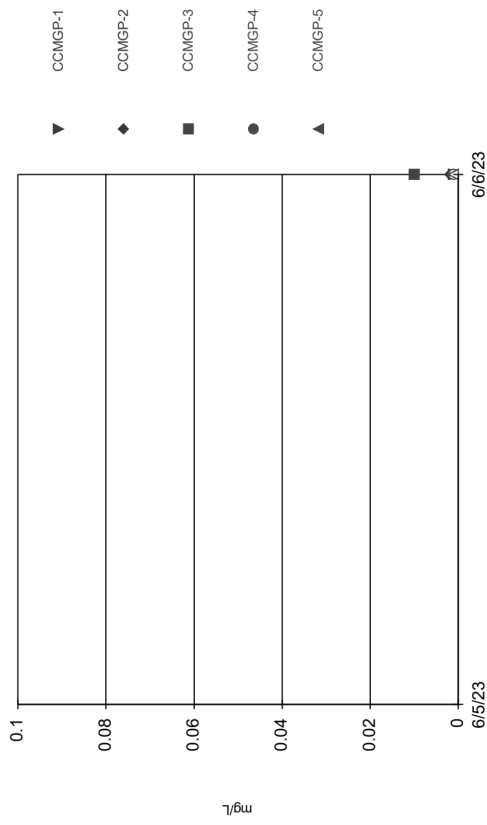


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

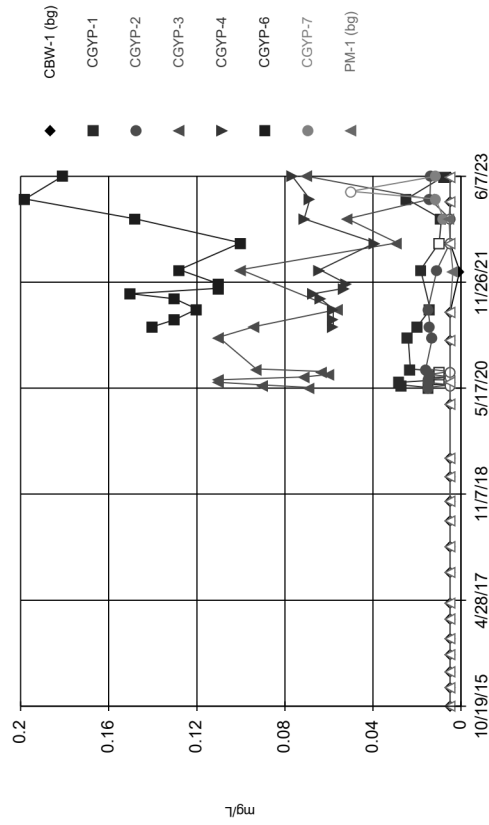


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

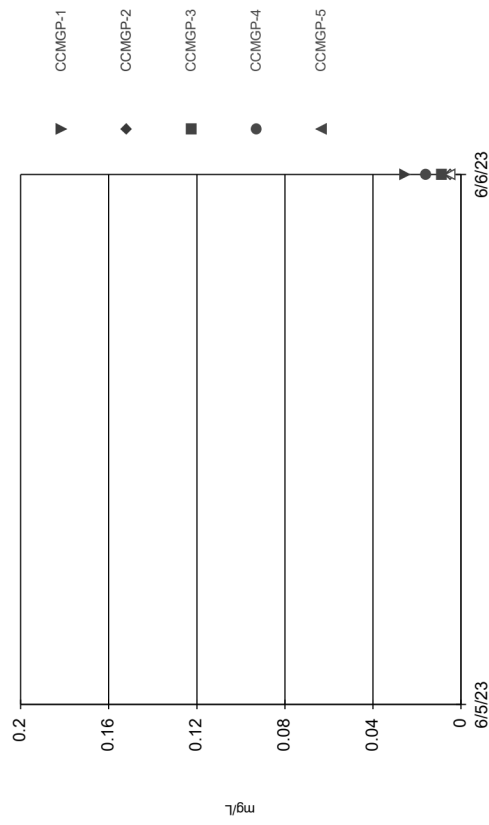


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

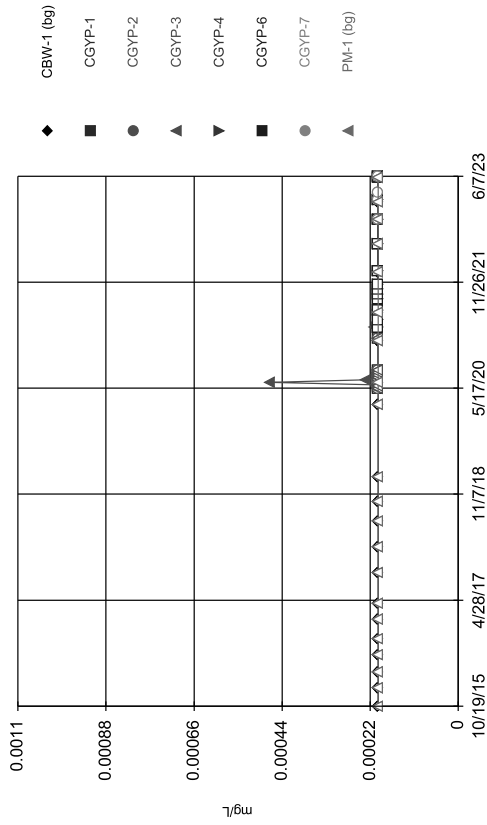


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

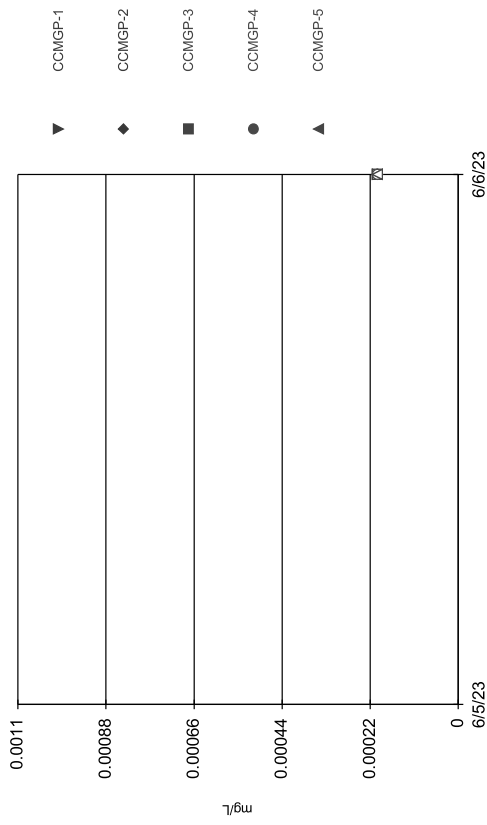


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

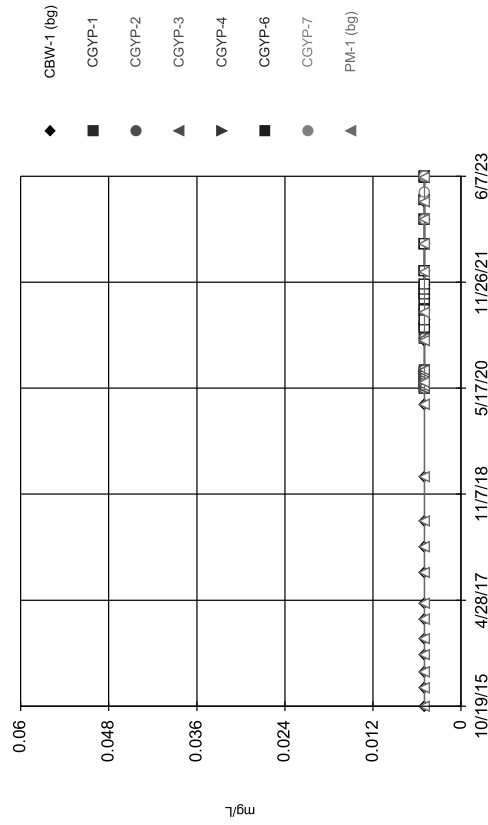


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

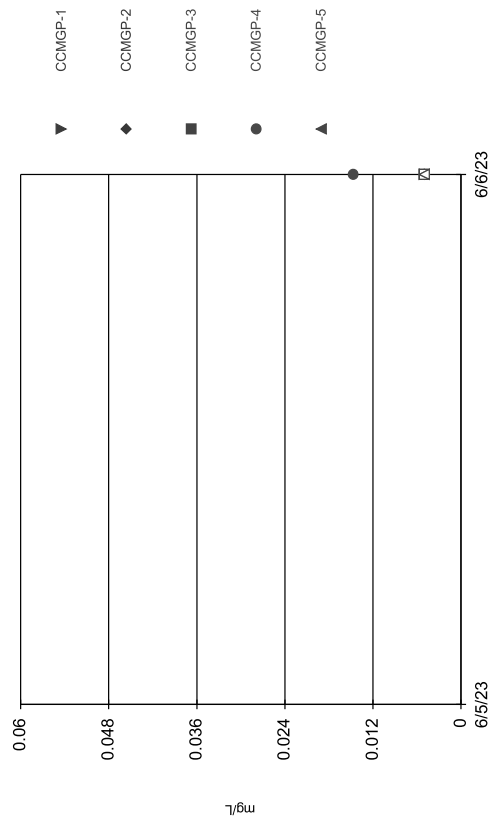


Time Series

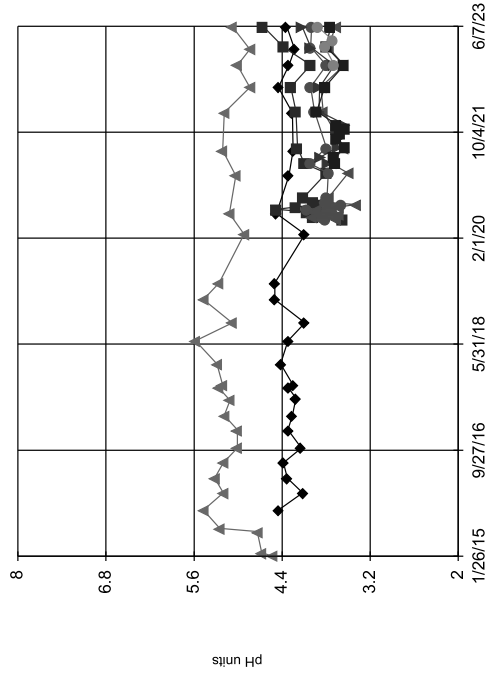


Constituent: pH, Field Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

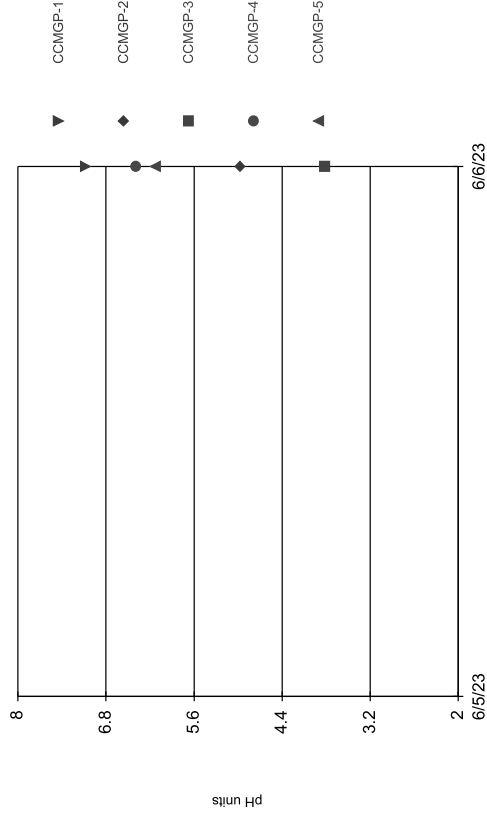


Constituent: pH, Field Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

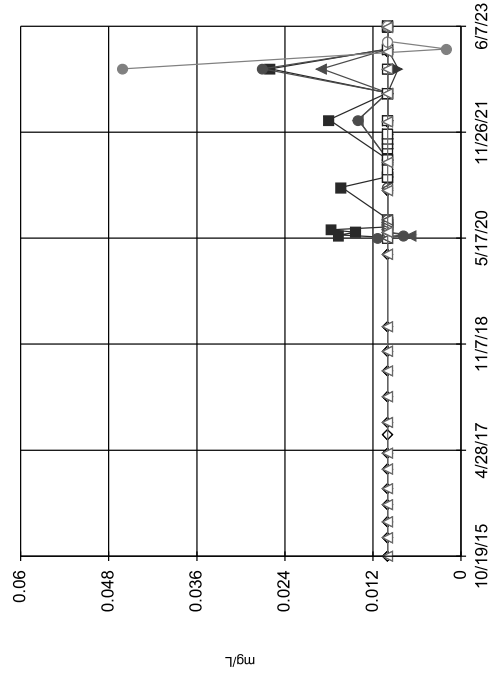


Constituent: Selenium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

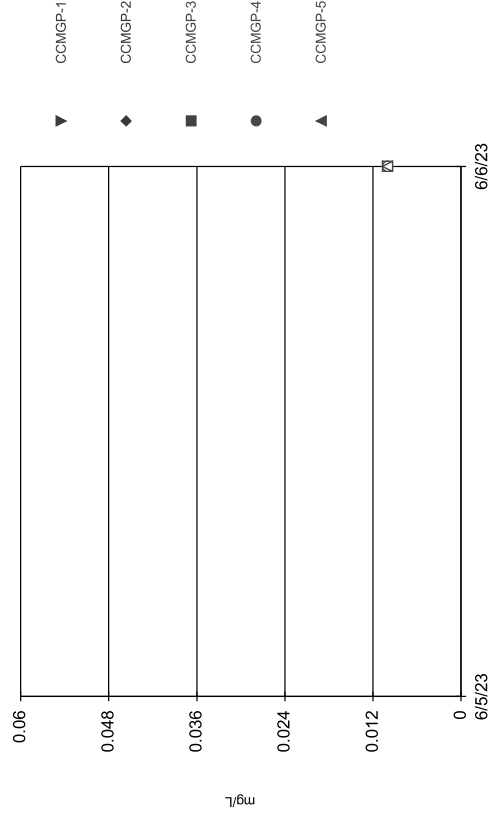


Constituent: Selenium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

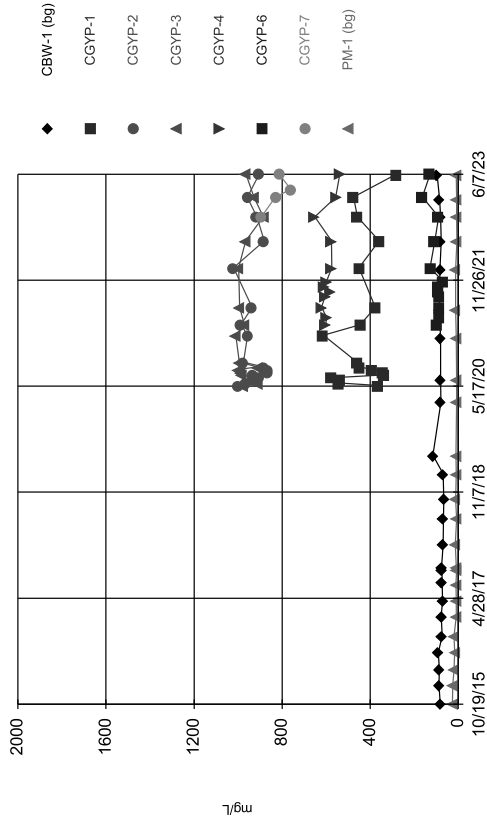


Constituent: Sulfate Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

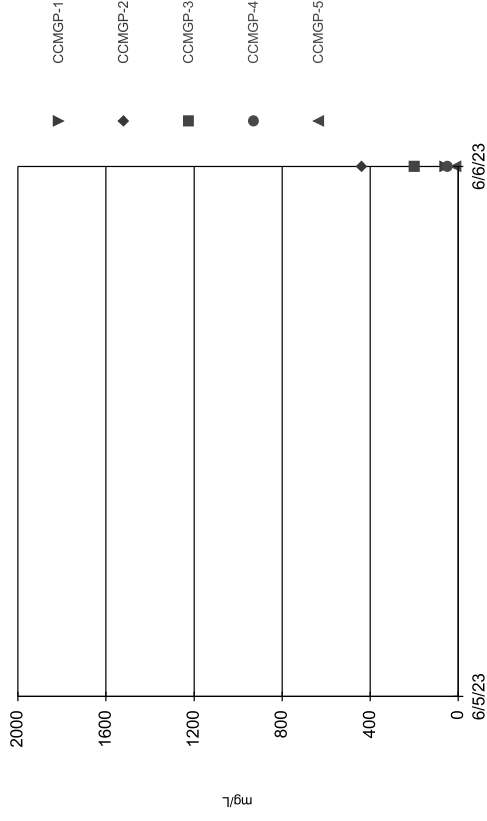


Constituent: Sulfate Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

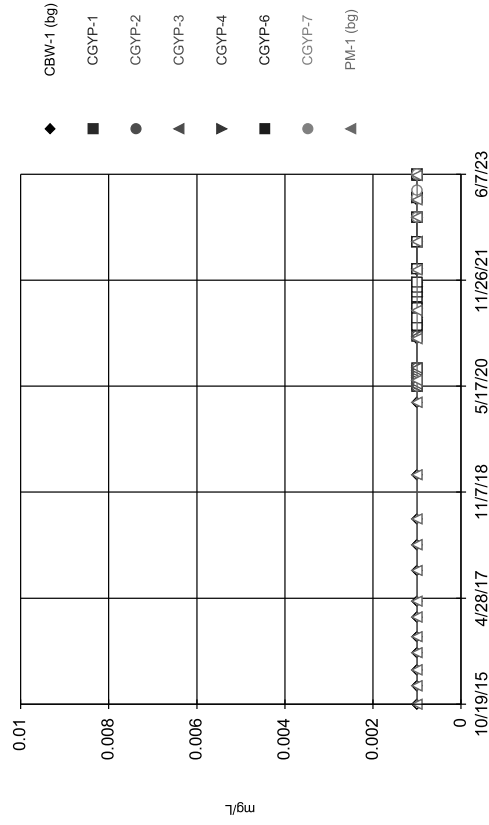


Constituent: Thallium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

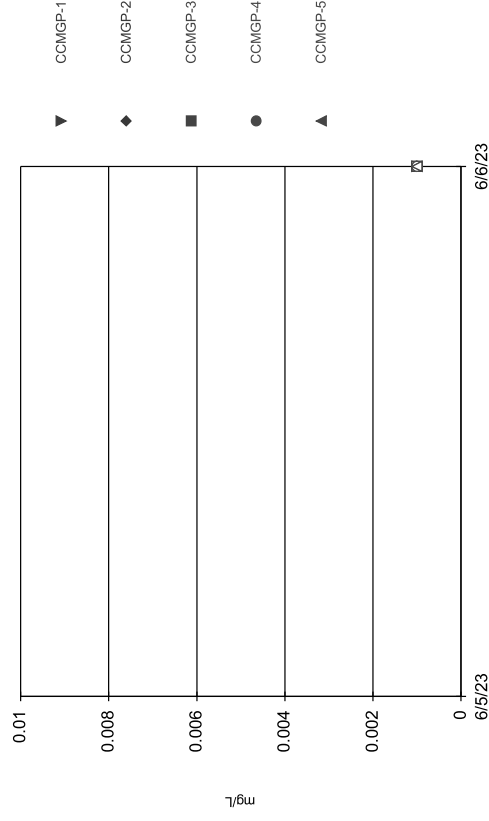


Constituent: Thallium Analysis Run 9/13/2023 11:34 AM
CGYP Client: Santee Cooper Data: CGYP

Time Series

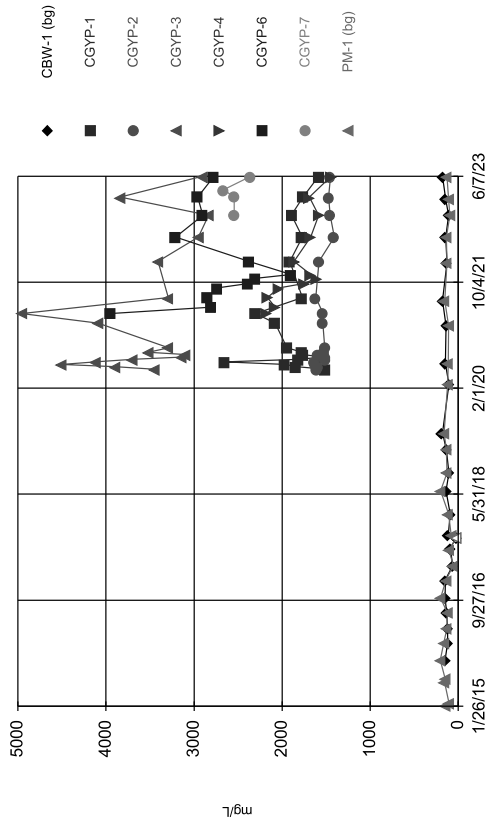

Constituent: Total Dissolved Solids - Analysis Run 9/13/2023 11:34 AM
 CGYP Client: Santee Cooper Data: CGYP

Time Series

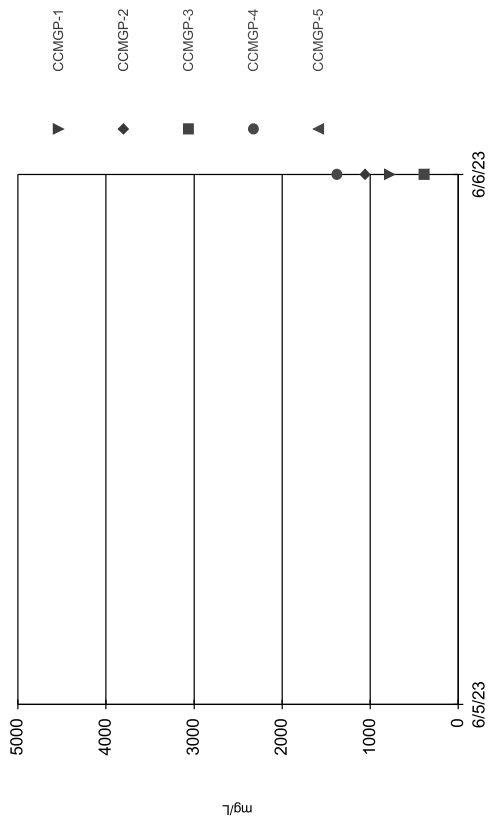

Constituent: Total Dissolved Solids - Analysis Run 9/13/2023 11:34 AM
 CGYP Client: Santee Cooper Data: CGYP

Time Series

Constituent: Antimony (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.005							<0.005
1/26/2016	<0.005							<0.005
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	<0.005							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		<0.005	<0.005	<0.005				
6/4/2020		<0.005	<0.005	<0.005				
6/18/2020		<0.005	<0.005	<0.005				
6/22/2020	<0.005							<0.005
7/1/2020		<0.005		<0.005				
7/2/2020			<0.005					
7/16/2020		<0.005	<0.005	<0.005				
7/30/2020		<0.005	<0.005	<0.005				
8/13/2020		<0.005	<0.005	<0.005				
8/27/2020		<0.005	<0.005	<0.005				
1/26/2021	<0.005							<0.005
2/10/2021		<0.005	<0.005	<0.005				
4/7/2021		<0.005	<0.005	<0.005	<0.005	<0.005		
5/13/2021					<0.005	<0.005		
6/21/2021	<0.005							<0.005
7/7/2021		<0.005	<0.005	<0.005				
7/8/2021					<0.005	<0.005		
8/31/2021						<0.005		
9/1/2021					<0.005			
9/27/2021					<0.005	<0.005		
10/26/2021					<0.005	<0.005		
11/17/2021					<0.005	<0.005		
1/24/2022	<0.005							<0.005
1/31/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
6/20/2022	<0.005							<0.005
6/21/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
10/25/2022	<0.005		<0.005	<0.005	<0.005	<0.005		<0.005
10/26/2022		<0.005					<0.005	
1/24/2023	<0.005							<0.005
2/6/2023			<0.005	<0.005	<0.005			
2/7/2023		<0.005				<0.005	<0.005	
3/20/2023							<0.005	
6/5/2023								<0.005
6/6/2023	<0.005	<0.005						
6/7/2023			<0.005	<0.005	<0.005	<0.005	<0.005	

Time Series

Constituent: Antimony (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.005	<0.005	<0.005	<0.005	<0.005

Time Series

Constituent: Arsenic (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.016							0.0042
1/26/2016	0.0067							0.0035
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	0.00537							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
7/12/2017								<0.005
7/25/2017	<0.005							
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
10/1/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		0.0171	0.029	0.0169				
6/4/2020		0.037	0.0167	0.0138				
6/18/2020		0.0406	0.0197	0.0215				
6/22/2020	<0.005							<0.005
7/1/2020		0.0407		0.0179				
7/2/2020			0.0191					
7/16/2020		0.0165	0.0217	0.017				
7/30/2020		0.014	0.0214	0.0171				
8/13/2020		0.0175	0.0214	0.0176				
8/27/2020		0.0278	0.0204	0.015				
1/26/2021	<0.005							<0.005
2/10/2021		0.0452	0.0184	0.022				
4/7/2021		0.0336	0.0169	0.0198	0.0103	<0.005		
5/13/2021					0.0105	<0.005		
6/21/2021	<0.005							<0.005
7/7/2021		0.0181	0.0194	0.0183				
7/8/2021					0.0113	<0.005		
8/31/2021						<0.005		
9/1/2021					0.0115			
9/27/2021					0.0118	<0.005		
10/26/2021					0.0104	<0.005		
11/17/2021					0.0112	<0.005		
1/24/2022	<0.005							<0.005
1/31/2022		0.0146	0.0165	0.0169	0.008	<0.005		
6/20/2022	<0.005							<0.005
6/21/2022		<0.01	<0.003	<0.01	<0.01	<0.005		
10/25/2022	<0.005		<0.003	0.007	0.0041	<0.005		<0.005
10/26/2022		0.00472					0.006	
1/24/2023	<0.005							0.00332
2/6/2023			0.00922	0.00795	0.00462			
2/7/2023		0.00956				<0.005	0.0142	
3/20/2023							0.0168	
6/5/2023								<0.005
6/6/2023	<0.005	0.00835						
6/7/2023			0.0131	0.0114	0.00514	<0.005	0.0221	

Time Series

Constituent: Arsenic (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.005	0.0154	0.0115	<0.005	<0.005

Time Series

Constituent: Barium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.061							0.1
1/26/2016	0.044							0.087
4/19/2016	0.0438							0.0875
7/18/2016	0.0378							0.0868
10/11/2016	0.0473							0.077
1/23/2017	0.0421							0.0703
4/17/2017	0.0418							0.0802
7/12/2017								0.0803
7/25/2017	0.0421							
9/25/2017	0.044							0.0753
2/7/2018	0.0436							0.0756
6/20/2018	0.043							0.103
10/1/2018	0.0428							0.0769
2/12/2019	0.0427							0.0817
2/24/2020	0.0413							0.0725
5/21/2020		0.0899	0.024	0.0621				
6/4/2020		0.0447	0.0378	0.0582				
6/18/2020		0.0403	0.0445	0.0502				
6/22/2020	0.0433							0.0766
7/1/2020		0.0426		0.0547				
7/2/2020			0.0439					
7/16/2020		0.0574	0.0274	0.0444				
7/30/2020		0.0575	0.0316	0.0437				
8/13/2020		0.0517	0.0289	0.0431				
8/27/2020		0.0447	0.0407	0.0459				
1/26/2021	0.0466							0.0857
2/10/2021		0.0397	0.021	0.0405				
4/7/2021		0.0448	0.0145	0.0384	0.0454	0.326		
5/13/2021					0.0375	0.437		
6/21/2021	0.0423							0.0873
7/7/2021		0.0522	0.0178	0.0378				
7/8/2021					0.0395	0.585		
8/31/2021						0.564		
9/1/2021					0.0364			
9/27/2021					0.0371	0.705		
10/26/2021					0.0336	0.529		
11/17/2021					0.0333	0.865		
1/24/2022	0.0377							0.0826
1/31/2022		0.0301	0.0125	0.0246	0.025	0.258		
6/20/2022	0.033							0.076
6/21/2022		0.023	<0.01	0.017	0.019	0.29		
10/25/2022	0.0466		0.0183	0.0422	0.0306	0.465		0.0851
10/26/2022		0.0469					0.0281	
1/24/2023	0.0425							0.0808
2/6/2023			0.0171	0.034	0.0286			
2/7/2023		0.0391				0.159	0.0283	
3/20/2023							0.0292	
6/5/2023								0.0766
6/6/2023	0.0388	0.0392						
6/7/2023			0.00976	0.0243	0.0255	0.204	0.0147	

Time Series

Constituent: Barium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	0.226	0.0166	0.0196	0.457	0.66

Time Series

Constituent: Beryllium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.00063							<0.0005
1/26/2016	<0.0005							<0.0005
4/19/2016	<0.0005							<0.0005
7/18/2016	<0.0005							<0.0005
10/11/2016	<0.0005							<0.0005
1/23/2017	<0.0005							<0.0005
4/17/2017	<0.0005							<0.0005
9/25/2017	<0.0005							<0.0005
2/7/2018	<0.0005							<0.0005
6/20/2018	<0.0005							<0.0005
10/1/2018	<0.0005							<0.0005
2/12/2019								<0.0005
5/20/2019	<0.0005							<0.0005
2/24/2020	<0.0005							<0.0005
5/21/2020		0.0058	0.0053	0.0283				
6/4/2020		0.0098	0.0034	0.0367				
6/18/2020		0.0109	0.0034	0.037				
6/22/2020	<0.0005							<0.0005
7/1/2020		0.011		0.0468				
7/2/2020			0.0044					
7/16/2020		0.0045	0.0034	0.0252				
7/30/2020		0.004	0.0035	0.022				
8/13/2020		0.0061	0.0036	0.022				
8/27/2020		0.009	0.0034	0.0318				
1/26/2021	<0.0005							<0.0005
2/10/2021		0.0127	0.0025	0.035				
4/7/2021		0.0103	0.0031	0.0465	0.0174	0.0277		
5/13/2021					0.0164	0.0239		
6/21/2021	<0.0005							<0.0005
7/7/2021		0.0061	0.0028	0.0269				
7/8/2021					0.0179	0.0212		
8/31/2021						0.0197		
9/1/2021					0.015			
9/27/2021					0.0156	0.0219		
10/26/2021					0.0152	0.0214		
11/17/2021					0.0149	0.0194		
1/24/2022	<0.0005							<0.0005
1/31/2022		0.0112	0.004	0.0339	0.0166	0.0237		
6/20/2022	<0.0005							<0.0005
6/21/2022		0.006	0.003	0.017	0.013	0.019		
10/25/2022	<0.0005		0.0043	0.0345	0.0188	0.027		<0.0005
10/26/2022		0.0112					0.0117	
1/24/2023	<0.0005							<0.0005
2/6/2023			0.00424	0.0497	0.0162			
2/7/2023		0.011				0.0313	0.0116	
3/20/2023							0.00944	
6/5/2023								<0.0005
6/6/2023	<0.0005	0.00398						
6/7/2023			0.00341	0.0221	0.0151	0.0279	0.00791	

Time Series

Constituent: Beryllium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.0005	0.00185	0.00759	<0.0005	<0.0005

Time Series

Constituent: Boron (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.032							0.0178
1/26/2016	0.0218							<-0.015
4/19/2016	0.0183							<-0.015
7/18/2016	0.0217							0.0163
10/11/2016	0.0302							0.0165
1/23/2017	0.0249							<-0.015
4/17/2017	0.018							0.019
7/25/2017	0.022							
9/25/2017	0.024							0.018
10/9/2017	0.023							0.021
2/7/2018	0.018							<-0.015
6/20/2018	0.02							0.016
10/1/2018	0.025							0.015
2/12/2019	<0.04							<-0.015
2/24/2020	0.017							<-0.015
5/21/2020		8.6	2	18				
6/4/2020		10	1.7	19				
6/18/2020		10	1.6	23				
6/22/2020	0.018							0.049
7/1/2020		12		23				
7/2/2020			1.6					
7/16/2020		8.3	1.9	19				
7/30/2020		8.3	2	17				
8/13/2020		9.1	2.1	17				
8/27/2020		11	1.9	18				
9/21/2020		10	1.7	18				
1/26/2021	0.018							<-0.015
2/10/2021		14	0.96	25				
4/7/2021		11	0.85	23	7.6	7		
5/13/2021					8	6.9		
6/21/2021	<0.04							<-0.015
7/7/2021		9.4	1.3	17				
7/8/2021					7.7	6.7		
8/31/2021						6.9		
9/1/2021					8			
9/27/2021					7.8	7.3		
10/26/2021					6.8	6.7		
11/17/2021					7.1	5.2		
1/24/2022	0.0139							0.011
1/31/2022		9.84	0.51	21.5	6.21	6.2		
6/20/2022	0.015							<-0.015
6/21/2022		4.2	0.57	9.9	4.3	6.1		
10/25/2022	0.0203		1.14	16.6	6.13	5.71		0.0437
10/26/2022		12.6					11.8	
1/24/2023	0.0175							0.0114
2/6/2023			0.602	23.9	5.67			
2/7/2023		11.1				9.49	11.6	
3/20/2023							10.8	
6/5/2023								0.0184
6/6/2023	0.836	0.191						
6/7/2023			0.781	16.7	5.53	8.85	11.2	

Time Series

Constituent: Boron (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	0.823	0.412	0.0815	1.95	0.0179

Time Series

Constituent: Cadmium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.0005							<0.0005
1/26/2016	<0.0005							<0.0005
4/19/2016	<0.0005							<0.0005
7/18/2016	<0.0005							<0.0005
10/11/2016	<0.0005							<0.0005
1/23/2017	<0.0005							<0.0005
4/17/2017	<0.0005							<0.0005
7/12/2017								<0.0005
7/25/2017	<0.0005							
9/25/2017	<0.0005							<0.0005
2/7/2018	<0.0005							<0.0005
6/20/2018	<0.0005							<0.0005
2/12/2019	<0.0005							<0.0005
2/24/2020	<0.0005							<0.0005
5/21/2020		<0.0005	<0.0005	0.00062				
6/4/2020		<0.0005	<0.0005	0.0008				
6/18/2020		<0.0005	<0.0005	0.00074				
6/22/2020	<0.0005							<0.0005
7/1/2020		<0.0005		0.0009				
7/2/2020			<0.0005					
7/16/2020		<0.0005	<0.0005	0.00061				
7/30/2020		<0.0005	<0.0005	<0.0005				
8/13/2020		<0.0005	<0.0005	<0.0005				
8/27/2020		<0.0005	<0.0005	0.00076				
1/26/2021	<0.0005							<0.0005
2/10/2021		<0.0005	<0.0005	0.00078				
4/7/2021		<0.0005	<0.0005	0.00053	<0.0005	<0.0005		
5/13/2021					<0.0005	<0.0005		
6/21/2021	<0.0005							<0.0005
7/7/2021		<0.0005	<0.0005	<0.0005				
7/8/2021					<0.0005	<0.0005		
8/31/2021						<0.0005		
9/1/2021					<0.0005			
9/27/2021					<0.0005	<0.0005		
10/26/2021					<0.0005	<0.0005		
11/17/2021					<0.0005	<0.0005		
1/24/2022	<0.0005							<0.0005
1/31/2022		<0.0005	<0.0005	<0.0005	<0.0005	<0.0005		
6/20/2022	<0.0005							<0.0005
6/21/2022		<0.0005	<0.0005	<0.0005	<0.0005	<0.0005		
10/25/2022	<0.0005		0.0014	0.0019	0.0008	0.0006		<0.0005
10/26/2022		0.0022					0.0032	
1/24/2023	<0.0005							<0.0005
2/6/2023			0.001	0.0015	<0.0005			
2/7/2023		0.0013				<0.0005	0.0015	
3/20/2023							0.00079	
6/5/2023								<0.0005
6/6/2023	<0.0005	<0.0005						
6/7/2023			<0.0005	<0.0005	<0.0005	<0.0005	<0.0005	

Time Series

Constituent: Cadmium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.0005	<0.0005	<0.0005	<0.0005	<0.0005

Time Series

Constituent: Calcium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	27							26
1/26/2016	27							27
4/19/2016	29.4							23.3
7/18/2016	28.7							18.8
10/11/2016	22.7							16.4
1/23/2017	26.2							10.4
4/17/2017	25.6							12.5
7/12/2017								18.5
9/25/2017	21.9							15.4
10/9/2017	23							17
2/7/2018	24							14.7
6/20/2018	24							37
10/1/2018	22.7							16.6
2/12/2019	24.4							15.9
5/20/2019	42.2							16.4
2/24/2020	28.2							11
5/21/2020		204	311	564				
6/4/2020		290	298	658				
6/18/2020		289	299	737				
6/22/2020	28.4							13.5
7/1/2020		315		759				
7/2/2020			305					
7/16/2020		204	295	587				
7/30/2020		192	279	545				
8/13/2020		224	293	556				
8/27/2020		242	272	579				
9/21/2020		252	276	576				
1/26/2021	29.2							14.3
2/10/2021		353	298	729				
4/7/2021		276	273	700	348	480		
5/13/2021					360	468		
6/21/2021	29.9							17
7/7/2021		218	253	495				
7/8/2021					324	438		
8/31/2021						441		
9/1/2021					319			
9/27/2021					325	474		
10/26/2021					304	455		
11/17/2021					310	396		
1/24/2022	27.9							14.4
1/31/2022		229	226	563	254	362		
6/20/2022	29							6.2
6/21/2022		200	240	460	270	430		
10/25/2022	27.5		214	415	231	370		13.1
10/26/2022		193					320	
1/24/2023	29.3							12.6
2/6/2023			301	737	266			
2/7/2023		264				520	420	
3/20/2023							397	
6/5/2023								12.7
6/6/2023	33.9	181						
6/7/2023			254	508	254	486	377	

Time Series

Constituent: Calcium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	151	159	44.6	233	66.6

Time Series

Constituent: Chloride (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	3.21							12.7
1/26/2016	2.95							11.3
4/19/2016	2.33							12.1
7/18/2016	2.95							13.2
10/11/2016	3							12.8
1/23/2017	2.45							13.5
4/17/2017	2.96							12.7
7/12/2017								12.1
7/25/2017	2.61							
9/25/2017	2.51							13.3
10/9/2017	2.73							12.6
2/7/2018	2.88							12.4
6/20/2018	3							13.4
10/1/2018	2.71							12.9
2/12/2019	2.68							12.1
5/20/2019	2.9							12.7
2/24/2020	3.25							12.7
5/21/2020		600	103	1030				
6/4/2020		644	117	1140				
6/18/2020		666	127	1340				
6/22/2020	3.44							12.67
7/1/2020		717		1300				
7/2/2020			145					
7/16/2020		694	153	1070				
7/30/2020		703	176	971				
8/13/2020		647	163	1050				
8/27/2020		666	146	998				
9/21/2020		699	136	1060				
1/26/2021	3.22							11.8
2/10/2021		791	79.5	1460				
4/7/2021		795	55.87	1405	733	1160		
5/13/2021					683	1090		
6/21/2021	3.05							12
7/7/2021		728	83.1	950				
7/8/2021					670	1082		
8/31/2021						1033		
9/1/2021					617			
9/27/2021					574	1061		
10/26/2021					553	1070		
11/17/2021					537	865		
1/24/2022	3.21							12.1
1/31/2022		717	63	1160	523	937		
6/20/2022	3.79							13.4
6/21/2022		686	66.4	841	445	1070		
10/25/2022	3.78		57.3	842	495	896		12.7
10/26/2022		733					797	
1/24/2023	3							12.3
2/6/2023			46	1270	417			
2/7/2023		7.21				1150	910	
3/20/2023							1030	
6/5/2023								12.4
6/6/2023	3.73	679						

Time Series

Constituent: Chloride (mg/L) Analysis Run 9/13/2023 11:35 AM
CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
6/7/2023			55.9	872	353	1070	683	

Time Series

Constituent: Chloride (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	125	244	34.5	283	23.9

Time Series

Constituent: Chromium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.014							<0.005
1/26/2016	<0.005							<0.005
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	<0.005							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
7/12/2017								<0.005
7/25/2017	<0.005							
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		<0.005	<0.005	0.0058				
6/4/2020		<0.005	<0.005	0.0067				
6/18/2020		<0.005	<0.005	0.0063				
6/22/2020	<0.005							<0.005
7/1/2020		<0.005		0.0052				
7/2/2020			<0.005					
7/16/2020		<0.005	<0.005	0.0053				
7/30/2020		<0.005	<0.005	0.0055				
8/13/2020		<0.005	<0.005	0.0056				
8/27/2020		<0.005	<0.005	0.0059				
1/26/2021	<0.005							<0.005
2/10/2021		<0.005	<0.005	<0.005				
4/7/2021		<0.005	<0.005	0.0061	<0.005	<0.005		
5/13/2021					<0.005	<0.005		
6/21/2021	<0.005							<0.005
7/7/2021		<0.005	<0.005	0.0079				
7/8/2021					<0.005	<0.005		
8/31/2021						<0.005		
9/1/2021					<0.005			
9/27/2021					<0.005	<0.005		
10/26/2021					<0.005	<0.005		
11/17/2021					<0.005	<0.005		
1/24/2022	<0.005							
1/31/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
6/20/2022	<0.005							<0.005
6/21/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
10/25/2022	<0.005		<0.005	0.009	<0.005	<0.005		<0.005
10/26/2022		<0.005					<0.005	
1/24/2023	<0.005							<0.005
2/6/2023			<0.005	0.0073	<0.005			
2/7/2023		<0.005				<0.005	<0.005	
3/20/2023							<0.005	
6/5/2023								<0.005
6/6/2023	<0.005	<0.005						
6/7/2023			<0.005	0.008	<0.005	<0.005	<0.005	

Time Series

Constituent: Chromium (mg/L) Analysis Run 9/13/2023 11:35 AM
CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.005	<0.005	<0.005	0.0059	<0.005

Time Series

Constituent: Cobalt (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.0034							0.001
1/26/2016	0.0013							0.0009
4/19/2016	0.00116							0.00079
7/18/2016	0.00115							0.00085
10/11/2016	0.00109							0.000851
1/23/2017	0.001							0.00093
4/17/2017	0.0011							0.00098
9/25/2017	0.00086							0.00091
2/7/2018	0.00088							0.00089
6/20/2018	0.001							0.001
10/1/2018	0.00076							0.00084
2/12/2019	0.00084							0.00091
5/20/2019	0.00079							0.00091
2/24/2020	0.00082							0.001
5/21/2020		0.0448	0.0506	0.115				
6/4/2020		0.0479	0.0199	0.13				
6/18/2020		0.0492	0.0229	0.152				
6/22/2020	0.0008							0.001
7/1/2020		0.0548		0.154				
7/2/2020			0.025					
7/16/2020		0.0353	0.027	0.113				
7/30/2020		0.032	0.028	0.0966				
8/13/2020		0.0371	0.0294	0.0936				
8/27/2020		0.0467	0.0244	0.117				
1/26/2021	0.00066							0.001
2/10/2021		0.0587	0.019	0.151				
4/7/2021		0.0536	0.0183	0.143	0.0532	0.163		
5/13/2021					0.0498	0.149		
6/21/2021	0.0007							0.00094
7/7/2021		0.0362	0.0206	0.0967				
7/8/2021					0.0494	0.147		
8/31/2021						0.15		
9/1/2021					0.0487			
9/27/2021					0.0478	0.157		
10/26/2021					0.0463	0.158		
11/17/2021					0.0461	0.128		
1/24/2022	0.00073							<0.005
1/31/2022		0.00931	0.00644	0.0504	0.0168	0.114		
6/20/2022	<0.001							0.001
6/21/2022		0.033	0.018	0.055	0.033	0.117		
10/25/2022	0.00063		0.0215	0.0956	0.0415	0.156		0.00189
10/26/2022		0.0523					0.0797	
1/24/2023	0.00076							0.00136
2/6/2023			0.0227	0.141	0.0399			
2/7/2023		0.048				0.198	0.107	
3/20/2023							0.0994	
6/5/2023								0.00119
6/6/2023	0.000814	0.0315						
6/7/2023			0.0224	0.0311	0.0199	0.138	0.0178	

Time Series

Constituent: Cobalt (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.0005	0.0787	0.0766	0.00849	0.0057

Time Series

Constituent: Combined Radium 226 & 228 (pci/l) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<4							4.59
1/26/2016	<4							4.31
4/19/2016	5.31							<4
7/18/2016	<4							<4
10/11/2016	4.43							4.49
1/23/2017	6.34							<4
4/17/2017	<4							<4
9/25/2017	<4							<4
2/7/2018	<4							<4
6/20/2018	<4							7.09
10/1/2018	5.11							16.3
2/12/2019	0.346							0.585
2/24/2020	2.06							0.538
5/21/2020		3.97	1.34	5.59				
6/4/2020		3.96	2.14	4.18				
6/18/2020		3.79	2.61	5.24				
6/22/2020	1.14							1.38
7/1/2020		5.58		3.26				
7/2/2020			2.13					
7/16/2020		3.65	2.46	5.25				
7/30/2020		2.93	2.15	7.74				
8/13/2020		3.07	1.91	5.99				
8/27/2020		2.64	1.3	5.2				
1/26/2021	1.73							3.44
2/10/2021		3.86	2.83	4.69				
4/7/2021		3.89	4.18	7.93	6.37	3.68		
5/13/2021					5.84	6.31		
6/21/2021	0.552							2.1
7/7/2021		2.77	2.5	5.03				
7/8/2021					3.56	6.08		
8/31/2021						5.53		
9/1/2021					4.64			
9/27/2021					5.29	7.93		
10/26/2021					5.56	6.48		
11/17/2021					4.9	9.69		
1/24/2022	2.44							2.69
1/31/2022		6.81	3.4	6.17	4.85	3.44		
6/20/2022	1.98							1.59
6/21/2022		4.28	2.39	5.36	3.24	4.3		
10/25/2022	2.51		5.12	6.68	3.77	6.17		2.9
10/26/2022		3.53					6.04	
1/24/2023	1.66							2.63
2/6/2023			2.52	4.18	1.81			
2/7/2023		3.13				2.08	5.27	
3/20/2023							7.77	
6/5/2023								3.7
6/6/2023	5.08	3.94						
6/7/2023			1.77	5.33	1.67	5.69	6.6	

Time Series

Constituent: Combined Radium 226 & 228 (pci/l) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	1.39	4.25	1.34	2	3.01

Time Series

Constituent: Fluoride (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.25							<0.1
1/26/2016	0.3							<0.1
4/19/2016	0.29							<0.1
7/18/2016	0.27							<0.1
10/11/2016	0.28							<0.1
1/23/2017	0.25							<0.1
4/17/2017	0.22							<0.1
9/25/2017	0.23							<0.1
10/9/2017	0.22							<0.1
2/7/2018	0.19							<0.1
6/20/2018	0.2							<0.1
10/1/2018	0.19							<0.1
2/12/2019	0.18							<0.1
2/24/2020	0.19							<0.1
5/21/2020		0.58	0.75	0.65				
6/4/2020		0.96	0.75	2.89				
6/18/2020		1.05	0.62	2.82				
6/22/2020	0.2							<0.1
7/1/2020		0.69		0.73				
7/2/2020			<0.1					
7/16/2020		0.72	1.55	2.41				
7/30/2020		0.91	<0.1	<0.1				
8/13/2020		1.04	0.71	1				
8/27/2020		1.02	0.54	4.57				
9/21/2020		1.29	1.23	1.77				
1/26/2021	0.15							<0.1
2/10/2021		1.69	1.3	6.22				
4/7/2021		1.31	1.08	3.32	3.19	1.1		
5/13/2021					2.82	0.84		
6/21/2021	0.19							<0.1
7/7/2021		0.97	0.87	1.88				
7/8/2021					1.85	0.99		
8/31/2021						0.75		
9/1/2021					1.79			
9/27/2021					1.63	0.98		
10/26/2021					0.83	0.42		
11/17/2021					1.53	0.58		
1/24/2022	0.22							<0.1
1/31/2022		0.9	0.28	0.81	0.67	0.36		
6/20/2022	0.18							<0.1
6/21/2022		0.91	0.93	1.94	1.56	0.93		
10/25/2022	<0.1		0.42	1.06	0.99	0.49		<0.1
10/26/2022		0.53					0.66	
1/24/2023	0.15							<0.1
2/6/2023			1.12	3.08	1.58			
2/7/2023		1.28				0.89	1.61	
3/20/2023							1.06	
6/5/2023								<0.1
6/6/2023	0.23	0.89						
6/7/2023			0.53	1.6	1.16	0.68	0.91	

Time Series

Constituent: Fluoride (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	0.15	1.16	2.69	0.16	0.12

Time Series

Constituent: Lead (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.011							<0.001
1/26/2016	0.0036							<0.001
4/19/2016	0.0028							<0.001
7/18/2016	0.00318							<0.001
10/11/2016	0.00375							<0.001
1/23/2017	0.0031							<0.001
4/17/2017	0.0028							<0.001
7/25/2017	0.0032							
9/25/2017	0.0032							<0.001
2/7/2018	0.0027							<0.001
6/20/2018	0.003							<0.001
10/1/2018	0.0031							<0.001
2/12/2019	0.0025							<0.001
2/24/2020	0.0027							<0.001
5/21/2020		0.035	0.02	0.0279				
6/4/2020		0.0191	0.0238	0.019				
6/18/2020		0.0201	0.0247	0.0236				
6/22/2020	0.0026							<0.001
7/1/2020		0.0202		0.0236				
7/2/2020			0.026					
7/16/2020		0.0116	0.0235	0.0269				
7/30/2020		0.005	0.0244	0.0295				
8/13/2020		0.0093	0.0247	0.0355				
8/27/2020		0.0087	0.0268	0.0193				
1/26/2021	0.0025							<0.001
2/10/2021		0.0165	0.0196	0.092 (o)				
4/7/2021		0.008	0.0175	0.0248	0.0113	0.013		
5/13/2021					0.0122	0.0127		
6/21/2021	0.0026							<0.001
7/7/2021		0.0097	0.0208	0.0297				
7/8/2021					0.0126	0.0131		
8/31/2021						0.0136		
9/1/2021					0.0146			
9/27/2021					0.0147	0.0137		
10/26/2021					0.0145	0.0158		
11/17/2021					0.0147	0.0068		
1/24/2022	0.0027							<0.001
1/31/2022		0.0056	0.019	0.0244	0.0113	0.0105		
6/20/2022	<0.01							<0.001
6/21/2022		<0.01	<0.01	0.011	<0.01	<0.01		
10/25/2022	0.0032		0.0251	0.0298	0.0134	0.0028		<0.001
10/26/2022		0.0089					0.0551	
1/24/2023	0.00259							<0.001
2/6/2023			0.0234	0.0328	0.00927			
2/7/2023		0.00625				0.0118	0.0378	
3/20/2023							0.0361	
6/5/2023								<0.001
6/6/2023	0.00255	0.00144						
6/7/2023			0.0166	0.0181	0.00896	0.0132	0.0234	

Time Series

Constituent: Lead (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.001	0.00188	0.00983	<0.001	<0.001

Time Series

Constituent: Lithium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.005							<0.005
1/26/2016	<0.005							<0.005
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	<0.005							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
10/1/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
5/20/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		0.015	0.015	0.069				
6/4/2020		0.027	<0.005	0.09				
6/18/2020		0.028	0.015	0.11				
6/22/2020	<0.005							<0.005
7/1/2020		<0.01		0.11				
7/2/2020			0.015					
7/16/2020		0.01	<0.005	0.071				
7/30/2020		<0.01	0.014	0.06				
8/13/2020		<0.01	<0.005	0.063				
8/27/2020		0.023	0.016	0.093				
1/26/2021	<0.005							<0.005
2/10/2021		0.024	0.013	0.11				
4/7/2021		0.02	0.014	0.094	0.058	0.14		
5/13/2021					0.058	0.13		
6/21/2021	<0.005							<0.005
7/7/2021		0.014	0.015	0.056				
7/8/2021					0.058	0.12		
8/31/2021						0.13		
9/1/2021					0.064			
9/27/2021					0.067	0.15		
10/26/2021					0.053	0.11		
11/17/2021					0.052	0.11		
1/24/2022	0.00066							0.0037
1/31/2022		0.0183	0.0109	0.1	0.0642	0.128		
6/20/2022	<0.005							<0.005
6/21/2022		<0.01	<0.005	0.029	0.039	0.1		
10/25/2022	<0.005		<0.005	0.0517	0.0712	0.148		0.00544
10/26/2022		0.00893					0.00785	
1/24/2023	<0.005							<0.005
2/6/2023			0.0142	0.0143	0.0687			
2/7/2023		0.0247				0.198	0.0116	
3/20/2023							<0.05	
6/5/2023								<0.005
6/6/2023	<0.005	0.00779						
6/7/2023			0.0139	0.0701	0.0766	0.181	0.0115	

Time Series

Constituent: Lithium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	0.0255	<0.005	0.00855	0.0158	<0.005

Time Series

Constituent: Mercury (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.0002							<0.0002
1/26/2016	<0.0002							<0.0002
4/19/2016	<0.0002							<0.0002
7/18/2016	<0.0002							<0.0002
10/11/2016	<0.0002							<0.0002
1/23/2017	<0.0002							<0.0002
4/17/2017	<0.0002							<0.0002
9/25/2017	<0.0002							<0.0002
2/7/2018	<0.0002							<0.0002
6/20/2018	<0.0002							<0.0002
10/1/2018	<0.0002							<0.0002
2/12/2019	<0.0002							<0.0002
2/24/2020	<0.0002							<0.0002
5/21/2020		<0.0002	<0.0002	<0.0002				
6/4/2020		<0.0002	<0.0002	<0.0002				
6/18/2020		<0.0002	<0.0002	0.00047				
6/22/2020	<0.0002							<0.0002
7/1/2020		0.0002		0.00023				
7/2/2020			<0.0002					
7/16/2020		<0.0002	<0.0002	<0.0002				
7/30/2020		<0.0002	<0.0002	<0.0002				
8/13/2020		<0.0002	<0.0002	<0.0002				
8/27/2020		<0.0002	<0.0002	<0.0002				
1/26/2021	<0.0002							<0.0002
2/10/2021		<0.0002	<0.0002	<0.0002				
4/7/2021		<0.0002	<0.0002	0.00021	<0.0002	<0.0002		
5/13/2021					<0.0002	<0.0002		
6/21/2021	<0.0002							<0.0002
7/7/2021		<0.0002	<0.0002	<0.0002				
7/8/2021					<0.0002	<0.0002		
8/31/2021						<0.0002		
9/1/2021					<0.0002			
9/27/2021					<0.0002	<0.0002		
10/26/2021					<0.0002	<0.0002		
11/17/2021					<0.0002	<0.0002		
1/24/2022	<0.0002							<0.0002
1/31/2022		<0.0002	<0.0002	<0.0002	<0.0002	<0.0002		
6/20/2022	<0.0002							<0.0002
6/21/2022		<0.0002	<0.0002	<0.0002	<0.0002	<0.0002		
10/25/2022	<0.0002		<0.0002	<0.0002	<0.0002	<0.0002		<0.0002
10/26/2022		<0.0002					<0.0002	
1/24/2023	<0.0002							<0.0002
2/6/2023			<0.0002	<0.0002	<0.0002			
2/7/2023		<0.0002				<0.0002	<0.0002	
3/20/2023							<0.0002	
6/5/2023								<0.0002
6/6/2023	<0.0002	<0.0002						
6/7/2023			<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	

Time Series

Constituent: Mercury (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002

Time Series

Constituent: Molybdenum (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.005							<0.005
1/26/2016	<0.005							<0.005
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	<0.005							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		<0.005	<0.005	<0.005				
6/4/2020		<0.005	<0.005	<0.005				
6/18/2020		<0.005	<0.005	<0.005				
6/22/2020	<0.005							<0.005
7/1/2020		<0.005		<0.005				
7/2/2020			<0.005					
7/16/2020		<0.005	<0.005	<0.005				
7/30/2020		<0.005	<0.005	<0.005				
8/13/2020		<0.005	<0.005	<0.005				
8/27/2020		<0.005	<0.005	<0.005				
1/26/2021	<0.005							<0.005
2/10/2021		<0.005	<0.005	<0.005				
4/7/2021		<0.005	<0.005	<0.005	<0.005	<0.005		
5/13/2021					<0.005	<0.005		
6/21/2021	<0.005							<0.005
7/7/2021		<0.005	<0.005	<0.005				
7/8/2021					<0.005	<0.005		
8/31/2021						<0.005		
9/1/2021					<0.005			
9/27/2021					<0.005	<0.005		
10/26/2021					<0.005	<0.005		
11/17/2021					<0.005	<0.005		
1/24/2022	<0.005							<0.005
1/31/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
6/20/2022	<0.005							<0.005
6/21/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
10/25/2022	<0.005		<0.005	<0.005	<0.005	<0.005		<0.005
10/26/2022		<0.005					<0.005	
1/24/2023	<0.005							<0.005
2/6/2023			<0.005	<0.005	<0.005			
2/7/2023		<0.005				<0.005	<0.005	
3/20/2023							<0.005	
6/5/2023								<0.005
6/6/2023	<0.005	<0.005						
6/7/2023			<0.005	<0.005	<0.005	<0.005	<0.005	

Time Series

Constituent: Molybdenum (mg/L) Analysis Run 9/13/2023 11:35 AM
CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.005	<0.005	<0.005	0.0146	<0.005

Time Series

Constituent: pH, Field (pH units) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
1/26/2015								4.53
2/16/2015								4.68
6/16/2015								4.74
7/6/2015								5.25
10/19/2015	4.45							5.47
1/26/2016	4.12							5.2
4/19/2016	4.33							5.32
7/18/2016	4.38							5.2
10/11/2016	4.14							5.01
1/23/2017	4.32							5.01
4/17/2017	4.26							5.19
7/12/2017								5.11
7/25/2017	4.21							
9/25/2017	4.32							5.27
10/9/2017	4.25							5.21
2/7/2018	4.42							5.29
6/20/2018	4.32							5.58
10/1/2018	4.09							5.08
2/12/2019	4.5							5.47
5/20/2019	4.5							5.26
2/24/2020	4.09							4.92
5/21/2020		3.58	3.82	3.66				
6/4/2020		3.98	3.86	3.99				
6/18/2020		3.89	3.69	3.63				
6/22/2020	4.48							5.12
7/1/2020		4.06		3.96				
7/2/2020			3.79					
7/16/2020		4.48	4.06	3.93				
7/30/2020		4.22	3.72	3.63				
8/13/2020		3.92	3.59	3.4				
8/27/2020		3.98	3.81	3.81				
9/21/2020		4.11	3.79	3.77				
1/26/2021	4.31							5.03
2/10/2021		3.8	3.77	3.5				
4/7/2021		4.1	4.02	3.73	3.78	3.68		
5/13/2021					3.88	3.7		
6/21/2021	4.25							5.21
7/7/2021		4.19	3.8	3.56				
7/8/2021					3.65	3.54		
8/31/2021						3.67		
9/1/2021					3.65			
9/27/2021					3.65	3.62		
10/26/2021					3.66	3.54		
11/17/2021					3.54	3.66		
1/24/2022	4.26							5.19
1/31/2022		4.21	3.96	3.84	3.9	3.93		
6/20/2022	4.45							4.84
6/21/2022		4.28	4.01	3.87	3.89	3.82		
10/25/2022	4.31		3.8	3.56	3.69	3.56		5.01
10/26/2022		4.01					3.69	
1/24/2023	4.23							4.84
2/6/2023			4.01	3.77	4.01			

Time Series

Constituent: pH, Field (pH units) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
2/7/2023		4.38				3.8	3.82	
3/20/2023							3.72	
6/5/2023								5.08
6/6/2023	4.34	4.66						
6/7/2023			4	3.67	4.13	3.74	3.92	

Time Series

Constituent: pH, Field (pH units) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	7.08	4.96	3.81	6.39	6.12

Time Series

Constituent: Selenium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.01							<0.01
1/26/2016	<0.01							<0.01
4/19/2016	<0.01							<0.01
7/18/2016	<0.01							<0.01
10/11/2016	<0.01							<0.01
1/23/2017	<0.01							<0.01
4/17/2017	<0.01							<0.01
7/25/2017	<0.01							<0.01
9/25/2017	<0.01							<0.01
2/7/2018	<0.01							<0.01
6/20/2018	<0.01							<0.01
10/1/2018	<0.01							<0.01
2/12/2019	<0.01							<0.01
2/24/2020	<0.01							<0.01
5/21/2020		<0.01	0.0113	<0.01				
6/4/2020		0.0166	0.0078	0.0067				
6/18/2020		0.0143	<0.01	<0.01				
6/22/2020	<0.01							<0.01
7/1/2020		0.0177		<0.01				
7/2/2020			<0.01					
7/16/2020		<0.01	<0.01	<0.01				
7/30/2020		<0.01	<0.01	<0.01				
8/13/2020		<0.01	<0.01	<0.01				
8/27/2020		<0.01	<0.01	<0.01				
1/26/2021	<0.01							<0.01
2/10/2021		0.0163	<0.01	<0.01				
4/7/2021		<0.01	<0.01	<0.01	<0.01	<0.01		
5/13/2021					<0.01	<0.01		
6/21/2021	<0.01							<0.01
7/7/2021		<0.01	<0.01	<0.01				
7/8/2021					<0.01	<0.01		
8/31/2021						<0.01		
9/1/2021					<0.01			
9/27/2021					<0.01	<0.01		
10/26/2021					<0.01	<0.01		
11/17/2021					<0.01	<0.01		
1/24/2022	<0.01							<0.01
1/31/2022		0.018	0.014	0.014	<0.01	<0.01		
6/20/2022	<0.01							<0.01
6/21/2022		<0.01	<0.01	<0.01	<0.01	<0.01		
10/25/2022	<0.01		0.027	0.019	0.00856	<0.01		<0.01
10/26/2022		0.026					0.046	
1/24/2023	<0.01							<0.01
2/6/2023			<0.01	<0.01	<0.01			
2/7/2023		<0.01				<0.01	0.002	
3/20/2023							<0.01	
6/5/2023								<0.01
6/6/2023	<0.01	<0.01						
6/7/2023			<0.01	<0.01	<0.01	<0.01	<0.01	

Time Series

Constituent: Selenium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.01	<0.01	<0.01	<0.01	<0.01

Time Series

Constituent: Sulfate (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	81.5							26.5
1/26/2016	88.2							25.5
4/19/2016	86							20.2
7/18/2016	90.1							16
10/11/2016	73.7							19.3
1/23/2017	77.7							8.82
4/17/2017	71.2							9.71
7/12/2017								11.1
7/25/2017	73.3							
9/25/2017	74.5							8.03
10/9/2017	76.8							8.77
2/7/2018	69.1							13.5
6/20/2018	67.9							8.58
10/1/2018	65.5							11.9
2/12/2019	69.1							8.96
5/20/2019	115							10.5
2/24/2020	79.8							8.36
5/21/2020		364	1000	978				
6/4/2020		544	968	911				
6/18/2020		540	932	946.1				
6/22/2020	79.9							8.32
7/1/2020		575		924				
7/2/2020			908					
7/16/2020		338	933	983				
7/30/2020		340	868	991				
8/13/2020		391	868	999				
8/27/2020		448	885	913				
9/21/2020		460	976	995				
1/26/2021	80.7							9.98
2/10/2021		613	957	1010				
4/7/2021		445	987	972	602	96.3		
5/13/2021					598	83.6		
6/21/2021	86.6							11.9
7/7/2021		377	937	993				
7/8/2021					621	84.3		
8/31/2021						84.3		
9/1/2021					605			
9/27/2021					584	90.9		
10/26/2021					611	92.7		
11/17/2021					600	67		
1/24/2022	82.8							11.7
1/31/2022		451	1020	998	575	128		
6/20/2022	78.3							6.59
6/21/2022		359	881	966	576	106		
10/25/2022	80.4		914	885	652	89.3		7.99
10/26/2022		458					894	
1/24/2023	84.2							8.12
2/6/2023			958	928	557			
2/7/2023		476				163	830	
3/20/2023							761	
6/5/2023								9.11
6/6/2023	97.1	282						

Time Series

Constituent: Sulfate (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
6/7/2023			904	964	538	129	813	

Time Series

Constituent: Sulfate (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	56.4	438	198	48.9	5.84

Time Series

Constituent: Thallium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.001							<0.001
1/26/2016	<0.001							<0.001
4/19/2016	<0.001							<0.001
7/18/2016	<0.001							<0.001
10/11/2016	<0.001							<0.001
1/23/2017	<0.001							<0.001
4/17/2017	<0.001							<0.001
9/25/2017	<0.001							<0.001
2/7/2018	<0.001							<0.001
6/20/2018	<0.001							<0.001
2/12/2019	<0.001							<0.001
2/24/2020	<0.001							<0.001
5/21/2020		<0.001	<0.001	<0.001				
6/4/2020		<0.001	<0.001	<0.001				
6/18/2020		<0.001	<0.001	<0.001				
6/22/2020	<0.001							<0.001
7/1/2020		<0.001		<0.001				
7/2/2020			<0.001					
7/16/2020		<0.001	<0.001	<0.001				
7/30/2020		<0.001	<0.001	<0.001				
8/13/2020		<0.001	<0.001	<0.001				
8/27/2020		<0.001	<0.001	<0.001				
1/26/2021	<0.001							<0.001
2/10/2021		<0.001	<0.001	<0.001				
4/7/2021		<0.001	<0.001	<0.001	<0.001	<0.001		
5/13/2021					<0.001	<0.001		
6/21/2021	<0.001							<0.001
7/7/2021		<0.001	<0.001	<0.001				
7/8/2021					<0.001	<0.001		
8/31/2021						<0.001		
9/1/2021					<0.001			
9/27/2021					<0.001	<0.001		
10/26/2021					<0.001	<0.001		
11/17/2021					<0.001	<0.001		
1/24/2022	<0.001							<0.001
1/31/2022		<0.001	<0.001	<0.001	<0.001	<0.001		
6/20/2022	<0.001							<0.001
6/21/2022		<0.001	<0.001	<0.001	<0.001	<0.001		
10/25/2022	<0.001		<0.001	<0.001	<0.001	<0.001		<0.001
10/26/2022		<0.001					<0.001	
1/24/2023	<0.001							<0.001
2/6/2023			<0.001	<0.001	<0.001			
2/7/2023		<0.001				<0.001	<0.001	
3/20/2023							<0.001	
6/5/2023								<0.001
6/6/2023	<0.001	<0.001						
6/7/2023			<0.001	<0.001	<0.001	<0.001	<0.001	

Time Series

Constituent: Thallium (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	<0.001	<0.001	<0.001	<0.001	<0.001

Time Series

Constituent: Total Dissolved Solids (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
1/26/2015								142.5
2/16/2015								106.2
6/16/2015								158
7/6/2015								151
10/19/2015	150							206
1/26/2016	120							165
4/19/2016	120							130
7/18/2016	132							124
10/11/2016	151.7							200
1/23/2017	148							138
4/17/2017	62							56
7/12/2017								108
7/25/2017	92							
9/25/2017	<40							<40
10/9/2017	115							80
2/7/2018	92							112
6/20/2018	138.8							200
10/1/2018	107.5							130
2/12/2019	135							136.2
5/20/2019	181.2							162.5
2/24/2020	107.5							120
5/21/2020		1505	1609	3449				
6/4/2020		1839	1589	3895				
6/18/2020		1964	1624	4502				
6/22/2020	147.5							112.5
7/1/2020		2650		4120				
7/2/2020			1634					
7/16/2020		1811	1512	3700				
7/30/2020		1541	1515	3138				
8/13/2020		1768	1599	3102				
8/27/2020		1772	1526	3519				
9/21/2020		1945	1515	3288				
1/26/2021	138.8							110
2/10/2021		2081	1538	4090				
4/7/2021		2301	1536	4958	2178	3952		
5/13/2021					2078	2804		
6/21/2021	178.8							155
7/7/2021		1770	1618	3291				
7/8/2021					2168	2851		
8/31/2021						2740		
9/1/2021					2038			
9/27/2021					1749	2382		
10/26/2021					1614	2306		
11/17/2021					1676	1899		
1/24/2022	130							128.8
1/31/2022		1912	1582	3410	1864	2379		
6/20/2022	143.8							137.5
6/21/2022		1771	1408	2952	1676	3210		
10/25/2022	110		1454	2835	1585	2902		96.25
10/26/2022		1894					2545	
1/24/2023	142.5							111.2
2/6/2023			1474	3838	1689			

Time Series

Constituent: Total Dissolved Solids (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
2/7/2023		1764				2959	2546	
3/20/2023							2665	
6/5/2023								130
6/6/2023	178.8	1584						
6/7/2023			1451	2906	1445	2774	2355	

Time Series


Constituent: Total Dissolved Solids (mg/L) Analysis Run 9/13/2023 11:35 AM

CGYP Client: Santee Cooper Data: CGYP

	CCMGP-1	CCMGP-2	CCMGP-3	CCMGP-4	CCMGP-5
6/6/2023	771.2	1045	378.8	1370	388.8


FIGURE B.

Box & Whiskers Plot

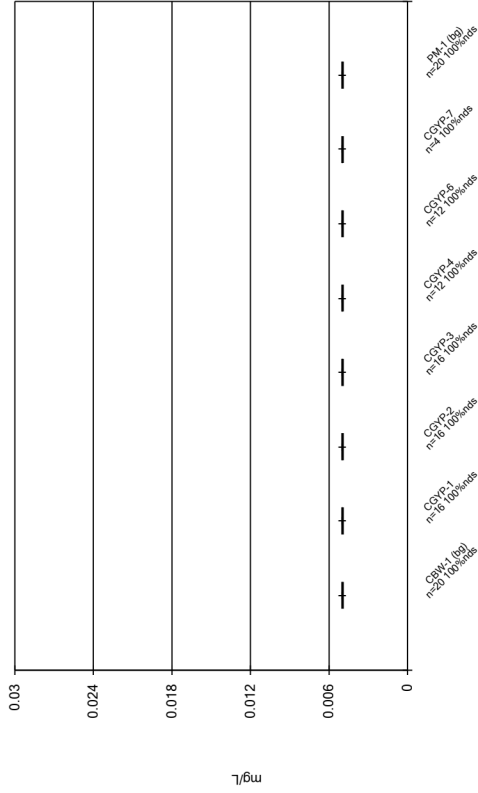


Constituent: Antimony Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

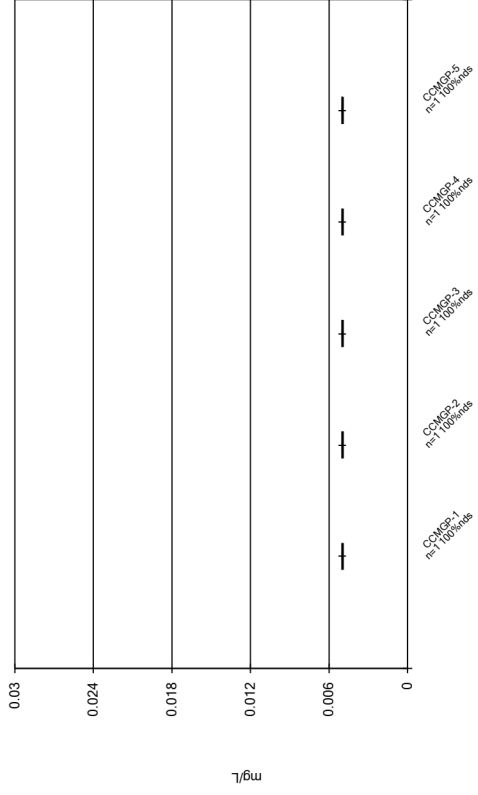


Constituent: Antimony Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

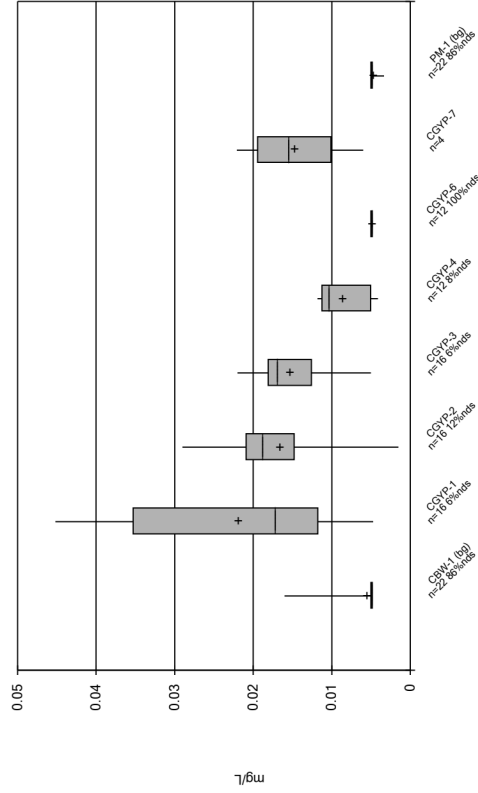


Constituent: Arsenic Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

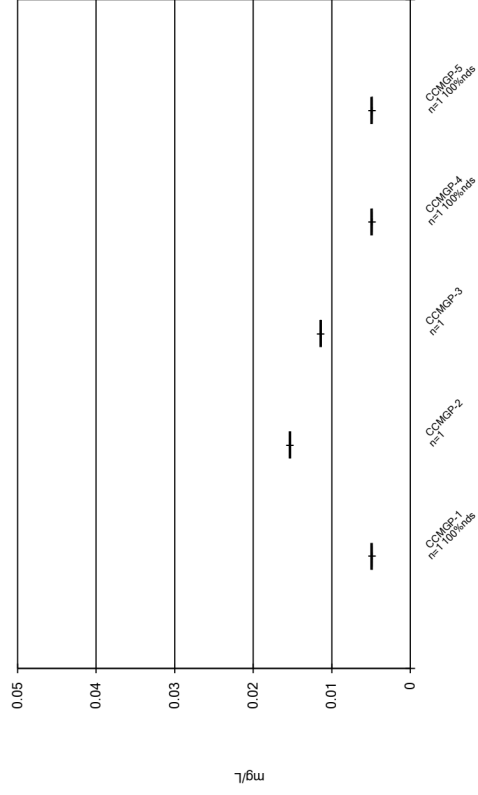


Constituent: Arsenic Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

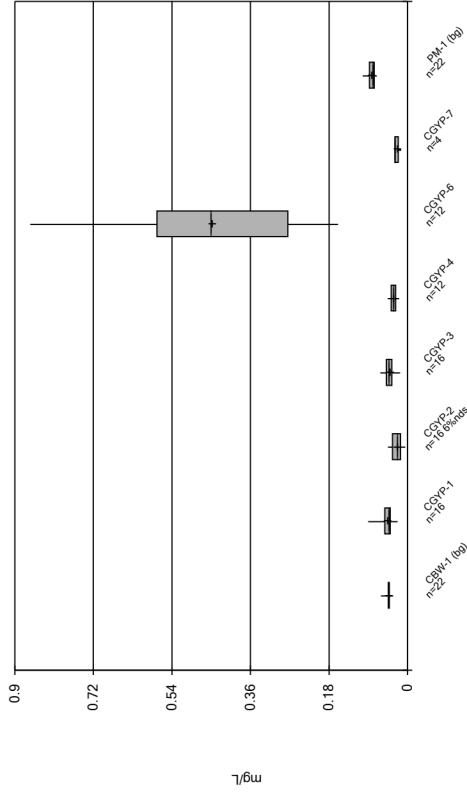


Constituent: Barium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

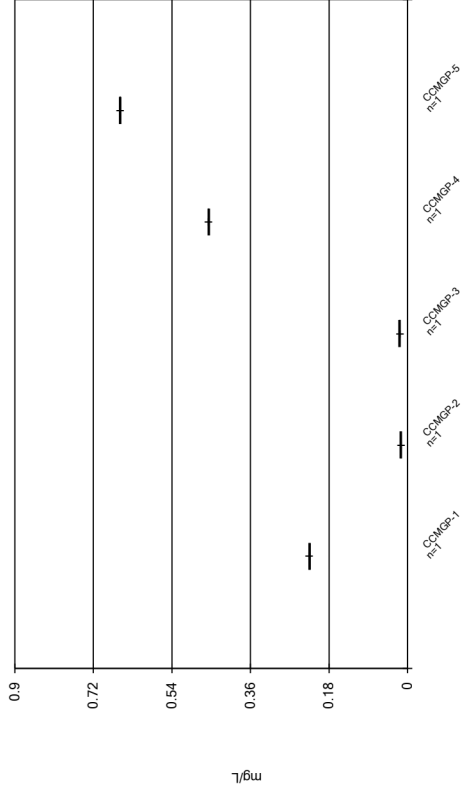


Constituent: Barium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

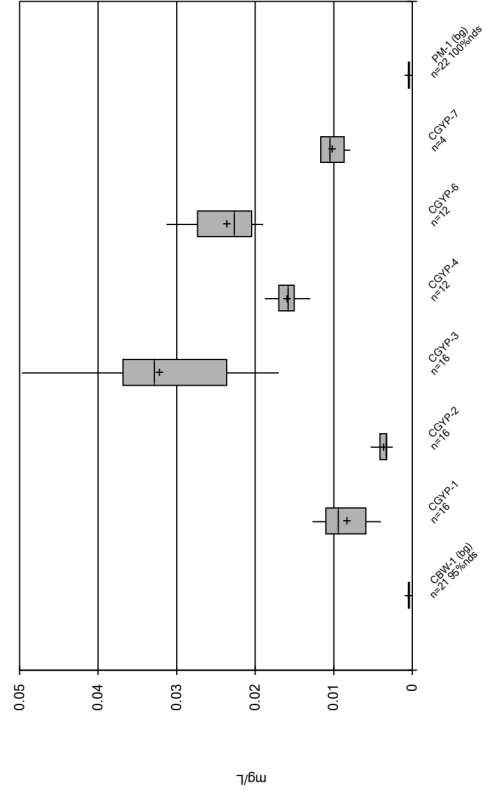


Constituent: Beryllium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

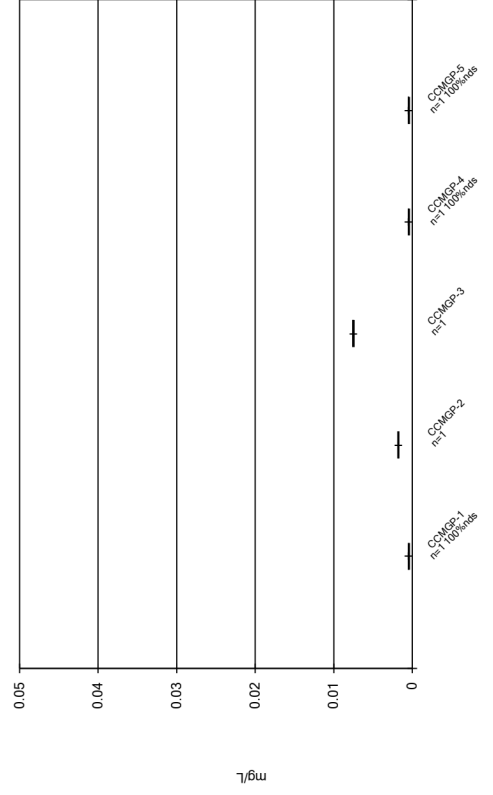


Constituent: Beryllium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

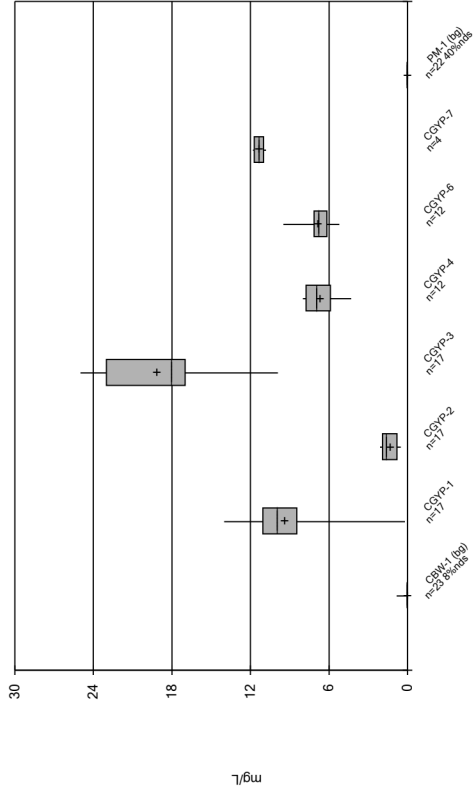


Constituent: Boron Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

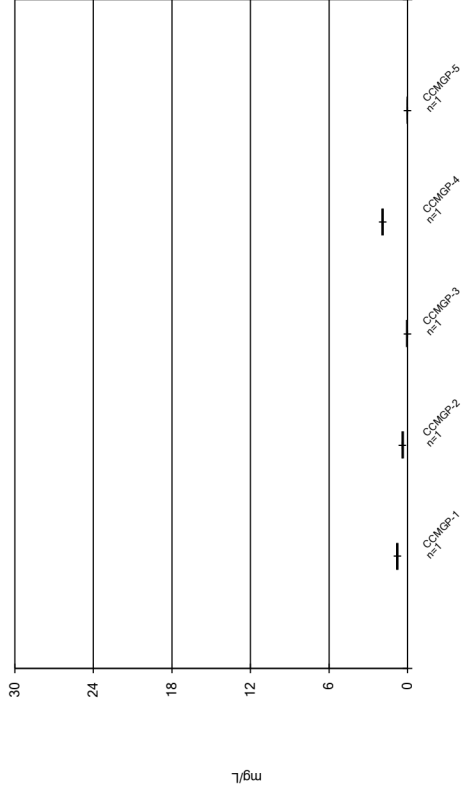


Constituent: Boron Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

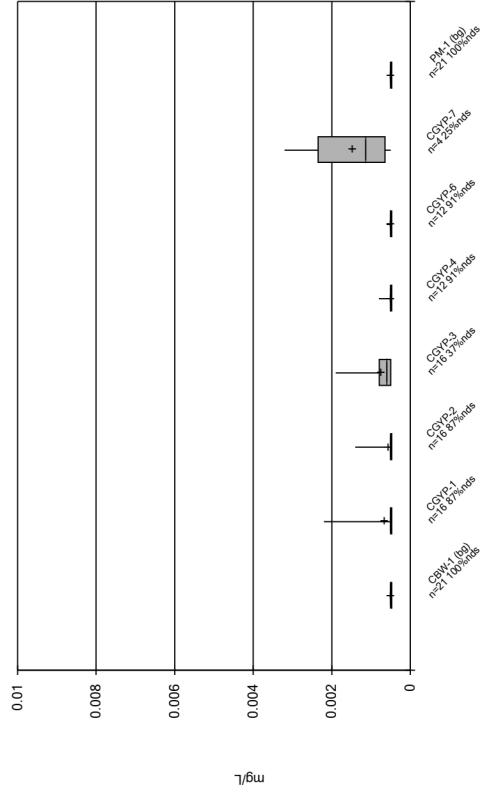


Constituent: Cadmium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

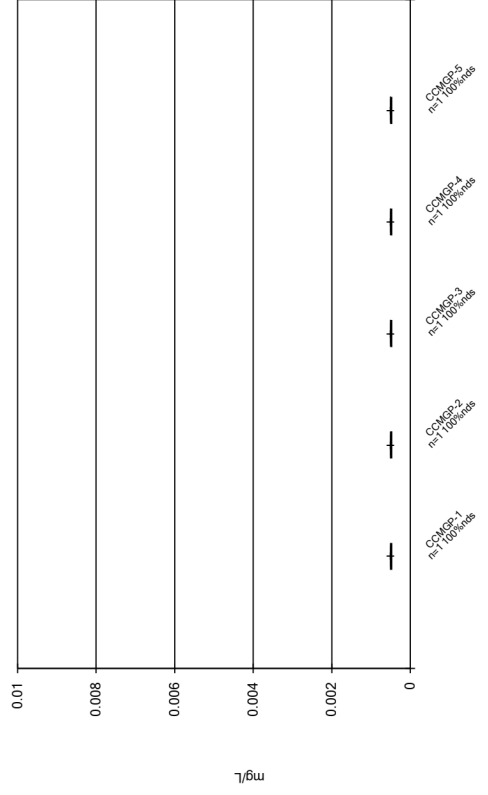


Constituent: Cadmium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

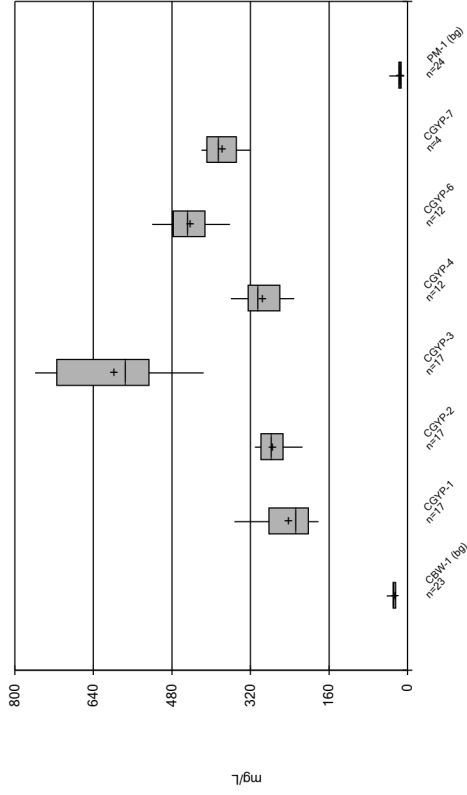


Constituent: Calcium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

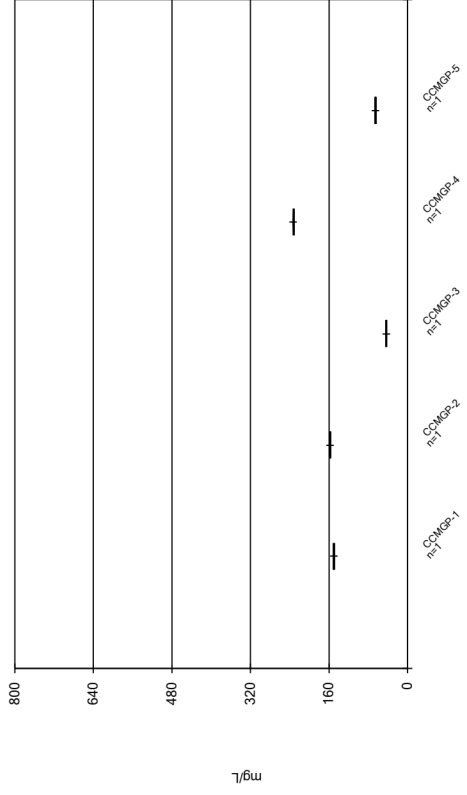


Constituent: Calcium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

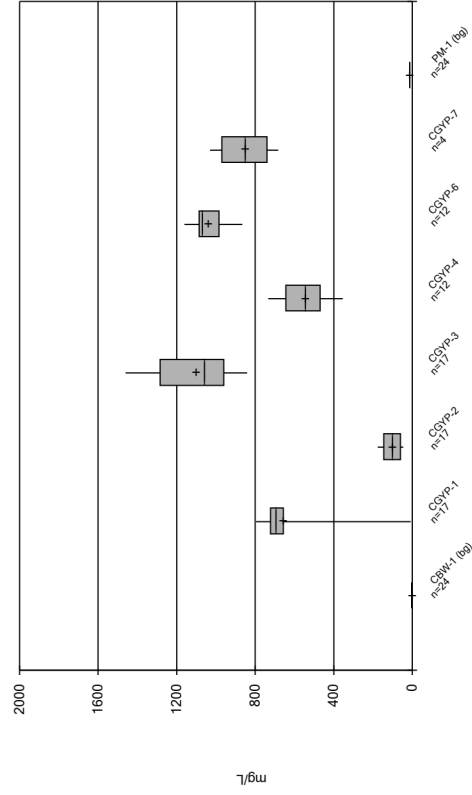


Constituent: Chloride Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

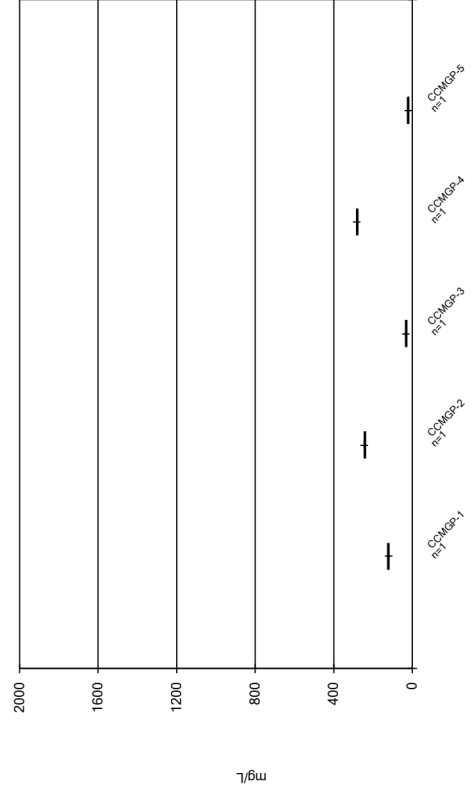


Constituent: Chloride Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

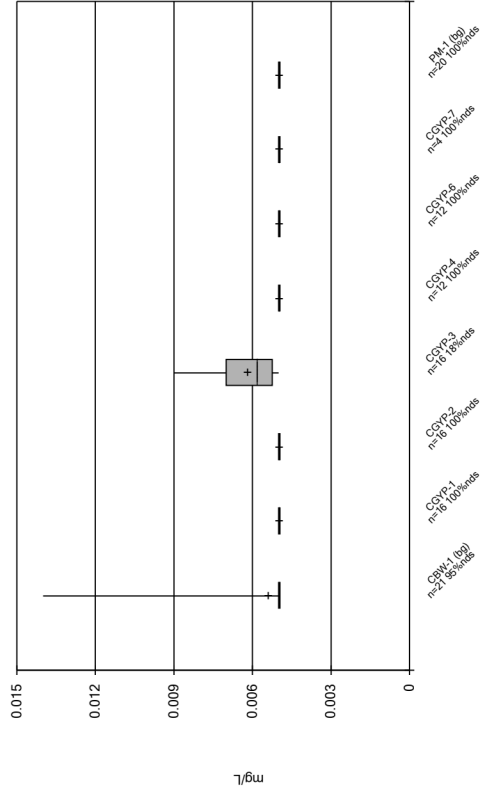


Constituent: Chromium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

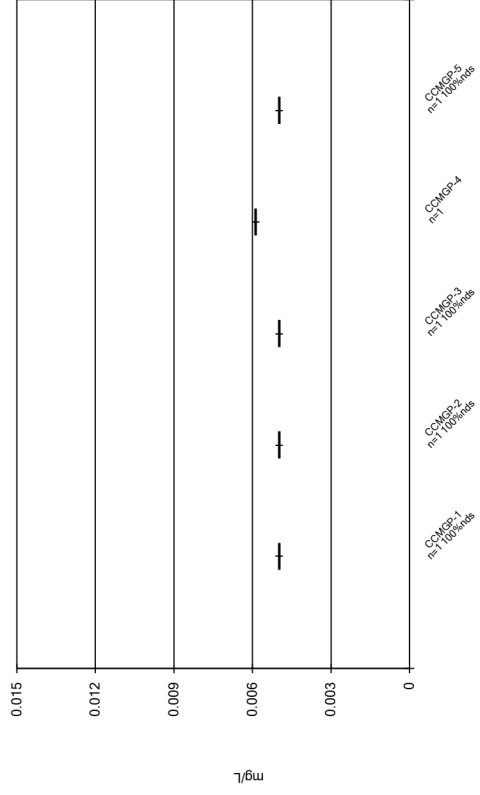


Constituent: Chromium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

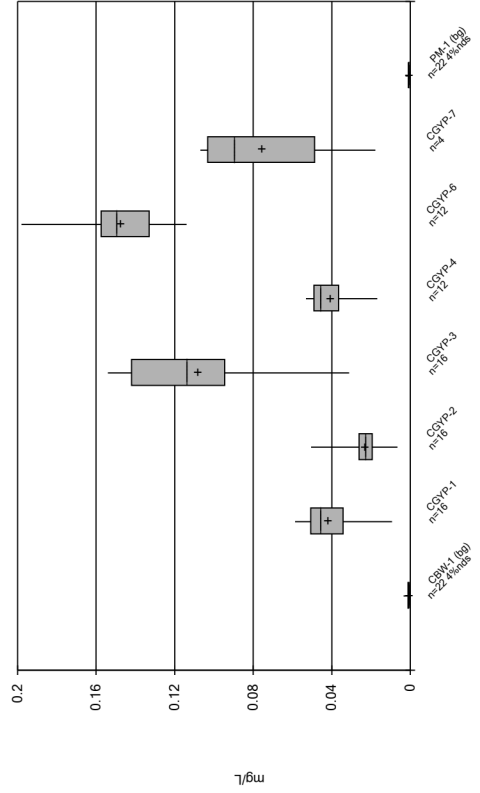


Constituent: Cobalt Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

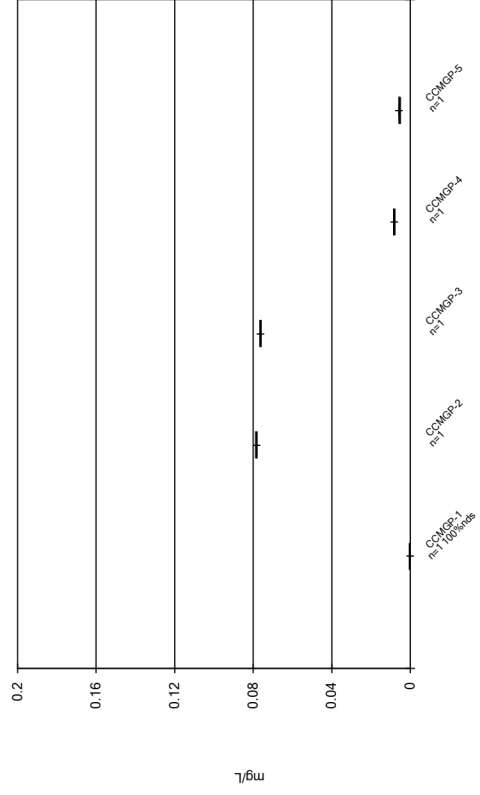


Constituent: Cobalt Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

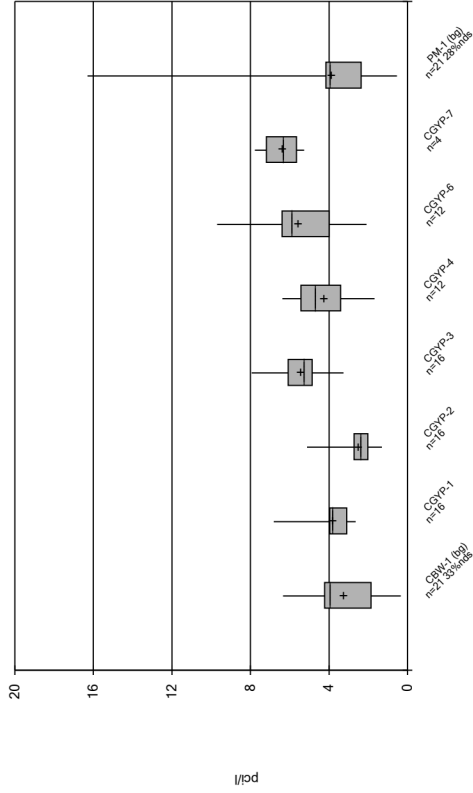


Constituent: Combined Radium 226 & 228 Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

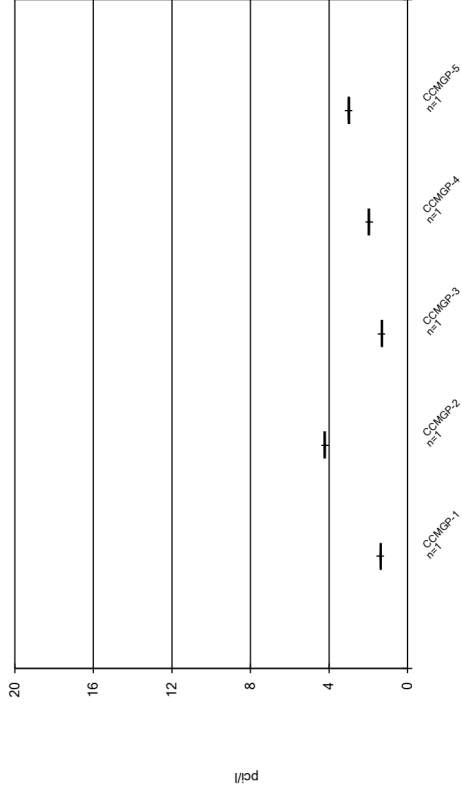


Constituent: Combined Radium 226 & 228 Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

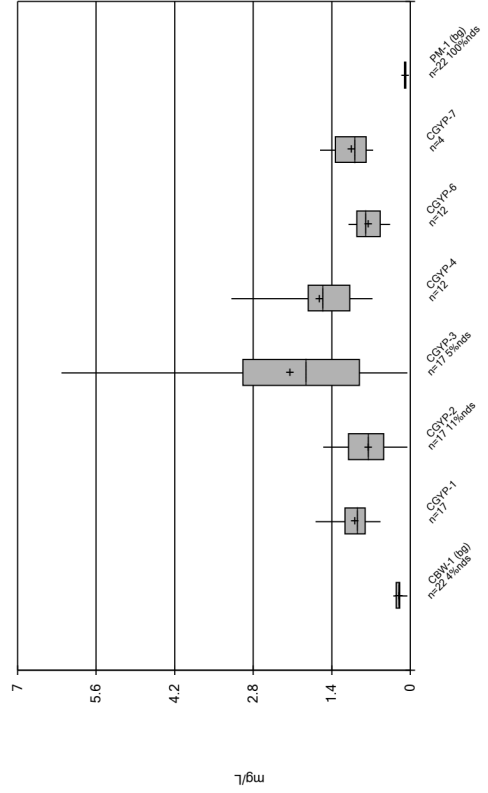


Constituent: Fluoride Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

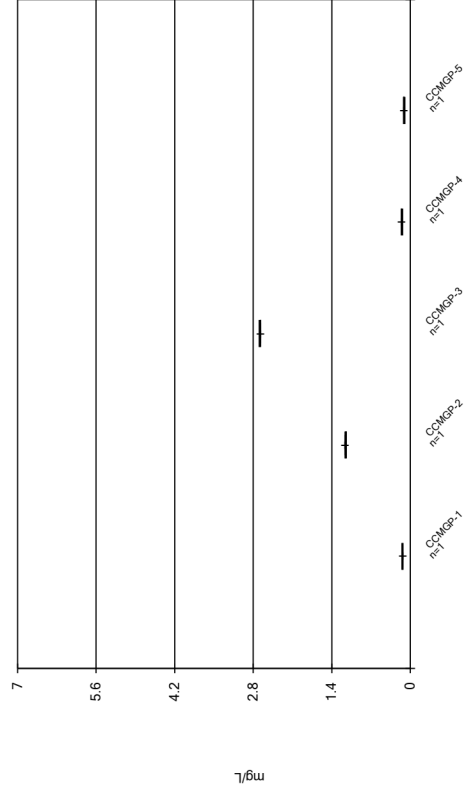


Constituent: Fluoride Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

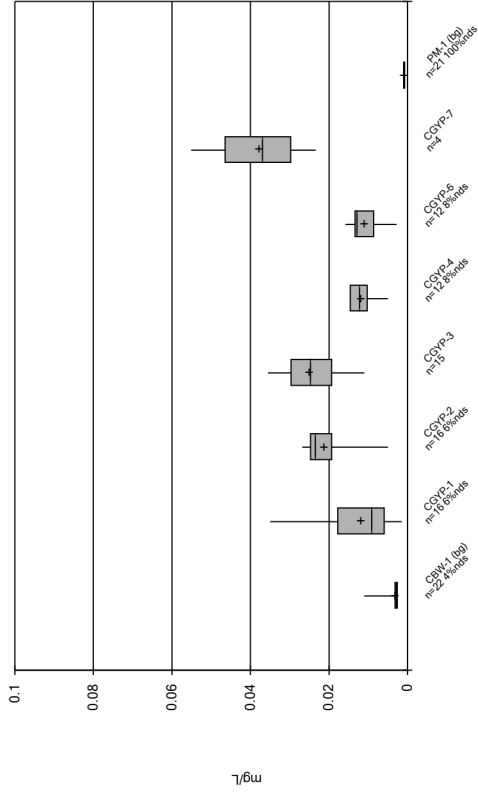


Constituent: Lead Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

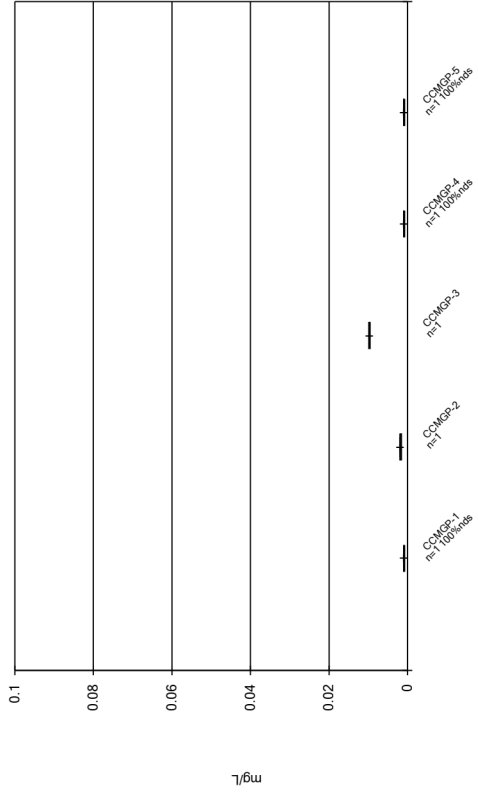


Constituent: Lead Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

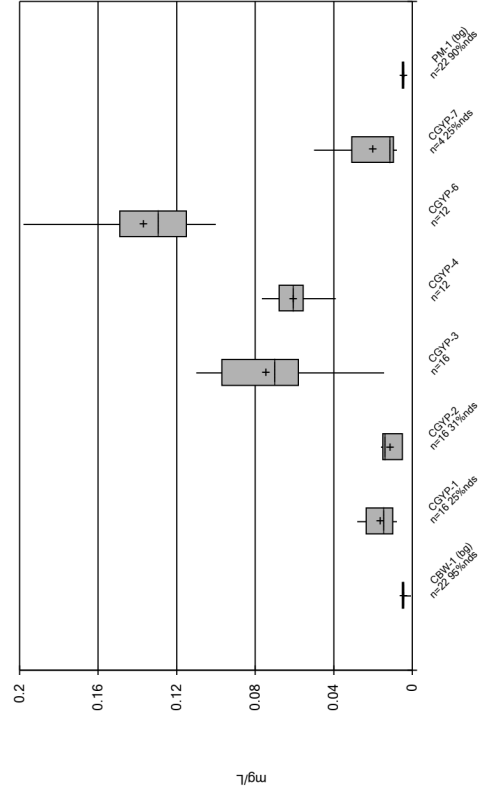


Constituent: Lithium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

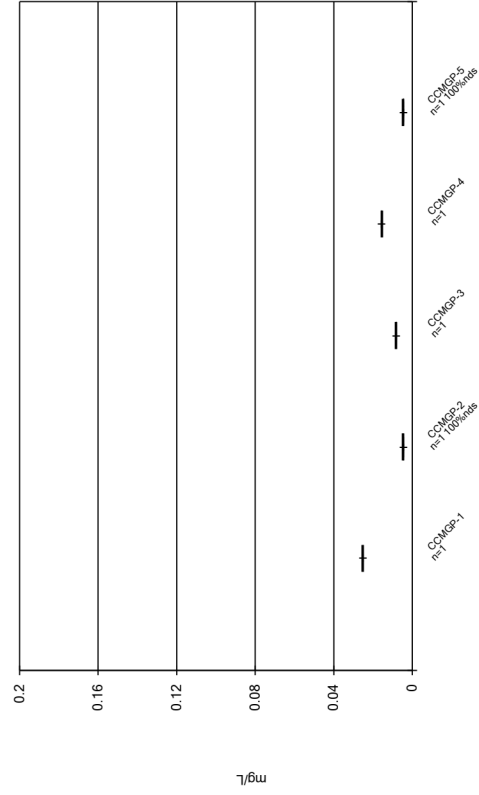


Constituent: Lithium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

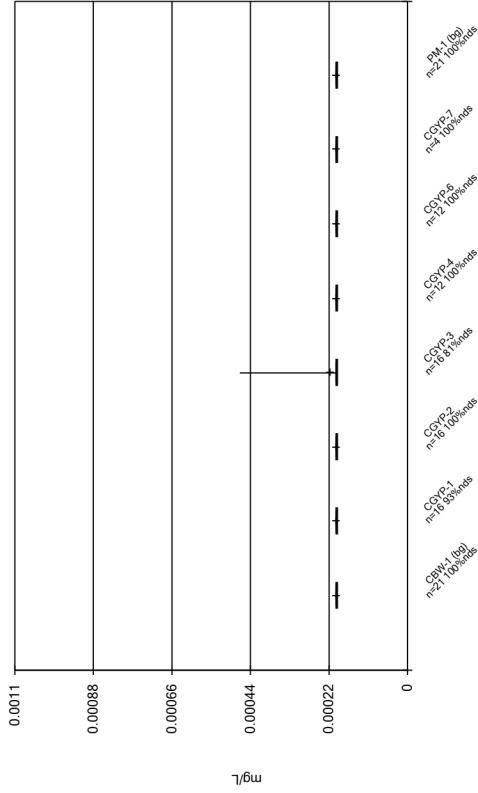


Constituent: Mercury Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

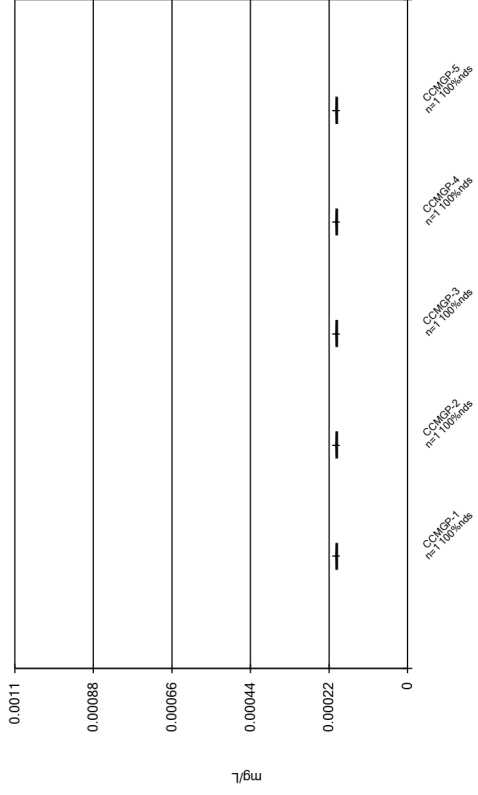


Constituent: Mercury Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

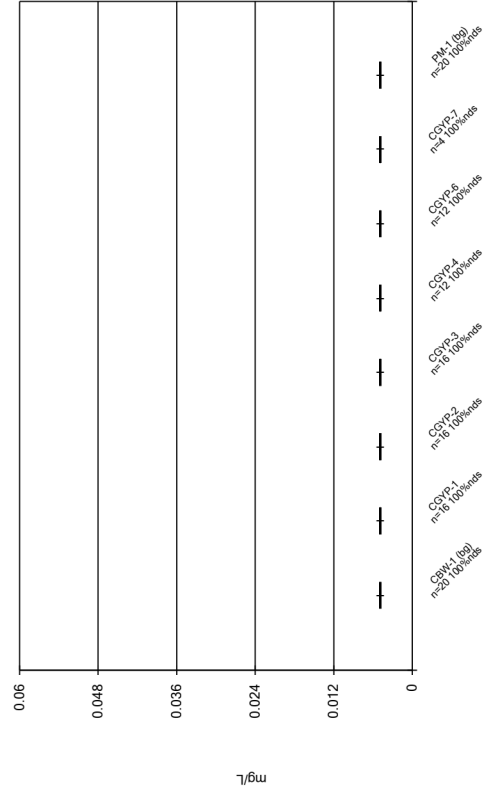


Constituent: Molybdenum Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

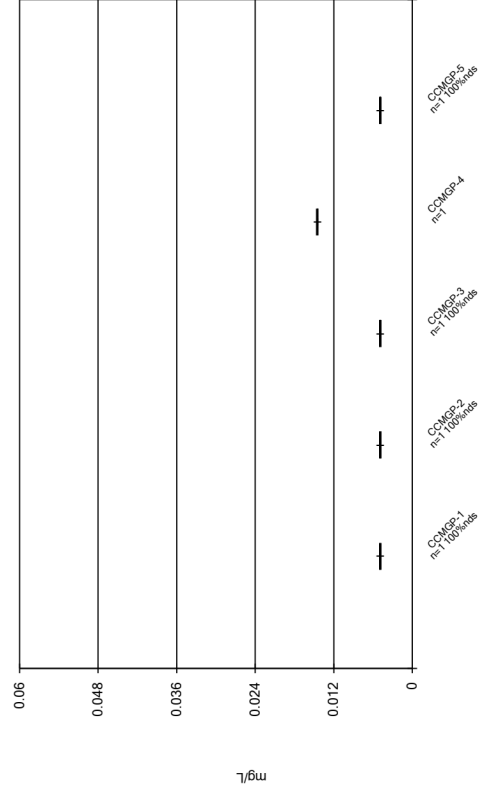


Constituent: Molybdenum Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

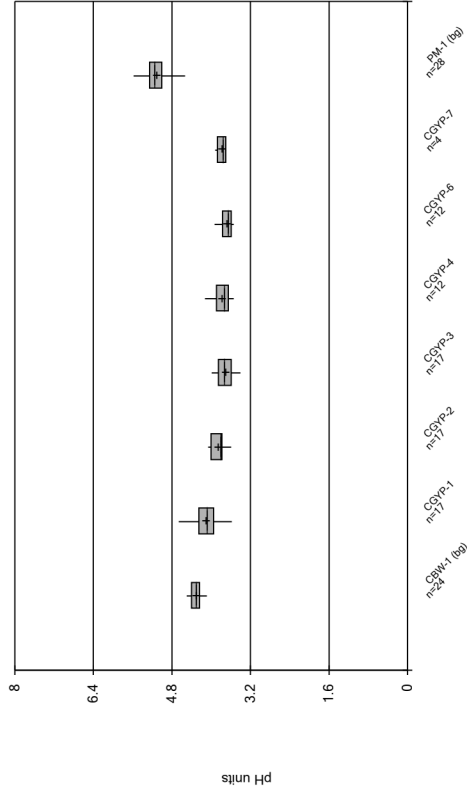


Constituent: pH, Field Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

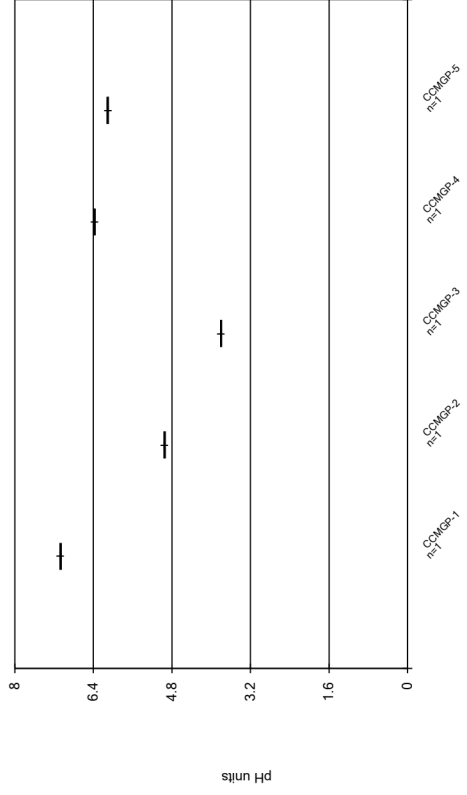


Constituent: pH, Field Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

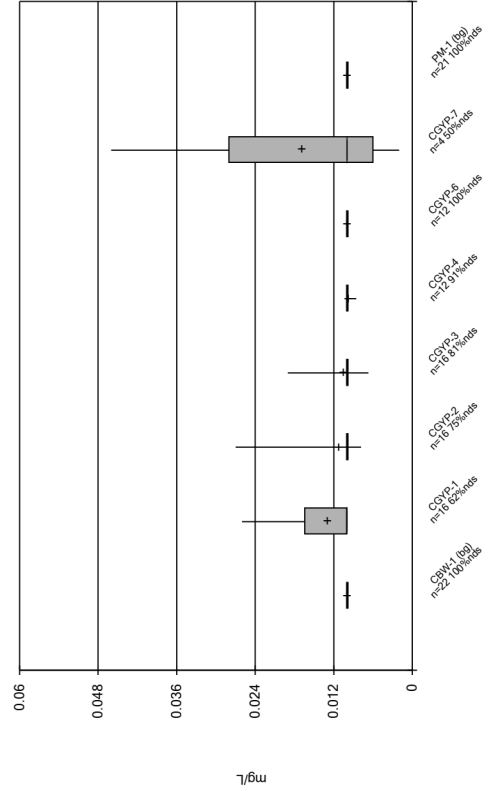


Constituent: Selenium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

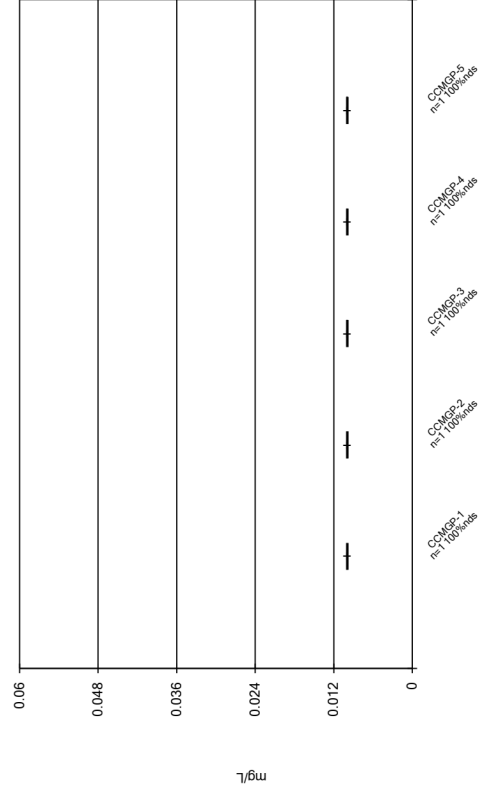


Constituent: Selenium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

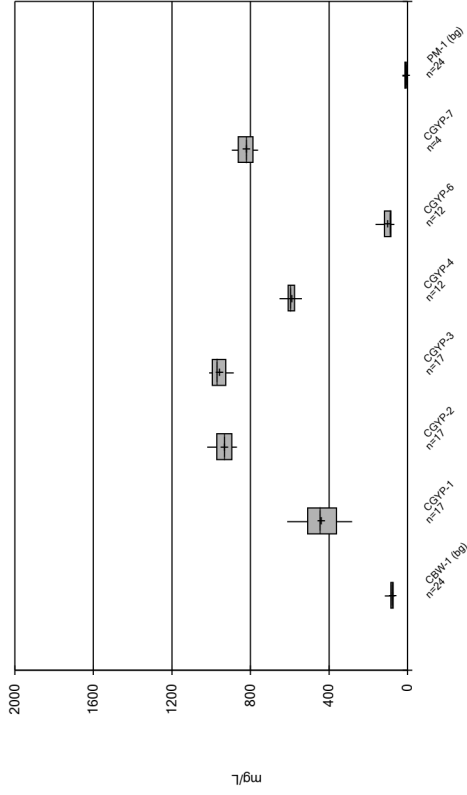


Constituent: Sulfate Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

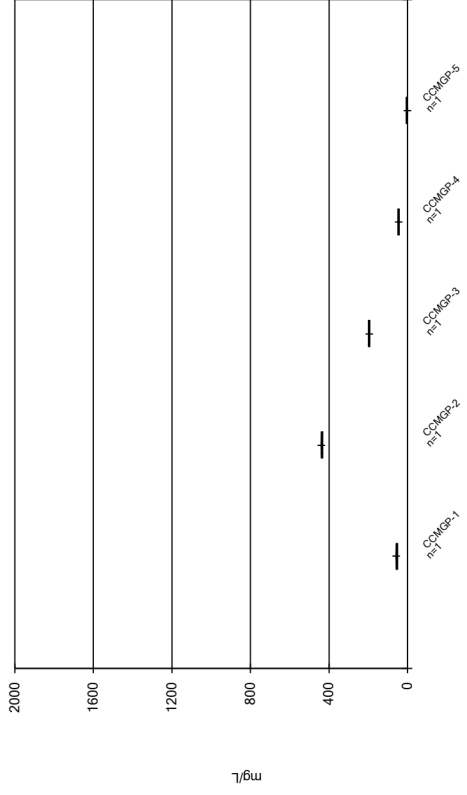


Constituent: Sulfate Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

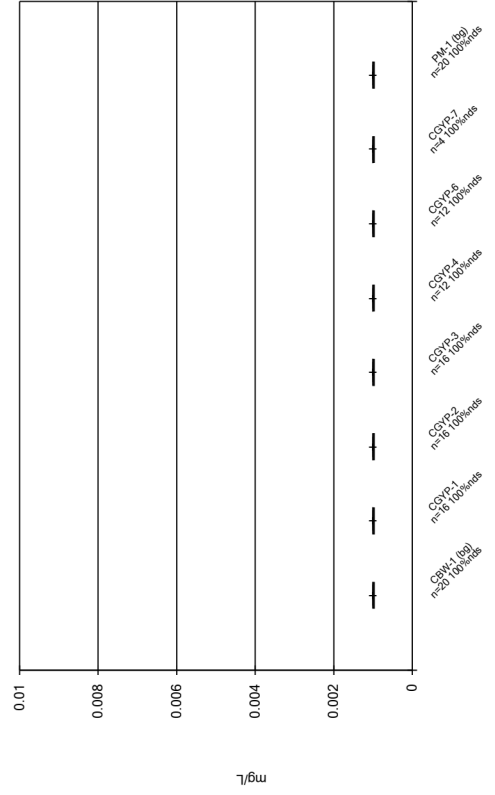


Constituent: Thallium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

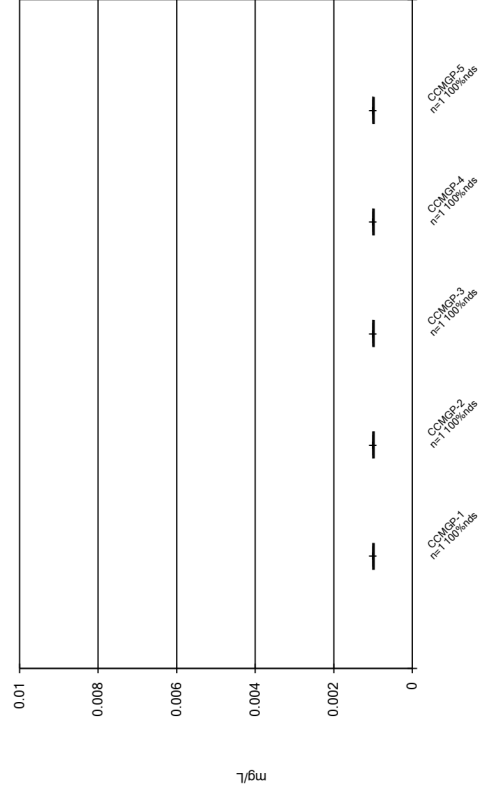


Constituent: Thallium Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

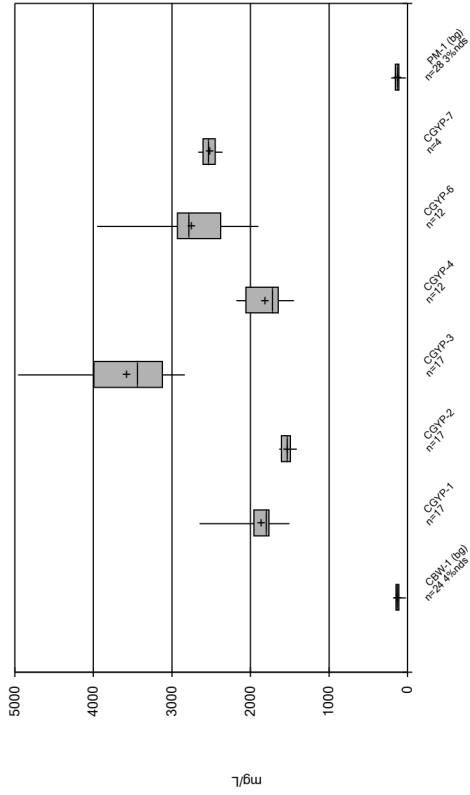

Constituent: Total Dissolved Solids Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

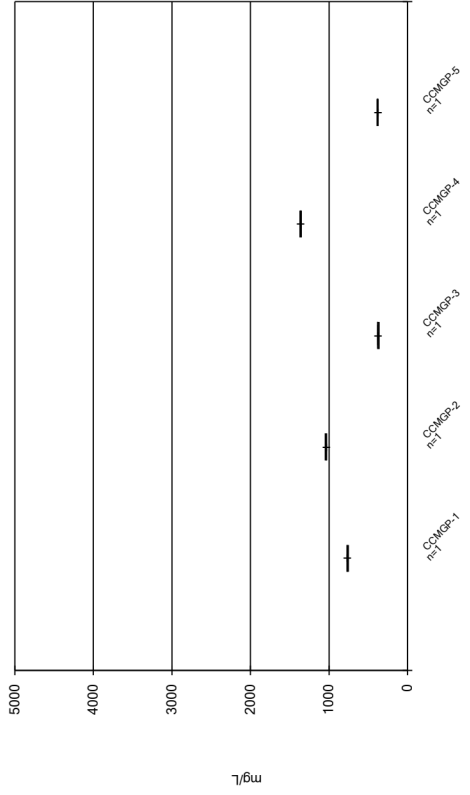

Constituent: Total Dissolved Solids Analysis Run 9/13/2023 11:36 AM
CGYP Client: Santee Cooper Data: CGYP

FIGURE C.

Outlier Summary

CGYP Client: Santee Cooper Data: CGYP Printed 9/13/2023, 11:37 AM

CGYP-3 Lead (mg/L)

2/10/2021 0.092 (o)

FIGURE D.

Appendix III Intrawell Prediction Limits - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 10/24/2023, 10:35 AM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-3	0.836	n/a	6/7/2023	16.7	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.836	n/a	6/7/2023	5.53	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.836	n/a	6/7/2023	8.85	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.33	n/a	6/6/2023	181	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.33	n/a	6/7/2023	254	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.33	n/a	6/7/2023	508	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.33	n/a	6/7/2023	254	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.33	n/a	6/7/2023	486	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	6/6/2023	679	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	6/7/2023	55.9	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	6/7/2023	872	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	6/7/2023	353	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	6/7/2023	1070	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	6/6/2023	0.89	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	6/7/2023	0.53	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	6/7/2023	1.6	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	6/7/2023	1.16	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	6/7/2023	0.68	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	6/7/2023	4	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	6/7/2023	3.67	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	6/7/2023	3.74	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	6/6/2023	282	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	6/7/2023	904	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	6/7/2023	964	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	6/7/2023	538	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	6/7/2023	129	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	199.3	n/a	6/6/2023	1584	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	199.3	n/a	6/7/2023	1451	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	199.3	n/a	6/7/2023	2906	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	199.3	n/a	6/7/2023	1445	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	199.3	n/a	6/7/2023	2774	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2


Appendix III Intrawell Prediction Limits - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 10/24/2023, 10:35 AM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.836	n/a	6/6/2023	0.191	No	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.836	n/a	6/7/2023	0.781	No	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.836	n/a	6/7/2023	16.7	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.836	n/a	6/7/2023	5.53	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.836	n/a	6/7/2023	8.85	Yes	45	n/a	n/a	24.44	n/a	n/a	0.0009391	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.33	n/a	6/6/2023	181	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.33	n/a	6/7/2023	254	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.33	n/a	6/7/2023	508	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.33	n/a	6/7/2023	254	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.33	n/a	6/7/2023	486	Yes	47	21.97	7.678	0	None	No	0.001504	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	6/6/2023	679	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	6/7/2023	55.9	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	6/7/2023	872	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	6/7/2023	353	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	6/7/2023	1070	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	6/6/2023	0.89	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	6/7/2023	0.53	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	6/7/2023	1.6	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	6/7/2023	1.16	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	6/7/2023	0.68	Yes	44	n/a	n/a	52.27	n/a	n/a	0.0009784	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	6/6/2023	4.66	No	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	6/7/2023	4	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	6/7/2023	3.67	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	6/7/2023	4.13	No	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	6/7/2023	3.74	Yes	52	n/a	n/a	0	n/a	n/a	0.001398	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	6/6/2023	282	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	6/7/2023	904	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	6/7/2023	964	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	6/7/2023	538	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	6/7/2023	129	Yes	48	n/a	n/a	0	n/a	n/a	0.0008213	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	199.3	n/a	6/6/2023	1584	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	199.3	n/a	6/7/2023	1451	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	199.3	n/a	6/7/2023	2906	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	199.3	n/a	6/7/2023	1445	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	199.3	n/a	6/7/2023	2774	Yes	52	128.3	38.22	3.846	None	No	0.001504	Param Inter 1 of 2

Exceeds Limit: CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

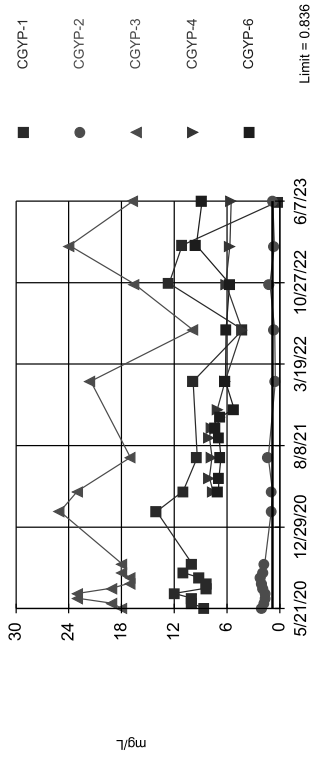


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 45 background values. 24.44% NDs. Annual per-constituent alpha = 0.009352. Individual comparison alpha = 0.0009391 (1 of 2). Comparing 5 points to limit.

Limit = 0.836

Constituent: Boron Analysis Run 10/24/2023 10:27 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

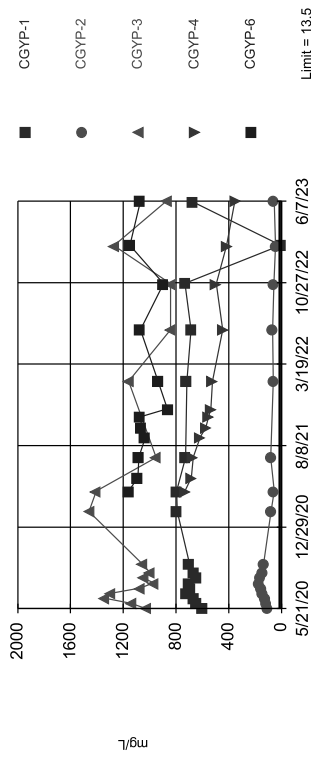


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 48 background values. Annual per-constituent alpha = 0.0008182. Individual comparison alpha = 0.0008213 (1 of 2). Comparing 5 points to limit.

Limit = 13.5

Constituent: Chloride Analysis Run 10/24/2023 10:27 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Parametric

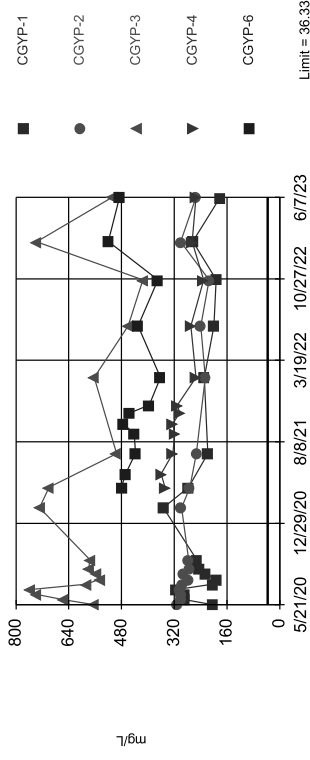


Background Data Summary: Mean=21.97, Std. Dev.=7.678, n=47, Normality test: Shapiro.Wilk.@alpha = 0.01, calculated = 0.9827, critical = 0.928. Kappa = 1.87 (c=7, w=5, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.001504. Comparing 5 points to limit.

Limit = 36.33

Constituent: Calcium Analysis Run 10/24/2023 10:27 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

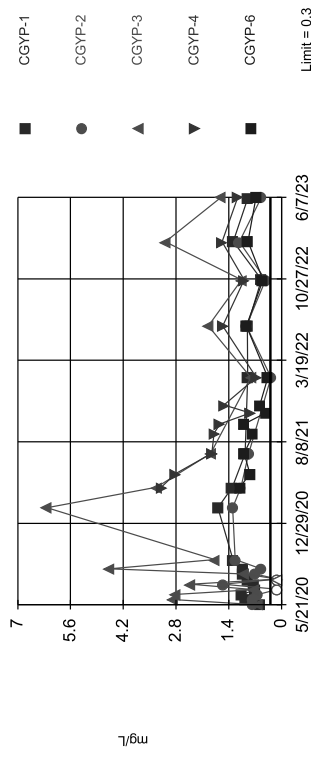


Non-parametric test used in lieu of parametric prediction limit because censored data exceeded 50%. Limit is highest of 44 background values. 52.27% NDs. Annual per-constituent alpha = 0.0009741. Individual comparison alpha = 0.0009784 (1 of 2). Comparing 5 points to limit.

Limit = 0.3

Constituent: Fluoride Analysis Run 10/24/2023 10:27 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limits: CGYP-2, CGYP-3, CGYP-6

Prediction Limit
Interwell Non-parametric

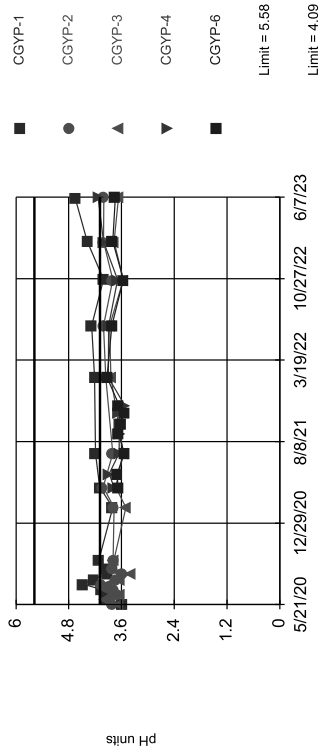


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Francia normality test showed the data to be non-normal at the 0.01 alpha level. Limits are highest and lowest of 52 background values. Annual per-constituent alpha = 0.01393. Individual comparison alpha = 0.001398 (1 of 2). Comparing 5 points to limit.

Constituent: pH, Field Analysis Run 10/24/2023 10:27 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

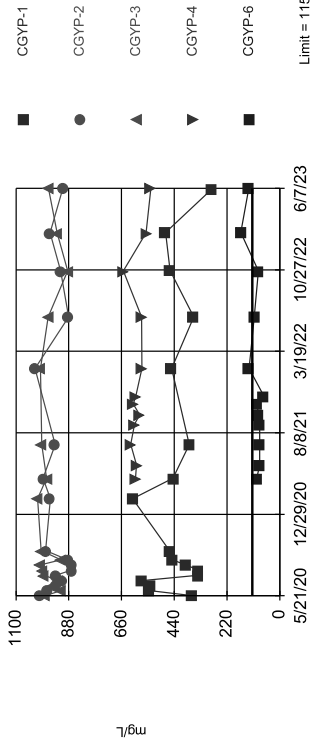


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 48 background values. Annual per-constituent alpha = 0.008182. Individual comparison alpha = 0.0008213 (1 of 2). Comparing 5 points to limit.

Constituent: Sulfate Analysis Run 10/24/2023 10:27 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Parametric

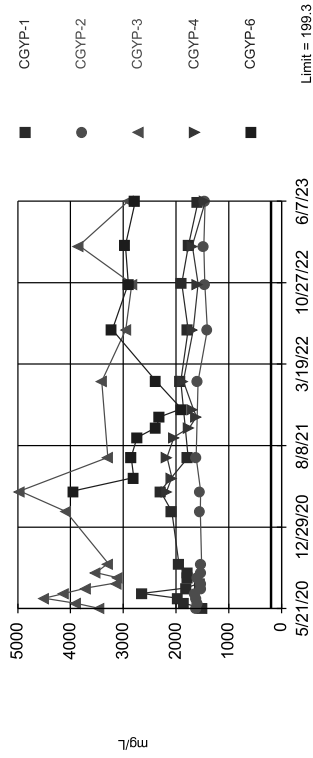

Background Data Summary: Mean=128.3, Std. Dev.=38.22, n=52, 3.846% NDs. Normality test: Shapiro Francia @alpha = 0.01, calculated = 0.943, critical = 0.937. Kappa = 1.858 (c=7, w=5, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.001504. Comparing 5 points to limit.

Constituent: Total Dissolved Solids Analysis Run 10/24/2023 10:27 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Prediction Limit

Constituent: Boron (mg/L) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs
 CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-3	CGYP-1	CGYP-2	CGYP-6	CGYP-4
10/19/2015	0.032	0.0178					
1/26/2016	0.0218	<0.015					
4/19/2016	0.0183	<0.015					
7/18/2016	0.0217	0.0163					
10/11/2016	0.0302	0.0165					
1/23/2017	0.0249	<0.015					
4/17/2017	0.018	0.019					
7/25/2017	0.022						
9/25/2017	0.024	0.018					
10/9/2017	0.023	0.021					
2/7/2018	0.018	<0.015					
6/20/2018	0.02	0.016					
10/1/2018	0.025	0.015					
2/12/2019	<0.015	<0.015					
2/24/2020	0.017	<0.015					
5/21/2020			18	8.6	2		
6/4/2020			19	10	1.7		
6/18/2020			23	10	1.6		
6/22/2020	0.018	0.049					
7/1/2020			23	12			
7/2/2020					1.6		
7/16/2020			19	8.3	1.9		
7/30/2020			17	8.3	2		
8/13/2020			17	9.1	2.1		
8/27/2020			18	11	1.9		
9/21/2020			18	10	1.7		
1/26/2021	0.018	<0.015					
2/10/2021			25	14	0.96		
4/7/2021			23	11	0.85	7	7.6
5/13/2021						6.9	8
6/21/2021	<0.015	<0.015					
7/7/2021			17	9.4	1.3		
7/8/2021						6.7	7.7
8/31/2021						6.9	
9/1/2021							8
9/27/2021						7.3	7.8
10/26/2021						6.7	6.8
11/17/2021						5.2	7.1
1/24/2022	0.0139	0.011					
1/31/2022			21.5	9.84	0.51	6.2	6.21
6/20/2022	0.015	<0.015					
6/21/2022			9.9	4.2	0.57	6.1	4.3
10/25/2022	0.0203	0.0437	16.6		1.14	5.71	6.13
10/26/2022				12.6			
1/24/2023	0.0175	0.0114					
2/6/2023			23.9		0.602		5.67
2/7/2023				11.1		9.49	
6/5/2023		0.0184					
6/6/2023	0.836			0.191			
6/7/2023			16.7		0.781	8.85	5.53

Prediction Limit

Constituent: Calcium (mg/L) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-3	CGYP-2	CGYP-1	CGYP-6	CGYP-4
10/19/2015	27	26					
1/26/2016	27	27					
4/19/2016	29.4	23.3					
7/18/2016	28.7	18.8					
10/11/2016	22.7	16.4					
1/23/2017	26.2	10.4					
4/17/2017	25.6	12.5					
7/12/2017		18.5					
9/25/2017	21.9	15.4					
10/9/2017	23	17					
2/7/2018	24	14.7					
6/20/2018	24	37					
10/1/2018	22.7	16.6					
2/12/2019	24.4	15.9					
5/20/2019	42.2	16.4					
2/24/2020	28.2	11					
5/21/2020			564	311	204		
6/4/2020			658	298	290		
6/18/2020			737	299	289		
6/22/2020	28.4	13.5					
7/1/2020			759		315		
7/2/2020				305			
7/16/2020			587	295	204		
7/30/2020			545	279	192		
8/13/2020			556	293	224		
8/27/2020			579	272	242		
9/21/2020			576	276	252		
1/26/2021	29.2	14.3					
2/10/2021			729	298	353		
4/7/2021			700	273	276	480	348
5/13/2021						468	360
6/21/2021	29.9	17					
7/7/2021			495	253	218		
7/8/2021						438	324
8/31/2021						441	
9/1/2021							319
9/27/2021						474	325
10/26/2021						455	304
11/17/2021						396	310
1/24/2022	27.9	14.4					
1/31/2022			563	226	229	362	254
6/20/2022	29	6.2					
6/21/2022			460	240	200	430	270
10/25/2022	27.5	13.1	415	214		370	231
10/26/2022					193		
1/24/2023	29.3	12.6					
2/6/2023			737	301			266
2/7/2023					264	520	
6/5/2023		12.7					
6/6/2023	33.9				181		
6/7/2023			508	254		486	254

Prediction Limit

Constituent: Chloride (mg/L) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-3	CGYP-2	CGYP-1	CGYP-6	CGYP-4
10/19/2015	3.21	12.7					
1/26/2016	2.95	11.3					
4/19/2016	2.33	12.1					
7/18/2016	2.95	13.2					
10/11/2016	3	12.8					
1/23/2017	2.45	13.5					
4/17/2017	2.96	12.7					
7/12/2017		12.1					
7/25/2017	2.61						
9/25/2017	2.51	13.3					
10/9/2017	2.73	12.6					
2/7/2018	2.88	12.4					
6/20/2018	3	13.4					
10/1/2018	2.71	12.9					
2/12/2019	2.68	12.1					
5/20/2019	2.9	12.7					
2/24/2020	3.25	12.7					
5/21/2020			1030	103	600		
6/4/2020			1140	117	644		
6/18/2020			1340	127	666		
6/22/2020	3.44	12.67					
7/1/2020			1300		717		
7/2/2020				145			
7/16/2020			1070	153	694		
7/30/2020			971	176	703		
8/13/2020			1050	163	647		
8/27/2020			998	146	666		
9/21/2020			1060	136	699		
1/26/2021	3.22	11.8					
2/10/2021			1460	79.5	791		
4/7/2021			1405	55.87	795	1160	733
5/13/2021						1090	683
6/21/2021	3.05	12					
7/7/2021			950	83.1	728		
7/8/2021						1082	670
8/31/2021						1033	
9/1/2021							617
9/27/2021						1061	574
10/26/2021						1070	553
11/17/2021						865	537
1/24/2022	3.21	12.1					
1/31/2022			1160	63	717	937	523
6/20/2022	3.79	13.4					
6/21/2022			841	66.4	686	1070	445
10/25/2022	3.78	12.7	842	57.3		896	495
10/26/2022					733		
1/24/2023	3	12.3					
2/6/2023			1270	46			417
2/7/2023					7.21	1150	
6/5/2023		12.4					
6/6/2023	3.73				679		
6/7/2023			872	55.9		1070	353

Prediction Limit

Constituent: Fluoride (mg/L) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-3	CGYP-2	CGYP-6	CGYP-4
10/19/2015	0.25	<0.1					
1/26/2016	0.3	<0.1					
4/19/2016	0.29	<0.1					
7/18/2016	0.27	<0.1					
10/11/2016	0.28	<0.1					
1/23/2017	0.25	<0.1					
4/17/2017	0.22	<0.1					
9/25/2017	0.23	<0.1					
10/9/2017	0.22	<0.1					
2/7/2018	0.19	<0.1					
6/20/2018	0.2	<0.1					
10/1/2018	0.19	<0.1					
2/12/2019	0.18	<0.1					
2/24/2020	0.19	<0.1					
5/21/2020			0.58	0.65	0.75		
6/4/2020			0.96	2.89	0.75		
6/18/2020			1.05	2.82	0.62		
6/22/2020	0.2	<0.1					
7/1/2020			0.69	0.73			
7/2/2020					<0.1		
7/16/2020			0.72	2.41	1.55		
7/30/2020			0.91	<0.1	<0.1		
8/13/2020			1.04	1	0.71		
8/27/2020			1.02	4.57	0.54		
9/21/2020			1.29	1.77	1.23		
1/26/2021	0.15	<0.1					
2/10/2021			1.69	6.22	1.3		
4/7/2021			1.31	3.32	1.08	1.1	3.19
5/13/2021						0.84	2.82
6/21/2021	0.19	<0.1					
7/7/2021			0.97	1.88	0.87		
7/8/2021						0.99	1.85
8/31/2021						0.75	
9/1/2021							1.79
9/27/2021						0.98	1.63
10/26/2021						0.42	0.83
11/17/2021						0.58	1.53
1/24/2022	0.22	<0.1					
1/31/2022			0.9	0.81	0.28	0.36	0.67
6/20/2022	0.18	<0.1					
6/21/2022			0.91	1.94	0.93	0.93	1.56
10/25/2022	<0.1	<0.1		1.06	0.42	0.49	0.99
10/26/2022			0.53				
1/24/2023	0.15	<0.1					
2/6/2023				3.08	1.12		1.58
2/7/2023			1.28			0.89	
6/5/2023		<0.1					
6/6/2023	0.23		0.89				
6/7/2023				1.6	0.53	0.68	1.16

Prediction Limit

Constituent: pH, Field (pH units) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-6	CGYP-4
1/26/2015	4.53						
2/16/2015	4.68						
6/16/2015	4.74						
7/6/2015	5.25						
10/19/2015	5.47	4.45					
1/26/2016	5.2	4.12					
4/19/2016	5.32	4.33					
7/18/2016	5.2	4.38					
10/11/2016	5.01	4.14					
1/23/2017	5.01	4.32					
4/17/2017	5.19	4.26					
7/12/2017	5.11						
7/25/2017		4.21					
9/25/2017	5.27	4.32					
10/9/2017	5.21	4.25					
2/7/2018	5.29	4.42					
6/20/2018	5.58	4.32					
10/1/2018	5.08	4.09					
2/12/2019	5.47	4.5					
5/20/2019	5.26	4.5					
2/24/2020	4.92	4.09					
5/21/2020			3.82	3.66	3.58		
6/4/2020			3.86	3.99	3.98		
6/18/2020			3.69	3.63	3.89		
6/22/2020	5.12	4.48					
7/1/2020				3.96	4.06		
7/2/2020			3.79				
7/16/2020			4.06	3.93	4.48		
7/30/2020			3.72	3.63	4.22		
8/13/2020			3.59	3.4	3.92		
8/27/2020			3.81	3.81	3.98		
9/21/2020			3.79	3.77	4.11		
1/26/2021	5.03	4.31					
2/10/2021			3.77	3.5	3.8		
4/7/2021			4.02	3.73	4.1	3.68	3.78
5/13/2021						3.7	3.88
6/21/2021	5.21	4.25					
7/7/2021			3.8	3.56	4.19		
7/8/2021						3.54	3.65
8/31/2021						3.67	
9/1/2021							3.65
9/27/2021						3.62	3.65
10/26/2021						3.54	3.66
11/17/2021						3.66	3.54
1/24/2022	5.19	4.26					
1/31/2022			3.96	3.84	4.21	3.93	3.9
6/20/2022	4.84	4.45					
6/21/2022			4.01	3.87	4.28	3.82	3.89
10/25/2022	5.01	4.31	3.8	3.56		3.56	3.69
10/26/2022					4.01		
1/24/2023	4.84	4.23					
2/6/2023			4.01	3.77			4.01

Prediction Limit

Constituent: pH, Field (pH units) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-6	CGYP-4
2/7/2023					4.38	3.8	
6/5/2023	5.08						
6/6/2023		4.34			4.66		
6/7/2023			4	3.67		3.74	4.13

Prediction Limit

Constituent: Sulfate (mg/L) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-3	CGYP-2	CGYP-1	CGYP-6	CGYP-4
10/19/2015	81.5	26.5					
1/26/2016	88.2	25.5					
4/19/2016	86	20.2					
7/18/2016	90.1	16					
10/11/2016	73.7	19.3					
1/23/2017	77.7	8.82					
4/17/2017	71.2	9.71					
7/12/2017		11.1					
7/25/2017	73.3						
9/25/2017	74.5	8.03					
10/9/2017	76.8	8.77					
2/7/2018	69.1	13.5					
6/20/2018	67.9	8.58					
10/1/2018	65.5	11.9					
2/12/2019	69.1	8.96					
5/20/2019	115	10.5					
2/24/2020	79.8	8.36					
5/21/2020			978	1000	364		
6/4/2020			911	968	544		
6/18/2020			946.1	932	540		
6/22/2020	79.9	8.32					
7/1/2020			924		575		
7/2/2020				908			
7/16/2020			983	933	338		
7/30/2020			991	868	340		
8/13/2020			999	868	391		
8/27/2020			913	885	448		
9/21/2020			995	976	460		
1/26/2021	80.7	9.98					
2/10/2021			1010	957	613		
4/7/2021			972	987	445	96.3	602
5/13/2021						83.6	598
6/21/2021	86.6	11.9					
7/7/2021			993	937	377		
7/8/2021						84.3	621
8/31/2021						84.3	
9/1/2021							605
9/27/2021						90.9	584
10/26/2021						92.7	611
11/17/2021						67	600
1/24/2022	82.8	11.7					
1/31/2022			998	1020	451	128	575
6/20/2022	78.3	6.59					
6/21/2022			966	881	359	106	576
10/25/2022	80.4	7.99	885	914		89.3	652
10/26/2022					458		
1/24/2023	84.2	8.12					
2/6/2023			928	958			557
2/7/2023					476	163	
6/5/2023		9.11					
6/6/2023	97.1				282		
6/7/2023			964	904		129	538

Prediction Limit

Constituent: Total Dissolved Solids (mg/L) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-6	CGYP-4
1/26/2015	142.5						
2/16/2015	106.2						
6/16/2015	158						
7/6/2015	151						
10/19/2015	206	150					
1/26/2016	165	120					
4/19/2016	130	120					
7/18/2016	124	132					
10/11/2016	200	151.7					
1/23/2017	138	148					
4/17/2017	56	62					
7/12/2017	108						
7/25/2017		92					
9/25/2017	<40	<40					
10/9/2017	80	115					
2/7/2018	112	92					
6/20/2018	200	138.8					
10/1/2018	130	107.5					
2/12/2019	136.2	135					
5/20/2019	162.5	181.2					
2/24/2020	120	107.5					
5/21/2020			1609	3449	1505		
6/4/2020			1589	3895	1839		
6/18/2020			1624	4502	1964		
6/22/2020	112.5	147.5					
7/1/2020				4120	2650		
7/2/2020			1634				
7/16/2020			1512	3700	1811		
7/30/2020			1515	3138	1541		
8/13/2020			1599	3102	1768		
8/27/2020			1526	3519	1772		
9/21/2020			1515	3288	1945		
1/26/2021	110	138.8					
2/10/2021			1538	4090	2081		
4/7/2021			1536	4958	2301	3952	2178
5/13/2021						2804	2078
6/21/2021	155	178.8					
7/7/2021			1618	3291	1770		
7/8/2021						2851	2168
8/31/2021						2740	
9/1/2021							2038
9/27/2021						2382	1749
10/26/2021						2306	1614
11/17/2021						1899	1676
1/24/2022	128.8	130					
1/31/2022			1582	3410	1912	2379	1864
6/20/2022	137.5	143.8					
6/21/2022			1408	2952	1771	3210	1676
10/25/2022	96.25	110	1454	2835		2902	1585
10/26/2022					1894		
1/24/2023	111.2	142.5					
2/6/2023			1474	3838			1689

Prediction Limit

Constituent: Total Dissolved Solids (mg/L) Analysis Run 10/24/2023 10:35 AM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-6	CGYP-4
2/7/2023					1764	2959	
6/5/2023	130						
6/6/2023		178.8			1584		
6/7/2023			1451	2906		2774	1445

FIGURE E.

Appendix III Trend Tests Summary - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 9/13/2023, 11:48 AM


Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CGYP-4	-1.341	-45	-38	Yes	12	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-29.67	-77	-63	Yes	17	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-58.84	-49	-38	Yes	12	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-0.9956	-124	-105	Yes	24	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1118	119	105	Yes	24	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-2	-31.73	-66	-63	Yes	17	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-175.8	-64	-38	Yes	12	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.0184	-141	-92	Yes	22	4.545	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-0.9811	-129	-105	Yes	24	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-337.2	-45	-38	Yes	12	0	n/a	n/a	0.01	NP

Appendix III Trend Tests Summary - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 9/13/2023, 11:48 AM


Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CBW-1 (bg)	-0.0008105	-80	-98	No	23	8.696	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-3	-0.4473	-24	-63	No	17	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-4	-1.341	-45	-38	Yes	12	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-6	-0.4909	-8	-38	No	12	0	n/a	n/a	0.01	NP
Boron (mg/L)	PM-1 (bg)	0	-26	-92	No	22	40.91	n/a	n/a	0.01	NP
Calcium (mg/L)	CBW-1 (bg)	0.616	76	98	No	23	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-1	-15.74	-31	-63	No	17	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-29.67	-77	-63	Yes	17	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-3	-49.87	-41	-63	No	17	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-58.84	-49	-38	Yes	12	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-6	-28.17	-8	-38	No	12	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-0.9956	-124	-105	Yes	24	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.1118	119	105	Yes	24	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-1	16.67	32	63	No	17	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-2	-31.73	-66	-63	Yes	17	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-3	-71.52	-30	-63	No	17	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-175.8	-64	-38	Yes	12	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-6	-42.75	-17	-38	No	12	0	n/a	n/a	0.01	NP
Chloride (mg/L)	PM-1 (bg)	-0.02275	-30	-105	No	24	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.0184	-141	-92	Yes	22	4.545	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-1	0.06613	11	63	No	17	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-2	0.0109	2	63	No	17	11.76	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-3	0.0979	12	63	No	17	5.882	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-4	-0.7591	-38	-38	No	12	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-6	-0.1695	-24	-38	No	12	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	PM-1 (bg)	0	0	92	No	22	100	n/a	n/a	0.01	NP
pH, Field (pH units)	CBW-1 (bg)	0	5	105	No	24	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-2	0.07081	33	63	No	17	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-3	-0.04801	-19	-63	No	17	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-6	0.04556	11	38	No	12	0	n/a	n/a	0.01	NP
pH, Field (pH units)	PM-1 (bg)	-0.005573	-17	-131	No	28	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CBW-1 (bg)	0.8675	33	105	No	24	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-1	-16.42	-10	-63	No	17	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-2	-2.969	-5	-63	No	17	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-3	2.169	4	63	No	17	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-4	-29.27	-26	-38	No	12	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-6	22.22	29	38	No	12	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-0.9811	-129	-105	Yes	24	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CBW-1 (bg)	3.648	47	105	No	24	4.167	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-1	-14.69	-12	-63	No	17	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-2	-47.58	-57	-63	No	17	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-3	-245	-44	-63	No	17	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-337.2	-45	-38	Yes	12	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-6	-123.9	-6	-38	No	12	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	PM-1 (bg)	-2.923	-62	-131	No	28	3.571	n/a	n/a	0.01	NP

Sen's Slope Estimator

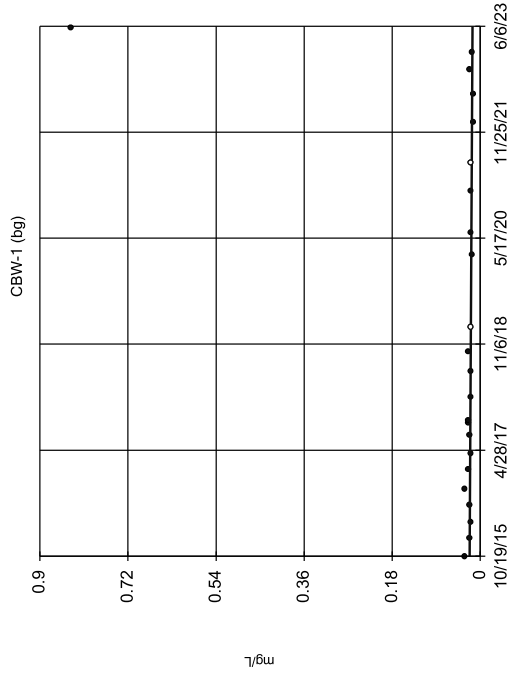


Constituent: Boron Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

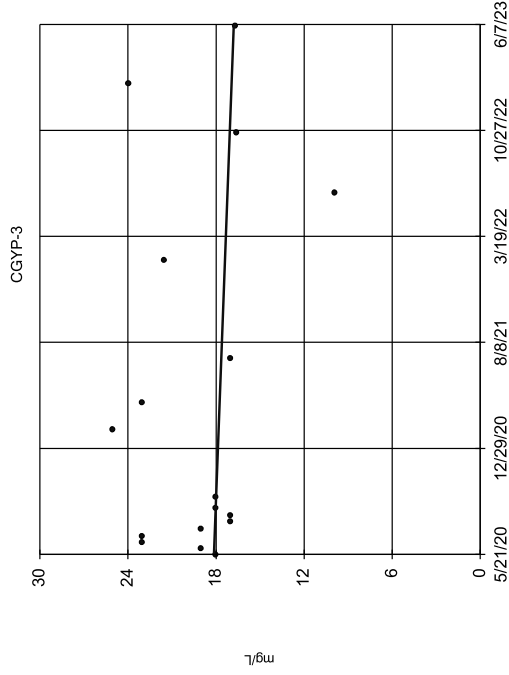


Constituent: Boron Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

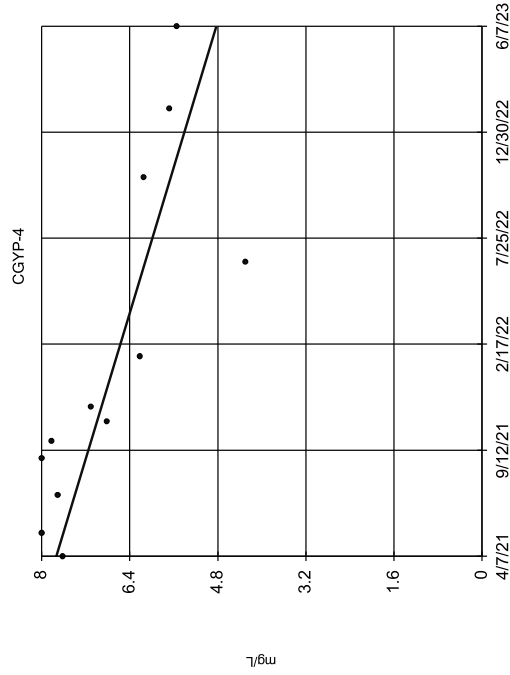


Constituent: Boron Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

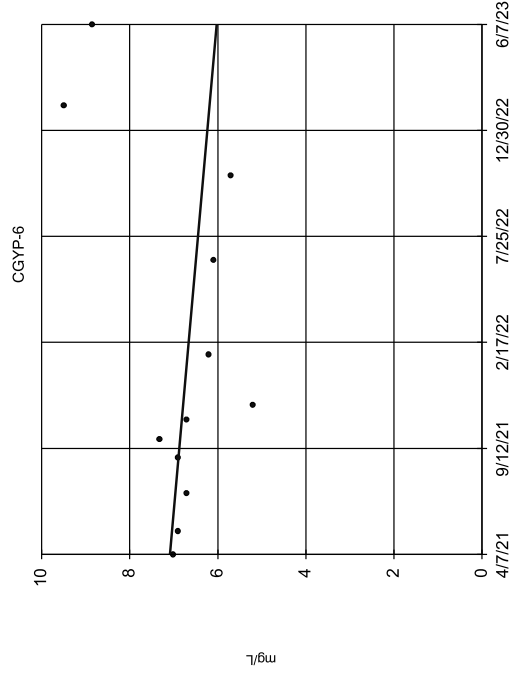


Constituent: Boron Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

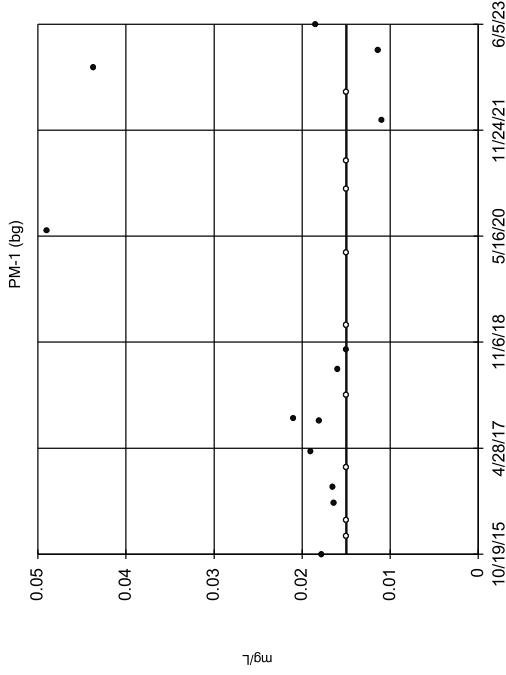


Constituent: Boron Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

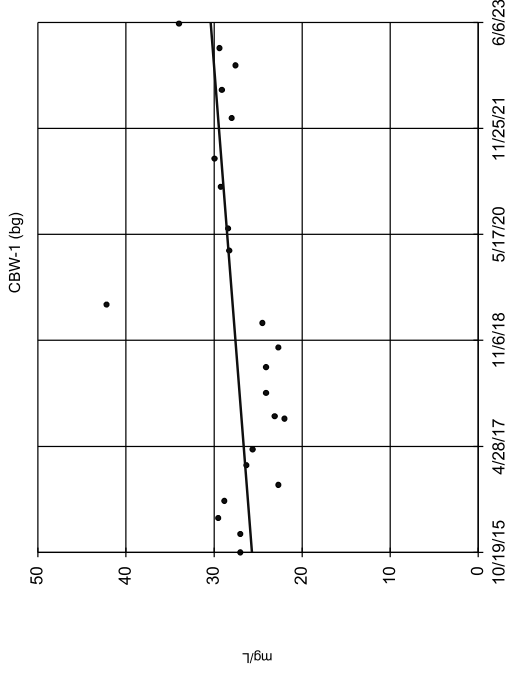


Constituent: Calcium Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

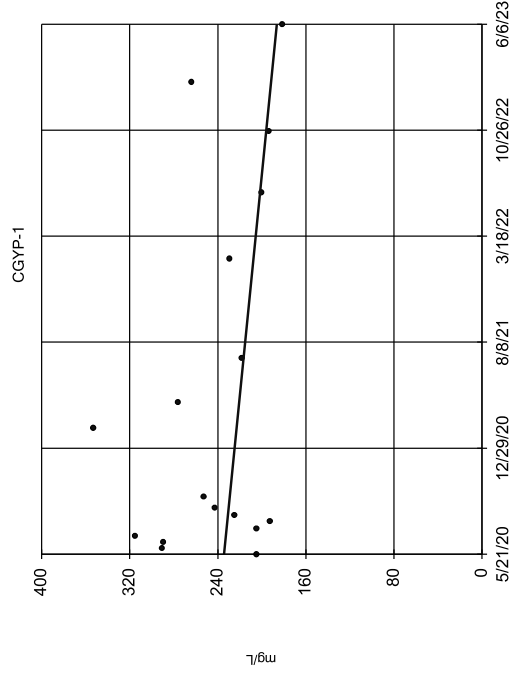


Constituent: Calcium Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

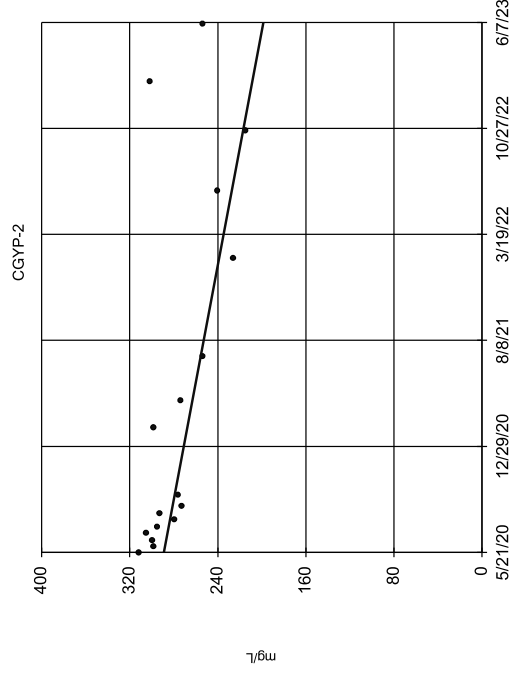


Constituent: Calcium Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

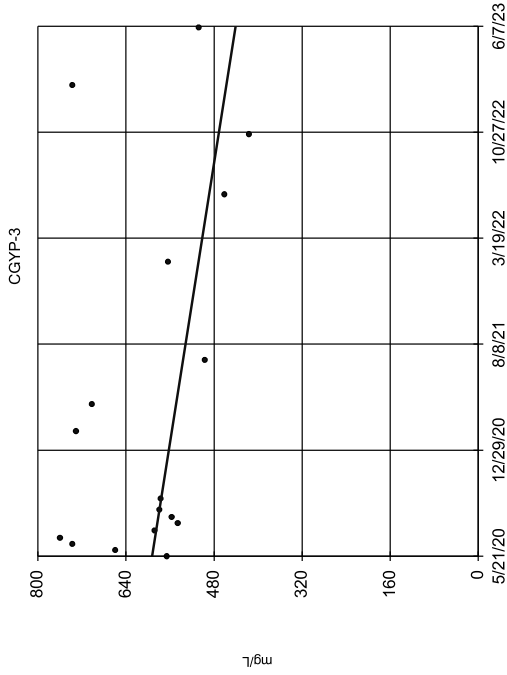


Constituent: Calcium Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

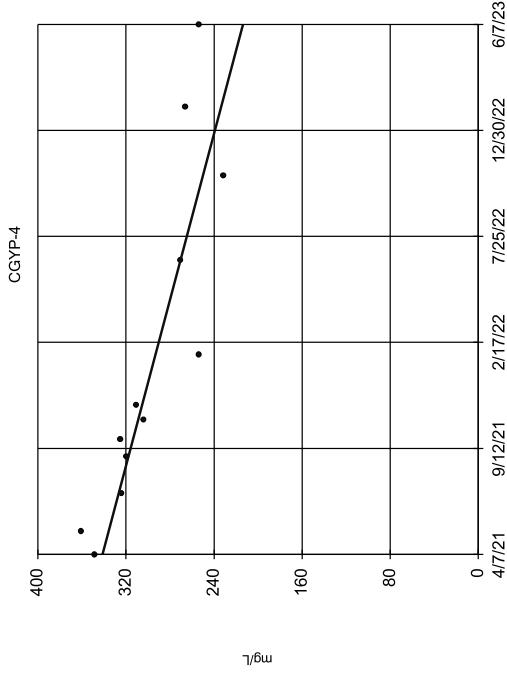


Constituent: Calcium Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

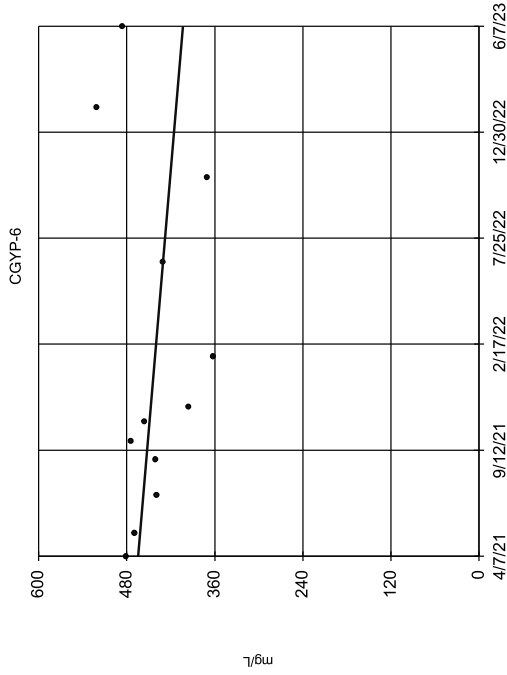


Constituent: Calcium Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

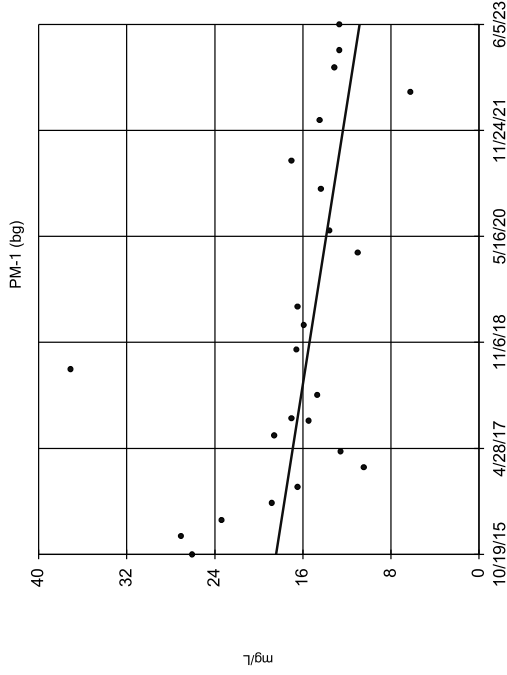

Constituent: Calcium Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

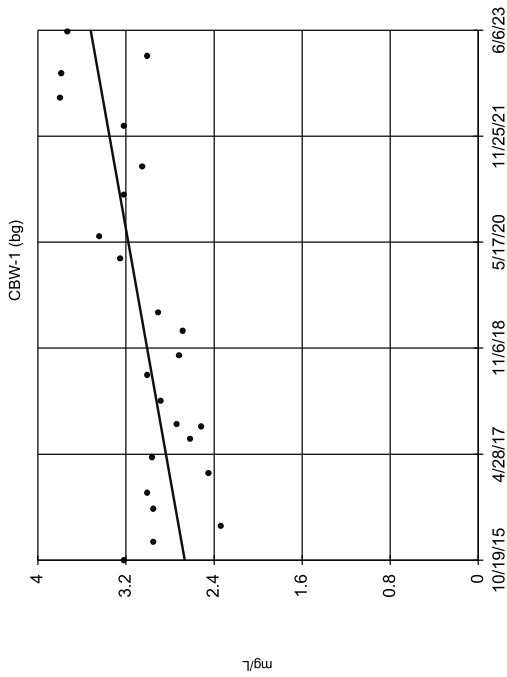

n = 24
 Slope = 0.1118
 units per year.
 Mann-Kendall
 statistic = 119
 critical = 105
 Increasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Chloride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

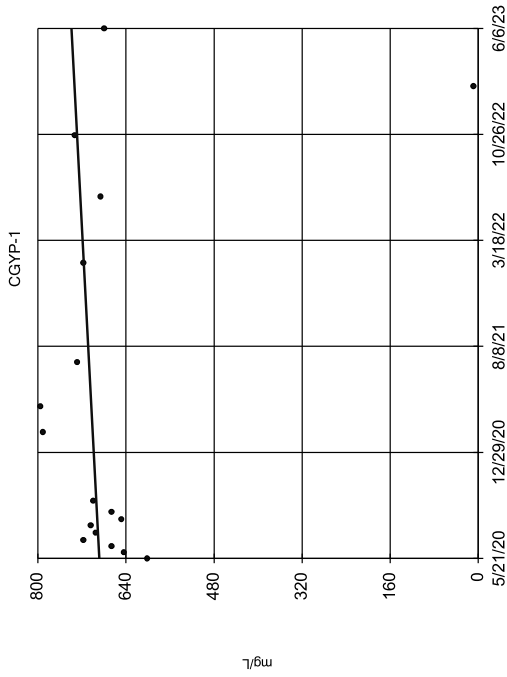

n = 17
 Slope = 16.67
 units per year.
 Mann-Kendall
 statistic = 32
 critical = 63
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Chloride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

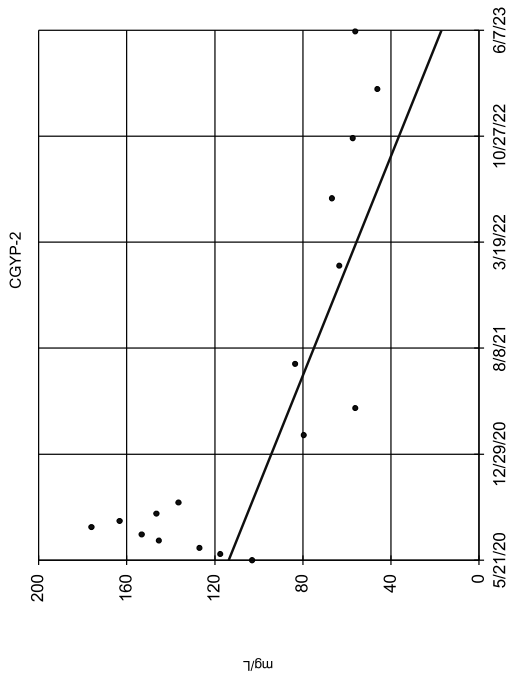

n = 17
 Slope = -31.73
 units per year.
 Mann-Kendall
 statistic = -66
 critical = -63
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Chloride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

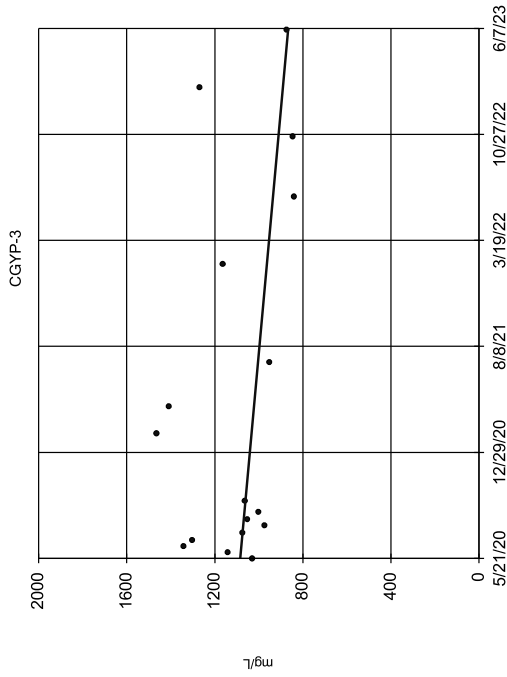

n = 17
 Slope = -71.52
 units per year.
 Mann-Kendall
 statistic = -30
 critical = -63
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).


Constituent: Chloride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

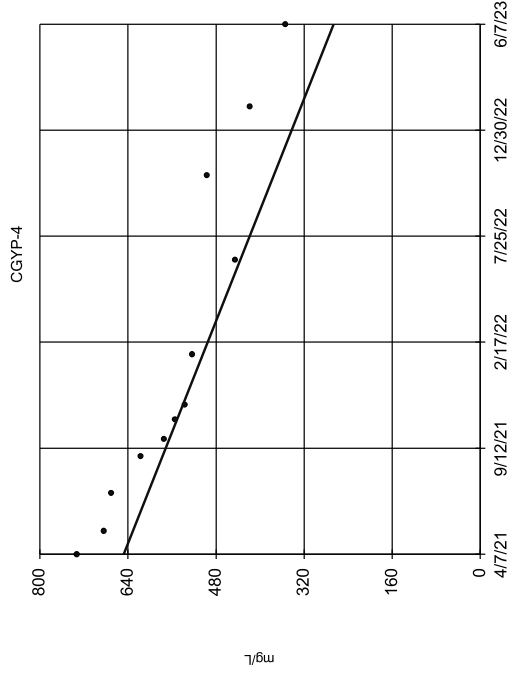


Constituent: Chloride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

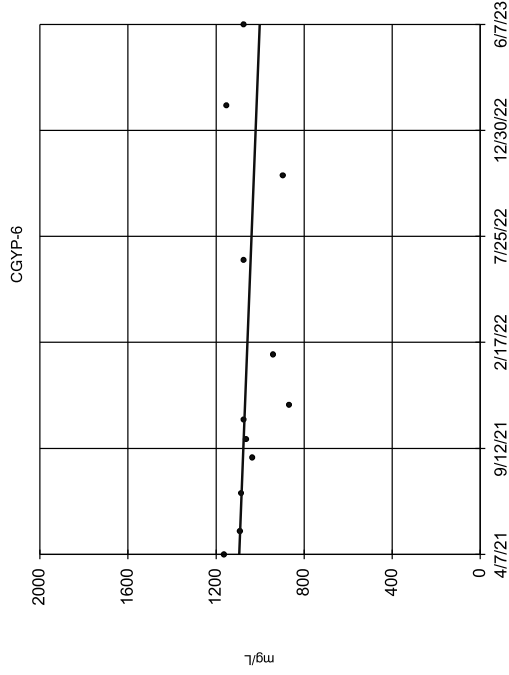


Constituent: Chloride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

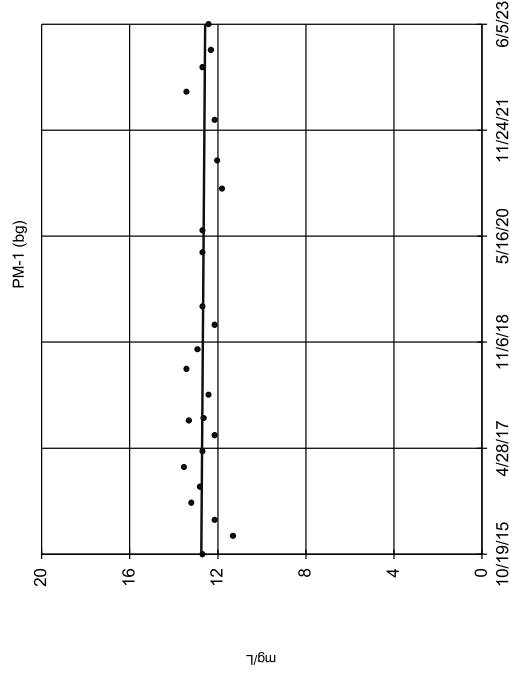

Constituent: Chloride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

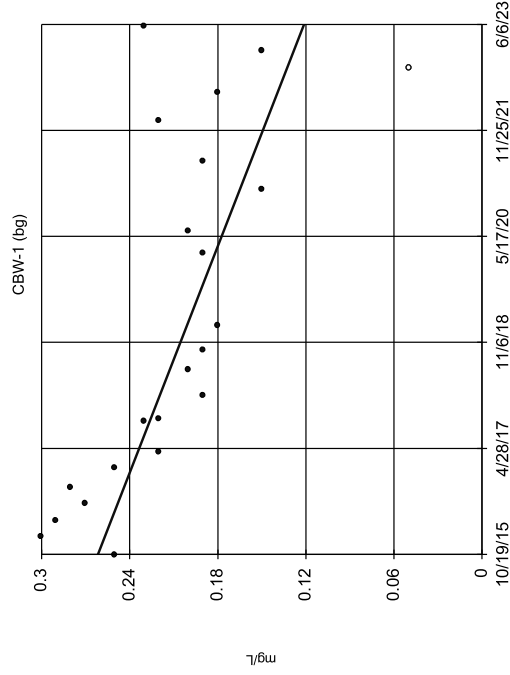

Constituent: Fluoride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-1

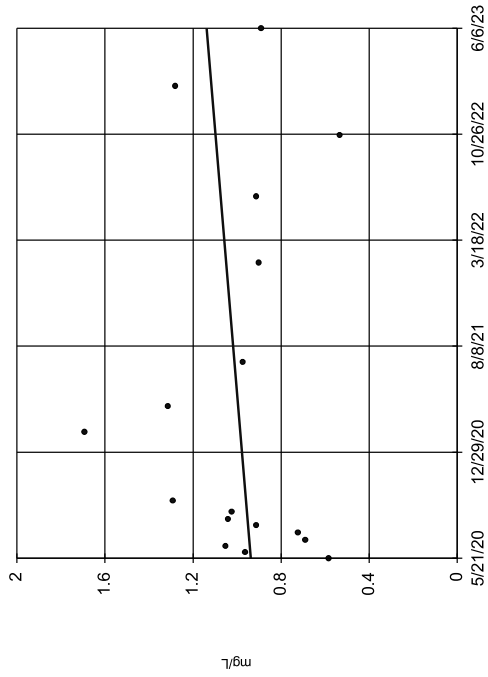


n = 17
Slope = 0.06613
units per year.
Mann-Kendall
statistic = 11
critical = 63
Trend not sig-
nificant at 99%
confidence level
(α = 0.005 per
tail).

Constituent: Fluoride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-2

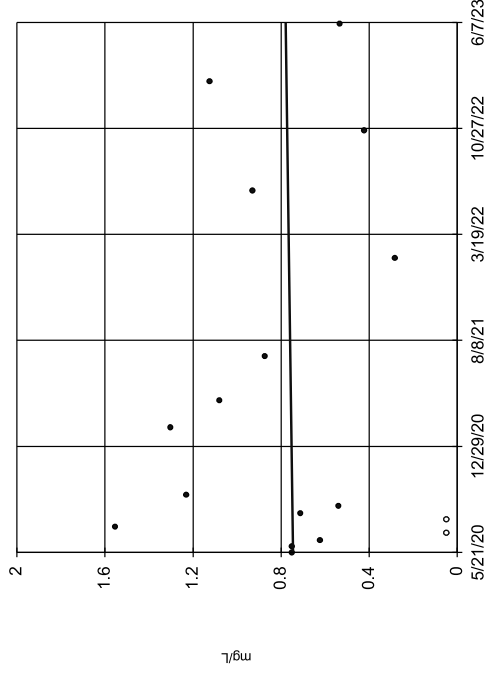


n = 17
Slope = 0.0109
units per year.
Mann-Kendall
statistic = 2
critical = 63
Trend not sig-
nificant at 99%
confidence level
(α = 0.005 per
tail).

Constituent: Fluoride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-3

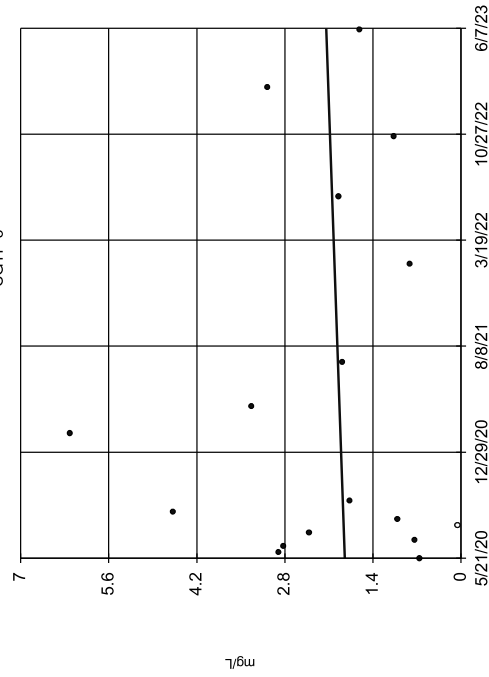


n = 17
Slope = 0.00979
units per year.
Mann-Kendall
statistic = 12
critical = 63
Trend not sig-
nificant at 99%
confidence level
(α = 0.005 per
tail).

Constituent: Fluoride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-4

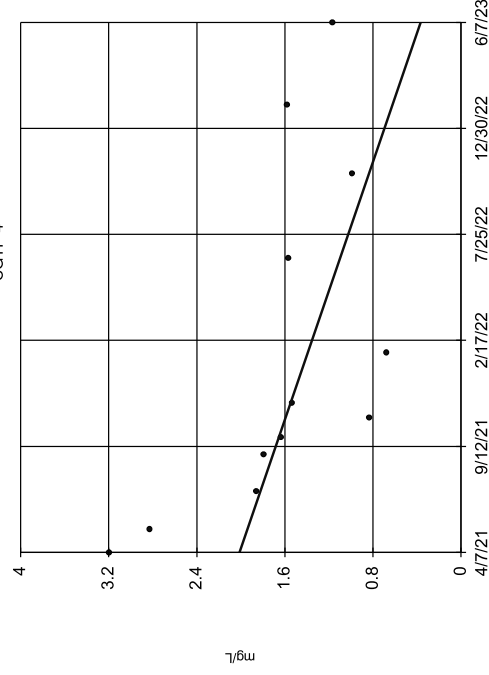

n = 12
Slope = -0.7591
units per year.
Mann-Kendall
statistic = -38
critical = -38
Trend not sig-
nificant at 99%
confidence level
(α = 0.005 per
tail).


Constituent: Fluoride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

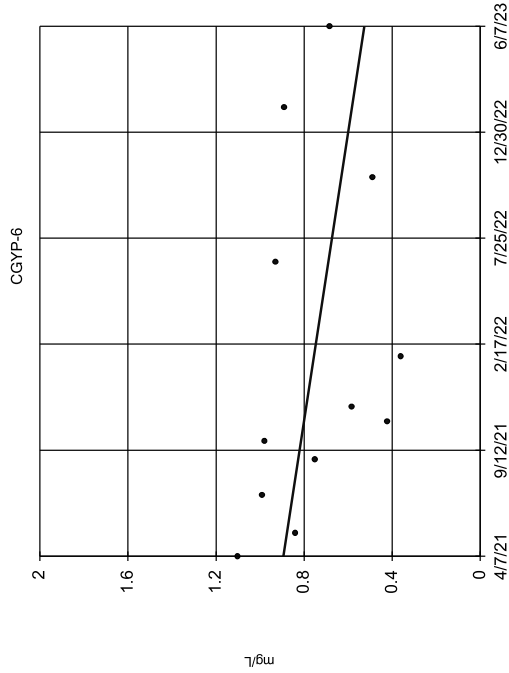


Constituent: Fluoride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

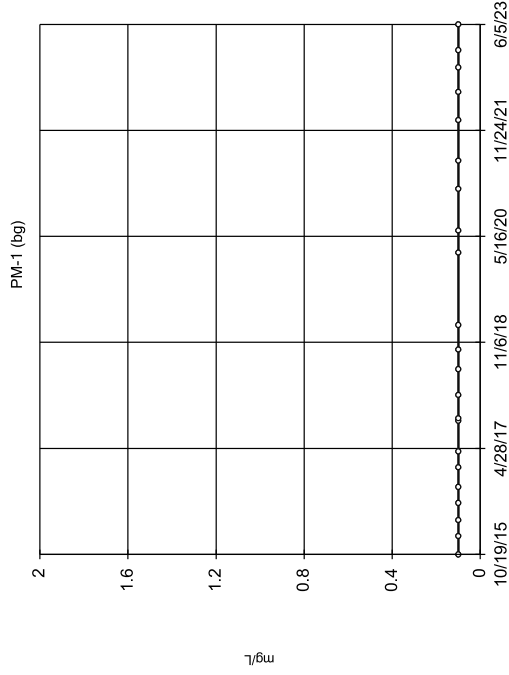


Constituent: Fluoride Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

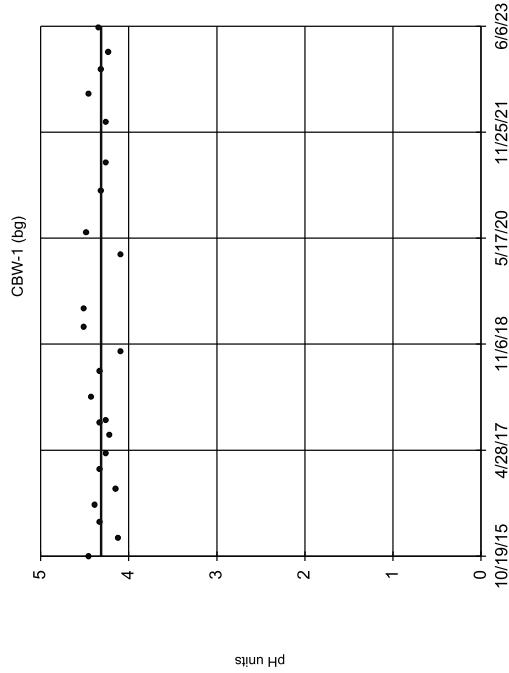

Constituent: pH, Field Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

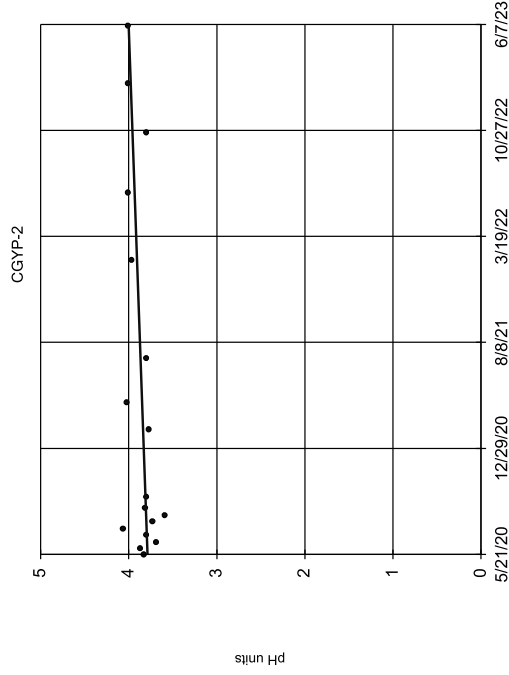

Constituent: pH, Field Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-3

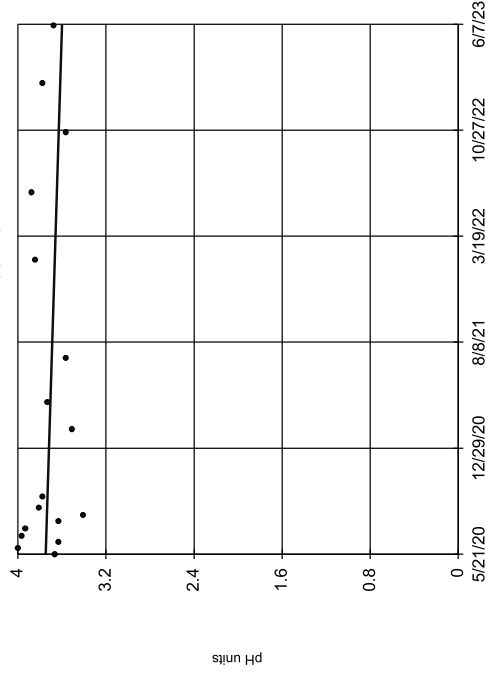


n = 17
Slope = -0.04801
units per year.
Mann-Kendall
statistic = -19
critical = -63
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: pH, Field Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-6

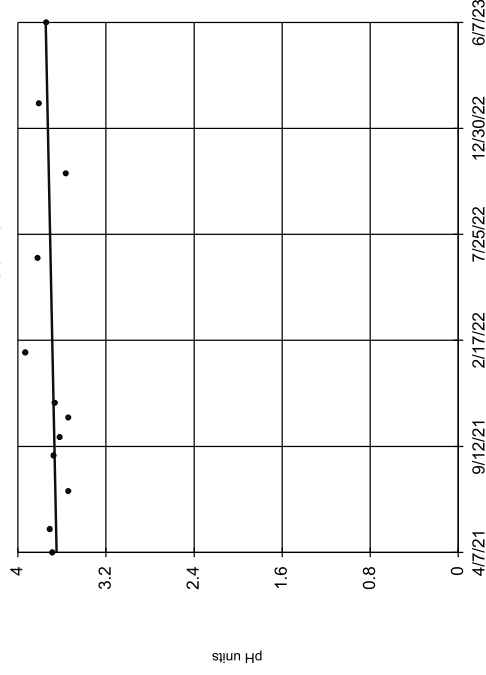


n = 12
Slope = 0.04556
units per year.
Mann-Kendall
statistic = 11
critical = 38
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: pH, Field Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

PM-1 (bg)

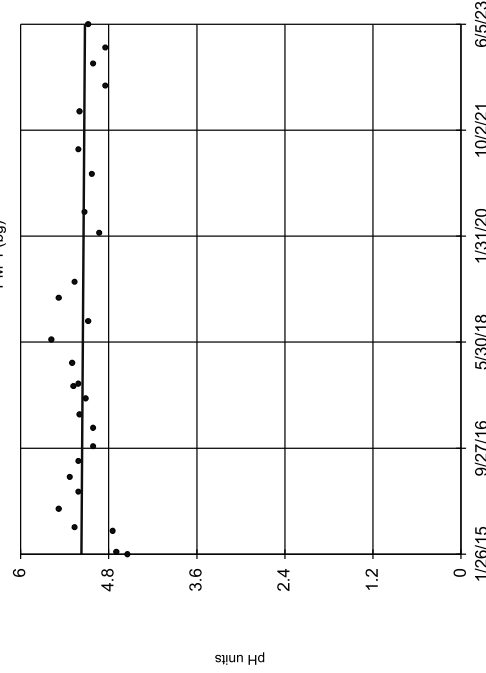


n = 28
Slope = -0.005573
units per year.
Mann-Kendall
statistic = -17
critical = -131
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: pH, Field Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CBW-1 (bg)

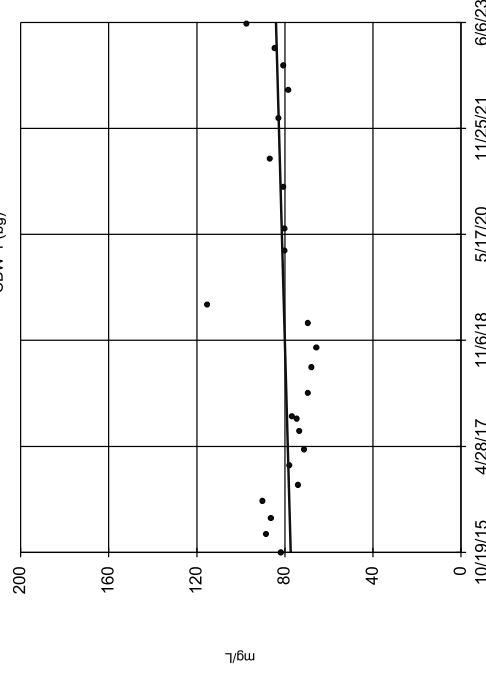


n = 24
Slope = 0.8675
units per year.
Mann-Kendall
statistic = 33
critical = 105
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Sulfate Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-1

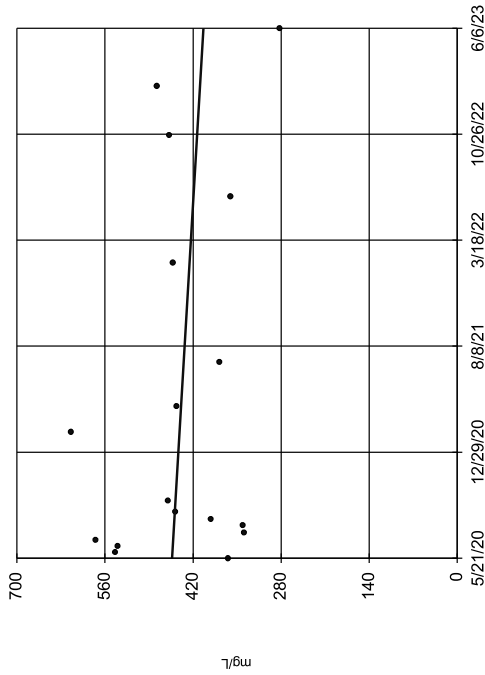

Constituent: Sulfate Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-2

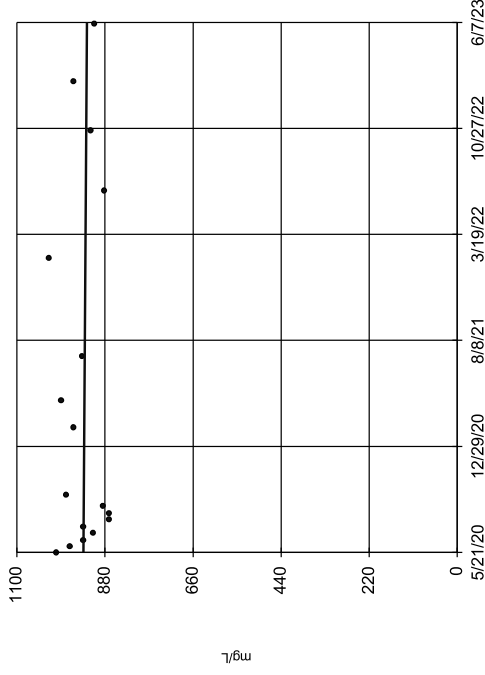

Constituent: Sulfate Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-3

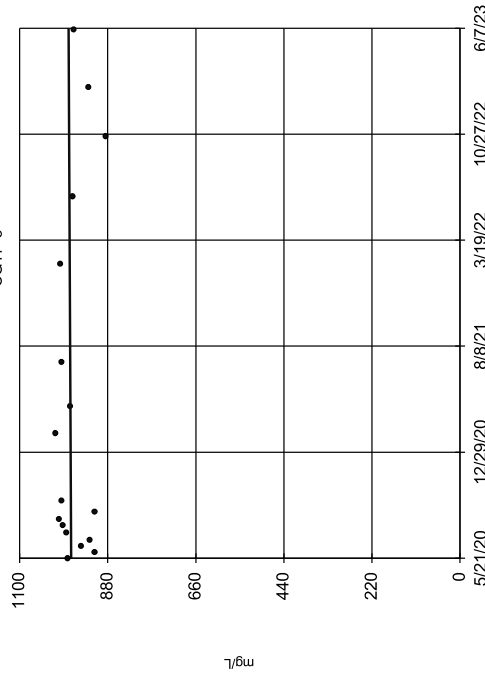

Constituent: Sulfate Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

CGYP-4

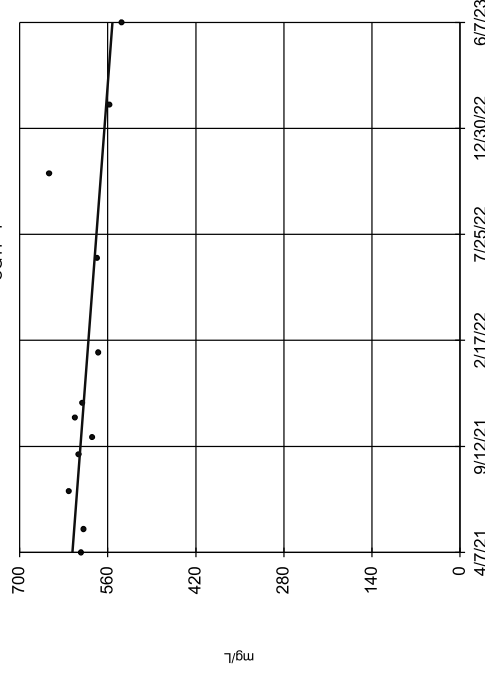

Constituent: Sulfate Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

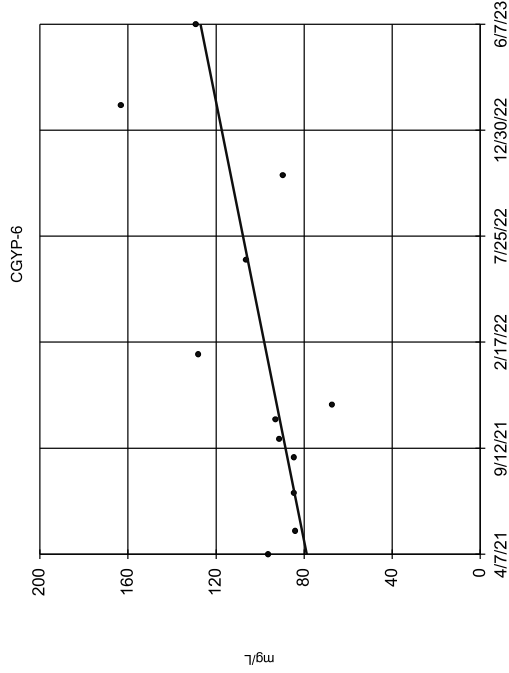

n = 12
 Slope = -22.22
 units per year.
 Mann-Kendall
 statistic = 29
 critical = 38
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Sulfate Analysis Run 9/13/2023 11:45 AM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

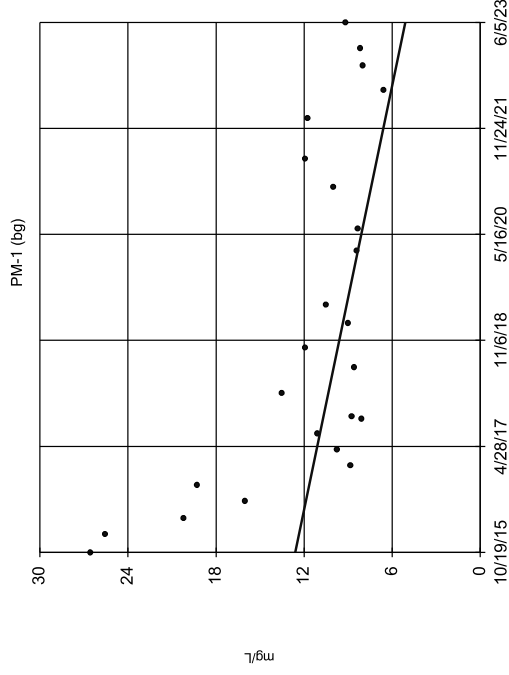

n = 24
 Slope = -0.0811
 units per year.
 Mann-Kendall
 statistic = -129
 critical = -105
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Sulfate Analysis Run 9/13/2023 11:45 AM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

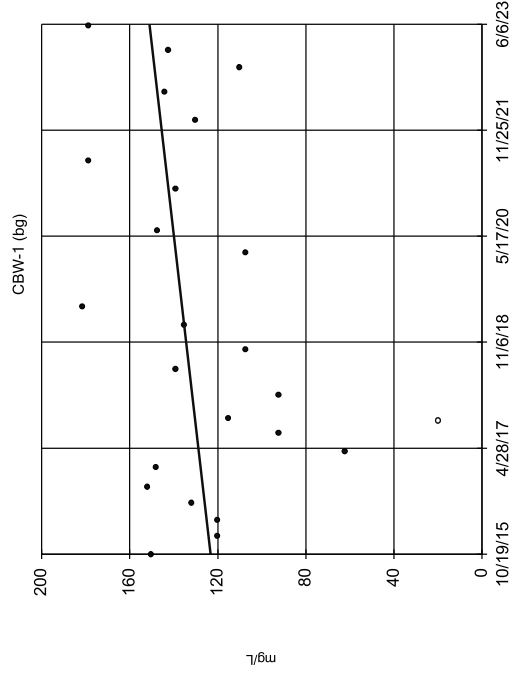

n = 24
 Slope = 3.648
 units per year.
 Mann-Kendall
 statistic = 47
 critical = 105
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Total Dissolved Solids Analysis Run 9/13/2023 11:45 AM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

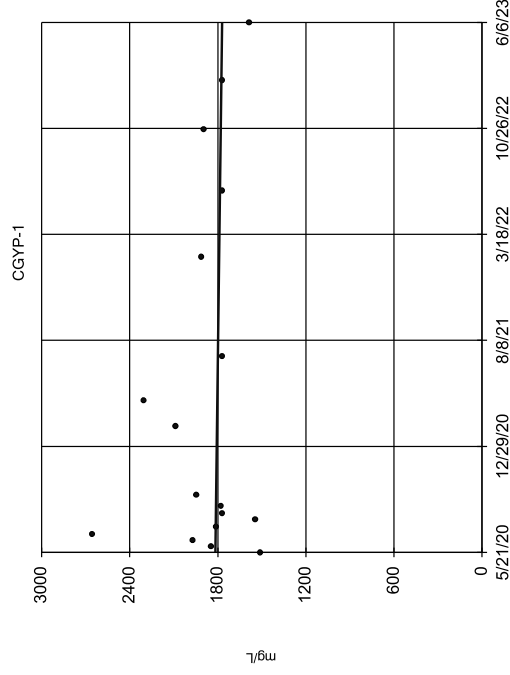

n = 17
 Slope = -14.69
 units per year.
 Mann-Kendall
 statistic = -12
 critical = -63
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Total Dissolved Solids Analysis Run 9/13/2023 11:45 AM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

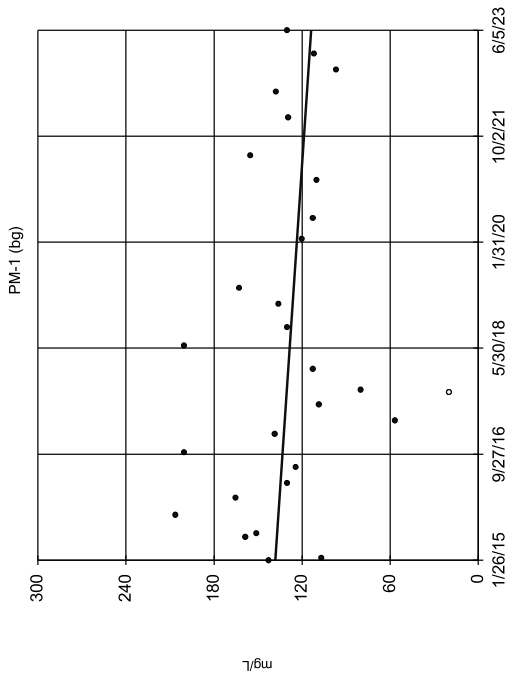

n = 28
Slope = -2.923
units per year.
Mann-Kendall
statistic = -62
critical = -131
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Total Dissolved Solids Analysis Run 9/13/2023 11:45 AM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

FIGURE F.

CYGP GWPS				
Constituent Name	MCL	CCR-Rule Specified	Background Limit	GWPS
Antimony, Total (mg/L)	0.006		0.025	0.025
Arsenic, Total (mg/L)	0.01		0.016	0.016
Barium, Total (mg/L)	2		0.103	2
Beryllium, Total (mg/L)	0.004		0.00063	0.004
Cadmium, Total (mg/L)	0.005		0.0005	0.005
Chromium, Total (mg/L)	0.1		0.014	0.1
Cobalt, Total (mg/L)		0.006	0.0034	0.006
Combined Radium 226 + 228 (pCi/L)	5		16.3	16.3
Fluoride, Total (mg/L)	4		0.3	4
Lead, Total (mg/L)		0.015	0.011	0.015
Lithium, Total (mg/L)		0.04	0.01	0.04
Mercury, Total (mg/L)	0.002		0.0006	0.002
Molybdenum, Total (mg/L)		0.1	0.01	0.1
Selenium, Total (mg/L)	0.05		0.02	0.05
Thallium, Total (mg/L)	0.002		0.001	0.002

*GWPS = Groundwater Protection Standard

*MCL = Maximum Contaminant Limit

*CCR = Coal Combustion Residuals

Shaded cells indicate background limit is higher than established MCL.

FIGURE G.

Appendix IV Confidence Intervals - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 10/16/2023, 1:16 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	%NDs	ND Adj.	Transform	Alpha	Method
Beryllium (mg/L)	CGYP-1	0.0112	0.0045	0.004	Yes	16	0	None	No	0.01	NP (normality)
Beryllium (mg/L)	CGYP-3	0.03854	0.02589	0.004	Yes	16	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01723	0.01478	0.004	Yes	12	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02679	0.02056	0.004	Yes	12	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.04995	0.03385	0.006	Yes	16	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.028	0.0183	0.006	Yes	16	0	None	No	0.01	NP (normality)
Cobalt (mg/L)	CGYP-3	0.1331	0.0838	0.006	Yes	16	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.04963	0.03411	0.006	Yes	12	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1656	0.1302	0.006	Yes	12	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-2	0.02447	0.01904	0.015	Yes	16	6.25	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.02936	0.02076	0.015	Yes	15	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-3	0.09312	0.05577	0.04	Yes	16	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06872	0.0529	0.04	Yes	12	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1598	0.1143	0.04	Yes	12	0	None	No	0.01	Param.


Appendix IV Confidence Intervals - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 10/16/2023, 1:16 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	%NDs	ND Adj.	Transform	Alpha	Method
Arsenic (mg/L)	CGYP-1	0.03073	0.01306	0.016	No	16	6.25	None	No	0.01	Param.
Arsenic (mg/L)	CGYP-2	0.02144	0.01385	0.016	No	16	12.5	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-3	0.01861	0.01204	0.016	No	16	6.25	None	No	0.01	Param.
Arsenic (mg/L)	CGYP-4	0.01107	0.007594	0.016	No	12	8.333	None	x^4	0.01	Param.
Barium (mg/L)	CGYP-1	0.0549	0.037	2	No	16	0	None	sqrt(x)	0.01	Param.
Barium (mg/L)	CGYP-2	0.0327	0.01664	2	No	16	6.25	None	No	0.01	Param.
Barium (mg/L)	CGYP-3	0.04929	0.03335	2	No	16	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-4	0.03835	0.0269	2	No	12	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-6	0.6159	0.2819	2	No	12	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-1	0.0112	0.0045	0.004	Yes	16	0	None	No	0.01	NP (normality)
Beryllium (mg/L)	CGYP-2	0.004062	0.003157	0.004	No	16	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03854	0.02589	0.004	Yes	16	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01723	0.01478	0.004	Yes	12	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02679	0.02056	0.004	Yes	12	0	None	No	0.01	Param.
Cadmium (mg/L)	CGYP-1	0.0013	0.0005	0.005	No	16	87.5	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-2	0.001	0.0005	0.005	No	16	87.5	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-3	0.0009	0.0005	0.005	No	16	37.5	None	No	0.01	NP (normality)
Cadmium (mg/L)	CGYP-4	0.0008	0.0005	0.005	No	12	91.67	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-6	0.0006	0.0005	0.005	No	12	91.67	None	No	0.01	NP (NDs)
Chromium (mg/L)	CGYP-3	0.007021	0.005532	0.1	No	16	18.75	Kaplan-Meier	sqrt(x)	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.04995	0.03385	0.006	Yes	16	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.028	0.0183	0.006	Yes	16	0	None	No	0.01	NP (normality)
Cobalt (mg/L)	CGYP-3	0.1331	0.0838	0.006	Yes	16	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.04963	0.03411	0.006	Yes	12	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1656	0.1302	0.006	Yes	12	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-1	4.442	3.195	16.3	No	16	0	None	x^(1/3)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-2	3.1	1.907	16.3	No	16	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-3	6.288	4.689	16.3	No	16	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-4	5.476	3.107	16.3	No	12	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-6	7.227	4.003	16.3	No	12	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.167	0.8028	4	No	17	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.018	0.4856	4	No	17	11.76	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.146	1.183	4	No	17	5.882	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.219	1.047	4	No	12	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9424	0.5593	4	No	12	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-1	0.01613	0.006294	0.015	No	16	6.25	None	sqrt(x)	0.01	Param.
Lead (mg/L)	CGYP-2	0.02447	0.01904	0.015	Yes	16	6.25	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.02936	0.02076	0.015	Yes	15	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-4	0.0142	0.009554	0.015	No	12	8.333	None	No	0.01	Param.
Lead (mg/L)	CGYP-6	0.01391	0.008813	0.015	No	12	8.333	None	x^2	0.01	Param.
Lithium (mg/L)	CGYP-1	0.0247	0.01	0.04	No	16	25	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-2	0.015	0.005	0.04	No	16	31.25	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-3	0.09312	0.05577	0.04	Yes	16	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06872	0.0529	0.04	Yes	12	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1598	0.1143	0.04	Yes	12	0	None	No	0.01	Param.
Mercury (mg/L)	CGYP-1	0.0002	0.0002	0.002	No	16	93.75	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-3	0.00021	0.0002	0.002	No	16	81.25	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-1	0.0177	0.01	0.05	No	16	62.5	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-2	0.0113	0.0078	0.05	No	16	75	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-3	0.014	0.0067	0.05	No	16	81.25	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-4	0.01	0.00856	0.05	No	12	91.67	None	No	0.01	NP (NDs)

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

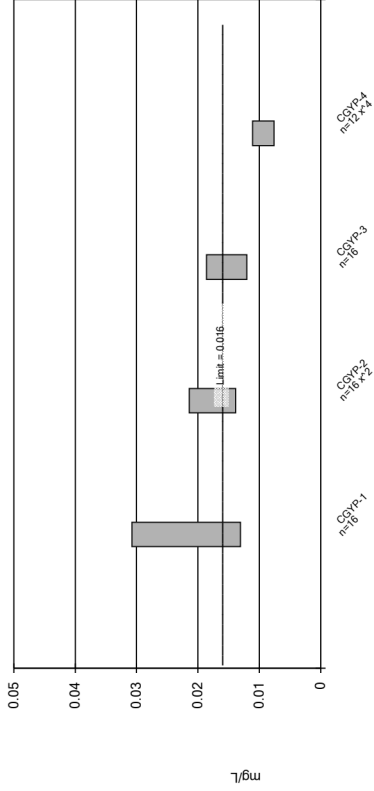

Constituent: Arsenic Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

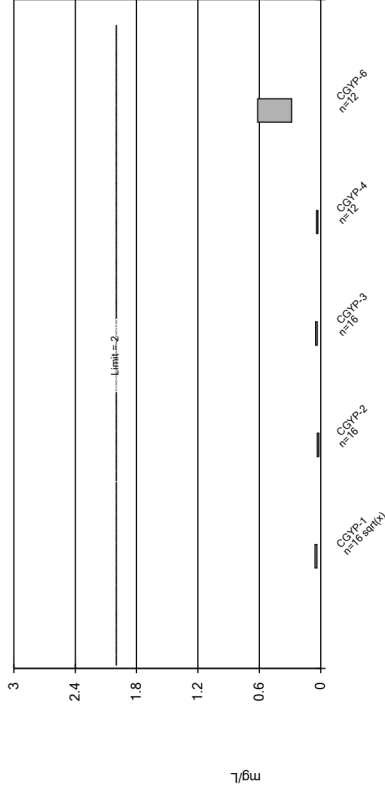

Constituent: Barium Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

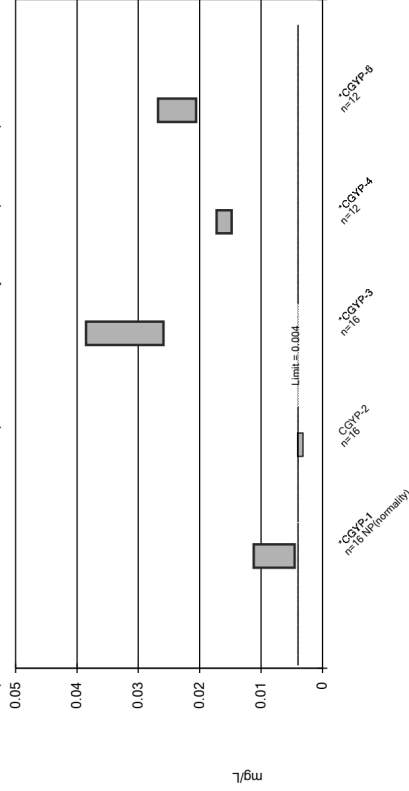

Constituent: Beryllium Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

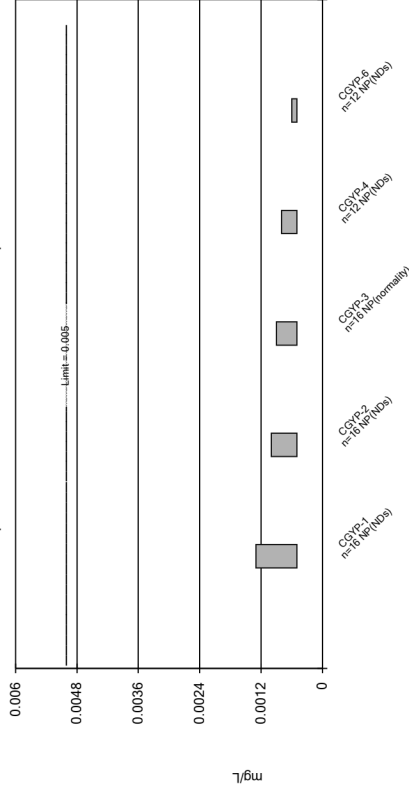

Constituent: Cadmium Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

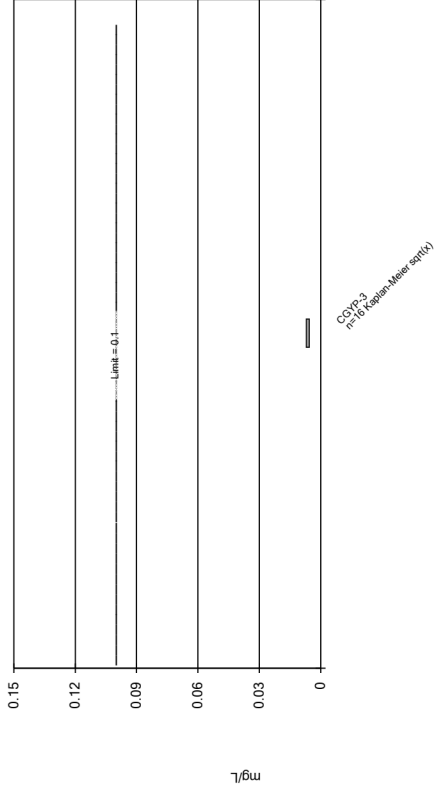

Constituent: Chromium Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

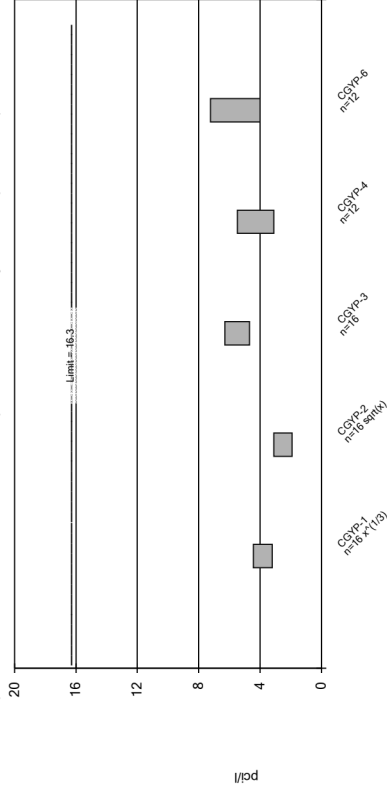

Constituent: Combined Radium 226 & 228 Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

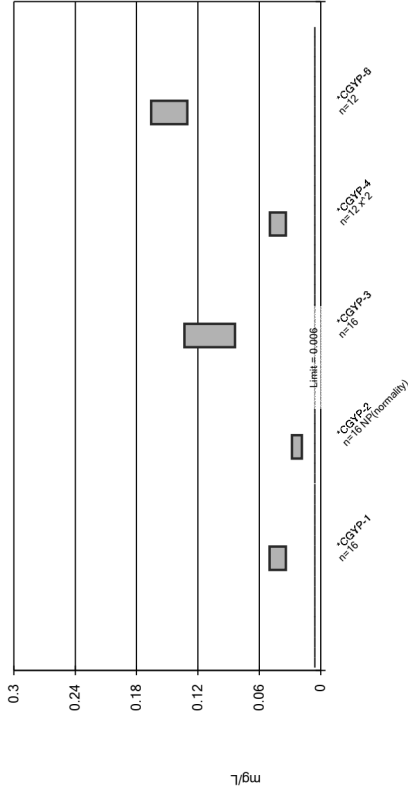

Constituent: Cobalt Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

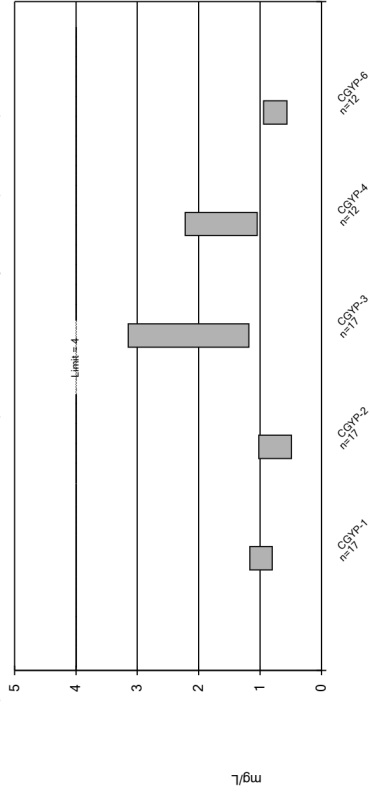

Constituent: Fluoride Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

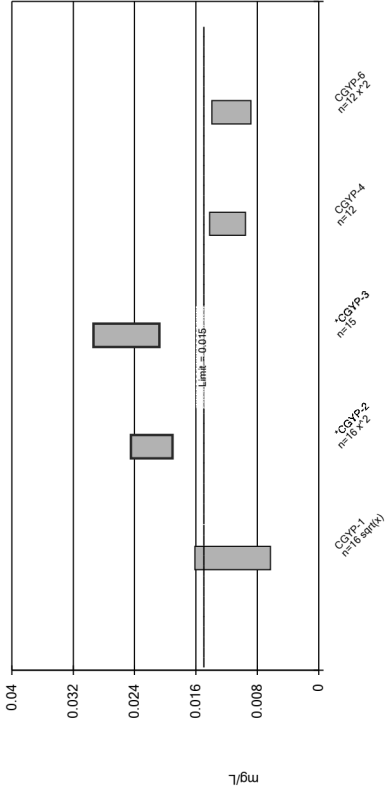

Constituent: Lead Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

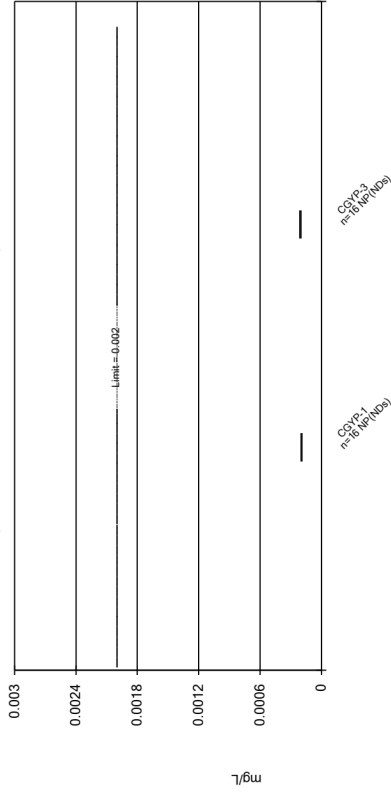

Constituent: Mercury Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

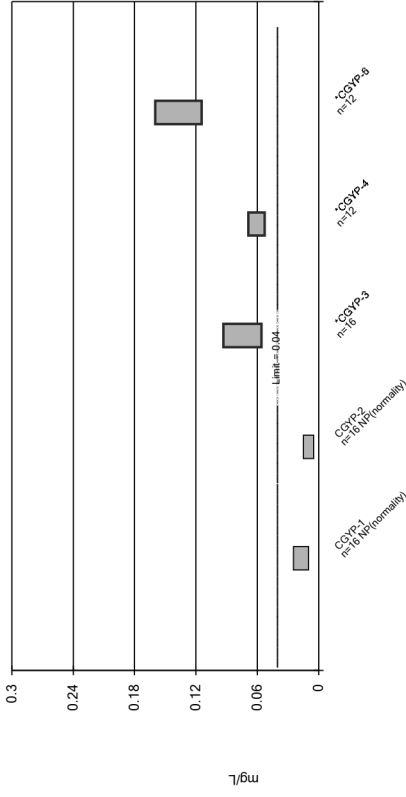

Constituent: Lithium Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01.

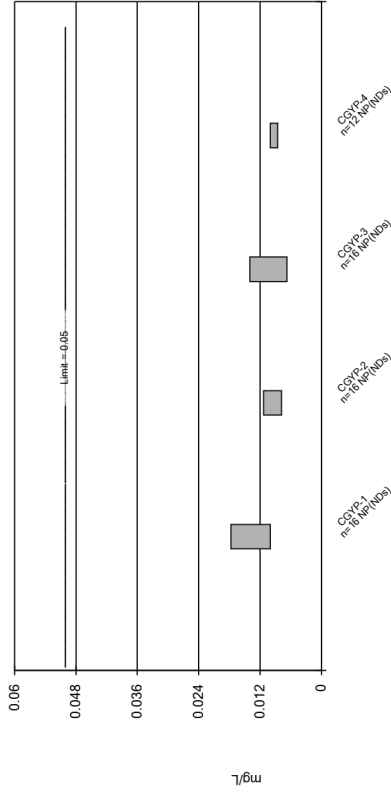

Constituent: Selenium Analysis Run 10/16/2023 1:15 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Confidence Interval

Constituent: Arsenic (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4
5/21/2020	0.0171	0.029	0.0169	
6/4/2020	0.037	0.0167	0.0138	
6/18/2020	0.0406	0.0197	0.0215	
7/1/2020	0.0407		0.0179	
7/2/2020		0.0191		
7/16/2020	0.0165	0.0217	0.017	
7/30/2020	0.014	0.0214	0.0171	
8/13/2020	0.0175	0.0214	0.0176	
8/27/2020	0.0278	0.0204	0.015	
2/10/2021	0.0452	0.0184	0.022	
4/7/2021	0.0336	0.0169	0.0198	0.0103
5/13/2021				0.0105
7/7/2021	0.0181	0.0194	0.0183	
7/8/2021				0.0113
9/1/2021				0.0115
9/27/2021				0.0118
10/26/2021				0.0104
11/17/2021				0.0112
1/31/2022	0.0146	0.0165	0.0169	0.008
6/21/2022	<0.01	<0.003	<0.01	<0.01
10/25/2022		<0.003	0.007	0.0041
10/26/2022	0.00472			
2/6/2023		0.00922	0.00795	0.00462
2/7/2023	0.00956			
6/6/2023	0.00835			
6/7/2023		0.0131	0.0114	0.00514
Mean	0.0219	0.01662	0.01532	0.008655
Std. Dev.	0.01357	0.007257	0.005049	0.003072
Upper Lim.	0.03073	0.02144	0.01861	0.01107
Lower Lim.	0.01306	0.01385	0.01204	0.007594

Confidence Interval

Constituent: Barium (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0899	0.024	0.0621		
6/4/2020	0.0447	0.0378	0.0582		
6/18/2020	0.0403	0.0445	0.0502		
7/1/2020	0.0426		0.0547		
7/2/2020		0.0439			
7/16/2020	0.0574	0.0274	0.0444		
7/30/2020	0.0575	0.0316	0.0437		
8/13/2020	0.0517	0.0289	0.0431		
8/27/2020	0.0447	0.0407	0.0459		
2/10/2021	0.0397	0.021	0.0405		
4/7/2021	0.0448	0.0145	0.0384	0.0454	0.326
5/13/2021				0.0375	0.437
7/7/2021	0.0522	0.0178	0.0378		
7/8/2021				0.0395	0.585
8/31/2021					0.564
9/1/2021				0.0364	
9/27/2021				0.0371	0.705
10/26/2021				0.0336	0.529
11/17/2021				0.0333	0.865
1/31/2022	0.0301	0.0125	0.0246	0.025	0.258
6/21/2022	0.023	<0.01	0.017	0.019	0.29
10/25/2022		0.0183	0.0422	0.0306	0.465
10/26/2022	0.0469				
2/6/2023		0.0171	0.034	0.0286	
2/7/2023	0.0391				0.159
6/6/2023	0.0392				
6/7/2023		0.00976	0.0243	0.0255	0.204
Mean	0.04649	0.02467	0.04132	0.03263	0.4489
Std. Dev.	0.01466	0.01234	0.01225	0.007291	0.2128
Upper Lim.	0.0549	0.0327	0.04929	0.03835	0.6159
Lower Lim.	0.037	0.01664	0.03335	0.0269	0.2819

Confidence Interval

Constituent: Beryllium (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0058	0.0053	0.0283		
6/4/2020	0.0098	0.0034	0.0367		
6/18/2020	0.0109	0.0034	0.037		
7/1/2020	0.011		0.0468		
7/2/2020		0.0044			
7/16/2020	0.0045	0.0034	0.0252		
7/30/2020	0.004	0.0035	0.022		
8/13/2020	0.0061	0.0036	0.022		
8/27/2020	0.009	0.0034	0.0318		
2/10/2021	0.0127	0.0025	0.035		
4/7/2021	0.0103	0.0031	0.0465	0.0174	0.0277
5/13/2021				0.0164	0.0239
7/7/2021	0.0061	0.0028	0.0269		
7/8/2021				0.0179	0.0212
8/31/2021					0.0197
9/1/2021				0.015	
9/27/2021				0.0156	0.0219
10/26/2021				0.0152	0.0214
11/17/2021				0.0149	0.0194
1/31/2022	0.0112	0.004	0.0339	0.0166	0.0237
6/21/2022	0.006	0.003	0.017	0.013	0.019
10/25/2022		0.0043	0.0345	0.0188	0.027
10/26/2022	0.0112				
2/6/2023		0.00424	0.0497	0.0162	
2/7/2023	0.011				0.0313
6/6/2023	0.00398				
6/7/2023		0.00341	0.0221	0.0151	0.0279
Mean	0.008349	0.003609	0.03221	0.01601	0.02368
Std. Dev.	0.003023	0.0006954	0.009719	0.001561	0.003974
Upper Lim.	0.0112	0.004062	0.03854	0.01723	0.02679
Lower Lim.	0.0045	0.003157	0.02589	0.01478	0.02056

Confidence Interval

Constituent: Cadmium (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.0005	<0.0005	0.00062		
6/4/2020	<0.0005	<0.0005	0.0008		
6/18/2020	<0.0005	<0.0005	0.00074		
7/1/2020	<0.0005		0.0009		
7/2/2020		<0.0005			
7/16/2020	<0.0005	<0.0005	0.00061		
7/30/2020	<0.0005	<0.0005	<0.0005		
8/13/2020	<0.0005	<0.0005	<0.0005		
8/27/2020	<0.0005	<0.0005	0.00076		
2/10/2021	<0.0005	<0.0005	0.00078		
4/7/2021	<0.0005	<0.0005	0.00053	<0.0005	<0.0005
5/13/2021				<0.0005	<0.0005
7/7/2021	<0.0005	<0.0005	<0.0005		
7/8/2021				<0.0005	<0.0005
8/31/2021					<0.0005
9/1/2021				<0.0005	
9/27/2021				<0.0005	<0.0005
10/26/2021				<0.0005	<0.0005
11/17/2021				<0.0005	<0.0005
1/31/2022	<0.0005	<0.0005	<0.0005	<0.0005	<0.0005
6/21/2022	<0.0005	<0.0005	<0.0005	<0.0005	<0.0005
10/25/2022		0.0014	0.0019	0.0008	0.0006
10/26/2022	0.0022				
2/6/2023		0.001	0.0015	<0.0005	
2/7/2023	0.0013				<0.0005
6/6/2023	<0.0005				
6/7/2023		<0.0005	<0.0005	<0.0005	<0.0005
Mean	0.0006563	0.0005875	0.0007588	0.000525	0.0005083
Std. Dev.	0.0004575	0.00025	0.0003975	8.66E-05	2.887E-05
Upper Lim.	0.0013	0.001	0.0009	0.0008	0.0006
Lower Lim.	0.0005	0.0005	0.0005	0.0005	0.0005

Confidence Interval

Constituent: Chromium (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

	CGYP-3
5/21/2020	0.0058
6/4/2020	0.0067
6/18/2020	0.0063
7/1/2020	0.0052
7/16/2020	0.0053
7/30/2020	0.0055
8/13/2020	0.0056
8/27/2020	0.0059
2/10/2021	<0.005
4/7/2021	0.0061
7/7/2021	0.0079
1/31/2022	<0.005
6/21/2022	<0.005
10/25/2022	0.009
2/6/2023	0.0073
6/7/2023	0.008
Mean	0.006225
Std. Dev.	0.001229
Upper Lim.	0.007021
Lower Lim.	0.005532

Confidence Interval

Constituent: Cobalt (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0448	0.0506	0.115		
6/4/2020	0.0479	0.0199	0.13		
6/18/2020	0.0492	0.0229	0.152		
7/1/2020	0.0548		0.154		
7/2/2020		0.025			
7/16/2020	0.0353	0.027	0.113		
7/30/2020	0.032	0.028	0.0966		
8/13/2020	0.0371	0.0294	0.0936		
8/27/2020	0.0467	0.0244	0.117		
2/10/2021	0.0587	0.019	0.151		
4/7/2021	0.0536	0.0183	0.143	0.0532	0.163
5/13/2021				0.0498	0.149
7/7/2021	0.0362	0.0206	0.0967		
7/8/2021				0.0494	0.147
8/31/2021					0.15
9/1/2021				0.0487	
9/27/2021				0.0478	0.157
10/26/2021				0.0463	0.158
11/17/2021				0.0461	0.128
1/31/2022	0.00931	0.00644	0.0504	0.0168	0.114
6/21/2022	0.033	0.018	0.055	0.033	0.117
10/25/2022		0.0215	0.0956	0.0415	0.156
10/26/2022	0.0523				
2/6/2023		0.0227	0.141	0.0399	
2/7/2023	0.048				0.198
6/6/2023	0.0315				
6/7/2023		0.0224	0.0311	0.0199	0.138
Mean	0.0419	0.02351	0.1084	0.04103	0.1479
Std. Dev.	0.01238	0.008948	0.03787	0.01188	0.02255
Upper Lim.	0.04995	0.028	0.1331	0.04963	0.1656
Lower Lim.	0.03385	0.0183	0.0838	0.03411	0.1302

Confidence Interval

Constituent: Combined Radium 226 & 228 (pci/l) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	3.97	1.34	5.59		
6/4/2020	3.96	2.14	4.18		
6/18/2020	3.79	2.61	5.24		
7/1/2020	5.58		3.26		
7/2/2020		2.13			
7/16/2020	3.65	2.46	5.25		
7/30/2020	2.93	2.15	7.74		
8/13/2020	3.07	1.91	5.99		
8/27/2020	2.64	1.3	5.2		
2/10/2021	3.86	2.83	4.69		
4/7/2021	3.89	4.18	7.93	6.37	3.68
5/13/2021				5.84	6.31
7/7/2021	2.77	2.5	5.03		
7/8/2021				3.56	6.08
8/31/2021					5.53
9/1/2021				4.64	
9/27/2021				5.29	7.93
10/26/2021				5.56	6.48
11/17/2021				4.9	9.69
1/31/2022	6.81	3.4	6.17	4.85	3.44
6/21/2022	4.28	2.39	5.36	3.24	4.3
10/25/2022		5.12	6.68	3.77	6.17
10/26/2022	3.53				
2/6/2023		2.52	4.18	1.81	
2/7/2023	3.13				2.08
6/6/2023	3.94				
6/7/2023		1.77	5.33	1.67	5.69
Mean	3.863	2.547	5.489	4.292	5.615
Std. Dev.	1.056	0.9883	1.229	1.51	2.055
Upper Lim.	4.442	3.1	6.288	5.476	7.227
Lower Lim.	3.195	1.907	4.689	3.107	4.003

Confidence Interval

Constituent: Fluoride (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.58	0.75	0.65		
6/4/2020	0.96	0.75	2.89		
6/18/2020	1.05	0.62	2.82		
7/1/2020	0.69		0.73		
7/2/2020		<0.1			
7/16/2020	0.72	1.55	2.41		
7/30/2020	0.91	<0.1	<0.1		
8/13/2020	1.04	0.71	1		
8/27/2020	1.02	0.54	4.57		
9/21/2020	1.29	1.23	1.77		
2/10/2021	1.69	1.3	6.22		
4/7/2021	1.31	1.08	3.32	3.19	1.1
5/13/2021				2.82	0.84
7/7/2021	0.97	0.87	1.88		
7/8/2021				1.85	0.99
8/31/2021					0.75
9/1/2021				1.79	
9/27/2021				1.63	0.98
10/26/2021				0.83	0.42
11/17/2021				1.53	0.58
1/31/2022	0.9	0.28	0.81	0.67	0.36
6/21/2022	0.91	0.93	1.94	1.56	0.93
10/25/2022		0.42	1.06	0.99	0.49
10/26/2022	0.53				
2/6/2023		1.12	3.08	1.58	
2/7/2023	1.28				0.89
6/6/2023	0.89				
6/7/2023		0.53	1.6	1.16	0.68
Mean	0.9847	0.7518	2.165	1.633	0.7508
Std. Dev.	0.2902	0.4247	1.566	0.7467	0.2441
Upper Lim.	1.167	1.018	3.146	2.219	0.9424
Lower Lim.	0.8028	0.4856	1.183	1.047	0.5593

Confidence Interval

Constituent: Lead (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.035	0.02	0.0279		
6/4/2020	0.0191	0.0238	0.019		
6/18/2020	0.0201	0.0247	0.0236		
7/1/2020	0.0202		0.0236		
7/2/2020		0.026			
7/16/2020	0.0116	0.0235	0.0269		
7/30/2020	0.005	0.0244	0.0295		
8/13/2020	0.0093	0.0247	0.0355		
8/27/2020	0.0087	0.0268	0.0193		
2/10/2021	0.0165	0.0196	0.092 (o)		
4/7/2021	0.008	0.0175	0.0248	0.0113	0.013
5/13/2021				0.0122	0.0127
7/7/2021	0.0097	0.0208	0.0297		
7/8/2021				0.0126	0.0131
8/31/2021					0.0136
9/1/2021				0.0146	
9/27/2021				0.0147	0.0137
10/26/2021				0.0145	0.0158
11/17/2021				0.0147	0.0068
1/31/2022	0.0056	0.019	0.0244	0.0113	0.0105
6/21/2022	<0.01	<0.01	0.011	<0.01	<0.01
10/25/2022		0.0251	0.0298	0.0134	0.0028
10/26/2022	0.0089				
2/6/2023		0.0234	0.0328	0.00927	
2/7/2023	0.00625				0.0118
6/6/2023	0.00144				
6/7/2023		0.0166	0.0181	0.00896	0.0132
Mean	0.0119	0.02131	0.02506	0.01188	0.011
Std. Dev.	0.008427	0.005338	0.006352	0.002961	0.003989
Upper Lim.	0.01613	0.02447	0.02936	0.0142	0.01391
Lower Lim.	0.006294	0.01904	0.02076	0.009554	0.008813

Confidence Interval

Constituent: Lithium (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.015	0.015	0.069		
6/4/2020	0.027	<0.005	0.09		
6/18/2020	0.028	0.015	0.11		
7/1/2020	<0.01		0.11		
7/2/2020		0.015			
7/16/2020	0.01	<0.005	0.071		
7/30/2020	<0.01	0.014	0.06		
8/13/2020	<0.01	<0.005	0.063		
8/27/2020	0.023	0.016	0.093		
2/10/2021	0.024	0.013	0.11		
4/7/2021	0.02	0.014	0.094	0.058	0.14
5/13/2021				0.058	0.13
7/7/2021	0.014	0.015	0.056		
7/8/2021				0.058	0.12
8/31/2021					0.13
9/1/2021				0.064	
9/27/2021				0.067	0.15
10/26/2021				0.053	0.11
11/17/2021				0.052	0.11
1/31/2022	0.0183	0.0109	0.1	0.0642	0.128
6/21/2022	<0.01	<0.005	0.029	0.039	0.1
10/25/2022		<0.005	0.0517	0.0712	0.148
10/26/2022	0.00893				
2/6/2023		0.0142	0.0143	0.0687	
2/7/2023	0.0247				0.198
6/6/2023	0.00779				
6/7/2023		0.0139	0.0701	0.0766	0.181
Mean	0.01629	0.01131	0.07444	0.06081	0.1371
Std. Dev.	0.007192	0.004532	0.0287	0.01008	0.029
Upper Lim.	0.0247	0.015	0.09312	0.06872	0.1598
Lower Lim.	0.01	0.005	0.05577	0.0529	0.1143

Confidence Interval

Constituent: Mercury (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-3
5/21/2020	<0.0002	<0.0002
6/4/2020	<0.0002	<0.0002
6/18/2020	<0.0002	0.00047
7/1/2020	0.0002	0.00023
7/16/2020	<0.0002	<0.0002
7/30/2020	<0.0002	<0.0002
8/13/2020	<0.0002	<0.0002
8/27/2020	<0.0002	<0.0002
2/10/2021	<0.0002	<0.0002
4/7/2021	<0.0002	0.00021
7/7/2021	<0.0002	<0.0002
1/31/2022	<0.0002	<0.0002
6/21/2022	<0.0002	<0.0002
10/25/2022		<0.0002
10/26/2022	<0.0002	
2/6/2023		<0.0002
2/7/2023	<0.0002	
6/6/2023	<0.0002	
6/7/2023		<0.0002
Mean	0.0002	0.0002194
Std. Dev.	1.3E-12	6.728E-05
Upper Lim.	0.0002	0.00021
Lower Lim.	0.0002	0.0002


Confidence Interval

Constituent: Selenium (mg/L) Analysis Run 10/16/2023 1:16 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4
5/21/2020	<0.01	0.0113	<0.01	
6/4/2020	0.0166	0.0078	0.0067	
6/18/2020	0.0143	<0.01	<0.01	
7/1/2020	0.0177		<0.01	
7/2/2020		<0.01		
7/16/2020	<0.01	<0.01	<0.01	
7/30/2020	<0.01	<0.01	<0.01	
8/13/2020	<0.01	<0.01	<0.01	
8/27/2020	<0.01	<0.01	<0.01	
2/10/2021	0.0163	<0.01	<0.01	
4/7/2021	<0.01	<0.01	<0.01	<0.01
5/13/2021				<0.01
7/7/2021	<0.01	<0.01	<0.01	
7/8/2021				<0.01
9/1/2021				<0.01
9/27/2021				<0.01
10/26/2021				<0.01
11/17/2021				<0.01
1/31/2022	0.018	0.014	0.014	<0.01
6/21/2022	<0.01	<0.01	<0.01	<0.01
10/25/2022		0.027	0.019	0.00856
10/26/2022	0.026			
2/6/2023		<0.01	<0.01	<0.01
2/7/2023	<0.01			
6/6/2023	<0.01			
6/7/2023		<0.01	<0.01	<0.01
Mean	0.01306	0.01126	0.01061	0.00988
Std. Dev.	0.004702	0.004369	0.002608	0.0004157
Upper Lim.	0.0177	0.0113	0.014	0.01
Lower Lim.	0.01	0.0078	0.0067	0.00856

GROUNDWATER STATS CONSULTING

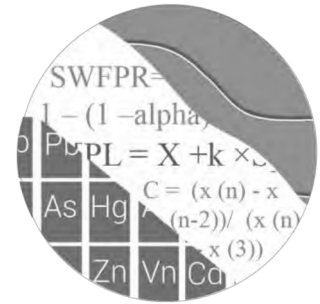

August 14, 2023

SynTerra
Attn: Ms. Kelly Ferri
148 River Street, Suite 220
Greenville, South Carolina 29601

RE:
Cross Generating Station Closed Gypsum Pond – 2023 Groundwater Statistical Analysis

Dear Ms. Ferri,

Groundwater Stats Consulting, formerly the statistical consulting division at Sanitas Technologies, is pleased to provide the data screening and statistical analysis of the January/February 2023 sample event of groundwater data at the Cross Generating Station Closed Gypsum Pond for the Coal Combustion Residuals (CCR) program. The analysis complies with the federal rule for the Disposal of Coal Combustion Residuals from Electric Utilities (CCR Rule, 2015) as well as with the United States Environmental Protection Agency (USEPA) Unified Guidance (2009).

Data were sent electronically to Groundwater Stats Consulting, and the statistical analysis was reviewed by Kristina Rayner, Founder and Senior Statistician for Groundwater Stats Consulting. The monitoring well network consists of the following wells:

- Upgradient wells: CBW-1 and PM-1
- Downgradient wells: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, and CGYP-7

Sampling began for the CCR program in October 2015 at upgradient wells CBW-1 and PM-1; in May 2020 for downgradient wells CGYP1, CGYP-2, and CGYP-3; in April 2021 for downgradient wells CGYP-4 and CGYP-6; and in October 2022 for downgradient well CGYP-7. All wells are analyzed in this report except for well CGYP-7, which is in the background collection phase and is only included on the time series graphs and box plots. The Appendix III constituents are evaluated using prediction limits when a minimum of 8 background samples are available; and confidence intervals are constructed for Appendix IV constituents when a minimum of 4 samples are available.

The following constituents are evaluated:

- **Appendix III:** boron, calcium, chloride, fluoride, pH, sulfate, and TDS
- **Appendix IV:** antimony, arsenic, barium, beryllium, cadmium, chromium, cobalt, combined radium 226 + 228, fluoride, lead, lithium, mercury, molybdenum, selenium, and thallium

Note that the terms “parameters” and “constituents” are interchangeable throughout this report. When there are no detections present in downgradient wells for a given constituent, statistical analyses are not required. A summary of well/constituent pairs containing 100% non-detects follows this letter.

During this analysis, slight corrections were made to historical data and did not result in any significant changes. In some cases, “dissolved” and “total” samples were previously reported for a given well/constituent pair during a single sample event and those samples were averaged in Sanitas. However, the Sanitas database was revised to only use “total” samples as provided by the laboratory.

Time series plots are provided for all well/constituent pairs and are particularly useful for screening data (Figure A). Additionally, a separate section of box plots is included for all constituents at upgradient and downgradient wells (Figure B). The time series plots display concentrations over time for each well and are used to initially screen for suspected outliers and trends, while the box plots provide visual representation of variation within individual wells and between all wells. Outliers and trends in background data result in increased variation and statistical limits that are not conservative (i.e., lower) from a regulatory perspective, if not addressed. When outliers are confirmed, these values are flagged in the computer database with “o” in order to deselect prior to construction of statistical limits. Values in background which have been flagged as outliers may be seen in a lighter font and as a disconnected symbol on the time series graphs. A list of flagged values follows this report (Figure C).

Reporting limit changes may occur depending on laboratory capabilities. A substitution of the most recent reporting limit is used for all non-detects for a given constituent to account for any varying detection limits in background data sets.

Data at all wells for constituents detected in downgradient wells were evaluated for the following: 1) outliers; 2) trends; 3) most appropriate statistical method based on site characteristics of groundwater data upgradient of the facility; and 4) eligibility of downgradient wells when intrawell statistical methods are recommended. A power curve

is provided to demonstrate that the selected statistical method for the Appendix III Detection Monitoring parameters listed above complies with the USEPA Unified Guidance. The EPA suggests the selected statistical method should provide at least 55% power at 3 standard deviations or at least 80% power at 4 standard deviations. Power curves were based on the following statistical methods:

CCR Appendix III Constituents:

- Semi-Annual Sampling
- Interwell Prediction Limits with 1-of-2 resample plan
- # Constituents: 7
- # Downgradient wells: 6

Parametric prediction limits are utilized when the screened historical data follow a normal or transformed-normal distribution. When data cannot be normalized or the majority of data are non-detects, a nonparametric test is utilized. While the false positive rate associated with the parametric limits is based on an annual 10% (5% per semi-annual event) as recommended by the EPA Unified Guidance (2009), the false positive rate associated with the nonparametric limits is dependent upon the available background sample size, number of future comparisons, and verification resample plan. The distribution of data is tested using the Shapiro-Wilk/Shapiro-Francia test for normality. After testing for normality and performing any adjustments as discussed below (US EPA, 2009), data are analyzed using either parametric or non-parametric prediction limits. Non-detects are handled as follows:

- No statistical analyses are required on wells and analytes containing 100% non-detects.
- When data contain <15% non-detects, simple substitution of one-half the reporting limit is utilized in the statistical analysis. The reporting limit utilized for non-detects is the most recent practical quantification limit (PQL) as reported by the laboratory.
- When data contain between 15-50% non-detects, the Kaplan-Meier non-detect adjustment is applied to the background data for parametric prediction limits. This technique adjusts the mean and standard deviation of the historical concentrations to account for concentrations below the reporting limit.
- Nonparametric prediction limits are used on data containing greater than 50% non-detects.

Natural systems continuously evolve due to physical changes made to the environment and unrelated to the site. Examples include capping a landfill, paving areas near a well, or

lining a drainage channel to prevent erosion. Periodic updating of background statistical limits is necessary to accommodate these types of changes. Because this site is currently in Assessment Monitoring, upgradient well data for Appendix III constituents will be carefully screened for any new outliers and interwell prediction limits will be updated when a minimum of 4 new samples are available at each upgradient well.

When newer measurements are representative of earlier measurements, the concentrations are incorporated into background. Improved sample size results in statistical limits that provide better representation of the true background population. In some cases, the earlier portion of records may require deselection prior to construction of limits to provide sensitive limits that are representative of present-day groundwater quality conditions and will rapidly detect changes in downgradient wells. Even though the data are excluded from the calculation, the values will continue to be reported and shown in tables and graphs. A summary of records with truncated data sets will be provided.

Summary of Background Screening through October 2022 – Appendix III Constituents

Outlier Testing

During the initial background screening conducted in February 2023, Tukey's box plot method was used to evaluate potential outliers through the October 2022 sample event for Appendix III constituents on pooled upgradient well data and at each downgradient well. No outliers were identified for any of the Appendix III constituents; therefore, no values were flagged.

Seasonality

No seasonal patterns were visually apparent in any of the detected data; therefore, no deseasonalizing adjustments were made to the data. When seasonal patterns are observed, data may be optionally deseasonalized so that the resulting limits will correctly account for the seasonality as a predictable pattern rather than random variation or a release.

Determination of Statistical Methods

The Analysis of Variance (ANOVA) was used to identify the most appropriate statistical approach based on observed groundwater quality upgradient of the Closed Gypsum Pond. Interwell tests, which compare downgradient well data to statistical limits

constructed from pooled upgradient well data, are appropriate when average concentrations are similar across upgradient wells. Intrawell tests, which compare compliance data from a single well to screened historical data within the same well, are appropriate when upgradient wells exhibit spatial variation; when statistical limits constructed from upgradient wells would not be conservative (i.e., lower) from a regulatory perspective; and when downgradient water quality is unimpacted compared to upgradient water quality for the same parameters.

In cases where downgradient concentrations are elevated relative to upgradient concentrations, an independent study and hydrogeological investigation would be required to identify local geochemical conditions and expected groundwater quality for the region to justify an intrawell approach. Such an assessment is beyond the scope of services provided by Groundwater Stats Consulting.

The ANOVA noted variation in groundwater quality among upgradient wells for boron, calcium, chloride, fluoride, pH, and sulfate. No variation was identified between upgradient wells for TDS, making this constituent eligible for interwell prediction limits. For all other Appendix III constituents, the results of the ANOVA indicated intrawell methods should be considered for these parameters if no pre-existing impacts from the unit are suspected in downgradient wells. Additional testing was conducted as described below to determine intrawell eligibility.

Intrawell limits constructed from carefully screened background data from within each well serve to provide statistical limits that are conservative (i.e., lower) from a regulatory perspective, and that will rapidly identify a change in more recent compliance data from within a given well. This statistical method removes the element of variation from across wells and eliminates the chance of mistaking natural spatial variation for a release from the facility. Prior to performing intrawell prediction limits, it is necessary to demonstrate that groundwater at downgradient wells is not suspected to have existing impacts from the practices of the facility.

In order to establish baseline upgradient well concentrations, tolerance limits (either parametric or nonparametric as appropriate, depending on the distribution of the data sets) were constructed using pooled upgradient well data for each of the Appendix III parameters recommended for intrawell analyses. Parametric tolerance limits were constructed with a target of 99% confidence and 95% coverage. The confidence and coverage levels for nonparametric tolerance limits are dependent upon the number of background samples. As more data are collected, the background population is better represented and the confidence and coverage levels increase.

Next, to determine whether average downgradient concentrations are elevated relative to the upgradient well baseline concentrations established by the tolerance limits above, confidence intervals were constructed on downgradient wells for each of the Appendix III parameters exhibiting spatial variation. The results showed that at least one confidence interval exceeded its respective limit for each of the parameters tested.

When the entire confidence interval exceeds a background standard, it is an indication that downgradient concentrations are elevated above background levels. Therefore, interwell methods are recommended initially in lieu of intrawell methods until further research identifies whether the elevated downgradient concentrations are likely the result of natural geological conditions, an off-site source, or may be the result of the facility. After such a study, data would be re-evaluated to determine the most appropriate statistical method.

Trend Testing – Upgradient Wells

The Sen's Slope/Mann Kendall trend test was used to evaluate pooled upgradient well data to identify statistically significant increasing or decreasing trends. Statistically significant increasing trending data are typically not included as part of the background data used for construction of interwell prediction limits. Truncating data sets in upgradient wells to eliminate trends reduces variation in background and results in statistical limits representative of present-day groundwater quality concentrations. When statistically significant decreasing trends are present, earlier data are evaluated to determine whether historic concentration levels are significantly higher than current reported concentrations and will be deselected as necessary. When the historical records of data are truncated for the reasons above, a summary report will be provided to show the date ranges used in construction of the statistical limits.

The results of the trend analyses identified the following statistically significant trends:

Increasing:

- Chloride: CBW-1

Decreasing:

- Calcium: PM-1
- Fluoride: CBW-1
- Sulfate: PM-1

These trends are relatively low in magnitude when compared to average concentrations within these wells; therefore, no adjustments were required to the data sets. No other statistically significant trends were identified for any of the Appendix III parameters.

Evaluation of Appendix III Constituents – January/February 2023 Event

Interwell Prediction Limits

Interwell prediction limits were constructed as recommended in the CCR Rule (2015) and in the EPA Unified Guidance (2009), based on a 1-of-2 resample plan, using pooled upgradient well data from wells CBW-1 and PM-1 for boron, calcium, chloride, fluoride, pH, sulfate, and TDS through February 2023 sample event (Figure D).

The January or February 2023 samples from each downgradient well were compared to the respective statistical limits. In the event of an initial exceedance of compliance well data, a resample may be collected to determine whether the initial exceedance is confirmed, in which case a statistically significant increase (SSI) is identified. If the resample falls within the statistical limit, the initial exceedance is considered to be a false positive result; therefore, no further action is necessary.

Parametric prediction limits were constructed when background data followed a normal or transformed-normal distribution. Non-parametric prediction limits are provided for data sets with greater than 50% non-detects, and for data sets which do not follow a normal or transformed-normal distribution. Downgradient measurements were compared to these background limits. Exceedances were noted for the majority of interwell prediction limits which may be seen on the summary tables following this letter.

Trend Tests - Exceedances

When an exceedance occurs in a downgradient well, the exceedance is further evaluated using the Sen's Slope/Mann Kendall trend test at the 99% confidence level. Upgradient wells are included in the trend analyses to identify whether similar patterns exist upgradient of the site (Figure E). Statistically significant trends were identified for the following well/constituent pairs:

Increasing

- Chloride: CBW-1 (upgradient)

Decreasing

- Boron: CBW-1 (upgradient), CGYP-2, and CGYP-4
- Calcium: PM-1 (upgradient), CGYP-2, and CGYP-4
- Chloride: CGYP-4
- Fluoride: CBW-1 (upgradient)
- Sulfate: PM-1 (upgradient)

Summary of Background Screening through October 2022 - Appendix IV Constituents

During the initial background screening conducted in February 2023, upgradient well data were screened through October 2022 for Appendix IV constituents using visual screening to identify whether seasonal patterns or trends are present that would lead to artificially elevated statistical limits. All upgradient well data appear stable for the Appendix IV constituents.

Tukey's outlier test on pooled upgradient well data through October 2022 identified outliers for cobalt and lead; however, these values were not flagged as outliers since the measurements were either similar to remaining measurements within the records or were less than the established Maximum Contaminant Limits (MCLs). The highest reported observation of 16.3 pCi/L for combined radium 226+228 was not identified as an outlier by Tukey's test, therefore, this measurement was not flagged as an outlier at the time of the screening. If further research indicates this measurement is not representative of naturally occurring groundwater quality upgradient of the facility it will be flagged as an outlier.

Additionally, downgradient well data through October 2022 were screened through visual screening and Tukey's test. Since the downgradient well data are used to construct confidence intervals, a regulatory conservative approach is taken in that values that are marginally high relative to the rest of the data are retained unless there is particular justification for excluding them. Tukey's test identified a single value of 0.092 mg/L for lead in well CGYP-3 which was flagged as an outlier in the database since all remaining measurements were less than 0.036 mg/L. While the test identified an outlier for mercury in well CGYP-3, this measurement was not flagged as an outlier since the concentration was significantly lower than the established MCL. The test also identified a low outlier for selenium in well CGYP-3 which was a reported trace value; therefore, the measurement was not flagged in the database.

Interwell Upper Tolerance Limits

Interwell upper tolerance limits are used to calculate background limits from all available pooled upgradient well data for Appendix IV parameters to determine the background limit for each constituent. Per your request, the interwell upper tolerance limits utilized in this analysis were constructed by Haley & Aldrich, Inc. in the 2022 Annual Groundwater Monitoring and Corrective Action Report for the Closed Gypsum Pond Cross Generating Station. Upgradient well data will be re-evaluated in future analyses for construction of interwell tolerance limits.

Groundwater Protection Standards

Interwell upper tolerance limits were compared to the MCLs and CCR-Rule specified levels in the Groundwater Protection Standard (GWPS) table following this letter to determine the highest limit for use as the GWPS in the Confidence Interval comparisons (Figure F).

Evaluation of Appendix IV Parameters – January/February 2023 Event

Prior to evaluating Appendix IV parameters, background data were reviewed through visual screening at upgradient wells for potential outliers and extreme trending patterns that would lead to artificially elevated statistical limits. No additional outliers were flagged during this analysis and a list of outliers follows this report (Figure C).

Confidence Intervals

Confidence intervals were then constructed on downgradient wells with data through February 2023 for each of the Appendix IV parameters using the highest limit of the MCL, the CCR-Rule specified levels, or background limits as discussed above (Figure G). Well/constituent pairs containing 100% non-detects do not require statistical analyses; therefore, no confidence intervals were required for antimony, molybdenum, and thallium.

These intervals were constructed as either parametric or nonparametric confidence intervals depending on the data distribution and percentage of non-detects. When data followed a normal or transformed-normal distribution, parametric confidence intervals were used for Appendix IV parameters. The lower confidence limit, which is constructed with 99% confidence for parametric confidence intervals, is compared to the GWPS prepared as described above. Nonparametric confidence intervals were constructed when data did not follow a normal or transformed-normal distribution or when there were

greater than 50% non-detects. The confidence level associated with nonparametric confidence intervals is dependent upon the number samples available.

Only when the entire confidence interval is above a GWPS is the well/constituent pair considered to exceed its respective standard. A summary of the confidence interval results follows this letter. Exceedances were identified for the following well/constituent pairs:

- Beryllium: CGYP-1, CGYP-3, CYGP-4, and CGYP-6
- Cobalt: CGYP-1, CGYP-2, CGYP-3, CGYP-4, and CGYP-6
- Lead: CGYP-2 and CGYP-3
- Lithium: CGYP-3, CGYP-4, and CGYP-6

Thank you for the opportunity to assist you in the statistical analysis of groundwater quality for the Closed Gypsum Pond. If you have any questions or comments, please feel free to contact us.

Sincerely,



Andrew T. Collins
Project Manager



Kristina L. Rayner
Senior Statistician

Table of Contents

Figure A. Time Series	20
Figure B. Box Plots	50
Figure C. Outlier Summary	57
Figure D. Appendix III Interwell PLs	59
Figure E. Appendix III Trend Tests	73
Figure F. CGYP GWPS Table	88
Figure G. Appendix IV Confidence Intervals	90

100% Non-Detects: Appendix IV Downgradient

Analysis Run 6/22/2023 3:41 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Antimony (mg/L)

CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-7

Arsenic (mg/L)

CGYP-6

Chromium (mg/L)

CGYP-1, CGYP-2, CGYP-4, CGYP-6, CGYP-7

Mercury (mg/L)

CGYP-2, CGYP-4, CGYP-6, CGYP-7

Molybdenum (mg/L)

CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-7

Selenium (mg/L)

CGYP-6

Thallium (mg/L)

CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6, CGYP-7

Appendix III Interwell Prediction Limits - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:05 PM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	2/7/2023	11.1	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	2/6/2023	0.602	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	2/6/2023	23.9	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	2/6/2023	5.67	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	2/7/2023	9.49	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.31	n/a	2/7/2023	264	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.31	n/a	2/6/2023	301	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.31	n/a	2/6/2023	737	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.31	n/a	2/6/2023	266	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.31	n/a	2/7/2023	520	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	2/6/2023	46	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	2/6/2023	1270	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	2/6/2023	417	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	2/7/2023	1150	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	2/7/2023	1.28	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	2/6/2023	1.12	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	2/6/2023	3.08	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	2/6/2023	1.58	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	2/7/2023	0.89	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	2/6/2023	4.01	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	2/6/2023	3.77	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	2/6/2023	4.01	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	2/7/2023	3.8	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	2/7/2023	476	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	2/6/2023	958	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	2/6/2023	928	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	2/6/2023	557	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	2/7/2023	163	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	200.1	n/a	2/7/2023	1764	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	200.1	n/a	2/6/2023	1474	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	200.1	n/a	2/6/2023	3838	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	200.1	n/a	2/6/2023	1689	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	200.1	n/a	2/7/2023	2959	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2

Appendix III Interwell Prediction Limits - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:05 PM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	2/7/2023	11.1	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	2/6/2023	0.602	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	2/6/2023	23.9	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	2/6/2023	5.67	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	2/7/2023	9.49	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.31	n/a	2/7/2023	264	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.31	n/a	2/6/2023	301	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.31	n/a	2/6/2023	737	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.31	n/a	2/6/2023	266	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.31	n/a	2/7/2023	520	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	2/7/2023	7.21	No	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	2/6/2023	46	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	2/6/2023	1270	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	2/6/2023	417	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	2/7/2023	1150	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	2/7/2023	1.28	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	2/6/2023	1.12	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	2/6/2023	3.08	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	2/6/2023	1.58	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	2/7/2023	0.89	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	2/7/2023	4.38	No	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	2/6/2023	4.01	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	2/6/2023	3.77	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	2/6/2023	4.01	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	2/7/2023	3.8	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	2/7/2023	476	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	2/6/2023	958	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	2/6/2023	928	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	2/6/2023	557	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	2/7/2023	163	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	200.1	n/a	2/7/2023	1764	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	200.1	n/a	2/6/2023	1474	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	200.1	n/a	2/6/2023	3838	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	200.1	n/a	2/6/2023	1689	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	200.1	n/a	2/7/2023	2959	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2

Appendix III Trend Tests - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:08 PM

Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CBW-1 (bg)	-0.001039	-102	-92	Yes	22	9.091	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-2	-0.5189	-62	-58	Yes	16	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-4	-1.614	-36	-34	Yes	11	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-33.53	-69	-58	Yes	16	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-71.61	-41	-34	Yes	11	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-1.127	-111	-98	Yes	23	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.09186	100	98	Yes	23	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-215	-53	-34	Yes	11	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02019	-149	-87	Yes	21	4.762	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.177	-126	-98	Yes	23	0	n/a	n/a	0.01	NP

Appendix III Trend Tests - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:08 PM

Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CBW-1 (bg)	-0.001039	-102	-92	Yes	22	9.091	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-1	0.6063	21	58	No	16	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-2	-0.5189	-62	-58	Yes	16	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-3	-0.1803	-12	-58	No	16	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-4	-1.614	-36	-34	Yes	11	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-6	-0.7466	-17	-34	No	11	0	n/a	n/a	0.01	NP
Boron (mg/L)	PM-1 (bg)	-1.3e-10	-39	-87	No	21	42.86	n/a	n/a	0.01	NP
Calcium (mg/L)	CBW-1 (bg)	0.3946	56	92	No	22	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-1	-9.278	-15	-58	No	16	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-33.53	-69	-58	Yes	16	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-3	-55.29	-31	-58	No	16	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-71.61	-41	-34	Yes	11	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-6	-45.17	-17	-34	No	11	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-1.127	-111	-98	Yes	23	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.09186	100	98	Yes	23	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-2	-36.44	-54	-58	No	16	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-3	-72.86	-18	-58	No	16	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-215	-53	-34	Yes	11	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-6	-77.26	-18	-34	No	11	0	n/a	n/a	0.01	NP
Chloride (mg/L)	PM-1 (bg)	-0.01849	-24	-98	No	23	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02019	-149	-87	Yes	21	4.762	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-1	0.114	19	58	No	16	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-2	0.09713	10	58	No	16	12.5	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-3	0.1407	16	58	No	16	6.25	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-4	-0.9914	-33	-34	No	11	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-6	-0.226	-21	-34	No	11	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	PM-1 (bg)	0	0	87	No	21	100	n/a	n/a	0.01	NP
pH, Field (pH units)	CBW-1 (bg)	0	-4	-98	No	23	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-2	0.07164	25	58	No	16	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-3	-0.05844	-17	-58	No	16	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-4	0.03484	14	34	No	11	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-6	0.05748	6	34	No	11	0	n/a	n/a	0.01	NP
pH, Field (pH units)	PM-1 (bg)	-0.001811	-11	-124	No	27	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CBW-1 (bg)	0.3067	12	98	No	23	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-1	7.022	6	58	No	16	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-2	1.547	3	58	No	16	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-3	5.388	8	58	No	16	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-4	-23.7	-15	-34	No	11	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-6	20.4	20	34	No	11	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.177	-126	-98	Yes	23	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CBW-1 (bg)	1.898	27	98	No	23	4.348	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-1	0.2477	0	58	No	16	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-2	-49.51	-43	-58	No	16	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-3	-245	-30	-58	No	16	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-363.2	-34	-34	No	11	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-6	-396.6	-5	-34	No	11	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	PM-1 (bg)	-3.395	-63	-124	No	27	3.704	n/a	n/a	0.01	NP

CYGP GWPS				
Constituent Name	MCL	CCR-Rule Specified	Background Limit	GWPS
Antimony, Total (mg/L)	0.006		0.025	0.025
Arsenic, Total (mg/L)	0.01		0.016	0.016
Barium, Total (mg/L)	2		0.103	2
Beryllium, Total (mg/L)	0.004		0.00063	0.004
Cadmium, Total (mg/L)	0.005		0.0005	0.005
Chromium, Total (mg/L)	0.1		0.014	0.1
Cobalt, Total (mg/L)		0.006	0.0034	0.006
Combined Radium 226 + 228 (pCi/L)	5		16.3	16.3
Fluoride, Total (mg/L)	4		0.3	4
Lead, Total (mg/L)		0.015	0.011	0.015
Lithium, Total (mg/L)		0.04	0.01	0.04
Mercury, Total (mg/L)	0.002		0.0006	0.002
Molybdenum, Total (mg/L)		0.1	0.01	0.1
Selenium, Total (mg/L)	0.05		0.02	0.05
Thallium, Total (mg/L)	0.002		0.001	0.002

*GWPS = Groundwater Protection Standard

*MCL = Maximum Contaminant Limit

*CCR = Coal Combustion Residuals

Shaded cells indicate background limit is higher than established MCL.

Appendix IV Confidence Intervals - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:20 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Lower Compl.	Sig.	N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Beryllium (mg/L)	CGYP-1	0.01071	0.007078	0.004	n/a	Yes	15	0.00864	0.002887	0	None	x^2	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03944	0.02634	0.004	n/a	Yes	15	0.03289	0.009665	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01743	0.01475	0.004	n/a	Yes	11	0.01609	0.001609	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02656	0.02002	0.004	n/a	Yes	11	0.02329	0.003927	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.05106	0.03413	0.006	n/a	Yes	15	0.04259	0.01249	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.028	0.0183	0.006	n/a	Yes	15	0.02358	0.009257	0	None	No	0.01	NP (normality)
Cobalt (mg/L)	CGYP-3	0.1359	0.09132	0.006	n/a	Yes	15	0.1136	0.03287	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.05052	0.0365	0.006	n/a	Yes	11	0.04295	0.01032	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1683	0.1293	0.006	n/a	Yes	11	0.1488	0.02342	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-2	0.02481	0.01932	0.015	n/a	Yes	15	0.02162	0.00537	6.667	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.03001	0.02111	0.015	n/a	Yes	14	0.02556	0.006282	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-3	0.09485	0.05462	0.04	n/a	Yes	15	0.07473	0.02968	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06703	0.05171	0.04	n/a	Yes	11	0.05937	0.009195	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1554	0.1108	0.04	n/a	Yes	11	0.1331	0.02673	0	None	No	0.01	Param.

Appendix IV Confidence Intervals - All Results


CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:20 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Lower Compl.	Sig.	N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Arsenic (mg/L)	CGYP-1	0.03198	0.01362	0.016	n/a	No	15	0.0228	0.01354	6.667	None	No	0.01	Param.
Arsenic (mg/L)	CGYP-2	0.02185	0.01394	0.016	n/a	No	15	0.01685	0.007449	13.33	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-3	0.019	0.01318	0.016	n/a	No	15	0.01558	0.005113	6.667	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-4	0.01128	0.007479	0.016	n/a	No	11	0.008975	0.003005	9.091	None	x^3	0.01	Param.
Barium (mg/L)	CGYP-1	0.05607	0.03684	2	n/a	No	15	0.04697	0.01504	0	None	sqrt(x)	0.01	Param.
Barium (mg/L)	CGYP-2	0.03386	0.01747	2	n/a	No	15	0.02567	0.0121	6.667	None	No	0.01	Param.
Barium (mg/L)	CGYP-3	0.05043	0.03447	2	n/a	No	15	0.04245	0.01178	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-4	0.03934	0.02721	2	n/a	No	11	0.03327	0.007276	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-6	0.6445	0.2978	2	n/a	No	11	0.4712	0.208	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-1	0.01071	0.007078	0.004	n/a	Yes	15	0.00864	0.002887	0	None	x^2	0.01	Param.
Beryllium (mg/L)	CGYP-2	0.004109	0.003136	0.004	n/a	No	15	0.003623	0.0007177	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03944	0.02634	0.004	n/a	Yes	15	0.03289	0.009665	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01743	0.01475	0.004	n/a	Yes	11	0.01609	0.001609	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02656	0.02002	0.004	n/a	Yes	11	0.02329	0.003927	0	None	No	0.01	Param.
Cadmium (mg/L)	CGYP-1	0.004	0.0022	0.005	n/a	No	15	0.0037	0.0008098	86.67	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-2	0.004	0.0014	0.005	n/a	No	15	0.003627	0.0009881	86.67	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-3	0.004	0.00062	0.005	n/a	No	15	0.001943	0.001546	33.33	None	No	0.01	NP (normality)
Cadmium (mg/L)	CGYP-4	0.0005	0.0005	0.005	n/a	No	11	0.0005273	0.00009045	90.91	None	No	0.006	NP (NDs)
Cadmium (mg/L)	CGYP-6	0.0005	0.0005	0.005	n/a	No	11	0.0005091	0.00003015	90.91	None	No	0.006	NP (NDs)
Chromium (mg/L)	CGYP-3	0.006876	0.005426	0.1	n/a	No	15	0.006107	0.001174	20	Kaplan-Meier	x^(1/3)	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.05106	0.03413	0.006	n/a	Yes	15	0.04259	0.01249	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.028	0.0183	0.006	n/a	Yes	15	0.02358	0.009257	0	None	No	0.01	NP (normality)
Cobalt (mg/L)	CGYP-3	0.1359	0.09132	0.006	n/a	Yes	15	0.1136	0.03287	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.05052	0.0365	0.006	n/a	Yes	11	0.04295	0.01032	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1683	0.1293	0.006	n/a	Yes	11	0.1488	0.02342	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-1	4.484	3.144	16.3	n/a	No	15	3.857	1.093	0	None	x^(1/3)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-2	3.191	1.924	16.3	n/a	No	15	2.599	1	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-3	6.361	4.638	16.3	n/a	No	15	5.499	1.271	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-4	5.635	3.425	16.3	n/a	No	11	4.53	1.326	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-6	7.404	3.813	16.3	n/a	No	11	5.608	2.155	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.185	0.7963	4	n/a	No	16	0.9906	0.2987	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.048	0.4828	4	n/a	No	16	0.7656	0.4347	12.5	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.248	1.152	4	n/a	No	16	2.2	1.611	6.25	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.316	1.037	4	n/a	No	11	1.676	0.7674	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9697	0.5448	4	n/a	No	11	0.7573	0.255	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-1	0.01693	0.007209	0.015	n/a	No	15	0.0126	0.008231	6.667	None	sqrt(x)	0.01	Param.
Lead (mg/L)	CGYP-2	0.02481	0.01932	0.015	n/a	Yes	15	0.02162	0.00537	6.667	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.03001	0.02111	0.015	n/a	Yes	14	0.02556	0.006282	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-4	0.01437	0.01021	0.015	n/a	No	11	0.01214	0.002952	9.091	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-6	0.01423	0.007367	0.015	n/a	No	11	0.0108	0.00412	9.091	None	No	0.01	Param.
Lithium (mg/L)	CGYP-1	0.0247	0.01	0.04	n/a	No	15	0.01686	0.007065	26.67	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-2	0.015	0.005	0.04	n/a	No	15	0.01114	0.004636	33.33	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-3	0.09485	0.05462	0.04	n/a	Yes	15	0.07473	0.02968	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06703	0.05171	0.04	n/a	Yes	11	0.05937	0.009195	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1554	0.1108	0.04	n/a	Yes	11	0.1331	0.02673	0	None	No	0.01	Param.
Mercury (mg/L)	CGYP-1	0.0002	0.0002	0.002	n/a	No	15	0.0002	1.3e-12	93.33	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-3	0.00021	0.0002	0.002	n/a	No	15	0.0002207	0.00006943	80	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-1	0.0177	0.0025	0.05	n/a	No	15	0.00876	0.008299	60	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-2	0.0113	0.0025	0.05	n/a	No	15	0.00584	0.006921	73.33	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-3	0.0067	0.0025	0.05	n/a	No	15	0.004647	0.005022	80	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-4	0.0025	0.0025	0.05	n/a	No	11	0.003051	0.001827	90.91	None	No	0.006	NP (NDs)

FIGURE A.

Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

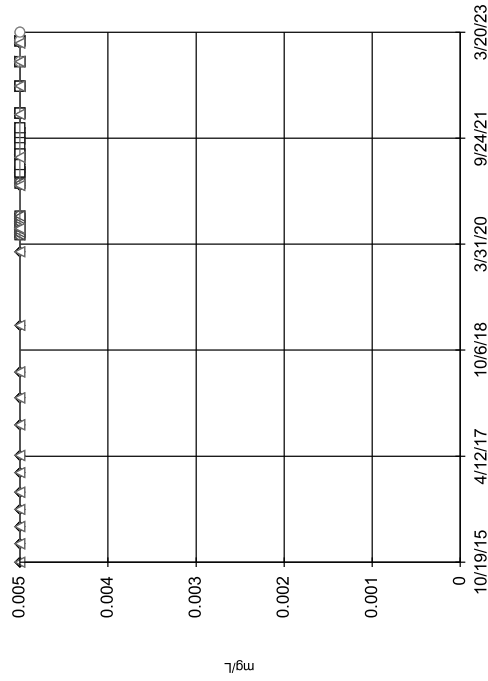

Constituent: Antimony Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

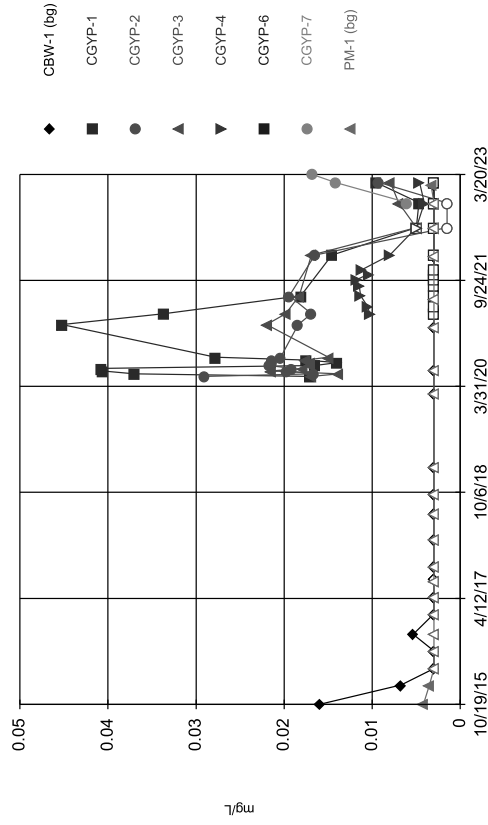

Constituent: Arsenic Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

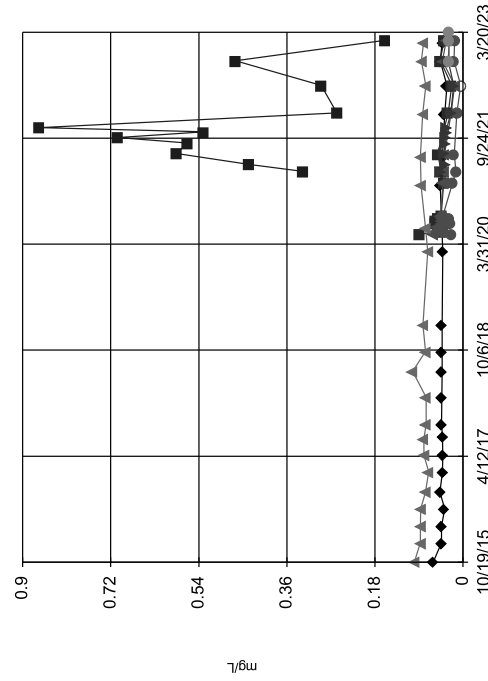

Constituent: Barium Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

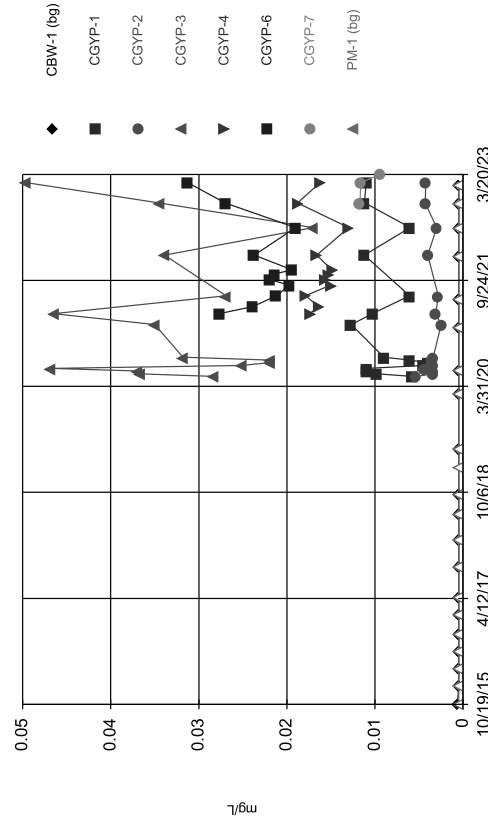

Constituent: Beryllium Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

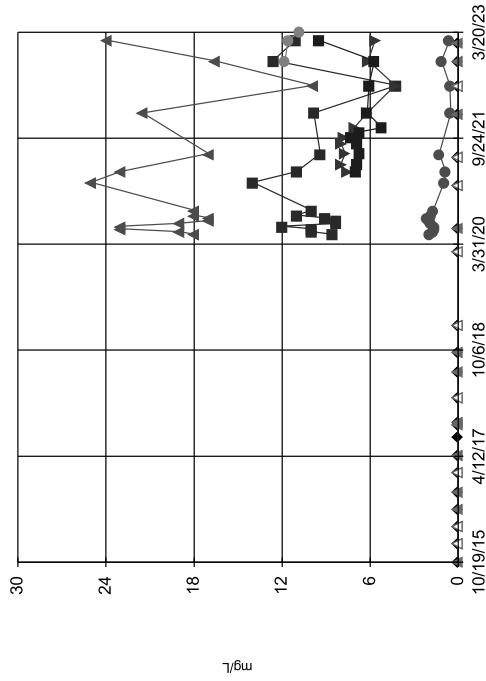

Constituent: Boron Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.


Time Series

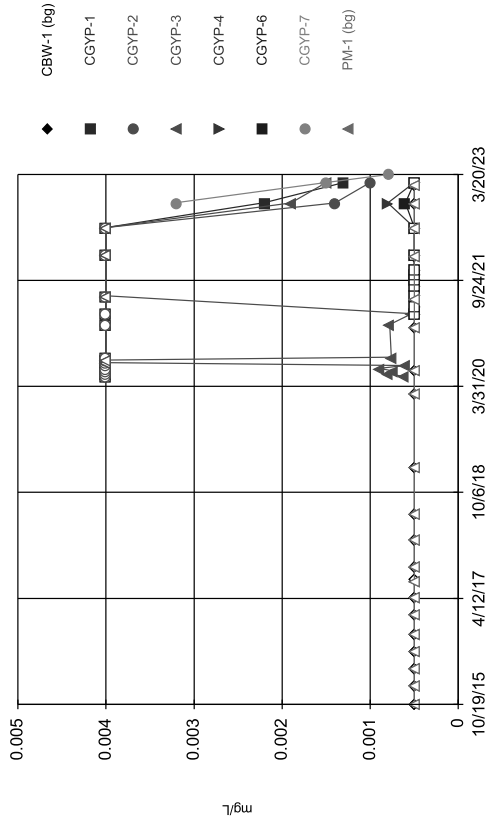

Constituent: Cadmium Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.37 Groundwater Stats Consulting, UG


Time Series

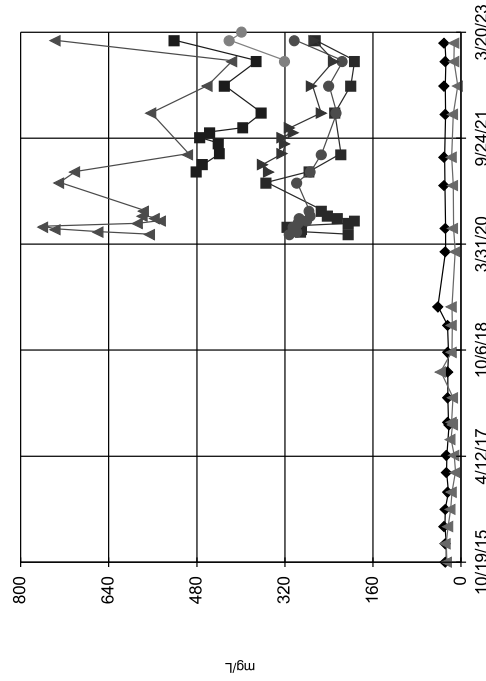

Constituent: Calcium Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Santitas™ v.9.6.37 Groundwater Stats Consulting, UG


Time Series

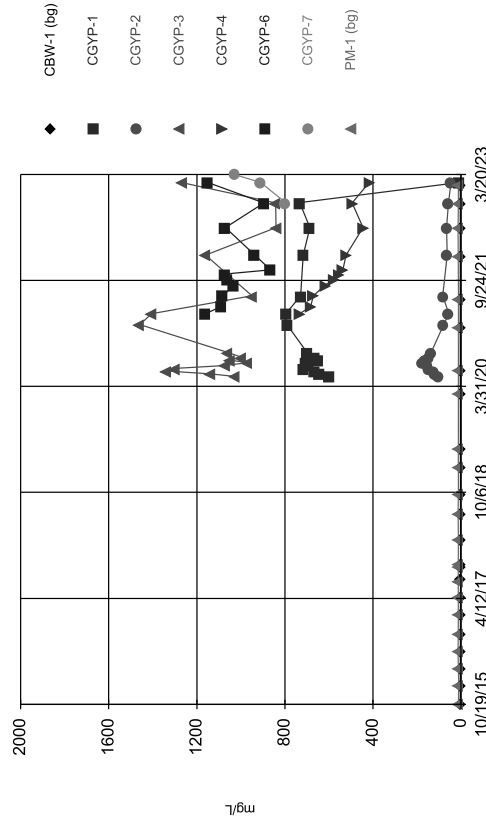

Constituent: Chloride Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

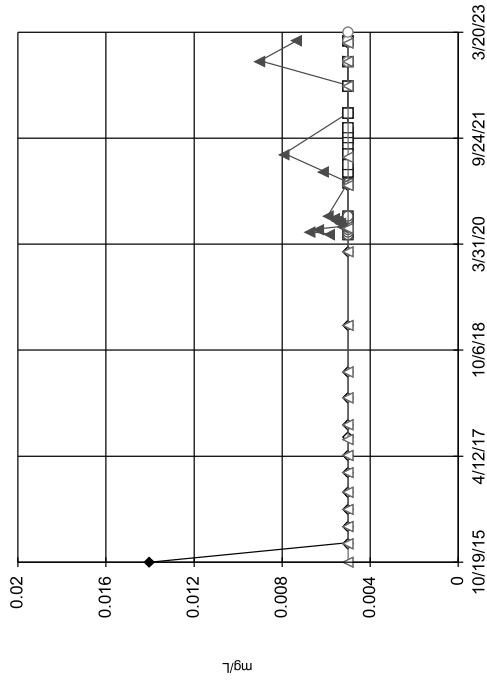


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

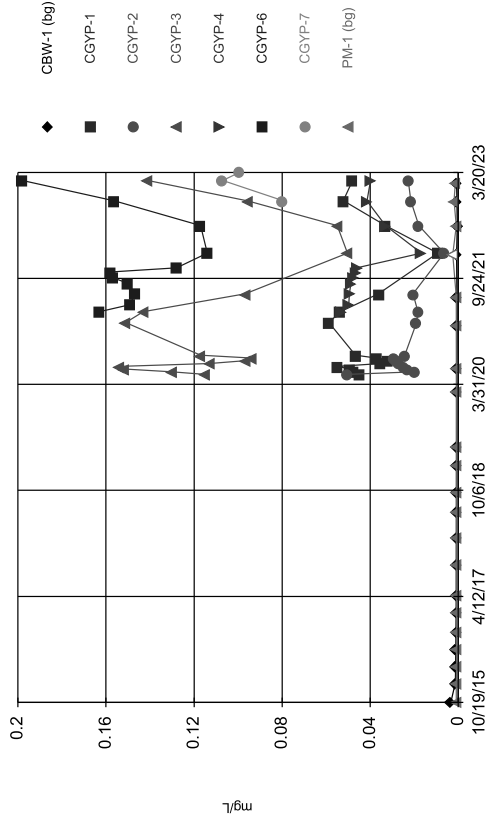


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

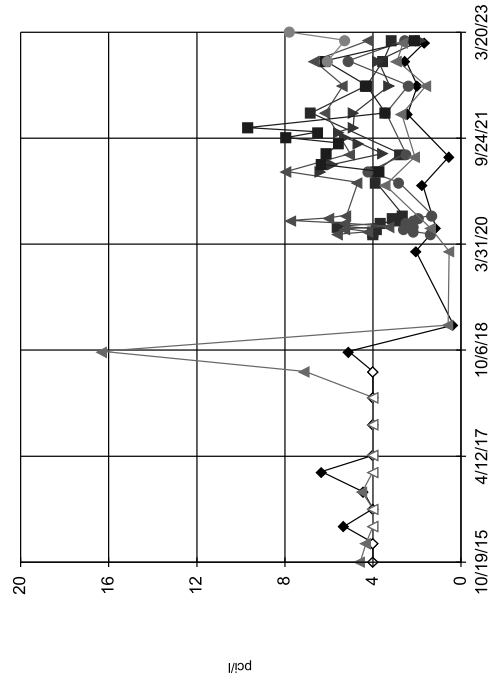


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

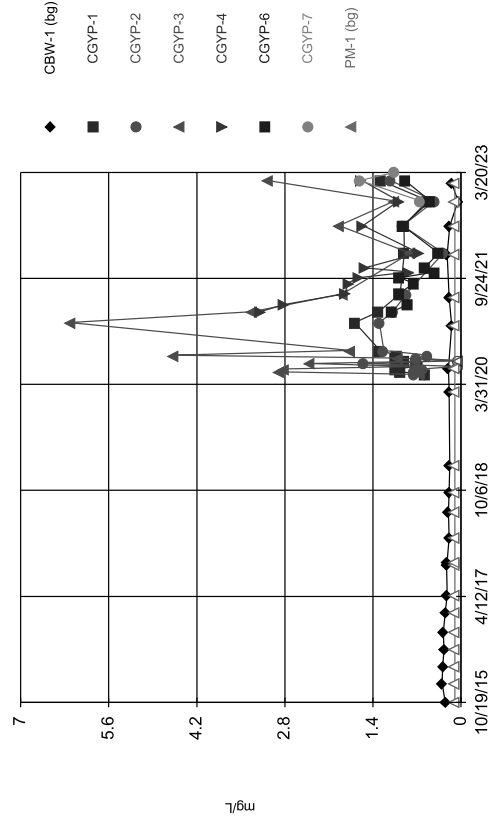


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

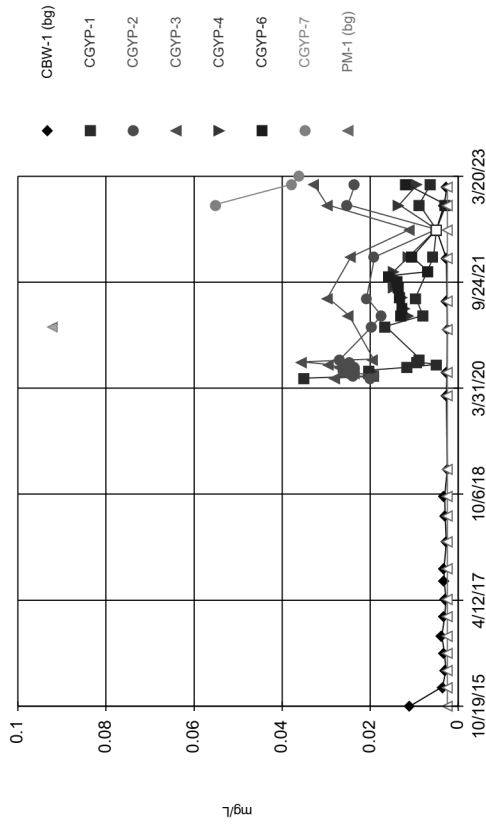


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

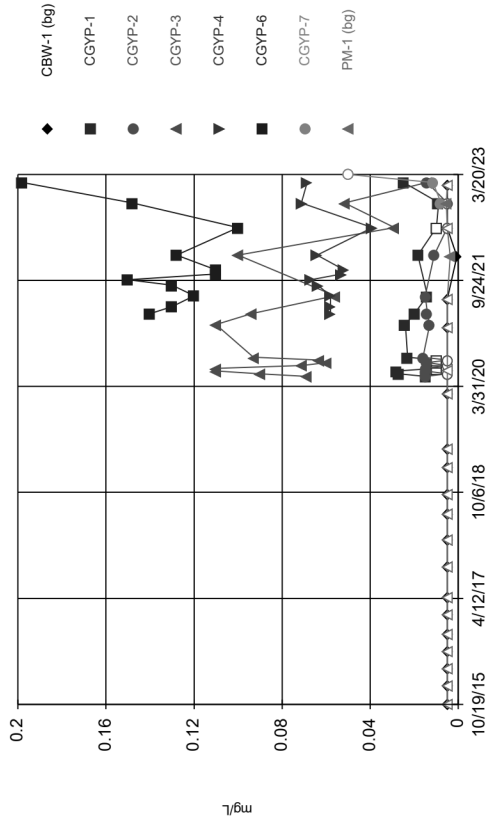


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

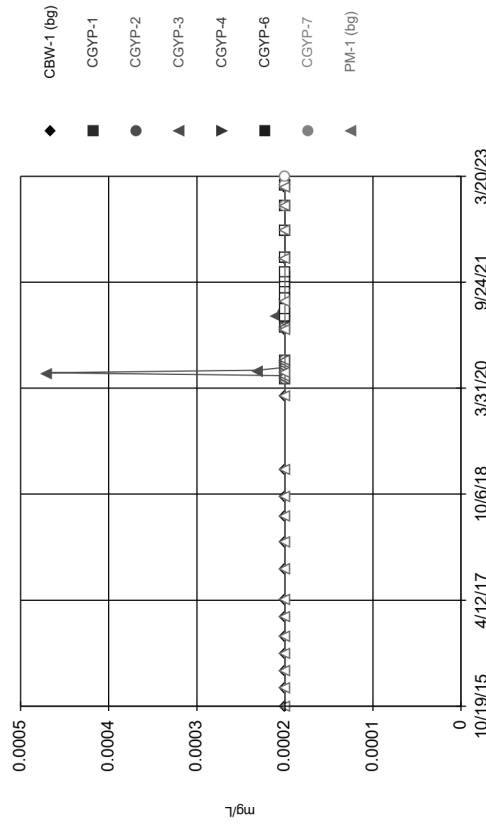


Santitas™ v.9.6.37 Groundwater Stats Consulting, UG
Hollow symbols indicate censored values.

Time Series

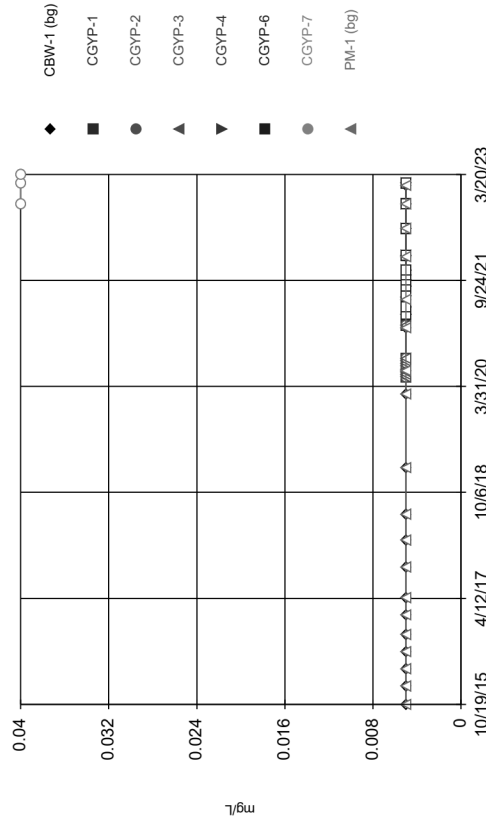


Time Series

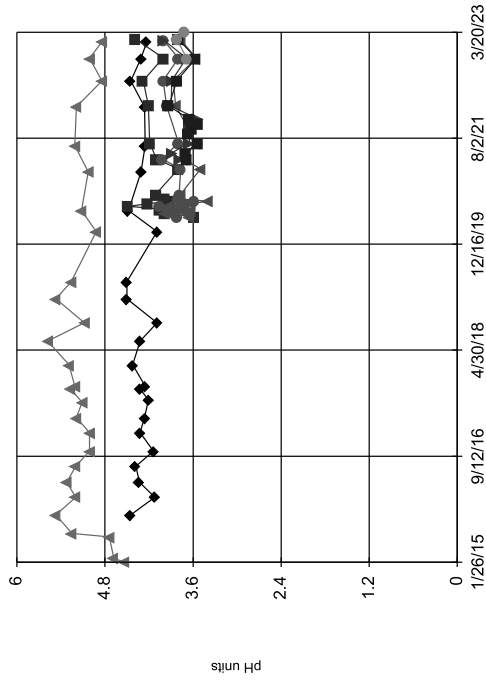


Constituent: pH; Field Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Time Series

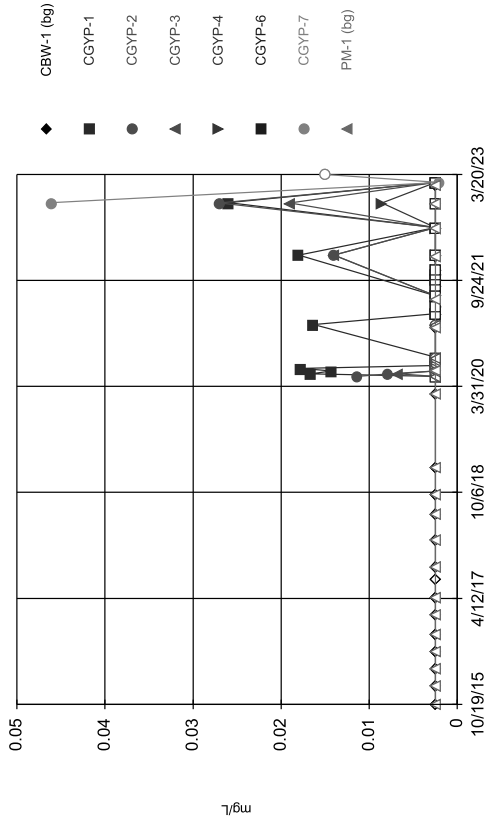


Constituent: Selenium Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Time Series

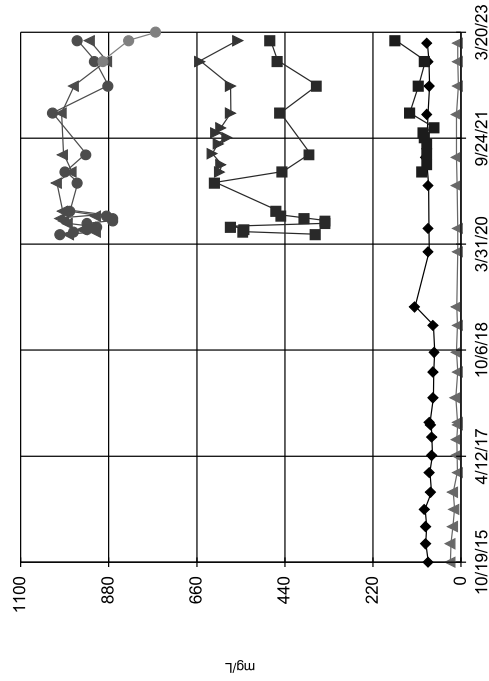


Constituent: Sulfate Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Time Series

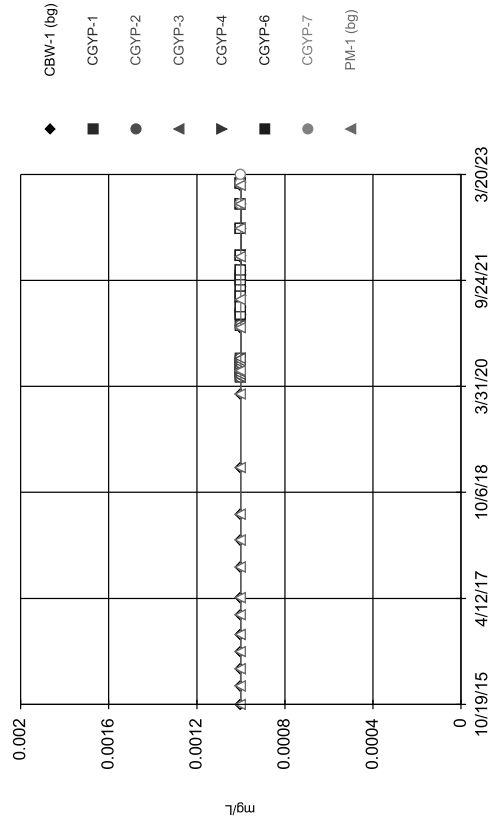

Constituent: Thallium Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Time Series

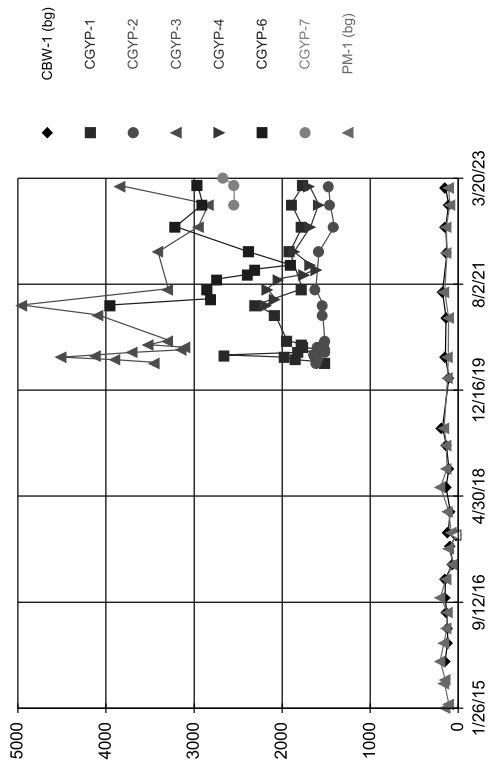

Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:13 PM
CGYP Client: Santee Cooper Data: CGYP

Time Series

Constituent: Antimony (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.005							<0.005
1/26/2016	<0.005							<0.005
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	<0.005							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		<0.005	<0.005	<0.005				
6/4/2020		<0.005	<0.005	<0.005				
6/18/2020		<0.005	<0.005	<0.005				
6/22/2020	<0.005							<0.005
7/1/2020		<0.005		<0.005				
7/2/2020			<0.005					
7/16/2020		<0.005	<0.005	<0.005				
7/30/2020		<0.005	<0.005	<0.005				
8/13/2020		<0.005	<0.005	<0.005				
8/27/2020		<0.005	<0.005	<0.005				
1/26/2021	<0.005							<0.005
2/10/2021		<0.005	<0.005	<0.005				
4/7/2021		<0.005	<0.005	<0.005	<0.005	<0.005		
5/13/2021					<0.005	<0.005		
6/21/2021	<0.005							<0.005
7/7/2021		<0.005	<0.005	<0.005				
7/8/2021					<0.005	<0.005		
8/31/2021						<0.005		
9/1/2021					<0.005			
9/27/2021					<0.005	<0.005		
10/26/2021					<0.005	<0.005		
11/17/2021					<0.005	<0.005		
1/24/2022	<0.005							<0.005
1/31/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
6/20/2022	<0.005							<0.005
6/21/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
10/25/2022	<0.005		<0.005	<0.005	<0.005	<0.005		<0.005
10/26/2022		<0.005					<0.005	
1/24/2023	<0.005							<0.005
2/6/2023			<0.005	<0.005	<0.005			
2/7/2023		<0.005				<0.005	<0.005	
3/20/2023							<0.005	

Time Series

Constituent: Arsenic (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.016							0.0042
1/26/2016	0.0067							0.0035
4/19/2016	<0.003							<0.003
7/18/2016	<0.003							<0.003
10/11/2016	0.00537							<0.003
1/23/2017	<0.003							<0.003
4/17/2017	<0.003							<0.003
7/12/2017								<0.003
7/25/2017	<0.003							
9/25/2017	<0.003							<0.003
2/7/2018	<0.003							<0.003
6/20/2018	<0.003							<0.003
10/1/2018	<0.003							<0.003
2/12/2019	<0.003							<0.003
2/24/2020	<0.003							<0.003
5/21/2020		0.0171	0.029	0.0169				
6/4/2020		0.037	0.0167	0.0138				
6/18/2020		0.0406	0.0197	0.0215				
6/22/2020	<0.003							<0.003
7/1/2020		0.0407		0.0179				
7/2/2020			0.0191					
7/16/2020		0.0165	0.0217	0.017				
7/30/2020		0.014	0.0214	0.0171				
8/13/2020		0.0175	0.0214	0.0176				
8/27/2020		0.0278	0.0204	0.015				
1/26/2021	<0.003							<0.003
2/10/2021		0.0452	0.0184	0.022				
4/7/2021		0.0336	0.0169	0.0198	0.0103	<0.003		
5/13/2021					0.0105	<0.003		
6/21/2021	<0.003							<0.003
7/7/2021		0.0181	0.0194	0.0183				
7/8/2021					0.0113	<0.003		
8/31/2021						<0.003		
9/1/2021					0.0115			
9/27/2021					0.0118	<0.003		
10/26/2021					0.0104	<0.003		
11/17/2021					0.0112	<0.003		
1/24/2022	<0.003							<0.003
1/31/2022		0.0146	0.0165	0.0169	0.008	<0.003		
6/20/2022	<0.003							<0.003
6/21/2022		<0.01	<0.003	<0.01	<0.01	<0.003		
10/25/2022	<0.003		<0.003	0.007	0.0041	<0.003		<0.003
10/26/2022		0.00472					0.006	
1/24/2023	<0.003							0.00332
2/6/2023			0.00922	0.00795	0.00462			
2/7/2023		0.00956				<0.003	0.0142	
3/20/2023							0.0168	

Time Series

Constituent: Barium (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.061							0.1
1/26/2016	0.044							0.087
4/19/2016	0.0438							0.0875
7/18/2016	0.0378							0.0868
10/11/2016	0.0473							0.077
1/23/2017	0.0421							0.0703
4/17/2017	0.0418							0.0802
7/12/2017								0.0803
7/25/2017	0.0421							
9/25/2017	0.044							0.0753
2/7/2018	0.0436							0.0756
6/20/2018	0.043							0.103
10/1/2018	0.0428							0.0769
2/12/2019	0.0427							0.0817
2/24/2020	0.0413							0.0725
5/21/2020		0.0899	0.024	0.0621				
6/4/2020		0.0447	0.0378	0.0582				
6/18/2020		0.0403	0.0445	0.0502				
6/22/2020	0.0433							0.0766
7/1/2020		0.0426		0.0547				
7/2/2020			0.0439					
7/16/2020		0.0574	0.0274	0.0444				
7/30/2020		0.0575	0.0316	0.0437				
8/13/2020		0.0517	0.0289	0.0431				
8/27/2020		0.0447	0.0407	0.0459				
1/26/2021	0.0466							0.0857
2/10/2021		0.0397	0.021	0.0405				
4/7/2021		0.0448	0.0145	0.0384	0.0454	0.326		
5/13/2021					0.0375	0.437		
6/21/2021	0.0423							0.0873
7/7/2021		0.0522	0.0178	0.0378				
7/8/2021					0.0395	0.585		
8/31/2021						0.564		
9/1/2021					0.0364			
9/27/2021					0.0371	0.705		
10/26/2021					0.0336	0.529		
11/17/2021					0.0333	0.865		
1/24/2022	0.0377							0.0826
1/31/2022		0.0301	0.0125	0.0246	0.025	0.258		
6/20/2022	0.033							0.076
6/21/2022		0.023	<0.01	0.017	0.019	0.29		
10/25/2022	0.0466		0.0183	0.0422	0.0306	0.465		0.0851
10/26/2022		0.0469					0.0281	
1/24/2023	0.0425							0.0808
2/6/2023			0.0171	0.034	0.0286			
2/7/2023		0.0391				0.159	0.0283	
3/20/2023							0.0292	

Time Series

Constituent: Beryllium (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.00063							<0.0005
1/26/2016	<0.0005							<0.0005
4/19/2016	<0.0005							<0.0005
7/18/2016	<0.0005							<0.0005
10/11/2016	<0.0005							<0.0005
1/23/2017	<0.0005							<0.0005
4/17/2017	<0.0005							<0.0005
9/25/2017	<0.0005							<0.0005
2/7/2018	<0.0005							<0.0005
6/20/2018	<0.0005							<0.0005
10/1/2018	<0.0005							<0.0005
2/12/2019								<0.0005
5/20/2019	<0.0005							<0.0005
2/24/2020	<0.0005							<0.0005
5/21/2020		0.0058	0.0053	0.0283				
6/4/2020		0.0098	0.0034	0.0367				
6/18/2020		0.0109	0.0034	0.037				
6/22/2020	<0.0005							<0.0005
7/1/2020		0.011		0.0468				
7/2/2020			0.0044					
7/16/2020		0.0045	0.0034	0.0252				
7/30/2020		0.004	0.0035	0.022				
8/13/2020		0.0061	0.0036	0.022				
8/27/2020		0.009	0.0034	0.0318				
1/26/2021	<0.0005							<0.0005
2/10/2021		0.0127	0.0025	0.035				
4/7/2021		0.0103	0.0031	0.0465	0.0174	0.0277		
5/13/2021					0.0164	0.0239		
6/21/2021	<0.0005							<0.0005
7/7/2021		0.0061	0.0028	0.0269				
7/8/2021					0.0179	0.0212		
8/31/2021						0.0197		
9/1/2021					0.015			
9/27/2021					0.0156	0.0219		
10/26/2021					0.0152	0.0214		
11/17/2021					0.0149	0.0194		
1/24/2022	<0.0005							<0.0005
1/31/2022		0.0112	0.004	0.0339	0.0166	0.0237		
6/20/2022	<0.0005							<0.0005
6/21/2022		0.006	0.003	0.017	0.013	0.019		
10/25/2022	<0.0005		0.0043	0.0345	0.0188	0.027		<0.0005
10/26/2022		0.0112					0.0117	
1/24/2023	<0.0005							<0.0005
2/6/2023			0.00424	0.0497	0.0162			
2/7/2023		0.011				0.0313	0.0116	
3/20/2023							0.00944	

Time Series

Constituent: Boron (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.032							0.0178
1/26/2016	0.0218							<-0.015
4/19/2016	0.0183							<-0.015
7/18/2016	0.0217							0.0163
10/11/2016	0.0302							0.0165
1/23/2017	0.0249							<-0.015
4/17/2017	0.018							0.019
7/25/2017	0.022							
9/25/2017	0.024							0.018
10/9/2017	0.023							0.021
2/7/2018	0.018							<-0.015
6/20/2018	0.02							0.016
10/1/2018	0.025							0.015
2/12/2019	<0.04							<-0.015
2/24/2020	0.017							<-0.015
5/21/2020		8.6	2	18				
6/4/2020		10	1.7	19				
6/18/2020		10	1.6	23				
6/22/2020	0.018							0.049
7/1/2020		12		23				
7/2/2020			1.6					
7/16/2020		8.3	1.9	19				
7/30/2020		8.3	2	17				
8/13/2020		9.1	2.1	17				
8/27/2020		11	1.9	18				
9/21/2020		10	1.7	18				
1/26/2021	0.018							<-0.015
2/10/2021		14	0.96	25				
4/7/2021		11	0.85	23	7.6	7		
5/13/2021					8	6.9		
6/21/2021	<0.04							<-0.015
7/7/2021		9.4	1.3	17				
7/8/2021					7.7	6.7		
8/31/2021						6.9		
9/1/2021					8			
9/27/2021					7.8	7.3		
10/26/2021					6.8	6.7		
11/17/2021					7.1	5.2		
1/24/2022	0.0139							0.011
1/31/2022		9.84	0.51	21.5	6.21	6.2		
6/20/2022	0.015							<-0.015
6/21/2022		4.2	0.57	9.9	4.3	6.1		
10/25/2022	0.0203		1.14	16.6	6.13	5.71		0.0437
10/26/2022		12.6					11.8	
1/24/2023	0.0175							0.0114
2/6/2023			0.602	23.9	5.67			
2/7/2023		11.1				9.49	11.6	
3/20/2023							10.8	

Time Series

Constituent: Cadmium (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.0005							<0.0005
1/26/2016	<0.0005							<0.0005
4/19/2016	<0.0005							<0.0005
7/18/2016	<0.0005							<0.0005
10/11/2016	<0.0005							<0.0005
1/23/2017	<0.0005							<0.0005
4/17/2017	<0.0005							<0.0005
7/12/2017								<0.0005
7/25/2017	<0.0005							
9/25/2017	<0.0005							<0.0005
2/7/2018	<0.0005							<0.0005
6/20/2018	<0.0005							<0.0005
2/12/2019	<0.0005							<0.0005
2/24/2020	<0.0005							<0.0005
5/21/2020		<0.004	<0.004	0.00062				
6/4/2020		<0.004	<0.004	0.0008				
6/18/2020		<0.004	<0.004	0.00074				
6/22/2020	<0.0005							<0.0005
7/1/2020		<0.004		0.0009				
7/2/2020			<0.004					
7/16/2020		<0.004	<0.004	0.00061				
7/30/2020		<0.004	<0.004	<0.004				
8/13/2020		<0.004	<0.004	<0.004				
8/27/2020		<0.004	<0.004	0.00076				
1/26/2021	<0.0005							<0.0005
2/10/2021		<0.004	<0.004	0.00078				
4/7/2021		<0.004	<0.004	0.00053	<0.0005	<0.0005		
5/13/2021					<0.0005	<0.0005		
6/21/2021	<0.0005							<0.0005
7/7/2021		<0.004	<0.004	<0.004				
7/8/2021					<0.0005	<0.0005		
8/31/2021						<0.0005		
9/1/2021					<0.0005			
9/27/2021					<0.0005	<0.0005		
10/26/2021					<0.0005	<0.0005		
11/17/2021					<0.0005	<0.0005		
1/24/2022	<0.0005							<0.0005
1/31/2022		<0.004	<0.004	<0.004	<0.0005	<0.0005		
6/20/2022	<0.0005							<0.0005
6/21/2022		<0.004	<0.004	<0.004	<0.0005	<0.0005		
10/25/2022	<0.0005		0.0014	0.0019	0.0008	0.0006		<0.0005
10/26/2022		0.0022					0.0032	
1/24/2023	<0.0005							<0.0005
2/6/2023			0.001	0.0015	<0.0005			
2/7/2023		0.0013				<0.0005	0.0015	
3/20/2023							0.00079	

Time Series

Constituent: Chromium (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.014							<0.005
1/26/2016	<0.005							<0.005
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	<0.005							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
7/12/2017								<0.005
7/25/2017	<0.005							
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		<0.005	<0.005	0.0058				
6/4/2020		<0.005	<0.005	0.0067				
6/18/2020		<0.005	<0.005	0.0063				
6/22/2020	<0.005							<0.005
7/1/2020		<0.005		0.0052				
7/2/2020			<0.005					
7/16/2020		<0.005	<0.005	0.0053				
7/30/2020		<0.005	<0.005	0.0055				
8/13/2020		<0.005	<0.005	0.0056				
8/27/2020		<0.005	<0.005	0.0059				
1/26/2021	<0.005							<0.005
2/10/2021		<0.005	<0.005	<0.005				
4/7/2021		<0.005	<0.005	0.0061	<0.005	<0.005		
5/13/2021					<0.005	<0.005		
6/21/2021	<0.005							<0.005
7/7/2021		<0.005	<0.005	0.0079				
7/8/2021					<0.005	<0.005		
8/31/2021						<0.005		
9/1/2021					<0.005			
9/27/2021					<0.005	<0.005		
10/26/2021					<0.005	<0.005		
11/17/2021					<0.005	<0.005		
1/24/2022	<0.005							
1/31/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
6/20/2022	<0.005							<0.005
6/21/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
10/25/2022	<0.005		<0.005	0.009	<0.005	<0.005		<0.005
10/26/2022		<0.005					<0.005	
1/24/2023	<0.005							<0.005
2/6/2023			<0.005	0.0073	<0.005			
2/7/2023		<0.005				<0.005	<0.005	
3/20/2023							<0.005	

Time Series

Constituent: Cobalt (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.0034							0.001
1/26/2016	0.0013							0.0009
4/19/2016	0.00116							0.00079
7/18/2016	0.00115							0.00085
10/11/2016	0.00109							0.000851
1/23/2017	0.001							0.00093
4/17/2017	0.0011							0.00098
9/25/2017	0.00086							0.00091
2/7/2018	0.00088							0.00089
6/20/2018	0.001							0.001
10/1/2018	0.00076							0.00084
2/12/2019	0.00084							0.00091
5/20/2019	0.00079							0.00091
2/24/2020	0.00082							0.001
5/21/2020		0.0448	0.0506	0.115				
6/4/2020		0.0479	0.0199	0.13				
6/18/2020		0.0492	0.0229	0.152				
6/22/2020	0.0008							0.001
7/1/2020		0.0548		0.154				
7/2/2020			0.025					
7/16/2020		0.0353	0.027	0.113				
7/30/2020		0.032	0.028	0.0966				
8/13/2020		0.0371	0.0294	0.0936				
8/27/2020		0.0467	0.0244	0.117				
1/26/2021	0.00066							0.001
2/10/2021		0.0587	0.019	0.151				
4/7/2021		0.0536	0.0183	0.143	0.0532	0.163		
5/13/2021					0.0498	0.149		
6/21/2021	0.0007							0.00094
7/7/2021		0.0362	0.0206	0.0967				
7/8/2021					0.0494	0.147		
8/31/2021						0.15		
9/1/2021					0.0487			
9/27/2021					0.0478	0.157		
10/26/2021					0.0463	0.158		
11/17/2021					0.0461	0.128		
1/24/2022	0.00073							<0.005
1/31/2022		0.00931	0.00644	0.0504	0.0168	0.114		
6/20/2022	<0.001							0.001
6/21/2022		0.033	0.018	0.055	0.033	0.117		
10/25/2022	0.00063		0.0215	0.0956	0.0415	0.156		0.00189
10/26/2022		0.0523					0.0797	
1/24/2023	0.00076							0.00136
2/6/2023			0.0227	0.141	0.0399			
2/7/2023		0.048				0.198	0.107	
3/20/2023							0.0994	

Time Series

Constituent: Combined Radium 226 & 228 (pci/l) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<4							4.59
1/26/2016	<4							4.31
4/19/2016	5.31							<4
7/18/2016	<4							<4
10/11/2016	4.43							4.49
1/23/2017	6.34							<4
4/17/2017	<4							<4
9/25/2017	<4							<4
2/7/2018	<4							<4
6/20/2018	<4							7.09
10/1/2018	5.11							16.3
2/12/2019	0.346							0.585
2/24/2020	2.06							0.538
5/21/2020		3.97	1.34	5.59				
6/4/2020		3.96	2.14	4.18				
6/18/2020		3.79	2.61	5.24				
6/22/2020	1.14							1.38
7/1/2020		5.58		3.26				
7/2/2020			2.13					
7/16/2020		3.65	2.46	5.25				
7/30/2020		2.93	2.15	7.74				
8/13/2020		3.07	1.91	5.99				
8/27/2020		2.64	1.3	5.2				
1/26/2021	1.73							3.44
2/10/2021		3.86	2.83	4.69				
4/7/2021		3.89	4.18	7.93	6.37	3.68		
5/13/2021					5.84	6.31		
6/21/2021	0.552							2.1
7/7/2021		2.77	2.5	5.03				
7/8/2021					3.56	6.08		
8/31/2021						5.53		
9/1/2021					4.64			
9/27/2021					5.29	7.93		
10/26/2021					5.56	6.48		
11/17/2021					4.9	9.69		
1/24/2022	2.44							2.69
1/31/2022		6.81	3.4	6.17	4.85	3.44		
6/20/2022	1.98							1.59
6/21/2022		4.28	2.39	5.36	3.24	4.3		
10/25/2022	2.51		5.12	6.68	3.77	6.17		2.9
10/26/2022		3.53					6.04	
1/24/2023	1.66							2.63
2/6/2023			2.52	4.18	1.81			
2/7/2023		3.13				2.08	5.27	
3/20/2023							7.77	

Time Series

Constituent: Fluoride (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.25							<0.1
1/26/2016	0.3							<0.1
4/19/2016	0.29							<0.1
7/18/2016	0.27							<0.1
10/11/2016	0.28							<0.1
1/23/2017	0.25							<0.1
4/17/2017	0.22							<0.1
9/25/2017	0.23							<0.1
10/9/2017	0.22							<0.1
2/7/2018	0.19							<0.1
6/20/2018	0.2							<0.1
10/1/2018	0.19							<0.1
2/12/2019	0.18							<0.1
2/24/2020	0.19							<0.1
5/21/2020		0.58	0.75	0.65				
6/4/2020		0.96	0.75	2.89				
6/18/2020		1.05	0.62	2.82				
6/22/2020	0.2							<0.1
7/1/2020		0.69		0.73				
7/2/2020			<0.1					
7/16/2020		0.72	1.55	2.41				
7/30/2020		0.91	<0.1	<0.1				
8/13/2020		1.04	0.71	1				
8/27/2020		1.02	0.54	4.57				
9/21/2020		1.29	1.23	1.77				
1/26/2021	0.15							<0.1
2/10/2021		1.69	1.3	6.22				
4/7/2021		1.31	1.08	3.32	3.19	1.1		
5/13/2021					2.82	0.84		
6/21/2021	0.19							<0.1
7/7/2021		0.97	0.87	1.88				
7/8/2021					1.85	0.99		
8/31/2021						0.75		
9/1/2021					1.79			
9/27/2021					1.63	0.98		
10/26/2021					0.83	0.42		
11/17/2021					1.53	0.58		
1/24/2022	0.22							<0.1
1/31/2022		0.9	0.28	0.81	0.67	0.36		
6/20/2022	0.18							<0.1
6/21/2022		0.91	0.93	1.94	1.56	0.93		
10/25/2022	<0.1		0.42	1.06	0.99	0.49		<0.1
10/26/2022		0.53					0.66	
1/24/2023	0.15							<0.1
2/6/2023			1.12	3.08	1.58			
2/7/2023		1.28				0.89	1.61	
3/20/2023							1.06	

Time Series

Constituent: Lead (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	0.011							<0.0025
1/26/2016	0.0036							<0.0025
4/19/2016	0.0028							<0.0025
7/18/2016	0.00318							<0.0025
10/11/2016	0.00375							<0.0025
1/23/2017	0.0031							<0.0025
4/17/2017	0.0028							<0.0025
7/25/2017	0.0032							
9/25/2017	0.0032							<0.0025
2/7/2018	0.0027							<0.0025
6/20/2018	0.003							<0.0025
10/1/2018	0.0031							<0.0025
2/12/2019	0.0025							<0.0025
2/24/2020	0.0027							<0.0025
5/21/2020		0.035	0.02	0.0279				
6/4/2020		0.0191	0.0238	0.019				
6/18/2020		0.0201	0.0247	0.0236				
6/22/2020	0.0026							<0.0025
7/1/2020		0.0202		0.0236				
7/2/2020			0.026					
7/16/2020		0.0116	0.0235	0.0269				
7/30/2020		0.005	0.0244	0.0295				
8/13/2020		0.0093	0.0247	0.0355				
8/27/2020		0.0087	0.0268	0.0193				
1/26/2021	0.0025							<0.0025
2/10/2021		0.0165	0.0196	0.092 (o)				
4/7/2021		0.008	0.0175	0.0248	0.0113	0.013		
5/13/2021					0.0122	0.0127		
6/21/2021	0.0026							<0.0025
7/7/2021		0.0097	0.0208	0.0297				
7/8/2021					0.0126	0.0131		
8/31/2021						0.0136		
9/1/2021					0.0146			
9/27/2021					0.0147	0.0137		
10/26/2021					0.0145	0.0158		
11/17/2021					0.0147	0.0068		
1/24/2022	0.0027							<0.0025
1/31/2022		0.0056	0.019	0.0244	0.0113	0.0105		
6/20/2022	<0.01							<0.0025
6/21/2022		<0.01	<0.01	0.011	<0.01	<0.01		
10/25/2022	0.0032		0.0251	0.0298	0.0134	0.0028		<0.0025
10/26/2022		0.0089					0.0551	
1/24/2023	0.00259							<0.0025
2/6/2023			0.0234	0.0328	0.00927			
2/7/2023		0.00625				0.0118	0.0378	
3/20/2023							0.0361	

Time Series

Constituent: Lithium (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.005							<0.005
1/26/2016	<0.005							<0.005
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	<0.005							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
10/1/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
5/20/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		0.015	0.015	0.069				
6/4/2020		0.027	<0.005	0.09				
6/18/2020		0.028	0.015	0.11				
6/22/2020	<0.005							<0.005
7/1/2020		<0.01		0.11				
7/2/2020			0.015					
7/16/2020		0.01	<0.005	0.071				
7/30/2020		<0.01	0.014	0.06				
8/13/2020		<0.01	<0.005	0.063				
8/27/2020		0.023	0.016	0.093				
1/26/2021	<0.005							<0.005
2/10/2021		0.024	0.013	0.11				
4/7/2021		0.02	0.014	0.094	0.058	0.14		
5/13/2021					0.058	0.13		
6/21/2021	<0.005							<0.005
7/7/2021		0.014	0.015	0.056				
7/8/2021					0.058	0.12		
8/31/2021						0.13		
9/1/2021					0.064			
9/27/2021					0.067	0.15		
10/26/2021					0.053	0.11		
11/17/2021					0.052	0.11		
1/24/2022	0.00066							0.0037
1/31/2022		0.0183	0.0109	0.1	0.0642	0.128		
6/20/2022	<0.005							<0.005
6/21/2022		<0.01	<0.005	0.029	0.039	0.1		
10/25/2022	<0.005		<0.005	0.0517	0.0712	0.148		0.00544
10/26/2022		0.00893					0.00785	
1/24/2023	<0.005							<0.005
2/6/2023			0.0142	0.0143	0.0687			
2/7/2023		0.0247				0.198	0.0116	
3/20/2023							<0.05	

Time Series

Constituent: Mercury (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.0002							<0.0002
1/26/2016	<0.0002							<0.0002
4/19/2016	<0.0002							<0.0002
7/18/2016	<0.0002							<0.0002
10/11/2016	<0.0002							<0.0002
1/23/2017	<0.0002							<0.0002
4/17/2017	<0.0002							<0.0002
9/25/2017	<0.0002							<0.0002
2/7/2018	<0.0002							<0.0002
6/20/2018	<0.0002							<0.0002
10/1/2018	<0.0002							<0.0002
2/12/2019	<0.0002							<0.0002
2/24/2020	<0.0002							<0.0002
5/21/2020		<0.0002	<0.0002	<0.0002				
6/4/2020		<0.0002	<0.0002	<0.0002				
6/18/2020		<0.0002	<0.0002	0.00047				
6/22/2020	<0.0002							<0.0002
7/1/2020		0.0002		0.00023				
7/2/2020			<0.0002					
7/16/2020		<0.0002	<0.0002	<0.0002				
7/30/2020		<0.0002	<0.0002	<0.0002				
8/13/2020		<0.0002	<0.0002	<0.0002				
8/27/2020		<0.0002	<0.0002	<0.0002				
1/26/2021	<0.0002							<0.0002
2/10/2021		<0.0002	<0.0002	<0.0002				
4/7/2021		<0.0002	<0.0002	0.00021	<0.0002	<0.0002		
5/13/2021					<0.0002	<0.0002		
6/21/2021	<0.0002							<0.0002
7/7/2021		<0.0002	<0.0002	<0.0002				
7/8/2021					<0.0002	<0.0002		
8/31/2021						<0.0002		
9/1/2021					<0.0002			
9/27/2021					<0.0002	<0.0002		
10/26/2021					<0.0002	<0.0002		
11/17/2021					<0.0002	<0.0002		
1/24/2022	<0.0002							<0.0002
1/31/2022		<0.0002	<0.0002	<0.0002	<0.0002	<0.0002		
6/20/2022	<0.0002							<0.0002
6/21/2022		<0.0002	<0.0002	<0.0002	<0.0002	<0.0002		
10/25/2022	<0.0002		<0.0002	<0.0002	<0.0002	<0.0002		<0.0002
10/26/2022		<0.0002					<0.0002	
1/24/2023	<0.0002							<0.0002
2/6/2023			<0.0002	<0.0002	<0.0002			
2/7/2023		<0.0002				<0.0002	<0.0002	
3/20/2023							<0.0002	

Time Series

Constituent: Molybdenum (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.005							<0.005
1/26/2016	<0.005							<0.005
4/19/2016	<0.005							<0.005
7/18/2016	<0.005							<0.005
10/11/2016	<0.005							<0.005
1/23/2017	<0.005							<0.005
4/17/2017	<0.005							<0.005
9/25/2017	<0.005							<0.005
2/7/2018	<0.005							<0.005
6/20/2018	<0.005							<0.005
2/12/2019	<0.005							<0.005
2/24/2020	<0.005							<0.005
5/21/2020		<0.005	<0.005	<0.005				
6/4/2020		<0.005	<0.005	<0.005				
6/18/2020		<0.005	<0.005	<0.005				
6/22/2020	<0.005							<0.005
7/1/2020		<0.005		<0.005				
7/2/2020			<0.005					
7/16/2020		<0.005	<0.005	<0.005				
7/30/2020		<0.005	<0.005	<0.005				
8/13/2020		<0.005	<0.005	<0.005				
8/27/2020		<0.005	<0.005	<0.005				
1/26/2021	<0.005							<0.005
2/10/2021		<0.005	<0.005	<0.005				
4/7/2021		<0.005	<0.005	<0.005	<0.005	<0.005		
5/13/2021					<0.005	<0.005		
6/21/2021	<0.005							<0.005
7/7/2021		<0.005	<0.005	<0.005				
7/8/2021					<0.005	<0.005		
8/31/2021						<0.005		
9/1/2021					<0.005			
9/27/2021					<0.005	<0.005		
10/26/2021					<0.005	<0.005		
11/17/2021					<0.005	<0.005		
1/24/2022	<0.005							<0.005
1/31/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
6/20/2022	<0.005							<0.005
6/21/2022		<0.005	<0.005	<0.005	<0.005	<0.005		
10/25/2022	<0.005		<0.005	<0.005	<0.005	<0.005		<0.005
10/26/2022		<0.005					<0.04	
1/24/2023	<0.005							<0.005
2/6/2023			<0.005	<0.005	<0.005			
2/7/2023		<0.005				<0.005	<0.04	
3/20/2023							<0.04	

Time Series

Constituent: pH, Field (pH units) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
1/26/2015								4.53
2/16/2015								4.68
6/16/2015								4.74
7/6/2015								5.25
10/19/2015	4.45							5.47
1/26/2016	4.12							5.2
4/19/2016	4.33							5.32
7/18/2016	4.38							5.2
10/11/2016	4.14							5.01
1/23/2017	4.32							5.01
4/17/2017	4.26							5.19
7/12/2017								5.11
7/25/2017	4.21							
9/25/2017	4.32							5.27
10/9/2017	4.25							5.21
2/7/2018	4.42							5.29
6/20/2018	4.32							5.58
10/1/2018	4.09							5.08
2/12/2019	4.5							5.47
5/20/2019	4.5							5.26
2/24/2020	4.09							4.92
5/21/2020		3.58	3.82	3.66				
6/4/2020		3.98	3.86	3.99				
6/18/2020		3.89	3.69	3.63				
6/22/2020	4.48							5.12
7/1/2020		4.06		3.96				
7/2/2020			3.79					
7/16/2020		4.48	4.06	3.93				
7/30/2020		4.22	3.72	3.63				
8/13/2020		3.92	3.59	3.4				
8/27/2020		3.98	3.81	3.81				
9/21/2020		4.11	3.79	3.77				
1/26/2021	4.31							5.03
2/10/2021		3.8	3.77	3.5				
4/7/2021		4.1	4.02	3.73	3.78	3.68		
5/13/2021					3.88	3.7		
6/21/2021	4.25							5.21
7/7/2021		4.19	3.8	3.56				
7/8/2021					3.65	3.54		
8/31/2021						3.67		
9/1/2021					3.65			
9/27/2021					3.65	3.62		
10/26/2021					3.66	3.54		
11/17/2021					3.54	3.66		
1/24/2022	4.26							5.19
1/31/2022		4.21	3.96	3.84	3.9	3.93		
6/20/2022	4.45							4.84
6/21/2022		4.28	4.01	3.87	3.89	3.82		
10/25/2022	4.31		3.8	3.56	3.69	3.56		5.01
10/26/2022		4.01					3.69	
1/24/2023	4.23							4.84
2/6/2023			4.01	3.77	4.01			

Time Series

Constituent: Selenium (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.0025							<0.0025
1/26/2016	<0.0025							<0.0025
4/19/2016	<0.0025							<0.0025
7/18/2016	<0.0025							<0.0025
10/11/2016	<0.0025							<0.0025
1/23/2017	<0.0025							<0.0025
4/17/2017	<0.0025							<0.0025
7/25/2017	<0.0025							<0.0025
9/25/2017	<0.0025							<0.0025
2/7/2018	<0.0025							<0.0025
6/20/2018	<0.0025							<0.0025
10/1/2018	<0.0025							<0.0025
2/12/2019	<0.0025							<0.0025
2/24/2020	<0.0025							<0.0025
5/21/2020		<0.0025	0.0113	<0.0025				
6/4/2020		0.0166	0.0078	0.0067				
6/18/2020		0.0143	<0.0025	<0.0025				
6/22/2020	<0.0025							<0.0025
7/1/2020		0.0177		<0.0025				
7/2/2020			<0.0025					
7/16/2020		<0.0025	<0.0025	<0.0025				
7/30/2020		<0.0025	<0.0025	<0.0025				
8/13/2020		<0.0025	<0.0025	<0.0025				
8/27/2020		<0.0025	<0.0025	<0.0025				
1/26/2021	<0.0025							<0.0025
2/10/2021		0.0163	<0.0025	<0.0025				
4/7/2021		<0.0025	<0.0025	<0.0025	<0.0025	<0.0025		
5/13/2021					<0.0025	<0.0025		
6/21/2021	<0.0025							<0.0025
7/7/2021		<0.0025	<0.0025	<0.0025				
7/8/2021					<0.0025	<0.0025		
8/31/2021						<0.0025		
9/1/2021					<0.0025			
9/27/2021					<0.0025	<0.0025		
10/26/2021					<0.0025	<0.0025		
11/17/2021					<0.0025	<0.0025		
1/24/2022	<0.0025							<0.0025
1/31/2022		0.018	0.014	0.014	<0.0025	<0.0025		
6/20/2022	<0.0025							<0.0025
6/21/2022		<0.0025	<0.0025	<0.0025	<0.0025	<0.0025		
10/25/2022	<0.0025		0.027	0.019	0.00856	<0.0025		<0.0025
10/26/2022		0.026					0.046	
1/24/2023	<0.0025							<0.0025
2/6/2023			<0.0025	<0.0025	<0.0025			
2/7/2023		<0.0025				<0.0025	0.002	
3/20/2023							<0.015	

Time Series

Constituent: Thallium (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
10/19/2015	<0.001							<0.001
1/26/2016	<0.001							<0.001
4/19/2016	<0.001							<0.001
7/18/2016	<0.001							<0.001
10/11/2016	<0.001							<0.001
1/23/2017	<0.001							<0.001
4/17/2017	<0.001							<0.001
9/25/2017	<0.001							<0.001
2/7/2018	<0.001							<0.001
6/20/2018	<0.001							<0.001
2/12/2019	<0.001							<0.001
2/24/2020	<0.001							<0.001
5/21/2020		<0.001	<0.001	<0.001				
6/4/2020		<0.001	<0.001	<0.001				
6/18/2020		<0.001	<0.001	<0.001				
6/22/2020	<0.001							<0.001
7/1/2020		<0.001		<0.001				
7/2/2020			<0.001					
7/16/2020		<0.001	<0.001	<0.001				
7/30/2020		<0.001	<0.001	<0.001				
8/13/2020		<0.001	<0.001	<0.001				
8/27/2020		<0.001	<0.001	<0.001				
1/26/2021	<0.001							<0.001
2/10/2021		<0.001	<0.001	<0.001				
4/7/2021		<0.001	<0.001	<0.001	<0.001	<0.001		
5/13/2021					<0.001	<0.001		
6/21/2021	<0.001							<0.001
7/7/2021		<0.001	<0.001	<0.001				
7/8/2021					<0.001	<0.001		
8/31/2021						<0.001		
9/1/2021					<0.001			
9/27/2021					<0.001	<0.001		
10/26/2021					<0.001	<0.001		
11/17/2021					<0.001	<0.001		
1/24/2022	<0.001							<0.001
1/31/2022		<0.001	<0.001	<0.001	<0.001	<0.001		
6/20/2022	<0.001							<0.001
6/21/2022		<0.001	<0.001	<0.001	<0.001	<0.001		
10/25/2022	<0.001		<0.001	<0.001	<0.001	<0.001		<0.001
10/26/2022		<0.001					<0.001	
1/24/2023	<0.001							<0.001
2/6/2023			<0.001	<0.001	<0.001			
2/7/2023		<0.001				<0.001	<0.001	
3/20/2023							<0.001	

Time Series


Constituent: Total Dissolved Solids (mg/L) Analysis Run 8/13/2023 4:13 PM

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6	CGYP-7	PM-1 (bg)
1/26/2015								142.5
2/16/2015								106.2
6/16/2015								158
7/6/2015								151
10/19/2015	150							206
1/26/2016	120							165
4/19/2016	120							130
7/18/2016	132							124
10/11/2016	151.7							200
1/23/2017	148							138
4/17/2017	62							56
7/12/2017								108
7/25/2017	92							
9/25/2017	<40							<40
10/9/2017	115							80
2/7/2018	92							112
6/20/2018	138.8							200
10/1/2018	107.5							130
2/12/2019	135							136.2
5/20/2019	181.2							162.5
2/24/2020	107.5							120
5/21/2020		1505	1609	3449				
6/4/2020		1839	1589	3895				
6/18/2020		1964	1624	4502				
6/22/2020	147.5							112.5
7/1/2020		2650		4120				
7/2/2020			1634					
7/16/2020		1811	1512	3700				
7/30/2020		1541	1515	3138				
8/13/2020		1768	1599	3102				
8/27/2020		1772	1526	3519				
9/21/2020		1945	1515	3288				
1/26/2021	138.8							110
2/10/2021		2081	1538	4090				
4/7/2021		2301	1536	4958	2178	3952		
5/13/2021					2078	2804		
6/21/2021	178.8							155
7/7/2021		1770	1618	3291				
7/8/2021					2168	2851		
8/31/2021						2740		
9/1/2021					2038			
9/27/2021					1749	2382		
10/26/2021					1614	2306		
11/17/2021					1676	1899		
1/24/2022	130							128.8
1/31/2022		1912	1582	3410	1864	2379		
6/20/2022	143.8							137.5
6/21/2022		1771	1408	2952	1676	3210		
10/25/2022	110		1454	2835	1585	2902		96.25
10/26/2022		1894					2545	
1/24/2023	142.5							111.2
2/6/2023			1474	3838	1689			


FIGURE B.

Box & Whiskers Plot

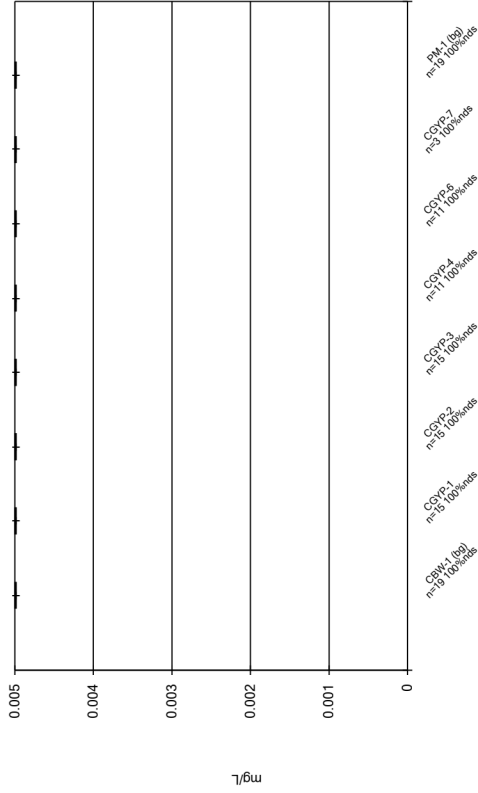


Constituent: Antimony Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

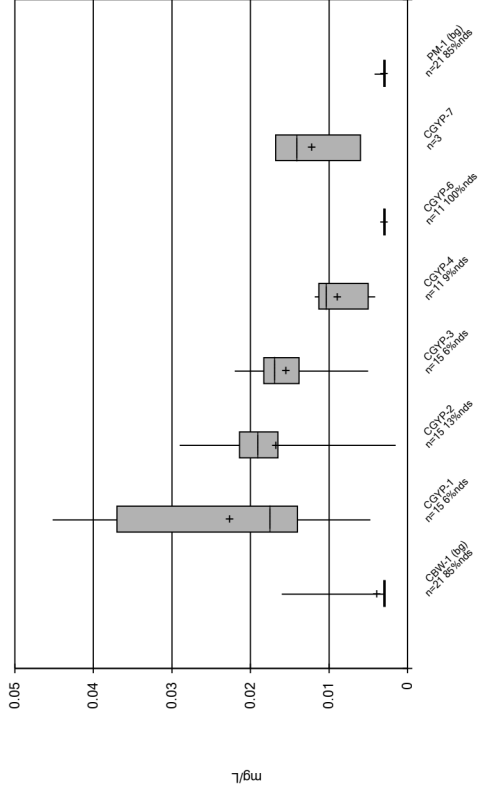


Constituent: Arsenic Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

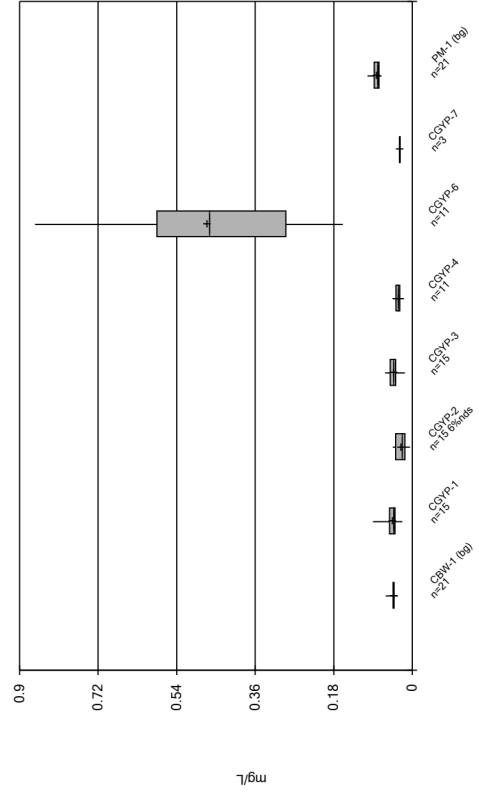


Constituent: Barium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

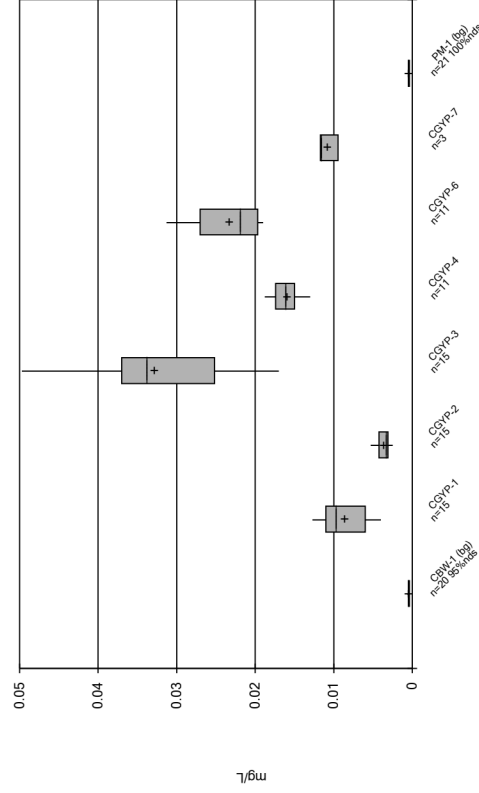


Constituent: Beryllium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

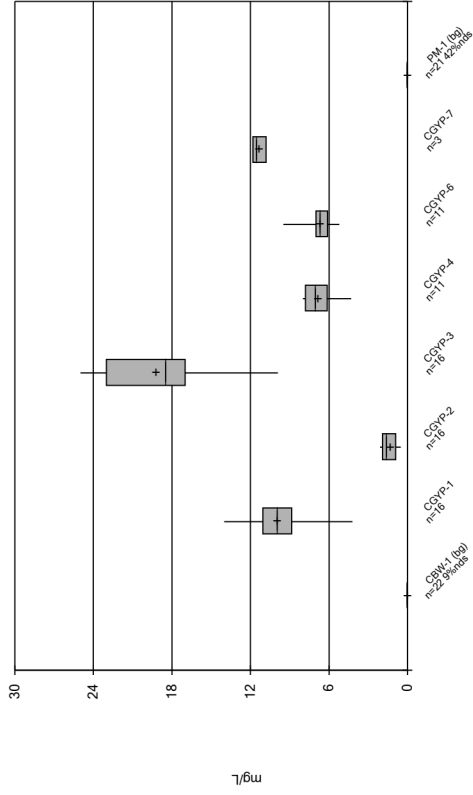


Constituent: Boron Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

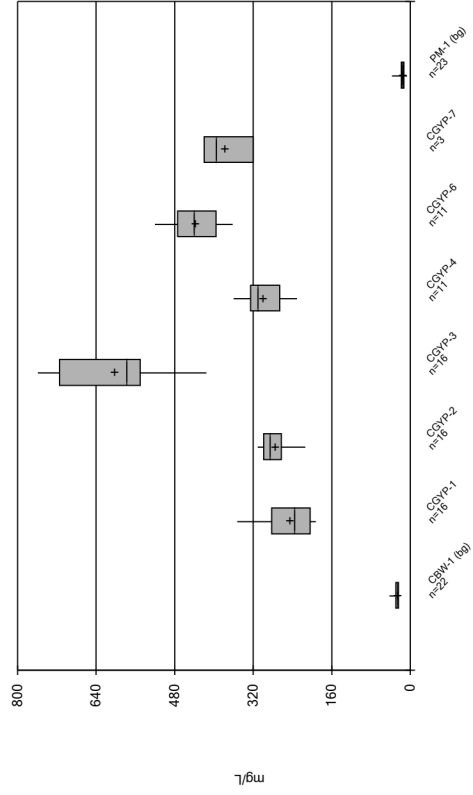


Constituent: Calcium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

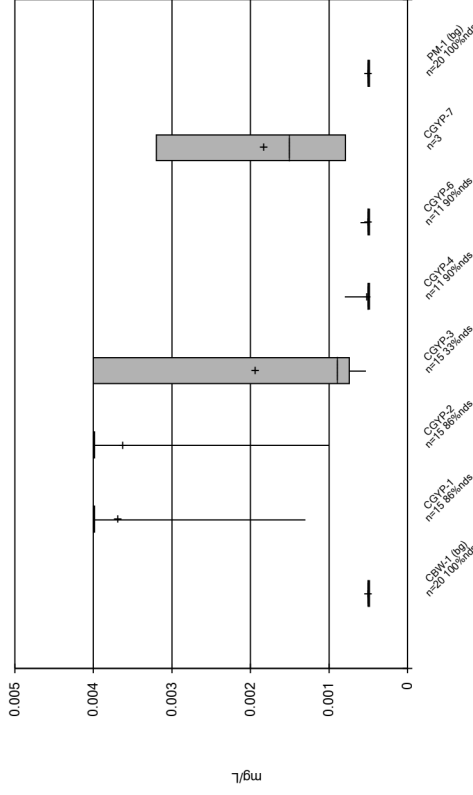


Constituent: Cadmium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

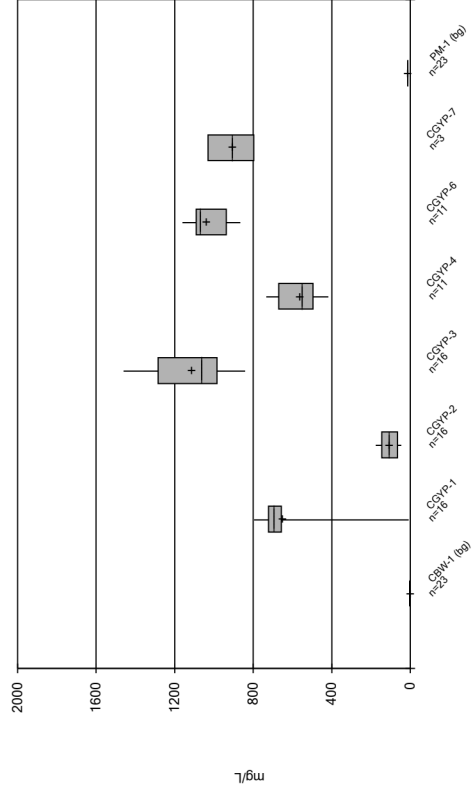


Constituent: Chloride Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

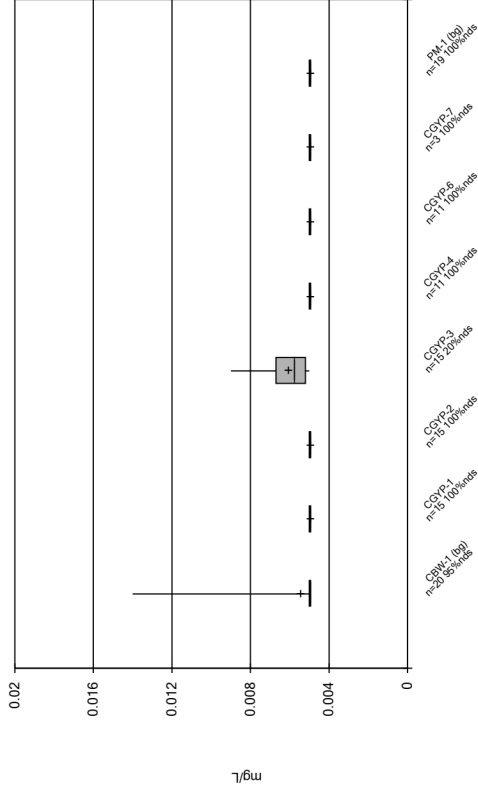


Constituent: Chromium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

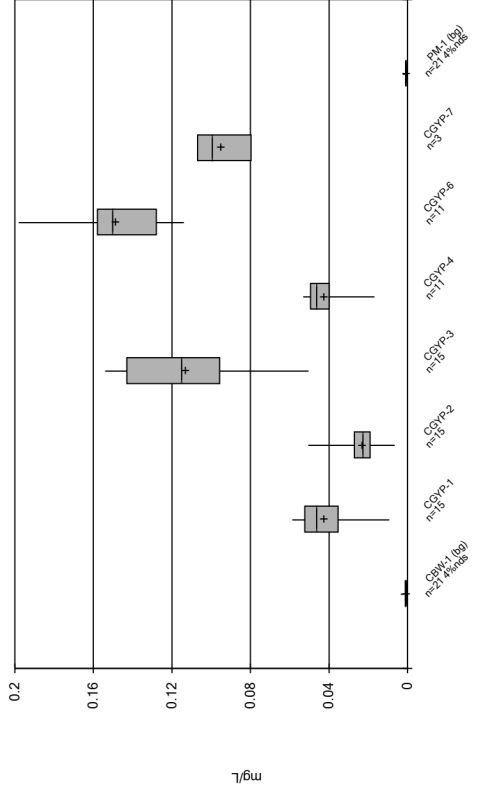


Constituent: Cobalt Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

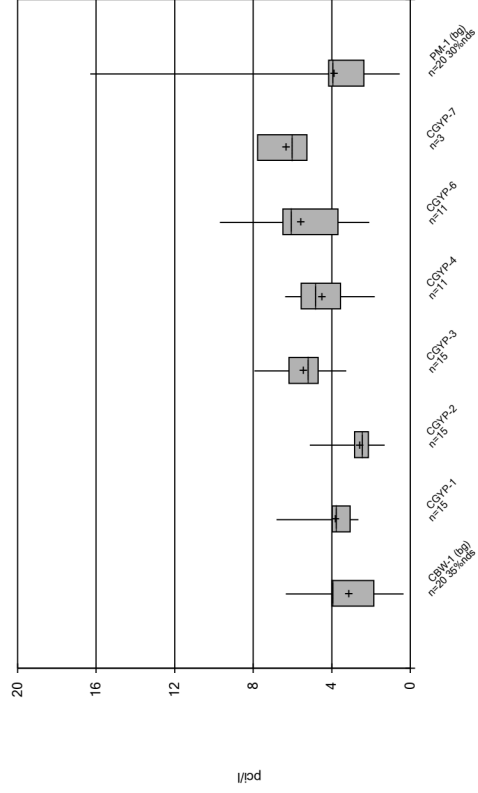


Constituent: Combined Radium 226 & 228 Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

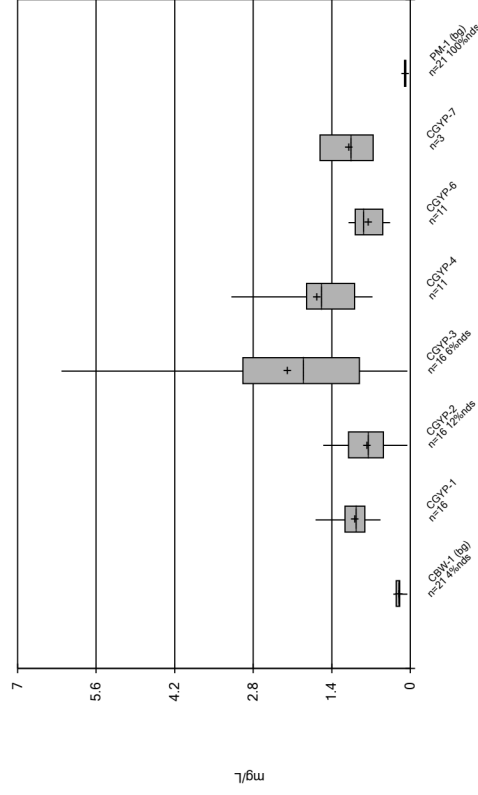


Constituent: Fluoride Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

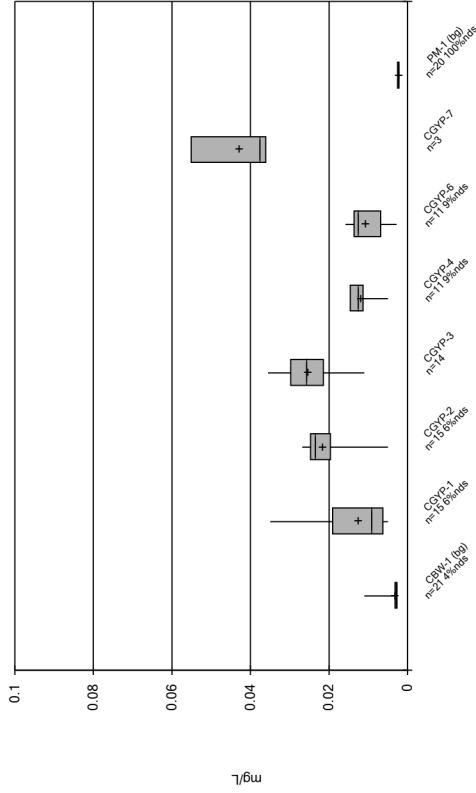


Constituent: Lithium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

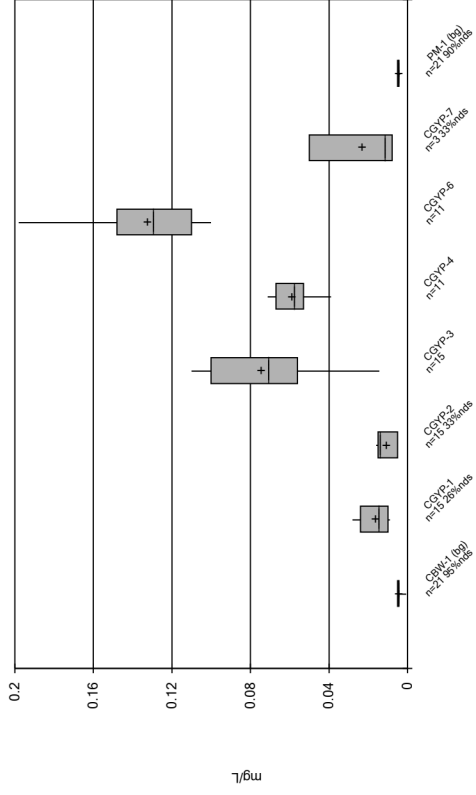


Constituent: Lithium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

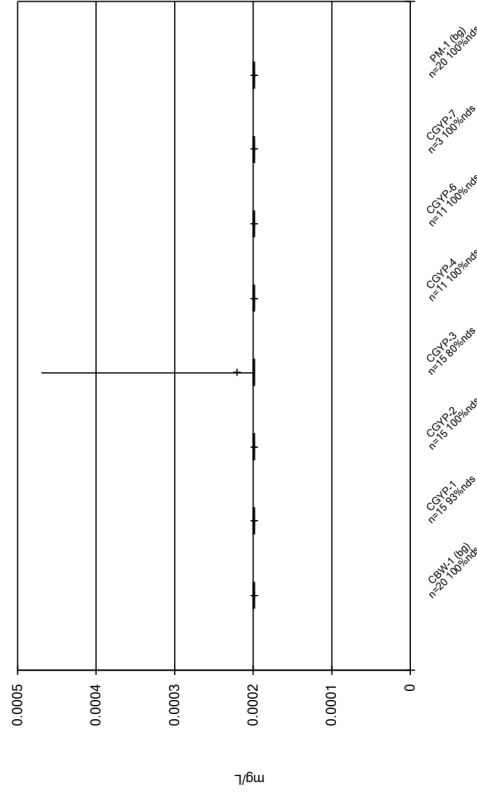


Constituent: Mercury Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

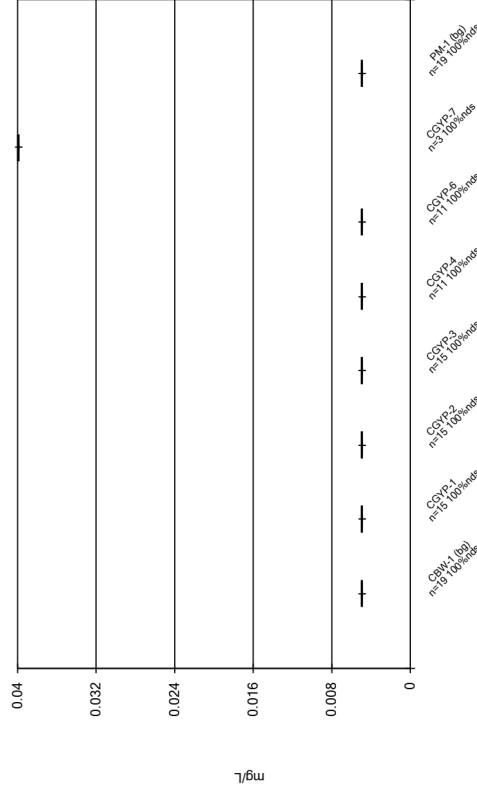


Constituent: Molybdenum Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

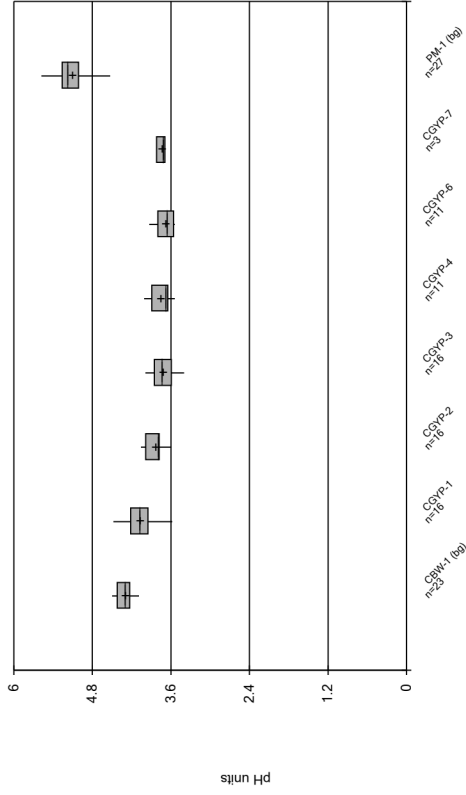


Constituent: pH, Field Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

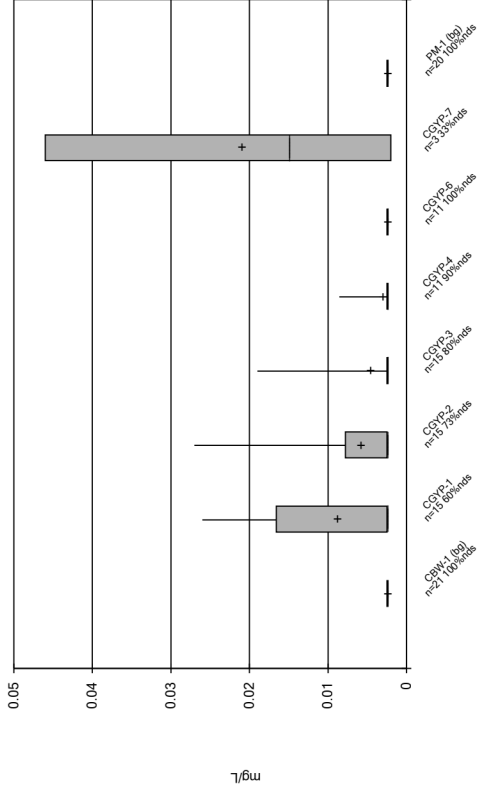


Constituent: Selenium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

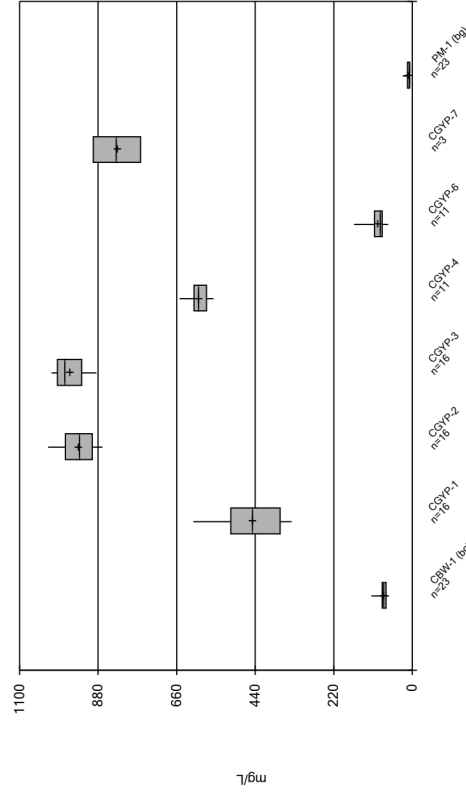


Constituent: Sulfate Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

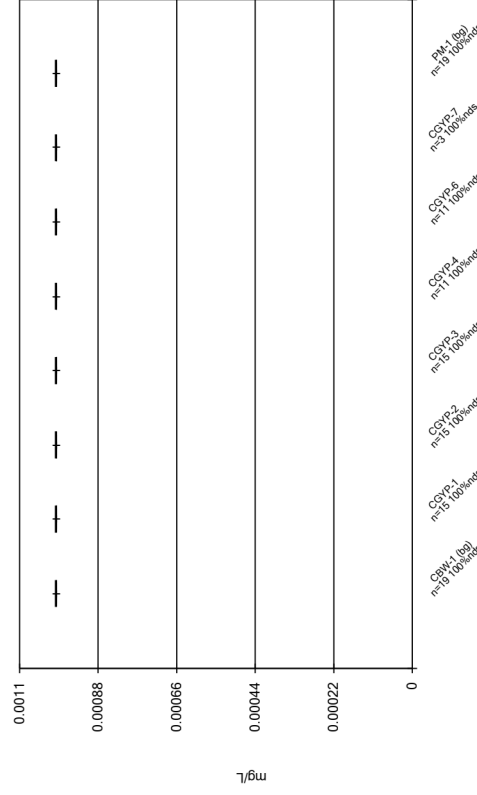

Constituent: Thallium Analysis Run 8/13/2023 4:14 PM
CGYP Client: Santee Cooper Data: CGYP

Box & Whiskers Plot

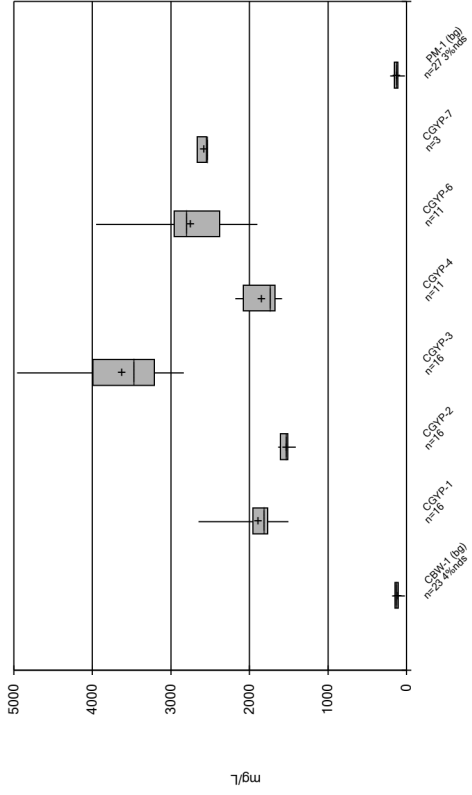

Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:14 PM

CGYP Client: Santee Cooper Data: CGYP

FIGURE C.

Outlier Summary

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:15 PM

CGYP-3 Lead (mg/L)

2/10/2021 0.092 (o)

FIGURE D.

Appendix III Interwell Prediction Limits - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:05 PM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	2/7/2023	11.1	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	2/6/2023	0.602	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	2/6/2023	23.9	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	2/6/2023	5.67	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	2/7/2023	9.49	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.31	n/a	2/7/2023	264	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.31	n/a	2/6/2023	301	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.31	n/a	2/6/2023	737	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.31	n/a	2/6/2023	266	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.31	n/a	2/7/2023	520	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	2/6/2023	46	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	2/6/2023	1270	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	2/6/2023	417	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	2/7/2023	1150	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	2/7/2023	1.28	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	2/6/2023	1.12	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	2/6/2023	3.08	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	2/6/2023	1.58	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	2/7/2023	0.89	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	2/6/2023	4.01	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	2/6/2023	3.77	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	2/6/2023	4.01	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	2/7/2023	3.8	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	2/7/2023	476	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	2/6/2023	958	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	2/6/2023	928	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	2/6/2023	557	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	2/7/2023	163	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	200.1	n/a	2/7/2023	1764	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	200.1	n/a	2/6/2023	1474	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	200.1	n/a	2/6/2023	3838	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	200.1	n/a	2/6/2023	1689	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	200.1	n/a	2/7/2023	2959	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2


Appendix III Interwell Prediction Limits - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:05 PM

Constituent	Well	Upper Lim.	Lower Lim.	Date	Observ.	Sig.	Bg N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Boron (mg/L)	CGYP-1	0.049	n/a	2/7/2023	11.1	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-2	0.049	n/a	2/6/2023	0.602	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-3	0.049	n/a	2/6/2023	23.9	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-4	0.049	n/a	2/6/2023	5.67	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Boron (mg/L)	CGYP-6	0.049	n/a	2/7/2023	9.49	Yes	43	n/a	n/a	25.58	n/a	n/a	0.001013	NP Inter (normality) 1 of 2
Calcium (mg/L)	CGYP-1	36.31	n/a	2/7/2023	264	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-2	36.31	n/a	2/6/2023	301	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-3	36.31	n/a	2/6/2023	737	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-4	36.31	n/a	2/6/2023	266	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Calcium (mg/L)	CGYP-6	36.31	n/a	2/7/2023	520	Yes	45	21.92	7.512	0	None	No	0.001254	Param Inter 1 of 2
Chloride (mg/L)	CGYP-1	13.5	n/a	2/7/2023	7.21	No	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-2	13.5	n/a	2/6/2023	46	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-3	13.5	n/a	2/6/2023	1270	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-4	13.5	n/a	2/6/2023	417	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Chloride (mg/L)	CGYP-6	13.5	n/a	2/7/2023	1150	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Fluoride (mg/L)	CGYP-1	0.3	n/a	2/7/2023	1.28	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-2	0.3	n/a	2/6/2023	1.12	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-3	0.3	n/a	2/6/2023	3.08	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-4	0.3	n/a	2/6/2023	1.58	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
Fluoride (mg/L)	CGYP-6	0.3	n/a	2/7/2023	0.89	Yes	42	n/a	n/a	52.38	n/a	n/a	0.001052	NP Inter (NDs) 1 of 2
pH, Field (pH units)	CGYP-1	5.58	4.09	2/7/2023	4.38	No	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-2	5.58	4.09	2/6/2023	4.01	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-3	5.58	4.09	2/6/2023	3.77	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-4	5.58	4.09	2/6/2023	4.01	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
pH, Field (pH units)	CGYP-6	5.58	4.09	2/7/2023	3.8	Yes	50	n/a	n/a	0	n/a	n/a	0.001481	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-1	115	n/a	2/7/2023	476	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-2	115	n/a	2/6/2023	958	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-3	115	n/a	2/6/2023	928	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-4	115	n/a	2/6/2023	557	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Sulfate (mg/L)	CGYP-6	115	n/a	2/7/2023	163	Yes	46	n/a	n/a	0	n/a	n/a	0.0008958	NP Inter (normality) 1 of 2
Total Dissolved Solids (mg/L)	CGYP-1	200.1	n/a	2/7/2023	1764	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-2	200.1	n/a	2/6/2023	1474	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-3	200.1	n/a	2/6/2023	3838	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-4	200.1	n/a	2/6/2023	1689	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2
Total Dissolved Solids (mg/L)	CGYP-6	200.1	n/a	2/7/2023	2959	Yes	50	127.2	38.31	4	None	No	0.001254	Param Inter 1 of 2

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

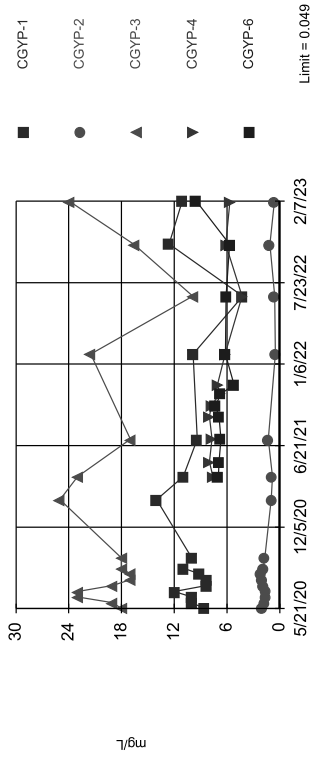


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 43 background values. 25.58% NDs. Annual per-constituent alpha = 0.01208. Individual comparison alpha = 0.001013 (1 of 2). Comparing 5 points to limit. Assumes 1 future value.

Constituent: Boron Analysis Run 8/13/2023 4:03 PM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

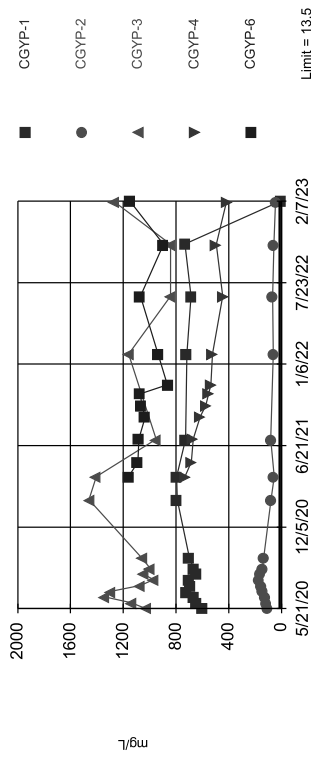


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 46 background values. Annual per-constituent alpha = 0.0107. Individual comparison alpha = 0.0008958 (1 of 2). Comparing 5 points to limit. Assumes 1 future value.

Constituent: Chloride Analysis Run 8/13/2023 4:03 PM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Parametric

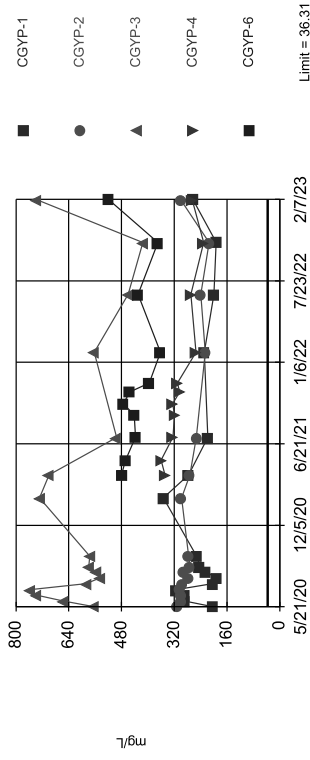


Background Data Summary: Mean=21.92, Std. Dev.=7.512, n=45. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9593, critical = 0.926. Kappa = 1.916 (c=7, w=6, 1 of 2, event.alpha = 0.0532). Report alpha = 0.007498. Individual comparison alpha = 0.001254. Comparing 5 points to limit. Assumes 1 future value.

Constituent: Calcium Analysis Run 8/13/2023 4:03 PM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

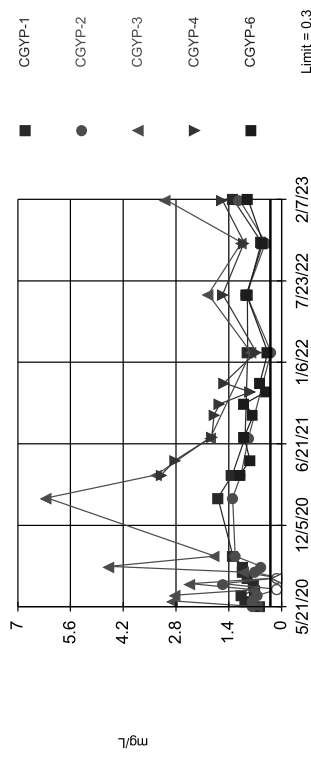


Non-parametric test used in lieu of parametric prediction limit because censored data exceeded 50%. Limit is highest of 42 background values. 52.38% NDs. Annual per-constituent alpha = 0.01255. Individual comparison alpha = 0.001052 (1 of 2). Comparing 5 points to limit. Assumes 1 future value.

Constituent: Fluoride Analysis Run 8/13/2023 4:03 PM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limits: CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

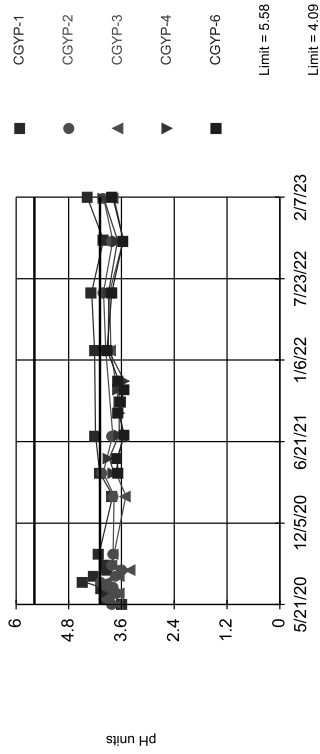


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Francia normality test showed the data to be non-normal at the 0.01 alpha level. Limits are highest and lowest of 50 background values. Annual per-constituent alpha = 0.0177. Individual comparison alpha = 0.001481 (1 of 2). Comparing 5 points to limit. Assumes 1 future value.

Constituent: pH, Field Analysis Run 8/13/2023 4:03 PM View: Interwell PLS
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Non-parametric

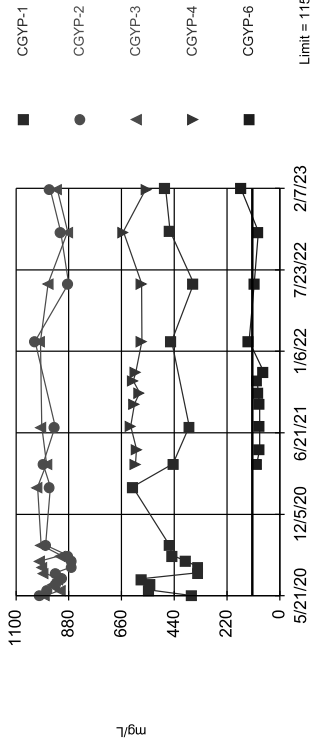


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 46 background values. Annual per-constituent alpha = 0.0107. Individual comparison alpha = 0.0008958 (1 of 2). Comparing 5 points to limit. Assumes 1 future value.

Constituent: Sulfate Analysis Run 8/13/2023 4:03 PM View: Interwell PLS
CGYP Client: Santee Cooper Data: CGYP

Exceeds Limit: CGYP-1, CGYP-2, CGYP-3, CGYP-4, CGYP-6

Prediction Limit
Interwell Parametric

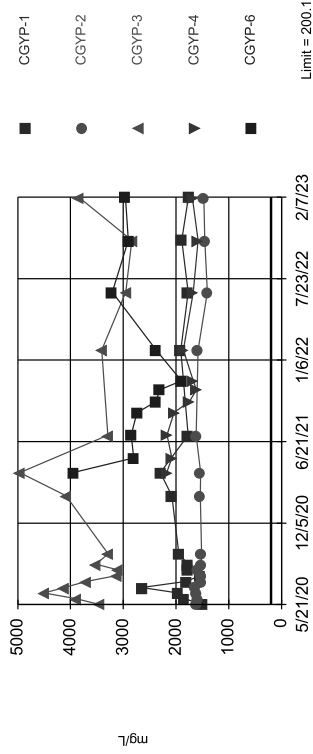

Background Data Summary: Mean=127.2, Std. Dev.=38.31, n=50, 4% NDs. Normality test: Shapiro Francia @alpha = 0.01, calculated = 0.9407, critical = 0.935. Kappa = 1.902 (c=7, w=6, 1 of 2, event alpha = 0.05132). Report alpha = 0.007498. Individual comparison alpha = 0.001254. Comparing 5 points to limit. Assumes 1 future value.

Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:03 PM View: Interwell PLS
CGYP Client: Santee Cooper Data: CGYP

Prediction Limit

Constituent: Boron (mg/L) Analysis Run 8/13/2023 4:05 PM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-3	CGYP-2	CGYP-6	CGYP-4
10/19/2015	0.032	0.0178					
1/26/2016	0.0218	<0.015					
4/19/2016	0.0183	<0.015					
7/18/2016	0.0217	0.0163					
10/11/2016	0.0302	0.0165					
1/23/2017	0.0249	<0.015					
4/17/2017	0.018	0.019					
7/25/2017	0.022						
9/25/2017	0.024	0.018					
10/9/2017	0.023	0.021					
2/7/2018	0.018	<0.015					
6/20/2018	0.02	0.016					
10/1/2018	0.025	0.015					
2/12/2019	<0.015	<0.015					
2/24/2020	0.017	<0.015					
5/21/2020			8.6	18	2		
6/4/2020			10	19	1.7		
6/18/2020			10	23	1.6		
6/22/2020	0.018	0.049					
7/1/2020			12	23			
7/2/2020					1.6		
7/16/2020			8.3	19	1.9		
7/30/2020			8.3	17	2		
8/13/2020			9.1	17	2.1		
8/27/2020			11	18	1.9		
9/21/2020			10	18	1.7		
1/26/2021	0.018	<0.015					
2/10/2021			14	25	0.96		
4/7/2021			11	23	0.85	7	7.6
5/13/2021						6.9	8
6/21/2021	<0.015	<0.015					
7/7/2021			9.4	17	1.3		
7/8/2021						6.7	7.7
8/31/2021						6.9	
9/1/2021							8
9/27/2021						7.3	7.8
10/26/2021						6.7	6.8
11/17/2021						5.2	7.1
1/24/2022	0.0139	0.011					
1/31/2022			9.84	21.5	0.51	6.2	6.21
6/20/2022	0.015	<0.015					
6/21/2022			4.2	9.9	0.57	6.1	4.3
10/25/2022	0.0203	0.0437		16.6	1.14	5.71	6.13
10/26/2022			12.6				
1/24/2023	0.0175	0.0114					
2/6/2023				23.9	0.602		5.67
2/7/2023			11.1			9.49	

Prediction Limit

Constituent: Calcium (mg/L) Analysis Run 8/13/2023 4:05 PM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-6	CGYP-4
10/19/2015	27	26					
1/26/2016	27	27					
4/19/2016	29.4	23.3					
7/18/2016	28.7	18.8					
10/11/2016	22.7	16.4					
1/23/2017	26.2	10.4					
4/17/2017	25.6	12.5					
7/12/2017		18.5					
9/25/2017	21.9	15.4					
10/9/2017	23	17					
2/7/2018	24	14.7					
6/20/2018	24	37					
10/1/2018	22.7	16.6					
2/12/2019	24.4	15.9					
5/20/2019	42.2	16.4					
2/24/2020	28.2	11					
5/21/2020			311	564	204		
6/4/2020			298	658	290		
6/18/2020			299	737	289		
6/22/2020	28.4	13.5					
7/1/2020				759	315		
7/2/2020			305				
7/16/2020			295	587	204		
7/30/2020			279	545	192		
8/13/2020			293	556	224		
8/27/2020			272	579	242		
9/21/2020			276	576	252		
1/26/2021	29.2	14.3					
2/10/2021			298	729	353		
4/7/2021			273	700	276	480	348
5/13/2021						468	360
6/21/2021	29.9	17					
7/7/2021			253	495	218		
7/8/2021						438	324
8/31/2021						441	
9/1/2021							319
9/27/2021						474	325
10/26/2021						455	304
11/17/2021						396	310
1/24/2022	27.9	14.4					
1/31/2022			226	563	229	362	254
6/20/2022	29	6.2					
6/21/2022			240	460	200	430	270
10/25/2022	27.5	13.1	214	415		370	231
10/26/2022					193		
1/24/2023	29.3	12.6					
2/6/2023			301	737			266
2/7/2023					264	520	

Prediction Limit

Constituent: Chloride (mg/L) Analysis Run 8/13/2023 4:05 PM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-3	CGYP-2	CGYP-4	CGYP-6
10/19/2015	3.21	12.7					
1/26/2016	2.95	11.3					
4/19/2016	2.33	12.1					
7/18/2016	2.95	13.2					
10/11/2016	3	12.8					
1/23/2017	2.45	13.5					
4/17/2017	2.96	12.7					
7/12/2017		12.1					
7/25/2017	2.61						
9/25/2017	2.51	13.3					
10/9/2017	2.73	12.6					
2/7/2018	2.88	12.4					
6/20/2018	3	13.4					
10/1/2018	2.71	12.9					
2/12/2019	2.68	12.1					
5/20/2019	2.9	12.7					
2/24/2020	3.25	12.7					
5/21/2020			600	1030	103		
6/4/2020			644	1140	117		
6/18/2020			666	1340	127		
6/22/2020	3.44	12.67					
7/1/2020			717	1300			
7/2/2020					145		
7/16/2020			694	1070	153		
7/30/2020			703	971	176		
8/13/2020			647	1050	163		
8/27/2020			666	998	146		
9/21/2020			699	1060	136		
1/26/2021	3.22	11.8					
2/10/2021			791	1460	79.5		
4/7/2021			795	1405	55.87	733	1160
5/13/2021						683	1090
6/21/2021	3.05	12					
7/7/2021			728	950	83.1		
7/8/2021						670	1082
8/31/2021							1033
9/1/2021						617	
9/27/2021						574	1061
10/26/2021						553	1070
11/17/2021						537	865
1/24/2022	3.21	12.1					
1/31/2022			717	1160	63	523	937
6/20/2022	3.79	13.4					
6/21/2022			686	841	66.4	445	1070
10/25/2022	3.78	12.7		842	57.3	495	896
10/26/2022			733				
1/24/2023	3	12.3					
2/6/2023				1270	46	417	
2/7/2023			7.21				1150

Prediction Limit

Constituent: Fluoride (mg/L) Analysis Run 8/13/2023 4:05 PM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-3	CGYP-2	CGYP-6	CGYP-4
10/19/2015	0.25	<0.1					
1/26/2016	0.3	<0.1					
4/19/2016	0.29	<0.1					
7/18/2016	0.27	<0.1					
10/11/2016	0.28	<0.1					
1/23/2017	0.25	<0.1					
4/17/2017	0.22	<0.1					
9/25/2017	0.23	<0.1					
10/9/2017	0.22	<0.1					
2/7/2018	0.19	<0.1					
6/20/2018	0.2	<0.1					
10/1/2018	0.19	<0.1					
2/12/2019	0.18	<0.1					
2/24/2020	0.19	<0.1					
5/21/2020			0.58	0.65	0.75		
6/4/2020			0.96	2.89	0.75		
6/18/2020			1.05	2.82	0.62		
6/22/2020	0.2	<0.1					
7/1/2020			0.69	0.73			
7/2/2020					<0.1		
7/16/2020			0.72	2.41	1.55		
7/30/2020			0.91	<0.1	<0.1		
8/13/2020			1.04	1	0.71		
8/27/2020			1.02	4.57	0.54		
9/21/2020			1.29	1.77	1.23		
1/26/2021	0.15	<0.1					
2/10/2021			1.69	6.22	1.3		
4/7/2021			1.31	3.32	1.08	1.1	3.19
5/13/2021						0.84	2.82
6/21/2021	0.19	<0.1					
7/7/2021			0.97	1.88	0.87		
7/8/2021						0.99	1.85
8/31/2021						0.75	
9/1/2021							1.79
9/27/2021						0.98	1.63
10/26/2021						0.42	0.83
11/17/2021						0.58	1.53
1/24/2022	0.22	<0.1					
1/31/2022			0.9	0.81	0.28	0.36	0.67
6/20/2022	0.18	<0.1					
6/21/2022			0.91	1.94	0.93	0.93	1.56
10/25/2022	<0.1	<0.1		1.06	0.42	0.49	0.99
10/26/2022			0.53				
1/24/2023	0.15	<0.1					
2/6/2023				3.08	1.12		1.58
2/7/2023			1.28			0.89	

Prediction Limit

Constituent: pH, Field (pH units) Analysis Run 8/13/2023 4:05 PM View: Interwell PLS

CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-4	CGYP-6
1/26/2015	4.53						
2/16/2015	4.68						
6/16/2015	4.74						
7/6/2015	5.25						
10/19/2015	5.47	4.45					
1/26/2016	5.2	4.12					
4/19/2016	5.32	4.33					
7/18/2016	5.2	4.38					
10/11/2016	5.01	4.14					
1/23/2017	5.01	4.32					
4/17/2017	5.19	4.26					
7/12/2017	5.11						
7/25/2017		4.21					
9/25/2017	5.27	4.32					
10/9/2017	5.21	4.25					
2/7/2018	5.29	4.42					
6/20/2018	5.58	4.32					
10/1/2018	5.08	4.09					
2/12/2019	5.47	4.5					
5/20/2019	5.26	4.5					
2/24/2020	4.92	4.09					
5/21/2020			3.82	3.66	3.58		
6/4/2020			3.86	3.99	3.98		
6/18/2020			3.69	3.63	3.89		
6/22/2020	5.12	4.48					
7/1/2020				3.96	4.06		
7/2/2020			3.79				
7/16/2020			4.06	3.93	4.48		
7/30/2020			3.72	3.63	4.22		
8/13/2020			3.59	3.4	3.92		
8/27/2020			3.81	3.81	3.98		
9/21/2020			3.79	3.77	4.11		
1/26/2021	5.03	4.31					
2/10/2021			3.77	3.5	3.8		
4/7/2021			4.02	3.73	4.1	3.78	3.68
5/13/2021						3.88	3.7
6/21/2021	5.21	4.25					
7/7/2021			3.8	3.56	4.19		
7/8/2021						3.65	3.54
8/31/2021							3.67
9/1/2021						3.65	
9/27/2021						3.65	3.62
10/26/2021						3.66	3.54
11/17/2021						3.54	3.66
1/24/2022	5.19	4.26					
1/31/2022			3.96	3.84	4.21	3.9	3.93
6/20/2022	4.84	4.45					
6/21/2022			4.01	3.87	4.28	3.89	3.82
10/25/2022	5.01	4.31	3.8	3.56		3.69	3.56
10/26/2022					4.01		
1/24/2023	4.84	4.23					
2/6/2023			4.01	3.77		4.01	

Prediction Limit

Constituent: pH, Field (pH units) Analysis Run 8/13/2023 4:05 PM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-4	CGYP-6
2/7/2023					4.38		3.8

Prediction Limit

Constituent: Sulfate (mg/L) Analysis Run 8/13/2023 4:05 PM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	CBW-1 (bg)	PM-1 (bg)	CGYP-1	CGYP-3	CGYP-2	CGYP-4	CGYP-6
10/19/2015	81.5	26.5					
1/26/2016	88.2	25.5					
4/19/2016	86	20.2					
7/18/2016	90.1	16					
10/11/2016	73.7	19.3					
1/23/2017	77.7	8.82					
4/17/2017	71.2	9.71					
7/12/2017		11.1					
7/25/2017	73.3						
9/25/2017	74.5	8.03					
10/9/2017	76.8	8.77					
2/7/2018	69.1	13.5					
6/20/2018	67.9	8.58					
10/1/2018	65.5	11.9					
2/12/2019	69.1	8.96					
5/20/2019	115	10.5					
2/24/2020	79.8	8.36					
5/21/2020			364	978	1000		
6/4/2020			544	911	968		
6/18/2020			540	946.1	932		
6/22/2020	79.9	8.32					
7/1/2020			575	924			
7/2/2020					908		
7/16/2020			338	983	933		
7/30/2020			340	991	868		
8/13/2020			391	999	868		
8/27/2020			448	913	885		
9/21/2020			460	995	976		
1/26/2021	80.7	9.98					
2/10/2021			613	1010	957		
4/7/2021			445	972	987	602	96.3
5/13/2021						598	83.6
6/21/2021	86.6	11.9					
7/7/2021			377	993	937		
7/8/2021						621	84.3
8/31/2021							84.3
9/1/2021						605	
9/27/2021						584	90.9
10/26/2021						611	92.7
11/17/2021						600	67
1/24/2022	82.8	11.7					
1/31/2022			451	998	1020	575	128
6/20/2022	78.3	6.59					
6/21/2022			359	966	881	576	106
10/25/2022	80.4	7.99		885	914	652	89.3
10/26/2022			458				
1/24/2023	84.2	8.12					
2/6/2023				928	958	557	
2/7/2023			476				163

Prediction Limit

Constituent: Total Dissolved Solids (mg/L) Analysis Run 8/13/2023 4:05 PM View: Interwell PLs

CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-4	CGYP-6
1/26/2015	142.5						
2/16/2015	106.2						
6/16/2015	158						
7/6/2015	151						
10/19/2015	206	150					
1/26/2016	165	120					
4/19/2016	130	120					
7/18/2016	124	132					
10/11/2016	200	151.7					
1/23/2017	138	148					
4/17/2017	56	62					
7/12/2017	108						
7/25/2017		92					
9/25/2017	<40	<40					
10/9/2017	80	115					
2/7/2018	112	92					
6/20/2018	200	138.8					
10/1/2018	130	107.5					
2/12/2019	136.2	135					
5/20/2019	162.5	181.2					
2/24/2020	120	107.5					
5/21/2020			1609	3449	1505		
6/4/2020			1589	3895	1839		
6/18/2020			1624	4502	1964		
6/22/2020	112.5	147.5					
7/1/2020				4120	2650		
7/2/2020			1634				
7/16/2020			1512	3700	1811		
7/30/2020			1515	3138	1541		
8/13/2020			1599	3102	1768		
8/27/2020			1526	3519	1772		
9/21/2020			1515	3288	1945		
1/26/2021	110	138.8					
2/10/2021			1538	4090	2081		
4/7/2021			1536	4958	2301	2178	3952
5/13/2021						2078	2804
6/21/2021	155	178.8					
7/7/2021			1618	3291	1770		
7/8/2021						2168	2851
8/31/2021							2740
9/1/2021						2038	
9/27/2021						1749	2382
10/26/2021						1614	2306
11/17/2021						1676	1899
1/24/2022	128.8	130					
1/31/2022			1582	3410	1912	1864	2379
6/20/2022	137.5	143.8					
6/21/2022			1408	2952	1771	1676	3210
10/25/2022	96.25	110	1454	2835		1585	2902
10/26/2022					1894		
1/24/2023	111.2	142.5					
2/6/2023			1474	3838		1689	

Prediction Limit

Constituent: Total Dissolved Solids (mg/L) Analysis Run 8/13/2023 4:05 PM View: Interwell PLs
CGYP Client: Santee Cooper Data: CGYP

	PM-1 (bg)	CBW-1 (bg)	CGYP-2	CGYP-3	CGYP-1	CGYP-4	CGYP-6
2/7/2023					1764		2959

FIGURE E.

Appendix III Trend Tests - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:08 PM


Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CBW-1 (bg)	-0.001039	-102	-92	Yes	22	9.091	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-2	-0.5189	-62	-58	Yes	16	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-4	-1.614	-36	-34	Yes	11	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-33.53	-69	-58	Yes	16	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-71.61	-41	-34	Yes	11	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-1.127	-111	-98	Yes	23	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.09186	100	98	Yes	23	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-215	-53	-34	Yes	11	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02019	-149	-87	Yes	21	4.762	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.177	-126	-98	Yes	23	0	n/a	n/a	0.01	NP

Appendix III Trend Tests - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:08 PM


Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron (mg/L)	CBW-1 (bg)	-0.001039	-102	-92	Yes	22	9.091	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-1	0.6063	21	58	No	16	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-2	-0.5189	-62	-58	Yes	16	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-3	-0.1803	-12	-58	No	16	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-4	-1.614	-36	-34	Yes	11	0	n/a	n/a	0.01	NP
Boron (mg/L)	CGYP-6	-0.7466	-17	-34	No	11	0	n/a	n/a	0.01	NP
Boron (mg/L)	PM-1 (bg)	-1.3e-10	-39	-87	No	21	42.86	n/a	n/a	0.01	NP
Calcium (mg/L)	CBW-1 (bg)	0.3946	56	92	No	22	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-1	-9.278	-15	-58	No	16	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-2	-33.53	-69	-58	Yes	16	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-3	-55.29	-31	-58	No	16	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-4	-71.61	-41	-34	Yes	11	0	n/a	n/a	0.01	NP
Calcium (mg/L)	CGYP-6	-45.17	-17	-34	No	11	0	n/a	n/a	0.01	NP
Calcium (mg/L)	PM-1 (bg)	-1.127	-111	-98	Yes	23	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CBW-1 (bg)	0.09186	100	98	Yes	23	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-2	-36.44	-54	-58	No	16	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-3	-72.86	-18	-58	No	16	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-4	-215	-53	-34	Yes	11	0	n/a	n/a	0.01	NP
Chloride (mg/L)	CGYP-6	-77.26	-18	-34	No	11	0	n/a	n/a	0.01	NP
Chloride (mg/L)	PM-1 (bg)	-0.01849	-24	-98	No	23	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CBW-1 (bg)	-0.02019	-149	-87	Yes	21	4.762	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-1	0.114	19	58	No	16	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-2	0.09713	10	58	No	16	12.5	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-3	0.1407	16	58	No	16	6.25	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-4	-0.9914	-33	-34	No	11	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	CGYP-6	-0.226	-21	-34	No	11	0	n/a	n/a	0.01	NP
Fluoride (mg/L)	PM-1 (bg)	0	0	87	No	21	100	n/a	n/a	0.01	NP
pH, Field (pH units)	CBW-1 (bg)	0	-4	-98	No	23	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-2	0.07164	25	58	No	16	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-3	-0.05844	-17	-58	No	16	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-4	0.03484	14	34	No	11	0	n/a	n/a	0.01	NP
pH, Field (pH units)	CGYP-6	0.05748	6	34	No	11	0	n/a	n/a	0.01	NP
pH, Field (pH units)	PM-1 (bg)	-0.001811	-11	-124	No	27	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CBW-1 (bg)	0.3067	12	98	No	23	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-1	7.022	6	58	No	16	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-2	1.547	3	58	No	16	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-3	5.388	8	58	No	16	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-4	-23.7	-15	-34	No	11	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	CGYP-6	20.4	20	34	No	11	0	n/a	n/a	0.01	NP
Sulfate (mg/L)	PM-1 (bg)	-1.177	-126	-98	Yes	23	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CBW-1 (bg)	1.898	27	98	No	23	4.348	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-1	0.2477	0	58	No	16	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-2	-49.51	-43	-58	No	16	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-3	-245	-30	-58	No	16	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-4	-363.2	-34	-34	No	11	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	CGYP-6	-396.6	-5	-34	No	11	0	n/a	n/a	0.01	NP
Total Dissolved Solids (mg/L)	PM-1 (bg)	-3.395	-63	-124	No	27	3.704	n/a	n/a	0.01	NP

Sen's Slope Estimator

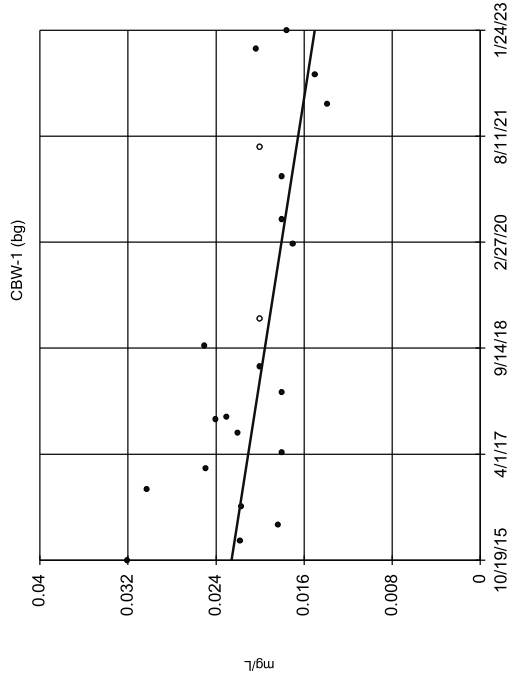


Constituent: Boron Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

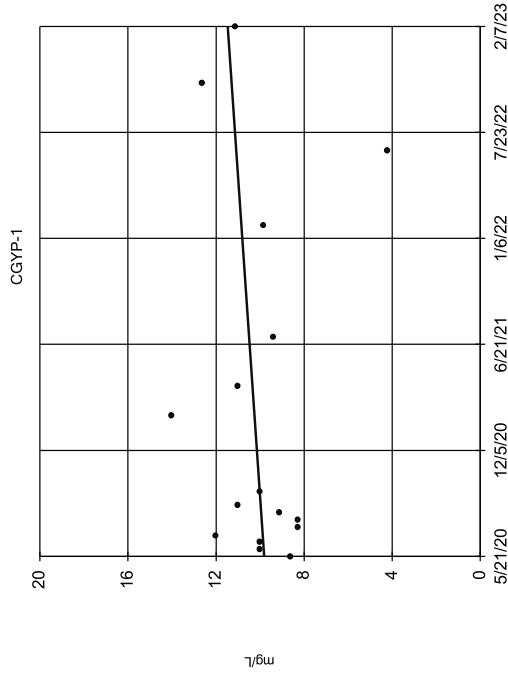


Constituent: Boron Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

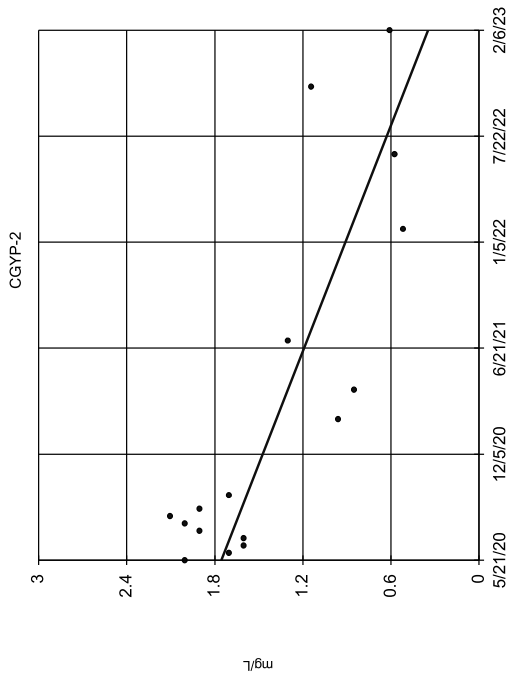


Constituent: Boron Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

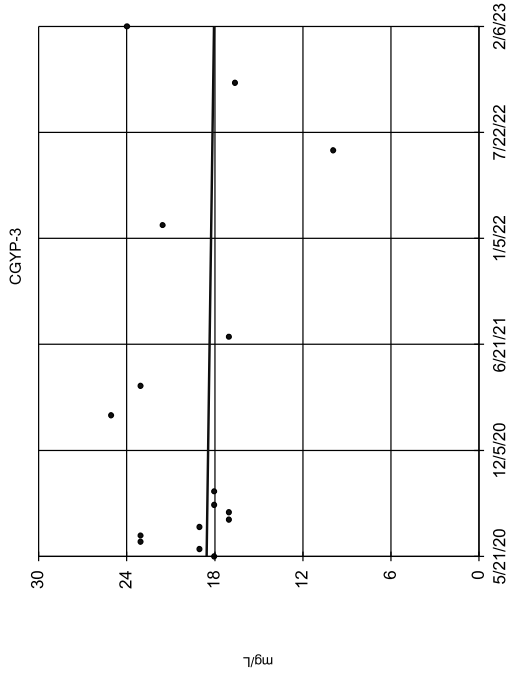

Constituent: Boron Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

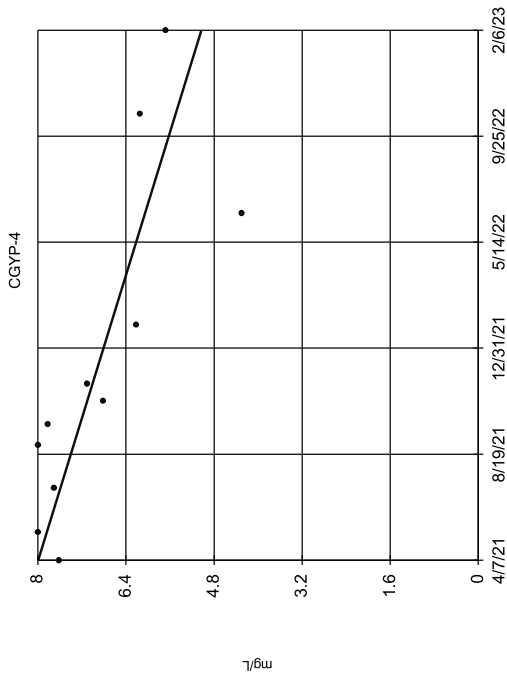

n = 11
 Slope = -1.614
 units per year.
 Mann-Kendall
 statistic = -36
 critical = -34
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Boron Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

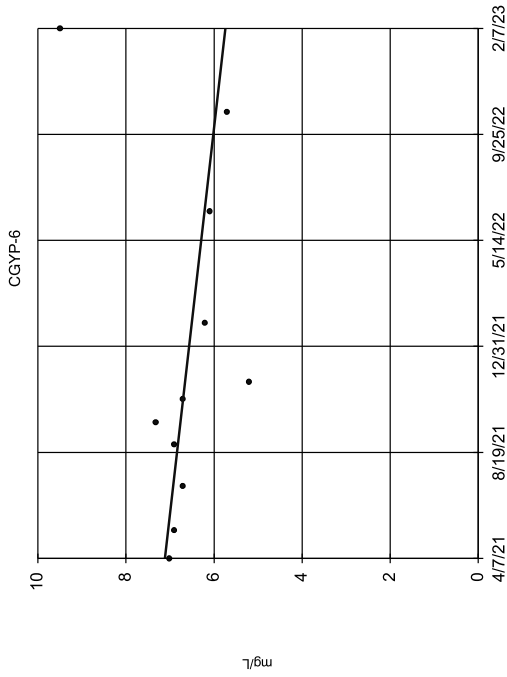

n = 11
 Slope = 0.7466
 units per year.
 Mann-Kendall
 statistic = -17
 critical = -34
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Boron Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

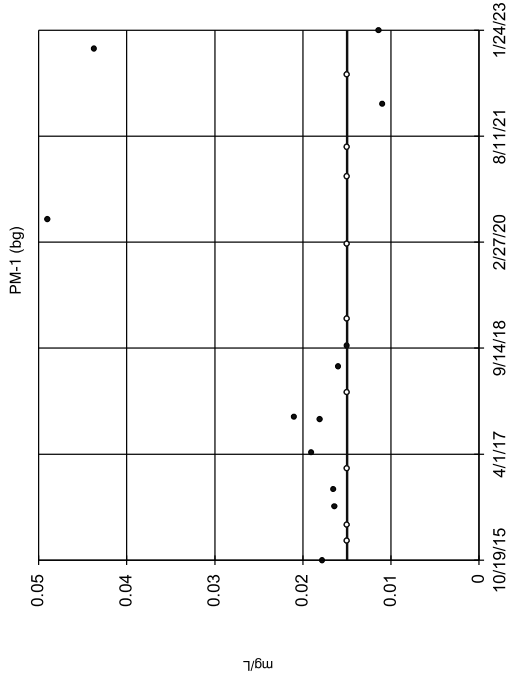

n = 21
 Slope = -1.3e-10
 units per year.
 Mann-Kendall
 statistic = -39
 critical = -87
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Boron Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

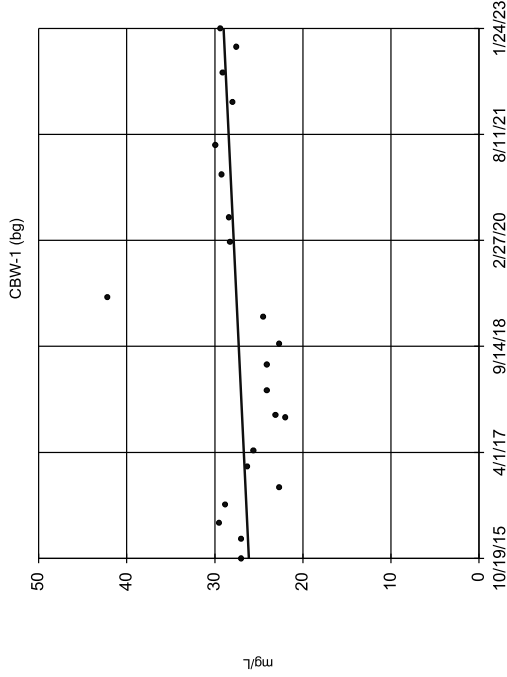


n = 22
 Slope = 0.3946
 units per year.
 Mann-Kendall
 statistic = 56
 critical = 92
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-1

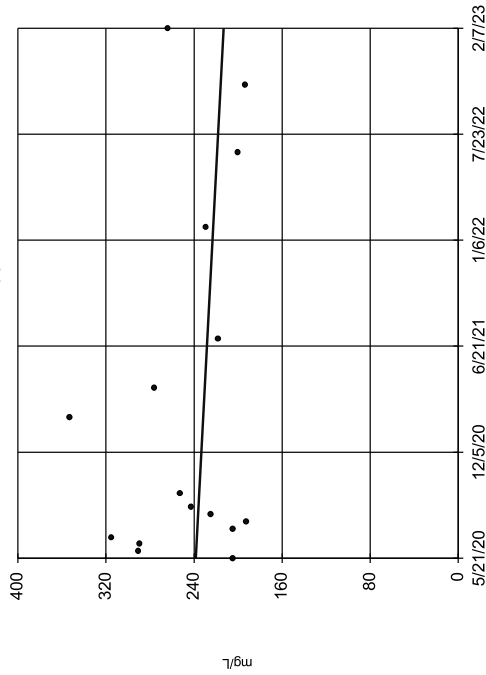


n = 16
 Slope = -9.278
 units per year.
 Mann-Kendall
 statistic = -15
 critical = -58
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-2

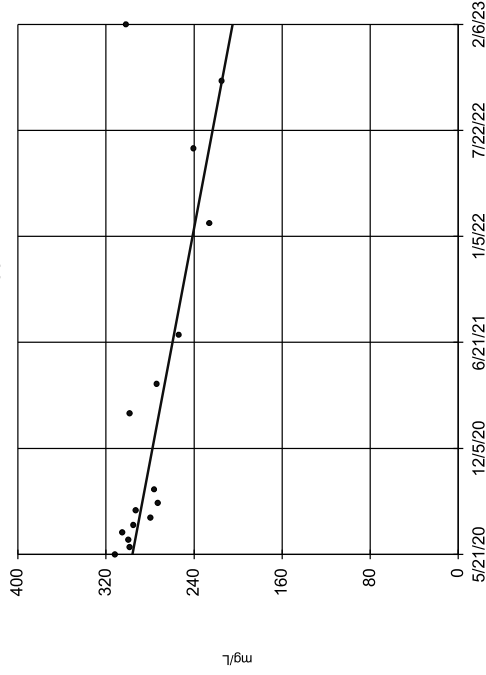


n = 16
 Slope = -32.53
 units per year.
 Mann-Kendall
 statistic = -69
 critical = -58
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

CGYP-3

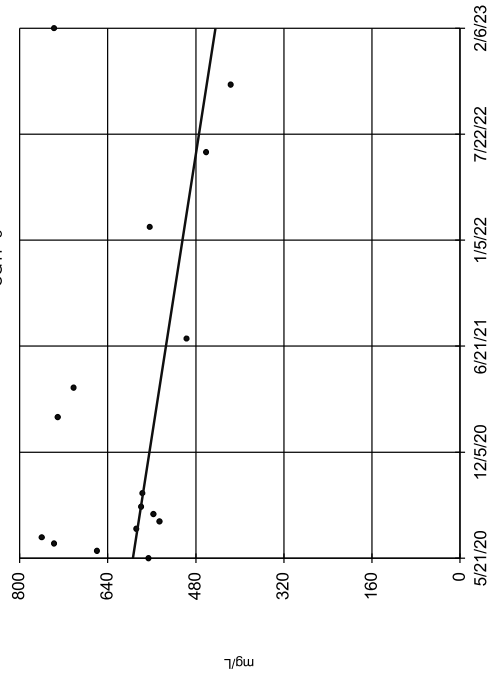


n = 16
 Slope = -55.29
 units per year.
 Mann-Kendall
 statistic = -31
 critical = -58
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-4

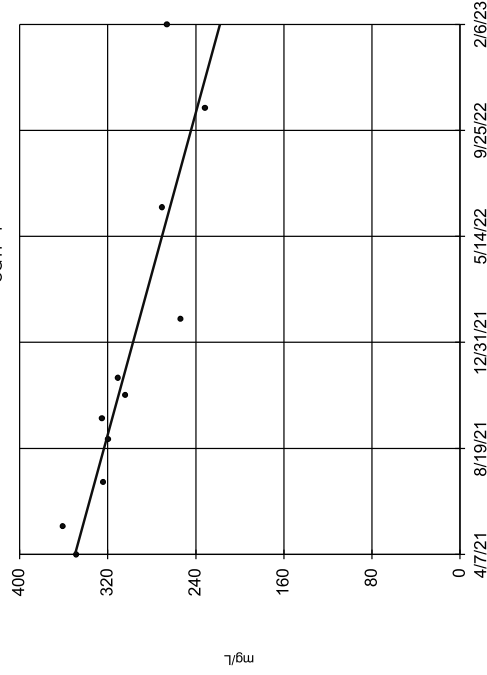

n = 11
 Slope = -71.61
 units per year.
 Mann-Kendall
 statistic = -41
 critical = -34
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

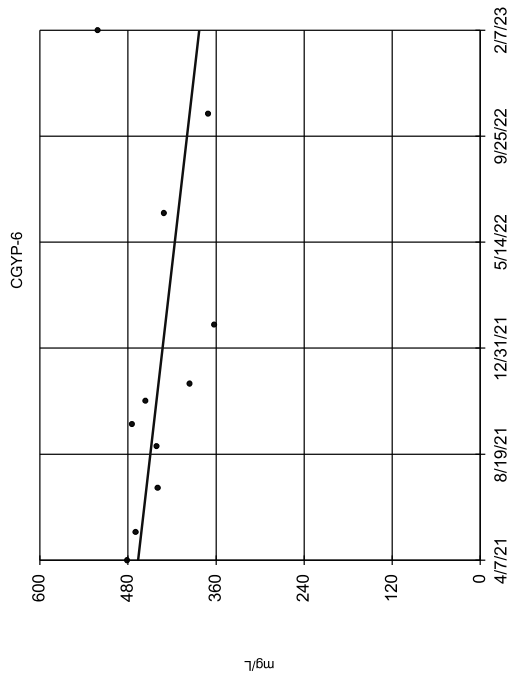

n = 11
 Slope = 45.17
 units per year.
 Mann-Kendall
 statistic = -17
 critical = -34
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

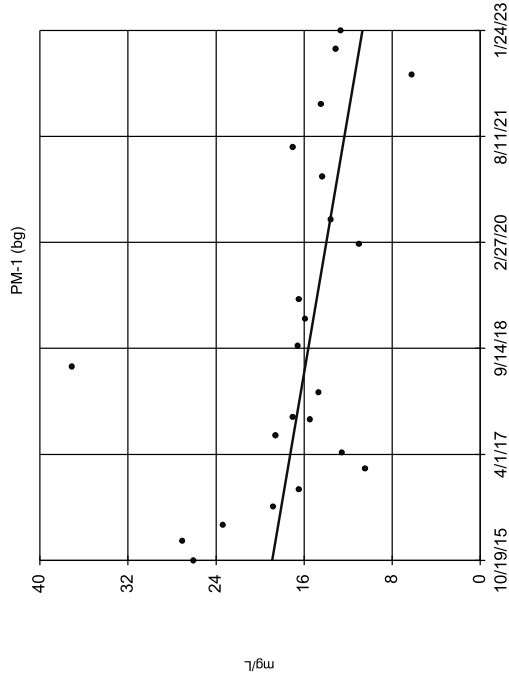

n = 23
 Slope = -1.127
 units per year.
 Mann-Kendall
 statistic = -111
 critical = -98
 Decreasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Calcium Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

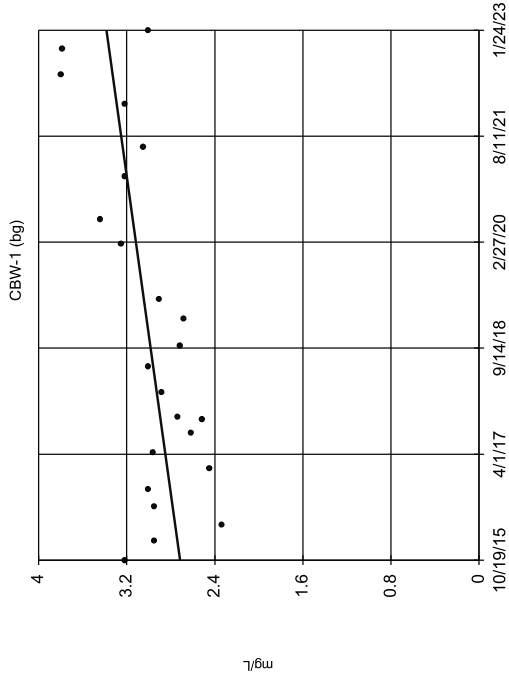

n = 23
 Slope = 0.09186
 units per year.
 Mann-Kendall
 statistic = 100
 critical = 98
 Increasing trend
 significant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Chloride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

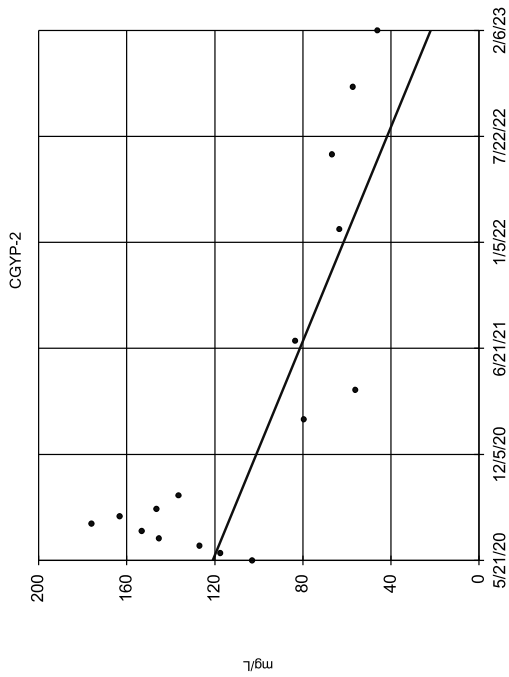


n = 16
 Slope = -36.44
 units per year.
 Mann-Kendall
 statistic = -54
 critical = -58
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Chloride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-3

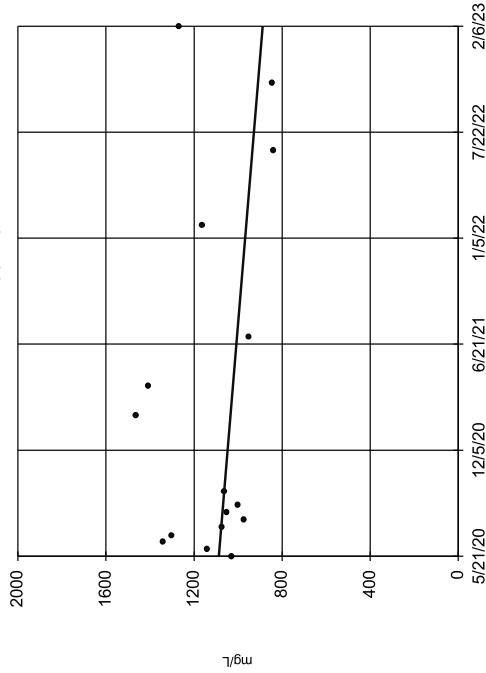

Constituent: Chloride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-4

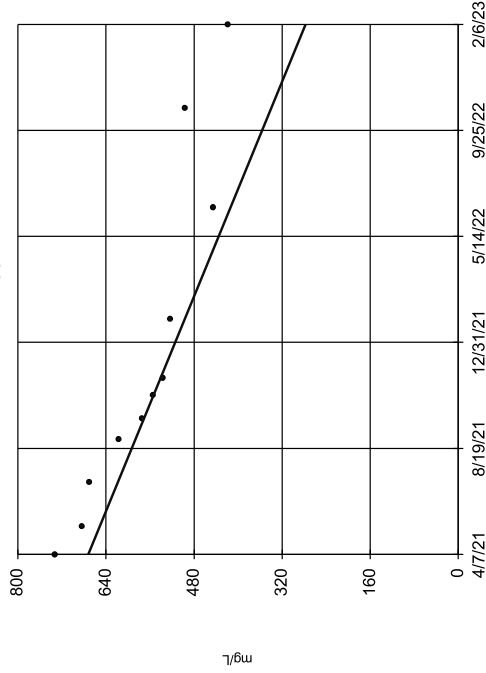

Constituent: Chloride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-6

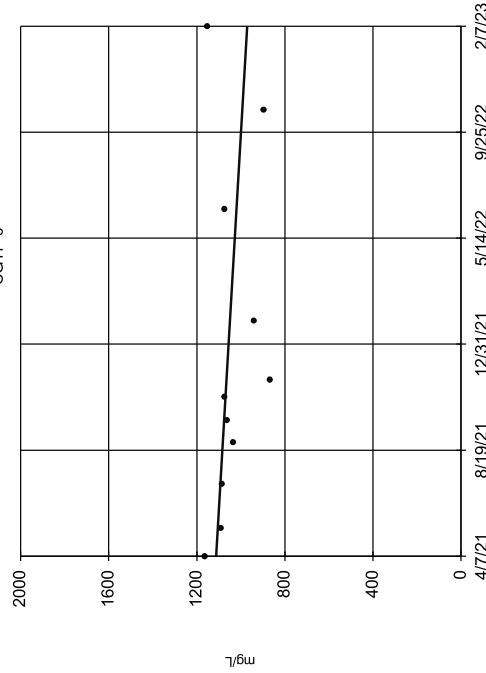

Constituent: Chloride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

PM-1 (bg)

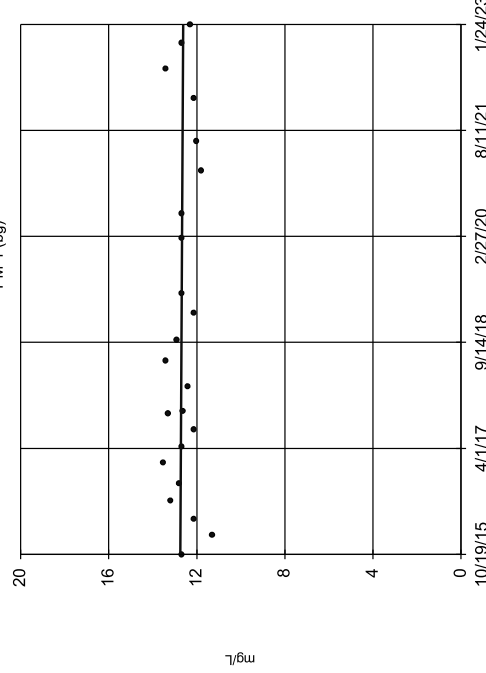

Constituent: Chloride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

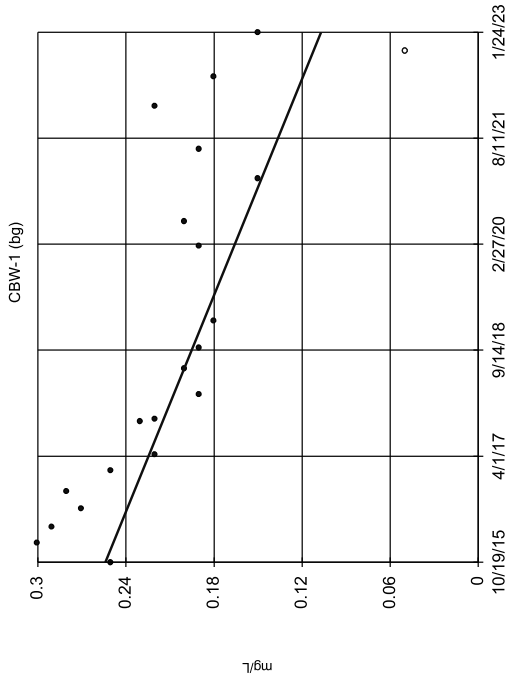

n = 21
Slope = -0.02019
units per year.
Mann-Kendall
statistic = -149
critical = -87
Decreasing trend
significant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Fluoride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

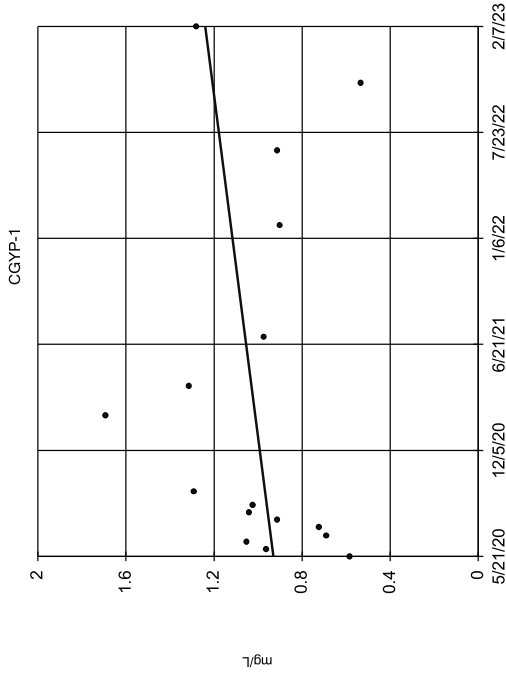

n = 16
Slope = 0.114
units per year.
Mann-Kendall
statistic = 19
critical = 58
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Fluoride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

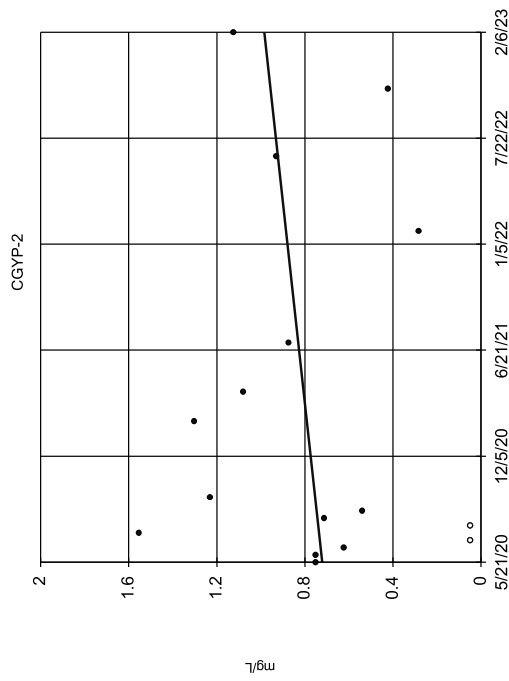

n = 16
Slope = 0.09713
units per year.
Mann-Kendall
statistic = 10
critical = 58
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Fluoride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

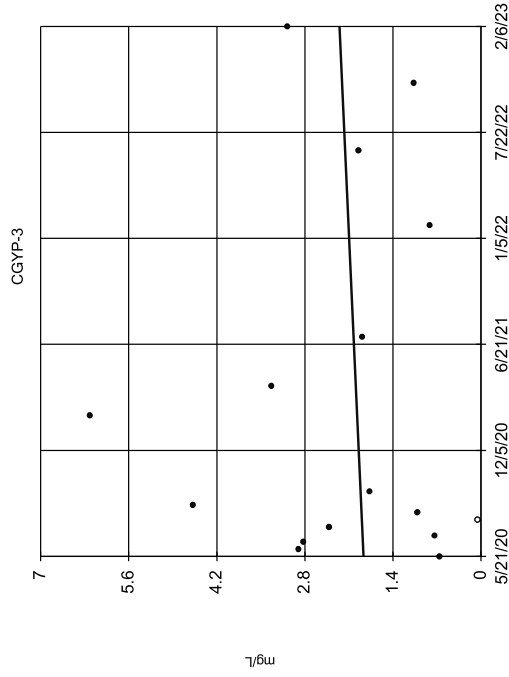


n = 16
Slope = 0.1407
units per year.
Mann-Kendall
statistic = 16
critical = 58
Trend not sig-
nificant at 99%
confidence level
($\alpha = 0.005$ per
tail).

Constituent: Fluoride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-4

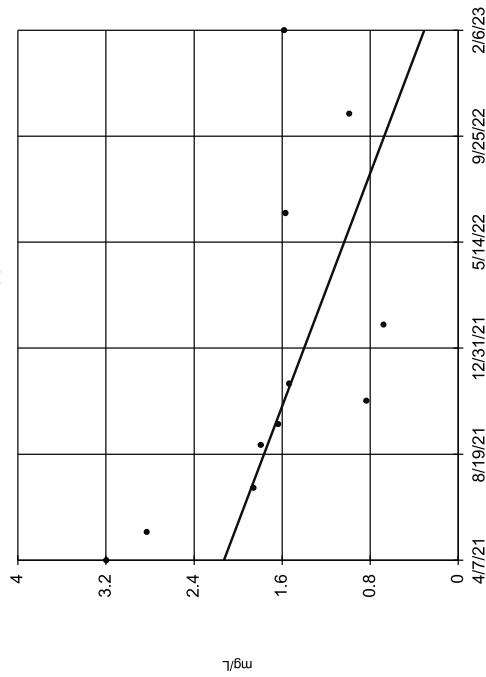

Constituent: Fluoride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


CGYP-6

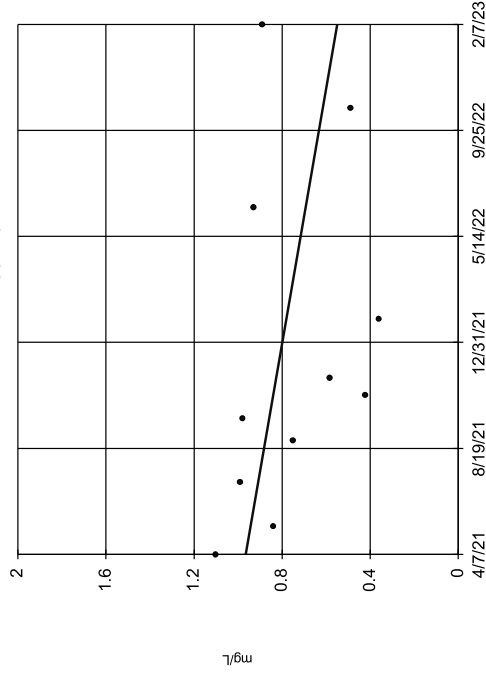

Constituent: Fluoride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator


PM-1 (bg)

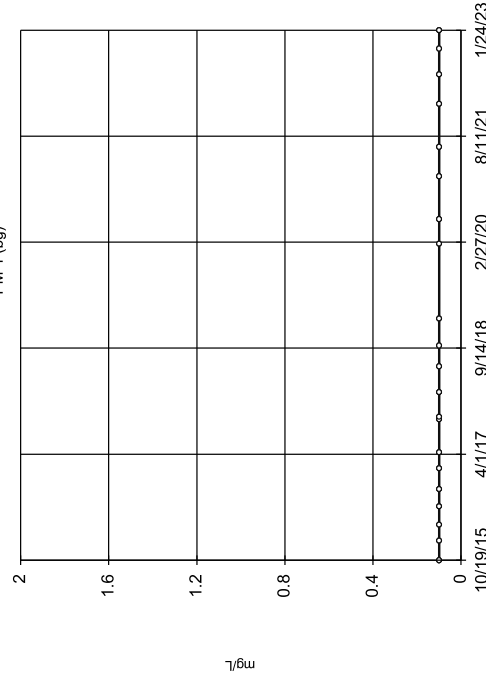

Constituent: Fluoride Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

CBW-1 (bg)

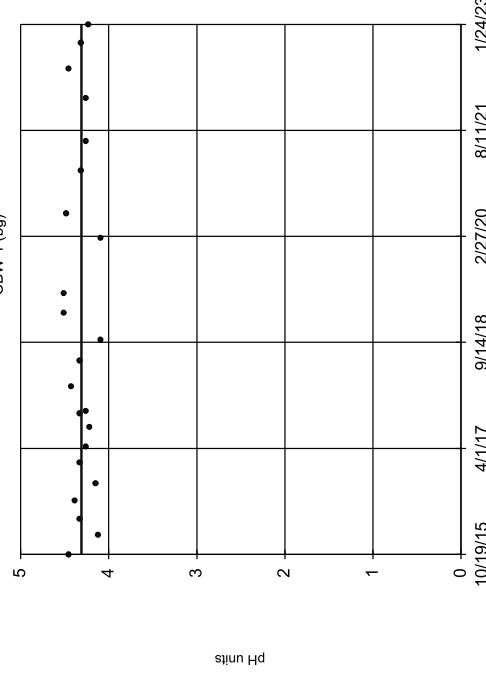


Constituent: pH, Field Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

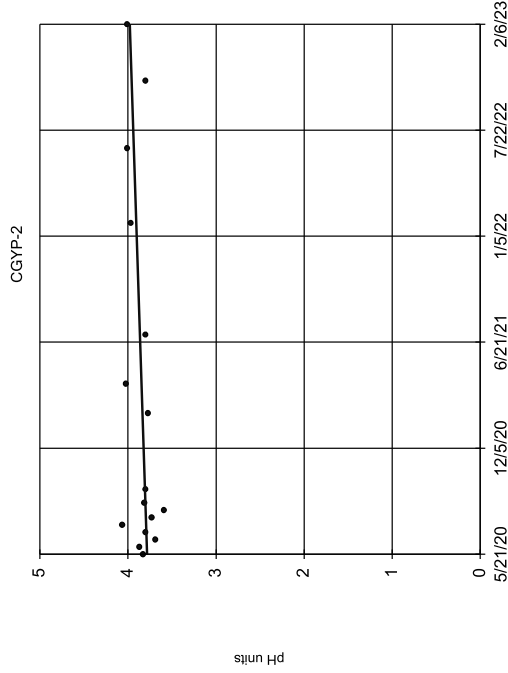


Constituent: pH, Field Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

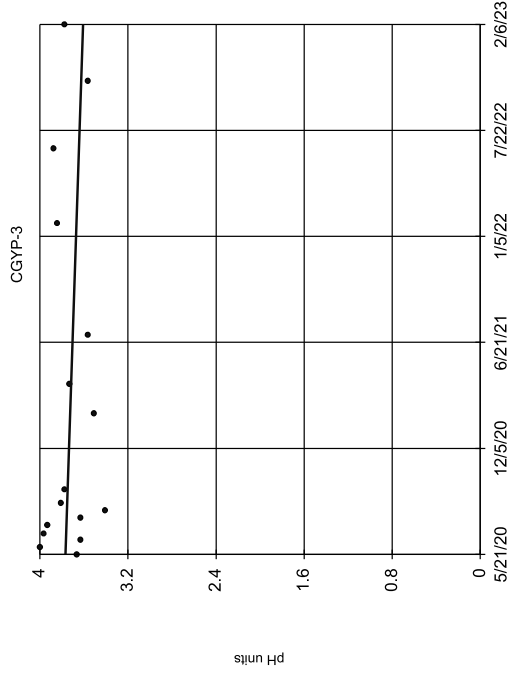


Constituent: pH, Field Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

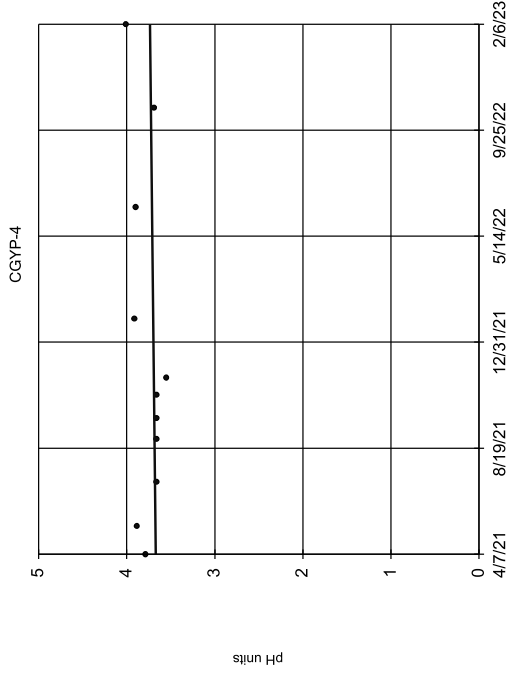


Constituent: pH, Field Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

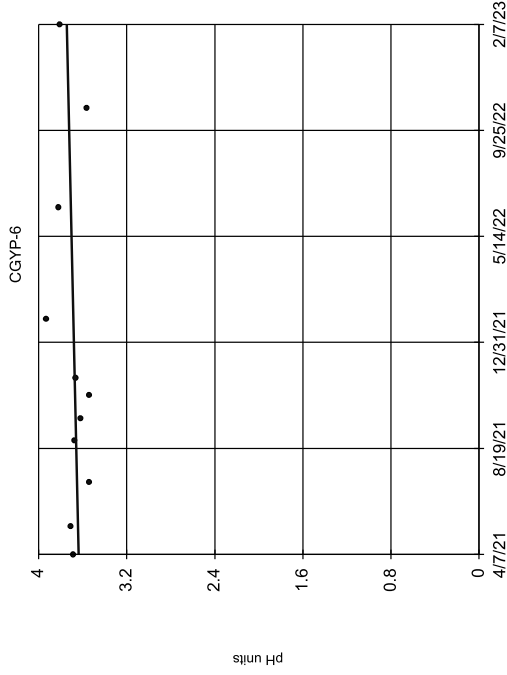

Constituent: pH, Field Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

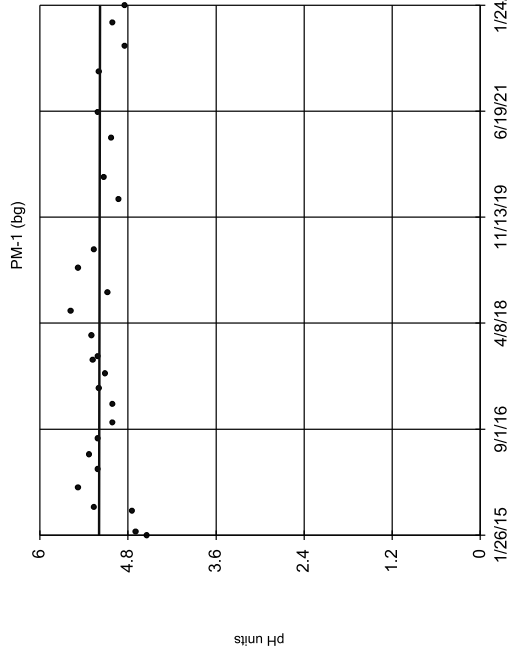

n = 27
 Slope = -0.001811
 units per year.
 Mann-Kendall
 statistic = -11
 critical = -124
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: pH, Field Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

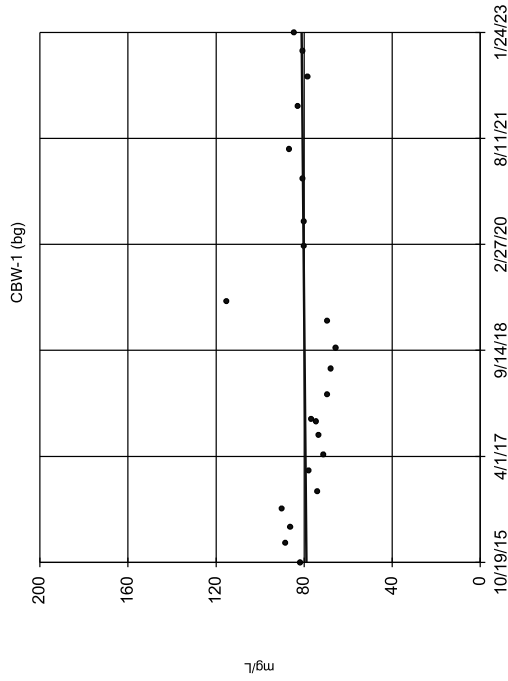

n = 23
 Slope = 0.2067
 units per year.
 Mann-Kendall
 statistic = 12
 critical = 98
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

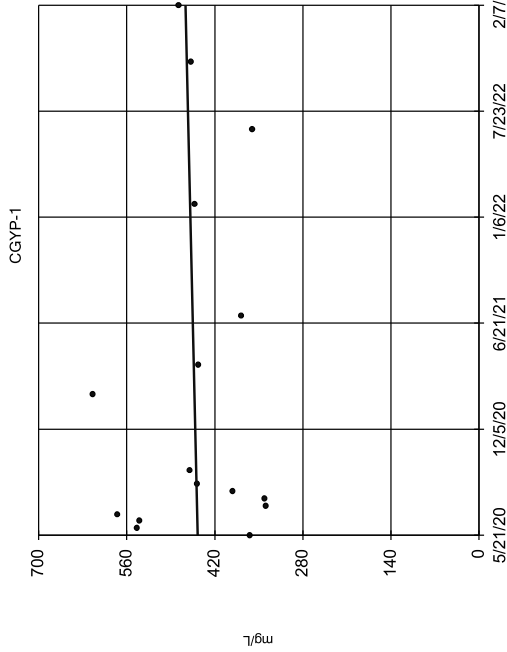

n = 16
 Slope = 7.022
 units per year.
 Mann-Kendall
 statistic = 6
 critical = 58
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).

Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP


Sen's Slope Estimator

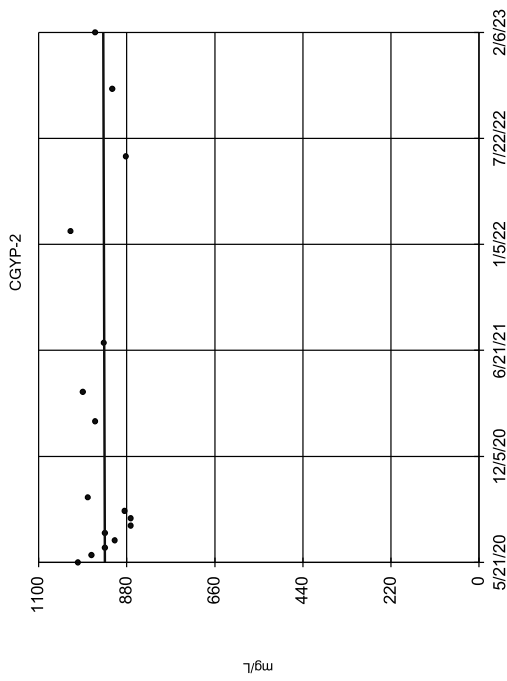

n = 16
 Slope = 1.547
 units per year.
 Mann-Kendall
 statistic = 3
 critical = 58
 Trend not sig-
 nificant at 99%
 confidence level
 (α = 0.005 per
 tail).


Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

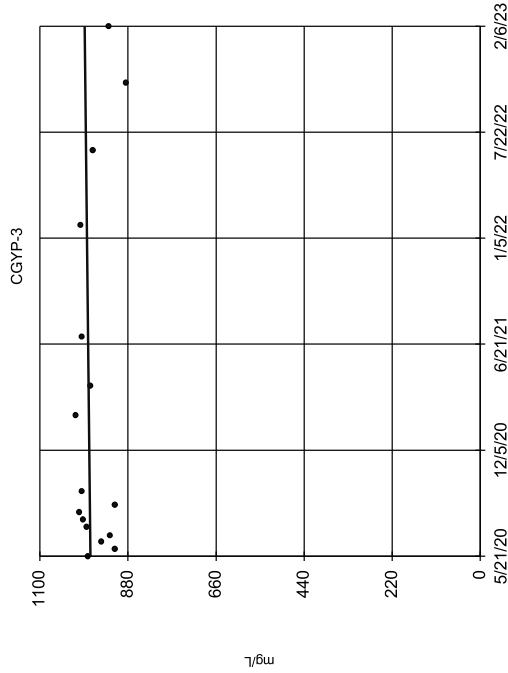


Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

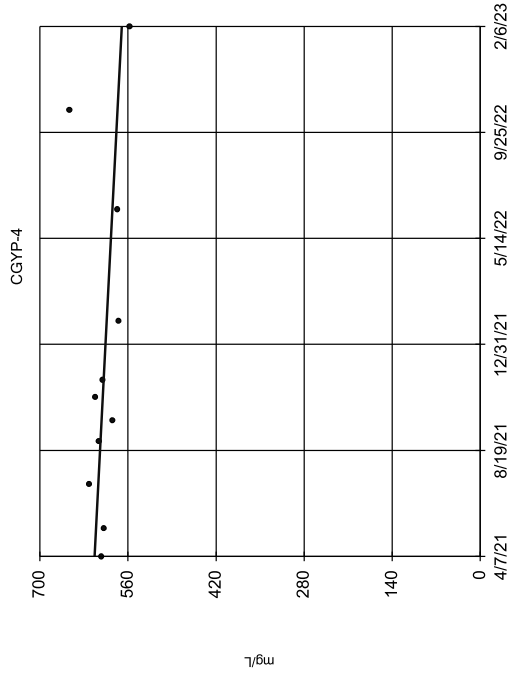


Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

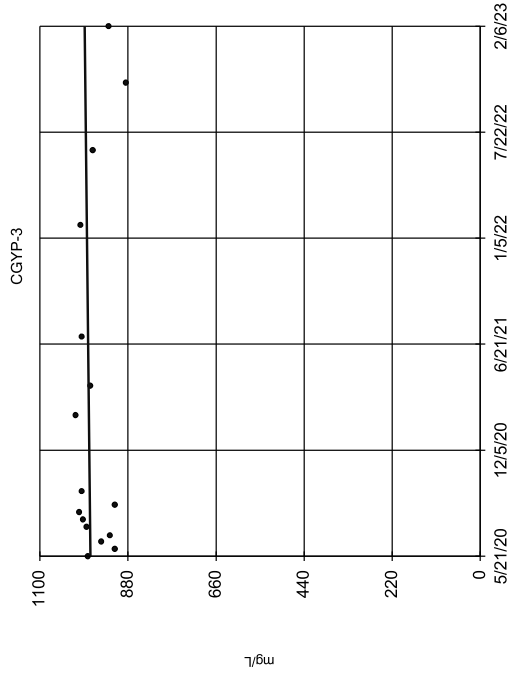

Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

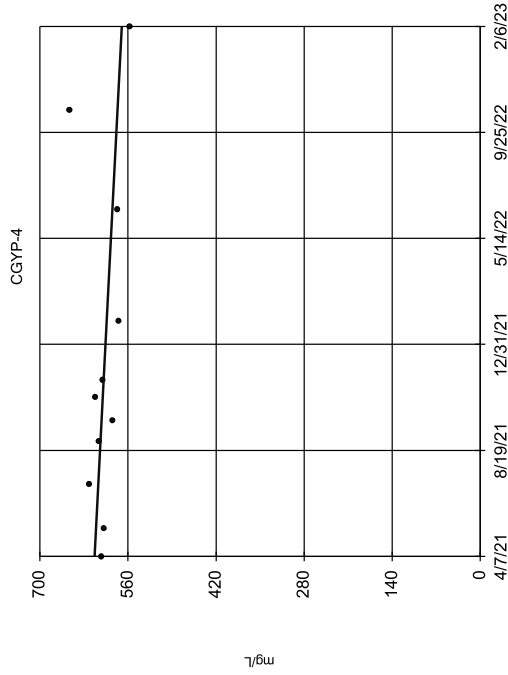


Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP


Constituent: Sulfate Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

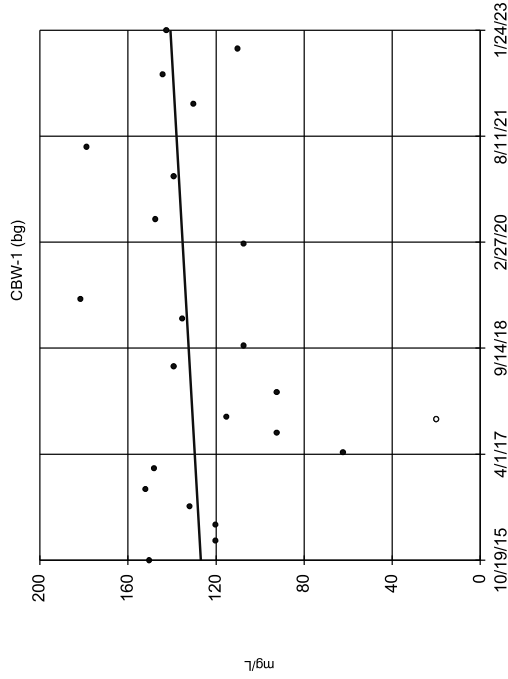


Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

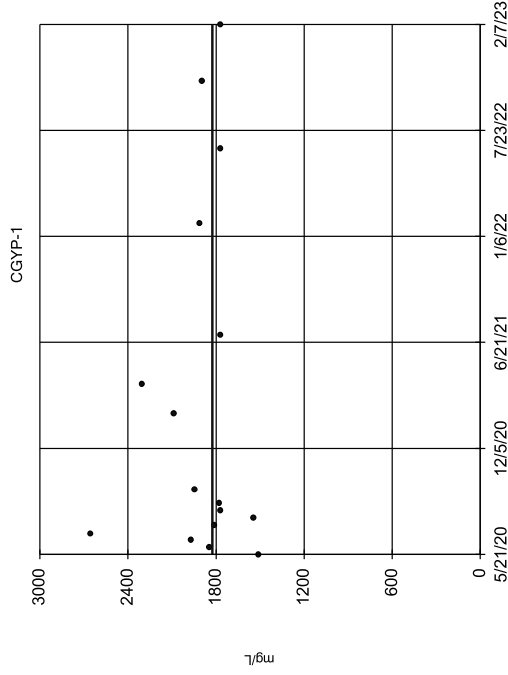


Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

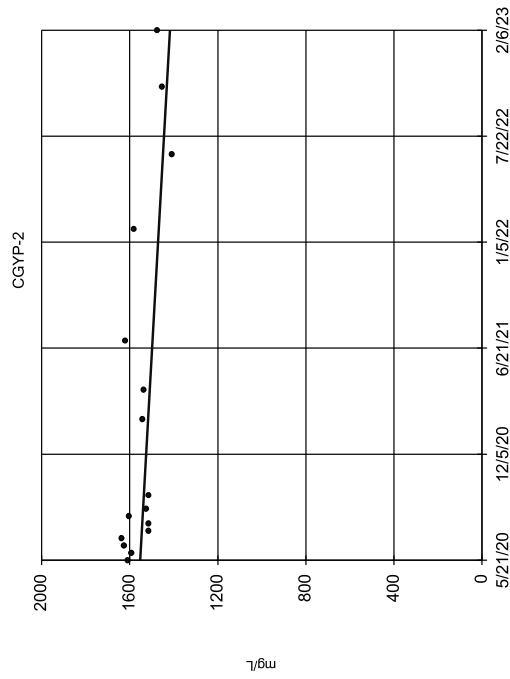


Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

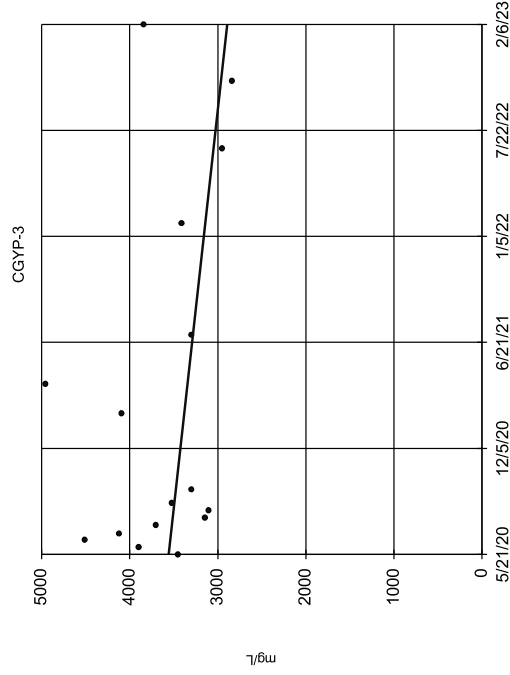


Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:07 PM View: Trend Tests
 CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

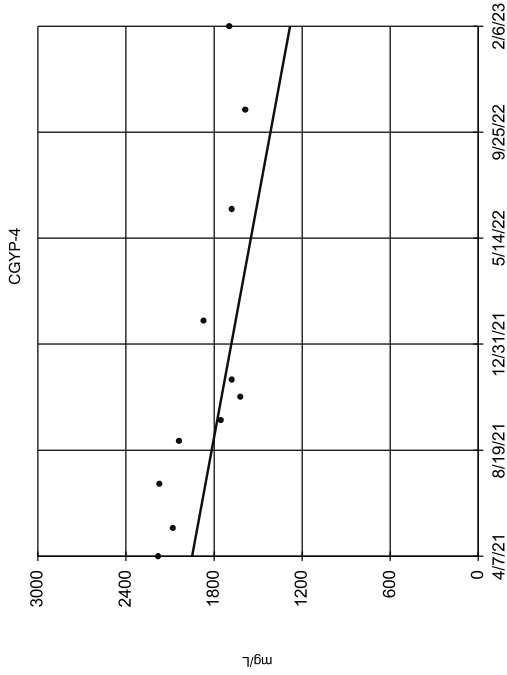


Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

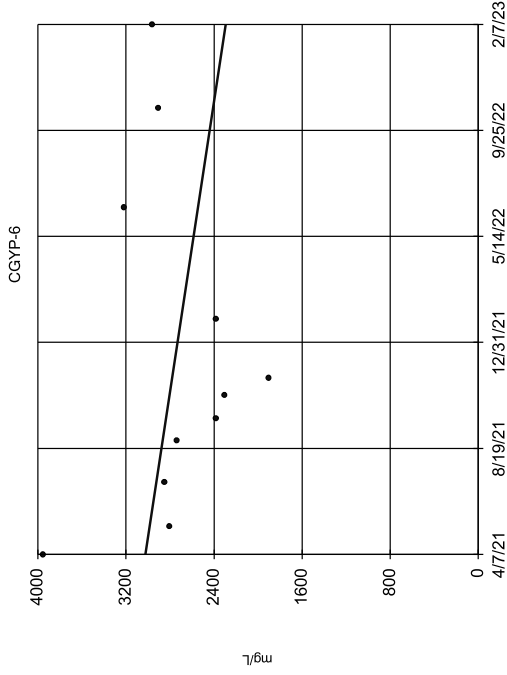

Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

Sen's Slope Estimator

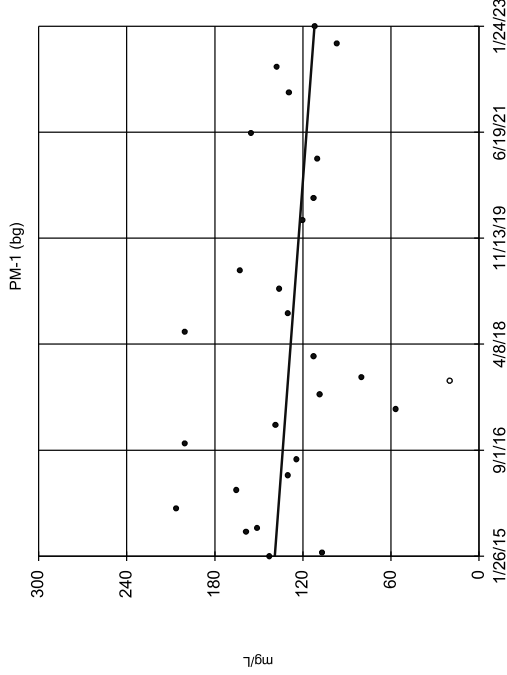

Constituent: Total Dissolved Solids Analysis Run 8/13/2023 4:07 PM View: Trend Tests
CGYP Client: Santee Cooper Data: CGYP

FIGURE F.

CYGP GWPS				
Constituent Name	MCL	CCR-Rule Specified	Background Limit	GWPS
Antimony, Total (mg/L)	0.006		0.025	0.025
Arsenic, Total (mg/L)	0.01		0.016	0.016
Barium, Total (mg/L)	2		0.103	2
Beryllium, Total (mg/L)	0.004		0.00063	0.004
Cadmium, Total (mg/L)	0.005		0.0005	0.005
Chromium, Total (mg/L)	0.1		0.014	0.1
Cobalt, Total (mg/L)		0.006	0.0034	0.006
Combined Radium 226 + 228 (pCi/L)	5		16.3	16.3
Fluoride, Total (mg/L)	4		0.3	4
Lead, Total (mg/L)		0.015	0.011	0.015
Lithium, Total (mg/L)		0.04	0.01	0.04
Mercury, Total (mg/L)	0.002		0.0006	0.002
Molybdenum, Total (mg/L)		0.1	0.01	0.1
Selenium, Total (mg/L)	0.05		0.02	0.05
Thallium, Total (mg/L)	0.002		0.001	0.002

*GWPS = Groundwater Protection Standard

*MCL = Maximum Contaminant Limit

*CCR = Coal Combustion Residuals

Shaded cells indicate background limit is higher than established MCL.

FIGURE G.

Appendix IV Confidence Intervals - Significant Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:20 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Lower Compl.	Sig.	N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Beryllium (mg/L)	CGYP-1	0.01071	0.007078	0.004	n/a	Yes	15	0.00864	0.002887	0	None	x^2	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03944	0.02634	0.004	n/a	Yes	15	0.03289	0.009665	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01743	0.01475	0.004	n/a	Yes	11	0.01609	0.001609	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02656	0.02002	0.004	n/a	Yes	11	0.02329	0.003927	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.05106	0.03413	0.006	n/a	Yes	15	0.04259	0.01249	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.028	0.0183	0.006	n/a	Yes	15	0.02358	0.009257	0	None	No	0.01	NP (normality)
Cobalt (mg/L)	CGYP-3	0.1359	0.09132	0.006	n/a	Yes	15	0.1136	0.03287	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.05052	0.0365	0.006	n/a	Yes	11	0.04295	0.01032	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1683	0.1293	0.006	n/a	Yes	11	0.1488	0.02342	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-2	0.02481	0.01932	0.015	n/a	Yes	15	0.02162	0.00537	6.667	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.03001	0.02111	0.015	n/a	Yes	14	0.02556	0.006282	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-3	0.09485	0.05462	0.04	n/a	Yes	15	0.07473	0.02968	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06703	0.05171	0.04	n/a	Yes	11	0.05937	0.009195	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1554	0.1108	0.04	n/a	Yes	11	0.1331	0.02673	0	None	No	0.01	Param.


Appendix IV Confidence Intervals - All Results

CGYP Client: Santee Cooper Data: CGYP Printed 8/13/2023, 4:20 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Lower Compl.	Sig.	N	Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Arsenic (mg/L)	CGYP-1	0.03198	0.01362	0.016	n/a	No	15	0.0228	0.01354	6.667	None	No	0.01	Param.
Arsenic (mg/L)	CGYP-2	0.02185	0.01394	0.016	n/a	No	15	0.01685	0.007449	13.33	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-3	0.019	0.01318	0.016	n/a	No	15	0.01558	0.005113	6.667	None	x^2	0.01	Param.
Arsenic (mg/L)	CGYP-4	0.01128	0.007479	0.016	n/a	No	11	0.008975	0.003005	9.091	None	x^3	0.01	Param.
Barium (mg/L)	CGYP-1	0.05607	0.03684	2	n/a	No	15	0.04697	0.01504	0	None	sqrt(x)	0.01	Param.
Barium (mg/L)	CGYP-2	0.03386	0.01747	2	n/a	No	15	0.02567	0.0121	6.667	None	No	0.01	Param.
Barium (mg/L)	CGYP-3	0.05043	0.03447	2	n/a	No	15	0.04245	0.01178	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-4	0.03934	0.02721	2	n/a	No	11	0.03327	0.007276	0	None	No	0.01	Param.
Barium (mg/L)	CGYP-6	0.6445	0.2978	2	n/a	No	11	0.4712	0.208	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-1	0.01071	0.007078	0.004	n/a	Yes	15	0.00864	0.002887	0	None	x^2	0.01	Param.
Beryllium (mg/L)	CGYP-2	0.004109	0.003136	0.004	n/a	No	15	0.003623	0.0007177	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-3	0.03944	0.02634	0.004	n/a	Yes	15	0.03289	0.009665	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-4	0.01743	0.01475	0.004	n/a	Yes	11	0.01609	0.001609	0	None	No	0.01	Param.
Beryllium (mg/L)	CGYP-6	0.02656	0.02002	0.004	n/a	Yes	11	0.02329	0.003927	0	None	No	0.01	Param.
Cadmium (mg/L)	CGYP-1	0.004	0.0022	0.005	n/a	No	15	0.0037	0.0008098	86.67	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-2	0.004	0.0014	0.005	n/a	No	15	0.003627	0.0009881	86.67	None	No	0.01	NP (NDs)
Cadmium (mg/L)	CGYP-3	0.004	0.00062	0.005	n/a	No	15	0.001943	0.001546	33.33	None	No	0.01	NP (normality)
Cadmium (mg/L)	CGYP-4	0.0005	0.0005	0.005	n/a	No	11	0.0005273	0.00009045	90.91	None	No	0.006	NP (NDs)
Cadmium (mg/L)	CGYP-6	0.0005	0.0005	0.005	n/a	No	11	0.0005091	0.00003015	90.91	None	No	0.006	NP (NDs)
Chromium (mg/L)	CGYP-3	0.006876	0.005426	0.1	n/a	No	15	0.006107	0.001174	20	Kaplan-Meier	x^(1/3)	0.01	Param.
Cobalt (mg/L)	CGYP-1	0.05106	0.03413	0.006	n/a	Yes	15	0.04259	0.01249	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-2	0.028	0.0183	0.006	n/a	Yes	15	0.02358	0.009257	0	None	No	0.01	NP (normality)
Cobalt (mg/L)	CGYP-3	0.1359	0.09132	0.006	n/a	Yes	15	0.1136	0.03287	0	None	No	0.01	Param.
Cobalt (mg/L)	CGYP-4	0.05052	0.0365	0.006	n/a	Yes	11	0.04295	0.01032	0	None	x^2	0.01	Param.
Cobalt (mg/L)	CGYP-6	0.1683	0.1293	0.006	n/a	Yes	11	0.1488	0.02342	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-1	4.484	3.144	16.3	n/a	No	15	3.857	1.093	0	None	x^(1/3)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-2	3.191	1.924	16.3	n/a	No	15	2.599	1	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-3	6.361	4.638	16.3	n/a	No	15	5.499	1.271	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-4	5.635	3.425	16.3	n/a	No	11	4.53	1.326	0	None	No	0.01	Param.
Combined Radium 226 & 228 (pci/l)	CGYP-6	7.404	3.813	16.3	n/a	No	11	5.608	2.155	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-1	1.185	0.7963	4	n/a	No	16	0.9906	0.2987	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-2	1.048	0.4828	4	n/a	No	16	0.7656	0.4347	12.5	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-3	3.248	1.152	4	n/a	No	16	2.2	1.611	6.25	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-4	2.316	1.037	4	n/a	No	11	1.676	0.7674	0	None	No	0.01	Param.
Fluoride (mg/L)	CGYP-6	0.9697	0.5448	4	n/a	No	11	0.7573	0.255	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-1	0.01693	0.007209	0.015	n/a	No	15	0.0126	0.008231	6.667	None	sqrt(x)	0.01	Param.
Lead (mg/L)	CGYP-2	0.02481	0.01932	0.015	n/a	Yes	15	0.02162	0.00537	6.667	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-3	0.03001	0.02111	0.015	n/a	Yes	14	0.02556	0.006282	0	None	No	0.01	Param.
Lead (mg/L)	CGYP-4	0.01437	0.01021	0.015	n/a	No	11	0.01214	0.002952	9.091	None	x^2	0.01	Param.
Lead (mg/L)	CGYP-6	0.01423	0.007367	0.015	n/a	No	11	0.0108	0.00412	9.091	None	No	0.01	Param.
Lithium (mg/L)	CGYP-1	0.0247	0.01	0.04	n/a	No	15	0.01686	0.007065	26.67	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-2	0.015	0.005	0.04	n/a	No	15	0.01114	0.004636	33.33	None	No	0.01	NP (normality)
Lithium (mg/L)	CGYP-3	0.09485	0.05462	0.04	n/a	Yes	15	0.07473	0.02968	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-4	0.06703	0.05171	0.04	n/a	Yes	11	0.05937	0.009195	0	None	No	0.01	Param.
Lithium (mg/L)	CGYP-6	0.1554	0.1108	0.04	n/a	Yes	11	0.1331	0.02673	0	None	No	0.01	Param.
Mercury (mg/L)	CGYP-1	0.0002	0.0002	0.002	n/a	No	15	0.0002	1.3e-12	93.33	None	No	0.01	NP (NDs)
Mercury (mg/L)	CGYP-3	0.00021	0.0002	0.002	n/a	No	15	0.0002207	0.00006943	80	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-1	0.0177	0.0025	0.05	n/a	No	15	0.00876	0.008299	60	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-2	0.0113	0.0025	0.05	n/a	No	15	0.00584	0.006921	73.33	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-3	0.0067	0.0025	0.05	n/a	No	15	0.004647	0.005022	80	None	No	0.01	NP (NDs)
Selenium (mg/L)	CGYP-4	0.0025	0.0025	0.05	n/a	No	11	0.003051	0.001827	90.91	None	No	0.006	NP (NDs)

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

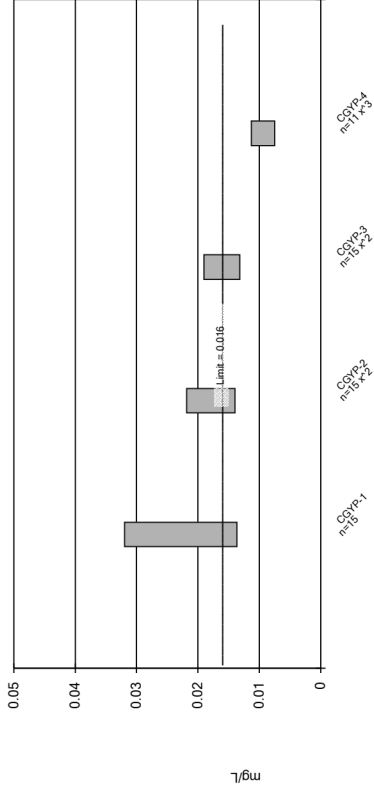

Constituent: Arsenic Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

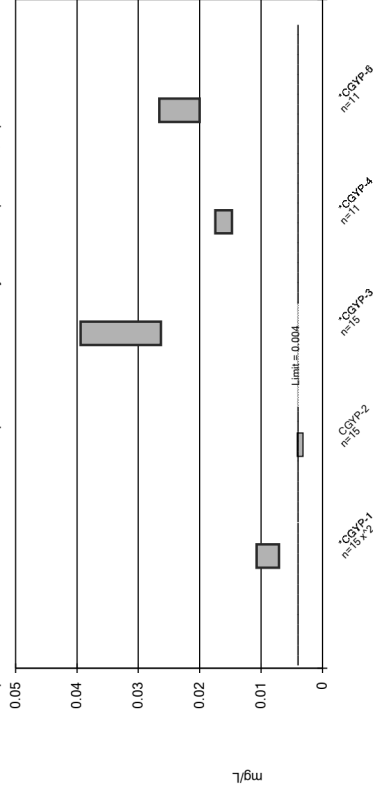

Constituent: Beryllium Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

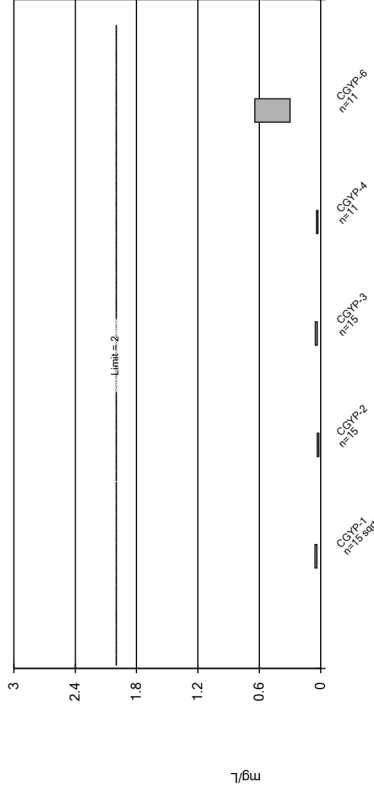

Constituent: Barium Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

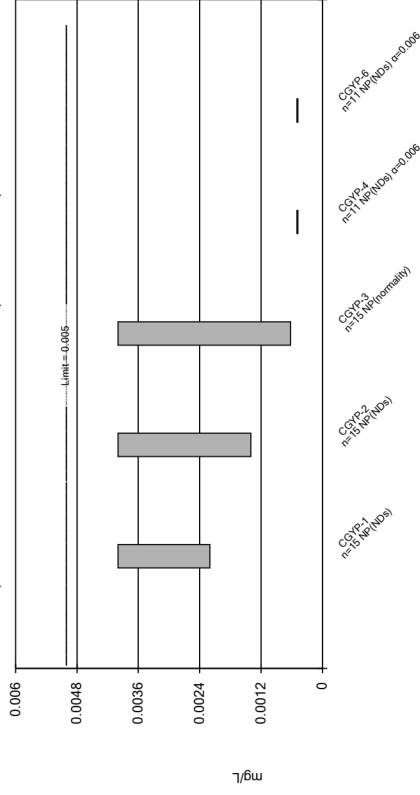

Constituent: Cadmium Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

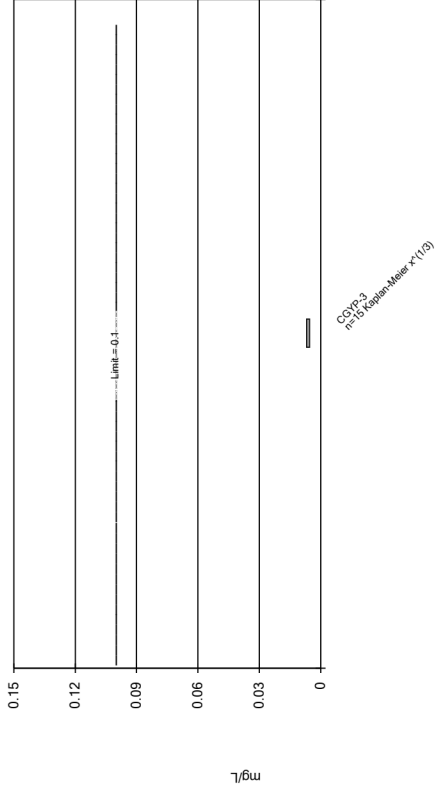

Constituent: Chromium Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

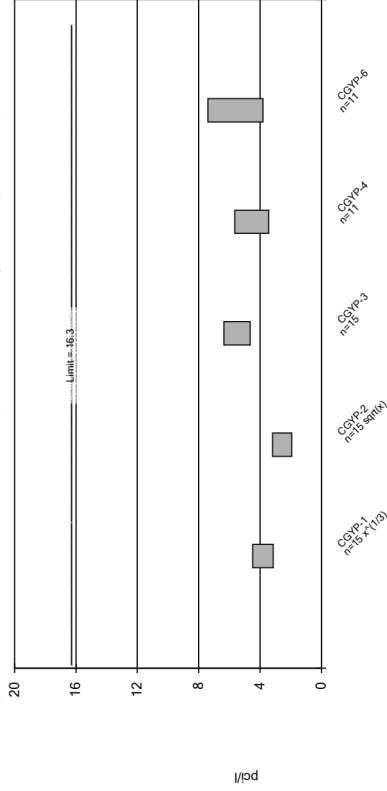

Constituent: Combined Radium 226 & 228 Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance limit is exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

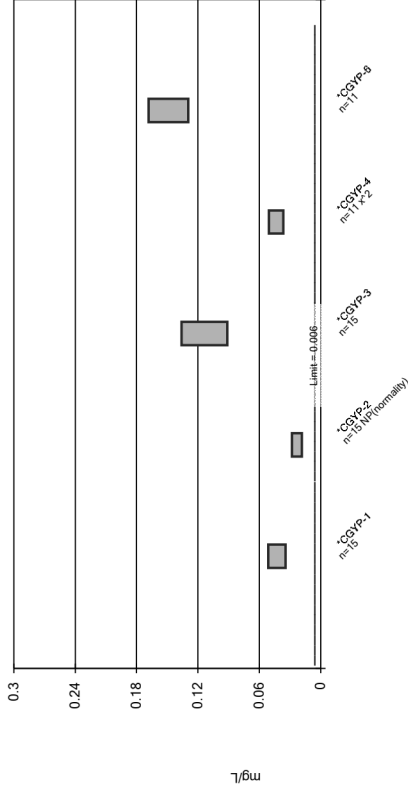

Constituent: Cobalt Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

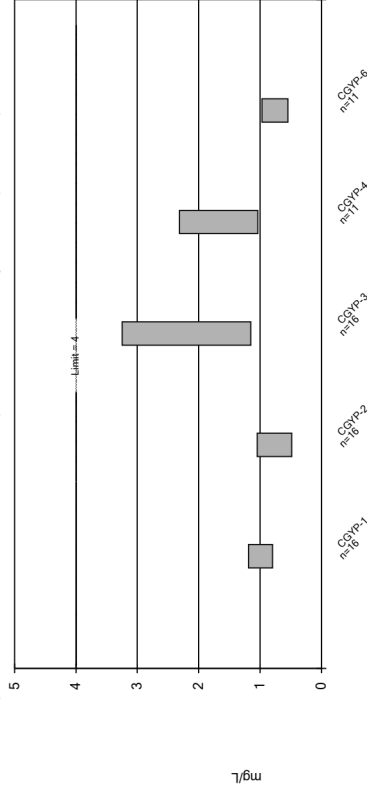

Constituent: Fluoride Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

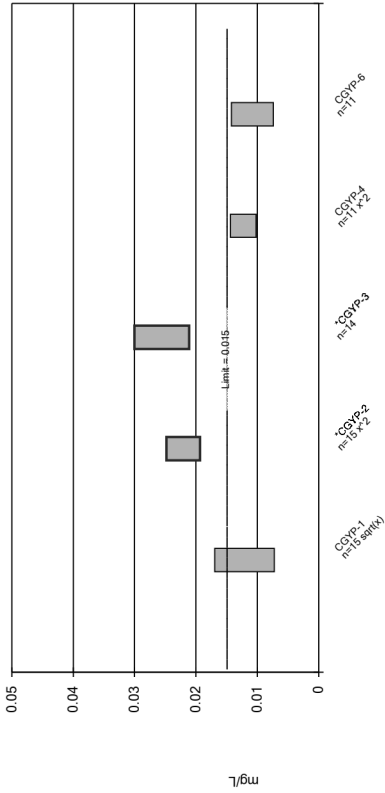

Constituent: Lead Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

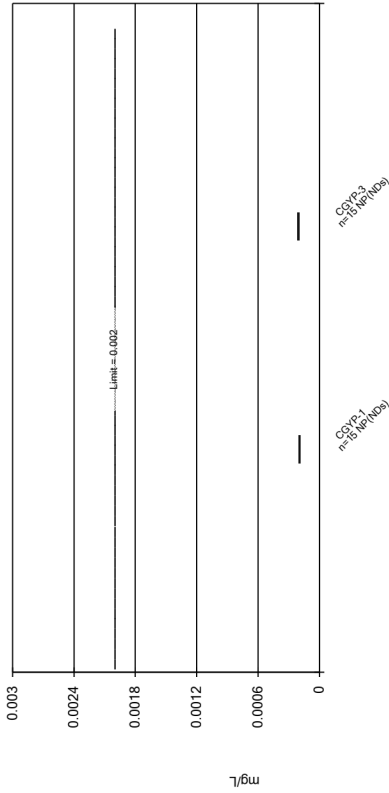

Constituent: Mercury Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance limit is exceeded.* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

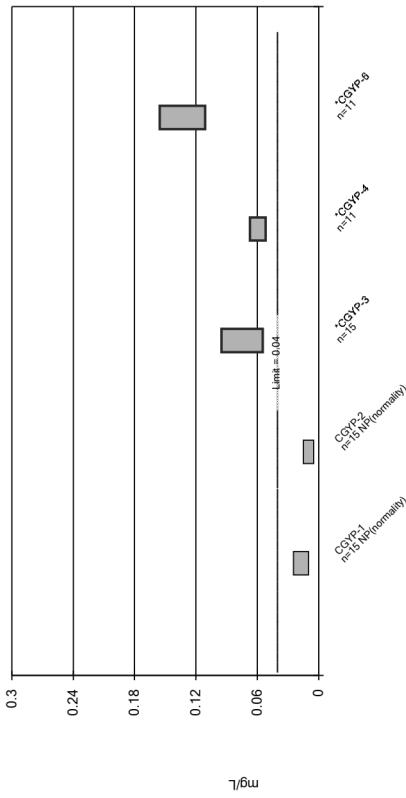

Constituent: Lithium Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Non-Parametric Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted.

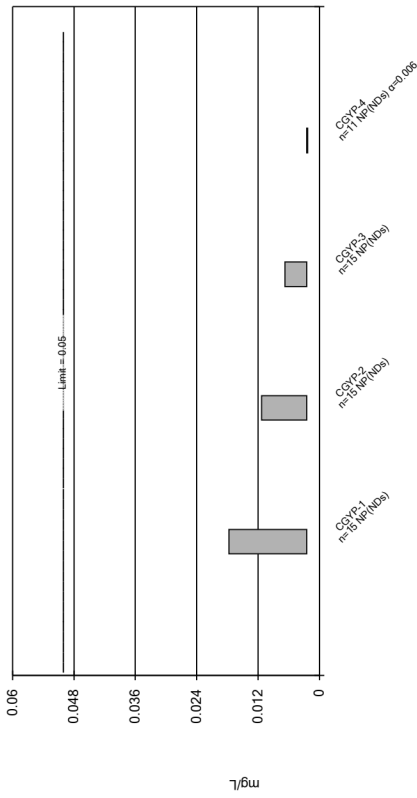

Constituent: Selenium Analysis Run 8/13/2023 4:19 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

Confidence Interval

Constituent: Arsenic (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4
5/21/2020	0.0171	0.029	0.0169	
6/4/2020	0.037	0.0167	0.0138	
6/18/2020	0.0406	0.0197	0.0215	
7/1/2020	0.0407		0.0179	
7/2/2020		0.0191		
7/16/2020	0.0165	0.0217	0.017	
7/30/2020	0.014	0.0214	0.0171	
8/13/2020	0.0175	0.0214	0.0176	
8/27/2020	0.0278	0.0204	0.015	
2/10/2021	0.0452	0.0184	0.022	
4/7/2021	0.0336	0.0169	0.0198	0.0103
5/13/2021				0.0105
7/7/2021	0.0181	0.0194	0.0183	
7/8/2021				0.0113
9/1/2021				0.0115
9/27/2021				0.0118
10/26/2021				0.0104
11/17/2021				0.0112
1/31/2022	0.0146	0.0165	0.0169	0.008
6/21/2022	<0.01	<0.003	<0.01	<0.01
10/25/2022		<0.003	0.007	0.0041
10/26/2022	0.00472			
2/6/2023		0.00922	0.00795	0.00462
2/7/2023	0.00956			
Mean	0.0228	0.01685	0.01558	0.008975
Std. Dev.	0.01354	0.007449	0.005113	0.003005
Upper Lim.	0.03198	0.02185	0.019	0.01128
Lower Lim.	0.01362	0.01394	0.01318	0.007479

Confidence Interval

Constituent: Barium (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0899	0.024	0.0621		
6/4/2020	0.0447	0.0378	0.0582		
6/18/2020	0.0403	0.0445	0.0502		
7/1/2020	0.0426		0.0547		
7/2/2020		0.0439			
7/16/2020	0.0574	0.0274	0.0444		
7/30/2020	0.0575	0.0316	0.0437		
8/13/2020	0.0517	0.0289	0.0431		
8/27/2020	0.0447	0.0407	0.0459		
2/10/2021	0.0397	0.021	0.0405		
4/7/2021	0.0448	0.0145	0.0384	0.0454	0.326
5/13/2021				0.0375	0.437
7/7/2021	0.0522	0.0178	0.0378		
7/8/2021				0.0395	0.585
8/31/2021					0.564
9/1/2021				0.0364	
9/27/2021				0.0371	0.705
10/26/2021				0.0336	0.529
11/17/2021				0.0333	0.865
1/31/2022	0.0301	0.0125	0.0246	0.025	0.258
6/21/2022	0.023	<0.01	0.017	0.019	0.29
10/25/2022		0.0183	0.0422	0.0306	0.465
10/26/2022	0.0469				
2/6/2023		0.0171	0.034	0.0286	
2/7/2023	0.0391				0.159
Mean	0.04697	0.02567	0.04245	0.03327	0.4712
Std. Dev.	0.01504	0.0121	0.01178	0.007276	0.208
Upper Lim.	0.05607	0.03386	0.05043	0.03934	0.6445
Lower Lim.	0.03684	0.01747	0.03447	0.02721	0.2978

Confidence Interval

Constituent: Beryllium (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0058	0.0053	0.0283		
6/4/2020	0.0098	0.0034	0.0367		
6/18/2020	0.0109	0.0034	0.037		
7/1/2020	0.011		0.0468		
7/2/2020		0.0044			
7/16/2020	0.0045	0.0034	0.0252		
7/30/2020	0.004	0.0035	0.022		
8/13/2020	0.0061	0.0036	0.022		
8/27/2020	0.009	0.0034	0.0318		
2/10/2021	0.0127	0.0025	0.035		
4/7/2021	0.0103	0.0031	0.0465	0.0174	0.0277
5/13/2021				0.0164	0.0239
7/7/2021	0.0061	0.0028	0.0269		
7/8/2021				0.0179	0.0212
8/31/2021					0.0197
9/1/2021				0.015	
9/27/2021				0.0156	0.0219
10/26/2021				0.0152	0.0214
11/17/2021				0.0149	0.0194
1/31/2022	0.0112	0.004	0.0339	0.0166	0.0237
6/21/2022	0.006	0.003	0.017	0.013	0.019
10/25/2022		0.0043	0.0345	0.0188	0.027
10/26/2022	0.0112				
2/6/2023		0.00424	0.0497	0.0162	
2/7/2023	0.011				0.0313
Mean	0.00864	0.003623	0.03289	0.01609	0.02329
Std. Dev.	0.002887	0.0007177	0.009665	0.001609	0.003927
Upper Lim.	0.01071	0.004109	0.03944	0.01743	0.02656
Lower Lim.	0.007078	0.003136	0.02634	0.01475	0.02002

Confidence Interval

Constituent: Cadmium (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	<0.004	<0.004	0.00062		
6/4/2020	<0.004	<0.004	0.0008		
6/18/2020	<0.004	<0.004	0.00074		
7/1/2020	<0.004		0.0009		
7/2/2020		<0.004			
7/16/2020	<0.004	<0.004	0.00061		
7/30/2020	<0.004	<0.004	<0.004		
8/13/2020	<0.004	<0.004	<0.004		
8/27/2020	<0.004	<0.004	0.00076		
2/10/2021	<0.004	<0.004	0.00078		
4/7/2021	<0.004	<0.004	0.00053	<0.0005	<0.0005
5/13/2021				<0.0005	<0.0005
7/7/2021	<0.004	<0.004	<0.004		
7/8/2021				<0.0005	<0.0005
8/31/2021					<0.0005
9/1/2021				<0.0005	
9/27/2021				<0.0005	<0.0005
10/26/2021				<0.0005	<0.0005
11/17/2021				<0.0005	<0.0005
1/31/2022	<0.004	<0.004	<0.004	<0.0005	<0.0005
6/21/2022	<0.004	<0.004	<0.004	<0.0005	<0.0005
10/25/2022		0.0014	0.0019	0.0008	0.0006
10/26/2022	0.0022				
2/6/2023		0.001	0.0015	<0.0005	
2/7/2023	0.0013				<0.0005
Mean	0.0037	0.003627	0.001943	0.0005273	0.0005091
Std. Dev.	0.0008098	0.0009881	0.001546	9.045E-05	3.015E-05
Upper Lim.	0.004	0.004	0.004	0.0005	0.0005
Lower Lim.	0.0022	0.0014	0.00062	0.0005	0.0005

Confidence Interval

Constituent: Chromium (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals
CGYP Client: Santee Cooper Data: CGYP

	CGYP-3
5/21/2020	0.0058
6/4/2020	0.0067
6/18/2020	0.0063
7/1/2020	0.0052
7/16/2020	0.0053
7/30/2020	0.0055
8/13/2020	0.0056
8/27/2020	0.0059
2/10/2021	<0.005
4/7/2021	0.0061
7/7/2021	0.0079
1/31/2022	<0.005
6/21/2022	<0.005
10/25/2022	0.009
2/6/2023	0.0073
Mean	0.006107
Std. Dev.	0.001174
Upper Lim.	0.006876
Lower Lim.	0.005426

Confidence Interval

Constituent: Cobalt (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.0448	0.0506	0.115		
6/4/2020	0.0479	0.0199	0.13		
6/18/2020	0.0492	0.0229	0.152		
7/1/2020	0.0548		0.154		
7/2/2020		0.025			
7/16/2020	0.0353	0.027	0.113		
7/30/2020	0.032	0.028	0.0966		
8/13/2020	0.0371	0.0294	0.0936		
8/27/2020	0.0467	0.0244	0.117		
2/10/2021	0.0587	0.019	0.151		
4/7/2021	0.0536	0.0183	0.143	0.0532	0.163
5/13/2021				0.0498	0.149
7/7/2021	0.0362	0.0206	0.0967		
7/8/2021				0.0494	0.147
8/31/2021					0.15
9/1/2021				0.0487	
9/27/2021				0.0478	0.157
10/26/2021				0.0463	0.158
11/17/2021				0.0461	0.128
1/31/2022	0.00931	0.00644	0.0504	0.0168	0.114
6/21/2022	0.033	0.018	0.055	0.033	0.117
10/25/2022		0.0215	0.0956	0.0415	0.156
10/26/2022	0.0523				
2/6/2023		0.0227	0.141	0.0399	
2/7/2023	0.048				0.198
Mean	0.04259	0.02358	0.1136	0.04295	0.1488
Std. Dev.	0.01249	0.009257	0.03287	0.01032	0.02342
Upper Lim.	0.05106	0.028	0.1359	0.05052	0.1683
Lower Lim.	0.03413	0.0183	0.09132	0.0365	0.1293

Confidence Interval

Constituent: Combined Radium 226 & 228 (pci/l) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	3.97	1.34	5.59		
6/4/2020	3.96	2.14	4.18		
6/18/2020	3.79	2.61	5.24		
7/1/2020	5.58		3.26		
7/2/2020		2.13			
7/16/2020	3.65	2.46	5.25		
7/30/2020	2.93	2.15	7.74		
8/13/2020	3.07	1.91	5.99		
8/27/2020	2.64	1.3	5.2		
2/10/2021	3.86	2.83	4.69		
4/7/2021	3.89	4.18	7.93	6.37	3.68
5/13/2021				5.84	6.31
7/7/2021	2.77	2.5	5.03		
7/8/2021				3.56	6.08
8/31/2021					5.53
9/1/2021				4.64	
9/27/2021				5.29	7.93
10/26/2021				5.56	6.48
11/17/2021				4.9	9.69
1/31/2022	6.81	3.4	6.17	4.85	3.44
6/21/2022	4.28	2.39	5.36	3.24	4.3
10/25/2022		5.12	6.68	3.77	6.17
10/26/2022	3.53				
2/6/2023		2.52	4.18	1.81	
2/7/2023	3.13				2.08
Mean	3.857	2.599	5.499	4.53	5.608
Std. Dev.	1.093	1	1.271	1.326	2.155
Upper Lim.	4.484	3.191	6.361	5.635	7.404
Lower Lim.	3.144	1.924	4.638	3.425	3.813

Confidence Interval

Constituent: Fluoride (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.58	0.75	0.65		
6/4/2020	0.96	0.75	2.89		
6/18/2020	1.05	0.62	2.82		
7/1/2020	0.69		0.73		
7/2/2020		<0.1			
7/16/2020	0.72	1.55	2.41		
7/30/2020	0.91	<0.1	<0.1		
8/13/2020	1.04	0.71	1		
8/27/2020	1.02	0.54	4.57		
9/21/2020	1.29	1.23	1.77		
2/10/2021	1.69	1.3	6.22		
4/7/2021	1.31	1.08	3.32	3.19	1.1
5/13/2021				2.82	0.84
7/7/2021	0.97	0.87	1.88		
7/8/2021				1.85	0.99
8/31/2021					0.75
9/1/2021				1.79	
9/27/2021				1.63	0.98
10/26/2021				0.83	0.42
11/17/2021				1.53	0.58
1/31/2022	0.9	0.28	0.81	0.67	0.36
6/21/2022	0.91	0.93	1.94	1.56	0.93
10/25/2022		0.42	1.06	0.99	0.49
10/26/2022	0.53				
2/6/2023		1.12	3.08	1.58	
2/7/2023	1.28				0.89
Mean	0.9906	0.7656	2.2	1.676	0.7573
Std. Dev.	0.2987	0.4347	1.611	0.7674	0.255
Upper Lim.	1.185	1.048	3.248	2.316	0.9697
Lower Lim.	0.7963	0.4828	1.152	1.037	0.5448

Confidence Interval

Constituent: Lead (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.035	0.02	0.0279		
6/4/2020	0.0191	0.0238	0.019		
6/18/2020	0.0201	0.0247	0.0236		
7/1/2020	0.0202		0.0236		
7/2/2020		0.026			
7/16/2020	0.0116	0.0235	0.0269		
7/30/2020	0.005	0.0244	0.0295		
8/13/2020	0.0093	0.0247	0.0355		
8/27/2020	0.0087	0.0268	0.0193		
2/10/2021	0.0165	0.0196	0.092 (o)		
4/7/2021	0.008	0.0175	0.0248	0.0113	0.013
5/13/2021				0.0122	0.0127
7/7/2021	0.0097	0.0208	0.0297		
7/8/2021				0.0126	0.0131
8/31/2021					0.0136
9/1/2021				0.0146	
9/27/2021				0.0147	0.0137
10/26/2021				0.0145	0.0158
11/17/2021				0.0147	0.0068
1/31/2022	0.0056	0.019	0.0244	0.0113	0.0105
6/21/2022	<0.01	<0.01	0.011	<0.01	<0.01
10/25/2022		0.0251	0.0298	0.0134	0.0028
10/26/2022	0.0089				
2/6/2023		0.0234	0.0328	0.00927	
2/7/2023	0.00625				0.0118
Mean	0.0126	0.02162	0.02556	0.01214	0.0108
Std. Dev.	0.008231	0.00537	0.006282	0.002952	0.00412
Upper Lim.	0.01693	0.02481	0.03001	0.01437	0.01423
Lower Lim.	0.007209	0.01932	0.02111	0.01021	0.007367

Confidence Interval

Constituent: Lithium (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4	CGYP-6
5/21/2020	0.015	0.015	0.069		
6/4/2020	0.027	<0.005	0.09		
6/18/2020	0.028	0.015	0.11		
7/1/2020	<0.01		0.11		
7/2/2020		0.015			
7/16/2020	0.01	<0.005	0.071		
7/30/2020	<0.01	0.014	0.06		
8/13/2020	<0.01	<0.005	0.063		
8/27/2020	0.023	0.016	0.093		
2/10/2021	0.024	0.013	0.11		
4/7/2021	0.02	0.014	0.094	0.058	0.14
5/13/2021				0.058	0.13
7/7/2021	0.014	0.015	0.056		
7/8/2021				0.058	0.12
8/31/2021					0.13
9/1/2021				0.064	
9/27/2021				0.067	0.15
10/26/2021				0.053	0.11
11/17/2021				0.052	0.11
1/31/2022	0.0183	0.0109	0.1	0.0642	0.128
6/21/2022	<0.01	<0.005	0.029	0.039	0.1
10/25/2022		<0.005	0.0517	0.0712	0.148
10/26/2022	0.00893				
2/6/2023		0.0142	0.0143	0.0687	
2/7/2023	0.0247				0.198
Mean	0.01686	0.01114	0.07473	0.05937	0.1331
Std. Dev.	0.007065	0.004636	0.02968	0.009195	0.02673
Upper Lim.	0.0247	0.015	0.09485	0.06703	0.1554
Lower Lim.	0.01	0.005	0.05462	0.05171	0.1108

Confidence Interval

Constituent: Mercury (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-3
5/21/2020	<0.0002	<0.0002
6/4/2020	<0.0002	<0.0002
6/18/2020	<0.0002	0.00047
7/1/2020	0.0002	0.00023
7/16/2020	<0.0002	<0.0002
7/30/2020	<0.0002	<0.0002
8/13/2020	<0.0002	<0.0002
8/27/2020	<0.0002	<0.0002
2/10/2021	<0.0002	<0.0002
4/7/2021	<0.0002	0.00021
7/7/2021	<0.0002	<0.0002
1/31/2022	<0.0002	<0.0002
6/21/2022	<0.0002	<0.0002
10/25/2022		<0.0002
10/26/2022	<0.0002	
2/6/2023		<0.0002
2/7/2023	<0.0002	
Mean	0.0002	0.0002207
Std. Dev.	1.3E-12	6.943E-05
Upper Lim.	0.0002	0.00021
Lower Lim.	0.0002	0.0002

Confidence Interval

Constituent: Selenium (mg/L) Analysis Run 8/13/2023 4:20 PM View: Confidence Intervals

CGYP Client: Santee Cooper Data: CGYP

	CGYP-1	CGYP-2	CGYP-3	CGYP-4
5/21/2020	<0.0025	0.0113	<0.0025	
6/4/2020	0.0166	0.0078	0.0067	
6/18/2020	0.0143	<0.0025	<0.0025	
7/1/2020	0.0177		<0.0025	
7/2/2020		<0.0025		
7/16/2020	<0.0025	<0.0025	<0.0025	
7/30/2020	<0.0025	<0.0025	<0.0025	
8/13/2020	<0.0025	<0.0025	<0.0025	
8/27/2020	<0.0025	<0.0025	<0.0025	
2/10/2021	0.0163	<0.0025	<0.0025	
4/7/2021	<0.0025	<0.0025	<0.0025	<0.0025
5/13/2021				<0.0025
7/7/2021	<0.0025	<0.0025	<0.0025	
7/8/2021				<0.0025
9/1/2021				<0.0025
9/27/2021				<0.0025
10/26/2021				<0.0025
11/17/2021				<0.0025
1/31/2022	0.018	0.014	0.014	<0.0025
6/21/2022	<0.0025	<0.0025	<0.0025	<0.0025
10/25/2022		0.027	0.019	0.00856
10/26/2022	0.026			
2/6/2023		<0.0025	<0.0025	<0.0025
2/7/2023	<0.0025			
Mean	0.00876	0.00584	0.004647	0.003051
Std. Dev.	0.008299	0.006921	0.005022	0.001827
Upper Lim.	0.0177	0.0113	0.0067	0.0025
Lower Lim.	0.0025	0.0025	0.0025	0.0025

Appendix B – Laboratory Analytical Results

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54600 **Location:** GW Well PM-1 **Date:** 01/24/2023 **Sample Collector:** MDG/CDM
Loc. Code PM-1 **Time:** 10:18

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Silver- Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Aluminum	<0.1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	<0.1	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/02/2023	GEL	SM2320B
Alkalinity	33.4	mg/L	02/02/2023	GEL	SM 2320B
Bicarbonate Alkalinity	33.4	mg/L	02/02/2023	GEL	SM 2320B
Arsenic	3.32	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	<3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	11.4	ug/L	03/02/2023	SJHATCHE	EPA 6010D
Boron Dissolved	13.8	ug/L	03/08/2023	SJHATCHE	EPA 6010D
Barium	80.8	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	76.3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	<0.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	<0.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium	12.6	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium Dissolved	12	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	<0.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	<0.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	12.3	mg/L	01/28/2023	KCWELLS	EPA 300.0
Cobalt	1.36	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	1.2	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Spec. Cond.	100	uS	01/24/2023	ZDM/MDG	
Chromium	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Depth	8.29	Feet	01/24/2023	ZDM/MDG	
Dissolved Oxygen	0.660	ppm	01/24/2023	ZDM/MDG	
Dissolved Organic Carbon	6.14	mg/L	02/02/2023	GEL	SM 5310B
Elevation	74.95	Feet	02/17/2023	ZDMCHENR	
Iron	11100	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Iron - Dissolved	10100	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Fluoride	<0.10	mg/L	01/28/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/21/2023	EUROFINS SAV	EPA 7470
Potassium	<1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Potassium Dissolved	<1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lithium	<5.00	ug/L	03/02/2023	SJHATCHE	EPA 6010D
Lithium Dissolved	<5.00	ug/L	03/08/2023	SJHATCHE	EPA 6010D
Magnesium	0.717	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Magnesium Dissolved	0.710	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese	10.7	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	10.00	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5.00	ug/L	03/02/2023	SJHATCHE	EPA 6010D
Molybdenum Dissolved	<5.00	ug/L	03/08/2023	SJHATCHE	EPA 6010D
Sodium	6.54	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Sodium Dissolved	6.26	mg/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54600 **Location:** GW Well PM-1 **Date:** 01/24/2023 **Sample Collector:** MDG/CDM
Loc. Code PM-1 **Time:** 10:18

Analysis	Result	Units	Test Date	Analyst	Method
Nickel - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	01/28/2023	KCWELLS	EPA 300.0
Nitrate	<0.10	mg/L	01/28/2023	KCWELLS	EPA 300.0
Oxidation Reduction Potential	37.0	mv	01/24/2023	ZDM/MDG	SM2580
Lead	<2.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	<2.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
pH	4.84	SU	01/24/2023	ZDM/MDG	
Radium 226	0.845	pCi/L	02/22/2023	GEL	EPA 903.1 Mod
Radium 228	1.79	pCi/L	02/23/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.63	pCi/L	02/24/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Selenium	<2.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	<2.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Silica	33000.0	ug/l	02/23/2023	EUROFINS SAV	EPA 200.7
SiO2 Dissolved	33000	ug/l	02/23/2023	EUROFINS SAV	EPA 200.7
Sulfate	8.12	mg/L	01/28/2023	KCWELLS	EPA 300.0
Sulfide	<0.1	mg/L	01/31/2023	GEL	EPA 9034
Total Dissolved Solids	111.2	mg/L	02/02/2023	KCWELLS	SM 2540C
Temp	17.68	C	01/24/2023	ZDM/MDG	
Thallium	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	5.09	mg/L	01/31/2023	GEL	SM 5310B
Total Phosphorus	<0.025	mg/L	01/30/2023	KCWELLS	EPA 365.1
Turbidity	2.90	NTU	01/24/2023	ZDM/MDG	
Zinc	<20	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Zinc Dissolved	<20	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:  5/19/23
 Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54572 **Location:** GW Well CBW-1 **Date:** 01/24/2023 **Sample Collector:** MDG/CDM
Loc. Code CBW-1 **Time:** 11:46

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Silver- Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Aluminum	0.752	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	0.650	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/02/2023	GEL	SM2320B
Alkalinity	5.00	mg/L	02/02/2023	GEL	SM 2320B
Bicarbonate Alkalinity	5.00	mg/L	02/02/2023	GEL	SM 2320B
Arsenic	<3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	<3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	17.5	ug/L	02/15/2023	AMSTOCKH	EPA 6010D
Boron Dissolved	17.7	ug/L	03/01/2023	SJHATCHE	EPA 6010D
Barium	42.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	42.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	<0.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	<0.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium	29.3	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium Dissolved	31	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	<0.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	<0.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	3.0	mg/L	01/28/2023	KCWELLS	EPA 300.0
Cobalt	0.760	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	0.77	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Spec. Cond.	181	uS	01/24/2023	ZDM/MDG	
Chromium	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Depth	9.29	Feet	01/24/2023	ZDM/MDG	
Dissolved Oxygen	0.720	ppm	01/24/2023	ZDM/MDG	
Dissolved Organic Carbon	3.52	mg/L	02/01/2023	GEL	SM 5310B
Elevation	76.51	Feet	02/17/2023	ZDMCHENR	
Iron	<100	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Iron - Dissolved	<100	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Fluoride	0.15	mg/L	01/28/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/21/2023	EUROFINS SAV	EPA 7470
Potassium	<1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Potassium Dissolved	<1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lithium	<5.00	ug/L	02/15/2023	AMSTOCKH	EPA 6010D
Lithium Dissolved	<5.00	ug/L	03/01/2023	SJHATCHE	EPA 6010D
Magnesium	2.29	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Magnesium Dissolved	2.28	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese	28.9	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	28.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5.00	ug/L	02/15/2023	AMSTOCKH	EPA 6010D
Molybdenum Dissolved	<5.00	ug/L	03/01/2023	SJHATCHE	EPA 6010D
Sodium	8.62	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Sodium Dissolved	8.71	mg/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54572 **Location:** GW Well CBW-1 **Date:** 01/24/2023 **Sample Collector:** MDG/CDM
Loc. Code CBW-1 **Time:** 11:46

Analysis	Result	Units	Test Date	Analyst	Method
Nickel - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	01/28/2023	KCWELLS	EPA 300.0
Nitrate	0.71	mg/L	01/28/2023	KCWELLS	EPA 300.0
Oxidation Reduction Potential	347	mv	01/24/2023	ZDM/MDG	SM2580
Lead	2.59	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	<2.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
pH	4.23	SU	01/24/2023	ZDM/MDG	
Radium 226	0.509	pCi/L	02/22/2023	GEL	EPA 903.1 Mod
Radium 228	1.15	pCi/L	02/23/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.66	pCi/L	02/24/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Selenium	<2.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	<2.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Silica	3110.0	ug/l	02/23/2023	EUROFINS SAV	EPA 200.7
SiO2 Dissolved	3110	ug/l	02/23/2023	EUROFINS SAV	EPA 200.7
Sulfate	84.2	mg/L	01/28/2023	KCWELLS	EPA 300.0
Sulfide	<0.1	mg/L	01/31/2023	GEL	EPA 9034
Total Dissolved Solids	142.5	mg/L	02/02/2023	KCWELLS	SM 2540C
Temp	18.20	C	01/24/2023	ZDM/MDG	
Thallium	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	2.28	mg/L	01/31/2023	GEL	SM 5310B
Total Phosphorus	<0.025	mg/L	01/30/2023	KCWELLS	EPA 365.1
Turbidity	0	NTU	01/24/2023	ZDM/MDG	
Zinc	241	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Zinc Dissolved	234	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:


Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54585 **Location:** GW Well CGYP-1 **Date:** 02/07/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-1 **Time:** 10:24

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Silver- Dissolved	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Aluminum	17.0	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	18.6	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/18/2023	SUB_GEL	SM2320B
Alkalinity	<4	mg/L	02/18/2023	SUB_GEL	SM 2320B
Bicarbonate Alkalinity	<4	mg/L	02/18/2023	SUB_GEL	SM 2320B
Arsenic	9.56	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	11.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	11100	ug/L	04/19/2023	LCWILLIA	EPA 6010D
Barium	39.1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	44.0	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	11.0	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	11.7	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium	264	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium Dissolved	288	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	1.3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	1.630	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	7.21	mg/L	02/10/2023	KCWELLS	EPA 300.0
Cobalt	48.0	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	53.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Spec. Cond.	2860	uS	02/07/2023	ZDM/BSB	
Chromium	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Depth	15.93	Feet	02/07/2023	ZDM/BSB	
Dissolved Oxygen	0.490	ppm	02/07/2023	ZDM/BSB	
Dissolved Organic Carbon	7.32	mg/L	02/15/2023	SUB_GEL	SM 5310B
Elevation	75.96	Feet	02/17/2023	ZDMCHENR	
Iron	179000	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Iron - Dissolved	197000	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Fluoride	1.28	mg/L	02/10/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/22/2023	EUROFINS SAV	EPA 7470
Potassium	4.59	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Potassium Dissolved	5.1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lithium	24.7	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Lithium Dissolved	24.8	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Magnesium	55.4	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Magnesium Dissolved	61.5	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese	437	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	480	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Sodium	74.4	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Sodium Dissolved	82.1	mg/L	02/17/2023	EUROFINS SAV	EPA 6020B

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54585 **Location:** GW Well CGYP-1 **Date:** 02/07/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-1 **Time:** 10:24

Analysis	Result	Units	Test Date	Analyst	Method
Nickel	32.8	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel - Dissolved	35.90	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Nitrate	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Oxidation Reduction Potential	208	mv	02/07/2023	ZDM/BSB	SM2580
Lead	6.25	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	6.40	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
pH	4.38	SU	02/07/2023	ZDM/BSB	
Radium 226	0.762	pCi/L	03/12/2023	GEL	EPA 903.1 Mod
Radium 228	2.37	pCi/L	03/08/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	3.13	pCi/L	03/14/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Selenium	<2.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	2.6	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Sulfate	476	mg/L	02/10/2023	KCWELLS	EPA 300.0
Sulfide	<0.1	mg/L	02/14/2023	SUB_GEL	EPA 9034
Total Dissolved Solids	1764	mg/L	02/14/2023	KCWELLS	SM 2540C
Temp	19.90	C	02/07/2023	ZDM/BSB	
Thallium	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	7.71	mg/L	02/16/2023	SUB_GEL	SM 5310B
Turbidity	0	NTU	02/07/2023	ZDM/BSB	
Zinc	68.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Zinc Dissolved	74.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:


 Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54586 **Location:** GW Well CGYP-2 **Date:** 02/06/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-2 **Time:** 14:02

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Silver- Dissolved	<1	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Aluminum	24.1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	21.0	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/18/2023	GEL	SM2320B
Alkalinity	<4	mg/L	02/18/2023	GEL	SM 2320B
Bicarbonate Alkalinity	<4	mg/L	02/18/2023	GEL	SM 2320B
Arsenic	9.22	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	8.1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	602	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Barium	17.1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	14.7	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	4.24	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	3.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium	301	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium Dissolved	258	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	1.0	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	1.590	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	46.0	mg/L	02/10/2023	KCWELLS	EPA 300.0
Cobalt	22.7	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	19.2	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Spec. Cond.	1460	uS	02/06/2023	ZDM/BSB	
Chromium	<5	ug/L	02/24/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	<5	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Depth	8.09	Feet	02/06/2023	ZDM/BSB	
Dissolved Oxygen	0.380	ppm	02/06/2023	ZDM/BSB	
Dissolved Organic Carbon	7.75	mg/L	02/15/2023	GEL	SM 5310B
Elevation	76.79	Feet	02/17/2023	ZDMCHENR	
Iron	81000	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Iron - Dissolved	69600	ug/L	02/23/2023	EUROFINS SAV	EPA 6020B
Fluoride	1.12	mg/L	02/10/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/22/2023	EUROFINS SAV	EPA 7470
Potassium	2.78	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Potassium Dissolved	2.3	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lithium	14.2	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Lithium Dissolved	14.6	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Magnesium	25.1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Magnesium Dissolved	21.5	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese	351	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	312	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Sodium	10.4	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Sodium Dissolved	8.31	mg/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel	12.1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel - Dissolved	10.20	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54586 **Location:** GW Well CGYP-2 **Date:** 02/06/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-2 **Time:** 14:02

Analysis	Result	Units	Test Date	Analyst	Method
Nitrate	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Oxidation Reduction Potential	277	mv	02/06/2023	ZDM/BSB	SM2580
Lead	23.4	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	20.0	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
pH	4.01	SU	02/06/2023	ZDM/BSB	
Radium 226	0.460	pCi/L	03/12/2023	GEL	EPA 903.1 Mod
Radium 228	2.06	pCi/L	03/08/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.52	pCi/L	03/14/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	02/24/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Selenium	<2.5	ug/L	02/24/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	<2.5	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Sulfate	958	mg/L	02/10/2023	KCWELLS	EPA 300.0
Sulfide	<0.1	mg/L	02/13/2023	GEL	EPA 9034
Total Dissolved Solids	1474	mg/L	02/14/2023	KCWELLS	SM 2540C
Temp	19.15	C	02/06/2023	ZDM/BSB	
Thallium	<1	ug/L	02/24/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	7.36	mg/L	02/16/2023	GEL	SM 5310B
Turbidity	28.2	NTU	02/06/2023	ZDM/BSB	
Zinc	<20	ug/l	02/24/2023	EUROFINS SAV	EPA 6020B
Zinc Dissolved	<20	ug/L	02/23/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:



Linda Williams - Manager Analytical Services



One Riverwood Drive
P.O. Box 2946101
Moncks Corner, SC 29461-2901
(843) 761-8000

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54587 **Location:** GW Well CGYP-2 **Date:** 02/06/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-2 **DUP** **Time:** 14:07

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Silver- Dissolved	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Aluminum	23.1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	20.7	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/18/2023	GEL	SM2320B
Alkalinity	<4	mg/L	02/18/2023	GEL	SM 2320B
Bicarbonate Alkalinity	<4	mg/L	02/18/2023	GEL	SM 2320B
Arsenic	9.22	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	8.0	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	609	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Barium	16.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	15.7	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	3.96	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	3.9	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium	292	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium Dissolved	263	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	0.90	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	0.940	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	45.8	mg/L	02/10/2023	KCWELLS	EPA 300.0
Cobalt	22.3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	19.9	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Dissolved Organic Carbon	7.96	mg/L	02/15/2023	GEL	SM 5310B
Iron	77700	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Iron - Dissolved	69000	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Fluoride	1.18	mg/L	02/10/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/22/2023	EUROFINS SAV	EPA 7470
Potassium	2.69	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Potassium Dissolved	2.4	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lithium	14.3	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Lithium Dissolved	14.9	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Magnesium	24.5	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Magnesium Dissolved	22.3	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese	343	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	305	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Sodium	10.5	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Sodium Dissolved	9.16	mg/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel	12.1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel - Dissolved	10.80	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Nitrate	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54587 Location: GW Well CGYP-2 Date: 02/06/2023 Sample Collector: ZDM/BSB
Loc. Code CGYP-2 DUP Time: 14:07

Analysis	Result	Units	Test Date	Analyst	Method
Lead	22.7	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	20.0	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Radium 226	0.629	pCi/L	03/12/2023	GEL	EPA 903.1 Mod
Radium 228	0.905	pCi/L	03/08/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.53	pCi/L	03/14/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Selenium	<2.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	<2.5	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Sulfate	979	mg/L	02/10/2023	KCWELLS	EPA 300.0
Sulfide	<0.1	mg/L	02/13/2023	GEL	EPA 9034
Total Dissolved Solids	1592	mg/L	02/14/2023	KCWELLS	SM 2540C
Thallium	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	7.48	mg/L	02/16/2023	GEL	SM 5310B
Zinc	<20	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Zinc Dissolved	<20	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:  5/19/23
Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54588 **Location:** GW Well CGYP-3 **Date:** 02/06/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-3 **Time:** 12:55

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Silver- Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Aluminum	53.5	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	52.5	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/18/2023	GEL	SM2320B
Alkalinity	<4	mg/L	02/18/2023	GEL	SM 2320B
Bicarbonate Alkalinity	<4	mg/L	02/18/2023	GEL	SM 2320B
Arsenic	7.95	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	8.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	23900	ug/L	04/19/2023	LCWILLIA	EPA 6010D
Boron Dissolved	779	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Barium	34.0	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	34.1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	49.7	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	48.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium	737	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium Dissolved	707	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	1.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	1.410	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	1270	mg/L	02/10/2023	KCWELLS	EPA 300.0
Cobalt	141	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	140	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Spec. Cond.	5250	uS	02/06/2023	ZDM/BSB	
Chromium	7.3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	7.38	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Depth	6.50	Feet	02/06/2023	ZDM/BSB	
Dissolved Oxygen	0.300	ppm	02/06/2023	ZDM/BSB	
Dissolved Organic Carbon	12.2	mg/L	02/15/2023	GEL	SM 5310B
Elevation	77.45	Feet	02/17/2023	ZDMCHENR	
Iron	157000	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Iron - Dissolved	153000	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Fluoride	3.08	mg/L	02/10/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/22/2023	EUROFINS SAV	EPA 7470
Potassium	2.92	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Potassium Dissolved	3.0	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lithium	14.3	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Lithium Dissolved	129	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Magnesium	34.1	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Magnesium Dissolved	34.0	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese	629	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	624	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Molybdenum Dissolved	<5.0	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Sodium	118	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Sodium Dissolved	118	mg/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel	127	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54588 **Location:** GW Well CGYP-3 **Date:** 02/06/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-3 **Time:** 12:55

Analysis	Result	Units	Test Date	Analyst	Method
Nickel - Dissolved	126.00	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Nitrate	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Oxidation Reduction Potential	273	mv	02/06/2023	ZDM/BSB	SM2580
Lead	32.8	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	32.6	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
pH	3.77	SU	02/06/2023	ZDM/BSB	
Radium 226	0.642	pCi/L	03/12/2023	GEL	EPA 903.1 Mod
Radium 228	3.53	pCi/L	03/08/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	4.18	pCi/L	03/14/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Selenium	<2.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	<2.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Silica	86700.0	ug/l	02/26/2023	EUROFINS SAV	EPA 200.7
SiO2 Dissolved	86700	ug/l	02/26/2023	EUROFINS SAV	EPA 200.7
Sulfate	928	mg/L	02/10/2023	KCWELLS	EPA 300.0
Sulfide	<0.1	mg/L	02/13/2023	GEL	EPA 9034
Total Dissolved Solids	3838	mg/L	02/14/2023	KCWELLS	SM 2540C
Temp	18.52	C	02/06/2023	ZDM/BSB	
Thallium	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	13.6	mg/L	02/16/2023	GEL	SM 5310B
Total Phosphorus	<0.025	mg/L	02/07/2023	KCWELLS	EPA 365.1
Turbidity	23.2	NTU	02/06/2023	ZDM/BSB	
Zinc	237	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Zinc Dissolved	236	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:



Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF54589 Location: GW Well CGYP-4 Date: 02/06/2023 Sample Collector: ZDM/BSB
Loc. Code CGYP-4 Time: 15:32

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum	16.6	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	16.3	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/18/2023	GEL	SM2320B
Alkalinity	<4	mg/L	02/18/2023	GEL	SM 2320B
Bicarbonate Alkalinity	<4	mg/L	02/18/2023	GEL	SM 2320B
Arsenic	4.62	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	4.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	5670	ug/L	04/19/2023	LCWILLIA	EPA 6010D
Boron Dissolved	5070	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Barium	28.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	30.0	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	16.2	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	15.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	<0.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	<0.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	417	mg/l	02/23/2023	EUROFINS SAV	EPA 300.0
Cobalt	39.9	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	40.1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Spec. Cond.	2020	uS	02/06/2023	ZDM/BSB	
Chromium	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Depth	6.19	Feet	02/06/2023	ZDM/BSB	
Dissolved Oxygen	0.280	ppm	02/06/2023	ZDM/BSB	
Dissolved Organic Carbon	11.2	mg/L	02/15/2023	GEL	SM 5310B
Elevation	77.30	Feet	02/17/2023	ZDMCHENR	
Fluoride	1.58	mg/L	02/10/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/22/2023	EUROFINS SAV	EPA 7470
Lithium	68.7	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Lithium Dissolved	65.0	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Manganese	296	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	292	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Molybdenum Dissolved	<5.0	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Nickel	40.0	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel - Dissolved	40.20	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Nitrate	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Oxidation Reduction Potential	269	mv	02/06/2023	ZDM/BSB	SM2580
Lead	9.27	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	9.00	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
pH	4.01	SU	02/06/2023	ZDM/BSB	
Radium 226	0.941	pCi/L	03/12/2023	GEL	EPA 903.1 Mod
Radium 228	0.869	pCi/L	03/08/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.81	pCi/L	03/14/2023	GEL	EPA 903.1 Mod

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54589 Location: GW Well CGYP-4 Date: 02/06/2023 Sample Collector: ZDM/BSB
Loc. Code CGYP-4 Time: 15:32

Analysis	Result	Units	Test Date	Analyst	Method
Antimony	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Selenium	<2.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	<2.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Silica	47900.0	ug/l	02/23/2023	EUROFINS SAV	EPA 200.7
SiO2 Dissolved	47900	ug/l	02/23/2023	EUROFINS SAV	EPA 200.7
Sulfate	557	mg/l	02/23/2023	EUROFINS SAV	EPA 300.0
Sulfide	<0.1	mg/L	02/13/2023	GEL	EPA 9034
Total Dissolved Solids	1689	mg/L	02/14/2023	KCWELLS	SM 2540C
Temp	21.31	C	02/06/2023	ZDM/BSB	
Thallium	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	11.7	mg/L	02/16/2023	GEL	SM 5310B
Total Phosphorus	<0.025	mg/L	02/07/2023	KCWELLS	EPA 365.1
Turbidity	1.60	NTU	02/06/2023	ZDM/BSB	
Zinc	69.7	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:

 5/19/23

Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54591 **Location:** GW Well CGYP-6 **Date:** 02/07/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-6 **Time:** 11:40

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Silver- Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Aluminum	11.9	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	11.6	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/18/2023	SUB_GEL	SM2320B
Alkalinity	<4	mg/L	02/18/2023	SUB_GEL	SM 2320B
Bicarbonate Alkalinity	<4	mg/L	02/18/2023	SUB_GEL	SM 2320B
Arsenic	<3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	<3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	9490	ug/L	04/19/2023	LCWILLIA	EPA 6010D
Boron Dissolved	8220	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Barium	159	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	149	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	31.3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	29.9	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium	520	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium Dissolved	541	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	<0.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	0.560	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	1150	mg/L	02/10/2023	KCWELLS	EPA 300.0
Cobalt	198	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	193	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Spec. Cond.	3900	uS	02/07/2023	ZDM/BSB	
Chromium	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Depth	7.06	Feet	02/07/2023	ZDM/BSB	
Dissolved Oxygen	0.310	ppm	02/07/2023	ZDM/BSB	
Dissolved Organic Carbon	4.34	mg/L	02/15/2023	SUB_GEL	SM 5310B
Elevation	76.17	Feet	02/17/2023	ZDMCHENR	
Iron	71500	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Iron - Dissolved	67900	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Fluoride	0.89	mg/L	02/10/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/21/2023	EUROFINS SAV	EPA 7470
Potassium	1.82	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Potassium Dissolved	1.8	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lithium	198	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Lithium Dissolved	175	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Magnesium	19.9	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Magnesium Dissolved	18.9	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese	209	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	208	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Molybdenum Dissolved	<5.0	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Sodium	121	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Sodium Dissolved	118	mg/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel	198	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54591 **Location:** GW Well CGYP-6 **Date:** 02/07/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-6 **Time:** 11:40

Analysis	Result	Units	Test Date	Analyst	Method
Nickel - Dissolved	189.00	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Nitrate	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Oxidation Reduction Potential	298	mv	02/07/2023	ZDM/BSB	SM2580
Lead	11.8	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	11.6	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
pH	3.80	SU	02/07/2023	ZDM/BSB	
Radium 226	0.193	pCi/L	03/12/2023	GEL	EPA 903.1 Mod
Radium 228	1.89	pCi/L	03/08/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.08	pCi/L	03/14/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Selenium	<2.5	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	<2.5	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Silica	117000.0	ug/l	02/26/2023	EUROFINS SAV	EPA 200.7
SiO2 Dissolved	117000	ug/l	02/26/2023	EUROFINS SAV	EPA 200.7
Sulfate	163	mg/L	02/10/2023	KCWELLS	EPA 300.0
Sulfide	<0.1	mg/L	02/14/2023	SUB_GEL	EPA 9034
Total Dissolved Solids	2959	mg/L	02/14/2023	COAMESWA	SM 2540C
Temp	21.82	C	02/07/2023	ZDM/BSB	
Thallium	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	4.65	mg/L	02/16/2023	SUB_GEL	SM 5310B
Total Phosphorus	<0.025	mg/L	02/14/2023	KCWELLS	EPA 365.1
Turbidity	0	NTU	02/07/2023	ZDM/BSB	
Zinc	1210	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Zinc Dissolved	1100	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:



Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54592 **Location:** GW Well CGYP-7 **Date:** 02/07/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-7 **Time:** 09:14

Analysis	Result	Units	Test Date	Analyst	Method
Silver	<1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Silver- Dissolved	<1	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Aluminum	33.3	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Aluminum - Dissolved	32.5	mg/l	02/17/2023	EUROFINS SAV	EPA 200.7
Alkalinity as CaCO3	<4	mg/L	02/18/2023	SUB_GEL	SM2320B
Alkalinity	<4	mg/L	02/18/2023	SUB_GEL	SM 2320B
Bicarbonate Alkalinity	<4	mg/L	02/18/2023	SUB_GEL	SM 2320B
Arsenic	14.2	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Arsenic Dissolved	13.4	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Boron	11600	ug/L	04/19/2023	LCWILLIA	EPA 6010D
Barium	28.3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Barium Dissolved	30.8	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium	11.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Beryllium Dissolved	11.3	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium	420	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Calcium Dissolved	407	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium	1.5	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cadmium - Dissolved	1.31	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Chloride	910	mg/L	02/10/2023	KCWELLS	EPA 300.0
Cobalt	107	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Cobalt Dissolved	105	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Spec. Cond.	3780	uS	02/07/2023	ZDM/BSB	
Chromium	<5	ug/L	02/24/2023	EUROFINS SAV	EPA 6020B
Chromium - Dissolved	<5	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Depth	9.16	Feet	02/07/2023	ZDM/BSB	
Dissolved Oxygen	0.540	ppm	02/07/2023	ZDM/BSB	
Dissolved Organic Carbon	9.29	mg/L	02/15/2023	SUB_GEL	SM 5310B
Elevation	76.32	Feet	02/17/2023	ZDMCHENR	
Iron	203000	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Iron - Dissolved	200000	ug/L	02/23/2023	EUROFINS SAV	EPA 6020B
Fluoride	1.61	mg/L	02/10/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/l	02/22/2023	EUROFINS SAV	EPA 7470
Potassium	5.02	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Potassium Dissolved	5.0	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lithium	11.6	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Lithium Dissolved	12.0	ug/L	04/05/2023	LCWILLIA	EPA 6010D
Magnesium	71.5	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Magnesium Dissolved	70.2	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese	1580	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Manganese Dissolved	1540	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Molybdenum	<5	ug/L	04/12/2023	LCWILLIA	EPA 6010D
Sodium	85.6	mg/l	02/17/2023	EUROFINS SAV	EPA 6020B
Sodium Dissolved	84.6	mg/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel	37.1	ug/L	02/17/2023	EUROFINS SAV	EPA 6020B
Nickel - Dissolved	37.4	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
Nitrite	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF54592 **Location:** GW Well CGYP-7 **Date:** 02/07/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-7 **Time:** 09:14

Analysis	Result	Units	Test Date	Analyst	Method
Nitrate	<0.10	mg/L	02/10/2023	KCWELLS	EPA 300.0
Oxidation Reduction Potential	297	mv	02/07/2023	ZDM/BSB	SM2580
Lead	37.8	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Lead - Dissolved	37.3	ug/l	02/17/2023	EUROFINS SAV	EPA 200.8
pH	3.82	SU	02/07/2023	ZDM/BSB	
Radium 226	0.795	pCi/L	03/12/2023	GEL	EPA 903.1 Mod
Radium 228	4.48	pCi/L	03/08/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	5.27	pCi/L	03/14/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	02/24/2023	EUROFINS SAV	EPA 6020B
Antimony - Dissolved	<5	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Selenium	2	ug/L	02/24/2023	EUROFINS SAV	EPA 6020B
Selenium - Dissolved	3.4	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Sulfate	830	mg/L	02/10/2023	KCWELLS	EPA 300.0
Sulfide	<0.5	mg/L	02/14/2023	SUB_GEL	EPA 9034
Total Dissolved Solids	2546	mg/L	02/14/2023	COAMESWA	SM 2540C
Temp	18.21	C	02/07/2023	ZDM/BSB	
Thallium	<1	ug/L	02/24/2023	EUROFINS SAV	EPA 6020B
Thallium - Dissolved	<1	ug/L	02/23/2023	EUROFINS SAV	EPA 200.8
Total Organic Carbon	9.83	mg/L	02/16/2023	SUB_GEL	SM 5310B
Turbidity	0	NTU	02/07/2023	ZDM/BSB	
Zinc	75.6	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B
Zinc Dissolved	74.9	ug/l	02/17/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:



Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF58977 **Location:** GW Well CGYP-7 **Date:** 03/20/2023 **Sample Collector:** ZDM/BSB

Loc. Code CGYP-7 **Time:** 10:37

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	16.8	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Boron	10800.0	ug/L	04/10/2023	EUROFINS SAV	EPA 6010D
Barium	29.2	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Beryllium	9.44	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Calcium	397000	mg/L	04/03/2023	EUROFINS SAV	EPA 6010D
Cadmium	0.79	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Chloride	1030	mg/L	03/29/2023	KCWELLS	EPA 300.0
Cobalt	99.4	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Fluoride	1.06	mg/L	03/29/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/L	04/17/2023	EUROFINS SAV	EPA 7470
Lithium	<50	ug/L	04/05/2023	EUROFINS SAV	EPA 6010D
Molybdenum	<40	ug/L	04/05/2023	EUROFINS SAV	EPA 6010D
Lead	36.1	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
pH	3.72	SU	03/20/2023	ZDM/BSB	
Radium 226	3.26	pCi/L	04/17/2023	GEL	EPA 903.1 Mod
Radium 228	4.50	pCi/L	04/10/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	7.77	pCi/L	04/21/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Selenium	<15	ug/L	04/03/2023	EUROFINS SAV	EPA 6010D
Sulfate	761	mg/L	03/29/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	2665	mg/L	03/28/2023	KCWELLS	SM 2540C
Thallium	<1	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

 Analysis Validated:  Validation date: 05/05/2023
 Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552

Sample # AF58978 **Location:** GW Well CGYP-7 **Date:** 03/20/2023 **Sample Collector:** ZDM/BSB
Loc. Code CGYP-7 **DUP** **Time:** 10:42

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	17.9	ug/l	03/29/2023	EUROFINS SAV	EPA 6020B
Boron	11700.0	ug/l	04/10/2023	EUROFINS SAV	EPA 6010D
Barium	30.7	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Beryllium	9.79	ug/l	03/29/2023	EUROFINS SAV	EPA 6020B
Calcium	418000	mg/L	04/03/2023	EUROFINS SAV	EPA 6010D
Cadmium	0.63	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Chloride	1030	mg/L	04/01/2023	KCWELLS	EPA 300.0
Cobalt	105	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Fluoride	1.73	mg/L	03/29/2023	KCWELLS	EPA 300.0
Mercury	<0.2	ug/L	03/30/2023	EUROFINS SAV	EPA 7470
Lithium	<50	ug/L	04/05/2023	EUROFINS SAV	EPA 6010D
Molybdenum	<40	ug/L	04/05/2023	EUROFINS SAV	EPA 6010D
Lead	37.5	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Radium 226	0.872	pCi/L	04/17/2023	GEL	EPA 903.1 Mod
Radium 228	5.38	pCi/L	04/10/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	6.25	pCi/L	04/21/2023	GEL	EPA 903.1 Mod
Antimony	<5	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B
Selenium	<30	ug/L	04/03/2023	EUROFINS SAV	EPA 6010D
Sulfate	743	mg/L	04/01/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	2824	mg/L	03/28/2023	KCWELLS	SM 2540C
Thallium	<1	ug/L	03/29/2023	EUROFINS SAV	EPA 6020B

Comments: BSR Lab spiked blank acceptance criteria not met

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID# 10120; "Eurofins" - Eurofins. - Lab ID# 98001; "Pace"- Pace Analytical Services, LLC.- Lab ID# 99030, "ROGERSNCALLC"-Rogers & Callcott, Inc. - Lab ID# 23105001; "Cornwell"-Cornwell Engineering Group Laboratory-Lab ID# 93013

Qualifiers: U-Value below RL; H-Holding Time Exceeded; J-Value is Estimated; M-Matrix Interference; F1-MS and/or MSD failure

Analysis Validated:



Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66439 **Location:** GW Well PM-1 **Date:** 06/05/2023 **Sample Collector:** WJK/ML


Loc. Code PM-1 **Time:** 14:55

Analysis	Result	Units	Test Date	Analyst	Method
Aluminum	<0.1	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Arsenic	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Arsenic Dissolved	<10.0	ug/L	07/20/2023	SKJACOBS	EPA 6020B
Barium	76.6	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Calcium	12.7	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Cobalt	1.19	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Iron	11100	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Potassium	0.623	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Magnesium	0.712	mg/L	06/20/2023	SKJACOBS	EPA 6020B
Sodium	6.16	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Boron	18.4	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Zinc	13.3	ug/L	07/26/2023	LCWILLIA	EPA 6020B
Total Organic Carbon	5.69	mg/L	06/14/2023	GEL	SM 5310B
Nitrate	<0.10	mg/L	06/06/2023	KCWELLS	EPA 300.0
Fluoride	<0.10	mg/L	06/06/2023	KCWELLS	EPA 300.0
Chloride	12.4	mg/L	06/06/2023	KCWELLS	EPA 300.0
Sulfate	9.11	mg/L	06/06/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	130.0	mg/L	06/07/2023	KCWELLS	SM 2540C
Radium 226	3.47	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	0.236	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	3.70	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	5.08	SU	06/05/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date: 8/29/23

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552
Sample # AF66407 **Location:** GW Well CBW-1 **Date:** 06/06/2023 **Sample Collector:** WK/ML

Loc. Code CBW-1 **Time:** 08:59

Analysis	Result	Units	Test Date	Analyst	Method
Aluminum	0.79	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Arsenic	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Arsenic Dissolved	<10.0	ug/L	07/27/2023	TDHARRIS	EPA 6020B
Barium	38.8	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Calcium	33.9	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Cobalt	0.814	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Iron	<50.0	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Potassium	0.78	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Magnesium	2.44	mg/L	06/20/2023	SKJACOBS	EPA 6020B
Sodium	10.1	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Lead	2.55	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Boron	836	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Zinc	<10.0	ug/L	08/01/2023	SKJACOBS	EPA 6020B
Total Organic Carbon	2.17	mg/L	06/14/2023	GEL	SM 5310B
Nitrate	1.49	mg/L	06/13/2023	KCWELLS	EPA 300.0
Fluoride	0.23	mg/L	06/13/2023	KCWELLS	EPA 300.0
Chloride	3.73	mg/L	06/13/2023	KCWELLS	EPA 300.0
Sulfate	97.1	mg/L	06/13/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	178.8	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	0.968	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	4.12	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	5.08	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	4.34	SU	06/06/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:


 Linda Williams - Manager Analytical Services

Validation date: 8/29/23

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66425 Location: GW Well CGYP-1 Date: 06/06/2023 Sample Collector: WK/ML

Loc. Code CGYP-1 Time: 13:29

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	8.35	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	39.2	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	3.98	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Calcium	181	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	31.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	1.44	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	191	ug/L	07/07/2023	SKJACOBS	EPA 6010D
Lithium	7.79	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	282	mg/L	06/08/2023	KCWELLS	EPA 300.0
Chloride	679	mg/L	06/08/2023	KCWELLS	EPA 300.0
Fluoride	0.89	mg/L	06/08/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1584	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	1.32	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	2.61	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	3.94	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	4.66	SU	06/06/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66426 Location: GW Well CGYP-2 Date: 06/07/2023 Sample Collector: WJK/ML

Loc. Code CGYP-2 Time: 10:04

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	13.1	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	9.76	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	3.41	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Calcium	254	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	22.4	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	16.6	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	781	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	13.9	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	904	mg/L	06/13/2023	KCWELLS	EPA 300.0
Chloride	55.9	mg/L	06/13/2023	KCWELLS	EPA 300.0
Fluoride	0.53	mg/L	06/13/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1451	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	0.809	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	0.960	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.77	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	4.00	SU	06/07/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66427 **Location:** GW Well CGYP-2 **Date:** 06/07/2023 **Sample Collector:** WJK/ML

Loc. Code CGYP-2 DUP **Time:** 10:09

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	13.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	9.88	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	3.44	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Calcium	259	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	22.7	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	15.9	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	770	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	14.6	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	907	mg/L	06/13/2023	KCWELLS	EPA 300.0
Chloride	56.1	mg/L	06/13/2023	KCWELLS	EPA 300.0
Fluoride	0.69	mg/L	06/13/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1442	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	0.875	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	1.56	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.44	pCi/L	07/07/2023	GEL	EPA 903.1 Mod

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66428 **Location:** GW Well CGYP-3 **Date:** 06/07/2023 **Sample Collector:** WJK/ML
Loc. Code CGYP-3 **Time:** 11:35

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	11.4	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	24.3	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	22.1	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Calcium	508	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	31.1	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Chromium	8.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	18.1	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	16700	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	70.1	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	964	mg/L	06/13/2023	KCWELLS	EPA 300.0
Chloride	872	mg/L	06/13/2023	KCWELLS	EPA 300.0
Fluoride	1.60	mg/L	06/13/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	2906	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	1.16	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	4.17	pCi/L	07/03/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	5.33	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	3.67	SU	06/07/2023	WJK/ML	

Comments:
 Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:  Validation date: 08/02/2023
 Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66429 **Location:** GW Well CGYP-4 **Date:** 06/07/2023 **Sample Collector:** WJK/ML

Loc. Code CGYP-4 **Time:** 12:27

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	5.14	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	25.5	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	15.1	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Calcium	254	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	19.9	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	8.96	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/07/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	5530	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	76.6	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	538	mg/L	06/13/2023	KCWELLS	EPA 300.0
Chloride	353	mg/L	06/13/2023	KCWELLS	EPA 300.0
Fluoride	1.16	mg/L	06/13/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1445	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	0.153	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	1.51	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.67	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	4.13	SU	06/07/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66430 **Location:** GW Well CGYP-6 **Date:** 06/07/2023 **Sample Collector:** WJK/ML

Loc. Code CGYP-6 **Time:** 13:37

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Barium	204	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	27.9	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Calcium	486	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Cobalt	138	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Lead	13.2	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/07/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Boron	8850	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	181	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	129	mg/L	06/13/2023	KCWELLS	EPA 300.0
Chloride	1070	mg/L	06/13/2023	KCWELLS	EPA 300.0
Fluoride	0.68	mg/L	06/13/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	2774	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	1.16	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	4.53	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	5.69	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	3.74	SU	06/07/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552
Sample # AF66431 **Location:** GW Well CGYP-7 **Date:** 06/07/2023 **Sample Collector:** WJK/ML

Loc. Code CGYP-7 **Time:** 09:04

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	22.1	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Barium	14.7	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	7.91	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Calcium	377	mg/L	07/06/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Cobalt	17.8	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Lead	23.4	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/07/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/06/2023	SKJACOBS	EPA 6020B
Boron	11200	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	11.5	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/26/2023	EUROFINS SAV	EPA 7470
Sulfate	813	mg/L	06/13/2023	KCWELLS	EPA 300.0
Chloride	683	mg/L	06/13/2023	KCWELLS	EPA 300.0
Fluoride	0.91	mg/L	06/13/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	2355	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	2.81	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	3.78	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	6.60	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	3.92	SU	06/07/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552
Sample # AF66417 **Location:** GW Well CCMGP-1 **Date:** 06/06/2023 **Sample Collector:** WK/ML

Loc. Code CCMGP-1 **Time:** 15:45

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<5.0	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Barium	226	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Calcium	151	mg/L	07/21/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Cobalt	<0.5	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/18/2023	SKJACOBS	EPA 6020B
Boron	823	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	25.5	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	56.4	mg/L	06/08/2023	KCWELLS	EPA 300.0
Chloride	125	mg/L	06/08/2023	KCWELLS	EPA 300.0
Fluoride	0.15	mg/L	06/08/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	771.2	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	0.824	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	0.568	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.39	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	7.08	SU	06/06/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552
Sample # AF66418 **Location:** GW Well CCMGP-2 **Date:** 06/06/2023 **Sample Collector:** WK/ML

Loc. Code CCMGP-2 **Time:** 10:07

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	15.4	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	16.6	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	1.85	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Calcium	159	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	78.7	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	1.88	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	412	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	438	mg/L	06/08/2023	KCWELLS	EPA 300.0
Chloride	244	mg/L	06/08/2023	KCWELLS	EPA 300.0
Fluoride	1.16	mg/L	06/08/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1045	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	0.661	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	3.59	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	4.25	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	4.96	SU	06/06/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66419 Location: GW Well CCMGP-3 Date: 06/06/2023 Sample Collector: WK/ML

Loc. Code CCMGP-3 Time: 11:17

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	11.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	19.6	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	7.59	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Calcium	44.6	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	76.6	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	9.83	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	81.5	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	8.55	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	198	mg/L	06/08/2023	KCWELLS	EPA 300.0
Chloride	34.5	mg/L	06/08/2023	KCWELLS	EPA 300.0
Fluoride	2.69	mg/L	06/08/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	378.8	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	0.583	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	0.760	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.34	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	3.81	SU	06/06/2023	WJK/ML	

Comments:
Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:  Validation date: 08/02/2023
Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66420 **Location:** GW Well CCMGP-4 **Date:** 06/06/2023 **Sample Collector:** WK/ML

Loc. Code CCMGP-4 **Time:** 12:17

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	457	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Calcium	233	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	8.49	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Chromium	5.9	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	1950	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	15.8	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	14.6	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	48.9	mg/L	06/08/2023	KCWELLS	EPA 300.0
Chloride	283	mg/L	06/08/2023	KCWELLS	EPA 300.0
Fluoride	0.16	mg/L	06/08/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1370	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	1.26	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	0.736	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.00	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	6.39	SU	06/06/2023	WJK/ML	

Comments:
 Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:  Validation date: 08/02/2023
 Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF66421 **Location:** GW Well CCMGP-5 **Date:** 06/06/2023 **Sample Collector:** WK/ML

Loc. Code CCMGP-5 **Time:** 14:38

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Barium	660	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Calcium	66.6	mg/L	07/05/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Cobalt	5.70	ug/L	06/20/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	07/05/2023	SKJACOBS	EPA 6020B
Boron	17.9	ug/L	07/05/2023	SKJACOBS	EPA 6010D
Lithium	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	06/20/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	06/22/2023	EUROFINS SAV	EPA 7470
Sulfate	5.84	mg/L	06/08/2023	KCWELLS	EPA 300.0
Chloride	23.9	mg/L	06/08/2023	KCWELLS	EPA 300.0
Fluoride	0.12	mg/L	06/08/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	388.8	mg/L	06/14/2023	KCWELLS	SM 2540C
Radium 226	1.85	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
Radium 228	1.16	pCi/L	06/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	3.01	pCi/L	07/07/2023	GEL	EPA 903.1 Mod
pH	6.12	SU	06/06/2023	WJK/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Validation date: 08/02/2023

Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552


Sample # AF71897 **Location:** GW Well CGYP-7 **Date:** 07/19/2023 **Sample Collector:** WJK/BB
Loc. Code CGYP-7 **Time:** 10:00

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	15.2	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Barium	27.1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Beryllium	9.82	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Calcium	262000	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Cadmium	0.56	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Cobalt	61.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Lead	37.0	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Antimony	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Selenium	<20	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Thallium	<1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Boron	9810	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Lithium	15.1	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	08/15/2023	EUROFINS SAV	EPA 7470
Fluoride	0.44	mg/L	08/05/2023	KCWELLS	EPA 300.0
Chloride	648	mg/L	08/05/2023	KCWELLS	EPA 300.0
Sulfate	810	mg/L	08/05/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	2252	mg/L	08/04/2023	NTCHIN	SM 2540C
Radium 226	1.70	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
Radium 228	1.85	pCi/L	08/22/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	3.55	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
pH	3.83	SU	08/02/2023	WJK/BB	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date: 9/18/23

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF71898 **Location:** GW Well CGYP-7 **Date:** 07/19/2023 **Sample Collector:** WJK/BB
Loc. Code CGYP-7 **DUP** **Time:** 10:05

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	14.0	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Barium	26.3	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Beryllium	9.79	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Calcium	262000	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Cadmium	0.57	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Cobalt	60.6	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Lead	36.6	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Antimony	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Selenium	<20	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Thallium	<1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Boron	9470	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Lithium	14.1	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	08/15/2023	EUROFINS SAV	EPA 7470
Fluoride	0.57	mg/L	08/05/2023	KCWELLS	EPA 300.0
Chloride	676	mg/L	08/05/2023	KCWELLS	EPA 300.0
Sulfate	805	mg/L	08/05/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	2155	mg/L	08/04/2023	NTCHIN	SM 2540C
Radium 226	0.706	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
Radium 228	3.63	pCi/L	08/22/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	4.34	pCi/L	09/01/2023	GEL	EPA 903.1 Mod

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:


 Linda Williams - Manager Analytical Services

Validation date: 9/18/23

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552


Sample # AF71891 Location: GW Well CCMGP-1 Date: 07/19/2023 Sample Collector: WJK/BB
Loc. Code CCMGP-1 Time: 09:03

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<3	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Barium	301	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Beryllium	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Calcium	133000	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Cadmium	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Cobalt	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Lead	<2.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Antimony	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Selenium	<20	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Thallium	<1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Boron	475	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Lithium	21.1	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	08/15/2023	EUROFINS SAV	EPA 7470
Fluoride	0.12	mg/L	08/05/2023	KCWELLS	EPA 300.0
Chloride	108	mg/L	08/05/2023	KCWELLS	EPA 300.0
Sulfate	34.8	mg/L	08/05/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	660.0	mg/L	08/04/2023	NTCHIN	SM 2540C
Radium 226	0.970	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
Radium 228	0.128	pCi/L	08/22/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.10	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
pH	6.74	SU	08/02/2023	WJK/BB	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date:

9/18/23

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF71892 Location: GW Well CCMGP-1 Date: 07/19/2023 Sample Collector: WJK/BB

Loc. Code CCMGP-1 DUP Time: 09:08

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<3	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Barium	310	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Beryllium	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Calcium	139000	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Cadmium	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Cobalt	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Lead	<2.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Antimony	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Selenium	<20	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Thallium	<1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Boron	481	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Lithium	26.7	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	08/15/2023	EUROFINS SAV	EPA 7470
Fluoride	0.10	mg/L	08/05/2023	KCWELLS	EPA 300.0
Chloride	105	mg/L	08/05/2023	KCWELLS	EPA 300.0
Sulfate	33.4	mg/L	08/05/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	663.8	mg/L	08/04/2023	NTCHIN	SM 2540C
Radium 226	0.715	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
Radium 228	0.321	pCi/L	08/22/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.04	pCi/L	09/01/2023	GEL	EPA 903.1 Mod

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date:

9/18/23

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552


Sample # AF71893 **Location:** GW Well CCMGP-2 **Date:** 08/01/2023 **Sample Collector:** WJK/BB
Loc. Code CCMGP-2 **Time:** 10:45

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	12.0	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Barium	21.8	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Beryllium	3.18	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Calcium	73400	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Cadmium	0.82	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Cobalt	84.7	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Lead	13.4	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Antimony	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Selenium	<20	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Thallium	<1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Boron	337	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Lithium	6.75	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	08/15/2023	EUROFINS SAV	EPA 7470
Fluoride	0.94	mg/L	08/05/2023	KCWELLS	EPA 300.0
Chloride	240	mg/L	08/05/2023	KCWELLS	EPA 300.0
Sulfate	422	mg/L	08/05/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	956.2	mg/L	08/04/2023	NTCHIN	SM 2540C
Radium 226	0.700	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
Radium 228	2.34	pCi/L	08/22/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	3.04	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
pH	4.04	SU	08/01/2023	WJK/BB	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date: 9/18/23

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF71894 **Location:** GW Well CCMGP-3 **Date:** 08/01/2023 **Sample Collector:** WJK/BB
Loc. Code CCMGP-3 **Time:** 11:52

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	7.66	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Barium	30.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Beryllium	7.29	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Calcium	27400	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Cadmium	0.62	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Cobalt	60.6	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Lead	9.41	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Antimony	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Selenium	<20	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Thallium	<1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Boron	77.5	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Lithium	8.97	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	08/15/2023	EUROFINS SAV	EPA 7470
Fluoride	2.84	mg/L	08/05/2023	KCWELLS	EPA 300.0
Chloride	28.5	mg/L	08/05/2023	KCWELLS	EPA 300.0
Sulfate	205	mg/L	08/05/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	16130	mg/L	08/04/2023	NTCHIN	SM 2540C
Radium 226	0.474	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
Radium 228	0.983	pCi/L	08/22/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.46	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
pH	3.80	SU	08/01/2023	WJK/BB	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:  Validation date: 9/18/23
Linda Williams - Manager Analytical Services


SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS
LAB CERTIFICATION #08552
Sample # AF71895 Location: GW Well CCMGP-4 Date: 08/01/2023 Sample Collector: WJK/BB
Loc. Code CCMGP-4 Time: 13:17

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<3	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Barium	510	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Beryllium	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Calcium	222000	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Cadmium	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Cobalt	7.74	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Lead	<2.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Antimony	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Selenium	<20	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Thallium	<1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Boron	1670	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Lithium	16.9	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Molybdenum	6.98	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	08/15/2023	EUROFINS SAV	EPA 7470
Fluoride	0.10	mg/L	08/05/2023	KCWELLS	EPA 300.0
Chloride	273	mg/L	08/05/2023	KCWELLS	EPA 300.0
Sulfate	49.8	mg/L	08/05/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1184	mg/L	08/04/2023	NTCHIN	SM 2540C
Radium 226	0.670	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
Radium 228	1.57	pCi/L	08/22/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.24	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
pH	6.34	SU	08/01/2023	WJK/BB	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date: 9/18/23

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF71896 **Location:** GW Well CCMGP-5 **Date:** 08/01/2023 **Sample Collector:** WJK/BB
Loc. Code CCMGP-5 **Time:** 09:53

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<3	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Barium	851	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Beryllium	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Calcium	67500	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Cadmium	<0.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Cobalt	6.35	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Chromium	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Lead	<2.5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Antimony	<5	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Selenium	<20	ug/L	08/11/2023	EUROFINS SAV	EPA 6010D
Thallium	<1	ug/L	08/11/2023	EUROFINS SAV	EPA 6020B
Boron	17.2	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Lithium	6.53	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	08/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	08/15/2023	EUROFINS SAV	EPA 7470
Fluoride	0.10	mg/L	08/05/2023	KCWELLS	EPA 300.0
Chloride	27.4	mg/L	08/05/2023	KCWELLS	EPA 300.0
Sulfate	2.34	mg/L	08/05/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	312.5	mg/L	08/04/2023	NTCHIN	SM 2540C
Radium 226	2.30	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
Radium 228	-0.250	pCi/L	08/22/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.30	pCi/L	09/01/2023	GEL	EPA 903.1 Mod
pH	6.35	SU	08/01/2023	WJK/BB	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:  Validation date: 9/18/23
Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF80265 **Location:** GW Well CGYP-7 **Date:** 10/10/2023 **Sample Collector:** ZM/BB
Loc. Code CGYP-7 **Time:** 11:23

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	21.2	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Barium	25.8	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Beryllium	7.2	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Calcium	372	mg/L	10/24/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Cobalt	60.4	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Lead	40.4	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Antimony	5.8	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Boron	10100	ug/L	10/25/2023	SKJACOBS	EPA 6010D
Lithium	13.5	ug/L	10/25/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	10/25/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	10/19/2023	EUROFINS SAV	EPA 7470
Fluoride	1.70	mg/L	10/17/2023	GEL	EPA 300.0
Chloride	575	mg/L	10/19/2023	GEL	EPA 300.0
Sulfate	789	mg/L	10/19/2023	GEL	EPA 300.0
Total Dissolved Solids	2101	mg/L	10/18/2023	KCWELLS	SM 2540C
Radium 226	0.655	pCi/L	11/02/2023	GEL	EPA 903.1 Mod
Radium 228	2.93	pCi/L	10/24/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	3.58	pCi/L	11/03/2023	GEL	EPA 903.1 Mod
pH	3.63	SU	10/10/2023	ZM/BB	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:  Validation date: 11/27/23
Linda Williams - Manager Analytical Services

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES
CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF80266 **Location:** GW Well CGYP-7 **Date:** 10/10/2023 **Sample Collector:**
Loc. Code CGYP-7 **DUP** **Time:** 11:28

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	21.4	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Barium	26.1	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Beryllium	6.8	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Calcium	371	mg/L	10/24/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Cobalt	59.5	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Lead	39.9	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	10/24/2023	SKJACOBS	EPA 6020B
Boron	10100	ug/L	10/26/2023	SKJACOBS	EPA 6010D
Lithium	14.1	ug/L	10/26/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	10/26/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	10/19/2023	EUROFINS SAV	EPA 7470
Fluoride	1.67	mg/L	10/18/2023	GEL	EPA 300.0
Chloride	579	mg/L	10/19/2023	GEL	EPA 300.0
Sulfate	773	mg/L	10/19/2023	GEL	EPA 300.0
Total Dissolved Solids	2144	mg/L	10/18/2023	KCWELLS	SM 2540C
Radium 226	0.0767	pCi/L	11/02/2023	GEL	EPA 903.1 Mod
Radium 228	3.98	pCi/L	10/24/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	4.05	pCi/L	11/03/2023	GEL	EPA 903.1 Mod

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date:

11/27/23

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF81444 Location: GW Well CCMGP-1 Date: 11/08/2023 Sample Collector: ZM
Loc. Code CCMGP-1 Time: 09:29

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Barium	308	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Calcium	155	mg/L	11/29/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Cobalt	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Antimony	6.1	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Boron	517	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Lithium	25.7	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	11/30/2023	GEL	EPA 7470
Fluoride	<0.10	mg/L	11/15/2023	KCWELLS	EPA 300.0
Chloride	115	mg/L	11/15/2023	KCWELLS	EPA 300.0
Sulfate	30.8	mg/L	11/15/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	638.8	mg/L	11/13/2023	LCWILLIA	SM 2540C
Radium 226	0.865	pCi/L	11/28/2023	GEL	EPA 903.1 Mod
Radium 228	1.29	pCi/L	11/20/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.15	pCi/L	12/01/2023	GEL	EPA 903.1 Mod
pH	6.78	SU	11/08/2023	ZM/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:


Linda Williams - Manager Analytical Services

Validation date: 12/12/23

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF81445 Location: GW Well CCMGP-1 Date: 11/08/2023 Sample Collector: ZM
Loc. Code CCMGP-1 DUP Time: 09:34

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Barium	309	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Calcium	150	mg/L	11/29/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Cobalt	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Boron	538	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Lithium	26.1	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	11/30/2023	GEL	EPA 7470
Fluoride	<0.10	mg/L	11/15/2023	KCWELLS	EPA 300.0
Chloride	114	mg/L	11/15/2023	KCWELLS	EPA 300.0
Sulfate	29.8	mg/L	11/15/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	623.8	mg/L	11/13/2023	LCWILLIA	SM 2540C
Radium 226	1.10	pCi/L	11/28/2023	GEL	EPA 903.1 Mod
Radium 228	-0.612	pCi/L	11/20/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.10	pCi/L	12/01/2023	GEL	EPA 903.1 Mod

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date: 12/12/23

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF81446 Location: GW Well CCMGP-2 Date: 11/08/2023 Sample Collector: ZM
Loc. Code CCMGP-2 Time: 12:29

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	6.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Barium	41.4	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Calcium	212	mg/L	11/29/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Cobalt	10.1	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Boron	668	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Lithium	<5.0	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Mercury	0.470	ug/L	11/30/2023	GEL	EPA 7470
Fluoride	<0.10	mg/L	11/15/2023	KCWELLS	EPA 300.0
Chloride	482	mg/L	11/15/2023	KCWELLS	EPA 300.0
Sulfate	89.6	mg/L	11/15/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1236	mg/L	11/13/2023	LCWILLIA	SM 2540C
Radium 226	0.623	pCi/L	11/28/2023	GEL	EPA 903.1 Mod
Radium 228	1.52	pCi/L	11/20/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.14	pCi/L	12/01/2023	GEL	EPA 903.1 Mod
pH	5.73	SU	11/08/2023	ZM/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:  Validation date: 12/12/23
Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552


Sample # AF81447 **Location:** GW Well CCMGP-3 **Date:** 11/08/2023 **Sample Collector:** ZM
Loc. Code CCMGP-3 **Time:** 10:39

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	13.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Barium	28.1	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Beryllium	4.18	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Calcium	44.7	mg/L	11/29/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Cobalt	49.6	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Lead	13.2	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Boron	113	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Lithium	7.33	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	11/30/2023	GEL	EPA 7470
Fluoride	1.86	mg/L	11/15/2023	KCWELLS	EPA 300.0
Chloride	29.8	mg/L	11/15/2023	KCWELLS	EPA 300.0
Sulfate	251	mg/L	11/15/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	423.8	mg/L	11/13/2023	LCWILLIA	SM 2540C
Radium 226	0.935	pCi/L	11/28/2023	GEL	EPA 903.1 Mod
Radium 228	1.39	pCi/L	11/20/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	2.33	pCi/L	12/01/2023	GEL	EPA 903.1 Mod
pH	3.62	SU	11/08/2023	ZM/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date:

12/12/23

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS


LAB CERTIFICATION #08552

Sample # AF81448 Location: GW Well CCMGP-4 Date: 11/07/2023 Sample Collector: ZM
Loc. Code CCMGP-4 Time: 11:35

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Barium	435	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Calcium	201	mg/L	11/29/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Cobalt	7.2	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Boron	1340	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Lithium	11.8	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Molybdenum	5.21	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	11/30/2023	GEL	EPA 7470
Fluoride	<0.10	mg/L	11/15/2023	KCWELLS	EPA 300.0
Chloride	256	mg/L	11/15/2023	KCWELLS	EPA 300.0
Sulfate	31.1	mg/L	11/15/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	927.5	mg/L	11/13/2023	LCWILLIA	SM 2540C
Radium 226	1.60	pCi/L	11/28/2023	GEL	EPA 903.1 Mod
Radium 228	1.80	pCi/L	11/20/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	3.40	pCi/L	12/01/2023	GEL	EPA 903.1 Mod
pH	6.13	SU	11/08/2023	ZM/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:  Validation date: 12/12/23
Linda Williams - Manager Analytical Services

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF81449 Location: GW Well CCMGP-5 Date: 11/07/2023 Sample Collector: ZM
Loc. Code CCMGP-5 Time: 14:06

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Barium	345	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Beryllium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Calcium	67.9	mg/L	11/29/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Cobalt	2.5	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Lead	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	11/29/2023	SKJACOBS	EPA 6020B
Boron	15.8	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Lithium	6.74	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	11/28/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	11/30/2023	GEL	EPA 7470
Fluoride	<0.10	mg/L	11/15/2023	KCWELLS	EPA 300.0
Chloride	23.6	mg/L	11/15/2023	KCWELLS	EPA 300.0
Sulfate	2.55	mg/L	11/15/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	248.8	mg/L	11/13/2023	LCWILLIA	SM 2540C
Radium 226	1.20	pCi/L	11/28/2023	GEL	EPA 903.1 Mod
Radium 228	-0.349	pCi/L	11/20/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	1.20	pCi/L	12/01/2023	GEL	EPA 903.1 Mod
pH	6.52	SU	11/07/2023	ZM/ML	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date: 12/12/23

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552


Sample # AF84383 Location: GW Well CGYP-7 Date: 12/05/2023 Sample Collector: ZM/BB
Loc. Code CGYP-7 Time: 13:26

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	20.6	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Barium	25.6	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Beryllium	6.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Calcium	345	mg/L	12/07/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Cobalt	53.5	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Lead	36.3	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Boron	10100	ug/L	12/12/2023	SKJACOBS	EPA 6010D
Lithium	7.32	ug/L	12/12/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	12/12/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	12/13/2023	EUROFINS SAV	EPA 7470
Fluoride	0.96	mg/L	12/20/2023	KCWELLS	EPA 300.0
Chloride	638	mg/L	12/20/2023	KCWELLS	EPA 300.0
Sulfate	782	mg/L	12/20/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1935	mg/L	12/12/2023	KCWELLS	SM 2540C
Radium 226	0.797	pCi/L	01/02/2024	GEL	EPA 903.1 Mod
Radium 228	4.72	pCi/L	12/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	5.52	pCi/L	01/04/2024	GEL	EPA 903.1 Mod
pH	3.90	SU	12/05/2023	ZM/BB	

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date: 1/10/24

Authorized Signature Only- Not Valid Unless Signed

SANTEE COOPER ANALYTICAL SERVICES

CERTIFICATE OF ANALYSIS

LAB CERTIFICATION #08552

Sample # AF84384 **Location:** GW Well CGYP-7 **Date:** 12/05/2023 **Sample Collector:** ZM/BB
Loc. Code CGYP-7 **DUP** **Time:** 13:31

Analysis	Result	Units	Test Date	Analyst	Method
Arsenic	20.8	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Barium	26.1	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Beryllium	6.2	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Calcium	371	mg/L	12/07/2023	SKJACOBS	EPA 6020B
Cadmium	<0.5	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Cobalt	54.5	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Chromium	<5.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Lead	37.3	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Antimony	<5.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Selenium	<10.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Thallium	<1.0	ug/L	12/07/2023	SKJACOBS	EPA 6020B
Boron	10200	ug/L	12/12/2023	SKJACOBS	EPA 6010D
Lithium	7.06	ug/L	12/12/2023	SKJACOBS	EPA 6010D
Molybdenum	<5.0	ug/L	12/12/2023	SKJACOBS	EPA 6010D
Mercury	<0.2	ug/L	12/13/2023	EUROFINS SAV	EPA 7470
Fluoride	0.92	mg/L	12/20/2023	KCWELLS	EPA 300.0
Chloride	620	mg/L	12/20/2023	KCWELLS	EPA 300.0
Sulfate	755	mg/L	12/20/2023	KCWELLS	EPA 300.0
Total Dissolved Solids	1995	mg/L	12/12/2023	KCWELLS	SM 2540C
Radium 226	1.12	pCi/L	01/02/2024	GEL	EPA 903.1 Mod
Radium 228	3.55	pCi/L	12/29/2023	GEL	EPA 904.0
Radium 226/228 Combined Calculation	4.67	pCi/L	01/04/2024	GEL	EPA 903.1 Mod

Comments:

Independent Laboratory Results: "GEL" - GEL Laboratories LLC - Lab ID # 10120; "Test America" - TestAmerica Laboratories, Inc. - Lab ID# 98001; "DavisBrown"- Davis & Brown Lab ID # 21117; "Shealy"- Shealy Environmental Services, Inc.- Lab ID# 32010 "ROGERSCALLCO"- Rogers & Callcot, Inc.- Lab ID # 23105001

Analysis Validated:



Linda Williams - Manager Analytical Services

Validation date: 1/10/24



February 24, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 608830

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on January 27, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Heather Millar for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 608830 GEL Work Order: 608830

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by

Heather Millar

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54572 Project: SOOP00119
Sample ID: 608830001 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 24-JAN-23 11:46
Receive Date: 27-JAN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.15	+/-1.31	2.19	3.00	pCi/L		JE1	02/23/23	1238	2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.66	+/-1.33			pCi/L		1 NXL1	02/24/23	0841	2377478	2
Rad Radium-226 Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.509	+/-0.247	0.268	1.00	pCi/L		LXP1	02/22/23	1035	2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			73.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54597	Project: SOOP00119
Sample ID: 608830002	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 24-JAN-23 15:40	
Receive Date: 27-JAN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	-0.247	+/-1.23	2.36	3.00	pCi/L			JE1	02/23/23	1238 2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.518	+/-1.27			pCi/L		1	NXL1	02/24/23	0841 2377478	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.518	+/-0.298	0.386	1.00	pCi/L			LXP1	02/22/23	1035 2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			75.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54598 Project: SOOP00119
Sample ID: 608830003 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 24-JAN-23 13:27
Receive Date: 27-JAN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	-0.766	+/-1.10	2.32	3.00	pCi/L		JE1	02/23/23	1238	2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.507	+/-1.14			pCi/L		1 NXL1	02/24/23	0841	2377478	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.507	+/-0.292	0.367	1.00	pCi/L		LXP1	02/22/23	1035	2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			69.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54600	Project: SOOP00119
Sample ID: 608830004	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 24-JAN-23 10:18	
Receive Date: 27-JAN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.79	+/-1.47	2.35	3.00	pCi/L			JE1	02/23/23	1238 2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.63	+/-1.52			pCi/L		1	NXL1	02/24/23	0841 2377478	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.845	+/-0.355	0.372	1.00	pCi/L			LXP1	02/22/23	1035 2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			63.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54595 Project: SOOP00119
Sample ID: 608830005 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 25-JAN-23 11:00
Receive Date: 27-JAN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.37	+/-1.42	2.36	3.00	pCi/L			JE1	02/23/23	1238 2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.01	+/-1.46			pCi/L		1	NXL1	02/24/23	0841 2377478	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.638	+/-0.331	0.407	1.00	pCi/L			LXP1	02/22/23	1106 2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			80.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54596 Project: SOOP00119
Sample ID: 608830006 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 25-JAN-23 09:54
Receive Date: 27-JAN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.906	+/-1.36	2.35	3.00	pCi/L		JE1	02/23/23	1238	2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.27	+/-1.38			pCi/L		1 NXL1	02/24/23	0841	2377478	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.364	+/-0.222	0.232	1.00	pCi/L		LXP1	02/22/23	1106	2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			79.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54593	Project: SOOP00119
Sample ID: 608830007	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 26-JAN-23 09:38	
Receive Date: 27-JAN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.06	+/-1.49	2.56	3.00	pCi/L			JE1	02/23/23	1238 2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.42	+/-1.51			pCi/L		1	NXL1	02/24/23	0841 2377478	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.358	+/-0.222	0.263	1.00	pCi/L			LXP1	02/22/23	1106 2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			55.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54594	Project: SOOP00119
Sample ID: 608830008	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 26-JAN-23 09:43	
Receive Date: 27-JAN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.08	+/-1.29	2.18	3.00	pCi/L			JE1	02/23/23	1238 2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.43	+/-1.31			pCi/L		1	NXL1	02/24/23	0841 2377478	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.354	+/-0.240	0.271	1.00	pCi/L			LXP1	02/22/23	1106 2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			67.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54582 Project: SOOP00119
Sample ID: 608830009 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 26-JAN-23 11:19
Receive Date: 27-JAN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting GFPC, Ra228, Liquid "As Received"												
Radium-228	U	-1.13	+/-1.04	2.28	3.00	pCi/L			JE1	02/23/23	1238 2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.439	+/-1.07			pCi/L		1	NXL1	02/24/23	0841 2377478	2
Rad Radium-226 Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.439	+/-0.236	0.224	1.00	pCi/L			LXP1	02/22/23	1106 2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			74.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 24, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54583 Project: SOOP00119
Sample ID: 608830010 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 26-JAN-23 13:00
Receive Date: 27-JAN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.21	+/-1.33	2.22	3.00	pCi/L		JE1	02/23/23	1238	2377480	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.66	+/-1.35			pCi/L		1 NXL1	02/24/23	0841	2377478	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.443	+/-0.243	0.265	1.00	pCi/L		LXP1	02/22/23	1106	2377434	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			73.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: February 24, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 608830

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2377480										
QC1205310041	608830001	DUP									
Radium-228	U	1.15	U	2.38	pCi/L	N/A		N/A	JE1	02/23/23	12:37
	Uncertainty	+/-1.31		+/-1.62							
QC1205310042	LCS										
Radium-228	63.5			66.1	pCi/L		104	(75%-125%)		02/23/23	12:38
	Uncertainty			+/-5.06							
QC1205310040	MB										
Radium-228			U	0.177	pCi/L					02/23/23	12:37
	Uncertainty			+/-1.21							
Rad Ra-226											
Batch	2377434										
QC1205309937	608830001	DUP									
Radium-226			U	0.258	pCi/L	65.6		(0% - 100%)	LXP1	02/22/23	11:38
	Uncertainty	+/-0.247		+/-0.217							
QC1205309939	LCS										
Radium-226	26.6			22.1	pCi/L		83.3	(75%-125%)		02/22/23	11:38
	Uncertainty			+/-1.48							
QC1205309936	MB										
Radium-226			U	0.137	pCi/L					02/22/23	11:38
	Uncertainty			+/-0.269							
QC1205309938	608830001	MS									
Radium-226	133	0.509		102	pCi/L		75.8	(75%-125%)		02/22/23	11:38
	Uncertainty	+/-0.247		+/-7.91							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 608830

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 608830**

Product: Radium-226+Radium-228 Calculation

Analytical Method: Calculation

Analytical Procedure: GL-RAD-D-003 REV# 45

Analytical Batch: 2377478

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
608830001	AF54572
608830002	AF54597
608830003	AF54598
608830004	AF54600
608830005	AF54595
608830006	AF54596
608830007	AF54593
608830008	AF54594
608830009	AF54582
608830010	AF54583

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2377480

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
608830001	AF54572
608830002	AF54597
608830003	AF54598
608830004	AF54600
608830005	AF54595
608830006	AF54596
608830007	AF54593
608830008	AF54594
608830009	AF54582

608830010	AF54583
1205310040	Method Blank (MB)
1205310041	608830001(AF54572) Sample Duplicate (DUP)
1205310042	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2377434

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
608830001	AF54572
608830002	AF54597
608830003	AF54598
608830004	AF54600
608830005	AF54595
608830006	AF54596
608830007	AF54593
608830008	AF54594
608830009	AF54582
608830010	AF54583
1205309936	Method Blank (MB)
1205309937	608830001(AF54572) Sample Duplicate (DUP)
1205309938	608830001(AF54572) Matrix Spike (MS)
1205309939	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.


Miscellaneous Information

Additional Comments

The matrix spike, 1205309938 (AF54572MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.



Chain of Custody

Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone: (843)761-8000 Ext. 5148
Fax: (843)761-4175

608826 / 608830
Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LCWILLIA @santecooper.com

125915 / JM02.08.601.1 / 36500

Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	TOC / DOC	TOTAL BICARB ALK	SULFIDE	*TOTAL CHL. RAD 226/228
AF54599	CLFIB-5D	1/24/23	1438	BSB CDM	1	G	G	GW	3/1	→ THIS SAMPLE NEEDS TOC ONLY.	X			
AF54572	CBW-1		1146	MDS CDM	6	G+ P	G	GW	*		2	1	1	2
AF54597	CLFIB-4		1540							* PRESERVATIVES: TOC H2SO4				
AF54598	CLFIB-5		1327							SULFIDE FINE ACETATE, NaOH RAD HNO3				
AF54600	PM-1		1018							<4°C				
AF54595	CLFIB-2	1/25/23	1100	ZDM MDG						ALKAL - TOTAL, BICARB + CARB				
AF54596	CLFIB-3		0954											
AF54593	CLFIB-1	1/26/23	0938							* SULFIDE HAS SHORT HOLD.				
AF54594	CLFIB-1 DUP		0943											
AF54582	CCMLF-1		1119											

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	1/27/23	0958	<i>GEL</i>	GEL	1/27/23	0958
<i>SJB</i>	666	1/28/23	1545	<i>Theresa Tate</i>	GEL	1/27/23	1555

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

RAD 2/27/23

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 6 / 23 Send report to lcwillia@santecooper.com & sjbrown@santecooper.com



Santee Cooper
One Riverwood Drive
Monks Corner, SC 29461
Phone: (843)761-8000 Ext. 5148
Fax: (843)761-4175

Chain of Custody

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.08.GW1.1 / 36500 Rerun request for any flagged QC: Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	TOC/DOC	TOTAL ALK BICARB/CARB	SULFIDE	Rad 226/228	TOTAL CALC
AF54583	CCMLF-ID	1/26/23	1300	EDM MDG	6	G+ P	G	GW	*	* PRESERVATIVES: • Method # • Reporting limit • Misc. sample info • Any other notes TOC H2SO4 SULFIDE ZINC ACETATE, NaOH RAD HNO3 <4°C ALK - TOTAL, BICARB + CARB * SULFIDE HAS SHORT HOLD.	2	1	1	2	

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	1/27/23	0958	<i>GEL</i>	GEL	1/27/23	0958
<i>GEL</i>	661	1-27-23	1555	<i>Thyasa Jackson</i>	GEL	1-27-23	1555

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: SOOP SDG/AR/COC/Work Order: 608826/608830 S.R.

Received By: Thyasia Tatum Date Received: 1-27-23

Carrier and Tracking Number

Circle Applicable:
 FedEx Express FedEx Ground UPS Field Services Courier Other

Suspected Hazard Information Yes No *If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.

A) Shipped as a DOT Hazardous? Hazard Class Shipped: UN#: If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___

B) Did the client designate the samples are to be received as radioactive? COC notation or radioactive stickers on containers equal client designation.

C) Did the RSO classify the samples as radioactive? Maximum Net Counts Observed* (Observed Counts - Area Background Counts): 0 CPM / mR/Hr
 Classified as: Rad 1 Rad 2 Rad 3

D) Did the client designate samples are hazardous? COC notation or hazard labels on containers equal client designation.

E) Did the RSO identify possible hazards? If D or E is yes, select Hazards below.
 PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:

Sample Receipt Criteria	Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1 Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2 Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Preservation Method: <u>Wet Ice</u> Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius TEMP: <u>2C</u>
4 Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Temperature Device Serial #: <u>IR2-20</u> Secondary Temperature Device Serial # (If Applicable):
5 Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6 Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Sample ID's and Containers Affected:
7 Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	If Preservation added, Lot#:
				<input checked="" type="checkbox"/> Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)
				Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
8 Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and tests affected:
9 Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and containers affected:
10 Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11 Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12 Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
13 COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

PM (or PMA) review: Initials MM Date 1/30/23 Page 1 of 1

List of current GEL Certifications as of 24 February 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



February 13, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 609427

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on February 03, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Jessica Ward for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 609427 GEL Work Order: 609427

The Qualifiers in this report are defined as follows:

U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

J Value is estimated

* A quality control analyte recovery is outside of specified acceptance criteria

** Analyte is a surrogate compound

** Analyte is a Tracer compound

J See case narrative for an explanation

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by _____



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54602 Project: SOOP00119
Sample ID: 609427001 Client ID: SOOP001
Matrix: GW
Collect Date: 30-JAN-23 11:26
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		1.92	0.330	1.00	mg/L		1	RM3	02/06/23	1925	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1952	2379521	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		246	1.81	5.00	mg/L			EK1	02/10/23	1250	2382176	3
Bicarbonate alkalinity (CaCO3)		246	1.81	5.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.81	5.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54602 (DOC) Project: SOOP00119
Sample ID: 609427002 Client ID: SOOP001
Matrix: GW
Collect Date: 30-JAN-23 11:26
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		1.93	0.330	1.00	mg/L		1	TSM	02/08/23	1415	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54604
Sample ID: 609427003
Matrix: GW
Collect Date: 30-JAN-23 09:37
Receive Date: 03-FEB-23
Collector: Client
Project: SOOP00119
Client ID: SOOP001

Table with 12 columns: Parameter, Qualifier, Result, DL, RL, Units, PF, DF, Analyst Date, Time Batch, Method. Rows include Carbon Analysis (SM 5310 B Total Organic Carbon), Spectrometric Analysis (SM 4500-S(2-) D Sulfide), and Titration and Ion Analysis (SM 2320B Total Alkalinity).

The following Analytical Methods were performed:

Table with 3 columns: Method, Description, Analyst Comments. Rows list methods 1 (SM 5310 B), 2 (SM 4500-S (2-) D), and 3 (SM 2320B).

Notes:

Column headers are defined as follows:

- DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54604 (DOC) Project: SOOP00119
Sample ID: 609427004 Client ID: SOOP001
Matrix: GW
Collect Date: 30-JAN-23 09:37
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		2.47	0.330	1.00	mg/L		1	TSM	02/08/23	1515	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54607 Project: SOOP00119
Sample ID: 609427005 Client ID: SOOP001
Matrix: GW
Collect Date: 30-JAN-23 14:10
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		1.64	0.330	1.00	mg/L		1	RM3	02/06/23	2106	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1953	2379521	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		185	1.45	4.00	mg/L			EK1	02/10/23	1309	2382176	3
Bicarbonate alkalinity (CaCO3)		185	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54607 (DOC) Project: SOOP00119
Sample ID: 609427006 Client ID: SOOP001
Matrix: GW
Collect Date: 30-JAN-23 14:10
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		1.45	0.330	1.00	mg/L		1	TSM	02/08/23	1535	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54603 Project: SOOP00119
Sample ID: 609427007 Client ID: SOOP001
Matrix: GW
Collect Date: 30-JAN-23 13:08
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.41	0.330	1.00	mg/L		1	RM3	02/06/23	2128	2379317	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54570 Project: SOOP00119
Sample ID: 609427008 Client ID: SOOP001
Matrix: GW
Collect Date: 31-JAN-23 12:49
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		11.1	0.330	1.00	mg/L		1	RM3	02/06/23	2149	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1954	2379521	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		39.4	1.45	4.00	mg/L			EK1	02/10/23	1315	2382176	3
Bicarbonate alkalinity (CaCO3)		39.4	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54570 (DOC) Project: SOOP00119
Sample ID: 609427009 Client ID: SOOP001
Matrix: GW
Collect Date: 31-JAN-23 12:49
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		10.2	0.330	1.00	mg/L		1	TSM	02/08/23	1557	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54601 Project: SOOP00119
Sample ID: 609427010 Client ID: SOOP001
Matrix: GW
Collect Date: 31-JAN-23 11:17
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		3.01	0.330	1.00	mg/L		1	RM3	02/06/23	2210	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1954	2379521	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		469	1.45	4.00	mg/L			EK1	02/10/23	1318	2382176	3
Bicarbonate alkalinity (CaCO3)		469	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54601 (DOC) Project: SOOP00119
Sample ID: 609427011 Client ID: SOOP001
Matrix: GW
Collect Date: 31-JAN-23 11:17
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		2.75	0.330	1.00	mg/L		1	TSM	02/08/23	1617	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54605 Project: SOOP00119
Sample ID: 609427012 Client ID: SOOP001
Matrix: GW
Collect Date: 31-JAN-23 09:40
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.683	0.330	1.00	mg/L		1	RM3	02/06/23	2230	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1955	2379521	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		9.60	1.45	4.00	mg/L			EK1	02/10/23	1321	2382176	3
Bicarbonate alkalinity (CaCO3)		9.60	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54605 (DOC) Project: SOOP00119
Sample ID: 609427013 Client ID: SOOP001
Matrix: GW
Collect Date: 31-JAN-23 09:40
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average	J	0.803	0.330	1.00	mg/L		1	TSM	02/08/23	1658	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54606 Project: SOOP00119
Sample ID: 609427014 Client ID: SOOP001
Matrix: GW
Collect Date: 31-JAN-23 09:45
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.359	0.330	1.00	mg/L		1	RM3	02/06/23	2250	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1841	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		10.8	1.45	4.00	mg/L			EK1	02/10/23	1323	2382176	3
Bicarbonate alkalinity (CaCO3)		10.8	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54606 (DOC) Project: SOOP00119
Sample ID: 609427015 Client ID: SOOP001
Matrix: GW
Collect Date: 31-JAN-23 09:45
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average	J	0.558	0.330	1.00	mg/L		1	TSM	02/08/23	1718	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: February 13, 2023

Page 1 of 4

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 609427

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch 2379317											
QC1205312930	609427001	DUP									
Total Organic Carbon Average		1.92		1.97	mg/L	2.47 ^		(+/-1.00)	RM3	02/06/23	19:45
QC1205312932	609445003	DUP									
Total Organic Carbon Average		3.57		3.56	mg/L	0.224 ^		(+/-1.00)		02/06/23	23:52
QC1205312929	LCS										
Total Organic Carbon Average	10.0			9.55	mg/L		95.5	(80%-120%)		02/06/23	18:55
QC1205312928	MB										
Total Organic Carbon Average			U	ND	mg/L					02/06/23	18:45
QC1205312931	609427001	PS									
Total Organic Carbon Average	10.0	1.92		11.6	mg/L		96.8	(65%-120%)		02/06/23	20:06
QC1205312933	609445003	PS									
Total Organic Carbon Average	10.0	3.57		12.4	mg/L		88.6	(65%-120%)		02/07/23	00:15
Batch 2379995											
QC1205312846	609445012	DUP									
Dissolved Organic Carbon Average		3.13		3.00	mg/L	4.18 ^		(+/-1.00)	TSM	02/08/23	19:51
QC1205312847	609427002	DUP									
Dissolved Organic Carbon Average		1.93		1.92	mg/L	0.728 ^		(+/-1.00)		02/08/23	14:35
QC1205313808	FLT B										
Dissolved Organic Carbon Average			U	ND	mg/L					02/08/23	13:52
QC1205314036	LCS										
Dissolved Organic Carbon Average	10.0			9.93	mg/L		99.3	(80%-120%)		02/08/23	14:02

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 609427

Page 2 of 4

Paramname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch	2379995										
QC1205314035		MB									
Dissolved Organic Carbon Average			U	ND	mg/L				TSM	02/08/23	13:43
QC1205312848	609445012	PS									
Dissolved Organic Carbon Average	10.0		3.13	12.1	mg/L		89.4	(65%-120%)		02/08/23	20:13
QC1205312849	609427002	PS									
Dissolved Organic Carbon Average	10.0		1.93	11.9	mg/L		100	(65%-120%)		02/08/23	14:55
Spectrometric Analysis											
Batch	2379521										
QC1205313136		LCS									
Total Sulfide	0.400			0.401	mg/L		100	(85%-115%)	HH2	02/06/23	19:38
QC1205313135		MB									
Total Sulfide			U	ND	mg/L					02/06/23	19:36
QC1205313139	609276004	PS									
Total Sulfide	0.400	U	ND	0.354	mg/L		88.1	(75%-125%)		02/06/23	19:43
QC1205313140	609276004	PSD									
Total Sulfide	0.400	U	ND	0.358	mg/L	1	89	(0%-15%)		02/06/23	19:43
Batch	2379523										
QC1205313148		LCS									
Total Sulfide	0.400			0.399	mg/L		99.7	(85%-115%)	HH2	02/06/23	18:38
QC1205313147		MB									
Total Sulfide			U	ND	mg/L					02/06/23	18:37
QC1205313151	609445017	PS									
Total Sulfide	0.400	U	ND	0.208	mg/L		51.9*	(75%-125%)		02/06/23	18:47

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 609427

Page 3 of 4

Paramname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Spectrometric Analysis											
Batch	2379523										
QC1205313152	609445017	PSD									
Total Sulfide	0.400	U	ND	0.208	mg/L	0	51.9*	(0%-15%)	HH2	02/06/23	18:47
Titration and Ion Analysis											
Batch	2382176										
QC1205317754	609427001	DUP									
Alkalinity, Total as CaCO3			246	247	mg/L	0.203		(0%-20%)	EK1	02/10/23	12:58
Bicarbonate alkalinity (CaCO3)			246	247	mg/L	0.203		(0%-20%)			
Carbonate alkalinity (CaCO3)	U		ND	U	ND	mg/L	N/A				
QC1205317756	609445007	DUP									
Alkalinity, Total as CaCO3			191	191	mg/L	0.131		(0%-20%)		02/10/23	13:42
Bicarbonate alkalinity (CaCO3)			191	191	mg/L	0.131		(0%-20%)			
Carbonate alkalinity (CaCO3)	U		ND	U	ND	mg/L	N/A				
QC1205317753	LCS										
Alkalinity, Total as CaCO3	100			104	mg/L		104	(90%-110%)		02/10/23	12:41
QC1205317755	609427001	MS									
Alkalinity, Total as CaCO3	125		246	377	mg/L		104	(80%-120%)		02/10/23	13:02
QC1205317757	609445007	MS									
Alkalinity, Total as CaCO3	125		191	319	mg/L		102	(80%-120%)		02/10/23	13:45

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 609427

Page 4 of 4

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
H											
<											
>											
h											
R											
Z											
d											
^											
N/A											
ND											
NJ											
E											
Q											
NI											
R											
B											
e											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**General Chemistry
Technical Case Narrative
Santee Cooper
SDG #: 609427**

Product: Carbon, Total Organic
Analytical Method: SM 5310 B
Analytical Procedure: GL-GC-E-093 REV# 21
Analytical Batch: 2379317

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609427001	AF54602
609427003	AF54604
609427005	AF54607
609427007	AF54603
609427008	AF54570
609427010	AF54601
609427012	AF54605
609427014	AF54606
1205312928	Method Blank (MB)
1205312929	Laboratory Control Sample (LCS)
1205312930	609427001(AF54602) Sample Duplicate (DUP)
1205312931	609427001(AF54602) Post Spike (PS)
1205312932	609445003(AF54560) Sample Duplicate (DUP)
1205312933	609445003(AF54560) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Carbon, Dissolved Organic
Analytical Method: SM 5310 B
Analytical Procedure: GL-GC-E-093 REV# 21
Analytical Batch: 2379995

Filtration Method: EPA 160
Filtration Procedure: GL-LB-E-034 REV# 4
Filtration Batch: 2379287

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609427002	AF54602 (DOC)
609427004	AF54604 (DOC)
609427006	AF54607 (DOC)

609427009	AF54570 (DOC)
609427011	AF54601 (DOC)
609427013	AF54605 (DOC)
609427015	AF54606 (DOC)
1205312846	609445012(AF54564 (DOC)) Sample Duplicate (DUP)
1205312847	609427002(AF54602 (DOC)) Sample Duplicate (DUP)
1205312848	609445012(AF54564 (DOC)) Post Spike (PS)
1205312849	609427002(AF54602 (DOC)) Post Spike (PS)
1205313808	Filtration Blank (FLTB)
1205314035	Method Blank (MB)
1205314036	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

Container scanning event for custody missed, however all samples was in the custody of the Analyst at the time of analysis.

Product: Sulfide, Total

Analytical Method: SM 4500-S (2-) D

Analytical Procedure: GL-GC-E-052 REV# 12

Analytical Batch: 2379521

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609427001	AF54602
609427003	AF54604
609427005	AF54607
609427008	AF54570
609427010	AF54601
609427012	AF54605
1205313135	Method Blank (MB)
1205313136	Laboratory Control Sample (LCS)
1205313139	609276004(NonSDG) Post Spike (PS)
1205313140	609276004(NonSDG) Post Spike Duplicate (PSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Sulfide, Total

Analytical Method: SM 4500-S (2-) D
Analytical Procedure: GL-GC-E-052 REV# 12
Analytical Batch: 2379523

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609427014	AF54606
1205313147	Method Blank (MB)
1205313148	Laboratory Control Sample (LCS)
1205313151	609445017(AF54567) Post Spike (PS)
1205313152	609445017(AF54567) Post Spike Duplicate (PSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Matrix Spike (MS)/Post Spike (PS) Recovery Statement

The percent recoveries (%R) obtained from the spike analyses are evaluated when the sample concentration is less than four times (4X) the spike concentration added. The matrix spike recovered outside of the established acceptance limits due to matrix interference and/or non-homogeneity.

Analyte	Sample	Value
Total Sulfide	1205313151 (AF54567PS) and 1205313152 (AF54567PSD)	51.9* (75%-125%)

Product: Alkalinity

Analytical Method: SM 2320B
Analytical Procedure: GL-GC-E-033 REV# 14
Analytical Batch: 2382176

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609427001	AF54602
609427003	AF54604
609427005	AF54607
609427008	AF54570
609427010	AF54601
609427012	AF54605
609427014	AF54606
1205317753	Laboratory Control Sample (LCS)
1205317754	609427001(AF54602) Sample Duplicate (DUP)
1205317755	609427001(AF54602) Matrix Spike (MS)
1205317756	609445007(AF54562) Sample Duplicate (DUP)
1205317757	609445007(AF54562) Matrix Spike (MS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

40 mL aliquots used due to sample availability; low pH values verified by pH strip 1205317754 (AF54602DUP), 1205317755 (AF54602MS), 1205317756 (AF54562DUP), 1205317757 (AF54562MS) and 609427001 (AF54602).

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.



Chain of Custody

609427/609440

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LCWILLIA @santecooper.com _____ / _____ / _____ 125915 / JM02.09.G01-1 / 36500 Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	TOC/DOC	TOTAL ALK BICARB CARB	SULFIDE	RAD 226/228	TOTAL GCLC
AF 54602	POZ-4	1/30/23	1126	ZDM BSB	6	G P	G	GW	*	* SULFIDE HAS SHORT HOLD	2	1	1	2	
AF 54604	POZ-6		0937												
↓ 7	POZ-8		1410												
AF 54603	POZ-5D	1/30/23	1308		1	G	G	GW	3/1	→ THIS SAMPLE NEEDS TOC ONLY.	1				
AF 54570	CAP-13	1/31/23	1249		6	G P	G		*	* PRESERVATIVES TOC H2SO4	2	1	1	2	
AF 54601	POZ-3		1117							SULFIDE ZINC ACETATE, NaOH RAD #NO3 <4°C					
↓ 05	POZ-7		0940												
↓ 06	POZ-7 DUP		0945							ALKAL-TOTAL, BICARB, CARB					

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	2/3/23	0947	<i>[Signature]</i>	GEL	2/3/23	0947
<i>[Signature]</i>	666	2/3/23	1520	<i>[Signature]</i>	GEL	2/3/23	1530

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code: 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: SCOOP SDG/AR/COC/Work Order: 609427 / 609440
Received By: JW Date Received: 2/3/23
Carrier and Tracking Number: _____
Circle Applicable: FedEx Express FedEx Ground UPS Field Services Courier Other
Suspected Hazard Information: Yes No *If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous? Yes No Hazard Class Shipped: _____ UN#: _____
If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive? Yes No COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive? Yes No Maximum Net Counts Observed* (Observed Counts - Area Background Counts): 0 CPM / mR/Hr
Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous? Yes No COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards? Yes No If D or E is yes, select Hazards below.
PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:

Sample Receipt Criteria		Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Preservation Method: Wet Ice Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius TEMP: _____
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Temperature Device Serial #: <u>IR2-21</u> Secondary Temperature Device Serial # (If Applicable):
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#:
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and tests affected:
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and containers affected:
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

PM (or PMA) review: Initials HW Date 2/4/23 Page 1 of 1

List of current GEL Certifications as of 13 February 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



March 03, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 609440

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on February 03, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Heather Millar for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 609440 GEL Work Order: 609440

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by

Heather Millar

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 3, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54602	Project: SOOP00119
Sample ID: 609440001	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 30-JAN-23 11:26	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.98	+/-1.70	2.40	3.00	pCi/L		JE1	03/01/23	1337	2382900	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		4.80	+/-1.79			pCi/L		NXL1	03/03/23	1123	2382899	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.818	+/-0.547	0.724	1.00	pCi/L		LXP1	03/02/23	1054	2382886	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			68.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 3, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54604	Project: SOOP00119
Sample ID: 609440002	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 30-JAN-23 09:37	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.82	+/-1.73	2.45	3.00	pCi/L		JE1	03/01/23	1337	2382900	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		4.60	+/-1.84			pCi/L		NXL1	03/03/23	1123	2382899	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.786	+/-0.622	0.875	1.00	pCi/L		LXP1	03/02/23	1054	2382886	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			64.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54607 Project: SOOP00119
Sample ID: 609440003 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 30-JAN-23 14:10
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.44	+/-1.30	2.12	3.00	pCi/L		JE1	03/01/23	1337	2382900		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.74	+/-1.34			pCi/L		NXL1	03/03/23	1123	2382899		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.304	+/-0.335	0.514	1.00	pCi/L		LXP1	03/02/23	1054	2382886		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			84.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54570 Project: SOOP00119
Sample ID: 609440004 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 31-JAN-23 12:49
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.71	+/-1.72	2.63	3.00	pCi/L		JE1	03/01/23	1502	2382900	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		4.11	+/-1.77			pCi/L		NXL1	03/03/23	1123	2382899	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.405	+/-0.411	0.635	1.00	pCi/L		LXP1	03/02/23	1054	2382886	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			65.2	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54601 Project: SOOP00119
Sample ID: 609440005 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 31-JAN-23 11:17
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.32	+/-1.37	2.26	3.00	pCi/L		JE1	03/01/23	1337	2382900	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.89	+/-1.44			pCi/L		NXL1	03/03/23	1123	2382899	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.570	+/-0.458	0.588	1.00	pCi/L		LXP1	03/02/23	1054	2382886	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			56.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 3, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54605	Project: SOOP00119
Sample ID: 609440006	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 31-JAN-23 09:40	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		4.02	+/-1.66	2.17	3.00	pCi/L		JE1	03/03/23	0851	2382900		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		4.87	+/-1.74			pCi/L		NXL1	03/03/23	1123	2382899		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.854	+/-0.498	0.448	1.00	pCi/L		LXP1	03/02/23	1054	2382886		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			55.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54606 Project: SOOP00119
Sample ID: 609440007 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 31-JAN-23 09:45
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.80	+/-1.72	2.35	3.00	pCi/L		JE1	03/01/23	1338	2382900	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		4.44	+/-1.79			pCi/L		NXL1	03/03/23	1123	2382899	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.643	+/-0.480	0.586	1.00	pCi/L		LXP1	03/02/23	1054	2382886	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			59.2	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: March 3, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 609440

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2382900										
QC1205319023	609440001	DUP									
Radium-228		3.98	U	0.908	pCi/L	126*		(0% - 100%)	JE1	03/01/23	13:36
		Uncertainty	+/-1.70	+/-1.42							
QC1205319025	LCS										
Radium-228		62.8		64.3	pCi/L		102	(75%-125%)		03/01/23	13:37
		Uncertainty		+/-5.21							
QC1205319022	MB										
Radium-228				2.74	pCi/L					03/01/23	13:36
		Uncertainty		+/-1.51							
Rad Ra-226											
Batch	2382886										
QC1205318990	609440001	DUP									
Radium-226		0.818		0.658	pCi/L	21.8		(0% - 100%)	LXP1	03/02/23	11:16
		Uncertainty	+/-0.547	+/-0.446							
QC1205318994	LCS										
Radium-226		26.5		24.7	pCi/L		93.2	(75%-125%)		03/02/23	11:41
		Uncertainty		+/-2.44							
QC1205318989	MB										
Radium-226				0.462	pCi/L					03/02/23	11:16
		Uncertainty		+/-0.359							
QC1205318992	609440001	MS									
Radium-226		131	0.818	105	pCi/L		79.5	(75%-125%)		03/02/23	11:16
		Uncertainty	+/-0.547	+/-11.1							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 609440

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 609440**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2382900

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609440001	AF54602
609440002	AF54604
609440003	AF54607
609440004	AF54570
609440005	AF54601
609440006	AF54605
609440007	AF54606
1205319022	Method Blank (MB)
1205319023	609440001(AF54602) Sample Duplicate (DUP)
1205319025	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Method Blank Criteria

The blank result (See Below) is greater than the MDC but less than the required detection limit.

Sample	Analyte	Value
1205319022 (MB)	Radium-228	Result: 2.74 pCi/L > MDA: 2.17 pCi/L <= RDL: 3.00 pCi/L

Duplication Criteria between QC Sample and Duplicate Sample

The Sample and the Duplicate, (See Below), did not meet the relative percent difference requirement; however, they do meet the relative error ratio requirement with the value listed below.

Sample	Analyte	Value
1205319023 (AF54602DUP)	Radium-228	RPD 126* (0%-20%) RER 2.46 (0-3)

Technical Information

Recounts

Sample 609440006 (AF54605) was re-eluted and recounted to verify sample result. The recount is reported.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2382886

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609440001	AF54602
609440002	AF54604
609440003	AF54607
609440004	AF54570
609440005	AF54601
609440006	AF54605
609440007	AF54606
1205318989	Method Blank (MB)
1205318990	609440001(AF54602) Sample Duplicate (DUP)
1205318992	609440001(AF54602) Matrix Spike (MS)
1205318994	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Method Blank Criteria

The blank result (See Below) is greater than the MDC but less than the required detection limit.

Sample	Analyte	Value
1205318989 (MB)	Radium-226	Result: 0.462 pCi/L > MDA: 0.407 pCi/L <= RDL: 1.00 pCi/L

Miscellaneous Information

Additional Comments

Aliquots for the matrix spikes, 1205318992 (AF54602MS), were reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the

requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

RAD 3/10/23

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 13 / 22 Send report to lcwillia@santeecooper.com & sjbrown@santeecooper.com



Chain of Custody

609427/609440

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LCWILLIA @santeecooper.com _____ / _____ / _____ 125915 / JM02.09.G01.1 / 36500 Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	TOC/DOC	TOTAL ALK BICARB CARB	SULFIDE	RAD 226/228	TOTAL GCLC
AF 54602	POZ-4	1/30/23	1126	ZDM BSB	6	G P	G	GW	*	* SULFIDE HAS SHORT HOLD	2	1	1	2	
AF 54604	POZ-6		0937												
↓ 7	POZ-8		1410												
AF 54603	POZ-5D	1/30/23	1308		1	G	G	GW	3/1	→ THIS SAMPLE NEEDS TOC ONLY.	1				
AF 54570	CAP-13	1/31/23	1249		6	G	G		*	* PRESERVATIVES TOC H2SO4	2	1	1	2	
AF 54601	POZ-3		1117							SULFIDE ZINC ACETATE, NaOH RAD #U03 <4°C					
↓ 05	POZ-7		0940												
↓ 06	POZ-7 DUP		0945							ALKAL-TOTAL, BICARB, CARB					

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	2/3/23	0947	<i>[Signature]</i>	GEL	2/3/23	0947
<i>[Signature]</i>	GEL	2/3/23	1520	<i>[Signature]</i>	GEL	2/3/23	1530

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb,Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code: 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOOP</u>		SDG/AR/COC/Work Order: <u>609427 / 609440</u>			
Received By: <u>JW</u>		Date Received: <u>2/3/23</u>			
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other			
Suspected Hazard Information		Yes	No	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.	
A) Shipped as a DOT Hazardous?	<input checked="" type="checkbox"/>			Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___	
B) Did the client designate the samples to be received as radioactive?	<input checked="" type="checkbox"/>			COC notation or radioactive stickers on containers equal client designation.	
C) Did the RSO classify the samples as radioactive?	<input checked="" type="checkbox"/>			Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3	
D) Did the client designate samples are hazardous?	<input checked="" type="checkbox"/>			COC notation or hazard labels on containers equal client designation.	
E) Did the RSO identify possible hazards?	<input checked="" type="checkbox"/>			If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____	
Sample Receipt Criteria		Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>			Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>			Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>			Preservation Method: Wet Ice Ice Packs Dry ice None Other: _____ *all temperatures are recorded in Celsius TEMP: _____
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>			Temperature Device Serial #: <u>IR2-21</u> Secondary Temperature Device Serial # (If Applicable): _____
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>			Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>			Sample ID's and Containers Affected: _____
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>			If Preservation added, Lot#: _____
					If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)
					Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
					Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___
					Sample ID's and containers affected: _____
8	Samples received within holding time?	<input checked="" type="checkbox"/>			ID's and tests affected: _____
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>			ID's and containers affected: _____
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>			Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>			Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>			
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>			Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed): 					

PM (or PMA) review: Initials HM Date 2/4/23 Page 1 of 1

List of current GEL Certifications as of 03 March 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



February 13, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 609445

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on February 03, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Jessica Ward for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 609445 GEL Work Order: 609445

The Qualifiers in this report are defined as follows:

U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

J Value is estimated

* A quality control analyte recovery is outside of specified acceptance criteria

** Analyte is a surrogate compound

** Analyte is a Tracer compound

J See case narrative for an explanation

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54559 Project: SOOP00119
Sample ID: 609445001 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 09:34
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		4.56	0.330	1.00	mg/L		1	RM3	02/06/23	2310	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1842	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		291	1.45	4.00	mg/L			EK1	02/10/23	1326	2382176	3
Bicarbonate alkalinity (CaCO3)		291	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54559 (DOC) Project: SOOP00119
Sample ID: 609445002 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 09:34
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		4.77	0.330	1.00	mg/L		1	TSM	02/08/23	1739	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54560 Project: SOOP00119
Sample ID: 609445003 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 11:13
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		3.57	0.330	1.00	mg/L		1	RM3	02/06/23	2330	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1842	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		213	1.45	4.00	mg/L			EK1	02/10/23	1336	2382176	3
Bicarbonate alkalinity (CaCO3)		213	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54560 (DOC) Project: SOOP00119
Sample ID: 609445004 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 11:13
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		3.05	0.330	1.00	mg/L		1	TSM	02/08/23	1801	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54561 Project: SOOP00119
Sample ID: 609445005 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 12:32
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		3.97	0.330	1.00	mg/L		1	RM3	02/07/23	0056	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1843	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			EK1	02/10/23	1338	2382176	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54561 (DOC) Project: SOOP00119
Sample ID: 609445006 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 12:32
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		3.70	0.330	1.00	mg/L		1	TSM	02/08/23	1823	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54562 Project: SOOP00119
Sample ID: 609445007 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 13:44
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.70	0.330	1.00	mg/L		1	RM3	02/07/23	0116	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1844	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		191	1.81	5.00	mg/L			EK1	02/10/23	1341	2382176	3
Bicarbonate alkalinity (CaCO3)		191	1.81	5.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.81	5.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF5462 (DOC) Project: SOOP00119
Sample ID: 609445008 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 13:44
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		2.59	0.330	1.00	mg/L		1	TSM	02/08/23	1845	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54563 Project: SOOP00119
Sample ID: 609445009 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 14:52
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		9.73	0.330	1.00	mg/L		1	RM3	02/07/23	0137	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1844	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		78.4	1.45	4.00	mg/L			EK1	02/10/23	1349	2382176	3
Bicarbonate alkalinity (CaCO3)		78.4	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54563 (DOC) Project: SOOP00119
Sample ID: 609445010 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 14:52
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		7.56	0.330	1.00	mg/L		1	TSM	02/08/23	1907	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54564 Project: SOOP00119
Sample ID: 609445011 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 02-FEB-23 09:42
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		3.64	0.330	1.00	mg/L		1	RM3	02/07/23	0159	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1845	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		207	1.45	4.00	mg/L			EK1	02/10/23	1354	2382176	3
Bicarbonate alkalinity (CaCO3)		207	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54564 (DOC) Project: SOOP00119
Sample ID: 609445012 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 02-FEB-23 09:42
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		3.13	0.330	1.00	mg/L		1	TSM	02/08/23	1929	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54565	Project: SOOP00119
Sample ID: 609445013	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 02-FEB-23 11:13	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		3.87	0.330	1.00	mg/L		1	RM3	02/07/23	0222	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1845	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			EK1	02/10/23	1358	2382176	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54565 (DOC) Project: SOOP00119
Sample ID: 609445014 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 02-FEB-23 11:13
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		3.12	0.330	1.00	mg/L		1	TSM	02/08/23	2057	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54566 Project: SOOP00119
Sample ID: 609445015 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 02-FEB-23 11:18
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		3.88	0.330	1.00	mg/L		1	RM3	02/07/23	0244	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1845	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			EK1	02/10/23	1400	2382176	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54566 (DOC) Project: SOOP00119
Sample ID: 609445016 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 02-FEB-23 11:18
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		3.09	0.330	1.00	mg/L		1	TSM	02/08/23	2119	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54567 Project: SOOP00119
Sample ID: 609445017 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 02-FEB-23 13:21
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.745	0.330	1.00	mg/L		1	RM3	02/07/23	0307	2379317	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/06/23	1846	2379523	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		182	1.45	4.00	mg/L			EK1	02/10/23	1401	2382176	3
Bicarbonate alkalinity (CaCO3)		182	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54567 (DOC) Project: SOOP00119
Sample ID: 609445018 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 02-FEB-23 13:21
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average	J	0.810	0.330	1.00	mg/L		1	TSM	02/08/23	2141	2379995	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/07/23	1115	2379287

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: February 13, 2023

Page 1 of 4

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 609445

Parname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch 2379317											
QC1205312930	609427001	DUP									
Total Organic Carbon Average		1.92		1.97	mg/L	2.47 ^		(+/-1.00)	RM3	02/06/23	19:45
QC1205312932	609445003	DUP									
Total Organic Carbon Average		3.57		3.56	mg/L	0.224 ^		(+/-1.00)		02/06/23	23:52
QC1205312929	LCS										
Total Organic Carbon Average	10.0			9.55	mg/L		95.5	(80%-120%)		02/06/23	18:55
QC1205312928	MB										
Total Organic Carbon Average			U	ND	mg/L					02/06/23	18:45
QC1205312931	609427001	PS									
Total Organic Carbon Average	10.0	1.92		11.6	mg/L		96.8	(65%-120%)		02/06/23	20:06
QC1205312933	609445003	PS									
Total Organic Carbon Average	10.0	3.57		12.4	mg/L		88.6	(65%-120%)		02/07/23	00:15
Batch 2379995											
QC1205312846	609445012	DUP									
Dissolved Organic Carbon Average		3.13		3.00	mg/L	4.18 ^		(+/-1.00)	TSM	02/08/23	19:51
QC1205312847	609427002	DUP									
Dissolved Organic Carbon Average		1.93		1.92	mg/L	0.728 ^		(+/-1.00)		02/08/23	14:35
QC1205313808	FLTB										
Dissolved Organic Carbon Average			U	ND	mg/L					02/08/23	13:52
QC1205314036	LCS										
Dissolved Organic Carbon Average	10.0			9.93	mg/L		99.3	(80%-120%)		02/08/23	14:02

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 609445

Page 2 of 4

Paramname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch	2379995										
QC1205314035		MB									
Dissolved Organic Carbon Average			U	ND	mg/L				TSM	02/08/23	13:43
QC1205312848	609445012	PS									
Dissolved Organic Carbon Average	10.0		3.13	12.1	mg/L		89.4	(65%-120%)		02/08/23	20:13
QC1205312849	609427002	PS									
Dissolved Organic Carbon Average	10.0		1.93	11.9	mg/L		100	(65%-120%)		02/08/23	14:55
Spectrometric Analysis											
Batch	2379523										
QC1205313148		LCS									
Total Sulfide	0.400			0.399	mg/L		99.7	(85%-115%)	HH2	02/06/23	18:38
QC1205313147		MB									
Total Sulfide			U	ND	mg/L					02/06/23	18:37
QC1205313151	609445017	PS									
Total Sulfide	0.400	U	ND	0.208	mg/L		51.9*	(75%-125%)		02/06/23	18:47
QC1205313152	609445017	PSD									
Total Sulfide	0.400	U	ND	0.208	mg/L	0	51.9*	(0%-15%)		02/06/23	18:47
Titration and Ion Analysis											
Batch	2382176										
QC1205317754	609427001	DUP									
Alkalinity, Total as CaCO3			246	247	mg/L	0.203		(0%-20%)	EK1	02/10/23	12:58
Bicarbonate alkalinity (CaCO3)			246	247	mg/L	0.203		(0%-20%)			
Carbonate alkalinity (CaCO3)		U	ND	U	mg/L	N/A					
QC1205317756	609445007	DUP									
Alkalinity, Total as CaCO3			191	191	mg/L	0.131		(0%-20%)		02/10/23	13:42

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 609445

Page 3 of 4

Paramname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Titration and Ion Analysis											
Batch	2382176										
Bicarbonate alkalinity (CaCO3)		191		191	mg/L	0.131		(0%-20%)	EK1	02/10/23	13:42
Carbonate alkalinity (CaCO3)	U	ND	U	ND	mg/L	N/A					
QC1205317753 LCS											
Alkalinity, Total as CaCO3	100			104	mg/L		104	(90%-110%)		02/10/23	12:41
QC1205317755 609427001 MS											
Alkalinity, Total as CaCO3	125	246		377	mg/L		104	(80%-120%)		02/10/23	13:02
QC1205317757 609445007 MS											
Alkalinity, Total as CaCO3	125	191		319	mg/L		102	(80%-120%)		02/10/23	13:45

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected
- Z Paint Filter Test--Particulates passed through the filter, however no free liquids were observed.
- d 5-day BOD--The 2:1 depletion requirement was not met for this sample
- ^ RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.
- N/A RPD or %Recovery limits do not apply.
- ND Analyte concentration is not detected above the detection limit
- NJ Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- E General Chemistry--Concentration of the target analyte exceeds the instrument calibration range
- Q One or more quality control criteria have not been met. Refer to the applicable narrative or DER.
- N1 See case narrative
- R Per section 9.3.4.1 of Method 1664 Revision B, due to matrix spike recovery issues, this result may not be reported or used for regulatory compliance purposes.

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 609445

Page 4 of 4

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
B		The target analyte was detected in the associated blank.									
e		5-day BOD--Test replicates show more than 30% difference between high and low values. The data is qualified per the method and can be used for reporting purposes									
J		See case narrative for an explanation									

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**General Chemistry
Technical Case Narrative
Santee Cooper
SDG #: 609445**

Product: Carbon, Total Organic
Analytical Method: SM 5310 B
Analytical Procedure: GL-GC-E-093 REV# 21
Analytical Batch: 2379317

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609445001	AF54559
609445003	AF54560
609445005	AF54561
609445007	AF54562
609445009	AF54563
609445011	AF54564
609445013	AF54565
609445015	AF54566
609445017	AF54567
1205312928	Method Blank (MB)
1205312929	Laboratory Control Sample (LCS)
1205312930	609427001(AF54602) Sample Duplicate (DUP)
1205312931	609427001(AF54602) Post Spike (PS)
1205312932	609445003(AF54560) Sample Duplicate (DUP)
1205312933	609445003(AF54560) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Carbon, Dissolved Organic
Analytical Method: SM 5310 B
Analytical Procedure: GL-GC-E-093 REV# 21
Analytical Batch: 2379995

Filtration Method: EPA 160
Filtration Procedure: GL-LB-E-034 REV# 4
Filtration Batch: 2379287

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609445002	AF54559 (DOC)
609445004	AF54560 (DOC)

609445006	AF54561 (DOC)
609445008	AF5462 (DOC)
609445010	AF54563 (DOC)
609445012	AF54564 (DOC)
609445014	AF54565 (DOC)
609445016	AF54566 (DOC)
609445018	AF54567 (DOC)
1205312846	609445012(AF54564 (DOC)) Sample Duplicate (DUP)
1205312847	609427002(AF54602 (DOC)) Sample Duplicate (DUP)
1205312848	609445012(AF54564 (DOC)) Post Spike (PS)
1205312849	609427002(AF54602 (DOC)) Post Spike (PS)
1205313808	Filtration Blank (FLTB)
1205314035	Method Blank (MB)
1205314036	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

Container scanning event for custody missed, however all samples was in the custody of the Analyst at the time of analysis.

Product: Sulfide, Total

Analytical Method: SM 4500-S (2-) D

Analytical Procedure: GL-GC-E-052 REV# 12

Analytical Batch: 2379523

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609445001	AF54559
609445003	AF54560
609445005	AF54561
609445007	AF54562
609445009	AF54563
609445011	AF54564
609445013	AF54565
609445015	AF54566
609445017	AF54567
1205313147	Method Blank (MB)
1205313148	Laboratory Control Sample (LCS)
1205313151	609445017(AF54567) Post Spike (PS)
1205313152	609445017(AF54567) Post Spike Duplicate (PSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Matrix Spike (MS)/Post Spike (PS) Recovery Statement

The percent recoveries (%R) obtained from the spike analyses are evaluated when the sample concentration is less than four times (4X) the spike concentration added. The matrix spike recovered outside of the established acceptance limits due to matrix interference and/or non-homogeneity.

Analyte	Sample	Value
Total Sulfide	1205313151 (AF54567PS) and 1205313152 (AF54567PSD)	51.9* (75%-125%)

Product: Alkalinity

Analytical Method: SM 2320B

Analytical Procedure: GL-GC-E-033 REV# 14

Analytical Batch: 2382176

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609445001	AF54559
609445003	AF54560
609445005	AF54561
609445007	AF54562
609445009	AF54563
609445011	AF54564
609445013	AF54565
609445015	AF54566
609445017	AF54567
1205317753	Laboratory Control Sample (LCS)
1205317754	609427001(AF54602) Sample Duplicate (DUP)
1205317755	609427001(AF54602) Matrix Spike (MS)
1205317756	609445007(AF54562) Sample Duplicate (DUP)
1205317757	609445007(AF54562) Matrix Spike (MS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

40 mL aliquots used due to sample availability; low pH values verified by pH strip 1205317754 (AF54602DUP), 1205317755 (AF54602MS), 1205317756 (AF54562DUP), 1205317757 (AF54562MS), 609445005 (AF54561),

609445007 (AF54562), 609445013 (AF54565) and 609445015 (AF54566).

Certification Statement


Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

RAD 3/10/23

609445/609452

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 13 / 22

Send report to lcwillia@santecooper.com & sjbrown@santecooper.com



Santee Cooper One Riverwood Drive Moncks Corner, SC 29461 Phone: (843)761-8000 Ext. 5148 Fax: (843)761-4175

See 2/4/23 60945

Chain of Custody

Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LCWILLIA @santecooper.com

125915 / JMO2.08.GP1.1 / 36500

Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	TOC/DOC	TOTAL ALK BICARB, GARB	SULFIDE	RAD 226/228	TOTAL CALC.
AF54559	CAP-3	2/1/23	0934	ZDM BSB	6	P G	G	GW	3 1	* SULFIDE HAS SHORT HOLD.	2	1	1	2	
60	CAP-4		1113												
61	CAP-5		1232							PRESERVATIVES TOC H2SO4					
62	CAP-6		1344							SULFIDE ZINC ACETATE, NaOH RAD HNO3					
63	CAP-7		1452							<4°C					
AF54564	CAP-8	2/2/23	0942												
65	CAP-9		1113												
66	CAP 9D		1118												
67	CAP 10		1321												

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	35594	2/3/23	0947	<i>[Signature]</i>	GEL	2/3/23	0947
<i>[Signature]</i>	GEL	2/3/23	1520	<i>[Signature]</i>	GEL	2/3/23	1520

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code: 1=4°C 2=HNO3 3=H2SO4 4=HCl 5=Na2S2O3 6=Other (Specify)

List of current GEL Certifications as of 13 February 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



March 13, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 609452

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on February 03, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 609452 GEL Work Order: 609452

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by

Julie Robinson

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54559	Project: SOOP00119
Sample ID: 609452001	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 01-FEB-23 09:34	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	-0.308	+/-1.10	2.25	3.00	pCi/L		JE1	03/09/23	1042	2387247		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		0.828	+/-1.16			pCi/L		NXL1	03/13/23	0838	2387244		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.828	+/-0.353	0.275	1.00	pCi/L		LXP1	03/12/23	0845	2387198		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			54.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54560 Project: SOOP00119
Sample ID: 609452002 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 11:13
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	-0.281	+/-1.16	2.23	3.00	pCi/L		JE1	03/09/23	1042	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.654	+/-1.22			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.654	+/-0.376	0.496	1.00	pCi/L		LXP1	03/12/23	0845	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			73.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54561 Project: SOOP00119
Sample ID: 609452003 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 12:32
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		12.8	+/-2.22	2.36	3.00	pCi/L		JE1	03/09/23	1042	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		17.2	+/-2.37			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		4.47	+/-0.822	0.543	1.00	pCi/L		LXP1	03/12/23	0845	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			84.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54562 Project: SOOP00119
Sample ID: 609452004 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 13:44
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.885	+/-1.37	2.38	3.00	pCi/L		JE1	03/09/23	1042	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.10	+/-1.45			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226 Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		1.22	+/-0.478	0.449	1.00	pCi/L		LXP1	03/12/23	0845	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			50.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54563 Project: SOOP00119
Sample ID: 609452005 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 01-FEB-23 14:52
Receive Date: 03-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.559	+/-1.26	2.24	3.00	pCi/L		JE1	03/09/23	1042	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.11	+/-1.29			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226 Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.553	+/-0.278	0.249	1.00	pCi/L		LXP1	03/12/23	0845	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			69.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54564	Project: SOOP00119
Sample ID: 609452006	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 02-FEB-23 09:42	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.03	+/-1.33	2.26	3.00	pCi/L		JE1	03/09/23	1042	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.50	+/-1.36			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.470	+/-0.275	0.277	1.00	pCi/L		LXP1	03/12/23	0845	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			81.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54565	Project: SOOP00119
Sample ID: 609452007	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 02-FEB-23 11:13	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.90	+/-1.58	2.25	3.00	pCi/L		JE1	03/09/23	1042	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.93	+/-1.64			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		1.03	+/-0.446	0.494	1.00	pCi/L		LXP1	03/12/23	0845	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			54.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54566	Project: SOOP00119
Sample ID: 609452008	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 02-FEB-23 11:18	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.318	+/-1.22	2.22	3.00	pCi/L		JE1	03/09/23	1042	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.962	+/-1.27			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.644	+/-0.335	0.422	1.00	pCi/L		LXP1	03/12/23	0845	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			66.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54567	Project: SOOP00119
Sample ID: 609452009	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 02-FEB-23 13:21	
Receive Date: 03-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.445	+/-1.26	2.26	3.00	pCi/L		JE1	03/09/23	1042	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.872	+/-1.31			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.427	+/-0.349	0.520	1.00	pCi/L		LXP1	03/12/23	0917	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			69.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: March 13, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 609452

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2387247										
QC1205326727	609452001	DUP									
Radium-228	U	-0.308	U	1.30	pCi/L	N/A		N/A	JE1	03/09/23	10:42
	Uncertainty	+/-1.10		+/-1.38							
QC1205326728	LCS										
Radium-228	62.6			65.2	pCi/L		104	(75%-125%)		03/09/23	10:42
	Uncertainty			+/-4.40							
QC1205326726	MB										
Radium-228			U	-0.360	pCi/L					03/09/23	10:41
	Uncertainty			+/-1.12							
Rad Ra-226											
Batch	2387198										
QC1205326617	609452001	DUP									
Radium-226		0.828		0.696	pCi/L	17.4		(0% - 100%)	LXP1	03/12/23	09:49
	Uncertainty	+/-0.353		+/-0.386							
QC1205326619	LCS										
Radium-226	26.4			25.2	pCi/L		95.6	(75%-125%)		03/12/23	10:21
	Uncertainty			+/-1.91							
QC1205326616	MB										
Radium-226			U	0.225	pCi/L					03/12/23	09:49
	Uncertainty			+/-0.247							
QC1205326618	609452001	MS									
Radium-226	129	0.828		111	pCi/L		84.9	(75%-125%)		03/12/23	09:49
	Uncertainty	+/-0.353		+/-8.55							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 609452

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 609452**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2387247

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609452001	AF54559
609452002	AF54560
609452003	AF54561
609452004	AF54562
609452005	AF54563
609452006	AF54564
609452007	AF54565
609452008	AF54566
609452009	AF54567
1205326726	Method Blank (MB)
1205326727	609452001(AF54559) Sample Duplicate (DUP)
1205326728	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

Sample results verify with historical activity.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2387198

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
609452001	AF54559
609452002	AF54560

609452003	AF54561
609452004	AF54562
609452005	AF54563
609452006	AF54564
609452007	AF54565
609452008	AF54566
609452009	AF54567
1205326616	Method Blank (MB)
1205326617	609452001(AF54559) Sample Duplicate (DUP)
1205326618	609452001(AF54559) Matrix Spike (MS)
1205326619	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

The matrix spike, 1205326618 (AF54559MS), aliquot was reduced to conserve sample volume.

Certification Statement


Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

RAD 3/10/23

609445/609452

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 13 / 22

Send report to lcwillia@santecooper.com & sjbrown@santecooper.com



Santee Cooper One Riverwood Drive Moncks Corner, SC 29461 Phone: (843)761-8000 Ext. 5148 Fax: (843)761-4175

See 2/4/23 60945

Chain of Custody

Customer Email/Report Recipient: Date Results Needed by: Project/Task/Unit #: Rerun request for any flagged QC

LCWILLIA @santecooper.com / / 125915 / JMO2.08.G01.1 / 36500 Yes (No)

Analysis Group

Labworks ID # (Internal use only)	Sample Location/Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass-G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	TOC/DOC	TOTAL ALK BICARB/GARB	SULFIDE	RAD 226/228	TOTAL GALS
AF54559	CAP-3	2/1/23	0934	ZDM BSB	6	P G	G	GW	3/1	* SULFIDE HAS SHORT HOLD.	2	1	1	2	
60	CAP-4		1113												
61	CAP-5		1232							PRESERVATIVES TOC H2SO4					
62	CAP-6		1344							SULFIDE ZINC ACETATE, NaOH RAD HNO3					
63	CAP-7		1452							<4°C					
AF54564	CAP-8	2/2/23	0942												
65	CAP-9		1113												
66	CAP 9D		1118												
67	CAP 10		1321												

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	35594	2/3/23	0947	<i>[Signature]</i>	GEL	2/3/23	0947
<i>[Signature]</i>	GEL	2/3/23	1520	<i>[Signature]</i>	GEL	2/3/23	1520

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code: 1=4°C 2=HNO3 3=H2SO4 4=HCl 5=Na2S2O3 6=Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SDG</u>		SDG/AR/COC/Work Order: <u>609445/609452</u>	
Received By: <u>JW</u>		Date Received: <u>2/3/23</u>	
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other	
Suspected Hazard Information		Yes	No
*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.			
A) Shipped as a DOT Hazardous?		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___	
B) Did the client designate the samples to be received as radioactive?		COC notation or radioactive stickers on containers equal client designation.	
C) Did the RSO classify the samples as radioactive?		Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3	
D) Did the client designate samples are hazardous?		COC notation or hazard labels on containers equal client designation.	
E) Did the RSO identify possible hazards?		If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:	
Sample Receipt Criteria		Yes	NA
Comments/Qualifiers (Required for Non-Conforming Items)			
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Circle Applicable: Seals broken Damaged container Leaking container Other (describe)			
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Circle Applicable: Client contacted and provided COC COC created upon receipt			
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Preservation Method: Wet Ice Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius TEMP: _____			
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Temperature Device Serial #: <u>IR2-21</u> Secondary Temperature Device Serial # (If Applicable): _____			
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Circle Applicable: Seals broken Damaged container Leaking container Other (describe)			
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Sample ID's and Containers Affected: If Preservation added, Lot#: If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)			
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:			
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
ID's and tests affected:			
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
ID's and containers affected:			
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)			
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Circle Applicable: No container count on COC Other (describe)			
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Circle Applicable: Not relinquished Other (describe)			
Comments (Use Continuation Form if needed):			

PM (or PMA) review: Initials JW Date 2/4/23 Page 1 of 1

List of current GEL Certifications as of 13 March 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



February 20, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 610529

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on February 10, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. Alkalinity container was not received.
610529009(AF54579).

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Heather Millar for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 610529 GEL Work Order: 610529

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- J Value is estimated
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by

Heather Millar

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54575 Project: SOOP00119
Sample ID: 610529001 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 09:30
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		3.98	0.330	1.00	mg/L		1	TSM	02/15/23	2202	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1906	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		254	2.42	6.67	mg/L			MS3	02/18/23	1245	2385420	3
Bicarbonate alkalinity (CaCO3)		254	2.42	6.67	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	2.42	6.67	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		
2	SM 4500-S (2-) D		
3	SM 2320B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54575 Project: SOOP00119
Sample ID: 610529002 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 09:30
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		4.06	0.330	1.00	mg/L		1	TSM	02/15/23	1322	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54576 Project: SOOP00119
Sample ID: 610529003 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 12:29
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		1.06	0.330	1.00	mg/L		1	TSM	02/15/23	2329	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1907	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		177	1.45	4.00	mg/L			MS3	02/18/23	1256	2385420	3
Bicarbonate alkalinity (CaCO3)		177	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54576 Project: SOOP00119
Sample ID: 610529004 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 12:29
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		1.34	0.330	1.00	mg/L		1	TSM	02/15/23	1429	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54577 Project: SOOP00119
Sample ID: 610529005 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 12:34
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		1.17	0.330	1.00	mg/L		1	TSM	02/15/23	2349	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1908	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		173	1.45	4.00	mg/L			MS3	02/18/23	1259	2385420	3
Bicarbonate alkalinity (CaCO3)		173	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54577 Project: SOOP00119
Sample ID: 610529006 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 12:34
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		1.16	0.330	1.00	mg/L		1	TSM	02/15/23	1449	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54578 Project: SOOP00119
Sample ID: 610529007 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 14:48
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.893	0.330	1.00	mg/L		1	TSM	02/16/23	0009	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1909	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		298	1.45	4.00	mg/L			MS3	02/18/23	1301	2385420	3
Bicarbonate alkalinity (CaCO3)		298	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54578 Project: SOOP00119
Sample ID: 610529008 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 14:48
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		1.18	0.330	1.00	mg/L		1	TSM	02/15/23	1509	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54579 Project: SOOP00119
Sample ID: 610529009 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 10:43
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		3.39	0.330	1.00	mg/L		1	TSM	02/16/23	0029	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1909	2383570	2

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		
2	SM 4500-S (2-) D		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54579 Project: SOOP00119
Sample ID: 610529010 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 10:43
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		3.25	0.330	1.00	mg/L		1	TSM	02/15/23	1529	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54557 Project: SOOP00119
Sample ID: 610529011 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 11:39
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		8.13	0.330	1.00	mg/L		1	TSM	02/16/23	0049	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/13/23	1733	2383083	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		20.0	1.45	4.00	mg/L			MS3	02/18/23	1303	2385420	3
Bicarbonate alkalinity (CaCO3)		20.0	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54557 Project: SOOP00119
Sample ID: 610529012 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 11:39
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		7.69	0.330	1.00	mg/L		1	TSM	02/15/23	1609	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54586 Project: SOOP00119
Sample ID: 610529013 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 14:02
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		7.36	0.330	1.00	mg/L		1	TSM	02/16/23	0109	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/13/23	1733	2383083	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			MS3	02/18/23	1304	2385420	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54586 Project: SOOP00119
Sample ID: 610529014 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 14:02
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		7.75	0.330	1.00	mg/L		1	TSM	02/15/23	1629	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54587 Project: SOOP00119
Sample ID: 610529015 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 14:07
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		7.48	0.330	1.00	mg/L		1	TSM	02/16/23	0129	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/13/23	1733	2383083	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			MS3	02/18/23	1305	2385420	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54587 Project: SOOP00119
Sample ID: 610529016 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 14:07
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		7.96	0.330	1.00	mg/L		1	TSM	02/15/23	1730	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54588 Project: SOOP00119
Sample ID: 610529017 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 12:55
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		13.6	0.330	1.00	mg/L		1	TSM	02/16/23	0149	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/13/23	1733	2383083	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			MS3	02/18/23	1306	2385420	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54588 Project: SOOP00119
Sample ID: 610529018 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 12:55
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		12.2	0.330	1.00	mg/L		1	TSM	02/15/23	1750	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54589	Project: SOOP00119
Sample ID: 610529019	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 06-FEB-23 15:32	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		11.7	0.330	1.00	mg/L		1	TSM	02/16/23	0212	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/13/23	1733	2383083	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			MS3	02/18/23	1309	2385420	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54589 Project: SOOP00119
Sample ID: 610529020 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 15:32
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		11.2	0.330	1.00	mg/L		1	TSM	02/15/23	1812	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54574 Project: SOOP00119
Sample ID: 610529021 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 14:17
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		1.23	0.330	1.00	mg/L		1	TSM	02/16/23	0233	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1909	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		7.67	2.42	6.67	mg/L			MS3	02/18/23	1310	2385420	3
Bicarbonate alkalinity (CaCO3)		7.67	2.42	6.67	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	2.42	6.67	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54574	Project: SOOP00119
Sample ID: 610529022	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 07-FEB-23 14:17	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		1.27	0.330	1.00	mg/L		1	TSM	02/15/23	1833	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54580 Project: SOOP00119
Sample ID: 610529023 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 13:08
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.376	0.330	1.00	mg/L		1	TSM	02/16/23	0313	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1909	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		32.4	1.45	4.00	mg/L			MS3	02/18/23	1317	2385420	3
Bicarbonate alkalinity (CaCO3)		32.4	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54580 Project: SOOP00119
Sample ID: 610529024 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 13:08
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average	J	0.572	0.330	1.00	mg/L		1	TSM	02/15/23	1853	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54584 Project: SOOP00119
Sample ID: 610529025 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 15:22
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.431	0.330	1.00	mg/L		1	TSM	02/16/23	0333	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1911	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		13.2	1.45	4.00	mg/L			MS3	02/18/23	1319	2385420	3
Bicarbonate alkalinity (CaCO3)		13.2	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54584 Project: SOOP00119
Sample ID: 610529026 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 15:22
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average	J	0.570	0.330	1.00	mg/L		1	TSM	02/15/23	1913	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54585 Project: SOOP00119
Sample ID: 610529027 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 10:24
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		7.71	0.330	1.00	mg/L		1	TSM	02/16/23	0354	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1911	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			MS3	02/18/23	1322	2385420	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54585 Project: SOOP00119
Sample ID: 610529028 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 10:24
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		7.32	0.330	1.00	mg/L		1	TSM	02/15/23	1954	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54591 Project: SOOP00119
Sample ID: 610529029 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 11:40
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		4.65	0.330	1.00	mg/L		1	TSM	02/16/23	0416	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1911	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			MS3	02/18/23	1323	2385420	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54591 Project: SOOP00119
Sample ID: 610529030 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 11:40
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		4.34	0.330	1.00	mg/L		1	TSM	02/15/23	2016	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54592 Project: SOOP00119
Sample ID: 610529031 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 09:14
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		9.83	0.330	1.00	mg/L		1	TSM	02/16/23	0438	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.165	0.500	mg/L		5	HH2	02/14/23	1912	2383570	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3	U	ND	1.45	4.00	mg/L			MS3	02/18/23	1323	2385420	3
Bicarbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54592 Project: SOOP00119
Sample ID: 610529032 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 09:14
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average		9.29	0.330	1.00	mg/L		1	TSM	02/15/23	2038	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54573 Project: SOOP00119
Sample ID: 610529033 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 09-FEB-23 11:22
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.560	0.330	1.00	mg/L		1	TSM	02/16/23	0501	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1917	2383084	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		146	1.45	4.00	mg/L			MS3	02/18/23	1324	2385420	3
Bicarbonate alkalinity (CaCO3)		146	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	
2	SM 4500-S (2-) D	
3	SM 2320B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54573 Project: SOOP00119
Sample ID: 610529034 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 09-FEB-23 11:22
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average	J	0.598	0.330	1.00	mg/L		1	TSM	02/15/23	2101	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54581 Project: SOOP00119
Sample ID: 610529035 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 09-FEB-23 09:42
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	U	ND	0.330	1.00	mg/L		1	TSM	02/16/23	0521	2383069	1
Spectrometric Analysis												
SM 4500-S(2-) D Sulfide "As Received"												
Total Sulfide	U	ND	0.0330	0.100	mg/L		1	HH2	02/14/23	1918	2383084	2
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO3		10.8	1.45	4.00	mg/L			MS3	02/18/23	1327	2385420	3
Bicarbonate alkalinity (CaCO3)		10.8	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO3)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		
2	SM 4500-S (2-) D		
3	SM 2320B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54581 Project: SOOP00119
Sample ID: 610529036 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 09-FEB-23 09:42
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Dissolved Organic Carbon "As Received"												
Dissolved Organic Carbon Average	J	0.389	0.330	1.00	mg/L		1	TSM	02/15/23	2121	2384265	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
EPA 160	Laboratory Filtration - DOC	TSM	02/14/23	1244	2383064

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SM 5310 B	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: February 20, 2023

Page 1 of 4

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact: Ms. Jeanette Gilmetti
Workorder: 610529

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch	2383069										
QC1205319459	610529001	DUP									
Total Organic Carbon Average			3.98	3.96	mg/L	0.479 ^		(+/-1.00)	TSM	02/15/23	22:24
QC1205319457	LCS										
Total Organic Carbon Average	10.0			9.74	mg/L		97.4	(80%-120%)		02/15/23	21:51
QC1205319456	MB										
Total Organic Carbon Average			U	ND	mg/L					02/15/23	21:41
QC1205319461	610529001	PS									
Total Organic Carbon Average	10.0		3.98	12.6	mg/L		86.3	(65%-120%)		02/15/23	22:46
Batch	2384265										
QC1205319423	610529002	DUP									
Dissolved Organic Carbon Average			4.06	3.88	mg/L	4.41 ^		(+/-1.00)	TSM	02/15/23	13:44
QC1205319424	610529014	DUP									
Dissolved Organic Carbon Average			7.75	7.81	mg/L	0.823		(0%-20%)		02/15/23	16:49
QC1205319422	FLT B										
Dissolved Organic Carbon Average			U	ND	mg/L					02/15/23	13:02
QC1205321680	LCS										
Dissolved Organic Carbon Average	10.0			9.98	mg/L		99.8	(80%-120%)		02/15/23	13:12
QC1205321679	MB										
Dissolved Organic Carbon Average			U	ND	mg/L					02/15/23	12:52
QC1205319425	610529002	PS									
Dissolved Organic Carbon Average	10.0		4.06	13.1	mg/L		90.3	(65%-120%)		02/15/23	14:07

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 610529

Page 2 of 4

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch 2384265											
QC1205319426	610529014	PS									
Dissolved Organic Carbon Average	10.0		7.75	16.2	mg/L		84.8	(65%-120%)	TSM	02/15/23	17:09
Spectrometric Analysis											
Batch 2383083											
QC1205319504	LCS										
Total Sulfide	0.400			0.394	mg/L		98.6	(85%-115%)	HH2	02/13/23	17:33
QC1205319503	MB										
Total Sulfide			U	ND	mg/L					02/13/23	17:33
QC1205319507	610529013	PS									
Total Sulfide	0.400	U	ND	0.256	mg/L		62.8*	(75%-125%)		02/13/23	17:33
QC1205319508	610529013	PSD									
Total Sulfide	0.400	U	ND	0.251	mg/L	2.02	61.5*	(0%-15%)		02/13/23	17:33
Batch 2383084											
QC1205319510	LCS										
Total Sulfide	0.400			0.408	mg/L		102	(85%-115%)	HH2	02/14/23	19:14
QC1205319509	MB										
Total Sulfide			U	ND	mg/L					02/14/23	19:14
QC1205319511	610239003	PS									
Total Sulfide	0.400	U	ND	0.432	mg/L		106	(75%-125%)		02/14/23	19:14
QC1205319512	610239003	PSD									
Total Sulfide	0.400	U	ND	0.423	mg/L	1.96	104	(0%-15%)		02/14/23	19:15
Batch 2383570											
QC1205320600	LCS										
Total Sulfide	0.400			0.408	mg/L		102	(85%-115%)	HH2	02/14/23	19:04

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 610529

Page 3 of 4

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Spectrometric Analysis											
Batch 2383570											
QC1205320599 MB											
Total Sulfide			U	ND	mg/L				HH2	02/14/23	19:04
QC1205320603 610529023 PS											
Total Sulfide	0.400	U	ND	0.299	mg/L		74.8*	(75%-125%)		02/14/23	19:10
QC1205320604 610529023 PSD											
Total Sulfide	0.400	U	ND	0.298	mg/L	0.467	74.5*	(0%-15%)		02/14/23	19:10
Titration and Ion Analysis											
Batch 2385420											
QC1205323656 610529001 DUP											
Alkalinity, Total as CaCO3		254		256	mg/L	0.916		(0%-20%)	MS3	02/18/23	12:50
Bicarbonate alkalinity (CaCO3)		254		256	mg/L	0.916		(0%-20%)			
Carbonate alkalinity (CaCO3)			U	ND	U	ND		N/A			
QC1205323655 LCS											
Alkalinity, Total as CaCO3	100			105	mg/L		105	(90%-110%)		02/18/23	12:42
QC1205323657 610529001 MS											
Alkalinity, Total as CaCO3	167	254		422	mg/L		101	(80%-120%)		02/18/23	12:53

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 610529

Page 4 of 4

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Z	Paint Filter Test--	Particulates passed through the filter, however no free liquids were observed.									
d	5-day BOD--	The 2:1 depletion requirement was not met for this sample									
^	RPD of sample and duplicate evaluated using +/-RL.	Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.									
N/A	RPD or %Recovery limits do not apply.										
ND	Analyte concentration is not detected above the detection limit										
NJ	Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier										
E	General Chemistry--	Concentration of the target analyte exceeds the instrument calibration range									
Q	One or more quality control criteria have not been met. Refer to the applicable narrative or DER.										
NI	See case narrative										
R	Per section 9.3.4.1 of Method 1664 Revision B, due to matrix spike recovery issues, this result may not be reported or used for regulatory compliance purposes.										
B	The target analyte was detected in the associated blank.										
e	5-day BOD--	Test replicates show more than 30% difference between high and low values. The data is qualified per the method and can be used for reporting purposes									
J	See case narrative for an explanation										

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**General Chemistry
Technical Case Narrative
Santee Cooper
SDG #: 610529**

Product: Carbon, Total Organic
Analytical Method: SM 5310 B
Analytical Procedure: GL-GC-E-093 REV# 21
Analytical Batch: 2383069

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610529001	AF54575
610529003	AF54576
610529005	AF54577
610529007	AF54578
610529009	AF54579
610529011	AF54557
610529013	AF54586
610529015	AF54587
610529017	AF54588
610529019	AF54589
610529021	AF54574
610529023	AF54580
610529025	AF54584
610529027	AF54585
610529029	AF54591
610529031	AF54592
610529033	AF54573
610529035	AF54581
1205319456	Method Blank (MB)
1205319457	Laboratory Control Sample (LCS)
1205319459	610529001(AF54575) Sample Duplicate (DUP)
1205319461	610529001(AF54575) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Carbon, Dissolved Organic
Analytical Method: SM 5310 B
Analytical Procedure: GL-GC-E-093 REV# 21
Analytical Batch: 2384265

Filtration Method: EPA 160
Filtration Procedure: GL-LB-E-034 REV# 4

Filtration Batch: 2383064

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610529002	AF54575
610529004	AF54576
610529006	AF54577
610529008	AF54578
610529010	AF54579
610529012	AF54557
610529014	AF54586
610529016	AF54587
610529018	AF54588
610529020	AF54589
610529022	AF54574
610529024	AF54580
610529026	AF54584
610529028	AF54585
610529030	AF54591
610529032	AF54592
610529034	AF54573
610529036	AF54581
1205319422	Filtration Blank (FLTB)
1205319423	610529002(AF54575) Sample Duplicate (DUP)
1205319424	610529014(AF54586) Sample Duplicate (DUP)
1205319425	610529002(AF54575) Post Spike (PS)
1205319426	610529014(AF54586) Post Spike (PS)
1205321679	Method Blank (MB)
1205321680	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Sulfide, Total

Analytical Method: SM 4500-S (2-) D

Analytical Procedure: GL-GC-E-052 REV# 12

Analytical Batch: 2383083

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610529011	AF54557
610529013	AF54586
610529015	AF54587
610529017	AF54588
610529019	AF54589
1205319503	Method Blank (MB)
1205319504	Laboratory Control Sample (LCS)
1205319507	610529013(AF54586) Post Spike (PS)

1205319508

610529013(AF54586) Post Spike Duplicate (PSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Matrix Spike (MS)/Post Spike (PS) Recovery Statement

The percent recoveries (%R) obtained from the spike analyses are evaluated when the sample concentration is less than four times (4X) the spike concentration added. The matrix spike recovered outside of the established acceptance limits due to matrix interference and/or non-homogeneity.

Analyte	Sample	Value
Total Sulfide	1205319507 (AF54586PS)	62.8* (75%-125%)
	1205319508 (AF54586PSD)	61.5* (75%-125%)

Product: Sulfide, Total

Analytical Method: SM 4500-S (2-) D

Analytical Procedure: GL-GC-E-052 REV# 12

Analytical Batch: 2383084

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610529033	AF54573
610529035	AF54581
1205319509	Method Blank (MB)
1205319510	Laboratory Control Sample (LCS)
1205319511	610239003(NonSDG) Post Spike (PS)
1205319512	610239003(NonSDG) Post Spike Duplicate (PSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Sulfide, Total

Analytical Method: SM 4500-S (2-) D

Analytical Procedure: GL-GC-E-052 REV# 12

Analytical Batch: 2383570

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610529001	AF54575
610529003	AF54576
610529005	AF54577
610529007	AF54578
610529009	AF54579
610529021	AF54574
610529023	AF54580
610529025	AF54584
610529027	AF54585
610529029	AF54591
610529031	AF54592
1205320599	Method Blank (MB)
1205320600	Laboratory Control Sample (LCS)
1205320603	610529023(AF54580) Post Spike (PS)
1205320604	610529023(AF54580) Post Spike Duplicate (PSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Matrix Spike (MS)/Post Spike (PS) Recovery Statement

The percent recoveries (%R) obtained from the spike analyses are evaluated when the sample concentration is less than four times (4X) the spike concentration added. The matrix spike recovered outside of the established acceptance limits due to matrix interference and/or non-homogeneity.

Analyte	Sample	Value
Total Sulfide	1205320603 (AF54580PS)	74.8* (75%-125%)
	1205320604 (AF54580PSD)	74.5* (75%-125%)

Technical Information

Sample Dilutions

The following sample 610529031 (AF54592) in this sample group was diluted due to matrix interference. Dilutions may be required for many reasons, including to minimize matrix interferences or to bring over range target analyte concentrations into the linear calibration range.

Analyte	610529
	031
Total Sulfide	5X

Product: Alkalinity

Analytical Method: SM 2320B

Analytical Procedure: GL-GC-E-033 REV# 14

Analytical Batch: 2385420

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610529001	AF54575
610529003	AF54576
610529005	AF54577
610529007	AF54578
610529011	AF54557
610529013	AF54586
610529015	AF54587
610529017	AF54588
610529019	AF54589
610529021	AF54574
610529023	AF54580
610529025	AF54584
610529027	AF54585
610529029	AF54591
610529031	AF54592
610529033	AF54573
610529035	AF54581
1205323655	Laboratory Control Sample (LCS)
1205323656	610529001(AF54575) Sample Duplicate (DUP)
1205323657	610529001(AF54575) Matrix Spike (MS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

610529/610542

RAD - 3/10/23

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 20 / 23 Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody



Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.09.GW.1 / 36500 Rerun request for any flagged QC: Yes (No)

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	TOC/DOC	TOTAL, BICARB ALK CARB	SULFIDE	RAD 226/228	TOTAL CALC.
76	- 4		1229							PRESERVATIVES TOC H2SO4					
77	- 4D		1234							SULFIDE ZINC ACETATE, NaOH RAD HNO3					
78	- 5		1448							<4°C					
79	- 6		1043							ALK - TOTAL, BICARB, CARB					
AF54557	CAP-1	2/6/23	1139							*SULFIDE HAS SHORT HOLD					
86	CGYP2		1402												
87	CGYP2D		1407												
88	CGYP-3		1255												
89	CGYP-4		1532												

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	2/10/23	0943	<i>[Signature]</i>	GEL	2/10/23	0943
<i>[Signature]</i>	666	2/10/23	1535	<i>[Signature]</i>	GEL	2/10/23	15:25

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____


<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> % Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4=HCl 5=Na2S2O3 6=Other (Specify)

RAD 3/10/23

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 20 / 23 Send report to lcwillia@santeecooper.com & sjbrown@santeecooper.com

Chain of Custody



Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone: (843)761-8000 Ext. 5148
Fax: (843)761-4175

Customer Email/Report Recipient: LCWILLIA@santeecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.09.GP1.1 / 36500 Rerun request for any flagged QC: Yes (No)

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	TOC/DOC	TOTAL BICARB ALK CARB	SULFIDE	RAD 2/16/23	TOTAL CALC.
AF54574	CCMAP-2	2/7/23	1417	EDM BSB	6	G+	G	GW	*		X	X	X	X	
80	CCMAP-7		1308							*PRESERVATIVES: TOC H2SO4					
84	CCMLF-2		1522							SULFIDE ZINC ACETATE, NaOH RAD HNO3					
85	CGYP-1		1024							<4°C					
91	CGYP-6		1140							ALKAL-TOTAL, BICARB + CARB					
92	CGYP-7		0914							*SULFIDE HAS SHORT HOLD					
AF54573	CCMAP-1	2/9/23	1122												
81	CCMAP-8		0912												

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	25574	2/10/23	0943	<i>[Signature]</i>	GEL	2/10/23	0943
<i>[Signature]</i>	<i>[Signature]</i>	2/10/23	1525	<i>[Signature]</i>	GEL	2/10/23	15:25

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOOP</u>	SDG/AR/COC/Work Order: <u>61052a/610542</u> <u>JR</u>
Received By: <u>Thyasia Tatum</u>	Date Received: <u>2/10/23</u>
Carrier and Tracking Number	Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other

Suspected Hazard Information	Yes	No	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?		<input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive?		<input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive?		<input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?		<input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards?		<input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCBs Flammable Foreign Soil RCRA Asbestos Beryllium Other:

Sample Receipt Criteria	Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1 Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>			Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2 Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>			Circle Applicable: Client contacted and provided COC COC created upon receipt
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>			Preservation Method: <u>Wet Ice</u> Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius TEMP: <u>1C</u>
4 Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>			Temperature Device Serial #: <u>IR2-20</u> Secondary Temperature Device Serial # (If Applicable):
5 Sample containers intact and sealed?	<input checked="" type="checkbox"/>			Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6 Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>			Sample ID's and Containers Affected: If Preservation added, Lot#:
7 Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>			If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8 Samples received within holding time?	<input checked="" type="checkbox"/>			ID's and tests affected:
9 Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>			ID's and containers affected:
10 Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>			Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11 Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>			Circle Applicable: No container count on COC Other (describe) <u>ID: AF54579 NOT RECEIVED</u>
12 Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>			
13 COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>			Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

PM (or PMA) review: Initials SM Date 2/11/23 Page 1 of 1

Jordan Melton

From: Jessica Ward
Sent: Monday, February 13, 2023 9:41 AM
To: Sherri Brown; Heather Millar
Cc: Team Robinson
Subject: RE: GEL WOs: 610529 and 610542 Missing Sample

Sherri,

I spent some time looking through all the samples for this analysis. We are only missing the Alkalinity container 125ml for Sample ID AF54579. We have the DOC/TOC containers as well as the RadChem containers for this sample. Unfortunately, I do not think it was included in the coolers, I have checked the labels on all containers and the GEL label matches the client label for all samples.

Thank you,
Jessica Ward

Project Manager Assistant



2040 Savage Road, Charleston, SC 29407 | P.O. Box 30712, Charleston, SC 29417
Office Main: 843.556.8171 | Office Direct: 843.556.8171 ext. 4523 | Office Fax: 843.769.7383
E-Mail: Jessica.Ward@gel.com | Website: www.gel.com

From: Sherri Brown <sherri.brown@santecooper.com>
Sent: Sunday, February 12, 2023 9:19 AM
To: Heather Millar <Heather.Millar@gel.com>
Cc: Team Robinson <Team.Robinson@gel.com>
Subject: RE: GEL WOs: 610529 and 610542 Missing Sample

[EXTERNAL EMAIL] DO NOT CLICK links or attachments unless you recognize the sender and know the content is safe.

Good morning,

Ok thanks so much for double checking. So just to recap, you are now only missing one bottle for TOC only? I will double check our lab and get back to you. Thanks again.

Thanks,

Sherri J. Brown
Lab Tech A
Environmental Resources
☎ 843.761.8000 ext. 5709
✉ sjbrown@santecooper.com

From: Heather Millar <Heather.Millar@gel.com>
Sent: Saturday, February 11, 2023 1:30 PM
To: Sherri Brown <sherri.brown@santecooper.com>
Cc: Team Robinson <Team.Robinson@gel.com>
Subject: [EXTERNAL SENDER] RE: GEL WOs: 610529 and 610542 Missing Sample

Sherri,

We did a double check, the only container we did not receive is the TOC analysis bottle. Please advise.

Heather Millar
Project Manager Assistant



2040 Savage Road, Charleston, SC 29407 | P.O. Box 30712, Charleston, SC 29417
Office Main: 843.556.8171 | Office Fax: 843.769.7383
E-Mail: heather.millar@gel.com | Website: www.gel.com
Follow us on [LinkedIn](#)


From: Sherri Brown <sherri.brown@santecooper.com>
Sent: Saturday, February 11, 2023 12:02 PM
To: Heather Millar <Heather.Millar@gel.com>
Cc: Team Robinson <Team.Robinson@gel.com>
Subject: RE: GEL WOs: 610529 and 610542 Missing Sample
Importance: High

[EXTERNAL EMAIL] DO NOT CLICK links or attachments unless you recognize the sender and know the content is safe.

I know we sent a lot of samples. Could you please ask someone to double check all the bottles that you received? I see it's noted on the chain where we received the samples and for that particular sample ID I have found the metals bottles we retained here (which were all collected in a set). Please advise.

Thanks,

Sherri J. Brown
Lab Tech A
Environmental Resources
☎843.761.8000 ext. 5709
✉sjbrown@santecooper.com



From: Heather Millar <Heather.Millar@gel.com>
Sent: Saturday, February 11, 2023 10:47 AM
To: Sherri Brown <sherri.brown@santecooper.com>
Cc: Team Robinson <Team.Robinson@gel.com>
Subject: [EXTERNAL SENDER] RE: GEL WOs: 610529 and 610542 Missing Sample

Sherri,

There were no containers for this sample ID received.

Heather Millar
Project Manager Assistant



2040 Savage Road, Charleston, SC 29407 | P.O. Box 30712, Charleston, SC 29417
Office Main: 843.556.8171 | Office Fax: 843.769.7383
E-Mail: heather.millar@gel.com | Website: www.gel.com
Follow us on [LinkedIn](#)

From: Sherri Brown <sherri.brown@santecooper.com>
Sent: Saturday, February 11, 2023 10:39 AM
To: Heather Millar <Heather.Millar@gel.com>
Cc: Team Robinson <Team.Robinson@gel.com>
Subject: RE: GEL WOs: 610529 and 610542 Missing Sample


[EXTERNAL EMAIL] DO NOT CLICK links or attachments unless you recognize the sender and know the content is safe.

Good morning,

It wasn't received for any of the analyses or just one? There should have been bottles for RAD, sulfide, TOC, DOC and alkalinity. Please advise.

Thanks,

Sherri J. Brown
Lab Tech A
Environmental Resources
☎843.761.8000 ext. 5709
✉sjbrown@santecooper.com



From: Heather Millar <Heather.Millar@gel.com>
Sent: Saturday, February 11, 2023 9:30 AM
To: Sherri Brown <sherri.brown@santeecooper.com>
Cc: Team Robinson <Team.Robinson@gel.com>
Subject: [EXTERNAL SENDER] GEL WOs: 610529 and 610542 Missing Sample

Good morning,

GEL received samples via courier yesterday afternoon. Sample ID AF54579 was not received. We will not be able to run the requested analyses due to not having the sample. I apologize for any inconvenience this may cause.

Thank you,

Heather Millar
Project Manager Assistant



2040 Savage Road, Charleston, SC 29407 | P.O. Box 30712, Charleston, SC 29417
Office Main: 843.556.8171 | Office Fax: 843.769.7383
E-Mail: heather.millar@gel.com | Website: www.gel.com
Follow us on [LinkedIn](#)

CONFIDENTIALITY NOTICE: This e-mail and any files transmitted with it are the property of The GEL Group, Inc. and its affiliates. All rights, including without limitation copyright, are reserved. The proprietary information contained in this e-mail message, and any files transmitted with it, is intended for the use of the recipient(s) named above. If the reader of this e-mail is not the intended recipient, you are hereby notified that you have received this e-mail in error and that any review, distribution or copying of this e-mail or any files transmitted with it is strictly prohibited. If you have received this e-mail in error, please notify the sender immediately and delete the original message and any files transmitted. The unauthorized use of this e-mail or any files transmitted with it is prohibited and disclaimed by The GEL Group, Inc. and its affiliates.

WARNING!

This e-mail message originated outside of Santee Cooper.

Do not click on any links or open any attachments unless you are confident it is from a trusted source.

If you have questions, please call the Technology Service Desk at Ext. 7777.

WARNING!

This e-mail message originated outside of Santee Cooper.
Do not click on any links or open any attachments unless you are confident it is from a trusted source.
If you have questions, please call the Technology Service Desk at Ext. 7777.

WARNING!

This e-mail message originated outside of Santee Cooper.
Do not click on any links or open any attachments unless you are confident it is from a trusted source.
If you have questions, please call the Technology Service Desk at Ext. 7777.

List of current GEL Certifications as of 20 February 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



March 14, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 610542

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on February 10, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 610542 GEL Work Order: 610542

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54575 Project: SOOP00119
Sample ID: 610542001 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 09:30
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	-0.957	+/-0.645	1.61	3.00	pCi/L		JE1	03/08/23	1342	2387255	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.467	+/-0.714			pCi/L		NXL1	03/14/23	0853	2387251	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.467	+/-0.305	0.373	1.00	pCi/L		LXP1	03/12/23	0710	2387201	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			76.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54576	Project: SOOP00119
Sample ID: 610542002	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 08-FEB-23 12:29	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.63	+/-1.20	1.86	3.00	pCi/L		JE1	03/08/23	1342	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.83	+/-1.23			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.199	+/-0.244	0.409	1.00	pCi/L		LXP1	03/12/23	0710	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			68.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54577 Project: SOOP00119
Sample ID: 610542003 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 12:34
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.414	+/-1.31	2.35	3.00	pCi/L		JE1	03/08/23	1342	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.10	+/-1.36			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.690	+/-0.352	0.367	1.00	pCi/L		LXP1	03/12/23	0710	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			73	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54578 Project: SOOP00119
Sample ID: 610542004 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 08-FEB-23 14:48
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.643	+/-1.12	1.98	3.00	pCi/L		JE1	03/08/23	1342	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		0.938	+/-1.18			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.295	+/-0.361	0.605	1.00	pCi/L		LXP1	03/12/23	0710	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			64.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54579	Project: SOOP00119
Sample ID: 610542005	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 08-FEB-23 10:43	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.56	+/-1.41	2.28	3.00	pCi/L		JE1	03/08/23	1342	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.86	+/-1.42			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.304	+/-0.220	0.258	1.00	pCi/L		LXP1	03/12/23	0710	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			63.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54557	Project: SOOP00119
Sample ID: 610542006	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 06-FEB-23 11:39	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.44	+/-1.32	2.15	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.19	+/-1.37			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.746	+/-0.376	0.455	1.00	pCi/L		LXP1	03/12/23	0710	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			69.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54586 Project: SOOP00119
Sample ID: 610542007 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 14:02
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		2.06	+/-1.10	1.56	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.52	+/-1.13			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.460	+/-0.281	0.293	1.00	pCi/L		LXP1	03/12/23	0710	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			81	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54587 Project: SOOP00119
Sample ID: 610542008 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 14:07
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.905	+/-1.33	2.28	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.53	+/-1.37			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.629	+/-0.314	0.348	1.00	pCi/L		LXP1	03/12/23	0710	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			73.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54588	Project: SOOP00119
Sample ID: 610542009	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 06-FEB-23 12:55	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.53	+/-1.82	2.69	3.00	pCi/L		JE1	03/08/23	1343	2387255	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		4.18	+/-1.85			pCi/L		NXL1	03/14/23	0853	2387251	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.642	+/-0.334	0.307	1.00	pCi/L		LXP1	03/12/23	0742	2387201	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			64.2	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54589 Project: SOOP00119
Sample ID: 610542010 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 06-FEB-23 15:32
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.869	+/-1.42	2.46	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.81	+/-1.46			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226 Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.941	+/-0.365	0.311	1.00	pCi/L		LXP1	03/12/23	0742	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			65.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54574	Project: SOOP00119
Sample ID: 610542011	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 07-FEB-23 14:17	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	-2.61	+/-1.02	2.67	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		0.613	+/-1.07			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.613	+/-0.303	0.309	1.00	pCi/L		LXP1	03/12/23	0742	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			58.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54580	Project: SOOP00119
Sample ID: 610542012	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 07-FEB-23 13:08	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.44	+/-1.60	2.69	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.73	+/-1.63			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.291	+/-0.294	0.460	1.00	pCi/L		LXP1	03/12/23	0742	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			58.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54584	Project: SOOP00119
Sample ID: 610542013	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 07-FEB-23 15:22	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.445	+/-1.24	2.23	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.19	+/-1.28			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.748	+/-0.340	0.326	1.00	pCi/L		LXP1	03/12/23	0742	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			69.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54585	Project: SOOP00119
Sample ID: 610542014	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 07-FEB-23 10:24	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.37	+/-1.21	1.72	3.00	pCi/L		JE1	03/08/23	1343	2387255	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.13	+/-1.27			pCi/L		NXL1	03/14/23	0853	2387251	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.762	+/-0.384	0.464	1.00	pCi/L		LXP1	03/12/23	0742	2387201	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			75.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54591	Project: SOOP00119
Sample ID: 610542015	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 07-FEB-23 11:40	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.89	+/-1.31	2.00	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.08	+/-1.34			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.193	+/-0.273	0.475	1.00	pCi/L		LXP1	03/12/23	0742	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			62.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54592 Project: SOOP00119
Sample ID: 610542016 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 07-FEB-23 09:14
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		4.48	+/-1.65	2.33	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		5.27	+/-1.68			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.795	+/-0.317	0.234	1.00	pCi/L		LXP1	03/12/23	0742	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			73.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54573 Project: SOOP00119
Sample ID: 610542017 Client ID: SOOP001
Matrix: Ground Water
Collect Date: 09-FEB-23 11:22
Receive Date: 10-FEB-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.963	+/-1.27	2.17	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.31	+/-1.31			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.344	+/-0.290	0.423	1.00	pCi/L		LXP1	03/12/23	0813	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			76.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 14, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF54581	Project: SOOP00119
Sample ID: 610542018	Client ID: SOOP001
Matrix: Ground Water	
Collect Date: 09-FEB-23 09:42	
Receive Date: 10-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.600	+/-0.958	1.68	3.00	pCi/L		JE1	03/08/23	1343	2387255		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.02	+/-1.00			pCi/L		NXL1	03/14/23	0853	2387251		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.420	+/-0.290	0.397	1.00	pCi/L		LXP1	03/12/23	0813	2387201		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			66.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: March 14, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 610542

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2387255										
QC1205326737	610542001	DUP									
Radium-228	U	-0.957	U	1.35	pCi/L	N/A		N/A	JE1	03/08/23	13:42
	Uncertainty	+/-0.645		+/-1.39							
QC1205326738	LCS										
Radium-228	62.5			55.8	pCi/L		89.2	(75%-125%)		03/08/23	13:42
	Uncertainty			+/-4.38							
QC1205326736	MB										
Radium-228			U	-0.776	pCi/L					03/08/23	13:42
	Uncertainty			+/-0.755							
Rad Ra-226											
Batch	2387201										
QC1205326629	610542001	DUP									
Radium-226				0.467	pCi/L	40.8		(0% - 100%)	LXP1	03/12/23	08:13
	Uncertainty			+/-0.305							
QC1205326631	LCS										
Radium-226	26.5			21.5	pCi/L		81.4	(75%-125%)		03/12/23	08:13
	Uncertainty			+/-1.63							
QC1205326628	MB										
Radium-226			U	0.171	pCi/L					03/12/23	08:13
	Uncertainty			+/-0.276							
QC1205326630	610542001	MS									
Radium-226	134	0.467		114	pCi/L		85.1	(75%-125%)		03/12/23	08:13
	Uncertainty			+/-0.305							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 610542

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 610542**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2387255

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610542001	AF54575
610542002	AF54576
610542003	AF54577
610542004	AF54578
610542005	AF54579
610542006	AF54557
610542007	AF54586
610542008	AF54587
610542009	AF54588
610542010	AF54589
610542011	AF54574
610542012	AF54580
610542013	AF54584
610542014	AF54585
610542015	AF54591
610542016	AF54592
610542017	AF54573
610542018	AF54581
1205326736	Method Blank (MB)
1205326737	610542001(AF54575) Sample Duplicate (DUP)
1205326738	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Technical Information

Negative > 3 sigma TPU

Sample result was more negative than the three sigma TPU. The background control chart was examined and the detector was determined to be fully functional.

Sample	Analyte	Value
610542011 (AF54574)	Radium-228	Negative Result > 3 sigma value

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2387201

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610542001	AF54575
610542002	AF54576
610542003	AF54577
610542004	AF54578
610542005	AF54579
610542006	AF54557
610542007	AF54586
610542008	AF54587
610542009	AF54588
610542010	AF54589
610542011	AF54574
610542012	AF54580
610542013	AF54584
610542014	AF54585
610542015	AF54591
610542016	AF54592
610542017	AF54573
610542018	AF54581
1205326628	Method Blank (MB)
1205326629	610542001(AF54575) Sample Duplicate (DUP)
1205326630	610542001(AF54575) Matrix Spike (MS)
1205326631	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

The matrix spike, 1205326630 (AF54575MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

610529/610542

RAD - 3/10/23

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 20 / 23 Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody



Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone: (843)761-8000 Ext. 5148
Fax: (843)761-4175

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.09.GW.1 / 36500 Rerun request for any flagged QC: Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	TOC/DOC	TOTAL ALK BICARB	SULFIDE	RAD 226/228	TOTAL CALC.
AF54575	CCMAT - 3	2/8/23	0930	ZDM RSB	6	G/P	G	GW	*		X	X	X	X	
76	- 4		1229							PRESERVATIVES TOC H2SO4					
77	- 4D		1234							SULFIDE ZINC ACETATE, NaOH RAD HNO3					
78	- 5		1448							<4°C					
79	- 6		1043							ALK - TOTAL, BICARB, CARB					
AF54557	CAP-1	2/6/23	1139							*SULFIDE HAS SHORT HOLD					
86	CGYP2		1402												
87	CGYP2D		1407												
88	CGYP-3		1255												
89	CGYP-4		1532												

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	2/10/23	0943	<i>ALC</i>	GEL	2/10/23	0943
<i>ALC</i>	666	2/10/23	1525	<i>LCWILLIA</i>	GEL	2/10/23	15:25

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> % Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

RAD 3/10/23

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 20 / 23 Send report to lcwillia@santeecooper.com & sjbrown@santeecooper.com

Chain of Custody



Customer Email/Report Recipient: LCWILLIA@santeecooper.com Date Results Needed by: / / Project/Task/Unit #: 125915 / JM02.09.G01.1 / 36500 Rerun request for any flagged QC Yes (No)

Analysis Group

Labworks ID # (Internal use only)	Sample Location/Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass-G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	TOC/DOC	TOTAL BICARB ALK CARB	SULFIDE	RAD 224/223	TOTAL CALC.
AF54574	CCMAP-2	2/7/23	1417	EDM BSB	6	G+	G	GW	*		X	X	X	X	
80	CCMAP-7		1308							*PRESERVATIVES: TOC H2SO4					
84	CCMLF-2		1522							SULFIDE ZINC ACETATE, NaOH RAD HNO3					
85	CGYP-1		1024							<4°C					
91	CGYP-6		1140							ALKAL-TOTAL, BICARB + CARB					
92	CGYP-7		0914							*SULFIDE HAS SHORT HOLD					
AF54573	CCMAP-1	2/9/23	1122												
81	CCMAP-8		0912												

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	35574	2/10/23	0943	<i>[Signature]</i>	GEL	2/10/23	0943
<i>[Signature]</i>	<i>[Signature]</i>	2/10/23	1525	<i>[Signature]</i>	GEL	2/10/23	15:25

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOOP</u>	SDG/AR/COC/Work Order: <u>61052a/610542</u> <u>JR</u>
Received By: <u>Thyasia Tatum</u>	Date Received: <u>2/10/23</u>
Carrier and Tracking Number	Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>○</u> Courier Other

Suspected Hazard Information	Yes	No	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?		<input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive?		<input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive?		<input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?		<input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards?		<input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCBs Flammable Foreign Soil RCRA Asbestos Beryllium Other:

Sample Receipt Criteria	Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1 Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>			Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2 Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>			Circle Applicable: Client contacted and provided COC COC created upon receipt
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>			Preservation Method: <u>○</u> Wet Ice Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius TEMP: <u>10</u>
4 Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>			Temperature Device Serial #: <u>IR2-20</u> Secondary Temperature Device Serial # (If Applicable):
5 Sample containers intact and sealed?	<input checked="" type="checkbox"/>			Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6 Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>			Sample ID's and Containers Affected: If Preservation added, Lot#:
7 Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>			If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8 Samples received within holding time?	<input checked="" type="checkbox"/>			ID's and tests affected:
9 Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>			ID's and containers affected:
10 Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>			Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11 Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>			Circle Applicable: No container count on COC Other (describe) <u>ID: AF54579 NOT RECEIVED</u>
12 Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>			
13 COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>			Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

PM (or PMA) review: Initials STW Date 2/11/23 Page 1 of 1

List of current GEL Certifications as of 14 March 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



February 20, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 610889

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on February 14, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The sample was delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Heather Millar for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 610889 GEL Work Order: 610889

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by

Heather Millar

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: February 20, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF54579 Project: SOOP00119
Sample ID: 610889001 Client ID: SOOP001
Matrix: GW
Collect Date: 08-FEB-23 10:43
Receive Date: 14-FEB-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Titration and Ion Analysis												
SM 2320B Total Alkalinity "As Received"												
Alkalinity, Total as CaCO ₃		7.80	1.45	4.00	mg/L		MS3	02/18/23	1329	2385420		1
Bicarbonate alkalinity (CaCO ₃)		7.80	1.45	4.00	mg/L							
Carbonate alkalinity (CaCO ₃)	U	ND	1.45	4.00	mg/L							

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 2320B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: February 20, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact: Ms. Jeanette Gilmetti

Workorder: 610889

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Titration and Ion Analysis											
Batch	2385420										
QC1205323658	610529021	DUP									
Alkalinity, Total as CaCO3		7.67		8.00	mg/L	4.26 ^		(+/-6.67)	MS3	02/18/23	13:12
Bicarbonate alkalinity (CaCO3)		7.67		8.00	mg/L	4.26 ^		(+/-6.67)			
Carbonate alkalinity (CaCO3)	U	ND	U	ND	mg/L	N/A					
QC1205323655	LCS										
Alkalinity, Total as CaCO3	100			105	mg/L		105	(90%-110%)		02/18/23	12:42
QC1205323659	610529021	MS									
Alkalinity, Total as CaCO3	167	7.67		179	mg/L		103	(80%-120%)		02/18/23	13:15

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected
- Z Paint Filter Test--Particulates passed through the filter, however no free liquids were observed.
- d 5-day BOD--The 2:1 depletion requirement was not met for this sample
- ^ RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.
- N/A RPD or %Recovery limits do not apply.
- ND Analyte concentration is not detected above the detection limit
- NJ Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- E General Chemistry--Concentration of the target analyte exceeds the instrument calibration range

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 610889

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Q											
Q											
N1											
R											
B											
e											
J											

Q One or more quality control criteria have not been met. Refer to the applicable narrative or DER.

N1 See case narrative

R Per section 9.3.4.1 of Method 1664 Revision B, due to matrix spike recovery issues, this result may not be reported or used for regulatory compliance purposes.

B The target analyte was detected in the associated blank.

e 5-day BOD--Test replicates show more than 30% difference between high and low values. The data is qualified per the method and can be used for reporting purposes

J See case narrative for an explanation

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**General Chemistry
Technical Case Narrative
Santee Cooper
SDG #: 610889**

Product: Alkalinity

Analytical Method: SM 2320B

Analytical Procedure: GL-GC-E-033 REV# 14

Analytical Batch: 2385420

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610889001	AF54579
1205323655	Laboratory Control Sample (LCS)
1205323658	610529021(AF54574) Sample Duplicate (DUP)
1205323659	610529021(AF54574) Matrix Spike (MS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

610889

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 2 / 20 / 23 Send report to lcwillia@santecooper.com & sjbrown@santecooper.com



Chain of Custody

Customer Email/Report Recipient: LCWILLIA @santecooper.com Date Results Needed by: / / Project/Task/Unit #: 125915 / JM02.08.G01.1 / 36500 Rerun request for any flagged QC: Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	ALKALINITY (TOTAL BICARB + CARB)
A-F54579	CCMAP-6	2/8/23	1043	ZDM MDG	1	P	G	GW	1	ALKAL - TOTAL BICARB + CARBONATE	X

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sjbrown</i>	35594	2/14/23	0940	<i>[Signature]</i>	GEL	2/14/23	0940
<i>[Signature]</i>	GEL	2/14/23	15:00	<i>Thomasa Tatum</i>	GEL	2/14/23	15:00

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4=HCl 5=Na2S2O3 6=Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: SOOP	SDG/AR/COC/Work Order: 610888 / 610893 / 610889 S.R.
Received By: THYASIA TATUM	Date Received: 2/14/23
Carrier and Tracking Number	Circle Applicable: FedEx Express FedEx Ground UPS Field Services Courier Other

Suspected Hazard Information	Yes	No	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:

Sample Receipt Criteria		Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Preservation Method: Wet Ice Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius TEMP: 20
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Temperature Device Serial #: IR2-20 Secondary Temperature Device Serial # (If Applicable):
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#:
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)
					Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
					Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and tests affected:
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and containers affected:
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

PM (or PMA) review: Initials JM Date 2-16-23 Page 1 of 1

List of current GEL Certifications as of 20 February 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



March 13, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 610893

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on February 14, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 610893 GEL Work Order: 610893

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF55969	Project: SOOP00119
Sample ID: 610893001	Client ID: SOOP001
Matrix: GW	
Collect Date: 08-FEB-23 11:41	
Receive Date: 14-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.878	+/-1.30	2.23	3.00	pCi/L		JE1	03/09/23	1043	2387247		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.41	+/-1.34			pCi/L		NXL1	03/13/23	0838	2387244		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.529	+/-0.332	0.434	1.00	pCi/L		LXP1	03/12/23	0949	2387198		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			67.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: March 13, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF55970	Project: SOOP00119
Sample ID: 610893002	Client ID: SOOP001
Matrix: GW	
Collect Date: 08-FEB-23 11:46	
Receive Date: 14-FEB-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.63	+/-1.47	2.24	3.00	pCi/L		JE1	03/09/23	1044	2387247	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.56	+/-1.52			pCi/L		NXL1	03/13/23	0838	2387244	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.934	+/-0.398	0.311	1.00	pCi/L		LXP1	03/12/23	0949	2387198	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			83.2	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: March 13, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact: Ms. Jeanette Gilmetti

Workorder: 610893

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2387247										
QC1205326727	609452001	DUP									
Radium-228	U	-0.308	U	1.30	pCi/L	N/A		N/A	JE1	03/09/23	10:42
	Uncertainty	+/-1.10		+/-1.38							
QC1205326728	LCS										
Radium-228	62.6			65.2	pCi/L		104	(75%-125%)		03/09/23	10:42
	Uncertainty			+/-4.40							
QC1205326726	MB										
Radium-228			U	-0.360	pCi/L					03/09/23	10:41
	Uncertainty			+/-1.12							
Rad Ra-226											
Batch	2387198										
QC1205326617	609452001	DUP									
Radium-226		0.828		0.696	pCi/L	17.4		(0% - 100%)	LXP1	03/12/23	09:49
	Uncertainty	+/-0.353		+/-0.386							
QC1205326619	LCS										
Radium-226	26.4			25.2	pCi/L		95.6	(75%-125%)		03/12/23	10:21
	Uncertainty			+/-1.91							
QC1205326616	MB										
Radium-226			U	0.225	pCi/L					03/12/23	09:49
	Uncertainty			+/-0.247							
QC1205326618	609452001	MS									
Radium-226	129	0.828		111	pCi/L		84.9	(75%-125%)		03/12/23	09:49
	Uncertainty	+/-0.353		+/-8.55							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 610893

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 610893**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2387247

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610893001	AF55969
610893002	AF55970
1205326726	Method Blank (MB)
1205326727	609452001(AF54559) Sample Duplicate (DUP)
1205326728	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

Sample results verify with historical activity.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2387198

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
610893001	AF55969
610893002	AF55970
1205326616	Method Blank (MB)
1205326617	609452001(AF54559) Sample Duplicate (DUP)
1205326618	609452001(AF54559) Matrix Spike (MS)
1205326619	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information**Additional Comments**

The matrix spike, 1205326618 (AF54559MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

610893

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 3 / 14 / 23 Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody

santecooper
Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone: (843)761-8000 Ext. 5148
Fax: (843)761-4175

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LCWILLIA @santecooper.com _____ / _____ / _____ 121567 / JM02.09.G01 / 36500 Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix:(see below)	Preservative (see below)	Comments	RAD 226/228	TOTAL-RAD CALC
AF55969	C3LF LEACH	2/8/23	1141	MDS MD	2	P	G	GW	2	• Method # • Reporting limit • Misc. sample info • Any other notes	X	X
AF55970	C3LF LEACH DUP	1	1146	1	1	1	1	1	1		X	X

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sjbrown</i>	35594	2/14/23	0940	<i>[Signature]</i>	GEL	2/14/23	0940
<i>[Signature]</i>	GEL	2/14/23	1530	<i>Thyrcia Tatum</i>	GEL	2/14/23	1530
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input checked="" type="checkbox"/> Rad 226 <input checked="" type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard <input type="checkbox"/> Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: SOOP	SDG/AR/COC/Work Order: 610888/610893/610889 S.R.
Received By: THYASIA TATUM	Date Received: 2/14/23
Carrier and Tracking Number	Circle Applicable: FedEx Express FedEx Ground UPS Field Services <input checked="" type="radio"/> Courier Other

Suspected Hazard Information	Yes	No	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:

Sample Receipt Criteria		Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Preservation Method: <input checked="" type="radio"/> Wet Ice <input type="radio"/> Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius TEMP: 2C
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Temperature Device Serial #: <u>IR2-20</u> Secondary Temperature Device Serial # (If Applicable):
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#:
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)
					Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
					Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and tests affected:
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and containers affected:
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

PM (or PMA) review: Initials JM Date 2-16-23 Page 1 of 1

List of current GEL Certifications as of 13 March 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



April 21, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 615744

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on March 24, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 615744 GEL Work Order: 615744

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: April 21, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF58977 Project: SOOP00119
Sample ID: 615744001 Client ID: SOOP001
Matrix: GW
Collect Date: 20-MAR-23 10:37
Receive Date: 24-MAR-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		4.50	+/-1.32	1.50	3.00	pCi/L		JE1	04/10/23	1452	2406252	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		7.77	+/-1.71			pCi/L		1 TON1	04/21/23	0707	2407955	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		3.26	+/-1.08	0.794	1.00	pCi/L		LXP1	04/17/23	0854	2406211	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			79.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: April 21, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF58978 Project: SOOP00119
Sample ID: 615744002 Client ID: SOOP001
Matrix: GW
Collect Date: 20-MAR-23 10:42
Receive Date: 24-MAR-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		5.38	+/-1.79	2.46	3.00	pCi/L			JE1	04/10/23	1452 2406252	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		6.25	+/-1.85			pCi/L		1	TON1	04/21/23	0707 2407955	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.872	+/-0.463	0.409	1.00	pCi/L			LXP1	04/17/23	0854 2406211	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			76.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: April 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF58979	Project: SOOP00119
Sample ID: 615744003	Client ID: SOOP001
Matrix: GW	
Collect Date: 20-MAR-23 09:28	
Receive Date: 24-MAR-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.713	+/-1.24	2.14	3.00	pCi/L			JE1	04/10/23	1452	2406252	1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.13	+/-1.28			pCi/L		1	TON1	04/21/23	0707	2407955	2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.421	+/-0.343	0.422	1.00	pCi/L			LXP1	04/17/23	0854	2406211	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			83.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: April 21, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 615744

Parname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2406252										
QC1205361128	615744001	DUP									
Radium-228		4.50		3.72	pCi/L	19.2		(0% - 100%)	JE1	04/10/23	14:51
		Uncertainty	+/-1.32	+/-1.24							
QC1205361129	LCS										
Radium-228		83.3		75.2	pCi/L		90.3	(75%-125%)		04/10/23	14:51
		Uncertainty		+/-4.62							
QC1205361127	MB										
Radium-228			U	0.402	pCi/L					04/10/23	14:50
		Uncertainty		+/-1.31							
Rad Ra-226											
Batch	2406211										
QC1205361066	615744001	DUP									
Radium-226		3.26		1.36	pCi/L	82.4		(0% - 100%)	LXP1	04/17/23	09:29
		Uncertainty	+/-1.08	+/-0.560							
QC1205361068	LCS										
Radium-226		26.5		23.5	pCi/L		88.7	(75%-125%)		04/17/23	09:29
		Uncertainty		+/-2.35							
QC1205361065	MB										
Radium-226			U	-0.0363	pCi/L					04/17/23	09:29
		Uncertainty		+/-0.188							
QC1205361067	615744001	MS									
Radium-226		132	3.26	117	pCi/L		86	(75%-125%)		04/17/23	09:29
		Uncertainty	+/-1.08	+/-11.4							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 615744

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 615744**

Product: Radium-226+Radium-228 Calculation

Analytical Method: Calculation

Analytical Procedure: GL-RAD-D-003 REV# 45

Analytical Batch: 2407955

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
615744001	AF58977
615744002	AF58978
615744003	AF58979

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2406252

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
615744001	AF58977
615744002	AF58978
615744003	AF58979
1205361127	Method Blank (MB)
1205361128	615744001(AF58977) Sample Duplicate (DUP)
1205361129	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2406211

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
615744001	AF58977
615744002	AF58978
615744003	AF58979
1205361065	Method Blank (MB)
1205361066	615744001(AF58977) Sample Duplicate (DUP)
1205361067	615744001(AF58977) Matrix Spike (MS)
1205361068	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

The matrix spike, 1205361067 (AF58977MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Chain of Custody



Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: / / Project/Task/Unit #: 125915 / JM02-09.G61.1 / 36500 Rerun request for any flagged QC: Yes No

Analysis Group


Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	RAD 226/228	TOTAL RAD CALC
AF58977	CGYP-7	3/20/23	1037	EDM BSP	2	P	G	GW	2	• Method # • Reporting limit • Misc. sample info • Any other notes	X	X
78	CGYP-7D		1042									
79	POZ-3		0928									

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sj Brown</i>	35594	3/24/23	1030	<i>[Signature]</i>	GEL	3/24/23	1020
<i>[Signature]</i>	GEL	3/24/23	1135	<i>[Signature]</i>	GEL	3/24/23	1635

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code: 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)



SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOC</u>		SDG/AR/COC/Work Order: <u>615 744</u>		
Received By: <u>QG</u>		Date Received: <u>3/24/23</u>		
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other		
Suspected Hazard Information		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.		
A) Shipped as a DOT Hazardous?		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___		
B) Did the client designate the samples are to be received as radioactive?		COC notation or radioactive stickers on containers equal client designation.		
C) Did the RSO classify the samples as radioactive?		Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0.0</u> CPM/mR/Hr Classified as: Rad 1 Rad 2 Rad 3		
D) Did the client designate samples are hazardous?		COC notation or hazard labels on containers equal client designation.		
E) Did the RSO identify possible hazards?		If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:		
Sample Receipt Criteria		Yes	NA	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Preservation Method: <u>Wet Ice</u> Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius TEMP: <u>4°C</u>
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Temperature Device Serial #: <u>IR3-23</u> Secondary Temperature Device Serial # (If Applicable):
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#:
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and tests affected:
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and containers affected:
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed):				

PM (or PMA) review: Initials JMM Date 3/27/23 Page 1 of 1

List of current GEL Certifications as of 21 April 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 2/28/2023 9:56:23 AM

JOB DESCRIPTION

125915/JM02.09 G01.1/36500

JOB NUMBER

680-230663-1


Eurofins Savannah

Job Notes

The test results in this report meet NELAP requirements for parameters for which accreditation is required or available. Any exceptions to the NELAP requirements are noted. Results pertain only to samples listed in this report. This report may not be reproduced, except in full, without the written approval of the laboratory. Questions should be directed to the person who signed this report.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
2/28/2023 9:56:23 AM

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	34
QC Sample Results	120
QC Association	134
Chronicle	145
Chain of Custody	160
Receipt Checklists	165
Certification Summary	166



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Job ID: 680-230663-1

Laboratory: Eurofins Savannah

Narrative

Job Narrative 680-230663-1

Receipt

The samples were received on 2/16/2023 11:00 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 18.1°C

Metals

Samples AF54563 (680-230663-19), AF54586 (680-230663-25), AF54604 (680-230663-32), AF54592 (680-230663-39), and AF54565 (680-230663-41), failed MS/MSD and were re-prepped and reported to confirm results per client request. Both sets of data have been reported.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.



Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-230663-1	AF54593	Water	01/26/23 09:38	02/16/23 11:00
680-230663-2	AF54594	Water	01/26/23 09:43	02/16/23 11:00
680-230663-3	AF54582	Water	01/26/23 11:19	02/16/23 11:00
680-230663-4	AF54583	Water	01/26/23 13:00	02/16/23 11:00
680-230663-5	AF54595	Water	01/25/23 11:00	02/16/23 11:00
680-230663-6	AF54596	Water	01/25/23 09:54	02/16/23 11:00
680-230663-7	AF54572	Water	01/24/23 11:46	02/16/23 11:00
680-230663-8	AF54597	Water	01/24/23 15:40	02/16/23 11:00
680-230663-9	AF54598	Water	01/24/23 13:27	02/16/23 11:00
680-230663-10	AF54600	Water	01/24/23 10:18	02/16/23 11:00
680-230663-11	AF54570	Water	01/31/23 12:49	02/16/23 11:00
680-230663-12	AF54601	Water	01/31/23 11:17	02/16/23 11:00
680-230663-13	AF54605	Water	01/31/23 09:40	02/16/23 11:00
680-230663-14	AF54606	Water	01/31/23 09:45	02/16/23 11:00
680-230663-15	AF54559	Water	02/01/23 09:34	02/16/23 11:00
680-230663-16	AF54560	Water	02/01/23 11:13	02/16/23 11:00
680-230663-17	AF54561	Water	02/01/23 12:32	02/16/23 11:00
680-230663-18	AF54562	Water	02/01/23 13:44	02/16/23 11:00
680-230663-19	AF54563	Water	02/01/23 14:52	02/16/23 11:00
680-230663-20	AF54603	Water	01/30/23 13:08	02/16/23 11:00
680-230663-21	AF54558	Water	01/31/23 15:41	02/16/23 11:00
680-230663-22	AF54571	Water	01/31/23 14:05	02/16/23 11:00
680-230663-23	AF54599	Water	01/24/23 14:38	02/16/23 11:00
680-230663-24	AF54557	Water	02/06/23 11:39	02/16/23 11:00
680-230663-25	AF54586	Water	02/06/23 14:02	02/16/23 11:00
680-230663-26	AF54587	Water	02/06/23 14:07	02/16/23 11:00
680-230663-27	AF54588	Water	02/06/23 12:55	02/16/23 11:00
680-230663-28	AF54589	Water	02/06/23 15:32	02/16/23 11:00
680-230663-29	AF54568	Water	02/06/23 09:17	02/16/23 11:00
680-230663-30	AF54569	Water	02/06/23 10:19	02/16/23 11:00
680-230663-31	AF54602	Water	01/30/23 11:26	02/16/23 11:00
680-230663-32	AF54604	Water	01/30/23 09:37	02/16/23 11:00
680-230663-33	AF54607	Water	01/30/23 14:10	02/16/23 11:00
680-230663-34	AF54574	Water	02/07/23 14:17	02/16/23 11:00
680-230663-35	AF54580	Water	02/07/23 13:08	02/16/23 11:00
680-230663-36	AF54584	Water	02/07/23 15:22	02/16/23 11:00
680-230663-37	AF54585	Water	02/07/23 10:24	02/16/23 11:00
680-230663-38	AF54591	Water	02/07/23 11:40	02/16/23 11:00
680-230663-39	AF54592	Water	02/07/23 09:14	02/16/23 11:00
680-230663-40	AF54564	Water	02/02/23 09:42	02/16/23 11:00
680-230663-41	AF54565	Water	02/02/23 11:13	02/16/23 11:00
680-230663-42	AF54566	Water	02/02/23 11:18	02/16/23 11:00
680-230663-43	AF54567	Water	02/02/23 13:21	02/16/23 11:00

Method Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method	Method Description	Protocol	Laboratory
6020B	Metals (ICP/MS)	SW846	EET SAV
7470A	Mercury (CVAA)	SW846	EET SAV
3005A	Preparation, Total Recoverable or Dissolved Metals	SW846	EET SAV
7470A	Preparation, Mercury	SW846	EET SAV

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Qualifiers

Metals	
Qualifier	Qualifier Description
4	MS, MSD: The analyte present in the original sample is greater than 4 times the matrix spike concentration; therefore, control limits are not applicable.
F1	MS and/or MSD recovery exceeds control limits.
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
▫	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54593

Lab Sample ID: 680-230663-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	127		5.00		ug/L	1		6020B	Total Recoverable
Calcium	188000		500		ug/L	1		6020B	Total Recoverable
Cobalt	1.98		0.500		ug/L	1		6020B	Total Recoverable
Magnesium	3050		250		ug/L	1		6020B	Total Recoverable
Manganese	77.8		5.00		ug/L	1		6020B	Total Recoverable
Sodium	23300		500		ug/L	1		6020B	Total Recoverable
Zinc	25.3		20.0		ug/L	1		6020B	Total Recoverable
Barium	130		5.00		ug/L	1		6020B	Dissolved
Calcium	180000		500		ug/L	1		6020B	Dissolved
Cobalt	1.93		0.500		ug/L	1		6020B	Dissolved
Magnesium	3010		250		ug/L	1		6020B	Dissolved
Manganese	76.7		5.00		ug/L	1		6020B	Dissolved
Sodium	22800		500		ug/L	1		6020B	Dissolved
Zinc	25.7		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54594

Lab Sample ID: 680-230663-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	135		5.00		ug/L	1		6020B	Total Recoverable
Calcium	193000		500		ug/L	1		6020B	Total Recoverable
Cobalt	2.25		0.500		ug/L	1		6020B	Total Recoverable
Magnesium	3250		250		ug/L	1		6020B	Total Recoverable
Manganese	91.1		5.00		ug/L	1		6020B	Total Recoverable
Sodium	26000		500		ug/L	1		6020B	Total Recoverable
Zinc	96.1		20.0		ug/L	1		6020B	Total Recoverable
Barium	125		5.00		ug/L	1		6020B	Dissolved
Calcium	178000		500		ug/L	1		6020B	Dissolved
Cobalt	2.00		0.500		ug/L	1		6020B	Dissolved
Magnesium	2960		250		ug/L	1		6020B	Dissolved
Manganese	84.7		5.00		ug/L	1		6020B	Dissolved
Sodium	23700		500		ug/L	1		6020B	Dissolved
Zinc	61.4		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54582

Lab Sample ID: 680-230663-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	151		5.00		ug/L	1		6020B	Total Recoverable
Calcium	29000		500		ug/L	1		6020B	Total Recoverable
Cobalt	7.28		0.500		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54582 (Continued)

Lab Sample ID: 680-230663-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Magnesium	2410		250		ug/L	1		6020B	Total Recoverable
Manganese	301		5.00		ug/L	1		6020B	Total Recoverable
Potassium	1630		1000		ug/L	1		6020B	Total Recoverable
Sodium	8780		500		ug/L	1		6020B	Total Recoverable
Barium	155		5.00		ug/L	1		6020B	Dissolved
Calcium	31300		500		ug/L	1		6020B	Dissolved
Cobalt	7.73		0.500		ug/L	1		6020B	Dissolved
Magnesium	2540		250		ug/L	1		6020B	Dissolved
Manganese	312		5.00		ug/L	1		6020B	Dissolved
Potassium	1680		1000		ug/L	1		6020B	Dissolved
Sodium	9490		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54583

Lab Sample ID: 680-230663-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	38.5		5.00		ug/L	1		6020B	Total Recoverable
Calcium	54200		500		ug/L	1		6020B	Total Recoverable
Iron	1640		100		ug/L	1		6020B	Total Recoverable
Magnesium	1280		250		ug/L	1		6020B	Total Recoverable
Manganese	70.1		5.00		ug/L	1		6020B	Total Recoverable
Potassium	1190		1000		ug/L	1		6020B	Total Recoverable
Sodium	3860		500		ug/L	1		6020B	Total Recoverable
Barium	41.2		5.00		ug/L	1		6020B	Dissolved
Calcium	57200		500		ug/L	1		6020B	Dissolved
Magnesium	1390		250		ug/L	1		6020B	Dissolved
Manganese	66.7		5.00		ug/L	1		6020B	Dissolved
Potassium	1230		1000		ug/L	1		6020B	Dissolved
Sodium	4330		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54595

Lab Sample ID: 680-230663-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	177		5.00		ug/L	1		6020B	Total Recoverable
Calcium	147000		500		ug/L	1		6020B	Total Recoverable
Cobalt	1.85		0.500		ug/L	1		6020B	Total Recoverable
Iron	165		100		ug/L	1		6020B	Total Recoverable
Magnesium	2250		250		ug/L	1		6020B	Total Recoverable
Manganese	85.5		5.00		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54595 (Continued)

Lab Sample ID: 680-230663-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Sodium	10600		500		ug/L	1		6020B	Total Recoverable
Barium	186		5.00		ug/L	1		6020B	Dissolved
Calcium	156000		500		ug/L	1		6020B	Dissolved
Cobalt	1.94		0.500		ug/L	1		6020B	Dissolved
Iron	105		100		ug/L	1		6020B	Dissolved
Magnesium	2450		250		ug/L	1		6020B	Dissolved
Manganese	89.3		5.00		ug/L	1		6020B	Dissolved
Sodium	11800		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54596

Lab Sample ID: 680-230663-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	64.5		5.00		ug/L	1		6020B	Total Recoverable
Calcium	208000		500		ug/L	1		6020B	Total Recoverable
Cobalt	19.1		0.500		ug/L	1		6020B	Total Recoverable
Iron	2140		100		ug/L	1		6020B	Total Recoverable
Magnesium	5530		250		ug/L	1		6020B	Total Recoverable
Manganese	547		5.00		ug/L	1		6020B	Total Recoverable
Sodium	9880		500		ug/L	1		6020B	Total Recoverable
Barium	67.3		5.00		ug/L	1		6020B	Dissolved
Calcium	202000		500		ug/L	1		6020B	Dissolved
Cobalt	17.6		0.500		ug/L	1		6020B	Dissolved
Iron	174		100		ug/L	1		6020B	Dissolved
Magnesium	5200		250		ug/L	1		6020B	Dissolved
Manganese	504		5.00		ug/L	1		6020B	Dissolved
Sodium	9020		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54572

Lab Sample ID: 680-230663-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	752		100		ug/L	1		6020B	Total Recoverable
Barium	42.5		5.00		ug/L	1		6020B	Total Recoverable
Calcium	29300		500		ug/L	1		6020B	Total Recoverable
Cobalt	0.760		0.500		ug/L	1		6020B	Total Recoverable
Lead	2.59		2.50		ug/L	1		6020B	Total Recoverable
Magnesium	2290		250		ug/L	1		6020B	Total Recoverable
Manganese	28.9		5.00		ug/L	1		6020B	Total Recoverable
Sodium	8620		500		ug/L	1		6020B	Total Recoverable
Zinc	241		20.0		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54572 (Continued)

Lab Sample ID: 680-230663-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	645		100		ug/L	1		6020B	Dissolved
Barium	42.6		5.00		ug/L	1		6020B	Dissolved
Calcium	30600		500		ug/L	1		6020B	Dissolved
Cobalt	0.765		0.500		ug/L	1		6020B	Dissolved
Magnesium	2280		250		ug/L	1		6020B	Dissolved
Manganese	28.6		5.00		ug/L	1		6020B	Dissolved
Sodium	8710		500		ug/L	1		6020B	Dissolved
Zinc	234		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54597

Lab Sample ID: 680-230663-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	56.6		5.00		ug/L	1		6020B	Total Recoverable
Calcium	133000		500		ug/L	1		6020B	Total Recoverable
Magnesium	3210		250		ug/L	1		6020B	Total Recoverable
Sodium	12600		500		ug/L	1		6020B	Total Recoverable
Barium	57.5		5.00		ug/L	1		6020B	Dissolved
Calcium	136000		500		ug/L	1		6020B	Dissolved
Magnesium	3300		250		ug/L	1		6020B	Dissolved
Sodium	12900		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54598

Lab Sample ID: 680-230663-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	109		5.00		ug/L	1		6020B	Total Recoverable
Calcium	289000		500		ug/L	1		6020B	Total Recoverable
Cobalt	2.24		0.500		ug/L	1		6020B	Total Recoverable
Iron	928		100		ug/L	1		6020B	Total Recoverable
Magnesium	5010		250		ug/L	1		6020B	Total Recoverable
Manganese	169		5.00		ug/L	1		6020B	Total Recoverable
Sodium	21100		500		ug/L	1		6020B	Total Recoverable
Barium	108		5.00		ug/L	1		6020B	Dissolved
Calcium	283000		500		ug/L	1		6020B	Dissolved
Cobalt	2.18		0.500		ug/L	1		6020B	Dissolved
Iron	617		100		ug/L	1		6020B	Dissolved
Magnesium	4990		250		ug/L	1		6020B	Dissolved
Manganese	164		5.00		ug/L	1		6020B	Dissolved
Sodium	21100		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54600

Lab Sample ID: 680-230663-10

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Arsenic	3.32		3.00		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54600 (Continued)

Lab Sample ID: 680-230663-10

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	80.8		5.00		ug/L	1		6020B	Total
									Recoverable
Calcium	12600		500		ug/L	1		6020B	Total
									Recoverable
Cobalt	1.36		0.500		ug/L	1		6020B	Total
									Recoverable
Iron	11100		100		ug/L	1		6020B	Total
									Recoverable
Magnesium	717		250		ug/L	1		6020B	Total
									Recoverable
Manganese	10.7		5.00		ug/L	1		6020B	Total
									Recoverable
Sodium	6540		500		ug/L	1		6020B	Total
									Recoverable
Barium	76.3		5.00		ug/L	1		6020B	Dissolved
Calcium	12300		500		ug/L	1		6020B	Dissolved
Cobalt	1.18		0.500		ug/L	1		6020B	Dissolved
Iron	10100		100		ug/L	1		6020B	Dissolved
Magnesium	712		250		ug/L	1		6020B	Dissolved
Manganese	10.0		5.00		ug/L	1		6020B	Dissolved
Sodium	6260		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54570

Lab Sample ID: 680-230663-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	199		5.00		ug/L	1		6020B	Total
									Recoverable
Calcium	55900		500		ug/L	1		6020B	Total
									Recoverable
Iron	9860		100		ug/L	1		6020B	Total
									Recoverable
Magnesium	2550		250		ug/L	1		6020B	Total
									Recoverable
Manganese	65.9		5.00		ug/L	1		6020B	Total
									Recoverable
Potassium	1690		1000		ug/L	1		6020B	Total
									Recoverable
Sodium	6170		500		ug/L	1		6020B	Total
									Recoverable
Barium	197		5.00		ug/L	1		6020B	Dissolved
Calcium	54500		500		ug/L	1		6020B	Dissolved
Iron	6990		100		ug/L	1		6020B	Dissolved
Magnesium	2520		250		ug/L	1		6020B	Dissolved
Manganese	64.3		5.00		ug/L	1		6020B	Dissolved
Potassium	1670		1000		ug/L	1		6020B	Dissolved
Sodium	6070		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54601

Lab Sample ID: 680-230663-12

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	96.3		5.00		ug/L	1		6020B	Total
									Recoverable
Calcium	193000		500		ug/L	1		6020B	Total
									Recoverable
Cobalt	0.865		0.500		ug/L	1		6020B	Total
									Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54601 (Continued)

Lab Sample ID: 680-230663-12

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Magnesium	8500		250		ug/L	1		6020B	Total Recoverable
Manganese	23.0		5.00		ug/L	1		6020B	Total Recoverable
Sodium	49900		500		ug/L	1		6020B	Total Recoverable
Barium	103		5.00		ug/L	1		6020B	Dissolved
Calcium	206000		500		ug/L	1		6020B	Dissolved
Cobalt	0.990		0.500		ug/L	1		6020B	Dissolved
Magnesium	9490		250		ug/L	1		6020B	Dissolved
Manganese	38.1		5.00		ug/L	1		6020B	Dissolved
Sodium	54000		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54605

Lab Sample ID: 680-230663-13

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	95.1		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	0.735		0.500		ug/L	1		6020B	Total Recoverable
Calcium	7570		500		ug/L	1		6020B	Total Recoverable
Cobalt	1.40		0.500		ug/L	1		6020B	Total Recoverable
Magnesium	732		250		ug/L	1		6020B	Total Recoverable
Manganese	11.5		5.00		ug/L	1		6020B	Total Recoverable
Potassium	2150		1000		ug/L	1		6020B	Total Recoverable
Sodium	7380		500		ug/L	1		6020B	Total Recoverable
Barium	99.2		5.00		ug/L	1		6020B	Dissolved
Beryllium	0.835		0.500		ug/L	1		6020B	Dissolved
Calcium	7850		500		ug/L	1		6020B	Dissolved
Cobalt	1.18		0.500		ug/L	1		6020B	Dissolved
Magnesium	755		250		ug/L	1		6020B	Dissolved
Manganese	8.08		5.00		ug/L	1		6020B	Dissolved
Potassium	2230		1000		ug/L	1		6020B	Dissolved
Sodium	7610		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54606

Lab Sample ID: 680-230663-14

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	106		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	0.755		0.500		ug/L	1		6020B	Total Recoverable
Calcium	9840		500		ug/L	1		6020B	Total Recoverable
Cobalt	1.22		0.500		ug/L	1		6020B	Total Recoverable
Magnesium	857		250		ug/L	1		6020B	Total Recoverable
Manganese	9.62		5.00		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54606 (Continued)

Lab Sample ID: 680-230663-14

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Potassium	2240		1000		ug/L	1		6020B	Total Recoverable
Sodium	7810		500		ug/L	1		6020B	Total Recoverable
Barium	105		5.00		ug/L	1		6020B	Dissolved
Beryllium	0.775		0.500		ug/L	1		6020B	Dissolved
Calcium	11200		500		ug/L	1		6020B	Dissolved
Cobalt	1.14		0.500		ug/L	1		6020B	Dissolved
Magnesium	900		250		ug/L	1		6020B	Dissolved
Manganese	8.35		5.00		ug/L	1		6020B	Dissolved
Potassium	2180		1000		ug/L	1		6020B	Dissolved
Sodium	7790		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54559

Lab Sample ID: 680-230663-15

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	45.4		5.00		ug/L	1		6020B	Total Recoverable
Calcium	652000		5000		ug/L	10		6020B	Total Recoverable
Cobalt	32.7		0.500		ug/L	1		6020B	Total Recoverable
Iron	2520		100		ug/L	1		6020B	Total Recoverable
Magnesium	67400		250		ug/L	1		6020B	Total Recoverable
Manganese	4580		5.00		ug/L	1		6020B	Total Recoverable
Nickel	12.7		5.00		ug/L	1		6020B	Total Recoverable
Potassium	4500		1000		ug/L	1		6020B	Total Recoverable
Sodium	96200		500		ug/L	1		6020B	Total Recoverable
Zinc	37.8		20.0		ug/L	1		6020B	Total Recoverable
Barium	52.7		5.00		ug/L	1		6020B	Dissolved
Calcium	711000		5000		ug/L	10		6020B	Dissolved
Cobalt	36.0		0.500		ug/L	1		6020B	Dissolved
Iron	3900		100		ug/L	1		6020B	Dissolved
Magnesium	75400		250		ug/L	1		6020B	Dissolved
Manganese	5080		5.00		ug/L	1		6020B	Dissolved
Nickel	15.1		5.00		ug/L	1		6020B	Dissolved
Potassium	5120		1000		ug/L	1		6020B	Dissolved
Sodium	107000		500		ug/L	1		6020B	Dissolved
Zinc	32.1		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54560

Lab Sample ID: 680-230663-16

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	125		5.00		ug/L	1		6020B	Total Recoverable
Calcium	709000		5000		ug/L	10		6020B	Total Recoverable
Iron	12800		100		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54560 (Continued)

Lab Sample ID: 680-230663-16

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Magnesium	76200		250		ug/L	1		6020B	Total Recoverable
Manganese	623		5.00		ug/L	1		6020B	Total Recoverable
Potassium	8410		1000		ug/L	1		6020B	Total Recoverable
Sodium	129000		500		ug/L	1		6020B	Total Recoverable
Barium	121		5.00		ug/L	1		6020B	Dissolved
Calcium	723000		5000		ug/L	10		6020B	Dissolved
Iron	11900		100		ug/L	1		6020B	Dissolved
Magnesium	75200		250		ug/L	1		6020B	Dissolved
Manganese	622		5.00		ug/L	1		6020B	Dissolved
Potassium	8290		1000		ug/L	1		6020B	Dissolved
Sodium	128000		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54561

Lab Sample ID: 680-230663-17

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	6150		100		ug/L	1		6020B	Total Recoverable
Barium	1580		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	5.53		0.500		ug/L	1		6020B	Total Recoverable
Calcium	167000		500		ug/L	1		6020B	Total Recoverable
Cobalt	17.1		0.500		ug/L	1		6020B	Total Recoverable
Iron	140000		100		ug/L	1		6020B	Total Recoverable
Lead	7.05		2.50		ug/L	1		6020B	Total Recoverable
Magnesium	4490		250		ug/L	1		6020B	Total Recoverable
Manganese	80.4		5.00		ug/L	1		6020B	Total Recoverable
Nickel	24.7		5.00		ug/L	1		6020B	Total Recoverable
Sodium	88600		500		ug/L	1		6020B	Total Recoverable
Aluminum	5830		100		ug/L	1		6020B	Dissolved
Barium	1500		5.00		ug/L	1		6020B	Dissolved
Beryllium	5.20		0.500		ug/L	1		6020B	Dissolved
Calcium	163000		500		ug/L	1		6020B	Dissolved
Cobalt	16.5		0.500		ug/L	1		6020B	Dissolved
Iron	137000		100		ug/L	1		6020B	Dissolved
Lead	6.33		2.50		ug/L	1		6020B	Dissolved
Magnesium	4330		250		ug/L	1		6020B	Dissolved
Manganese	75.2		5.00		ug/L	1		6020B	Dissolved
Nickel	23.4		5.00		ug/L	1		6020B	Dissolved
Potassium	1010		1000		ug/L	1		6020B	Dissolved
Sodium	84900		500		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54562

Lab Sample ID: 680-230663-18

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	298		5.00		ug/L	1		6020B	Total
									Recoverable
Calcium	488000		5000		ug/L	10		6020B	Total
									Recoverable
Iron	15200		100		ug/L	1		6020B	Total
									Recoverable
Magnesium	14300		250		ug/L	1		6020B	Total
									Recoverable
Manganese	373		5.00		ug/L	1		6020B	Total
									Recoverable
Potassium	1510		1000		ug/L	1		6020B	Total
									Recoverable
Sodium	73400		500		ug/L	1		6020B	Total
									Recoverable
Barium	290		5.00		ug/L	1		6020B	Dissolved
Calcium	485000		5000		ug/L	10		6020B	Dissolved
Iron	14100		100		ug/L	1		6020B	Dissolved
Magnesium	14500		250		ug/L	1		6020B	Dissolved
Manganese	355		5.00		ug/L	1		6020B	Dissolved
Potassium	1530		1000		ug/L	1		6020B	Dissolved
Sodium	71900		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54563

Lab Sample ID: 680-230663-19

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	191		100		ug/L	1		6020B	Total
									Recoverable
Arsenic	3.35		3.00		ug/L	1		6020B	Total
									Recoverable
Barium	49.7		5.00		ug/L	1		6020B	Total
									Recoverable
Calcium	1180000		5000		ug/L	10		6020B	Total
									Recoverable
Cobalt	10.4		0.500		ug/L	1		6020B	Total
									Recoverable
Iron	245000		100		ug/L	1		6020B	Total
									Recoverable
Magnesium	364000		250		ug/L	1		6020B	Total
									Recoverable
Manganese	10100		5.00		ug/L	1		6020B	Total
									Recoverable
Potassium	19400		1000		ug/L	1		6020B	Total
									Recoverable
Sodium	202000		500		ug/L	1		6020B	Total
									Recoverable
Aluminum	170		100		ug/L	1		6020B	Dissolved
Aluminum	175		100		ug/L	1		6020B	Dissolved
Barium	56.0		5.00		ug/L	1		6020B	Dissolved
Barium	57.1		5.00		ug/L	1		6020B	Dissolved
Calcium	1200000		5000		ug/L	10		6020B	Dissolved
Calcium	1110000		5000		ug/L	10		6020B	Dissolved
Cobalt	9.88		0.500		ug/L	1		6020B	Dissolved
Cobalt	10.6		0.500		ug/L	1		6020B	Dissolved
Iron	234000		100		ug/L	1		6020B	Dissolved
Iron	233000		100		ug/L	1		6020B	Dissolved
Magnesium	335000		250		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54563 (Continued)

Lab Sample ID: 680-230663-19

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Magnesium	354000		250		ug/L	1		6020B	Dissolved
Manganese	9280		5.00		ug/L	1		6020B	Dissolved
Manganese	9800		5.00		ug/L	1		6020B	Dissolved
Nickel	5.40		5.00		ug/L	1		6020B	Dissolved
Potassium	18000		1000		ug/L	1		6020B	Dissolved
Potassium	18500		1000		ug/L	1		6020B	Dissolved
Sodium	186000		500		ug/L	1		6020B	Dissolved
Sodium	185000		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54603

Lab Sample ID: 680-230663-20

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	63.6		5.00		ug/L	1		6020B	Total Recoverable
Calcium	783000		5000		ug/L	10		6020B	Total Recoverable
Cobalt	9.40		0.500		ug/L	1		6020B	Total Recoverable
Iron	10600		100		ug/L	1		6020B	Total Recoverable
Magnesium	12400		250		ug/L	1		6020B	Total Recoverable
Manganese	2100		5.00		ug/L	1		6020B	Total Recoverable
Potassium	1570		1000		ug/L	1		6020B	Total Recoverable
Sodium	102000		500		ug/L	1		6020B	Total Recoverable
Barium	68.7		5.00		ug/L	1		6020B	Dissolved
Calcium	789000		5000		ug/L	10		6020B	Dissolved
Cobalt	9.98		0.500		ug/L	1		6020B	Dissolved
Iron	10300		100		ug/L	1		6020B	Dissolved
Magnesium	13300		250		ug/L	1		6020B	Dissolved
Manganese	2220		5.00		ug/L	1		6020B	Dissolved
Potassium	1720		1000		ug/L	1		6020B	Dissolved
Sodium	108000		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54558

Lab Sample ID: 680-230663-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	42.0		5.00		ug/L	1		6020B	Total Recoverable
Calcium	797000		5000		ug/L	10		6020B	Total Recoverable
Cobalt	10.1		0.500		ug/L	1		6020B	Total Recoverable
Iron	2400		100		ug/L	1		6020B	Total Recoverable
Magnesium	65700		250		ug/L	1		6020B	Total Recoverable
Manganese	2200		5.00		ug/L	1		6020B	Total Recoverable
Nickel	10.3		5.00		ug/L	1		6020B	Total Recoverable
Potassium	5190		1000		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54558 (Continued)

Lab Sample ID: 680-230663-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Sodium	122000		500		ug/L	1		6020B	Total Recoverable
Barium	44.7		5.00		ug/L	1		6020B	Dissolved
Calcium	772000		5000		ug/L	10		6020B	Dissolved
Cobalt	10.8		0.500		ug/L	1		6020B	Dissolved
Iron	2230		100		ug/L	1		6020B	Dissolved
Magnesium	72300		250		ug/L	1		6020B	Dissolved
Manganese	2450		5.00		ug/L	1		6020B	Dissolved
Nickel	11.7		5.00		ug/L	1		6020B	Dissolved
Potassium	5520		1000		ug/L	1		6020B	Dissolved
Sodium	131000		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54571

Lab Sample ID: 680-230663-22

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	63.7		5.00		ug/L	1		6020B	Total Recoverable
Calcium	99900		500		ug/L	1		6020B	Total Recoverable
Iron	1350		100		ug/L	1		6020B	Total Recoverable
Magnesium	1560		250		ug/L	1		6020B	Total Recoverable
Manganese	56.0		5.00		ug/L	1		6020B	Total Recoverable
Sodium	7720		500		ug/L	1		6020B	Total Recoverable
Barium	63.0		5.00		ug/L	1		6020B	Dissolved
Calcium	101000		500		ug/L	1		6020B	Dissolved
Iron	526		100		ug/L	1		6020B	Dissolved
Magnesium	1570		250		ug/L	1		6020B	Dissolved
Manganese	56.9		5.00		ug/L	1		6020B	Dissolved
Sodium	7800		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54599

Lab Sample ID: 680-230663-23

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	18.7		5.00		ug/L	1		6020B	Total Recoverable
Calcium	66600		500		ug/L	1		6020B	Total Recoverable
Iron	247		100		ug/L	1		6020B	Total Recoverable
Magnesium	3080		250		ug/L	1		6020B	Total Recoverable
Manganese	52.4		5.00		ug/L	1		6020B	Total Recoverable
Potassium	3800		1000		ug/L	1		6020B	Total Recoverable
Sodium	6210		500		ug/L	1		6020B	Total Recoverable
Barium	21.6		5.00		ug/L	1		6020B	Dissolved
Calcium	66900		500		ug/L	1		6020B	Dissolved
Magnesium	2980		250		ug/L	1		6020B	Dissolved
Manganese	50.2		5.00		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54599 (Continued)

Lab Sample ID: 680-230663-23

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Potassium	3600		1000		ug/L	1		6020B	Dissolved
Sodium	6040		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54557

Lab Sample ID: 680-230663-24

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	8320		100		ug/L	1		6020B	Total Recoverable
Arsenic	3.12		3.00		ug/L	1		6020B	Total Recoverable
Barium	32.5		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	11.6		0.500		ug/L	1		6020B	Total Recoverable
Calcium	298000		500		ug/L	1		6020B	Total Recoverable
Cobalt	28.7		0.500		ug/L	1		6020B	Total Recoverable
Iron	67400		100		ug/L	1		6020B	Total Recoverable
Magnesium	9270		250		ug/L	1		6020B	Total Recoverable
Manganese	147		5.00		ug/L	1		6020B	Total Recoverable
Nickel	20.9		5.00		ug/L	1		6020B	Total Recoverable
Sodium	71100		500		ug/L	1		6020B	Total Recoverable
Zinc	28.4		20.0		ug/L	1		6020B	Total Recoverable
Aluminum	7570		100		ug/L	1		6020B	Dissolved
Arsenic	3.05		3.00		ug/L	1		6020B	Dissolved
Barium	32.3		5.00		ug/L	1		6020B	Dissolved
Beryllium	11.6		0.500		ug/L	1		6020B	Dissolved
Calcium	292000		500		ug/L	1		6020B	Dissolved
Cobalt	28.1		0.500		ug/L	1		6020B	Dissolved
Iron	65800		100		ug/L	1		6020B	Dissolved
Magnesium	9170		250		ug/L	1		6020B	Dissolved
Manganese	143		5.00		ug/L	1		6020B	Dissolved
Nickel	21.2		5.00		ug/L	1		6020B	Dissolved
Sodium	68800		500		ug/L	1		6020B	Dissolved
Zinc	29.8		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54586

Lab Sample ID: 680-230663-25

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	24100		100		ug/L	1		6020B	Total Recoverable
Arsenic	9.22		3.00		ug/L	1		6020B	Total Recoverable
Barium	17.1		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	4.24		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	1.01		0.500		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54586 (Continued)

Lab Sample ID: 680-230663-25

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	301000		500		ug/L	1		6020B	Total Recoverable
Cobalt	22.7		0.500		ug/L	1		6020B	Total Recoverable
Iron	81000		100		ug/L	1		6020B	Total Recoverable
Lead	23.4		2.50		ug/L	1		6020B	Total Recoverable
Magnesium	25100		250		ug/L	1		6020B	Total Recoverable
Manganese	351		5.00		ug/L	1		6020B	Total Recoverable
Nickel	12.1		5.00		ug/L	1		6020B	Total Recoverable
Potassium	2780		1000		ug/L	1		6020B	Total Recoverable
Sodium	10400		500		ug/L	1		6020B	Total Recoverable
Aluminum	21800		100		ug/L	1		6020B	Dissolved
Aluminum	21000		100		ug/L	1		6020B	Dissolved
Arsenic	8.49		3.00		ug/L	1		6020B	Dissolved
Arsenic	8.08		3.00		ug/L	1		6020B	Dissolved
Barium	15.9		5.00		ug/L	1		6020B	Dissolved
Barium	14.7		5.00		ug/L	1		6020B	Dissolved
Beryllium	3.84		0.500		ug/L	1		6020B	Dissolved
Beryllium	3.60		0.500		ug/L	1		6020B	Dissolved
Cadmium	0.885		0.500		ug/L	1		6020B	Dissolved
Cadmium	1.59		0.500		ug/L	1		6020B	Dissolved
Calcium	279000		500		ug/L	1		6020B	Dissolved
Calcium	258000		500		ug/L	1		6020B	Dissolved
Cobalt	20.7		0.500		ug/L	1		6020B	Dissolved
Cobalt	19.2		0.500		ug/L	1		6020B	Dissolved
Iron	74400		100		ug/L	1		6020B	Dissolved
Iron	69600		100		ug/L	1		6020B	Dissolved
Lead	21.2		2.50		ug/L	1		6020B	Dissolved
Lead	20.0		2.50		ug/L	1		6020B	Dissolved
Magnesium	22500		250		ug/L	1		6020B	Dissolved
Magnesium	21500		250		ug/L	1		6020B	Dissolved
Manganese	314		5.00		ug/L	1		6020B	Dissolved
Manganese	312		5.00		ug/L	1		6020B	Dissolved
Nickel	10.7		5.00		ug/L	1		6020B	Dissolved
Nickel	10.2		5.00		ug/L	1		6020B	Dissolved
Potassium	2520		1000		ug/L	1		6020B	Dissolved
Potassium	2340		1000		ug/L	1		6020B	Dissolved
Sodium	9110		500		ug/L	1		6020B	Dissolved
Sodium	8310		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54587

Lab Sample ID: 680-230663-26

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	23100		100		ug/L	1		6020B	Total Recoverable
Arsenic	9.22		3.00		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54587 (Continued)

Lab Sample ID: 680-230663-26

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	16.6		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	3.96		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	0.895		0.500		ug/L	1		6020B	Total Recoverable
Calcium	292000		500		ug/L	1		6020B	Total Recoverable
Cobalt	22.3		0.500		ug/L	1		6020B	Total Recoverable
Iron	77700		100		ug/L	1		6020B	Total Recoverable
Lead	22.7		2.50		ug/L	1		6020B	Total Recoverable
Magnesium	24500		250		ug/L	1		6020B	Total Recoverable
Manganese	343		5.00		ug/L	1		6020B	Total Recoverable
Nickel	12.1		5.00		ug/L	1		6020B	Total Recoverable
Potassium	2690		1000		ug/L	1		6020B	Total Recoverable
Sodium	10500		500		ug/L	1		6020B	Total Recoverable
Aluminum	20700		100		ug/L	1		6020B	Dissolved
Arsenic	8.02		3.00		ug/L	1		6020B	Dissolved
Barium	15.7		5.00		ug/L	1		6020B	Dissolved
Beryllium	3.87		0.500		ug/L	1		6020B	Dissolved
Cadmium	0.935		0.500		ug/L	1		6020B	Dissolved
Calcium	263000		500		ug/L	1		6020B	Dissolved
Cobalt	19.9		0.500		ug/L	1		6020B	Dissolved
Iron	69000		100		ug/L	1		6020B	Dissolved
Lead	20.0		2.50		ug/L	1		6020B	Dissolved
Magnesium	22300		250		ug/L	1		6020B	Dissolved
Manganese	305		5.00		ug/L	1		6020B	Dissolved
Nickel	10.8		5.00		ug/L	1		6020B	Dissolved
Potassium	2400		1000		ug/L	1		6020B	Dissolved
Sodium	9160		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54588

Lab Sample ID: 680-230663-27

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	53500		100		ug/L	1		6020B	Total Recoverable
Arsenic	7.95		3.00		ug/L	1		6020B	Total Recoverable
Barium	34.0		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	49.7		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	1.47		0.500		ug/L	1		6020B	Total Recoverable
Calcium	737000		5000		ug/L	10		6020B	Total Recoverable
Chromium	7.26		5.00		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54588 (Continued)

Lab Sample ID: 680-230663-27

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Cobalt	141		0.500		ug/L	1		6020B	Total
									Recoverable
Iron	157000		100		ug/L	1		6020B	Total
									Recoverable
Lead	32.8		2.50		ug/L	1		6020B	Total
									Recoverable
Magnesium	34100		250		ug/L	1		6020B	Total
									Recoverable
Manganese	629		5.00		ug/L	1		6020B	Total
									Recoverable
Nickel	127		5.00		ug/L	1		6020B	Total
									Recoverable
Potassium	2920		1000		ug/L	1		6020B	Total
									Recoverable
Sodium	118000		500		ug/L	1		6020B	Total
									Recoverable
Zinc	237		20.0		ug/L	1		6020B	Total
									Recoverable
Aluminum	52500		100		ug/L	1		6020B	Dissolved
Arsenic	8.64		3.00		ug/L	1		6020B	Dissolved
Barium	34.1		5.00		ug/L	1		6020B	Dissolved
Beryllium	48.6		0.500		ug/L	1		6020B	Dissolved
Cadmium	1.41		0.500		ug/L	1		6020B	Dissolved
Calcium	707000		5000		ug/L	10		6020B	Dissolved
Chromium	7.38		5.00		ug/L	1		6020B	Dissolved
Cobalt	140		0.500		ug/L	1		6020B	Dissolved
Iron	153000		100		ug/L	1		6020B	Dissolved
Lead	32.6		2.50		ug/L	1		6020B	Dissolved
Magnesium	34000		250		ug/L	1		6020B	Dissolved
Manganese	624		5.00		ug/L	1		6020B	Dissolved
Nickel	126		5.00		ug/L	1		6020B	Dissolved
Potassium	2970		1000		ug/L	1		6020B	Dissolved
Sodium	118000		500		ug/L	1		6020B	Dissolved
Zinc	236		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54589

Lab Sample ID: 680-230663-28

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	16600		100		ug/L	1		6020B	Total
									Recoverable
Arsenic	4.62		3.00		ug/L	1		6020B	Total
									Recoverable
Barium	28.6		5.00		ug/L	1		6020B	Total
									Recoverable
Beryllium	16.2		0.500		ug/L	1		6020B	Total
									Recoverable
Calcium	266000		500		ug/L	1		6020B	Total
									Recoverable
Cobalt	39.9		0.500		ug/L	1		6020B	Total
									Recoverable
Iron	95600		100		ug/L	1		6020B	Total
									Recoverable
Lead	9.27		2.50		ug/L	1		6020B	Total
									Recoverable
Magnesium	13400		250		ug/L	1		6020B	Total
									Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54589 (Continued)

Lab Sample ID: 680-230663-28

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Manganese	296		5.00		ug/L	1		6020B	Total Recoverable
Nickel	40.0		5.00		ug/L	1		6020B	Total Recoverable
Potassium	2580		1000		ug/L	1		6020B	Total Recoverable
Sodium	77300		500		ug/L	1		6020B	Total Recoverable
Zinc	69.7		20.0		ug/L	1		6020B	Total Recoverable
Aluminum	16300		100		ug/L	1		6020B	Dissolved
Arsenic	4.55		3.00		ug/L	1		6020B	Dissolved
Barium	30.0		5.00		ug/L	1		6020B	Dissolved
Beryllium	15.5		0.500		ug/L	1		6020B	Dissolved
Calcium	255000		500		ug/L	1		6020B	Dissolved
Cobalt	40.1		0.500		ug/L	1		6020B	Dissolved
Iron	90600		100		ug/L	1		6020B	Dissolved
Lead	9.00		2.50		ug/L	1		6020B	Dissolved
Magnesium	13200		250		ug/L	1		6020B	Dissolved
Manganese	292		5.00		ug/L	1		6020B	Dissolved
Nickel	40.2		5.00		ug/L	1		6020B	Dissolved
Potassium	2520		1000		ug/L	1		6020B	Dissolved
Sodium	76000		500		ug/L	1		6020B	Dissolved
Zinc	68.0		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54568

Lab Sample ID: 680-230663-29

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	195		100		ug/L	1		6020B	Total Recoverable
Barium	126		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	1.43		0.500		ug/L	1		6020B	Total Recoverable
Calcium	19100		500		ug/L	1		6020B	Total Recoverable
Cobalt	7.33		0.500		ug/L	1		6020B	Total Recoverable
Iron	184		100		ug/L	1		6020B	Total Recoverable
Magnesium	878		250		ug/L	1		6020B	Total Recoverable
Manganese	8.85		5.00		ug/L	1		6020B	Total Recoverable
Nickel	6.59		5.00		ug/L	1		6020B	Total Recoverable
Sodium	51000		500		ug/L	1		6020B	Total Recoverable
Aluminum	200		100		ug/L	1		6020B	Dissolved
Barium	131		5.00		ug/L	1		6020B	Dissolved
Beryllium	1.35		0.500		ug/L	1		6020B	Dissolved
Calcium	20000		500		ug/L	1		6020B	Dissolved
Cobalt	7.36		0.500		ug/L	1		6020B	Dissolved
Iron	158		100		ug/L	1		6020B	Dissolved
Magnesium	901		250		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54568 (Continued)

Lab Sample ID: 680-230663-29

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Manganese	9.79		5.00		ug/L	1		6020B	Dissolved
Nickel	6.37		5.00		ug/L	1		6020B	Dissolved
Sodium	50600		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54569

Lab Sample ID: 680-230663-30

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	165		100		ug/L	1		6020B	Total Recoverable
Barium	208		5.00		ug/L	1		6020B	Total Recoverable
Calcium	263000		500		ug/L	1		6020B	Total Recoverable
Iron	3040		100		ug/L	1		6020B	Total Recoverable
Magnesium	4710		250		ug/L	1		6020B	Total Recoverable
Manganese	232		5.00		ug/L	1		6020B	Total Recoverable
Potassium	2040		1000		ug/L	1		6020B	Total Recoverable
Sodium	20000		500		ug/L	1		6020B	Total Recoverable
Aluminum	383		100		ug/L	1		6020B	Dissolved
Barium	179		5.00		ug/L	1		6020B	Dissolved
Calcium	239000		500		ug/L	1		6020B	Dissolved
Cobalt	1.23		0.500		ug/L	1		6020B	Dissolved
Iron	2960		100		ug/L	1		6020B	Dissolved
Magnesium	4310		250		ug/L	1		6020B	Dissolved
Manganese	206		5.00		ug/L	1		6020B	Dissolved
Potassium	1780		1000		ug/L	1		6020B	Dissolved
Sodium	18200		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54602

Lab Sample ID: 680-230663-31

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	132		5.00		ug/L	1		6020B	Total Recoverable
Calcium	277000		500		ug/L	1		6020B	Total Recoverable
Cobalt	32.1		0.500		ug/L	1		6020B	Total Recoverable
Iron	135		100		ug/L	1		6020B	Total Recoverable
Magnesium	4190		250		ug/L	1		6020B	Total Recoverable
Manganese	950		5.00		ug/L	1		6020B	Total Recoverable
Nickel	6.66		5.00		ug/L	1		6020B	Total Recoverable
Potassium	2010		1000		ug/L	1		6020B	Total Recoverable
Sodium	65700		500		ug/L	1		6020B	Total Recoverable
Barium	131		5.00		ug/L	1		6020B	Dissolved
Calcium	282000		500		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54602 (Continued)

Lab Sample ID: 680-230663-31

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Cobalt	31.4		0.500		ug/L	1		6020B	Dissolved
Iron	809		100		ug/L	1		6020B	Dissolved
Magnesium	4230		250		ug/L	1		6020B	Dissolved
Manganese	955		5.00		ug/L	1		6020B	Dissolved
Nickel	7.11		5.00		ug/L	1		6020B	Dissolved
Potassium	2030		1000		ug/L	1		6020B	Dissolved
Sodium	65100		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54604

Lab Sample ID: 680-230663-32

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	758		100		ug/L	1		6020B	Total Recoverable
Aluminum	627		100		ug/L	1		6020B	Total Recoverable
Barium	78.1		5.00		ug/L	1		6020B	Total Recoverable
Barium	79.4		5.00		ug/L	1		6020B	Total Recoverable
Calcium	459000		5000		ug/L	10		6020B	Total Recoverable
Calcium	417000		5000		ug/L	10		6020B	Total Recoverable
Cobalt	3.01		0.500		ug/L	1		6020B	Total Recoverable
Cobalt	3.50		0.500		ug/L	1		6020B	Total Recoverable
Iron	15200		100		ug/L	1		6020B	Total Recoverable
Iron	15300		100		ug/L	1		6020B	Total Recoverable
Magnesium	8430		250		ug/L	1		6020B	Total Recoverable
Magnesium	8680		250		ug/L	1		6020B	Total Recoverable
Manganese	619		5.00		ug/L	1		6020B	Total Recoverable
Manganese	650		5.00		ug/L	1		6020B	Total Recoverable
Potassium	1580		1000		ug/L	1		6020B	Total Recoverable
Potassium	1570		1000		ug/L	1		6020B	Total Recoverable
Sodium	65700		500		ug/L	1		6020B	Total Recoverable
Sodium	63700		500		ug/L	1		6020B	Total Recoverable
Barium	74.6		5.00		ug/L	1		6020B	Dissolved
Calcium	448000		500		ug/L	1		6020B	Dissolved
Cobalt	2.17		0.500		ug/L	1		6020B	Dissolved
Iron	13000		100		ug/L	1		6020B	Dissolved
Magnesium	7830		250		ug/L	1		6020B	Dissolved
Manganese	571		5.00		ug/L	1		6020B	Dissolved
Potassium	1460		1000		ug/L	1		6020B	Dissolved
Sodium	61700		500		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54607

Lab Sample ID: 680-230663-33

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	520		5.00		ug/L	1		6020B	Total Recoverable
Calcium	631000		5000		ug/L	10		6020B	Total Recoverable
Iron	16600		100		ug/L	1		6020B	Total Recoverable
Magnesium	14700		250		ug/L	1		6020B	Total Recoverable
Manganese	1150		5.00		ug/L	1		6020B	Total Recoverable
Potassium	4950		1000		ug/L	1		6020B	Total Recoverable
Sodium	102000		500		ug/L	1		6020B	Total Recoverable
Barium	513		5.00		ug/L	1		6020B	Dissolved
Calcium	639000		5000		ug/L	10		6020B	Dissolved
Iron	16300		100		ug/L	1		6020B	Dissolved
Magnesium	14400		250		ug/L	1		6020B	Dissolved
Manganese	1140		5.00		ug/L	1		6020B	Dissolved
Potassium	4860		1000		ug/L	1		6020B	Dissolved
Sodium	100000		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54574

Lab Sample ID: 680-230663-34

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	166		100		ug/L	1		6020B	Total Recoverable
Barium	19.1		5.00		ug/L	1		6020B	Total Recoverable
Calcium	4940		500		ug/L	1		6020B	Total Recoverable
Cobalt	1.57		0.500		ug/L	1		6020B	Total Recoverable
Iron	499		100		ug/L	1		6020B	Total Recoverable
Magnesium	665		250		ug/L	1		6020B	Total Recoverable
Manganese	16.6		5.00		ug/L	1		6020B	Total Recoverable
Sodium	6540		500		ug/L	1		6020B	Total Recoverable
Aluminum	172		100		ug/L	1		6020B	Dissolved
Barium	22.0		5.00		ug/L	1		6020B	Dissolved
Calcium	8080		500		ug/L	1		6020B	Dissolved
Cobalt	2.55		0.500		ug/L	1		6020B	Dissolved
Iron	861		100		ug/L	1		6020B	Dissolved
Magnesium	720		250		ug/L	1		6020B	Dissolved
Manganese	16.0		5.00		ug/L	1		6020B	Dissolved
Sodium	6450		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54580

Lab Sample ID: 680-230663-35

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	37.3		5.00		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54580 (Continued)

Lab Sample ID: 680-230663-35

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	12400		500		ug/L	1		6020B	Total Recoverable
Cobalt	8.47		0.500		ug/L	1		6020B	Total Recoverable
Magnesium	596		250		ug/L	1		6020B	Total Recoverable
Manganese	457		5.00		ug/L	1		6020B	Total Recoverable
Sodium	7010		500		ug/L	1		6020B	Total Recoverable
Barium	36.2		5.00		ug/L	1		6020B	Dissolved
Calcium	12300		500		ug/L	1		6020B	Dissolved
Cobalt	7.49		0.500		ug/L	1		6020B	Dissolved
Magnesium	623		250		ug/L	1		6020B	Dissolved
Manganese	433		5.00		ug/L	1		6020B	Dissolved
Sodium	6840		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54584

Lab Sample ID: 680-230663-36

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	25.8		5.00		ug/L	1		6020B	Total Recoverable
Calcium	5070		500		ug/L	1		6020B	Total Recoverable
Magnesium	250		250		ug/L	1		6020B	Total Recoverable
Manganese	64.0		5.00		ug/L	1		6020B	Total Recoverable
Sodium	4850		500		ug/L	1		6020B	Total Recoverable
Barium	36.6		5.00		ug/L	1		6020B	Dissolved
Calcium	5000		500		ug/L	1		6020B	Dissolved
Magnesium	251		250		ug/L	1		6020B	Dissolved
Manganese	63.4		5.00		ug/L	1		6020B	Dissolved
Sodium	4760		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54585

Lab Sample ID: 680-230663-37

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	17000		100		ug/L	1		6020B	Total Recoverable
Arsenic	9.56		3.00		ug/L	1		6020B	Total Recoverable
Barium	39.1		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	11.0		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	1.28		0.500		ug/L	1		6020B	Total Recoverable
Calcium	264000		500		ug/L	1		6020B	Total Recoverable
Cobalt	48.0		0.500		ug/L	1		6020B	Total Recoverable
Iron	179000		100		ug/L	1		6020B	Total Recoverable
Lead	6.25		2.50		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54585 (Continued)

Lab Sample ID: 680-230663-37

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Magnesium	55400		250		ug/L	1		6020B	Total Recoverable
Manganese	437		5.00		ug/L	1		6020B	Total Recoverable
Nickel	32.8		5.00		ug/L	1		6020B	Total Recoverable
Potassium	4590		1000		ug/L	1		6020B	Total Recoverable
Sodium	74400		500		ug/L	1		6020B	Total Recoverable
Zinc	68.5		20.0		ug/L	1		6020B	Total Recoverable
Aluminum	18600		100		ug/L	1		6020B	Dissolved
Arsenic	11.6		3.00		ug/L	1		6020B	Dissolved
Barium	44.0		5.00		ug/L	1		6020B	Dissolved
Beryllium	11.7		0.500		ug/L	1		6020B	Dissolved
Cadmium	1.63		0.500		ug/L	1		6020B	Dissolved
Calcium	288000		500		ug/L	1		6020B	Dissolved
Cobalt	53.5		0.500		ug/L	1		6020B	Dissolved
Iron	197000		100		ug/L	1		6020B	Dissolved
Lead	6.40		2.50		ug/L	1		6020B	Dissolved
Magnesium	61500		250		ug/L	1		6020B	Dissolved
Manganese	480		5.00		ug/L	1		6020B	Dissolved
Nickel	35.9		5.00		ug/L	1		6020B	Dissolved
Potassium	5110		1000		ug/L	1		6020B	Dissolved
Selenium	2.65		2.50		ug/L	1		6020B	Dissolved
Sodium	82100		500		ug/L	1		6020B	Dissolved
Zinc	74.6		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54591

Lab Sample ID: 680-230663-38

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	11900		100		ug/L	1		6020B	Total Recoverable
Barium	159		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	31.3		0.500		ug/L	1		6020B	Total Recoverable
Calcium	520000		5000		ug/L	10		6020B	Total Recoverable
Cobalt	198		0.500		ug/L	1		6020B	Total Recoverable
Iron	71500		100		ug/L	1		6020B	Total Recoverable
Lead	11.8		2.50		ug/L	1		6020B	Total Recoverable
Magnesium	19900		250		ug/L	1		6020B	Total Recoverable
Manganese	209		5.00		ug/L	1		6020B	Total Recoverable
Nickel	198		5.00		ug/L	1		6020B	Total Recoverable
Potassium	1820		1000		ug/L	1		6020B	Total Recoverable
Sodium	121000		500		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54591 (Continued)

Lab Sample ID: 680-230663-38

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Zinc	1210		20.0		ug/L	1		6020B	Total Recoverable
Aluminum	11600		100		ug/L	1		6020B	Dissolved
Barium	149		5.00		ug/L	1		6020B	Dissolved
Beryllium	29.9		0.500		ug/L	1		6020B	Dissolved
Cadmium	0.560		0.500		ug/L	1		6020B	Dissolved
Calcium	541000		5000		ug/L	10		6020B	Dissolved
Cobalt	193		0.500		ug/L	1		6020B	Dissolved
Iron	67900		100		ug/L	1		6020B	Dissolved
Lead	11.6		2.50		ug/L	1		6020B	Dissolved
Magnesium	18900		250		ug/L	1		6020B	Dissolved
Manganese	208		5.00		ug/L	1		6020B	Dissolved
Nickel	189		5.00		ug/L	1		6020B	Dissolved
Potassium	1800		1000		ug/L	1		6020B	Dissolved
Sodium	118000		500		ug/L	1		6020B	Dissolved
Zinc	1100		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54592

Lab Sample ID: 680-230663-39

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	33300		100		ug/L	1		6020B	Total Recoverable
Aluminum	34900		100		ug/L	1		6020B	Total Recoverable
Arsenic	14.2		3.00		ug/L	1		6020B	Total Recoverable
Arsenic	14.2		3.00		ug/L	1		6020B	Total Recoverable
Barium	28.3		5.00		ug/L	1		6020B	Total Recoverable
Barium	28.0		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	11.6		0.500		ug/L	1		6020B	Total Recoverable
Beryllium	11.7		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	1.49		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	2.45		0.500		ug/L	1		6020B	Total Recoverable
Calcium	420000		500		ug/L	1		6020B	Total Recoverable
Calcium	426000		500		ug/L	1		6020B	Total Recoverable
Cobalt	107		0.500		ug/L	1		6020B	Total Recoverable
Cobalt	111		0.500		ug/L	1		6020B	Total Recoverable
Iron	203000		100		ug/L	1		6020B	Total Recoverable
Iron	216000		100		ug/L	1		6020B	Total Recoverable
Lead	37.8		2.50		ug/L	1		6020B	Total Recoverable
Lead	40.1		2.50		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54592 (Continued)

Lab Sample ID: 680-230663-39

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Magnesium	71500		250		ug/L	1		6020B	Total Recoverable
Magnesium	74200		250		ug/L	1		6020B	Total Recoverable
Manganese	1580		5.00		ug/L	1		6020B	Total Recoverable
Manganese	1650		5.00		ug/L	1		6020B	Total Recoverable
Nickel	37.1		5.00		ug/L	1		6020B	Total Recoverable
Nickel	39.8		5.00		ug/L	1		6020B	Total Recoverable
Potassium	5020		1000		ug/L	1		6020B	Total Recoverable
Potassium	5110		1000		ug/L	1		6020B	Total Recoverable
Selenium	3.37		2.50		ug/L	1		6020B	Total Recoverable
Selenium	3.03		2.50		ug/L	1		6020B	Total Recoverable
Sodium	85600		500		ug/L	1		6020B	Total Recoverable
Sodium	85400		500		ug/L	1		6020B	Total Recoverable
Zinc	75.6		20.0		ug/L	1		6020B	Total Recoverable
Zinc	79.9		20.0		ug/L	1		6020B	Total Recoverable
Aluminum	32500		100		ug/L	1		6020B	Dissolved
Arsenic	13.4		3.00		ug/L	1		6020B	Dissolved
Barium	30.8		5.00		ug/L	1		6020B	Dissolved
Beryllium	11.3		0.500		ug/L	1		6020B	Dissolved
Cadmium	1.31		0.500		ug/L	1		6020B	Dissolved
Calcium	407000		500		ug/L	1		6020B	Dissolved
Cobalt	105		0.500		ug/L	1		6020B	Dissolved
Iron	200000		100		ug/L	1		6020B	Dissolved
Lead	37.3		2.50		ug/L	1		6020B	Dissolved
Magnesium	70200		250		ug/L	1		6020B	Dissolved
Manganese	1540		5.00		ug/L	1		6020B	Dissolved
Nickel	37.4		5.00		ug/L	1		6020B	Dissolved
Potassium	4960		1000		ug/L	1		6020B	Dissolved
Selenium	3.43		2.50		ug/L	1		6020B	Dissolved
Sodium	84600		500		ug/L	1		6020B	Dissolved
Zinc	74.9		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54564

Lab Sample ID: 680-230663-40

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	50.8		5.00		ug/L	1		6020B	Total Recoverable
Calcium	962000		5000		ug/L	10		6020B	Total Recoverable
Cobalt	35.3		0.500		ug/L	1		6020B	Total Recoverable
Iron	10900		100		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54564 (Continued)

Lab Sample ID: 680-230663-40

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Magnesium	149000		250		ug/L	1		6020B	Total
									Recoverable
Manganese	5120		5.00		ug/L	1		6020B	Total
									Recoverable
Nickel	16.2		5.00		ug/L	1		6020B	Total
									Recoverable
Potassium	10200		1000		ug/L	1		6020B	Total
									Recoverable
Sodium	190000		500		ug/L	1		6020B	Total
									Recoverable
Barium	54.2		5.00		ug/L	1		6020B	Dissolved
Calcium	1040000		5000		ug/L	10		6020B	Dissolved
Cobalt	36.9		0.500		ug/L	1		6020B	Dissolved
Iron	10500		100		ug/L	1		6020B	Dissolved
Magnesium	154000		250		ug/L	1		6020B	Dissolved
Manganese	5340		5.00		ug/L	1		6020B	Dissolved
Nickel	16.2		5.00		ug/L	1		6020B	Dissolved
Potassium	10700		1000		ug/L	1		6020B	Dissolved
Sodium	195000		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54565

Lab Sample ID: 680-230663-41

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	25200		100		ug/L	1		6020B	Total
									Recoverable
Arsenic	4.01		3.00		ug/L	1		6020B	Total
									Recoverable
Barium	39.5		5.00		ug/L	1		6020B	Total
									Recoverable
Beryllium	22.3		0.500		ug/L	1		6020B	Total
									Recoverable
Cadmium	1.13		0.500		ug/L	1		6020B	Total
									Recoverable
Calcium	576000		5000		ug/L	10		6020B	Total
									Recoverable
Cobalt	46.6		0.500		ug/L	1		6020B	Total
									Recoverable
Iron	96400		100		ug/L	1		6020B	Total
									Recoverable
Lead	19.8		2.50		ug/L	1		6020B	Total
									Recoverable
Magnesium	60700		250		ug/L	1		6020B	Total
									Recoverable
Manganese	1170		5.00		ug/L	1		6020B	Total
									Recoverable
Nickel	46.4		5.00		ug/L	1		6020B	Total
									Recoverable
Potassium	7580		1000		ug/L	1		6020B	Total
									Recoverable
Sodium	154000		500		ug/L	1		6020B	Total
									Recoverable
Zinc	141		20.0		ug/L	1		6020B	Total
									Recoverable
Aluminum	24600		100		ug/L	1		6020B	Dissolved
Arsenic	3.73		3.00		ug/L	1		6020B	Dissolved
Barium	38.6		5.00		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54565 (Continued)

Lab Sample ID: 680-230663-41

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Beryllium	21.8		0.500		ug/L	1		6020B	Dissolved
Cadmium	0.830		0.500		ug/L	1		6020B	Dissolved
Calcium	597000		5000		ug/L	10		6020B	Dissolved
Cobalt	45.7		0.500		ug/L	1		6020B	Dissolved
Iron	93500		100		ug/L	1		6020B	Dissolved
Lead	18.9		2.50		ug/L	1		6020B	Dissolved
Magnesium	61100		250		ug/L	1		6020B	Dissolved
Manganese	1150		5.00		ug/L	1		6020B	Dissolved
Nickel	44.6		5.00		ug/L	1		6020B	Dissolved
Potassium	7490		1000		ug/L	1		6020B	Dissolved
Sodium	152000		500		ug/L	1		6020B	Dissolved
Zinc	138		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54566

Lab Sample ID: 680-230663-42

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	24000		100		ug/L	1		6020B	Total Recoverable
Arsenic	3.72		3.00		ug/L	1		6020B	Total Recoverable
Barium	42.9		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	21.7		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	0.685		0.500		ug/L	1		6020B	Total Recoverable
Calcium	601000		5000		ug/L	10		6020B	Total Recoverable
Cobalt	44.5		0.500		ug/L	1		6020B	Total Recoverable
Iron	95300		100		ug/L	1		6020B	Total Recoverable
Lead	17.8		2.50		ug/L	1		6020B	Total Recoverable
Magnesium	58000		250		ug/L	1		6020B	Total Recoverable
Manganese	1090		5.00		ug/L	1		6020B	Total Recoverable
Nickel	44.3		5.00		ug/L	1		6020B	Total Recoverable
Potassium	7330		1000		ug/L	1		6020B	Total Recoverable
Sodium	146000		500		ug/L	1		6020B	Total Recoverable
Zinc	129		20.0		ug/L	1		6020B	Total Recoverable
Aluminum	24700		100		ug/L	1		6020B	Dissolved
Arsenic	3.62		3.00		ug/L	1		6020B	Dissolved
Barium	43.7		5.00		ug/L	1		6020B	Dissolved
Beryllium	22.3		0.500		ug/L	1		6020B	Dissolved
Cadmium	0.820		0.500		ug/L	1		6020B	Dissolved
Calcium	598000		5000		ug/L	10		6020B	Dissolved
Cobalt	45.4		0.500		ug/L	1		6020B	Dissolved
Iron	98000		100		ug/L	1		6020B	Dissolved
Lead	18.1		2.50		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54566 (Continued)

Lab Sample ID: 680-230663-42

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Magnesium	59200		250		ug/L	1		6020B	Dissolved
Manganese	1110		5.00		ug/L	1		6020B	Dissolved
Nickel	44.7		5.00		ug/L	1		6020B	Dissolved
Potassium	7500		1000		ug/L	1		6020B	Dissolved
Sodium	149000		500		ug/L	1		6020B	Dissolved
Zinc	134		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54567

Lab Sample ID: 680-230663-43

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	104		5.00		ug/L	1		6020B	Total Recoverable
Calcium	140000		500		ug/L	1		6020B	Total Recoverable
Iron	1800		100		ug/L	1		6020B	Total Recoverable
Magnesium	2750		250		ug/L	1		6020B	Total Recoverable
Manganese	79.3		5.00		ug/L	1		6020B	Total Recoverable
Potassium	1150		1000		ug/L	1		6020B	Total Recoverable
Sodium	17400		500		ug/L	1		6020B	Total Recoverable
Barium	96.4		5.00		ug/L	1		6020B	Dissolved
Calcium	130000		500		ug/L	1		6020B	Dissolved
Iron	838		100		ug/L	1		6020B	Dissolved
Magnesium	2590		250		ug/L	1		6020B	Dissolved
Manganese	74.6		5.00		ug/L	1		6020B	Dissolved
Potassium	1100		1000		ug/L	1		6020B	Dissolved
Sodium	16200		500		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54593

Lab Sample ID: 680-230663-1

Date Collected: 01/26/23 09:38

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 23:07	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:07	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 23:07	1
Barium	127		5.00		ug/L		02/17/23 09:09	02/17/23 23:07	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:07	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:07	1
Calcium	188000		500		ug/L		02/17/23 09:09	02/17/23 23:07	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:07	1
Cobalt	1.98		0.500		ug/L		02/17/23 09:09	02/17/23 23:07	1
Iron	100	U	100		ug/L		02/17/23 09:09	02/17/23 23:07	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:07	1
Magnesium	3050		250		ug/L		02/17/23 09:09	02/17/23 23:07	1
Manganese	77.8		5.00		ug/L		02/17/23 09:09	02/17/23 23:07	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:07	1
Potassium	1000	U	1000		ug/L		02/17/23 09:09	02/17/23 23:07	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:07	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:07	1
Sodium	23300		500		ug/L		02/17/23 09:09	02/17/23 23:07	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:07	1
Zinc	25.3		20.0		ug/L		02/17/23 09:09	02/17/23 23:07	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:17	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:17	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:17	1
Barium	130		5.00		ug/L		02/17/23 10:16	02/17/23 20:17	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:17	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:17	1
Calcium	180000		500		ug/L		02/17/23 10:16	02/17/23 20:17	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:17	1
Cobalt	1.93		0.500		ug/L		02/17/23 10:16	02/17/23 20:17	1
Iron	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:17	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:17	1
Magnesium	3010		250		ug/L		02/17/23 10:16	02/17/23 20:17	1
Manganese	76.7		5.00		ug/L		02/17/23 10:16	02/17/23 20:17	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:17	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 20:17	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:17	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:17	1
Sodium	22800		500		ug/L		02/17/23 10:16	02/17/23 20:17	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:17	1
Zinc	25.7		20.0		ug/L		02/17/23 10:16	02/17/23 20:17	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 13:15	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54593

Lab Sample ID: 680-230663-1

Date Collected: 01/26/23 09:38

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:07	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54594

Lab Sample ID: 680-230663-2

Date Collected: 01/26/23 09:43

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 15:28	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:28	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 15:28	1
Barium	135		5.00		ug/L		02/17/23 09:14	02/17/23 15:28	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:28	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:28	1
Calcium	193000		500		ug/L		02/17/23 09:14	02/17/23 15:28	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:28	1
Cobalt	2.25		0.500		ug/L		02/17/23 09:14	02/17/23 15:28	1
Iron	100	U	100		ug/L		02/17/23 09:14	02/17/23 15:28	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:28	1
Magnesium	3250		250		ug/L		02/17/23 09:14	02/17/23 15:28	1
Manganese	91.1		5.00		ug/L		02/17/23 09:14	02/17/23 15:28	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:28	1
Potassium	1000	U	1000		ug/L		02/17/23 09:14	02/17/23 15:28	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:28	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:28	1
Sodium	26000		500		ug/L		02/17/23 09:14	02/17/23 15:28	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:28	1
Zinc	96.1		20.0		ug/L		02/17/23 09:14	02/17/23 15:28	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:29	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:29	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:29	1
Barium	125		5.00		ug/L		02/17/23 10:16	02/17/23 20:29	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:29	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:29	1
Calcium	178000		500		ug/L		02/17/23 10:16	02/17/23 20:29	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:29	1
Cobalt	2.00		0.500		ug/L		02/17/23 10:16	02/17/23 20:29	1
Iron	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:29	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:29	1
Magnesium	2960		250		ug/L		02/17/23 10:16	02/17/23 20:29	1
Manganese	84.7		5.00		ug/L		02/17/23 10:16	02/17/23 20:29	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:29	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 20:29	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:29	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:29	1
Sodium	23700		500		ug/L		02/17/23 10:16	02/17/23 20:29	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:29	1
Zinc	61.4		20.0		ug/L		02/17/23 10:16	02/17/23 20:29	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 16:53	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54594

Lab Sample ID: 680-230663-2

Date Collected: 01/26/23 09:43

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:10	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54582

Lab Sample ID: 680-230663-3

Date Collected: 01/26/23 11:19

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:56	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:56	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:56	1
Barium	151		5.00		ug/L		02/17/23 10:39	02/17/23 18:56	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:56	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:56	1
Calcium	29000		500		ug/L		02/17/23 10:39	02/17/23 18:56	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:56	1
Cobalt	7.28		0.500		ug/L		02/17/23 10:39	02/17/23 18:56	1
Iron	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:56	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:56	1
Magnesium	2410		250		ug/L		02/17/23 10:39	02/17/23 18:56	1
Manganese	301		5.00		ug/L		02/17/23 10:39	02/17/23 18:56	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:56	1
Potassium	1630		1000		ug/L		02/17/23 10:39	02/17/23 18:56	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:56	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:56	1
Sodium	8780		500		ug/L		02/17/23 10:39	02/17/23 18:56	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:56	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:56	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 17:38	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:38	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 17:38	1
Barium	155		5.00		ug/L		02/17/23 10:39	02/17/23 17:38	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:38	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:38	1
Calcium	31300		500		ug/L		02/17/23 10:39	02/17/23 17:38	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:38	1
Cobalt	7.73		0.500		ug/L		02/17/23 10:39	02/17/23 17:38	1
Iron	100	U	100		ug/L		02/17/23 10:39	02/17/23 17:38	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:38	1
Magnesium	2540		250		ug/L		02/17/23 10:39	02/17/23 17:38	1
Manganese	312		5.00		ug/L		02/17/23 10:39	02/17/23 17:38	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:38	1
Potassium	1680		1000		ug/L		02/17/23 10:39	02/17/23 17:38	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:38	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:38	1
Sodium	9490		500		ug/L		02/17/23 10:39	02/17/23 17:38	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:38	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 17:38	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:10	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54582

Lab Sample ID: 680-230663-3

Date Collected: 01/26/23 11:19

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:14	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54583

Lab Sample ID: 680-230663-4

Date Collected: 01/26/23 13:00

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 22:23	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:23	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 22:23	1
Barium	38.5		5.00		ug/L		02/17/23 09:09	02/17/23 22:23	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:23	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:23	1
Calcium	54200		500		ug/L		02/17/23 09:09	02/17/23 22:23	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:23	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:23	1
Iron	1640		100		ug/L		02/17/23 09:09	02/17/23 22:23	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:23	1
Magnesium	1280		250		ug/L		02/17/23 09:09	02/17/23 22:23	1
Manganese	70.1		5.00		ug/L		02/17/23 09:09	02/17/23 22:23	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:23	1
Potassium	1190		1000		ug/L		02/17/23 09:09	02/17/23 22:23	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:23	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:23	1
Sodium	3860		500		ug/L		02/17/23 09:09	02/17/23 22:23	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:23	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 22:23	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:03	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:03	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:03	1
Barium	41.2		5.00		ug/L		02/17/23 10:39	02/17/23 18:03	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:03	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:03	1
Calcium	57200		500		ug/L		02/17/23 10:39	02/17/23 18:03	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:03	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:03	1
Iron	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:03	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:03	1
Magnesium	1390		250		ug/L		02/17/23 10:39	02/17/23 18:03	1
Manganese	66.7		5.00		ug/L		02/17/23 10:39	02/17/23 18:03	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:03	1
Potassium	1230		1000		ug/L		02/17/23 10:39	02/17/23 18:03	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:03	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:03	1
Sodium	4330		500		ug/L		02/17/23 10:39	02/17/23 18:03	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:03	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:03	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:13	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54583

Lab Sample ID: 680-230663-4

Date Collected: 01/26/23 13:00

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:17	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54595

Lab Sample ID: 680-230663-5

Date Collected: 01/25/23 11:00

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 23:36	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:36	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 23:36	1
Barium	177		5.00		ug/L		02/17/23 09:09	02/17/23 23:36	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:36	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:36	1
Calcium	147000		500		ug/L		02/17/23 09:09	02/17/23 23:36	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:36	1
Cobalt	1.85		0.500		ug/L		02/17/23 09:09	02/17/23 23:36	1
Iron	165		100		ug/L		02/17/23 09:09	02/17/23 23:36	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:36	1
Magnesium	2250		250		ug/L		02/17/23 09:09	02/17/23 23:36	1
Manganese	85.5		5.00		ug/L		02/17/23 09:09	02/17/23 23:36	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:36	1
Potassium	1000	U	1000		ug/L		02/17/23 09:09	02/17/23 23:36	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:36	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:36	1
Sodium	10600		500		ug/L		02/17/23 09:09	02/17/23 23:36	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:36	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 23:36	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:48	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:48	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:48	1
Barium	186		5.00		ug/L		02/17/23 10:39	02/17/23 18:48	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:48	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:48	1
Calcium	156000		500		ug/L		02/17/23 10:39	02/17/23 18:48	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:48	1
Cobalt	1.94		0.500		ug/L		02/17/23 10:39	02/17/23 18:48	1
Iron	105		100		ug/L		02/17/23 10:39	02/17/23 18:48	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:48	1
Magnesium	2450		250		ug/L		02/17/23 10:39	02/17/23 18:48	1
Manganese	89.3		5.00		ug/L		02/17/23 10:39	02/17/23 18:48	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:48	1
Potassium	1000	U	1000		ug/L		02/17/23 10:39	02/17/23 18:48	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:48	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:48	1
Sodium	11800		500		ug/L		02/17/23 10:39	02/17/23 18:48	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:48	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:48	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 12:40	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54595

Lab Sample ID: 680-230663-5

Date Collected: 01/25/23 11:00

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 13:25	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54596

Lab Sample ID: 680-230663-6

Date Collected: 01/25/23 09:54

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:05	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:05	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:05	1
Barium	64.5		5.00		ug/L		02/17/23 09:14	02/17/23 16:05	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:05	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:05	1
Calcium	208000		500		ug/L		02/17/23 09:14	02/17/23 16:05	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:05	1
Cobalt	19.1		0.500		ug/L		02/17/23 09:14	02/17/23 16:05	1
Iron	2140		100		ug/L		02/17/23 09:14	02/17/23 16:05	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:05	1
Magnesium	5530		250		ug/L		02/17/23 09:14	02/17/23 16:05	1
Manganese	547		5.00		ug/L		02/17/23 09:14	02/17/23 16:05	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:05	1
Potassium	1000	U	1000		ug/L		02/17/23 09:14	02/17/23 16:05	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:05	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:05	1
Sodium	9880		500		ug/L		02/17/23 09:14	02/17/23 16:05	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:05	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:05	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:58	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:58	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:58	1
Barium	67.3		5.00		ug/L		02/17/23 10:16	02/17/23 20:58	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:58	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:58	1
Calcium	202000		500		ug/L		02/17/23 10:16	02/17/23 20:58	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:58	1
Cobalt	17.6		0.500		ug/L		02/17/23 10:16	02/17/23 20:58	1
Iron	174		100		ug/L		02/17/23 10:16	02/17/23 20:58	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:58	1
Magnesium	5200		250		ug/L		02/17/23 10:16	02/17/23 20:58	1
Manganese	504		5.00		ug/L		02/17/23 10:16	02/17/23 20:58	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:58	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 20:58	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:58	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:58	1
Sodium	9020		500		ug/L		02/17/23 10:16	02/17/23 20:58	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:58	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 20:58	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 12:43	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54596

Lab Sample ID: 680-230663-6

Date Collected: 01/25/23 09:54

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 13:36	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54572

Lab Sample ID: 680-230663-7

Date Collected: 01/24/23 11:46

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	752		100		ug/L		02/17/23 06:34	02/17/23 13:59	1
Antimony	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:59	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 06:34	02/17/23 13:59	1
Barium	42.5		5.00		ug/L		02/17/23 06:34	02/17/23 13:59	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:59	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:59	1
Calcium	29300		500		ug/L		02/17/23 06:34	02/17/23 13:59	1
Chromium	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:59	1
Cobalt	0.760		0.500		ug/L		02/17/23 06:34	02/17/23 13:59	1
Iron	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:59	1
Lead	2.59		2.50		ug/L		02/17/23 06:34	02/17/23 13:59	1
Magnesium	2290		250		ug/L		02/17/23 06:34	02/17/23 13:59	1
Manganese	28.9		5.00		ug/L		02/17/23 06:34	02/17/23 13:59	1
Nickel	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:59	1
Potassium	1000	U	1000		ug/L		02/17/23 06:34	02/17/23 13:59	1
Selenium	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:59	1
Silver	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:59	1
Sodium	8620		500		ug/L		02/17/23 06:34	02/17/23 13:59	1
Thallium	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:59	1
Zinc	241		20.0		ug/L		02/17/23 06:34	02/17/23 13:59	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	645		100		ug/L		02/17/23 06:34	02/17/23 13:47	1
Antimony	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:47	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 06:34	02/17/23 13:47	1
Barium	42.6		5.00		ug/L		02/17/23 06:34	02/17/23 13:47	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:47	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:47	1
Calcium	30600		500		ug/L		02/17/23 06:34	02/17/23 13:47	1
Chromium	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:47	1
Cobalt	0.765		0.500		ug/L		02/17/23 06:34	02/17/23 13:47	1
Iron	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:47	1
Lead	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:47	1
Magnesium	2280		250		ug/L		02/17/23 06:34	02/17/23 13:47	1
Manganese	28.6		5.00		ug/L		02/17/23 06:34	02/17/23 13:47	1
Nickel	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:47	1
Potassium	1000	U	1000		ug/L		02/17/23 06:34	02/17/23 13:47	1
Selenium	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:47	1
Silver	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:47	1
Sodium	8710		500		ug/L		02/17/23 06:34	02/17/23 13:47	1
Thallium	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:47	1
Zinc	234		20.0		ug/L		02/17/23 06:34	02/17/23 13:47	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 12:46	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54572

Lab Sample ID: 680-230663-7

Date Collected: 01/24/23 11:46

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 13:39	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54597

Lab Sample ID: 680-230663-8

Date Collected: 01/24/23 15:40

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:39	1
Antimony	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:39	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 06:34	02/17/23 13:39	1
Barium	56.6		5.00		ug/L		02/17/23 06:34	02/17/23 13:39	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:39	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:39	1
Calcium	133000		500		ug/L		02/17/23 06:34	02/17/23 13:39	1
Chromium	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:39	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:39	1
Iron	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:39	1
Lead	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:39	1
Magnesium	3210		250		ug/L		02/17/23 06:34	02/17/23 13:39	1
Manganese	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:39	1
Nickel	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:39	1
Potassium	1000	U	1000		ug/L		02/17/23 06:34	02/17/23 13:39	1
Selenium	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:39	1
Silver	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:39	1
Sodium	12600		500		ug/L		02/17/23 06:34	02/17/23 13:39	1
Thallium	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:39	1
Zinc	20.0	U	20.0		ug/L		02/17/23 06:34	02/17/23 13:39	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:31	1
Antimony	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:31	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 06:34	02/17/23 13:31	1
Barium	57.5		5.00		ug/L		02/17/23 06:34	02/17/23 13:31	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:31	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:31	1
Calcium	136000		500		ug/L		02/17/23 06:34	02/17/23 13:31	1
Chromium	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:31	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:31	1
Iron	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:31	1
Lead	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:31	1
Magnesium	3300		250		ug/L		02/17/23 06:34	02/17/23 13:31	1
Manganese	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:31	1
Nickel	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:31	1
Potassium	1000	U	1000		ug/L		02/17/23 06:34	02/17/23 13:31	1
Selenium	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:31	1
Silver	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:31	1
Sodium	12900		500		ug/L		02/17/23 06:34	02/17/23 13:31	1
Thallium	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:31	1
Zinc	20.0	U	20.0		ug/L		02/17/23 06:34	02/17/23 13:31	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 12:50	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54597

Lab Sample ID: 680-230663-8

Date Collected: 01/24/23 15:40

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 13:49	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54598

Lab Sample ID: 680-230663-9

Date Collected: 01/24/23 13:27

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:43	1
Antimony	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:43	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 06:34	02/17/23 13:43	1
Barium	109		5.00		ug/L		02/17/23 06:34	02/17/23 13:43	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:43	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:43	1
Calcium	289000		500		ug/L		02/17/23 06:34	02/17/23 13:43	1
Chromium	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:43	1
Cobalt	2.24		0.500		ug/L		02/17/23 06:34	02/17/23 13:43	1
Iron	928		100		ug/L		02/17/23 06:34	02/17/23 13:43	1
Lead	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:43	1
Magnesium	5010		250		ug/L		02/17/23 06:34	02/17/23 13:43	1
Manganese	169		5.00		ug/L		02/17/23 06:34	02/17/23 13:43	1
Nickel	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:43	1
Potassium	1000	U	1000		ug/L		02/17/23 06:34	02/17/23 13:43	1
Selenium	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:43	1
Silver	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:43	1
Sodium	21100		500		ug/L		02/17/23 06:34	02/17/23 13:43	1
Thallium	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:43	1
Zinc	20.0	U	20.0		ug/L		02/17/23 06:34	02/17/23 13:43	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:35	1
Antimony	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:35	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 06:34	02/17/23 13:35	1
Barium	108		5.00		ug/L		02/17/23 06:34	02/17/23 13:35	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:35	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:35	1
Calcium	283000		500		ug/L		02/17/23 06:34	02/17/23 13:35	1
Chromium	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:35	1
Cobalt	2.18		0.500		ug/L		02/17/23 06:34	02/17/23 13:35	1
Iron	617		100		ug/L		02/17/23 06:34	02/17/23 13:35	1
Lead	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:35	1
Magnesium	4990		250		ug/L		02/17/23 06:34	02/17/23 13:35	1
Manganese	164		5.00		ug/L		02/17/23 06:34	02/17/23 13:35	1
Nickel	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:35	1
Potassium	1000	U	1000		ug/L		02/17/23 06:34	02/17/23 13:35	1
Selenium	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:35	1
Silver	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:35	1
Sodium	21100		500		ug/L		02/17/23 06:34	02/17/23 13:35	1
Thallium	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:35	1
Zinc	20.0	U	20.0		ug/L		02/17/23 06:34	02/17/23 13:35	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 12:53	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54598

Lab Sample ID: 680-230663-9

Date Collected: 01/24/23 13:27

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 13:53	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54600

Lab Sample ID: 680-230663-10

Date Collected: 01/24/23 10:18

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:01	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:01	1
Arsenic	3.32		3.00		ug/L		02/17/23 09:14	02/17/23 16:01	1
Barium	80.8		5.00		ug/L		02/17/23 09:14	02/17/23 16:01	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:01	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:01	1
Calcium	12600		500		ug/L		02/17/23 09:14	02/17/23 16:01	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:01	1
Cobalt	1.36		0.500		ug/L		02/17/23 09:14	02/17/23 16:01	1
Iron	11100		100		ug/L		02/17/23 09:14	02/17/23 16:01	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:01	1
Magnesium	717		250		ug/L		02/17/23 09:14	02/17/23 16:01	1
Manganese	10.7		5.00		ug/L		02/17/23 09:14	02/17/23 16:01	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:01	1
Potassium	1000	U	1000		ug/L		02/17/23 09:14	02/17/23 16:01	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:01	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:01	1
Sodium	6540		500		ug/L		02/17/23 09:14	02/17/23 16:01	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:01	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:01	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:25	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:25	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:25	1
Barium	76.3		5.00		ug/L		02/17/23 10:16	02/17/23 20:25	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:25	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:25	1
Calcium	12300		500		ug/L		02/17/23 10:16	02/17/23 20:25	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:25	1
Cobalt	1.18		0.500		ug/L		02/17/23 10:16	02/17/23 20:25	1
Iron	10100		100		ug/L		02/17/23 10:16	02/17/23 20:25	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:25	1
Magnesium	712		250		ug/L		02/17/23 10:16	02/17/23 20:25	1
Manganese	10.0		5.00		ug/L		02/17/23 10:16	02/17/23 20:25	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:25	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 20:25	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:25	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:25	1
Sodium	6260		500		ug/L		02/17/23 10:16	02/17/23 20:25	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:25	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 20:25	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 13:08	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54600

Lab Sample ID: 680-230663-10

Date Collected: 01/24/23 10:18

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 13:56	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54570

Lab Sample ID: 680-230663-11

Date Collected: 01/31/23 12:49

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 23:03	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:03	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 23:03	1
Barium	199		5.00		ug/L		02/17/23 09:09	02/17/23 23:03	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:03	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:03	1
Calcium	55900		500		ug/L		02/17/23 09:09	02/17/23 23:03	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:03	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:03	1
Iron	9860		100		ug/L		02/17/23 09:09	02/17/23 23:03	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:03	1
Magnesium	2550		250		ug/L		02/17/23 09:09	02/17/23 23:03	1
Manganese	65.9		5.00		ug/L		02/17/23 09:09	02/17/23 23:03	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:03	1
Potassium	1690		1000		ug/L		02/17/23 09:09	02/17/23 23:03	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:03	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:03	1
Sodium	6170		500		ug/L		02/17/23 09:09	02/17/23 23:03	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:03	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 23:03	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 19:36	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:36	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 19:36	1
Barium	197		5.00		ug/L		02/17/23 10:16	02/17/23 19:36	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:36	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:36	1
Calcium	54500		500		ug/L		02/17/23 10:16	02/17/23 19:36	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:36	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:36	1
Iron	6990		100		ug/L		02/17/23 10:16	02/17/23 19:36	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:36	1
Magnesium	2520		250		ug/L		02/17/23 10:16	02/17/23 19:36	1
Manganese	64.3		5.00		ug/L		02/17/23 10:16	02/17/23 19:36	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:36	1
Potassium	1670		1000		ug/L		02/17/23 10:16	02/17/23 19:36	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:36	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:36	1
Sodium	6070		500		ug/L		02/17/23 10:16	02/17/23 19:36	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:36	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 19:36	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:01	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54570

Lab Sample ID: 680-230663-11

Date Collected: 01/31/23 12:49

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:21	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54601

Lab Sample ID: 680-230663-12

Date Collected: 01/31/23 11:17

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 23:32	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:32	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 23:32	1
Barium	96.3		5.00		ug/L		02/17/23 09:09	02/17/23 23:32	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:32	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:32	1
Calcium	193000		500		ug/L		02/17/23 09:09	02/17/23 23:32	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:32	1
Cobalt	0.865		0.500		ug/L		02/17/23 09:09	02/17/23 23:32	1
Iron	100	U	100		ug/L		02/17/23 09:09	02/17/23 23:32	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:32	1
Magnesium	8500		250		ug/L		02/17/23 09:09	02/17/23 23:32	1
Manganese	23.0		5.00		ug/L		02/17/23 09:09	02/17/23 23:32	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:32	1
Potassium	1000	U	1000		ug/L		02/17/23 09:09	02/17/23 23:32	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:32	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:32	1
Sodium	49900		500		ug/L		02/17/23 09:09	02/17/23 23:32	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:32	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 23:32	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:50	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:50	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:50	1
Barium	103		5.00		ug/L		02/17/23 10:16	02/17/23 20:50	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:50	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:50	1
Calcium	206000		500		ug/L		02/17/23 10:16	02/17/23 20:50	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:50	1
Cobalt	0.990		0.500		ug/L		02/17/23 10:16	02/17/23 20:50	1
Iron	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:50	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:50	1
Magnesium	9490		250		ug/L		02/17/23 10:16	02/17/23 20:50	1
Manganese	38.1		5.00		ug/L		02/17/23 10:16	02/17/23 20:50	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:50	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 20:50	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:50	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:50	1
Sodium	54000		500		ug/L		02/17/23 10:16	02/17/23 20:50	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:50	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 20:50	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:36	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54601

Lab Sample ID: 680-230663-12

Date Collected: 01/31/23 11:17

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:31	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54605

Lab Sample ID: 680-230663-13

Date Collected: 01/31/23 09:40

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:21	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:21	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:21	1
Barium	95.1		5.00		ug/L		02/17/23 09:14	02/17/23 16:21	1
Beryllium	0.735		0.500		ug/L		02/17/23 09:14	02/17/23 16:21	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:21	1
Calcium	7570		500		ug/L		02/17/23 09:14	02/17/23 16:21	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:21	1
Cobalt	1.40		0.500		ug/L		02/17/23 09:14	02/17/23 16:21	1
Iron	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:21	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:21	1
Magnesium	732		250		ug/L		02/17/23 09:14	02/17/23 16:21	1
Manganese	11.5		5.00		ug/L		02/17/23 09:14	02/17/23 16:21	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:21	1
Potassium	2150		1000		ug/L		02/17/23 09:14	02/17/23 16:21	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:21	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:21	1
Sodium	7380		500		ug/L		02/17/23 09:14	02/17/23 16:21	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:21	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:21	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:31	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:31	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:31	1
Barium	99.2		5.00		ug/L		02/17/23 10:39	02/17/23 18:31	1
Beryllium	0.835		0.500		ug/L		02/17/23 10:39	02/17/23 18:31	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:31	1
Calcium	7850		500		ug/L		02/17/23 10:39	02/17/23 18:31	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:31	1
Cobalt	1.18		0.500		ug/L		02/17/23 10:39	02/17/23 18:31	1
Iron	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:31	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:31	1
Magnesium	755		250		ug/L		02/17/23 10:39	02/17/23 18:31	1
Manganese	8.08		5.00		ug/L		02/17/23 10:39	02/17/23 18:31	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:31	1
Potassium	2230		1000		ug/L		02/17/23 10:39	02/17/23 18:31	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:31	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:31	1
Sodium	7610		500		ug/L		02/17/23 10:39	02/17/23 18:31	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:31	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:31	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:16	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54605

Lab Sample ID: 680-230663-13

Date Collected: 01/31/23 09:40

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:34	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54606

Lab Sample ID: 680-230663-14

Date Collected: 01/31/23 09:45

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:37	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:37	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:37	1
Barium	106		5.00		ug/L		02/17/23 09:14	02/17/23 16:37	1
Beryllium	0.755		0.500		ug/L		02/17/23 09:14	02/17/23 16:37	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:37	1
Calcium	9840		500		ug/L		02/17/23 09:14	02/17/23 16:37	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:37	1
Cobalt	1.22		0.500		ug/L		02/17/23 09:14	02/17/23 16:37	1
Iron	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:37	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:37	1
Magnesium	857		250		ug/L		02/17/23 09:14	02/17/23 16:37	1
Manganese	9.62		5.00		ug/L		02/17/23 09:14	02/17/23 16:37	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:37	1
Potassium	2240		1000		ug/L		02/17/23 09:14	02/17/23 16:37	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:37	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:37	1
Sodium	7810		500		ug/L		02/17/23 09:14	02/17/23 16:37	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:37	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:37	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 19:57	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:57	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 19:57	1
Barium	105		5.00		ug/L		02/17/23 10:16	02/17/23 19:57	1
Beryllium	0.775		0.500		ug/L		02/17/23 10:16	02/17/23 19:57	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:57	1
Calcium	11200		500		ug/L		02/17/23 10:16	02/17/23 19:57	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:57	1
Cobalt	1.14		0.500		ug/L		02/17/23 10:16	02/17/23 19:57	1
Iron	100	U	100		ug/L		02/17/23 10:16	02/17/23 19:57	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:57	1
Magnesium	900		250		ug/L		02/17/23 10:16	02/17/23 19:57	1
Manganese	8.35		5.00		ug/L		02/17/23 10:16	02/17/23 19:57	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:57	1
Potassium	2180		1000		ug/L		02/17/23 10:16	02/17/23 19:57	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:57	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:57	1
Sodium	7790		500		ug/L		02/17/23 10:16	02/17/23 19:57	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:57	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 19:57	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:15	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54606

Lab Sample ID: 680-230663-14

Date Collected: 01/31/23 09:45

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:38	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54559

Lab Sample ID: 680-230663-15

Date Collected: 02/01/23 09:34

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:52	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:52	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:52	1
Barium	45.4		5.00		ug/L		02/17/23 10:39	02/17/23 18:52	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:52	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:52	1
Calcium	652000		5000		ug/L		02/17/23 10:39	02/20/23 19:23	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:52	1
Cobalt	32.7		0.500		ug/L		02/17/23 10:39	02/17/23 18:52	1
Iron	2520		100		ug/L		02/17/23 10:39	02/17/23 18:52	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:52	1
Magnesium	67400		250		ug/L		02/17/23 10:39	02/17/23 18:52	1
Manganese	4580		5.00		ug/L		02/17/23 10:39	02/17/23 18:52	1
Nickel	12.7		5.00		ug/L		02/17/23 10:39	02/17/23 18:52	1
Potassium	4500		1000		ug/L		02/17/23 10:39	02/17/23 18:52	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:52	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:52	1
Sodium	96200		500		ug/L		02/17/23 10:39	02/17/23 18:52	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:52	1
Zinc	37.8		20.0		ug/L		02/17/23 10:39	02/17/23 18:52	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:54	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:54	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:54	1
Barium	52.7		5.00		ug/L		02/17/23 10:16	02/17/23 20:54	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:54	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:54	1
Calcium	711000		5000		ug/L		02/17/23 10:16	02/20/23 19:55	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:54	1
Cobalt	36.0		0.500		ug/L		02/17/23 10:16	02/17/23 20:54	1
Iron	3900		100		ug/L		02/17/23 10:16	02/17/23 20:54	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:54	1
Magnesium	75400		250		ug/L		02/17/23 10:16	02/17/23 20:54	1
Manganese	5080		5.00		ug/L		02/17/23 10:16	02/17/23 20:54	1
Nickel	15.1		5.00		ug/L		02/17/23 10:16	02/17/23 20:54	1
Potassium	5120		1000		ug/L		02/17/23 10:16	02/17/23 20:54	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:54	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:54	1
Sodium	107000		500		ug/L		02/17/23 10:16	02/17/23 20:54	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:54	1
Zinc	32.1		20.0		ug/L		02/17/23 10:16	02/17/23 20:54	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:19	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54559

Lab Sample ID: 680-230663-15

Date Collected: 02/01/23 09:34

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:41	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54560

Lab Sample ID: 680-230663-16

Date Collected: 02/01/23 11:13

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:09	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:09	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:09	1
Barium	125		5.00		ug/L		02/17/23 09:14	02/17/23 16:09	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:09	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:09	1
Calcium	709000		5000		ug/L		02/17/23 09:14	02/20/23 18:30	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:09	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:09	1
Iron	12800		100		ug/L		02/17/23 09:14	02/17/23 16:09	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:09	1
Magnesium	76200		250		ug/L		02/17/23 09:14	02/17/23 16:09	1
Manganese	623		5.00		ug/L		02/17/23 09:14	02/17/23 16:09	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:09	1
Potassium	8410		1000		ug/L		02/17/23 09:14	02/17/23 16:09	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:09	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:09	1
Sodium	129000		500		ug/L		02/17/23 09:14	02/17/23 16:09	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:09	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:09	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:07	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:07	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:07	1
Barium	121		5.00		ug/L		02/17/23 10:39	02/17/23 18:07	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:07	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:07	1
Calcium	723000		5000		ug/L		02/17/23 10:39	02/20/23 19:03	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:07	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:07	1
Iron	11900		100		ug/L		02/17/23 10:39	02/17/23 18:07	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:07	1
Magnesium	75200		250		ug/L		02/17/23 10:39	02/17/23 18:07	1
Manganese	622		5.00		ug/L		02/17/23 10:39	02/17/23 18:07	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:07	1
Potassium	8290		1000		ug/L		02/17/23 10:39	02/17/23 18:07	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:07	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:07	1
Sodium	128000		500		ug/L		02/17/23 10:39	02/17/23 18:07	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:07	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:07	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:54	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54560

Lab Sample ID: 680-230663-16

Date Collected: 02/01/23 11:13

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:45	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54561

Lab Sample ID: 680-230663-17

Date Collected: 02/01/23 12:32

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	6150		100		ug/L		02/17/23 09:14	02/17/23 16:46	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:46	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:46	1
Barium	1580		5.00		ug/L		02/17/23 09:14	02/17/23 16:46	1
Beryllium	5.53		0.500		ug/L		02/17/23 09:14	02/17/23 16:46	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:46	1
Calcium	167000		500		ug/L		02/17/23 09:14	02/17/23 16:46	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:46	1
Cobalt	17.1		0.500		ug/L		02/17/23 09:14	02/17/23 16:46	1
Iron	140000		100		ug/L		02/17/23 09:14	02/17/23 16:46	1
Lead	7.05		2.50		ug/L		02/17/23 09:14	02/17/23 16:46	1
Magnesium	4490		250		ug/L		02/17/23 09:14	02/17/23 16:46	1
Manganese	80.4		5.00		ug/L		02/17/23 09:14	02/17/23 16:46	1
Nickel	24.7		5.00		ug/L		02/17/23 09:14	02/17/23 16:46	1
Potassium	1000	U	1000		ug/L		02/17/23 09:14	02/17/23 16:46	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:46	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:46	1
Sodium	88600		500		ug/L		02/17/23 09:14	02/17/23 16:46	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:46	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:46	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	5830		100		ug/L		02/17/23 10:39	02/17/23 17:34	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:34	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 17:34	1
Barium	1500		5.00		ug/L		02/17/23 10:39	02/17/23 17:34	1
Beryllium	5.20		0.500		ug/L		02/17/23 10:39	02/17/23 17:34	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:34	1
Calcium	163000		500		ug/L		02/17/23 10:39	02/17/23 17:34	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:34	1
Cobalt	16.5		0.500		ug/L		02/17/23 10:39	02/17/23 17:34	1
Iron	137000		100		ug/L		02/17/23 10:39	02/17/23 17:34	1
Lead	6.33		2.50		ug/L		02/17/23 10:39	02/17/23 17:34	1
Magnesium	4330		250		ug/L		02/17/23 10:39	02/17/23 17:34	1
Manganese	75.2		5.00		ug/L		02/17/23 10:39	02/17/23 17:34	1
Nickel	23.4		5.00		ug/L		02/17/23 10:39	02/17/23 17:34	1
Potassium	1010		1000		ug/L		02/17/23 10:39	02/17/23 17:34	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:34	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:34	1
Sodium	84900		500		ug/L		02/17/23 10:39	02/17/23 17:34	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:34	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 17:34	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:17	02/22/23 08:18	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54561

Lab Sample ID: 680-230663-17

Date Collected: 02/01/23 12:32

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:48	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54562

Lab Sample ID: 680-230663-18

Date Collected: 02/01/23 13:44

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:41	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:41	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:41	1
Barium	298		5.00		ug/L		02/17/23 09:14	02/17/23 16:41	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:41	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:41	1
Calcium	488000		5000		ug/L		02/17/23 09:14	02/20/23 18:42	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:41	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:41	1
Iron	15200		100		ug/L		02/17/23 09:14	02/17/23 16:41	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:41	1
Magnesium	14300		250		ug/L		02/17/23 09:14	02/17/23 16:41	1
Manganese	373		5.00		ug/L		02/17/23 09:14	02/17/23 16:41	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:41	1
Potassium	1510		1000		ug/L		02/17/23 09:14	02/17/23 16:41	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:41	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:41	1
Sodium	73400		500		ug/L		02/17/23 09:14	02/17/23 16:41	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:41	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:41	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:15	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:15	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:15	1
Barium	290		5.00		ug/L		02/17/23 10:39	02/17/23 18:15	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:15	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:15	1
Calcium	485000		5000		ug/L		02/17/23 10:39	02/20/23 19:11	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:15	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:15	1
Iron	14100		100		ug/L		02/17/23 10:39	02/17/23 18:15	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:15	1
Magnesium	14500		250		ug/L		02/17/23 10:39	02/17/23 18:15	1
Manganese	355		5.00		ug/L		02/17/23 10:39	02/17/23 18:15	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:15	1
Potassium	1530		1000		ug/L		02/17/23 10:39	02/17/23 18:15	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:15	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:15	1
Sodium	71900		500		ug/L		02/17/23 10:39	02/17/23 18:15	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:15	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:15	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:05	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54562

Lab Sample ID: 680-230663-18

Date Collected: 02/01/23 13:44

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:52	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54563

Lab Sample ID: 680-230663-19

Date Collected: 02/01/23 14:52

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	191		100		ug/L		02/17/23 09:14	02/17/23 15:20	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:20	1
Arsenic	3.35		3.00		ug/L		02/17/23 09:14	02/17/23 15:20	1
Barium	49.7		5.00		ug/L		02/17/23 09:14	02/17/23 15:20	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:20	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:20	1
Calcium	1180000		5000		ug/L		02/17/23 09:14	02/20/23 18:22	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:20	1
Cobalt	10.4		0.500		ug/L		02/17/23 09:14	02/17/23 15:20	1
Iron	245000		100		ug/L		02/17/23 09:14	02/17/23 15:20	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:20	1
Magnesium	364000		250		ug/L		02/17/23 09:14	02/17/23 15:20	1
Manganese	10100		5.00		ug/L		02/17/23 09:14	02/17/23 15:20	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:20	1
Potassium	19400		1000		ug/L		02/17/23 09:14	02/17/23 15:20	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:20	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:20	1
Sodium	202000		500		ug/L		02/17/23 09:14	02/17/23 15:20	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:20	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:20	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	170		100		ug/L		02/17/23 10:16	02/17/23 19:16	1
Aluminum	175		100		ug/L		02/23/23 10:43	02/24/23 13:30	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:16	1
Antimony	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:30	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 19:16	1
Arsenic	3.00	U	3.00		ug/L		02/23/23 10:43	02/24/23 13:30	1
Barium	56.0		5.00		ug/L		02/17/23 10:16	02/17/23 19:16	1
Barium	57.1		5.00		ug/L		02/23/23 10:43	02/24/23 13:30	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:16	1
Beryllium	0.500	U	0.500		ug/L		02/23/23 10:43	02/24/23 13:30	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:16	1
Cadmium	0.500	U	0.500		ug/L		02/23/23 10:43	02/24/23 13:30	1
Calcium	1200000		5000		ug/L		02/17/23 10:16	02/20/23 19:27	10
Calcium	1110000		5000		ug/L		02/23/23 10:43	02/24/23 13:58	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:16	1
Chromium	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:30	1
Cobalt	9.88		0.500		ug/L		02/17/23 10:16	02/17/23 19:16	1
Cobalt	10.6		0.500		ug/L		02/23/23 10:43	02/24/23 13:30	1
Iron	234000		100		ug/L		02/17/23 10:16	02/17/23 19:16	1
Iron	233000		100		ug/L		02/23/23 10:43	02/24/23 13:30	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:16	1
Lead	2.50	U	2.50		ug/L		02/23/23 10:43	02/24/23 13:30	1
Magnesium	335000		250		ug/L		02/17/23 10:16	02/17/23 19:16	1
Magnesium	354000		250		ug/L		02/23/23 10:43	02/24/23 13:30	1
Manganese	9280		5.00		ug/L		02/17/23 10:16	02/17/23 19:16	1
Manganese	9800		5.00		ug/L		02/23/23 10:43	02/24/23 13:30	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:16	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54563

Lab Sample ID: 680-230663-19

Date Collected: 02/01/23 14:52

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Dissolved (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nickel	5.40		5.00		ug/L		02/23/23 10:43	02/24/23 13:30	1
Potassium	18000		1000		ug/L		02/17/23 10:16	02/17/23 19:16	1
Potassium	18500		1000		ug/L		02/23/23 10:43	02/24/23 13:30	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:16	1
Selenium	2.50	U	2.50		ug/L		02/23/23 10:43	02/24/23 13:30	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:16	1
Silver	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:30	1
Sodium	186000		500		ug/L		02/17/23 10:16	02/17/23 19:16	1
Sodium	185000		500		ug/L		02/23/23 10:43	02/24/23 13:30	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:16	1
Thallium	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:30	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 19:16	1
Zinc	20.0	U	20.0		ug/L		02/23/23 10:43	02/24/23 13:30	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:31	1

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 08:56	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54603

Lab Sample ID: 680-230663-20

Date Collected: 01/30/23 13:08

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 22:59	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:59	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 22:59	1
Barium	63.6		5.00		ug/L		02/17/23 09:09	02/17/23 22:59	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:59	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:59	1
Calcium	783000		5000		ug/L		02/17/23 09:09	02/20/23 20:07	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:59	1
Cobalt	9.40		0.500		ug/L		02/17/23 09:09	02/17/23 22:59	1
Iron	10600		100		ug/L		02/17/23 09:09	02/17/23 22:59	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:59	1
Magnesium	12400		250		ug/L		02/17/23 09:09	02/17/23 22:59	1
Manganese	2100		5.00		ug/L		02/17/23 09:09	02/17/23 22:59	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:59	1
Potassium	1570		1000		ug/L		02/17/23 09:09	02/17/23 22:59	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:59	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:59	1
Sodium	102000		500		ug/L		02/17/23 09:09	02/17/23 22:59	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:59	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 22:59	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 22:31	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:31	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 22:31	1
Barium	68.7		5.00		ug/L		02/17/23 09:09	02/17/23 22:31	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:31	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:31	1
Calcium	789000		5000		ug/L		02/17/23 09:09	02/20/23 20:03	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:31	1
Cobalt	9.98		0.500		ug/L		02/17/23 09:09	02/17/23 22:31	1
Iron	10300		100		ug/L		02/17/23 09:09	02/17/23 22:31	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:31	1
Magnesium	13300		250		ug/L		02/17/23 09:09	02/17/23 22:31	1
Manganese	2220		5.00		ug/L		02/17/23 09:09	02/17/23 22:31	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:31	1
Potassium	1720		1000		ug/L		02/17/23 09:09	02/17/23 22:31	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:31	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:31	1
Sodium	108000		500		ug/L		02/17/23 09:09	02/17/23 22:31	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:31	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 22:31	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:17	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54603

Lab Sample ID: 680-230663-20

Date Collected: 01/30/23 13:08

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:25	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54558

Lab Sample ID: 680-230663-21

Date Collected: 01/31/23 15:41

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 23:20	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:20	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 23:20	1
Barium	42.0		5.00		ug/L		02/17/23 09:09	02/17/23 23:20	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:20	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:20	1
Calcium	797000		5000		ug/L		02/17/23 09:09	02/20/23 20:16	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:20	1
Cobalt	10.1		0.500		ug/L		02/17/23 09:09	02/17/23 23:20	1
Iron	2400		100		ug/L		02/17/23 09:09	02/17/23 23:20	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:20	1
Magnesium	65700		250		ug/L		02/17/23 09:09	02/17/23 23:20	1
Manganese	2200		5.00		ug/L		02/17/23 09:09	02/17/23 23:20	1
Nickel	10.3		5.00		ug/L		02/17/23 09:09	02/17/23 23:20	1
Potassium	5190		1000		ug/L		02/17/23 09:09	02/17/23 23:20	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:20	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:20	1
Sodium	122000		500		ug/L		02/17/23 09:09	02/17/23 23:20	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:20	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 23:20	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:11	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:11	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:11	1
Barium	44.7		5.00		ug/L		02/17/23 10:39	02/17/23 18:11	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:11	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:11	1
Calcium	772000		5000		ug/L		02/17/23 10:39	02/20/23 19:07	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:11	1
Cobalt	10.8		0.500		ug/L		02/17/23 10:39	02/17/23 18:11	1
Iron	2230		100		ug/L		02/17/23 10:39	02/17/23 18:11	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:11	1
Magnesium	72300		250		ug/L		02/17/23 10:39	02/17/23 18:11	1
Manganese	2450		5.00		ug/L		02/17/23 10:39	02/17/23 18:11	1
Nickel	11.7		5.00		ug/L		02/17/23 10:39	02/17/23 18:11	1
Potassium	5520		1000		ug/L		02/17/23 10:39	02/17/23 18:11	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:11	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:11	1
Sodium	131000		500		ug/L		02/17/23 10:39	02/17/23 18:11	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:11	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:11	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:58	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54558

Lab Sample ID: 680-230663-21

Date Collected: 01/31/23 15:41

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 08:46	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54571

Lab Sample ID: 680-230663-22

Date Collected: 01/31/23 14:05

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 22:19	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:19	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 22:19	1
Barium	63.7		5.00		ug/L		02/17/23 09:09	02/17/23 22:19	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:19	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:19	1
Calcium	99900		500		ug/L		02/17/23 09:09	02/17/23 22:19	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:19	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:19	1
Iron	1350		100		ug/L		02/17/23 09:09	02/17/23 22:19	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:19	1
Magnesium	1560		250		ug/L		02/17/23 09:09	02/17/23 22:19	1
Manganese	56.0		5.00		ug/L		02/17/23 09:09	02/17/23 22:19	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:19	1
Potassium	1000	U	1000		ug/L		02/17/23 09:09	02/17/23 22:19	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:19	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:19	1
Sodium	7720		500		ug/L		02/17/23 09:09	02/17/23 22:19	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:19	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 22:19	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 17:55	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:55	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 17:55	1
Barium	63.0		5.00		ug/L		02/17/23 10:39	02/17/23 17:55	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:55	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:55	1
Calcium	101000		500		ug/L		02/17/23 10:39	02/17/23 17:55	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:55	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:55	1
Iron	526		100		ug/L		02/17/23 10:39	02/17/23 17:55	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:55	1
Magnesium	1570		250		ug/L		02/17/23 10:39	02/17/23 17:55	1
Manganese	56.9		5.00		ug/L		02/17/23 10:39	02/17/23 17:55	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:55	1
Potassium	1000	U	1000		ug/L		02/17/23 10:39	02/17/23 17:55	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:55	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:55	1
Sodium	7800		500		ug/L		02/17/23 10:39	02/17/23 17:55	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:55	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 17:55	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:02	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54571

Lab Sample ID: 680-230663-22

Date Collected: 01/31/23 14:05

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 08:53	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54599

Lab Sample ID: 680-230663-23

Date Collected: 01/24/23 14:38

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 15:53	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:53	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 15:53	1
Barium	18.7		5.00		ug/L		02/17/23 09:14	02/17/23 15:53	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:53	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:53	1
Calcium	66600		500		ug/L		02/17/23 09:14	02/17/23 15:53	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:53	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:53	1
Iron	247		100		ug/L		02/17/23 09:14	02/17/23 15:53	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:53	1
Magnesium	3080		250		ug/L		02/17/23 09:14	02/17/23 15:53	1
Manganese	52.4		5.00		ug/L		02/17/23 09:14	02/17/23 15:53	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:53	1
Potassium	3800		1000		ug/L		02/17/23 09:14	02/17/23 15:53	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:53	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:53	1
Sodium	6210		500		ug/L		02/17/23 09:14	02/17/23 15:53	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:53	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:53	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 17:43	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:43	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 17:43	1
Barium	21.6		5.00		ug/L		02/17/23 10:39	02/17/23 17:43	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:43	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:43	1
Calcium	66900		500		ug/L		02/17/23 10:39	02/17/23 17:43	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:43	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:43	1
Iron	100	U	100		ug/L		02/17/23 10:39	02/17/23 17:43	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:43	1
Magnesium	2980		250		ug/L		02/17/23 10:39	02/17/23 17:43	1
Manganese	50.2		5.00		ug/L		02/17/23 10:39	02/17/23 17:43	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:43	1
Potassium	3600		1000		ug/L		02/17/23 10:39	02/17/23 17:43	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:43	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:43	1
Sodium	6040		500		ug/L		02/17/23 10:39	02/17/23 17:43	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:43	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 17:43	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 13:11	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54599

Lab Sample ID: 680-230663-23

Date Collected: 01/24/23 14:38

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:00	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54557

Lab Sample ID: 680-230663-24

Date Collected: 02/06/23 11:39

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	8320		100		ug/L		02/17/23 09:09	02/17/23 22:55	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:55	1
Arsenic	3.12		3.00		ug/L		02/17/23 09:09	02/17/23 22:55	1
Barium	32.5		5.00		ug/L		02/17/23 09:09	02/17/23 22:55	1
Beryllium	11.6		0.500		ug/L		02/17/23 09:09	02/17/23 22:55	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:55	1
Calcium	298000		500		ug/L		02/17/23 09:09	02/17/23 22:55	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:55	1
Cobalt	28.7		0.500		ug/L		02/17/23 09:09	02/17/23 22:55	1
Iron	67400		100		ug/L		02/17/23 09:09	02/17/23 22:55	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:55	1
Magnesium	9270		250		ug/L		02/17/23 09:09	02/17/23 22:55	1
Manganese	147		5.00		ug/L		02/17/23 09:09	02/17/23 22:55	1
Nickel	20.9		5.00		ug/L		02/17/23 09:09	02/17/23 22:55	1
Potassium	1000	U	1000		ug/L		02/17/23 09:09	02/17/23 22:55	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:55	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:55	1
Sodium	71100		500		ug/L		02/17/23 09:09	02/17/23 22:55	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:55	1
Zinc	28.4		20.0		ug/L		02/17/23 09:09	02/17/23 22:55	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	7570		100		ug/L		02/17/23 10:16	02/17/23 20:05	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:05	1
Arsenic	3.05		3.00		ug/L		02/17/23 10:16	02/17/23 20:05	1
Barium	32.3		5.00		ug/L		02/17/23 10:16	02/17/23 20:05	1
Beryllium	11.6		0.500		ug/L		02/17/23 10:16	02/17/23 20:05	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:05	1
Calcium	292000		500		ug/L		02/17/23 10:16	02/17/23 20:05	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:05	1
Cobalt	28.1		0.500		ug/L		02/17/23 10:16	02/17/23 20:05	1
Iron	65800		100		ug/L		02/17/23 10:16	02/17/23 20:05	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:05	1
Magnesium	9170		250		ug/L		02/17/23 10:16	02/17/23 20:05	1
Manganese	143		5.00		ug/L		02/17/23 10:16	02/17/23 20:05	1
Nickel	21.2		5.00		ug/L		02/17/23 10:16	02/17/23 20:05	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 20:05	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:05	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:05	1
Sodium	68800		500		ug/L		02/17/23 10:16	02/17/23 20:05	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:05	1
Zinc	29.8		20.0		ug/L		02/17/23 10:16	02/17/23 20:05	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:53	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54557

Lab Sample ID: 680-230663-24

Date Collected: 02/06/23 11:39

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:17	02/22/23 08:21	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54586

Lab Sample ID: 680-230663-25

Date Collected: 02/06/23 14:02

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	24100		100		ug/L		02/17/23 09:14	02/17/23 15:24	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:24	1
Arsenic	9.22		3.00		ug/L		02/17/23 09:14	02/17/23 15:24	1
Barium	17.1		5.00		ug/L		02/17/23 09:14	02/17/23 15:24	1
Beryllium	4.24		0.500		ug/L		02/17/23 09:14	02/17/23 15:24	1
Cadmium	1.01		0.500		ug/L		02/17/23 09:14	02/17/23 15:24	1
Calcium	301000		500		ug/L		02/17/23 09:14	02/17/23 15:24	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:24	1
Cobalt	22.7		0.500		ug/L		02/17/23 09:14	02/17/23 15:24	1
Iron	81000		100		ug/L		02/17/23 09:14	02/17/23 15:24	1
Lead	23.4		2.50		ug/L		02/17/23 09:14	02/17/23 15:24	1
Magnesium	25100		250		ug/L		02/17/23 09:14	02/17/23 15:24	1
Manganese	351		5.00		ug/L		02/17/23 09:14	02/17/23 15:24	1
Nickel	12.1		5.00		ug/L		02/17/23 09:14	02/17/23 15:24	1
Potassium	2780		1000		ug/L		02/17/23 09:14	02/17/23 15:24	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:24	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:24	1
Sodium	10400		500		ug/L		02/17/23 09:14	02/17/23 15:24	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:24	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:24	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	21800		100		ug/L		02/17/23 10:39	02/17/23 17:14	1
Aluminum	21000		100		ug/L		02/23/23 10:43	02/24/23 13:34	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:14	1
Antimony	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:34	1
Arsenic	8.49		3.00		ug/L		02/17/23 10:39	02/17/23 17:14	1
Arsenic	8.08		3.00		ug/L		02/23/23 10:43	02/24/23 13:34	1
Barium	15.9		5.00		ug/L		02/17/23 10:39	02/17/23 17:14	1
Barium	14.7		5.00		ug/L		02/23/23 10:43	02/24/23 13:34	1
Beryllium	3.84		0.500		ug/L		02/17/23 10:39	02/17/23 17:14	1
Beryllium	3.60		0.500		ug/L		02/23/23 10:43	02/24/23 13:34	1
Cadmium	0.885		0.500		ug/L		02/17/23 10:39	02/17/23 17:14	1
Cadmium	1.59		0.500		ug/L		02/23/23 10:43	02/24/23 13:34	1
Calcium	279000		500		ug/L		02/17/23 10:39	02/17/23 17:14	1
Calcium	258000		500		ug/L		02/23/23 10:43	02/24/23 13:34	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:14	1
Chromium	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:34	1
Cobalt	20.7		0.500		ug/L		02/17/23 10:39	02/17/23 17:14	1
Cobalt	19.2		0.500		ug/L		02/23/23 10:43	02/24/23 13:34	1
Iron	74400		100		ug/L		02/17/23 10:39	02/17/23 17:14	1
Iron	69600		100		ug/L		02/23/23 10:43	02/24/23 13:34	1
Lead	21.2		2.50		ug/L		02/17/23 10:39	02/17/23 17:14	1
Lead	20.0		2.50		ug/L		02/23/23 10:43	02/24/23 13:34	1
Magnesium	22500		250		ug/L		02/17/23 10:39	02/17/23 17:14	1
Magnesium	21500		250		ug/L		02/23/23 10:43	02/24/23 13:34	1
Manganese	314		5.00		ug/L		02/17/23 10:39	02/17/23 17:14	1
Manganese	312		5.00		ug/L		02/23/23 10:43	02/24/23 13:34	1
Nickel	10.7		5.00		ug/L		02/17/23 10:39	02/17/23 17:14	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54586

Lab Sample ID: 680-230663-25

Date Collected: 02/06/23 14:02

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Dissolved (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Nickel	10.2		5.00		ug/L		02/23/23 10:43	02/24/23 13:34	1
Potassium	2520		1000		ug/L		02/17/23 10:39	02/17/23 17:14	1
Potassium	2340		1000		ug/L		02/23/23 10:43	02/24/23 13:34	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:14	1
Selenium	2.50	U	2.50		ug/L		02/23/23 10:43	02/24/23 13:34	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:14	1
Silver	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:34	1
Sodium	9110		500		ug/L		02/17/23 10:39	02/17/23 17:14	1
Sodium	8310		500		ug/L		02/23/23 10:43	02/24/23 13:34	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:14	1
Thallium	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:34	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 17:14	1
Zinc	20.0	U	20.0		ug/L		02/23/23 10:43	02/24/23 13:34	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:57	1

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 09:10	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54587

Lab Sample ID: 680-230663-26

Date Collected: 02/06/23 14:07

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	23100		100		ug/L		02/17/23 09:14	02/17/23 15:32	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:32	1
Arsenic	9.22		3.00		ug/L		02/17/23 09:14	02/17/23 15:32	1
Barium	16.6		5.00		ug/L		02/17/23 09:14	02/17/23 15:32	1
Beryllium	3.96		0.500		ug/L		02/17/23 09:14	02/17/23 15:32	1
Cadmium	0.895		0.500		ug/L		02/17/23 09:14	02/17/23 15:32	1
Calcium	292000		500		ug/L		02/17/23 09:14	02/17/23 15:32	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:32	1
Cobalt	22.3		0.500		ug/L		02/17/23 09:14	02/17/23 15:32	1
Iron	77700		100		ug/L		02/17/23 09:14	02/17/23 15:32	1
Lead	22.7		2.50		ug/L		02/17/23 09:14	02/17/23 15:32	1
Magnesium	24500		250		ug/L		02/17/23 09:14	02/17/23 15:32	1
Manganese	343		5.00		ug/L		02/17/23 09:14	02/17/23 15:32	1
Nickel	12.1		5.00		ug/L		02/17/23 09:14	02/17/23 15:32	1
Potassium	2690		1000		ug/L		02/17/23 09:14	02/17/23 15:32	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:32	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:32	1
Sodium	10500		500		ug/L		02/17/23 09:14	02/17/23 15:32	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:32	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:32	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	20700		100		ug/L		02/17/23 10:16	02/17/23 19:40	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:40	1
Arsenic	8.02		3.00		ug/L		02/17/23 10:16	02/17/23 19:40	1
Barium	15.7		5.00		ug/L		02/17/23 10:16	02/17/23 19:40	1
Beryllium	3.87		0.500		ug/L		02/17/23 10:16	02/17/23 19:40	1
Cadmium	0.935		0.500		ug/L		02/17/23 10:16	02/17/23 19:40	1
Calcium	263000		500		ug/L		02/17/23 10:16	02/17/23 19:40	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:40	1
Cobalt	19.9		0.500		ug/L		02/17/23 10:16	02/17/23 19:40	1
Iron	69000		100		ug/L		02/17/23 10:16	02/17/23 19:40	1
Lead	20.0		2.50		ug/L		02/17/23 10:16	02/17/23 19:40	1
Magnesium	22300		250		ug/L		02/17/23 10:16	02/17/23 19:40	1
Manganese	305		5.00		ug/L		02/17/23 10:16	02/17/23 19:40	1
Nickel	10.8		5.00		ug/L		02/17/23 10:16	02/17/23 19:40	1
Potassium	2400		1000		ug/L		02/17/23 10:16	02/17/23 19:40	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:40	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:40	1
Sodium	9160		500		ug/L		02/17/23 10:16	02/17/23 19:40	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:40	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 19:40	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:18	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54587

Lab Sample ID: 680-230663-26

Date Collected: 02/06/23 14:07

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 09:14	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54588

Lab Sample ID: 680-230663-27

Date Collected: 02/06/23 12:55

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	53500		100		ug/L		02/17/23 09:09	02/17/23 23:11	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:11	1
Arsenic	7.95		3.00		ug/L		02/17/23 09:09	02/17/23 23:11	1
Barium	34.0		5.00		ug/L		02/17/23 09:09	02/17/23 23:11	1
Beryllium	49.7		0.500		ug/L		02/17/23 09:09	02/17/23 23:11	1
Cadmium	1.47		0.500		ug/L		02/17/23 09:09	02/17/23 23:11	1
Calcium	737000		5000		ug/L		02/17/23 09:09	02/20/23 20:12	10
Chromium	7.26		5.00		ug/L		02/17/23 09:09	02/17/23 23:11	1
Cobalt	141		0.500		ug/L		02/17/23 09:09	02/17/23 23:11	1
Iron	157000		100		ug/L		02/17/23 09:09	02/17/23 23:11	1
Lead	32.8		2.50		ug/L		02/17/23 09:09	02/17/23 23:11	1
Magnesium	34100		250		ug/L		02/17/23 09:09	02/17/23 23:11	1
Manganese	629		5.00		ug/L		02/17/23 09:09	02/17/23 23:11	1
Nickel	127		5.00		ug/L		02/17/23 09:09	02/17/23 23:11	1
Potassium	2920		1000		ug/L		02/17/23 09:09	02/17/23 23:11	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:11	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:11	1
Sodium	118000		500		ug/L		02/17/23 09:09	02/17/23 23:11	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:11	1
Zinc	237		20.0		ug/L		02/17/23 09:09	02/17/23 23:11	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	52500		100		ug/L		02/17/23 10:39	02/17/23 17:30	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:30	1
Arsenic	8.64		3.00		ug/L		02/17/23 10:39	02/17/23 17:30	1
Barium	34.1		5.00		ug/L		02/17/23 10:39	02/17/23 17:30	1
Beryllium	48.6		0.500		ug/L		02/17/23 10:39	02/17/23 17:30	1
Cadmium	1.41		0.500		ug/L		02/17/23 10:39	02/17/23 17:30	1
Calcium	707000		5000		ug/L		02/17/23 10:39	02/20/23 18:59	10
Chromium	7.38		5.00		ug/L		02/17/23 10:39	02/17/23 17:30	1
Cobalt	140		0.500		ug/L		02/17/23 10:39	02/17/23 17:30	1
Iron	153000		100		ug/L		02/17/23 10:39	02/17/23 17:30	1
Lead	32.6		2.50		ug/L		02/17/23 10:39	02/17/23 17:30	1
Magnesium	34000		250		ug/L		02/17/23 10:39	02/17/23 17:30	1
Manganese	624		5.00		ug/L		02/17/23 10:39	02/17/23 17:30	1
Nickel	126		5.00		ug/L		02/17/23 10:39	02/17/23 17:30	1
Potassium	2970		1000		ug/L		02/17/23 10:39	02/17/23 17:30	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:30	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:30	1
Sodium	118000		500		ug/L		02/17/23 10:39	02/17/23 17:30	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:30	1
Zinc	236		20.0		ug/L		02/17/23 10:39	02/17/23 17:30	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 08:32	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54588

Lab Sample ID: 680-230663-27

Date Collected: 02/06/23 12:55

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 08:49	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54589

Lab Sample ID: 680-230663-28

Date Collected: 02/06/23 15:32

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	16600		100		ug/L		02/17/23 09:09	02/17/23 22:51	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:51	1
Arsenic	4.62		3.00		ug/L		02/17/23 09:09	02/17/23 22:51	1
Barium	28.6		5.00		ug/L		02/17/23 09:09	02/17/23 22:51	1
Beryllium	16.2		0.500		ug/L		02/17/23 09:09	02/17/23 22:51	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:51	1
Calcium	266000		500		ug/L		02/17/23 09:09	02/17/23 22:51	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:51	1
Cobalt	39.9		0.500		ug/L		02/17/23 09:09	02/17/23 22:51	1
Iron	95600		100		ug/L		02/17/23 09:09	02/17/23 22:51	1
Lead	9.27		2.50		ug/L		02/17/23 09:09	02/17/23 22:51	1
Magnesium	13400		250		ug/L		02/17/23 09:09	02/17/23 22:51	1
Manganese	296		5.00		ug/L		02/17/23 09:09	02/17/23 22:51	1
Nickel	40.0		5.00		ug/L		02/17/23 09:09	02/17/23 22:51	1
Potassium	2580		1000		ug/L		02/17/23 09:09	02/17/23 22:51	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:51	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:51	1
Sodium	77300		500		ug/L		02/17/23 09:09	02/17/23 22:51	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:51	1
Zinc	69.7		20.0		ug/L		02/17/23 09:09	02/17/23 22:51	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	16300		100		ug/L		02/17/23 10:16	02/17/23 20:45	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:45	1
Arsenic	4.55		3.00		ug/L		02/17/23 10:16	02/17/23 20:45	1
Barium	30.0		5.00		ug/L		02/17/23 10:16	02/17/23 20:45	1
Beryllium	15.5		0.500		ug/L		02/17/23 10:16	02/17/23 20:45	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:45	1
Calcium	255000		500		ug/L		02/17/23 10:16	02/17/23 20:45	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:45	1
Cobalt	40.1		0.500		ug/L		02/17/23 10:16	02/17/23 20:45	1
Iron	90600		100		ug/L		02/17/23 10:16	02/17/23 20:45	1
Lead	9.00		2.50		ug/L		02/17/23 10:16	02/17/23 20:45	1
Magnesium	13200		250		ug/L		02/17/23 10:16	02/17/23 20:45	1
Manganese	292		5.00		ug/L		02/17/23 10:16	02/17/23 20:45	1
Nickel	40.2		5.00		ug/L		02/17/23 10:16	02/17/23 20:45	1
Potassium	2520		1000		ug/L		02/17/23 10:16	02/17/23 20:45	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:45	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:45	1
Sodium	76000		500		ug/L		02/17/23 10:16	02/17/23 20:45	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:45	1
Zinc	68.0		20.0		ug/L		02/17/23 10:16	02/17/23 20:45	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:39	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54589

Lab Sample ID: 680-230663-28

Date Collected: 02/06/23 15:32

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 09:24	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54568

Lab Sample ID: 680-230663-29

Date Collected: 02/06/23 09:17

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	195		100		ug/L		02/17/23 09:09	02/17/23 23:15	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:15	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 23:15	1
Barium	126		5.00		ug/L		02/17/23 09:09	02/17/23 23:15	1
Beryllium	1.43		0.500		ug/L		02/17/23 09:09	02/17/23 23:15	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:15	1
Calcium	19100		500		ug/L		02/17/23 09:09	02/17/23 23:15	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:15	1
Cobalt	7.33		0.500		ug/L		02/17/23 09:09	02/17/23 23:15	1
Iron	184		100		ug/L		02/17/23 09:09	02/17/23 23:15	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:15	1
Magnesium	878		250		ug/L		02/17/23 09:09	02/17/23 23:15	1
Manganese	8.85		5.00		ug/L		02/17/23 09:09	02/17/23 23:15	1
Nickel	6.59		5.00		ug/L		02/17/23 09:09	02/17/23 23:15	1
Potassium	1000	U	1000		ug/L		02/17/23 09:09	02/17/23 23:15	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:15	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:15	1
Sodium	51000		500		ug/L		02/17/23 09:09	02/17/23 23:15	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:15	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 23:15	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	200		100		ug/L		02/17/23 10:16	02/17/23 20:33	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:33	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:33	1
Barium	131		5.00		ug/L		02/17/23 10:16	02/17/23 20:33	1
Beryllium	1.35		0.500		ug/L		02/17/23 10:16	02/17/23 20:33	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:33	1
Calcium	20000		500		ug/L		02/17/23 10:16	02/17/23 20:33	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:33	1
Cobalt	7.36		0.500		ug/L		02/17/23 10:16	02/17/23 20:33	1
Iron	158		100		ug/L		02/17/23 10:16	02/17/23 20:33	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:33	1
Magnesium	901		250		ug/L		02/17/23 10:16	02/17/23 20:33	1
Manganese	9.79		5.00		ug/L		02/17/23 10:16	02/17/23 20:33	1
Nickel	6.37		5.00		ug/L		02/17/23 10:16	02/17/23 20:33	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 20:33	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:33	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:33	1
Sodium	50600		500		ug/L		02/17/23 10:16	02/17/23 20:33	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:33	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 20:33	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:09	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54568

Lab Sample ID: 680-230663-29

Date Collected: 02/06/23 09:17

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 09:07	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54569

Lab Sample ID: 680-230663-30

Date Collected: 02/06/23 10:19

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	165		100		ug/L		02/17/23 09:09	02/17/23 22:47	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:47	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 22:47	1
Barium	208		5.00		ug/L		02/17/23 09:09	02/17/23 22:47	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:47	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:47	1
Calcium	263000		500		ug/L		02/17/23 09:09	02/17/23 22:47	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:47	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:47	1
Iron	3040		100		ug/L		02/17/23 09:09	02/17/23 22:47	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:47	1
Magnesium	4710		250		ug/L		02/17/23 09:09	02/17/23 22:47	1
Manganese	232		5.00		ug/L		02/17/23 09:09	02/17/23 22:47	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:47	1
Potassium	2040		1000		ug/L		02/17/23 09:09	02/17/23 22:47	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:47	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:47	1
Sodium	20000		500		ug/L		02/17/23 09:09	02/17/23 22:47	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:47	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 22:47	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	383		100		ug/L		02/17/23 10:16	02/17/23 20:13	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:13	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:13	1
Barium	179		5.00		ug/L		02/17/23 10:16	02/17/23 20:13	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:13	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:13	1
Calcium	239000		500		ug/L		02/17/23 10:16	02/17/23 20:13	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:13	1
Cobalt	1.23		0.500		ug/L		02/17/23 10:16	02/17/23 20:13	1
Iron	2960		100		ug/L		02/17/23 10:16	02/17/23 20:13	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:13	1
Magnesium	4310		250		ug/L		02/17/23 10:16	02/17/23 20:13	1
Manganese	206		5.00		ug/L		02/17/23 10:16	02/17/23 20:13	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:13	1
Potassium	1780		1000		ug/L		02/17/23 10:16	02/17/23 20:13	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:13	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:13	1
Sodium	18200		500		ug/L		02/17/23 10:16	02/17/23 20:13	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:13	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 20:13	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:48	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54569

Lab Sample ID: 680-230663-30

Date Collected: 02/06/23 10:19

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 08:42	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54602

Lab Sample ID: 680-230663-31

Date Collected: 01/30/23 11:26

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 22:27	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:27	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 22:27	1
Barium	132		5.00		ug/L		02/17/23 09:09	02/17/23 22:27	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:27	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:27	1
Calcium	277000		500		ug/L		02/17/23 09:09	02/17/23 22:27	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:27	1
Cobalt	32.1		0.500		ug/L		02/17/23 09:09	02/17/23 22:27	1
Iron	135		100		ug/L		02/17/23 09:09	02/17/23 22:27	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:27	1
Magnesium	4190		250		ug/L		02/17/23 09:09	02/17/23 22:27	1
Manganese	950		5.00		ug/L		02/17/23 09:09	02/17/23 22:27	1
Nickel	6.66		5.00		ug/L		02/17/23 09:09	02/17/23 22:27	1
Potassium	2010		1000		ug/L		02/17/23 09:09	02/17/23 22:27	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:27	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:27	1
Sodium	65700		500		ug/L		02/17/23 09:09	02/17/23 22:27	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:27	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 22:27	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:01	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:01	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:01	1
Barium	131		5.00		ug/L		02/17/23 10:16	02/17/23 20:01	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:01	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:01	1
Calcium	282000		500		ug/L		02/17/23 10:16	02/17/23 20:01	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:01	1
Cobalt	31.4		0.500		ug/L		02/17/23 10:16	02/17/23 20:01	1
Iron	809		100		ug/L		02/17/23 10:16	02/17/23 20:01	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:01	1
Magnesium	4230		250		ug/L		02/17/23 10:16	02/17/23 20:01	1
Manganese	955		5.00		ug/L		02/17/23 10:16	02/17/23 20:01	1
Nickel	7.11		5.00		ug/L		02/17/23 10:16	02/17/23 20:01	1
Potassium	2030		1000		ug/L		02/17/23 10:16	02/17/23 20:01	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:01	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:01	1
Sodium	65100		500		ug/L		02/17/23 10:16	02/17/23 20:01	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:01	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 20:01	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:20	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54602

Lab Sample ID: 680-230663-31

Date Collected: 01/30/23 11:26

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:28	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54604

Lab Sample ID: 680-230663-32

Date Collected: 01/30/23 09:37

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	758		100		ug/L		02/17/23 09:14	02/17/23 15:08	1
Aluminum	627		100		ug/L		02/23/23 10:43	02/24/23 13:22	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:08	1
Antimony	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:22	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 15:08	1
Arsenic	3.00	U	3.00		ug/L		02/23/23 10:43	02/24/23 13:22	1
Barium	78.1		5.00		ug/L		02/17/23 09:14	02/17/23 15:08	1
Barium	79.4		5.00		ug/L		02/23/23 10:43	02/24/23 13:22	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:08	1
Beryllium	0.500	U	0.500		ug/L		02/23/23 10:43	02/24/23 13:22	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:08	1
Cadmium	0.500	U	0.500		ug/L		02/23/23 10:43	02/24/23 13:22	1
Calcium	459000		5000		ug/L		02/17/23 09:14	02/20/23 18:10	10
Calcium	417000		5000		ug/L		02/23/23 10:43	02/24/23 13:54	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:08	1
Chromium	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:22	1
Cobalt	3.01		0.500		ug/L		02/17/23 09:14	02/17/23 15:08	1
Cobalt	3.50		0.500		ug/L		02/23/23 10:43	02/24/23 13:22	1
Iron	15200		100		ug/L		02/17/23 09:14	02/17/23 15:08	1
Iron	15300		100		ug/L		02/23/23 10:43	02/24/23 13:22	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:08	1
Lead	2.50	U	2.50		ug/L		02/23/23 10:43	02/24/23 13:22	1
Magnesium	8430		250		ug/L		02/17/23 09:14	02/17/23 15:08	1
Magnesium	8680		250		ug/L		02/23/23 10:43	02/24/23 13:22	1
Manganese	619		5.00		ug/L		02/17/23 09:14	02/17/23 15:08	1
Manganese	650		5.00		ug/L		02/23/23 10:43	02/24/23 13:22	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:08	1
Nickel	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:22	1
Potassium	1580		1000		ug/L		02/17/23 09:14	02/17/23 15:08	1
Potassium	1570		1000		ug/L		02/23/23 10:43	02/24/23 13:22	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:08	1
Selenium	2.50	U	2.50		ug/L		02/23/23 10:43	02/24/23 13:22	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:08	1
Silver	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:22	1
Sodium	65700		500		ug/L		02/17/23 09:14	02/17/23 15:08	1
Sodium	63700		500		ug/L		02/23/23 10:43	02/24/23 13:22	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:08	1
Thallium	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:22	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:08	1
Zinc	20.0	U	20.0		ug/L		02/23/23 10:43	02/24/23 13:22	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 19:28	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:28	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 19:28	1
Barium	74.6		5.00		ug/L		02/17/23 10:16	02/17/23 19:28	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:28	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:28	1
Calcium	448000		500		ug/L		02/17/23 10:16	02/17/23 19:28	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54604

Lab Sample ID: 680-230663-32

Date Collected: 01/30/23 09:37

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Dissolved (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:28	1
Cobalt	2.17		0.500		ug/L		02/17/23 10:16	02/17/23 19:28	1
Iron	13000		100		ug/L		02/17/23 10:16	02/17/23 19:28	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:28	1
Magnesium	7830		250		ug/L		02/17/23 10:16	02/17/23 19:28	1
Manganese	571		5.00		ug/L		02/17/23 10:16	02/17/23 19:28	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:28	1
Potassium	1460		1000		ug/L		02/17/23 10:16	02/17/23 19:28	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:28	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:28	1
Sodium	61700		500		ug/L		02/17/23 10:16	02/17/23 19:28	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:28	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 19:28	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:24	1

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:32	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54607

Lab Sample ID: 680-230663-33

Date Collected: 01/30/23 14:10

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 15:57	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:57	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 15:57	1
Barium	520		5.00		ug/L		02/17/23 09:14	02/17/23 15:57	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:57	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:57	1
Calcium	631000		5000		ug/L		02/17/23 09:14	02/20/23 18:26	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:57	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:57	1
Iron	16600		100		ug/L		02/17/23 09:14	02/17/23 15:57	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:57	1
Magnesium	14700		250		ug/L		02/17/23 09:14	02/17/23 15:57	1
Manganese	1150		5.00		ug/L		02/17/23 09:14	02/17/23 15:57	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:57	1
Potassium	4950		1000		ug/L		02/17/23 09:14	02/17/23 15:57	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:57	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:57	1
Sodium	102000		500		ug/L		02/17/23 09:14	02/17/23 15:57	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:57	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:57	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:19	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:19	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:19	1
Barium	513		5.00		ug/L		02/17/23 10:39	02/17/23 18:19	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:19	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:19	1
Calcium	639000		5000		ug/L		02/17/23 10:39	02/20/23 19:15	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:19	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:19	1
Iron	16300		100		ug/L		02/17/23 10:39	02/17/23 18:19	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:19	1
Magnesium	14400		250		ug/L		02/17/23 10:39	02/17/23 18:19	1
Manganese	1140		5.00		ug/L		02/17/23 10:39	02/17/23 18:19	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:19	1
Potassium	4860		1000		ug/L		02/17/23 10:39	02/17/23 18:19	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:19	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:19	1
Sodium	100000		500		ug/L		02/17/23 10:39	02/17/23 18:19	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:19	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:19	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:27	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54607

Lab Sample ID: 680-230663-33

Date Collected: 01/30/23 14:10

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:35	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54574

Lab Sample ID: 680-230663-34

Date Collected: 02/07/23 14:17

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	166		100		ug/L		02/17/23 09:14	02/17/23 15:37	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:37	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 15:37	1
Barium	19.1		5.00		ug/L		02/17/23 09:14	02/17/23 15:37	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:37	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:37	1
Calcium	4940		500		ug/L		02/17/23 09:14	02/17/23 15:37	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:37	1
Cobalt	1.57		0.500		ug/L		02/17/23 09:14	02/17/23 15:37	1
Iron	499		100		ug/L		02/17/23 09:14	02/17/23 15:37	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:37	1
Magnesium	665		250		ug/L		02/17/23 09:14	02/17/23 15:37	1
Manganese	16.6		5.00		ug/L		02/17/23 09:14	02/17/23 15:37	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:37	1
Potassium	1000	U	1000		ug/L		02/17/23 09:14	02/17/23 15:37	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:37	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:37	1
Sodium	6540		500		ug/L		02/17/23 09:14	02/17/23 15:37	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:37	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:37	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	172		100		ug/L		02/17/23 10:16	02/17/23 19:44	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:44	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 19:44	1
Barium	22.0		5.00		ug/L		02/17/23 10:16	02/17/23 19:44	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:44	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:44	1
Calcium	8080		500		ug/L		02/17/23 10:16	02/17/23 19:44	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:44	1
Cobalt	2.55		0.500		ug/L		02/17/23 10:16	02/17/23 19:44	1
Iron	861		100		ug/L		02/17/23 10:16	02/17/23 19:44	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:44	1
Magnesium	720		250		ug/L		02/17/23 10:16	02/17/23 19:44	1
Manganese	16.0		5.00		ug/L		02/17/23 10:16	02/17/23 19:44	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:44	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 19:44	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:44	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:44	1
Sodium	6450		500		ug/L		02/17/23 10:16	02/17/23 19:44	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:44	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 19:44	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:38	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54574

Lab Sample ID: 680-230663-34

Date Collected: 02/07/23 14:17

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 20:00	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54580

Lab Sample ID: 680-230663-35

Date Collected: 02/07/23 13:08

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:17	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:17	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:17	1
Barium	37.3		5.00		ug/L		02/17/23 09:14	02/17/23 16:17	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:17	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:17	1
Calcium	12400		500		ug/L		02/17/23 09:14	02/17/23 16:17	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:17	1
Cobalt	8.47		0.500		ug/L		02/17/23 09:14	02/17/23 16:17	1
Iron	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:17	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:17	1
Magnesium	596		250		ug/L		02/17/23 09:14	02/17/23 16:17	1
Manganese	457		5.00		ug/L		02/17/23 09:14	02/17/23 16:17	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:17	1
Potassium	1000	U	1000		ug/L		02/17/23 09:14	02/17/23 16:17	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:17	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:17	1
Sodium	7010		500		ug/L		02/17/23 09:14	02/17/23 16:17	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:17	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:17	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 22:43	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:43	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 22:43	1
Barium	36.2		5.00		ug/L		02/17/23 09:09	02/17/23 22:43	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:43	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 22:43	1
Calcium	12300		500		ug/L		02/17/23 09:09	02/17/23 22:43	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:43	1
Cobalt	7.49		0.500		ug/L		02/17/23 09:09	02/17/23 22:43	1
Iron	100	U	100		ug/L		02/17/23 09:09	02/17/23 22:43	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:43	1
Magnesium	623		250		ug/L		02/17/23 09:09	02/17/23 22:43	1
Manganese	433		5.00		ug/L		02/17/23 09:09	02/17/23 22:43	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:43	1
Potassium	1000	U	1000		ug/L		02/17/23 09:09	02/17/23 22:43	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:43	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:43	1
Sodium	6840		500		ug/L		02/17/23 09:09	02/17/23 22:43	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:43	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 22:43	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:11	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54580

Lab Sample ID: 680-230663-35

Date Collected: 02/07/23 13:08

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:17	02/22/23 08:28	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54584

Lab Sample ID: 680-230663-36

Date Collected: 02/07/23 15:22

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:50	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:50	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:50	1
Barium	25.8		5.00		ug/L		02/17/23 09:14	02/17/23 16:50	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:50	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:50	1
Calcium	5070		500		ug/L		02/17/23 09:14	02/17/23 16:50	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:50	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:50	1
Iron	100	U	100		ug/L		02/17/23 09:14	02/17/23 16:50	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:50	1
Magnesium	250		250		ug/L		02/17/23 09:14	02/17/23 16:50	1
Manganese	64.0		5.00		ug/L		02/17/23 09:14	02/17/23 16:50	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:50	1
Potassium	1000	U	1000		ug/L		02/17/23 09:14	02/17/23 16:50	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:50	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:50	1
Sodium	4850		500		ug/L		02/17/23 09:14	02/17/23 16:50	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:50	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 16:50	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:23	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:23	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 18:23	1
Barium	36.6		5.00		ug/L		02/17/23 10:39	02/17/23 18:23	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:23	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:23	1
Calcium	5000		500		ug/L		02/17/23 10:39	02/17/23 18:23	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:23	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 18:23	1
Iron	100	U	100		ug/L		02/17/23 10:39	02/17/23 18:23	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:23	1
Magnesium	251		250		ug/L		02/17/23 10:39	02/17/23 18:23	1
Manganese	63.4		5.00		ug/L		02/17/23 10:39	02/17/23 18:23	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:23	1
Potassium	1000	U	1000		ug/L		02/17/23 10:39	02/17/23 18:23	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:23	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:23	1
Sodium	4760		500		ug/L		02/17/23 10:39	02/17/23 18:23	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:23	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 18:23	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:51	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54584

Lab Sample ID: 680-230663-36

Date Collected: 02/07/23 15:22

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 09:00	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54585

Lab Sample ID: 680-230663-37

Date Collected: 02/07/23 10:24

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	17000		100		ug/L		02/17/23 09:09	02/17/23 23:40	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:40	1
Arsenic	9.56		3.00		ug/L		02/17/23 09:09	02/17/23 23:40	1
Barium	39.1		5.00		ug/L		02/17/23 09:09	02/17/23 23:40	1
Beryllium	11.0		0.500		ug/L		02/17/23 09:09	02/17/23 23:40	1
Cadmium	1.28		0.500		ug/L		02/17/23 09:09	02/17/23 23:40	1
Calcium	264000		500		ug/L		02/17/23 09:09	02/17/23 23:40	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:40	1
Cobalt	48.0		0.500		ug/L		02/17/23 09:09	02/17/23 23:40	1
Iron	179000		100		ug/L		02/17/23 09:09	02/17/23 23:40	1
Lead	6.25		2.50		ug/L		02/17/23 09:09	02/17/23 23:40	1
Magnesium	55400		250		ug/L		02/17/23 09:09	02/17/23 23:40	1
Manganese	437		5.00		ug/L		02/17/23 09:09	02/17/23 23:40	1
Nickel	32.8		5.00		ug/L		02/17/23 09:09	02/17/23 23:40	1
Potassium	4590		1000		ug/L		02/17/23 09:09	02/17/23 23:40	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:40	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:40	1
Sodium	74400		500		ug/L		02/17/23 09:09	02/17/23 23:40	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:40	1
Zinc	68.5		20.0		ug/L		02/17/23 09:09	02/17/23 23:40	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	18600		100		ug/L		02/17/23 10:39	02/17/23 18:43	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:43	1
Arsenic	11.6		3.00		ug/L		02/17/23 10:39	02/17/23 18:43	1
Barium	44.0		5.00		ug/L		02/17/23 10:39	02/17/23 18:43	1
Beryllium	11.7		0.500		ug/L		02/17/23 10:39	02/17/23 18:43	1
Cadmium	1.63		0.500		ug/L		02/17/23 10:39	02/17/23 18:43	1
Calcium	288000		500		ug/L		02/17/23 10:39	02/17/23 18:43	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:43	1
Cobalt	53.5		0.500		ug/L		02/17/23 10:39	02/17/23 18:43	1
Iron	197000		100		ug/L		02/17/23 10:39	02/17/23 18:43	1
Lead	6.40		2.50		ug/L		02/17/23 10:39	02/17/23 18:43	1
Magnesium	61500		250		ug/L		02/17/23 10:39	02/17/23 18:43	1
Manganese	480		5.00		ug/L		02/17/23 10:39	02/17/23 18:43	1
Nickel	35.9		5.00		ug/L		02/17/23 10:39	02/17/23 18:43	1
Potassium	5110		1000		ug/L		02/17/23 10:39	02/17/23 18:43	1
Selenium	2.65		2.50		ug/L		02/17/23 10:39	02/17/23 18:43	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:43	1
Sodium	82100		500		ug/L		02/17/23 10:39	02/17/23 18:43	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:43	1
Zinc	74.6		20.0		ug/L		02/17/23 10:39	02/17/23 18:43	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:34	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54585

Lab Sample ID: 680-230663-37

Date Collected: 02/07/23 10:24

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 09:03	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54591

Lab Sample ID: 680-230663-38

Date Collected: 02/07/23 11:40

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	11900		100		ug/L		02/17/23 09:14	02/17/23 16:13	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:13	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 16:13	1
Barium	159		5.00		ug/L		02/17/23 09:14	02/17/23 16:13	1
Beryllium	31.3		0.500		ug/L		02/17/23 09:14	02/17/23 16:13	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 16:13	1
Calcium	520000		5000		ug/L		02/17/23 09:14	02/20/23 18:34	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:13	1
Cobalt	198		0.500		ug/L		02/17/23 09:14	02/17/23 16:13	1
Iron	71500		100		ug/L		02/17/23 09:14	02/17/23 16:13	1
Lead	11.8		2.50		ug/L		02/17/23 09:14	02/17/23 16:13	1
Magnesium	19900		250		ug/L		02/17/23 09:14	02/17/23 16:13	1
Manganese	209		5.00		ug/L		02/17/23 09:14	02/17/23 16:13	1
Nickel	198		5.00		ug/L		02/17/23 09:14	02/17/23 16:13	1
Potassium	1820		1000		ug/L		02/17/23 09:14	02/17/23 16:13	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:13	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:13	1
Sodium	121000		500		ug/L		02/17/23 09:14	02/17/23 16:13	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:13	1
Zinc	1210		20.0		ug/L		02/17/23 09:14	02/17/23 16:13	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	11600		100		ug/L		02/17/23 10:39	02/17/23 17:26	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:26	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 17:26	1
Barium	149		5.00		ug/L		02/17/23 10:39	02/17/23 17:26	1
Beryllium	29.9		0.500		ug/L		02/17/23 10:39	02/17/23 17:26	1
Cadmium	0.560		0.500		ug/L		02/17/23 10:39	02/17/23 17:26	1
Calcium	541000		5000		ug/L		02/17/23 10:39	02/20/23 18:46	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:26	1
Cobalt	193		0.500		ug/L		02/17/23 10:39	02/17/23 17:26	1
Iron	67900		100		ug/L		02/17/23 10:39	02/17/23 17:26	1
Lead	11.6		2.50		ug/L		02/17/23 10:39	02/17/23 17:26	1
Magnesium	18900		250		ug/L		02/17/23 10:39	02/17/23 17:26	1
Manganese	208		5.00		ug/L		02/17/23 10:39	02/17/23 17:26	1
Nickel	189		5.00		ug/L		02/17/23 10:39	02/17/23 17:26	1
Potassium	1800		1000		ug/L		02/17/23 10:39	02/17/23 17:26	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:26	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:26	1
Sodium	118000		500		ug/L		02/17/23 10:39	02/17/23 17:26	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:26	1
Zinc	1100		20.0		ug/L		02/17/23 10:39	02/17/23 17:26	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:17	02/22/23 08:25	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54591

Lab Sample ID: 680-230663-38

Date Collected: 02/07/23 11:40

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:56	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54592

Lab Sample ID: 680-230663-39

Date Collected: 02/07/23 09:14

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	33300		100		ug/L		02/17/23 09:09	02/17/23 22:03	1
Aluminum	34900		100		ug/L		02/23/23 10:43	02/24/23 13:26	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:03	1
Antimony	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:26	1
Arsenic	14.2		3.00		ug/L		02/17/23 09:09	02/17/23 22:03	1
Arsenic	14.2		3.00		ug/L		02/23/23 10:43	02/24/23 13:26	1
Barium	28.3		5.00		ug/L		02/17/23 09:09	02/17/23 22:03	1
Barium	28.0		5.00		ug/L		02/23/23 10:43	02/24/23 13:26	1
Beryllium	11.6		0.500		ug/L		02/17/23 09:09	02/17/23 22:03	1
Beryllium	11.7		0.500		ug/L		02/23/23 10:43	02/24/23 13:26	1
Cadmium	1.49		0.500		ug/L		02/17/23 09:09	02/17/23 22:03	1
Cadmium	2.45		0.500		ug/L		02/23/23 10:43	02/24/23 13:26	1
Calcium	420000		500		ug/L		02/17/23 09:09	02/17/23 22:03	1
Calcium	426000		500		ug/L		02/23/23 10:43	02/24/23 13:26	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:03	1
Chromium	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:26	1
Cobalt	107		0.500		ug/L		02/17/23 09:09	02/17/23 22:03	1
Cobalt	111		0.500		ug/L		02/23/23 10:43	02/24/23 13:26	1
Iron	203000		100		ug/L		02/17/23 09:09	02/17/23 22:03	1
Iron	216000		100		ug/L		02/23/23 10:43	02/24/23 13:26	1
Lead	37.8		2.50		ug/L		02/17/23 09:09	02/17/23 22:03	1
Lead	40.1		2.50		ug/L		02/23/23 10:43	02/24/23 13:26	1
Magnesium	71500		250		ug/L		02/17/23 09:09	02/17/23 22:03	1
Magnesium	74200		250		ug/L		02/23/23 10:43	02/24/23 13:26	1
Manganese	1580		5.00		ug/L		02/17/23 09:09	02/17/23 22:03	1
Manganese	1650		5.00		ug/L		02/23/23 10:43	02/24/23 13:26	1
Nickel	37.1		5.00		ug/L		02/17/23 09:09	02/17/23 22:03	1
Nickel	39.8		5.00		ug/L		02/23/23 10:43	02/24/23 13:26	1
Potassium	5020		1000		ug/L		02/17/23 09:09	02/17/23 22:03	1
Potassium	5110		1000		ug/L		02/23/23 10:43	02/24/23 13:26	1
Selenium	3.37		2.50		ug/L		02/17/23 09:09	02/17/23 22:03	1
Selenium	3.03		2.50		ug/L		02/23/23 10:43	02/24/23 13:26	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:03	1
Silver	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:26	1
Sodium	85600		500		ug/L		02/17/23 09:09	02/17/23 22:03	1
Sodium	85400		500		ug/L		02/23/23 10:43	02/24/23 13:26	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:03	1
Thallium	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:26	1
Zinc	75.6		20.0		ug/L		02/17/23 09:09	02/17/23 22:03	1
Zinc	79.9		20.0		ug/L		02/23/23 10:43	02/24/23 13:26	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	32500		100		ug/L		02/17/23 10:16	02/17/23 20:21	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:21	1
Arsenic	13.4		3.00		ug/L		02/17/23 10:16	02/17/23 20:21	1
Barium	30.8		5.00		ug/L		02/17/23 10:16	02/17/23 20:21	1
Beryllium	11.3		0.500		ug/L		02/17/23 10:16	02/17/23 20:21	1
Cadmium	1.31		0.500		ug/L		02/17/23 10:16	02/17/23 20:21	1
Calcium	407000		500		ug/L		02/17/23 10:16	02/17/23 20:21	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54592

Lab Sample ID: 680-230663-39

Date Collected: 02/07/23 09:14

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Dissolved (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:21	1
Cobalt	105		0.500		ug/L		02/17/23 10:16	02/17/23 20:21	1
Iron	200000		100		ug/L		02/17/23 10:16	02/17/23 20:21	1
Lead	37.3		2.50		ug/L		02/17/23 10:16	02/17/23 20:21	1
Magnesium	70200		250		ug/L		02/17/23 10:16	02/17/23 20:21	1
Manganese	1540		5.00		ug/L		02/17/23 10:16	02/17/23 20:21	1
Nickel	37.4		5.00		ug/L		02/17/23 10:16	02/17/23 20:21	1
Potassium	4960		1000		ug/L		02/17/23 10:16	02/17/23 20:21	1
Selenium	3.43		2.50		ug/L		02/17/23 10:16	02/17/23 20:21	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:21	1
Sodium	84600		500		ug/L		02/17/23 10:16	02/17/23 20:21	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:21	1
Zinc	74.9		20.0		ug/L		02/17/23 10:16	02/17/23 20:21	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 17:55	1

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 11:18	02/22/23 09:27	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54564

Lab Sample ID: 680-230663-40

Date Collected: 02/02/23 09:42

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 23:44	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:44	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 23:44	1
Barium	50.8		5.00		ug/L		02/17/23 09:09	02/17/23 23:44	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:44	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 23:44	1
Calcium	962000		5000		ug/L		02/17/23 09:09	02/20/23 20:20	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 23:44	1
Cobalt	35.3		0.500		ug/L		02/17/23 09:09	02/17/23 23:44	1
Iron	10900		100		ug/L		02/17/23 09:09	02/17/23 23:44	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:44	1
Magnesium	149000		250		ug/L		02/17/23 09:09	02/17/23 23:44	1
Manganese	5120		5.00		ug/L		02/17/23 09:09	02/17/23 23:44	1
Nickel	16.2		5.00		ug/L		02/17/23 09:09	02/17/23 23:44	1
Potassium	10200		1000		ug/L		02/17/23 09:09	02/17/23 23:44	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 23:44	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:44	1
Sodium	190000		500		ug/L		02/17/23 09:09	02/17/23 23:44	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 23:44	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 23:44	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 20:09	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:09	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 20:09	1
Barium	54.2		5.00		ug/L		02/17/23 10:16	02/17/23 20:09	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:09	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 20:09	1
Calcium	1040000		5000		ug/L		02/17/23 10:16	02/20/23 19:51	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 20:09	1
Cobalt	36.9		0.500		ug/L		02/17/23 10:16	02/17/23 20:09	1
Iron	10500		100		ug/L		02/17/23 10:16	02/17/23 20:09	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:09	1
Magnesium	154000		250		ug/L		02/17/23 10:16	02/17/23 20:09	1
Manganese	5340		5.00		ug/L		02/17/23 10:16	02/17/23 20:09	1
Nickel	16.2		5.00		ug/L		02/17/23 10:16	02/17/23 20:09	1
Potassium	10700		1000		ug/L		02/17/23 10:16	02/17/23 20:09	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 20:09	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:09	1
Sodium	195000		500		ug/L		02/17/23 10:16	02/17/23 20:09	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 20:09	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 20:09	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:12	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54564

Lab Sample ID: 680-230663-40

Date Collected: 02/02/23 09:42

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:47	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54565

Lab Sample ID: 680-230663-41

Date Collected: 02/02/23 11:13

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	25200		100		ug/L		02/17/23 09:14	02/17/23 16:25	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:25	1
Arsenic	4.01		3.00		ug/L		02/17/23 09:14	02/17/23 16:25	1
Barium	39.5		5.00		ug/L		02/17/23 09:14	02/17/23 16:25	1
Beryllium	22.3		0.500		ug/L		02/17/23 09:14	02/17/23 16:25	1
Cadmium	1.13		0.500		ug/L		02/17/23 09:14	02/17/23 16:25	1
Calcium	576000		5000		ug/L		02/17/23 09:14	02/20/23 18:38	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 16:25	1
Cobalt	46.6		0.500		ug/L		02/17/23 09:14	02/17/23 16:25	1
Iron	96400		100		ug/L		02/17/23 09:14	02/17/23 16:25	1
Lead	19.8		2.50		ug/L		02/17/23 09:14	02/17/23 16:25	1
Magnesium	60700		250		ug/L		02/17/23 09:14	02/17/23 16:25	1
Manganese	1170		5.00		ug/L		02/17/23 09:14	02/17/23 16:25	1
Nickel	46.4		5.00		ug/L		02/17/23 09:14	02/17/23 16:25	1
Potassium	7580		1000		ug/L		02/17/23 09:14	02/17/23 16:25	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 16:25	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:25	1
Sodium	154000		500		ug/L		02/17/23 09:14	02/17/23 16:25	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 16:25	1
Zinc	141		20.0		ug/L		02/17/23 09:14	02/17/23 16:25	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	24600		100		ug/L		02/17/23 10:39	02/17/23 18:27	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:27	1
Arsenic	3.73		3.00		ug/L		02/17/23 10:39	02/17/23 18:27	1
Barium	38.6		5.00		ug/L		02/17/23 10:39	02/17/23 18:27	1
Beryllium	21.8		0.500		ug/L		02/17/23 10:39	02/17/23 18:27	1
Cadmium	0.830		0.500		ug/L		02/17/23 10:39	02/17/23 18:27	1
Calcium	597000		5000		ug/L		02/17/23 10:39	02/20/23 19:19	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 18:27	1
Cobalt	45.7		0.500		ug/L		02/17/23 10:39	02/17/23 18:27	1
Iron	93500		100		ug/L		02/17/23 10:39	02/17/23 18:27	1
Lead	18.9		2.50		ug/L		02/17/23 10:39	02/17/23 18:27	1
Magnesium	61100		250		ug/L		02/17/23 10:39	02/17/23 18:27	1
Manganese	1150		5.00		ug/L		02/17/23 10:39	02/17/23 18:27	1
Nickel	44.6		5.00		ug/L		02/17/23 10:39	02/17/23 18:27	1
Potassium	7490		1000		ug/L		02/17/23 10:39	02/17/23 18:27	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 18:27	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:27	1
Sodium	152000		500		ug/L		02/17/23 10:39	02/17/23 18:27	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 18:27	1
Zinc	138		20.0		ug/L		02/17/23 10:39	02/17/23 18:27	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U F1	0.200		ug/L		02/21/23 11:17	02/22/23 08:08	1
Mercury	0.200	U	0.200		ug/L		02/23/23 10:48	02/23/23 17:57	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54565

Lab Sample ID: 680-230663-41

Date Collected: 02/02/23 11:13

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 14:03	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54566

Lab Sample ID: 680-230663-42

Date Collected: 02/02/23 11:18

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	24000		100		ug/L		02/17/23 09:09	02/17/23 22:15	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:15	1
Arsenic	3.72		3.00		ug/L		02/17/23 09:09	02/17/23 22:15	1
Barium	42.9		5.00		ug/L		02/17/23 09:09	02/17/23 22:15	1
Beryllium	21.7		0.500		ug/L		02/17/23 09:09	02/17/23 22:15	1
Cadmium	0.685		0.500		ug/L		02/17/23 09:09	02/17/23 22:15	1
Calcium	601000		5000		ug/L		02/17/23 09:09	02/20/23 19:59	10
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 22:15	1
Cobalt	44.5		0.500		ug/L		02/17/23 09:09	02/17/23 22:15	1
Iron	95300		100		ug/L		02/17/23 09:09	02/17/23 22:15	1
Lead	17.8		2.50		ug/L		02/17/23 09:09	02/17/23 22:15	1
Magnesium	58000		250		ug/L		02/17/23 09:09	02/17/23 22:15	1
Manganese	1090		5.00		ug/L		02/17/23 09:09	02/17/23 22:15	1
Nickel	44.3		5.00		ug/L		02/17/23 09:09	02/17/23 22:15	1
Potassium	7330		1000		ug/L		02/17/23 09:09	02/17/23 22:15	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 22:15	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:15	1
Sodium	146000		500		ug/L		02/17/23 09:09	02/17/23 22:15	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 22:15	1
Zinc	129		20.0		ug/L		02/17/23 09:09	02/17/23 22:15	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	24700		100		ug/L		02/17/23 10:16	02/17/23 19:32	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:32	1
Arsenic	3.62		3.00		ug/L		02/17/23 10:16	02/17/23 19:32	1
Barium	43.7		5.00		ug/L		02/17/23 10:16	02/17/23 19:32	1
Beryllium	22.3		0.500		ug/L		02/17/23 10:16	02/17/23 19:32	1
Cadmium	0.820		0.500		ug/L		02/17/23 10:16	02/17/23 19:32	1
Calcium	598000		5000		ug/L		02/17/23 10:16	02/20/23 19:47	10
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:32	1
Cobalt	45.4		0.500		ug/L		02/17/23 10:16	02/17/23 19:32	1
Iron	98000		100		ug/L		02/17/23 10:16	02/17/23 19:32	1
Lead	18.1		2.50		ug/L		02/17/23 10:16	02/17/23 19:32	1
Magnesium	59200		250		ug/L		02/17/23 10:16	02/17/23 19:32	1
Manganese	1110		5.00		ug/L		02/17/23 10:16	02/17/23 19:32	1
Nickel	44.7		5.00		ug/L		02/17/23 10:16	02/17/23 19:32	1
Potassium	7500		1000		ug/L		02/17/23 10:16	02/17/23 19:32	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:32	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:32	1
Sodium	149000		500		ug/L		02/17/23 10:16	02/17/23 19:32	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:32	1
Zinc	134		20.0		ug/L		02/17/23 10:16	02/17/23 19:32	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:50	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54566

Lab Sample ID: 680-230663-42

Date Collected: 02/02/23 11:18

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 20:03	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54567

Lab Sample ID: 680-230663-43

Date Collected: 02/02/23 13:21

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 15:49	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:49	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 15:49	1
Barium	104		5.00		ug/L		02/17/23 09:14	02/17/23 15:49	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:49	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:49	1
Calcium	140000		500		ug/L		02/17/23 09:14	02/17/23 15:49	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:49	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:49	1
Iron	1800		100		ug/L		02/17/23 09:14	02/17/23 15:49	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:49	1
Magnesium	2750		250		ug/L		02/17/23 09:14	02/17/23 15:49	1
Manganese	79.3		5.00		ug/L		02/17/23 09:14	02/17/23 15:49	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:49	1
Potassium	1150		1000		ug/L		02/17/23 09:14	02/17/23 15:49	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:49	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:49	1
Sodium	17400		500		ug/L		02/17/23 09:14	02/17/23 15:49	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:49	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:49	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 17:59	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:59	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 17:59	1
Barium	96.4		5.00		ug/L		02/17/23 10:39	02/17/23 17:59	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:59	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:59	1
Calcium	130000		500		ug/L		02/17/23 10:39	02/17/23 17:59	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:59	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:59	1
Iron	838		100		ug/L		02/17/23 10:39	02/17/23 17:59	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:59	1
Magnesium	2590		250		ug/L		02/17/23 10:39	02/17/23 17:59	1
Manganese	74.6		5.00		ug/L		02/17/23 10:39	02/17/23 17:59	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:59	1
Potassium	1100		1000		ug/L		02/17/23 10:39	02/17/23 17:59	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:59	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:59	1
Sodium	16200		500		ug/L		02/17/23 10:39	02/17/23 17:59	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:59	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 17:59	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:21	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54567

Lab Sample ID: 680-230663-43

Date Collected: 02/02/23 13:21

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 19:42	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS)

Lab Sample ID: MB 680-763814/1-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 763814

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Aluminum	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:10	1
Antimony	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:10	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 06:34	02/17/23 13:10	1
Barium	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:10	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:10	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:10	1
Calcium	500	U	500		ug/L		02/17/23 06:34	02/17/23 13:10	1
Chromium	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:10	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 06:34	02/17/23 13:10	1
Iron	100	U	100		ug/L		02/17/23 06:34	02/17/23 13:10	1
Lead	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:10	1
Magnesium	250	U	250		ug/L		02/17/23 06:34	02/17/23 13:10	1
Manganese	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:10	1
Nickel	5.00	U	5.00		ug/L		02/17/23 06:34	02/17/23 13:10	1
Potassium	1000	U	1000		ug/L		02/17/23 06:34	02/17/23 13:10	1
Selenium	2.50	U	2.50		ug/L		02/17/23 06:34	02/17/23 13:10	1
Silver	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:10	1
Sodium	500	U	500		ug/L		02/17/23 06:34	02/17/23 13:10	1
Thallium	1.00	U	1.00		ug/L		02/17/23 06:34	02/17/23 13:10	1
Zinc	20.0	U	20.0		ug/L		02/17/23 06:34	02/17/23 13:10	1

Lab Sample ID: LCS 680-763814/2-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 763814

Analyte	Spike Added	LCS	LCS	Unit	D	%Rec	%Rec Limits
		Result	Qualifier				
Aluminum	5000	4944		ug/L		99	80 - 120
Antimony	50.0	50.11		ug/L		100	80 - 120
Arsenic	100	104.3		ug/L		104	80 - 120
Barium	100	96.82		ug/L		97	80 - 120
Beryllium	50.0	50.00		ug/L		100	80 - 120
Cadmium	50.0	49.00		ug/L		98	80 - 120
Calcium	5000	5263		ug/L		105	80 - 120
Chromium	100	106.2		ug/L		106	80 - 120
Cobalt	50.0	51.56		ug/L		103	80 - 120
Iron	5000	5271		ug/L		105	80 - 120
Lead	505	505.9		ug/L		100	80 - 120
Magnesium	5010	4939		ug/L		99	80 - 120
Manganese	400	384.3		ug/L		96	80 - 120
Nickel	100	104.2		ug/L		104	80 - 120
Potassium	6970	7073		ug/L		101	80 - 120
Selenium	100	107.5		ug/L		107	80 - 120
Silver	50.0	50.45		ug/L		101	80 - 120
Sodium	5050	5345		ug/L		106	80 - 120
Thallium	50.0	47.64		ug/L		95	80 - 120
Zinc	100	102.8		ug/L		103	80 - 120

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: MB 680-763855/1-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 763855

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Aluminum	100	U	100		ug/L		02/17/23 09:09	02/17/23 21:54	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 21:54	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:09	02/17/23 21:54	1
Barium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 21:54	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 21:54	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 21:54	1
Calcium	500	U	500		ug/L		02/17/23 09:09	02/17/23 21:54	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 21:54	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:09	02/17/23 21:54	1
Iron	100	U	100		ug/L		02/17/23 09:09	02/17/23 21:54	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 21:54	1
Magnesium	250	U	250		ug/L		02/17/23 09:09	02/17/23 21:54	1
Manganese	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 21:54	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:09	02/17/23 21:54	1
Potassium	1000	U	1000		ug/L		02/17/23 09:09	02/17/23 21:54	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:09	02/17/23 21:54	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 21:54	1
Sodium	500	U	500		ug/L		02/17/23 09:09	02/17/23 21:54	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:09	02/17/23 21:54	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:09	02/17/23 21:54	1

Lab Sample ID: LCS 680-763855/2-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 763855

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Antimony	50.0	48.59		ug/L		97	80 - 120
Arsenic	100	100.6		ug/L		101	80 - 120
Barium	100	97.75		ug/L		98	80 - 120
Beryllium	50.0	49.25		ug/L		98	80 - 120
Cadmium	50.0	46.68		ug/L		93	80 - 120
Calcium	5000	5218		ug/L		104	80 - 120
Chromium	100	100.0		ug/L		100	80 - 120
Cobalt	50.0	48.70		ug/L		97	80 - 120
Iron	5000	5001		ug/L		100	80 - 120
Lead	505	488.7		ug/L		97	80 - 120
Magnesium	5010	4722		ug/L		94	80 - 120
Manganese	400	370.4		ug/L		93	80 - 120
Nickel	100	97.05		ug/L		97	80 - 120
Potassium	6970	6726		ug/L		96	80 - 120
Selenium	100	97.99		ug/L		98	80 - 120
Silver	50.0	46.95		ug/L		94	80 - 120
Sodium	5050	4965		ug/L		98	80 - 120
Thallium	50.0	46.16		ug/L		92	80 - 120
Zinc	100	95.35		ug/L		95	80 - 120

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-230663-39 MS

Matrix: Water

Analysis Batch: 764050

Client Sample ID: AF54592

Prep Type: Total Recoverable

Prep Batch: 763855

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec
	Result	Qualifier	Added	Result	Qualifier			Limits	
Aluminum	33300		5000	37310	4	ug/L		80	75 - 125
Antimony	5.00	U	50.0	54.71		ug/L		109	75 - 125
Arsenic	14.2		100	123.9		ug/L		110	75 - 125
Barium	28.3		100	132.4		ug/L		104	75 - 125
Beryllium	11.6		50.0	62.84		ug/L		103	75 - 125
Cadmium	1.49		50.0	53.26		ug/L		104	75 - 125
Calcium	420000		5000	416200	4	ug/L		-82	75 - 125
Chromium	5.00	U	100	112.6		ug/L		110	75 - 125
Cobalt	107		50.0	158.4		ug/L		104	75 - 125
Iron	203000		5000	207500	4	ug/L		95	75 - 125
Lead	37.8		505	583.0		ug/L		108	75 - 125
Magnesium	71500		5010	73780	4	ug/L		45	75 - 125
Manganese	1580		400	1969		ug/L		98	75 - 125
Nickel	37.1		100	141.1		ug/L		104	75 - 125
Potassium	5020		6970	12070		ug/L		101	75 - 125
Selenium	3.37		100	112.8		ug/L		109	75 - 125
Silver	1.00	U	50.0	51.32		ug/L		103	75 - 125
Sodium	85600		5050	88120	4	ug/L		50	75 - 125
Thallium	1.00	U	50.0	52.61		ug/L		105	75 - 125
Zinc	75.6		100	179.5		ug/L		104	75 - 125

Lab Sample ID: 680-230663-39 MSD

Matrix: Water

Analysis Batch: 764050

Client Sample ID: AF54592

Prep Type: Total Recoverable

Prep Batch: 763855

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	RPD
	Result	Qualifier	Added	Result	Qualifier			Limits	Limits	RPD	Limit
Aluminum	33300		5000	37740	4	ug/L		88	75 - 125	1	20
Antimony	5.00	U	50.0	56.04		ug/L		112	75 - 125	2	20
Arsenic	14.2		100	125.7		ug/L		112	75 - 125	1	20
Barium	28.3		100	134.1		ug/L		106	75 - 125	1	20
Beryllium	11.6		50.0	64.83		ug/L		107	75 - 125	3	20
Cadmium	1.49		50.0	54.70		ug/L		106	75 - 125	3	20
Calcium	420000		5000	422400	4	ug/L		42	75 - 125	1	20
Chromium	5.00	U	100	114.8		ug/L		112	75 - 125	2	20
Cobalt	107		50.0	159.8		ug/L		107	75 - 125	1	20
Iron	203000		5000	208100	4	ug/L		107	75 - 125	0	20
Lead	37.8		505	582.5		ug/L		108	75 - 125	0	20
Magnesium	71500		5010	74360	4	ug/L		57	75 - 125	1	20
Manganese	1580		400	1969		ug/L		98	75 - 125	0	20
Nickel	37.1		100	143.1		ug/L		106	75 - 125	1	20
Potassium	5020		6970	12250		ug/L		104	75 - 125	1	20
Selenium	3.37		100	116.8		ug/L		113	75 - 125	3	20
Silver	1.00	U	50.0	51.85		ug/L		104	75 - 125	1	20
Sodium	85600		5050	88430	4	ug/L		56	75 - 125	0	20
Thallium	1.00	U	50.0	53.49		ug/L		106	75 - 125	2	20
Zinc	75.6		100	178.5		ug/L		103	75 - 125	1	20

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: MB 680-763857/1-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 763857

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Aluminum	100	U	100		ug/L		02/17/23 09:14	02/17/23 15:00	1
Antimony	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:00	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 09:14	02/17/23 15:00	1
Barium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:00	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:00	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:00	1
Calcium	500	U	500		ug/L		02/17/23 09:14	02/17/23 15:00	1
Chromium	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:00	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 09:14	02/17/23 15:00	1
Iron	100	U	100		ug/L		02/17/23 09:14	02/17/23 15:00	1
Lead	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:00	1
Magnesium	250	U	250		ug/L		02/17/23 09:14	02/17/23 15:00	1
Manganese	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:00	1
Nickel	5.00	U	5.00		ug/L		02/17/23 09:14	02/17/23 15:00	1
Potassium	1000	U	1000		ug/L		02/17/23 09:14	02/17/23 15:00	1
Selenium	2.50	U	2.50		ug/L		02/17/23 09:14	02/17/23 15:00	1
Silver	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:00	1
Sodium	500	U	500		ug/L		02/17/23 09:14	02/17/23 15:00	1
Thallium	1.00	U	1.00		ug/L		02/17/23 09:14	02/17/23 15:00	1
Zinc	20.0	U	20.0		ug/L		02/17/23 09:14	02/17/23 15:00	1

Lab Sample ID: LCS 680-763857/2-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 763857

Analyte	Spike Added	LCS	LCS	Unit	D	%Rec	%Rec Limits
		Result	Qualifier				
Aluminum	5000	5308		ug/L		106	80 - 120
Antimony	50.0	53.52		ug/L		107	80 - 120
Arsenic	100	111.0		ug/L		111	80 - 120
Barium	100	104.2		ug/L		104	80 - 120
Beryllium	50.0	51.07		ug/L		102	80 - 120
Cadmium	50.0	52.28		ug/L		105	80 - 120
Calcium	5000	5522		ug/L		110	80 - 120
Chromium	100	113.6		ug/L		114	80 - 120
Cobalt	50.0	55.33		ug/L		111	80 - 120
Iron	5000	5477		ug/L		110	80 - 120
Lead	505	540.9		ug/L		107	80 - 120
Magnesium	5010	5310		ug/L		106	80 - 120
Manganese	400	409.8		ug/L		102	80 - 120
Nickel	100	110.6		ug/L		111	80 - 120
Potassium	6970	7386		ug/L		106	80 - 120
Selenium	100	109.2		ug/L		109	80 - 120
Silver	50.0	52.59		ug/L		105	80 - 120
Sodium	5050	5650		ug/L		112	80 - 120
Thallium	50.0	51.27		ug/L		103	80 - 120
Zinc	100	108.7		ug/L		109	80 - 120

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-230663-32 MS

Matrix: Water

Analysis Batch: 764050

Client Sample ID: AF54604

Prep Type: Total Recoverable

Prep Batch: 763857

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec
	Result	Qualifier	Added	Result	Qualifier			Limits	Limits
Aluminum	758		5000	6365		ug/L		112	75 - 125
Antimony	5.00	U	50.0	55.90		ug/L		112	75 - 125
Arsenic	3.00	U	100	119.8		ug/L		118	75 - 125
Barium	78.1		100	186.3		ug/L		108	75 - 125
Beryllium	0.500	U	50.0	54.78		ug/L		109	75 - 125
Cadmium	0.500	U	50.0	54.70		ug/L		109	75 - 125
Chromium	5.00	U	100	121.0		ug/L		119	75 - 125
Cobalt	3.01		50.0	60.88		ug/L		116	75 - 125
Iron	15200		5000	20450		ug/L		106	75 - 125
Lead	2.50	U	505	579.4		ug/L		115	75 - 125
Magnesium	8430		5010	13980		ug/L		111	75 - 125
Manganese	619		400	1052		ug/L		108	75 - 125
Nickel	5.00	U	100	116.2		ug/L		114	75 - 125
Potassium	1580		6970	9290		ug/L		111	75 - 125
Selenium	2.50	U	100	121.1		ug/L		121	75 - 125
Silver	1.00	U	50.0	53.63		ug/L		107	75 - 125
Sodium	65700		5050	71200	4	ug/L		108	75 - 125
Thallium	1.00	U	50.0	54.97		ug/L		110	75 - 125
Zinc	20.0	U	100	118.6		ug/L		110	75 - 125

Lab Sample ID: 680-230663-32 MS

Matrix: Water

Analysis Batch: 764211

Client Sample ID: AF54604

Prep Type: Total Recoverable

Prep Batch: 763857

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec
	Result	Qualifier	Added	Result	Qualifier			Limits	Limits
Calcium	459000		5000	433300	4	ug/L		-518	75 - 125

Lab Sample ID: 680-230663-32 MSD

Matrix: Water

Analysis Batch: 764050

Client Sample ID: AF54604

Prep Type: Total Recoverable

Prep Batch: 763857

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	RPD
	Result	Qualifier	Added	Result	Qualifier			Limits	Limits	RPD	Limit
Aluminum	758		5000	6273		ug/L		110	75 - 125	1	20
Antimony	5.00	U	50.0	54.03		ug/L		108	75 - 125	3	20
Arsenic	3.00	U	100	118.9		ug/L		118	75 - 125	1	20
Barium	78.1		100	183.5		ug/L		105	75 - 125	2	20
Beryllium	0.500	U	50.0	53.85		ug/L		107	75 - 125	2	20
Cadmium	0.500	U	50.0	54.93		ug/L		109	75 - 125	0	20
Chromium	5.00	U	100	116.3		ug/L		114	75 - 125	4	20
Cobalt	3.01		50.0	59.28		ug/L		113	75 - 125	3	20
Iron	15200		5000	20210		ug/L		101	75 - 125	1	20
Lead	2.50	U	505	548.6		ug/L		109	75 - 125	5	20
Magnesium	8430		5010	13730		ug/L		106	75 - 125	2	20
Manganese	619		400	1024		ug/L		101	75 - 125	3	20
Nickel	5.00	U	100	114.1		ug/L		112	75 - 125	2	20
Potassium	1580		6970	8999		ug/L		106	75 - 125	3	20
Selenium	2.50	U	100	112.7		ug/L		113	75 - 125	7	20
Silver	1.00	U	50.0	52.31		ug/L		105	75 - 125	2	20
Sodium	65700		5050	70890	4	ug/L		102	75 - 125	0	20

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-230663-32 MSD
Matrix: Water
Analysis Batch: 764050

Client Sample ID: AF54604
Prep Type: Total Recoverable
Prep Batch: 763857

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	Limit
	Result	Qualifier		Result	Qualifier				Limits		
Thallium	1.00	U	50.0	53.08		ug/L		106	75 - 125	3	20
Zinc	20.0	U	100	115.2		ug/L		106	75 - 125	3	20

Lab Sample ID: 680-230663-32 MSD
Matrix: Water
Analysis Batch: 764211

Client Sample ID: AF54604
Prep Type: Total Recoverable
Prep Batch: 763857

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	Limit
	Result	Qualifier		Result	Qualifier				Limits		
Calcium	459000		5000	473100	4	ug/L		278	75 - 125	9	20

Lab Sample ID: MB 680-763871/1-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 763871

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Aluminum	100	U	100		ug/L		02/17/23 10:16	02/17/23 19:08	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:08	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:16	02/17/23 19:08	1
Barium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:08	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:08	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:08	1
Calcium	500	U	500		ug/L		02/17/23 10:16	02/17/23 19:08	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:08	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:16	02/17/23 19:08	1
Iron	100	U	100		ug/L		02/17/23 10:16	02/17/23 19:08	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:08	1
Magnesium	250	U	250		ug/L		02/17/23 10:16	02/17/23 19:08	1
Manganese	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:08	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:16	02/17/23 19:08	1
Potassium	1000	U	1000		ug/L		02/17/23 10:16	02/17/23 19:08	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:16	02/17/23 19:08	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:08	1
Sodium	500	U	500		ug/L		02/17/23 10:16	02/17/23 19:08	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:16	02/17/23 19:08	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:16	02/17/23 19:08	1

Lab Sample ID: LCS 680-763871/2-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 763871

Analyte	Spike	LCS	LCS	Unit	D	%Rec	%Rec
		Added	Result				Qualifier
Aluminum	5000	5400		ug/L		108	80 - 120
Antimony	50.0	54.26		ug/L		109	80 - 120
Arsenic	100	112.6		ug/L		113	80 - 120
Barium	100	106.4		ug/L		106	80 - 120
Beryllium	50.0	53.26		ug/L		107	80 - 120
Cadmium	50.0	52.74		ug/L		105	80 - 120
Calcium	5000	5672		ug/L		113	80 - 120
Chromium	100	115.1		ug/L		115	80 - 120

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: LCS 680-763871/2-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 763871

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec	
							Limits	
Cobalt	50.0	55.73		ug/L		111	80 - 120	
Iron	5000	5555		ug/L		111	80 - 120	
Lead	505	546.2		ug/L		108	80 - 120	
Magnesium	5010	5358		ug/L		107	80 - 120	
Manganese	400	410.7		ug/L		103	80 - 120	
Nickel	100	109.5		ug/L		110	80 - 120	
Potassium	6970	7519		ug/L		108	80 - 120	
Selenium	100	115.0		ug/L		115	80 - 120	
Silver	50.0	52.31		ug/L		105	80 - 120	
Sodium	5050	5659		ug/L		112	80 - 120	
Thallium	50.0	51.57		ug/L		103	80 - 120	
Zinc	100	108.3		ug/L		108	80 - 120	

Lab Sample ID: MB 680-763876/1-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 763876

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Aluminum	100	U	100		ug/L		02/17/23 10:39	02/17/23 17:06	1
Antimony	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:06	1
Arsenic	3.00	U	3.00		ug/L		02/17/23 10:39	02/17/23 17:06	1
Barium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:06	1
Beryllium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:06	1
Cadmium	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:06	1
Calcium	500	U	500		ug/L		02/17/23 10:39	02/17/23 17:06	1
Chromium	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:06	1
Cobalt	0.500	U	0.500		ug/L		02/17/23 10:39	02/17/23 17:06	1
Iron	100	U	100		ug/L		02/17/23 10:39	02/17/23 17:06	1
Lead	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:06	1
Magnesium	250	U	250		ug/L		02/17/23 10:39	02/17/23 17:06	1
Manganese	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:06	1
Nickel	5.00	U	5.00		ug/L		02/17/23 10:39	02/17/23 17:06	1
Potassium	1000	U	1000		ug/L		02/17/23 10:39	02/17/23 17:06	1
Selenium	2.50	U	2.50		ug/L		02/17/23 10:39	02/17/23 17:06	1
Silver	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:06	1
Sodium	500	U	500		ug/L		02/17/23 10:39	02/17/23 17:06	1
Thallium	1.00	U	1.00		ug/L		02/17/23 10:39	02/17/23 17:06	1
Zinc	20.0	U	20.0		ug/L		02/17/23 10:39	02/17/23 17:06	1

Lab Sample ID: LCS 680-763876/2-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 763876

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec	
							Limits	
Aluminum	5000	5096		ug/L		102	80 - 120	
Antimony	50.0	50.87		ug/L		102	80 - 120	
Arsenic	100	107.3		ug/L		107	80 - 120	
Barium	100	99.35		ug/L		99	80 - 120	
Beryllium	50.0	49.81		ug/L		100	80 - 120	

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: LCS 680-763876/2-A
Matrix: Water
Analysis Batch: 764050

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 763876

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec	
							Limits	
Cadmium	50.0	49.66		ug/L		99	80 - 120	
Calcium	5000	5054		ug/L		101	80 - 120	
Chromium	100	109.2		ug/L		109	80 - 120	
Cobalt	50.0	53.67		ug/L		107	80 - 120	
Iron	5000	5078		ug/L		102	80 - 120	
Lead	505	518.8		ug/L		103	80 - 120	
Magnesium	5010	5077		ug/L		101	80 - 120	
Manganese	400	393.5		ug/L		98	80 - 120	
Nickel	100	104.4		ug/L		104	80 - 120	
Potassium	6970	7063		ug/L		101	80 - 120	
Selenium	100	108.3		ug/L		108	80 - 120	
Silver	50.0	49.70		ug/L		99	80 - 120	
Sodium	5050	5390		ug/L		107	80 - 120	
Thallium	50.0	48.94		ug/L		98	80 - 120	
Zinc	100	102.4		ug/L		102	80 - 120	

Lab Sample ID: MB 680-764648/1-A
Matrix: Water
Analysis Batch: 764981

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 764648

Analyte	MB MB		RL	MDL	Unit	D	Prepared		Analyzed		Dil Fac
	Result	Qualifier									
Aluminum	100	U	100		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Antimony	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Arsenic	3.00	U	3.00		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Barium	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Beryllium	0.500	U	0.500		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Cadmium	0.500	U	0.500		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Calcium	500	U	500		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Chromium	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Cobalt	0.500	U	0.500		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Iron	100	U	100		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Lead	2.50	U	2.50		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Magnesium	250	U	250		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Manganese	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Nickel	5.00	U	5.00		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Potassium	1000	U	1000		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Selenium	2.50	U	2.50		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Silver	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Sodium	500	U	500		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Thallium	1.00	U	1.00		ug/L		02/23/23 10:43	02/24/23 13:09		1	
Zinc	20.0	U	20.0		ug/L		02/23/23 10:43	02/24/23 13:09		1	

Lab Sample ID: LCS 680-764648/2-A
Matrix: Water
Analysis Batch: 764981

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 764648

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec	
							Limits	
Aluminum	5000	5278		ug/L		106	80 - 120	
Antimony	50.0	52.40		ug/L		105	80 - 120	

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: LCS 680-764648/2-A

Matrix: Water

Analysis Batch: 764981

Client Sample ID: Lab Control Sample

Prep Type: Total Recoverable

Prep Batch: 764648

Analyte	Spike Added	LCS	LCS	Unit	D	%Rec	%Rec Limits
		Result	Qualifier				
Arsenic	100	105.3		ug/L		105	80 - 120
Barium	100	102.2		ug/L		102	80 - 120
Beryllium	50.0	48.65		ug/L		97	80 - 120
Cadmium	50.0	51.84		ug/L		104	80 - 120
Calcium	5000	5254		ug/L		105	80 - 120
Chromium	100	100.9		ug/L		101	80 - 120
Cobalt	50.0	53.28		ug/L		107	80 - 120
Iron	5000	5270		ug/L		105	80 - 120
Lead	505	514.1		ug/L		102	80 - 120
Magnesium	5010	5176		ug/L		103	80 - 120
Manganese	400	416.7		ug/L		104	80 - 120
Nickel	100	105.4		ug/L		105	80 - 120
Potassium	6970	7095		ug/L		102	80 - 120
Selenium	100	106.4		ug/L		106	80 - 120
Silver	50.0	51.05		ug/L		102	80 - 120
Sodium	5050	5130		ug/L		102	80 - 120
Thallium	50.0	49.58		ug/L		99	80 - 120
Zinc	100	105.3		ug/L		105	80 - 120

Lab Sample ID: LCSD 680-764648/3-A

Matrix: Water

Analysis Batch: 764981

Client Sample ID: Lab Control Sample Dup

Prep Type: Total Recoverable

Prep Batch: 764648

Analyte	Spike Added	LCSD	LCSD	Unit	D	%Rec	%Rec Limits	RPD	
		Result	Qualifier					RPD	Limit
Aluminum	5000	5293		ug/L		106	80 - 120	0	20
Antimony	50.0	52.78		ug/L		106	80 - 120	1	20
Arsenic	100	106.7		ug/L		107	80 - 120	1	20
Barium	100	102.6		ug/L		103	80 - 120	0	20
Beryllium	50.0	50.72		ug/L		101	80 - 120	4	20
Cadmium	50.0	51.83		ug/L		104	80 - 120	0	20
Calcium	5000	5194		ug/L		104	80 - 120	1	20
Chromium	100	101.7		ug/L		102	80 - 120	1	20
Cobalt	50.0	53.60		ug/L		107	80 - 120	1	20
Iron	5000	5225		ug/L		105	80 - 120	1	20
Lead	505	533.5		ug/L		106	80 - 120	4	20
Magnesium	5010	5264		ug/L		105	80 - 120	2	20
Manganese	400	424.1		ug/L		106	80 - 120	2	20
Nickel	100	106.3		ug/L		106	80 - 120	1	20
Potassium	6970	7164		ug/L		103	80 - 120	1	20
Selenium	100	105.3		ug/L		105	80 - 120	1	20
Silver	50.0	50.92		ug/L		102	80 - 120	0	20
Sodium	5050	5184		ug/L		103	80 - 120	1	20
Thallium	50.0	50.87		ug/L		102	80 - 120	3	20
Zinc	100	104.6		ug/L		105	80 - 120	1	20

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-230663-19 MS

Matrix: Water

Analysis Batch: 764050

Client Sample ID: AF54563

Prep Type: Dissolved

Prep Batch: 763871

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec	
	Result	Qualifier	Added	Result	Qualifier				Limits	
Aluminum	170		5000	5180		ug/L		100	75 - 125	
Antimony	5.00	U	50.0	54.60		ug/L		109	75 - 125	
Arsenic	3.00	U	100	111.4		ug/L		109	75 - 125	
Barium	56.0		100	155.7		ug/L		100	75 - 125	
Beryllium	0.500	U	50.0	51.06		ug/L		102	75 - 125	
Cadmium	0.500	U	50.0	50.04		ug/L		100	75 - 125	
Chromium	5.00	U	100	107.8		ug/L		108	75 - 125	
Cobalt	9.88		50.0	61.01		ug/L		102	75 - 125	
Iron	234000		5000	228400	4	ug/L		-117	75 - 125	
Lead	2.50	U	505	518.0		ug/L		103	75 - 125	
Magnesium	335000		5010	340600	4	ug/L		118	75 - 125	
Manganese	9280		400	9576	4	ug/L		75	75 - 125	
Nickel	5.00	U	100	103.8		ug/L		99	75 - 125	
Potassium	18000		6970	25960		ug/L		114	75 - 125	
Selenium	2.50	U	100	107.2		ug/L		106	75 - 125	
Silver	1.00	U	50.0	49.32		ug/L		99	75 - 125	
Sodium	186000		5050	190300	4	ug/L		82	75 - 125	
Thallium	1.00	U	50.0	49.88		ug/L		100	75 - 125	
Zinc	20.0	U	100	103.8		ug/L		97	75 - 125	

Lab Sample ID: 680-230663-19 MS

Matrix: Water

Analysis Batch: 764211

Client Sample ID: AF54563

Prep Type: Dissolved

Prep Batch: 763871

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec	
	Result	Qualifier	Added	Result	Qualifier				Limits	
Calcium	1200000		5000	1150000	4	ug/L		-1074	75 - 125	

Lab Sample ID: 680-230663-19 MSD

Matrix: Water

Analysis Batch: 764050

Client Sample ID: AF54563

Prep Type: Dissolved

Prep Batch: 763871

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec		RPD	
	Result	Qualifier	Added	Result	Qualifier				Limits	RPD	Limit	
Aluminum	170		5000	5115		ug/L		99	75 - 125	1	20	
Antimony	5.00	U	50.0	52.28		ug/L		105	75 - 125	4	20	
Arsenic	3.00	U	100	110.3		ug/L		107	75 - 125	1	20	
Barium	56.0		100	154.6		ug/L		99	75 - 125	1	20	
Beryllium	0.500	U	50.0	50.09		ug/L		100	75 - 125	2	20	
Cadmium	0.500	U	50.0	50.17		ug/L		100	75 - 125	0	20	
Chromium	5.00	U	100	105.5		ug/L		106	75 - 125	2	20	
Cobalt	9.88		50.0	59.84		ug/L		100	75 - 125	2	20	
Iron	234000		5000	221700	4	ug/L		-252	75 - 125	3	20	
Lead	2.50	U	505	510.2		ug/L		101	75 - 125	2	20	
Magnesium	335000		5010	327800	4	ug/L		-137	75 - 125	4	20	
Manganese	9280		400	9455	4	ug/L		45	75 - 125	1	20	
Nickel	5.00	U	100	105.6		ug/L		101	75 - 125	2	20	
Potassium	18000		6970	25470		ug/L		107	75 - 125	2	20	
Selenium	2.50	U	100	104.0		ug/L		103	75 - 125	3	20	
Silver	1.00	U	50.0	48.26		ug/L		97	75 - 125	2	20	
Sodium	186000		5050	184400	4	ug/L		-36	75 - 125	3	20	

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-230663-19 MSD
Matrix: Water
Analysis Batch: 764050

Client Sample ID: AF54563
Prep Type: Dissolved
Prep Batch: 763871

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	
	Result	Qualifier		Result	Qualifier				Limits	RPD	Limit
Thallium	1.00	U	50.0	49.47		ug/L		99	75 - 125	1	20
Zinc	20.0	U	100	101.3		ug/L		95	75 - 125	2	20

Lab Sample ID: 680-230663-19 MSD
Matrix: Water
Analysis Batch: 764211

Client Sample ID: AF54563
Prep Type: Dissolved
Prep Batch: 763871

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	
	Result	Qualifier		Result	Qualifier				Limits	RPD	Limit
Calcium	1200000		5000	1157000	4	ug/L		-937	75 - 125	1	20

Lab Sample ID: 680-230663-25 MS
Matrix: Water
Analysis Batch: 764050

Client Sample ID: AF54586
Prep Type: Dissolved
Prep Batch: 763876

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec	RPD	
	Result	Qualifier		Result	Qualifier				Limits	RPD	Limit
Aluminum	21800		5000	25810	4	ug/L		80	75 - 125		
Antimony	5.00	U	50.0	55.34		ug/L		111	75 - 125		
Arsenic	8.49		100	116.6		ug/L		108	75 - 125		
Barium	15.9		100	119.2		ug/L		103	75 - 125		
Beryllium	3.84		50.0	55.54		ug/L		103	75 - 125		
Cadmium	0.885		50.0	56.40		ug/L		111	75 - 125		
Calcium	279000		5000	270900	4	ug/L		-162	75 - 125		
Chromium	5.00	U	100	112.2		ug/L		111	75 - 125		
Cobalt	20.7		50.0	73.19		ug/L		105	75 - 125		
Iron	74400		5000	76670	4	ug/L		45	75 - 125		
Lead	21.2		505	557.7		ug/L		106	75 - 125		
Magnesium	22500		5010	26270	4	ug/L		75	75 - 125		
Manganese	314		400	711.7		ug/L		100	75 - 125		
Nickel	10.7		100	118.1		ug/L		107	75 - 125		
Potassium	2520		6970	9554		ug/L		101	75 - 125		
Selenium	2.50	U	100	113.0		ug/L		111	75 - 125		
Silver	1.00	U	50.0	52.83		ug/L		106	75 - 125		
Sodium	9110		5050	14080		ug/L		99	75 - 125		
Thallium	1.00	U	50.0	53.04		ug/L		106	75 - 125		
Zinc	20.0	U	100	115.7		ug/L		104	75 - 125		

Lab Sample ID: 680-230663-25 MSD
Matrix: Water
Analysis Batch: 764050

Client Sample ID: AF54586
Prep Type: Dissolved
Prep Batch: 763876

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	
	Result	Qualifier		Result	Qualifier				Limits	RPD	Limit
Aluminum	21800		5000	26150	4	ug/L		87	75 - 125	1	20
Antimony	5.00	U	50.0	55.05		ug/L		110	75 - 125	1	20
Arsenic	8.49		100	117.7		ug/L		109	75 - 125	1	20
Barium	15.9		100	118.4		ug/L		103	75 - 125	1	20
Beryllium	3.84		50.0	55.08		ug/L		102	75 - 125	1	20
Cadmium	0.885		50.0	54.91		ug/L		108	75 - 125	3	20
Calcium	279000		5000	265600	4	ug/L		-268	75 - 125	2	20
Chromium	5.00	U	100	111.6		ug/L		110	75 - 125	1	20

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-230663-25 MSD
 Matrix: Water
 Analysis Batch: 764050

Client Sample ID: AF54586
 Prep Type: Dissolved
 Prep Batch: 763876

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	RPD
	Result	Qualifier	Added	Result	Qualifier				Limits	Limit	
Cobalt	20.7		50.0	74.26		ug/L		107	75 - 125	1	20
Iron	74400		5000	74740	4	ug/L		6	75 - 125	3	20
Lead	21.2		505	556.5		ug/L		106	75 - 125	0	20
Magnesium	22500		5010	27900	4	ug/L		107	75 - 125	6	20
Manganese	314		400	722.1		ug/L		102	75 - 125	1	20
Nickel	10.7		100	118.2		ug/L		108	75 - 125	0	20
Potassium	2520		6970	9551		ug/L		101	75 - 125	0	20
Selenium	2.50	U	100	114.7		ug/L		113	75 - 125	1	20
Silver	1.00	U	50.0	51.97		ug/L		104	75 - 125	2	20
Sodium	9110		5050	14560		ug/L		108	75 - 125	3	20
Thallium	1.00	U	50.0	52.71		ug/L		105	75 - 125	1	20
Zinc	20.0	U	100	117.1		ug/L		105	75 - 125	1	20

Method: 7470A - Mercury (CVAA)

Lab Sample ID: MB 680-764131/1-A
 Matrix: Water
 Analysis Batch: 764337

Client Sample ID: Method Blank
 Prep Type: Total/NA
 Prep Batch: 764131

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Mercury	0.200	U	0.200		ug/L		02/20/23 13:19	02/21/23 11:17	1

Lab Sample ID: LCS 680-764131/2-A
 Matrix: Water
 Analysis Batch: 764337

Client Sample ID: Lab Control Sample
 Prep Type: Total/NA
 Prep Batch: 764131

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec
							Limits
Mercury	2.50	2.431		ug/L		97	80 - 120

Lab Sample ID: MB 680-764146/1-A
 Matrix: Water
 Analysis Batch: 764393

Client Sample ID: Method Blank
 Prep Type: Total/NA
 Prep Batch: 764146

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Mercury	0.200	U	0.200		ug/L		02/20/23 13:43	02/21/23 13:18	1

Lab Sample ID: LCS 680-764146/2-A
 Matrix: Water
 Analysis Batch: 764393

Client Sample ID: Lab Control Sample
 Prep Type: Total/NA
 Prep Batch: 764146

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec
							Limits
Mercury	2.50	2.394		ug/L		96	80 - 120

Lab Sample ID: MB 680-764263/1-A
 Matrix: Water
 Analysis Batch: 764393

Client Sample ID: Method Blank
 Prep Type: Total/NA
 Prep Batch: 764263

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 16:46	1

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 7470A - Mercury (CVAA) (Continued)

Lab Sample ID: LCS 680-764263/2-A				Client Sample ID: Lab Control Sample							
Matrix: Water				Prep Type: Total/NA							
Analysis Batch: 764393				Prep Batch: 764263							
Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits				
Mercury	2.50	2.598		ug/L		104	80 - 120				
Lab Sample ID: 680-230663-2 MS				Client Sample ID: AF54594							
Matrix: Water				Prep Type: Total/NA							
Analysis Batch: 764393				Prep Batch: 764263							
Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
Mercury	0.200	U	1.00	0.8410		ug/L		84	80 - 120		
Lab Sample ID: 680-230663-2 MSD				Client Sample ID: AF54594							
Matrix: Water				Prep Type: Total/NA							
Analysis Batch: 764393				Prep Batch: 764263							
Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	Limit
Mercury	0.200	U	1.00	0.8775		ug/L		88	80 - 120	4	20
Lab Sample ID: MB 680-764264/1-A				Client Sample ID: Method Blank							
Matrix: Water				Prep Type: Total/NA							
Analysis Batch: 764393				Prep Batch: 764264							
Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac		
Mercury	0.200	U	0.200		ug/L		02/21/23 09:23	02/21/23 18:30	1		
Lab Sample ID: LCS 680-764264/2-A				Client Sample ID: Lab Control Sample							
Matrix: Water				Prep Type: Total/NA							
Analysis Batch: 764393				Prep Batch: 764264							
Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits				
Mercury	2.50	2.287		ug/L		91	80 - 120				
Lab Sample ID: 680-230663-12 MS				Client Sample ID: AF54601							
Matrix: Water				Prep Type: Total/NA							
Analysis Batch: 764393				Prep Batch: 764264							
Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
Mercury	0.200	U	1.00	0.8528		ug/L		85	80 - 120		
Lab Sample ID: 680-230663-12 MSD				Client Sample ID: AF54601							
Matrix: Water				Prep Type: Total/NA							
Analysis Batch: 764393				Prep Batch: 764264							
Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	Limit
Mercury	0.200	U	1.00	0.8449		ug/L		84	80 - 120	1	20
Lab Sample ID: MB 680-764295/1-A				Client Sample ID: Method Blank							
Matrix: Water				Prep Type: Total/NA							
Analysis Batch: 764458				Prep Batch: 764295							
Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac		
Mercury	0.200	U	0.200		ug/L		02/21/23 11:17	02/22/23 08:01	1		

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Method: 7470A - Mercury (CVAA)

Lab Sample ID: LCS 680-764295/2-A				Client Sample ID: Lab Control Sample						
Matrix: Water				Prep Type: Total/NA						
Analysis Batch: 764458				Prep Batch: 764295						
Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits			
Mercury	2.50	2.299		ug/L		92	80 - 120			
Lab Sample ID: 680-230663-41 MS				Client Sample ID: AF54565						
Matrix: Water				Prep Type: Total/NA						
Analysis Batch: 764458				Prep Batch: 764295						
Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits	
Mercury	0.200	U F1	1.00	0.3613	F1	ug/L		36	80 - 120	
Lab Sample ID: 680-230663-41 MSD				Client Sample ID: AF54565						
Matrix: Water				Prep Type: Total/NA						
Analysis Batch: 764458				Prep Batch: 764295						
Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	RPD	Limit
Mercury	0.200	U F1	1.00	0.3744	F1	ug/L		37	4	20
Lab Sample ID: MB 680-764655/1-A				Client Sample ID: Method Blank						
Matrix: Water				Prep Type: Total/NA						
Analysis Batch: 764851				Prep Batch: 764655						
Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac	
Mercury	0.200	U	0.200		ug/L		02/23/23 10:48	02/23/23 16:56	1	
Lab Sample ID: LCS 680-764655/2-A				Client Sample ID: Lab Control Sample						
Matrix: Water				Prep Type: Total/NA						
Analysis Batch: 764851				Prep Batch: 764655						
Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits			
Mercury	2.50	2.417		ug/L		97	80 - 120			
Lab Sample ID: 680-230663-5 MS				Client Sample ID: AF54595						
Matrix: Water				Prep Type: Dissolved						
Analysis Batch: 764393				Prep Batch: 764146						
Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits	
Mercury	0.200	U	1.00	0.9829		ug/L		98	80 - 120	
Lab Sample ID: 680-230663-5 MSD				Client Sample ID: AF54595						
Matrix: Water				Prep Type: Dissolved						
Analysis Batch: 764393				Prep Batch: 764146						
Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	RPD	Limit
Mercury	0.200	U	1.00	0.9367		ug/L		94	5	20

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals

Prep Batch: 763814

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-7	AF54572	Dissolved	Water	3005A	
680-230663-7	AF54572	Total Recoverable	Water	3005A	
680-230663-8	AF54597	Dissolved	Water	3005A	
680-230663-8	AF54597	Total Recoverable	Water	3005A	
680-230663-9	AF54598	Dissolved	Water	3005A	
680-230663-9	AF54598	Total Recoverable	Water	3005A	
MB 680-763814/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-763814/2-A	Lab Control Sample	Total Recoverable	Water	3005A	

Prep Batch: 763855

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-1	AF54593	Total Recoverable	Water	3005A	
680-230663-4	AF54583	Total Recoverable	Water	3005A	
680-230663-5	AF54595	Total Recoverable	Water	3005A	
680-230663-11	AF54570	Total Recoverable	Water	3005A	
680-230663-12	AF54601	Total Recoverable	Water	3005A	
680-230663-20	AF54603	Dissolved	Water	3005A	
680-230663-20	AF54603	Total Recoverable	Water	3005A	
680-230663-21	AF54558	Total Recoverable	Water	3005A	
680-230663-22	AF54571	Total Recoverable	Water	3005A	
680-230663-24	AF54557	Total Recoverable	Water	3005A	
680-230663-27	AF54588	Total Recoverable	Water	3005A	
680-230663-28	AF54589	Total Recoverable	Water	3005A	
680-230663-29	AF54568	Total Recoverable	Water	3005A	
680-230663-30	AF54569	Total Recoverable	Water	3005A	
680-230663-31	AF54602	Total Recoverable	Water	3005A	
680-230663-35	AF54580	Dissolved	Water	3005A	
680-230663-37	AF54585	Total Recoverable	Water	3005A	
680-230663-39	AF54592	Total Recoverable	Water	3005A	
680-230663-40	AF54564	Total Recoverable	Water	3005A	
680-230663-42	AF54566	Total Recoverable	Water	3005A	
MB 680-763855/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-763855/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
680-230663-39 MS	AF54592	Total Recoverable	Water	3005A	
680-230663-39 MSD	AF54592	Total Recoverable	Water	3005A	

Prep Batch: 763857

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-2	AF54594	Total Recoverable	Water	3005A	
680-230663-6	AF54596	Total Recoverable	Water	3005A	
680-230663-10	AF54600	Total Recoverable	Water	3005A	
680-230663-13	AF54605	Total Recoverable	Water	3005A	
680-230663-14	AF54606	Total Recoverable	Water	3005A	
680-230663-16	AF54560	Total Recoverable	Water	3005A	
680-230663-17	AF54561	Total Recoverable	Water	3005A	
680-230663-18	AF54562	Total Recoverable	Water	3005A	
680-230663-19	AF54563	Total Recoverable	Water	3005A	
680-230663-23	AF54599	Total Recoverable	Water	3005A	
680-230663-25	AF54586	Total Recoverable	Water	3005A	
680-230663-26	AF54587	Total Recoverable	Water	3005A	
680-230663-32	AF54604	Total Recoverable	Water	3005A	

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Prep Batch: 763857 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-33	AF54607	Total Recoverable	Water	3005A	
680-230663-34	AF54574	Total Recoverable	Water	3005A	
680-230663-35	AF54580	Total Recoverable	Water	3005A	
680-230663-36	AF54584	Total Recoverable	Water	3005A	
680-230663-38	AF54591	Total Recoverable	Water	3005A	
680-230663-41	AF54565	Total Recoverable	Water	3005A	
680-230663-43	AF54567	Total Recoverable	Water	3005A	
MB 680-763857/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-763857/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
680-230663-32 MS	AF54604	Total Recoverable	Water	3005A	
680-230663-32 MSD	AF54604	Total Recoverable	Water	3005A	

Prep Batch: 763871

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-1	AF54593	Dissolved	Water	3005A	
680-230663-2	AF54594	Dissolved	Water	3005A	
680-230663-6	AF54596	Dissolved	Water	3005A	
680-230663-10	AF54600	Dissolved	Water	3005A	
680-230663-11	AF54570	Dissolved	Water	3005A	
680-230663-12	AF54601	Dissolved	Water	3005A	
680-230663-14	AF54606	Dissolved	Water	3005A	
680-230663-15	AF54559	Dissolved	Water	3005A	
680-230663-19	AF54563	Dissolved	Water	3005A	
680-230663-24	AF54557	Dissolved	Water	3005A	
680-230663-26	AF54587	Dissolved	Water	3005A	
680-230663-28	AF54589	Dissolved	Water	3005A	
680-230663-29	AF54568	Dissolved	Water	3005A	
680-230663-30	AF54569	Dissolved	Water	3005A	
680-230663-31	AF54602	Dissolved	Water	3005A	
680-230663-32	AF54604	Dissolved	Water	3005A	
680-230663-34	AF54574	Dissolved	Water	3005A	
680-230663-39	AF54592	Dissolved	Water	3005A	
680-230663-40	AF54564	Dissolved	Water	3005A	
680-230663-42	AF54566	Dissolved	Water	3005A	
MB 680-763871/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-763871/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
680-230663-19 MS	AF54563	Dissolved	Water	3005A	
680-230663-19 MSD	AF54563	Dissolved	Water	3005A	

Prep Batch: 763876

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-3	AF54582	Dissolved	Water	3005A	
680-230663-3	AF54582	Total Recoverable	Water	3005A	
680-230663-4	AF54583	Dissolved	Water	3005A	
680-230663-5	AF54595	Dissolved	Water	3005A	
680-230663-13	AF54605	Dissolved	Water	3005A	
680-230663-15	AF54559	Total Recoverable	Water	3005A	
680-230663-16	AF54560	Dissolved	Water	3005A	
680-230663-17	AF54561	Dissolved	Water	3005A	
680-230663-18	AF54562	Dissolved	Water	3005A	
680-230663-21	AF54558	Dissolved	Water	3005A	

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Prep Batch: 763876 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-22	AF54571	Dissolved	Water	3005A	
680-230663-23	AF54599	Dissolved	Water	3005A	
680-230663-25	AF54586	Dissolved	Water	3005A	
680-230663-27	AF54588	Dissolved	Water	3005A	
680-230663-33	AF54607	Dissolved	Water	3005A	
680-230663-36	AF54584	Dissolved	Water	3005A	
680-230663-37	AF54585	Dissolved	Water	3005A	
680-230663-38	AF54591	Dissolved	Water	3005A	
680-230663-41	AF54565	Dissolved	Water	3005A	
680-230663-43	AF54567	Dissolved	Water	3005A	
MB 680-763876/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-763876/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
680-230663-25 MS	AF54586	Dissolved	Water	3005A	
680-230663-25 MSD	AF54586	Dissolved	Water	3005A	

Analysis Batch: 764050

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-1	AF54593	Dissolved	Water	6020B	763871
680-230663-1	AF54593	Total Recoverable	Water	6020B	763855
680-230663-2	AF54594	Dissolved	Water	6020B	763871
680-230663-2	AF54594	Total Recoverable	Water	6020B	763857
680-230663-3	AF54582	Dissolved	Water	6020B	763876
680-230663-3	AF54582	Total Recoverable	Water	6020B	763876
680-230663-4	AF54583	Dissolved	Water	6020B	763876
680-230663-4	AF54583	Total Recoverable	Water	6020B	763855
680-230663-5	AF54595	Dissolved	Water	6020B	763876
680-230663-5	AF54595	Total Recoverable	Water	6020B	763855
680-230663-6	AF54596	Dissolved	Water	6020B	763871
680-230663-6	AF54596	Total Recoverable	Water	6020B	763857
680-230663-7	AF54572	Dissolved	Water	6020B	763814
680-230663-7	AF54572	Total Recoverable	Water	6020B	763814
680-230663-8	AF54597	Dissolved	Water	6020B	763814
680-230663-8	AF54597	Total Recoverable	Water	6020B	763814
680-230663-9	AF54598	Dissolved	Water	6020B	763814
680-230663-9	AF54598	Total Recoverable	Water	6020B	763814
680-230663-10	AF54600	Dissolved	Water	6020B	763871
680-230663-10	AF54600	Total Recoverable	Water	6020B	763857
680-230663-11	AF54570	Dissolved	Water	6020B	763871
680-230663-11	AF54570	Total Recoverable	Water	6020B	763855
680-230663-12	AF54601	Dissolved	Water	6020B	763871
680-230663-12	AF54601	Total Recoverable	Water	6020B	763855
680-230663-13	AF54605	Dissolved	Water	6020B	763876
680-230663-13	AF54605	Total Recoverable	Water	6020B	763857
680-230663-14	AF54606	Dissolved	Water	6020B	763871
680-230663-14	AF54606	Total Recoverable	Water	6020B	763857
680-230663-15	AF54559	Dissolved	Water	6020B	763871
680-230663-15	AF54559	Total Recoverable	Water	6020B	763876
680-230663-16	AF54560	Dissolved	Water	6020B	763876
680-230663-16	AF54560	Total Recoverable	Water	6020B	763857
680-230663-17	AF54561	Dissolved	Water	6020B	763876
680-230663-17	AF54561	Total Recoverable	Water	6020B	763857

Eurofins Savannah

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Analysis Batch: 764050 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-18	AF54562	Dissolved	Water	6020B	763876
680-230663-18	AF54562	Total Recoverable	Water	6020B	763857
680-230663-19	AF54563	Dissolved	Water	6020B	763871
680-230663-19	AF54563	Total Recoverable	Water	6020B	763857
680-230663-20	AF54603	Dissolved	Water	6020B	763855
680-230663-20	AF54603	Total Recoverable	Water	6020B	763855
680-230663-21	AF54558	Dissolved	Water	6020B	763876
680-230663-21	AF54558	Total Recoverable	Water	6020B	763855
680-230663-22	AF54571	Dissolved	Water	6020B	763876
680-230663-22	AF54571	Total Recoverable	Water	6020B	763855
680-230663-23	AF54599	Dissolved	Water	6020B	763876
680-230663-23	AF54599	Total Recoverable	Water	6020B	763857
680-230663-24	AF54557	Dissolved	Water	6020B	763871
680-230663-24	AF54557	Total Recoverable	Water	6020B	763855
680-230663-25	AF54586	Dissolved	Water	6020B	763876
680-230663-25	AF54586	Total Recoverable	Water	6020B	763857
680-230663-26	AF54587	Dissolved	Water	6020B	763871
680-230663-26	AF54587	Total Recoverable	Water	6020B	763857
680-230663-27	AF54588	Dissolved	Water	6020B	763876
680-230663-27	AF54588	Total Recoverable	Water	6020B	763855
680-230663-28	AF54589	Dissolved	Water	6020B	763871
680-230663-28	AF54589	Total Recoverable	Water	6020B	763855
680-230663-29	AF54568	Dissolved	Water	6020B	763871
680-230663-29	AF54568	Total Recoverable	Water	6020B	763855
680-230663-30	AF54569	Dissolved	Water	6020B	763871
680-230663-30	AF54569	Total Recoverable	Water	6020B	763855
680-230663-31	AF54602	Dissolved	Water	6020B	763871
680-230663-31	AF54602	Total Recoverable	Water	6020B	763855
680-230663-32	AF54604	Dissolved	Water	6020B	763871
680-230663-32	AF54604	Total Recoverable	Water	6020B	763857
680-230663-33	AF54607	Dissolved	Water	6020B	763876
680-230663-33	AF54607	Total Recoverable	Water	6020B	763857
680-230663-34	AF54574	Dissolved	Water	6020B	763871
680-230663-34	AF54574	Total Recoverable	Water	6020B	763857
680-230663-35	AF54580	Dissolved	Water	6020B	763855
680-230663-35	AF54580	Total Recoverable	Water	6020B	763857
680-230663-36	AF54584	Dissolved	Water	6020B	763876
680-230663-36	AF54584	Total Recoverable	Water	6020B	763857
680-230663-37	AF54585	Dissolved	Water	6020B	763876
680-230663-37	AF54585	Total Recoverable	Water	6020B	763855
680-230663-38	AF54591	Dissolved	Water	6020B	763876
680-230663-38	AF54591	Total Recoverable	Water	6020B	763857
680-230663-39	AF54592	Dissolved	Water	6020B	763871
680-230663-39	AF54592	Total Recoverable	Water	6020B	763855
680-230663-40	AF54564	Dissolved	Water	6020B	763871
680-230663-40	AF54564	Total Recoverable	Water	6020B	763855
680-230663-41	AF54565	Dissolved	Water	6020B	763876
680-230663-41	AF54565	Total Recoverable	Water	6020B	763857
680-230663-42	AF54566	Dissolved	Water	6020B	763871
680-230663-42	AF54566	Total Recoverable	Water	6020B	763855
680-230663-43	AF54567	Dissolved	Water	6020B	763876

Eurofins Savannah

1
2
3
4
5
6
7
8
9
10
11
12
13
14

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Analysis Batch: 764050 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-43	AF54567	Total Recoverable	Water	6020B	763857
MB 680-763814/1-A	Method Blank	Total Recoverable	Water	6020B	763814
MB 680-763855/1-A	Method Blank	Total Recoverable	Water	6020B	763855
MB 680-763857/1-A	Method Blank	Total Recoverable	Water	6020B	763857
MB 680-763871/1-A	Method Blank	Total Recoverable	Water	6020B	763871
MB 680-763876/1-A	Method Blank	Total Recoverable	Water	6020B	763876
LCS 680-763814/2-A	Lab Control Sample	Total Recoverable	Water	6020B	763814
LCS 680-763855/2-A	Lab Control Sample	Total Recoverable	Water	6020B	763855
LCS 680-763857/2-A	Lab Control Sample	Total Recoverable	Water	6020B	763857
LCS 680-763871/2-A	Lab Control Sample	Total Recoverable	Water	6020B	763871
LCS 680-763876/2-A	Lab Control Sample	Total Recoverable	Water	6020B	763876
680-230663-19 MS	AF54563	Dissolved	Water	6020B	763871
680-230663-19 MSD	AF54563	Dissolved	Water	6020B	763871
680-230663-25 MS	AF54586	Dissolved	Water	6020B	763876
680-230663-25 MSD	AF54586	Dissolved	Water	6020B	763876
680-230663-32 MS	AF54604	Total Recoverable	Water	6020B	763857
680-230663-32 MSD	AF54604	Total Recoverable	Water	6020B	763857
680-230663-39 MS	AF54592	Total Recoverable	Water	6020B	763855
680-230663-39 MSD	AF54592	Total Recoverable	Water	6020B	763855

Prep Batch: 764131

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-1	AF54593	Total/NA	Water	7470A	
680-230663-5	AF54595	Total/NA	Water	7470A	
680-230663-6	AF54596	Total/NA	Water	7470A	
680-230663-7	AF54572	Total/NA	Water	7470A	
680-230663-8	AF54597	Total/NA	Water	7470A	
680-230663-9	AF54598	Total/NA	Water	7470A	
680-230663-10	AF54600	Total/NA	Water	7470A	
680-230663-23	AF54599	Total/NA	Water	7470A	
MB 680-764131/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-764131/2-A	Lab Control Sample	Total/NA	Water	7470A	

Prep Batch: 764146

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-1	AF54593	Dissolved	Water	7470A	
680-230663-2	AF54594	Dissolved	Water	7470A	
680-230663-3	AF54582	Dissolved	Water	7470A	
680-230663-4	AF54583	Dissolved	Water	7470A	
680-230663-5	AF54595	Dissolved	Water	7470A	
680-230663-6	AF54596	Dissolved	Water	7470A	
680-230663-7	AF54572	Dissolved	Water	7470A	
680-230663-8	AF54597	Dissolved	Water	7470A	
680-230663-9	AF54598	Dissolved	Water	7470A	
680-230663-10	AF54600	Dissolved	Water	7470A	
680-230663-11	AF54570	Dissolved	Water	7470A	
680-230663-12	AF54601	Dissolved	Water	7470A	
680-230663-13	AF54605	Dissolved	Water	7470A	
680-230663-14	AF54606	Dissolved	Water	7470A	
680-230663-15	AF54559	Dissolved	Water	7470A	
680-230663-16	AF54560	Dissolved	Water	7470A	

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Prep Batch: 764146 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-17	AF54561	Dissolved	Water	7470A	
680-230663-18	AF54562	Dissolved	Water	7470A	
680-230663-23	AF54599	Dissolved	Water	7470A	
680-230663-41	AF54565	Dissolved	Water	7470A	
MB 680-764146/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-764146/2-A	Lab Control Sample	Total/NA	Water	7470A	
680-230663-5 MS	AF54595	Dissolved	Water	7470A	
680-230663-5 MSD	AF54595	Dissolved	Water	7470A	

Analysis Batch: 764211

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-15	AF54559	Dissolved	Water	6020B	763871
680-230663-15	AF54559	Total Recoverable	Water	6020B	763876
680-230663-16	AF54560	Dissolved	Water	6020B	763876
680-230663-16	AF54560	Total Recoverable	Water	6020B	763857
680-230663-18	AF54562	Dissolved	Water	6020B	763876
680-230663-18	AF54562	Total Recoverable	Water	6020B	763857
680-230663-19	AF54563	Dissolved	Water	6020B	763871
680-230663-19	AF54563	Total Recoverable	Water	6020B	763857
680-230663-20	AF54603	Dissolved	Water	6020B	763855
680-230663-20	AF54603	Total Recoverable	Water	6020B	763855
680-230663-21	AF54558	Dissolved	Water	6020B	763876
680-230663-21	AF54558	Total Recoverable	Water	6020B	763855
680-230663-27	AF54588	Dissolved	Water	6020B	763876
680-230663-27	AF54588	Total Recoverable	Water	6020B	763855
680-230663-32	AF54604	Total Recoverable	Water	6020B	763857
680-230663-33	AF54607	Dissolved	Water	6020B	763876
680-230663-33	AF54607	Total Recoverable	Water	6020B	763857
680-230663-38	AF54591	Dissolved	Water	6020B	763876
680-230663-38	AF54591	Total Recoverable	Water	6020B	763857
680-230663-40	AF54564	Dissolved	Water	6020B	763871
680-230663-40	AF54564	Total Recoverable	Water	6020B	763855
680-230663-41	AF54565	Dissolved	Water	6020B	763876
680-230663-41	AF54565	Total Recoverable	Water	6020B	763857
680-230663-42	AF54566	Dissolved	Water	6020B	763871
680-230663-42	AF54566	Total Recoverable	Water	6020B	763855
680-230663-19 MS	AF54563	Dissolved	Water	6020B	763871
680-230663-19 MSD	AF54563	Dissolved	Water	6020B	763871
680-230663-32 MS	AF54604	Total Recoverable	Water	6020B	763857
680-230663-32 MSD	AF54604	Total Recoverable	Water	6020B	763857

Prep Batch: 764263

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-2	AF54594	Total/NA	Water	7470A	
680-230663-3	AF54582	Total/NA	Water	7470A	
680-230663-4	AF54583	Total/NA	Water	7470A	
680-230663-13	AF54605	Total/NA	Water	7470A	
680-230663-15	AF54559	Total/NA	Water	7470A	
680-230663-18	AF54562	Total/NA	Water	7470A	
680-230663-19	AF54563	Total/NA	Water	7470A	
680-230663-20	AF54603	Total/NA	Water	7470A	

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Prep Batch: 764263 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-21	AF54558	Total/NA	Water	7470A	
680-230663-22	AF54571	Total/NA	Water	7470A	
680-230663-29	AF54568	Total/NA	Water	7470A	
680-230663-30	AF54569	Total/NA	Water	7470A	
680-230663-31	AF54602	Total/NA	Water	7470A	
680-230663-32	AF54604	Total/NA	Water	7470A	
680-230663-33	AF54607	Total/NA	Water	7470A	
680-230663-34	AF54574	Total/NA	Water	7470A	
680-230663-36	AF54584	Total/NA	Water	7470A	
680-230663-37	AF54585	Total/NA	Water	7470A	
680-230663-39	AF54592	Total/NA	Water	7470A	
680-230663-40	AF54564	Total/NA	Water	7470A	
MB 680-764263/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-764263/2-A	Lab Control Sample	Total/NA	Water	7470A	
680-230663-2 MS	AF54594	Total/NA	Water	7470A	
680-230663-2 MSD	AF54594	Total/NA	Water	7470A	

Prep Batch: 764264

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-11	AF54570	Total/NA	Water	7470A	
680-230663-12	AF54601	Total/NA	Water	7470A	
680-230663-14	AF54606	Total/NA	Water	7470A	
680-230663-16	AF54560	Total/NA	Water	7470A	
680-230663-20	AF54603	Dissolved	Water	7470A	
680-230663-24	AF54557	Total/NA	Water	7470A	
680-230663-25	AF54586	Total/NA	Water	7470A	
680-230663-26	AF54587	Total/NA	Water	7470A	
680-230663-28	AF54589	Total/NA	Water	7470A	
680-230663-31	AF54602	Dissolved	Water	7470A	
680-230663-32	AF54604	Dissolved	Water	7470A	
680-230663-33	AF54607	Dissolved	Water	7470A	
680-230663-34	AF54574	Dissolved	Water	7470A	
680-230663-35	AF54580	Total/NA	Water	7470A	
680-230663-38	AF54591	Dissolved	Water	7470A	
680-230663-40	AF54564	Dissolved	Water	7470A	
680-230663-42	AF54566	Dissolved	Water	7470A	
680-230663-42	AF54566	Total/NA	Water	7470A	
680-230663-43	AF54567	Dissolved	Water	7470A	
680-230663-43	AF54567	Total/NA	Water	7470A	
MB 680-764264/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-764264/2-A	Lab Control Sample	Total/NA	Water	7470A	
680-230663-12 MS	AF54601	Total/NA	Water	7470A	
680-230663-12 MSD	AF54601	Total/NA	Water	7470A	

Prep Batch: 764295

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-17	AF54561	Total/NA	Water	7470A	
680-230663-19	AF54563	Dissolved	Water	7470A	
680-230663-21	AF54558	Dissolved	Water	7470A	
680-230663-22	AF54571	Dissolved	Water	7470A	
680-230663-24	AF54557	Dissolved	Water	7470A	

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Prep Batch: 764295 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-25	AF54586	Dissolved	Water	7470A	
680-230663-26	AF54587	Dissolved	Water	7470A	
680-230663-27	AF54588	Dissolved	Water	7470A	
680-230663-27	AF54588	Total/NA	Water	7470A	
680-230663-28	AF54589	Dissolved	Water	7470A	
680-230663-29	AF54568	Dissolved	Water	7470A	
680-230663-30	AF54569	Dissolved	Water	7470A	
680-230663-35	AF54580	Dissolved	Water	7470A	
680-230663-36	AF54584	Dissolved	Water	7470A	
680-230663-37	AF54585	Dissolved	Water	7470A	
680-230663-38	AF54591	Total/NA	Water	7470A	
680-230663-39	AF54592	Dissolved	Water	7470A	
680-230663-41	AF54565	Total/NA	Water	7470A	
MB 680-764295/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-764295/2-A	Lab Control Sample	Total/NA	Water	7470A	
680-230663-41 MS	AF54565	Total/NA	Water	7470A	
680-230663-41 MSD	AF54565	Total/NA	Water	7470A	

Analysis Batch: 764337

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-1	AF54593	Total/NA	Water	7470A	764131
680-230663-5	AF54595	Total/NA	Water	7470A	764131
680-230663-6	AF54596	Total/NA	Water	7470A	764131
680-230663-7	AF54572	Total/NA	Water	7470A	764131
680-230663-8	AF54597	Total/NA	Water	7470A	764131
680-230663-9	AF54598	Total/NA	Water	7470A	764131
680-230663-10	AF54600	Total/NA	Water	7470A	764131
680-230663-23	AF54599	Total/NA	Water	7470A	764131
MB 680-764131/1-A	Method Blank	Total/NA	Water	7470A	764131
LCS 680-764131/2-A	Lab Control Sample	Total/NA	Water	7470A	764131

Analysis Batch: 764393

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-1	AF54593	Dissolved	Water	7470A	764146
680-230663-2	AF54594	Dissolved	Water	7470A	764146
680-230663-2	AF54594	Total/NA	Water	7470A	764263
680-230663-3	AF54582	Dissolved	Water	7470A	764146
680-230663-3	AF54582	Total/NA	Water	7470A	764263
680-230663-4	AF54583	Dissolved	Water	7470A	764146
680-230663-4	AF54583	Total/NA	Water	7470A	764263
680-230663-5	AF54595	Dissolved	Water	7470A	764146
680-230663-6	AF54596	Dissolved	Water	7470A	764146
680-230663-7	AF54572	Dissolved	Water	7470A	764146
680-230663-8	AF54597	Dissolved	Water	7470A	764146
680-230663-9	AF54598	Dissolved	Water	7470A	764146
680-230663-10	AF54600	Dissolved	Water	7470A	764146
680-230663-11	AF54570	Dissolved	Water	7470A	764146
680-230663-11	AF54570	Total/NA	Water	7470A	764264
680-230663-12	AF54601	Dissolved	Water	7470A	764146
680-230663-12	AF54601	Total/NA	Water	7470A	764264
680-230663-13	AF54605	Dissolved	Water	7470A	764146

Eurofins Savannah

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Analysis Batch: 764393 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-13	AF54605	Total/NA	Water	7470A	764263
680-230663-14	AF54606	Dissolved	Water	7470A	764146
680-230663-14	AF54606	Total/NA	Water	7470A	764264
680-230663-15	AF54559	Dissolved	Water	7470A	764146
680-230663-15	AF54559	Total/NA	Water	7470A	764263
680-230663-16	AF54560	Dissolved	Water	7470A	764146
680-230663-16	AF54560	Total/NA	Water	7470A	764264
680-230663-17	AF54561	Dissolved	Water	7470A	764146
680-230663-18	AF54562	Dissolved	Water	7470A	764146
680-230663-18	AF54562	Total/NA	Water	7470A	764263
680-230663-19	AF54563	Total/NA	Water	7470A	764263
680-230663-20	AF54603	Dissolved	Water	7470A	764264
680-230663-20	AF54603	Total/NA	Water	7470A	764263
680-230663-21	AF54558	Total/NA	Water	7470A	764263
680-230663-22	AF54571	Total/NA	Water	7470A	764263
680-230663-23	AF54599	Dissolved	Water	7470A	764146
680-230663-24	AF54557	Total/NA	Water	7470A	764264
680-230663-25	AF54586	Total/NA	Water	7470A	764264
680-230663-26	AF54587	Total/NA	Water	7470A	764264
680-230663-28	AF54589	Total/NA	Water	7470A	764264
680-230663-29	AF54568	Total/NA	Water	7470A	764263
680-230663-30	AF54569	Total/NA	Water	7470A	764263
680-230663-31	AF54602	Dissolved	Water	7470A	764264
680-230663-31	AF54602	Total/NA	Water	7470A	764263
680-230663-32	AF54604	Dissolved	Water	7470A	764264
680-230663-32	AF54604	Total/NA	Water	7470A	764263
680-230663-33	AF54607	Dissolved	Water	7470A	764264
680-230663-33	AF54607	Total/NA	Water	7470A	764263
680-230663-34	AF54574	Dissolved	Water	7470A	764264
680-230663-34	AF54574	Total/NA	Water	7470A	764263
680-230663-35	AF54580	Total/NA	Water	7470A	764264
680-230663-36	AF54584	Total/NA	Water	7470A	764263
680-230663-37	AF54585	Total/NA	Water	7470A	764263
680-230663-38	AF54591	Dissolved	Water	7470A	764264
680-230663-39	AF54592	Total/NA	Water	7470A	764263
680-230663-40	AF54564	Dissolved	Water	7470A	764264
680-230663-40	AF54564	Total/NA	Water	7470A	764263
680-230663-41	AF54565	Dissolved	Water	7470A	764146
680-230663-42	AF54566	Dissolved	Water	7470A	764264
680-230663-42	AF54566	Total/NA	Water	7470A	764264
680-230663-43	AF54567	Dissolved	Water	7470A	764264
680-230663-43	AF54567	Total/NA	Water	7470A	764264
MB 680-764146/1-A	Method Blank	Total/NA	Water	7470A	764146
MB 680-764263/1-A	Method Blank	Total/NA	Water	7470A	764263
MB 680-764264/1-A	Method Blank	Total/NA	Water	7470A	764264
LCS 680-764146/2-A	Lab Control Sample	Total/NA	Water	7470A	764146
LCS 680-764263/2-A	Lab Control Sample	Total/NA	Water	7470A	764263
LCS 680-764264/2-A	Lab Control Sample	Total/NA	Water	7470A	764264
680-230663-2 MS	AF54594	Total/NA	Water	7470A	764263
680-230663-2 MSD	AF54594	Total/NA	Water	7470A	764263
680-230663-5 MS	AF54595	Dissolved	Water	7470A	764146

Eurofins Savannah

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals (Continued)

Analysis Batch: 764393 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-5 MSD	AF54595	Dissolved	Water	7470A	764146
680-230663-12 MS	AF54601	Total/NA	Water	7470A	764264
680-230663-12 MSD	AF54601	Total/NA	Water	7470A	764264

Analysis Batch: 764458

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-17	AF54561	Total/NA	Water	7470A	764295
680-230663-19	AF54563	Dissolved	Water	7470A	764295
680-230663-21	AF54558	Dissolved	Water	7470A	764295
680-230663-22	AF54571	Dissolved	Water	7470A	764295
680-230663-24	AF54557	Dissolved	Water	7470A	764295
680-230663-25	AF54586	Dissolved	Water	7470A	764295
680-230663-26	AF54587	Dissolved	Water	7470A	764295
680-230663-27	AF54588	Dissolved	Water	7470A	764295
680-230663-27	AF54588	Total/NA	Water	7470A	764295
680-230663-28	AF54589	Dissolved	Water	7470A	764295
680-230663-29	AF54568	Dissolved	Water	7470A	764295
680-230663-30	AF54569	Dissolved	Water	7470A	764295
680-230663-35	AF54580	Dissolved	Water	7470A	764295
680-230663-36	AF54584	Dissolved	Water	7470A	764295
680-230663-37	AF54585	Dissolved	Water	7470A	764295
680-230663-38	AF54591	Total/NA	Water	7470A	764295
680-230663-39	AF54592	Dissolved	Water	7470A	764295
680-230663-41	AF54565	Total/NA	Water	7470A	764295
MB 680-764295/1-A	Method Blank	Total/NA	Water	7470A	764295
LCS 680-764295/2-A	Lab Control Sample	Total/NA	Water	7470A	764295
680-230663-41 MS	AF54565	Total/NA	Water	7470A	764295
680-230663-41 MSD	AF54565	Total/NA	Water	7470A	764295

Prep Batch: 764648

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-19	AF54563	Dissolved	Water	3005A	
680-230663-25	AF54586	Dissolved	Water	3005A	
680-230663-32	AF54604	Total Recoverable	Water	3005A	
680-230663-39	AF54592	Total Recoverable	Water	3005A	
MB 680-764648/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-764648/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
LCSD 680-764648/3-A	Lab Control Sample Dup	Total Recoverable	Water	3005A	

Prep Batch: 764655

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-41	AF54565	Total/NA	Water	7470A	
MB 680-764655/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-764655/2-A	Lab Control Sample	Total/NA	Water	7470A	

Analysis Batch: 764851

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-41	AF54565	Total/NA	Water	7470A	764655
MB 680-764655/1-A	Method Blank	Total/NA	Water	7470A	764655
LCS 680-764655/2-A	Lab Control Sample	Total/NA	Water	7470A	764655

QC Association Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Metals

Analysis Batch: 764981

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230663-19	AF54563	Dissolved	Water	6020B	764648
680-230663-19	AF54563	Dissolved	Water	6020B	764648
680-230663-25	AF54586	Dissolved	Water	6020B	764648
680-230663-32	AF54604	Total Recoverable	Water	6020B	764648
680-230663-32	AF54604	Total Recoverable	Water	6020B	764648
680-230663-39	AF54592	Total Recoverable	Water	6020B	764648
MB 680-764648/1-A	Method Blank	Total Recoverable	Water	6020B	764648
LCS 680-764648/2-A	Lab Control Sample	Total Recoverable	Water	6020B	764648
LCSD 680-764648/3-A	Lab Control Sample Dup	Total Recoverable	Water	6020B	764648

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54593

Lab Sample ID: 680-230663-1

Date Collected: 01/26/23 09:38

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:17
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:07
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:07
Total/NA	Prep	7470A			764131	JKL	EET SAV	02/20/23 13:19
Total/NA	Analysis	7470A		1	764337	BJB	EET SAV	02/21/23 13:15

Client Sample ID: AF54594

Lab Sample ID: 680-230663-2

Date Collected: 01/26/23 09:43

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:29
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:28
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:10
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 16:53

Client Sample ID: AF54582

Lab Sample ID: 680-230663-3

Date Collected: 01/26/23 11:19

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 17:38
Total Recoverable	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:56
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:14
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:10

Client Sample ID: AF54583

Lab Sample ID: 680-230663-4

Date Collected: 01/26/23 13:00

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:03

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54583

Lab Sample ID: 680-230663-4

Date Collected: 01/26/23 13:00

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:23
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:17
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:13

Client Sample ID: AF54595

Lab Sample ID: 680-230663-5

Date Collected: 01/25/23 11:00

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:48
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:36
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 13:25
Total/NA	Prep	7470A			764131	JKL	EET SAV	02/20/23 13:19
Total/NA	Analysis	7470A		1	764337	BJB	EET SAV	02/21/23 12:40

Client Sample ID: AF54596

Lab Sample ID: 680-230663-6

Date Collected: 01/25/23 09:54

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:58
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:05
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 13:36
Total/NA	Prep	7470A			764131	JKL	EET SAV	02/20/23 13:19
Total/NA	Analysis	7470A		1	764337	BJB	EET SAV	02/21/23 12:43

Client Sample ID: AF54572

Lab Sample ID: 680-230663-7

Date Collected: 01/24/23 11:46

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763814	RR	EET SAV	02/17/23 06:34
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 13:47
Total Recoverable	Prep	3005A			763814	RR	EET SAV	02/17/23 06:34
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 13:59

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54572

Lab Sample ID: 680-230663-7

Date Collected: 01/24/23 11:46

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 13:39
Total/NA	Prep	7470A			764131	JKL	EET SAV	02/20/23 13:19
Total/NA	Analysis	7470A		1	764337	BJB	EET SAV	02/21/23 12:46

Client Sample ID: AF54597

Lab Sample ID: 680-230663-8

Date Collected: 01/24/23 15:40

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763814	RR	EET SAV	02/17/23 06:34
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 13:31
Total Recoverable	Prep	3005A			763814	RR	EET SAV	02/17/23 06:34
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 13:39
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 13:49
Total/NA	Prep	7470A			764131	JKL	EET SAV	02/20/23 13:19
Total/NA	Analysis	7470A		1	764337	BJB	EET SAV	02/21/23 12:50

Client Sample ID: AF54598

Lab Sample ID: 680-230663-9

Date Collected: 01/24/23 13:27

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763814	RR	EET SAV	02/17/23 06:34
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 13:35
Total Recoverable	Prep	3005A			763814	RR	EET SAV	02/17/23 06:34
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 13:43
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 13:53
Total/NA	Prep	7470A			764131	JKL	EET SAV	02/20/23 13:19
Total/NA	Analysis	7470A		1	764337	BJB	EET SAV	02/21/23 12:53

Client Sample ID: AF54600

Lab Sample ID: 680-230663-10

Date Collected: 01/24/23 10:18

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:25
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:01
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 13:56

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54600

Lab Sample ID: 680-230663-10

Date Collected: 01/24/23 10:18

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			764131	JKL	EET SAV	02/20/23 13:19
Total/NA	Analysis	7470A		1	764337	BJB	EET SAV	02/21/23 13:08

Client Sample ID: AF54570

Lab Sample ID: 680-230663-11

Date Collected: 01/31/23 12:49

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 19:36
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:03
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:21
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:01

Client Sample ID: AF54601

Lab Sample ID: 680-230663-12

Date Collected: 01/31/23 11:17

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:50
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:32
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:31
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:36

Client Sample ID: AF54605

Lab Sample ID: 680-230663-13

Date Collected: 01/31/23 09:40

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:31
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:21
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:34
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:16

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54606

Lab Sample ID: 680-230663-14

Date Collected: 01/31/23 09:45

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 19:57
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:37
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:38
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:15

Client Sample ID: AF54559

Lab Sample ID: 680-230663-15

Date Collected: 02/01/23 09:34

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:54
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:55
Total Recoverable	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:52
Total Recoverable	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:23
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:41
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:19

Client Sample ID: AF54560

Lab Sample ID: 680-230663-16

Date Collected: 02/01/23 11:13

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:07
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:03
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:09
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:30
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:45
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:54

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54561

Lab Sample ID: 680-230663-17

Date Collected: 02/01/23 12:32

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 17:34
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:46
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:48
Total/NA	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:17
Total/NA	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:18

Client Sample ID: AF54562

Lab Sample ID: 680-230663-18

Date Collected: 02/01/23 13:44

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:15
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:11
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:41
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:42
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:52
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:05

Client Sample ID: AF54563

Lab Sample ID: 680-230663-19

Date Collected: 02/01/23 14:52

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 19:16
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:27
Dissolved	Prep	3005A			764648	RR	EET SAV	02/23/23 10:43
Dissolved	Analysis	6020B		1	764981	BWR	EET SAV	02/24/23 13:30
Dissolved	Prep	3005A			764648	RR	EET SAV	02/23/23 10:43
Dissolved	Analysis	6020B		10	764981	BWR	EET SAV	02/24/23 13:58
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:20
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:22

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54563

Lab Sample ID: 680-230663-19

Date Collected: 02/01/23 14:52

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:56
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:31

Client Sample ID: AF54603

Lab Sample ID: 680-230663-20

Date Collected: 01/30/23 13:08

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:31
Dissolved	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 20:03
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:59
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 20:07
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:25
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:17

Client Sample ID: AF54558

Lab Sample ID: 680-230663-21

Date Collected: 01/31/23 15:41

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:11
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:07
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:20
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 20:16
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:46
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:58

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54571

Lab Sample ID: 680-230663-22

Date Collected: 01/31/23 14:05

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 17:55
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:19
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:53
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:02

Client Sample ID: AF54599

Lab Sample ID: 680-230663-23

Date Collected: 01/24/23 14:38

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 17:43
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:53
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:00
Total/NA	Prep	7470A			764131	JKL	EET SAV	02/20/23 13:19
Total/NA	Analysis	7470A		1	764337	BJB	EET SAV	02/21/23 13:11

Client Sample ID: AF54557

Lab Sample ID: 680-230663-24

Date Collected: 02/06/23 11:39

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:05
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:55
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:17
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:21
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:53

Client Sample ID: AF54586

Lab Sample ID: 680-230663-25

Date Collected: 02/06/23 14:02

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 17:14

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54586

Lab Sample ID: 680-230663-25

Date Collected: 02/06/23 14:02

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			764648	RR	EET SAV	02/23/23 10:43
Dissolved	Analysis	6020B		1	764981	BWR	EET SAV	02/24/23 13:34
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:24
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 09:10
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:57

Client Sample ID: AF54587

Lab Sample ID: 680-230663-26

Date Collected: 02/06/23 14:07

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 19:40
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:32
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 09:14
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:18

Client Sample ID: AF54588

Lab Sample ID: 680-230663-27

Date Collected: 02/06/23 12:55

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 17:30
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:59
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:11
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 20:12
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:49
Total/NA	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Total/NA	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:32

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54589

Lab Sample ID: 680-230663-28

Date Collected: 02/06/23 15:32

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:45
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:51
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 09:24
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:39

Client Sample ID: AF54568

Lab Sample ID: 680-230663-29

Date Collected: 02/06/23 09:17

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:33
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:15
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 09:07
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:09

Client Sample ID: AF54569

Lab Sample ID: 680-230663-30

Date Collected: 02/06/23 10:19

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:13
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:47
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:42
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:48

Client Sample ID: AF54602

Lab Sample ID: 680-230663-31

Date Collected: 01/30/23 11:26

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:01

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54602

Lab Sample ID: 680-230663-31

Date Collected: 01/30/23 11:26

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:27
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:28
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:20

Client Sample ID: AF54604

Lab Sample ID: 680-230663-32

Date Collected: 01/30/23 09:37

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 19:28
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:08
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:10
Total Recoverable	Prep	3005A			764648	RR	EET SAV	02/23/23 10:43
Total Recoverable	Analysis	6020B		1	764981	BWR	EET SAV	02/24/23 13:22
Total Recoverable	Prep	3005A			764648	RR	EET SAV	02/23/23 10:43
Total Recoverable	Analysis	6020B		10	764981	BWR	EET SAV	02/24/23 13:54
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:32
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:24

Client Sample ID: AF54607

Lab Sample ID: 680-230663-33

Date Collected: 01/30/23 14:10

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:19
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:15
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:57
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:26
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:35
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:27

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54574

Lab Sample ID: 680-230663-34

Date Collected: 02/07/23 14:17

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 19:44
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:37
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 20:00
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:38

Client Sample ID: AF54580

Lab Sample ID: 680-230663-35

Date Collected: 02/07/23 13:08

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:43
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:17
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:17
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:28
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:11

Client Sample ID: AF54584

Lab Sample ID: 680-230663-36

Date Collected: 02/07/23 15:22

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:23
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:50
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 09:00
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:51

Client Sample ID: AF54585

Lab Sample ID: 680-230663-37

Date Collected: 02/07/23 10:24

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:43

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54585

Lab Sample ID: 680-230663-37

Date Collected: 02/07/23 10:24

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:40
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 09:03
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:34

Client Sample ID: AF54591

Lab Sample ID: 680-230663-38

Date Collected: 02/07/23 11:40

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 17:26
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:46
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:13
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:34
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:56
Total/NA	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:17
Total/NA	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:25

Client Sample ID: AF54592

Lab Sample ID: 680-230663-39

Date Collected: 02/07/23 09:14

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:21
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:03
Total Recoverable	Prep	3005A			764648	RR	EET SAV	02/23/23 10:43
Total Recoverable	Analysis	6020B		1	764981	BWR	EET SAV	02/24/23 13:26
Dissolved	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:18
Dissolved	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 09:27
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 17:55

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54564

Lab Sample ID: 680-230663-40

Date Collected: 02/02/23 09:42

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 20:09
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:51
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 23:44
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 20:20
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:47
Total/NA	Prep	7470A			764263	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:12

Client Sample ID: AF54565

Lab Sample ID: 680-230663-41

Date Collected: 02/02/23 11:13

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 18:27
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:19
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 16:25
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 18:38
Dissolved	Prep	7470A			764146	JKL	EET SAV	02/20/23 13:43
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 14:03
Total/NA	Prep	7470A			764295	BCB	EET SAV	02/21/23 11:17
Total/NA	Analysis	7470A		1	764458	BJB	EET SAV	02/22/23 08:08
Total/NA	Prep	7470A			764655	JKL	EET SAV	02/23/23 10:48
Total/NA	Analysis	7470A		1	764851	JKL	EET SAV	02/23/23 17:57

Client Sample ID: AF54566

Lab Sample ID: 680-230663-42

Date Collected: 02/02/23 11:18

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 19:32
Dissolved	Prep	3005A			763871	RR	EET SAV	02/17/23 10:16
Dissolved	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:47
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 22:15

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Client Sample ID: AF54566

Lab Sample ID: 680-230663-42

Date Collected: 02/02/23 11:18

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			763855	RR	EET SAV	02/17/23 09:09
Total Recoverable	Analysis	6020B		10	764211	BWR	EET SAV	02/20/23 19:59
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 20:03
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 18:50

Client Sample ID: AF54567

Lab Sample ID: 680-230663-43

Date Collected: 02/02/23 13:21

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			763876	RR	EET SAV	02/17/23 10:39
Dissolved	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 17:59
Total Recoverable	Prep	3005A			763857	RR	EET SAV	02/17/23 09:14
Total Recoverable	Analysis	6020B		1	764050	BWR	EET SAV	02/17/23 15:49
Dissolved	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Dissolved	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:42
Total/NA	Prep	7470A			764264	BCB	EET SAV	02/21/23 09:23
Total/NA	Analysis	7470A		1	764393	BJB	EET SAV	02/21/23 19:21

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858




Chain of Custody

Customer Email/Report Recipient: LCWILLIA @santecooper.com Date Results Needed by: / / Project/Task/Unit #: 125915 / JMO2.09.GW.1 / 36500 Rerun request for any flagged QC Yes No

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass-G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	Analysis Group			
											TOTAL METALS - SEE BELOW	DISSOLVED METALS	Si	DISSOLVED Si
AF54593	CLFIB-1	1/26/23	0938	ZDM BSB	2	P	G	GW	2	Si - 6010	X	X		
94	CLFIB-1 DUP		0943							ALL OTHERS - 6020				
82	CCMLF-1		1119							Hg-7470				
83	CCMLF-1D		1300											
AF54595	CLFIB-2	1/25/23	1100	ZDM MDG						*SEE SHEET FOR RLS				
96	CLFIB-3		0954							WHERE APPLICABLE				
AF54572	CBW-1	1/24/23	1146	MDG CDM									X	X
97	CLFIB-4		1540											
98	CLFIB-5		1327											
600	PM-1		1018										X	X

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	2/15/23	1430	<i>JA</i>	7A	2/16/23	1100

Sample Receiving (Internal Use Only)
 TEMP (°C): 18.1 Initial:
 Correct pH: Yes No
 Preservative Lot#:

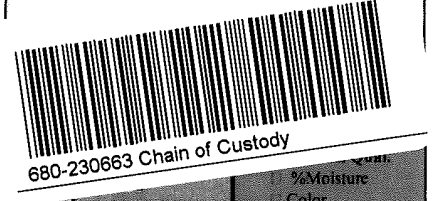

<input checked="" type="checkbox"/> Ag <input checked="" type="checkbox"/> Al <input checked="" type="checkbox"/> As <input type="checkbox"/> B <input checked="" type="checkbox"/> Ba <input checked="" type="checkbox"/> Be <input checked="" type="checkbox"/> Ca <input checked="" type="checkbox"/> Cd <input checked="" type="checkbox"/> Co <input checked="" type="checkbox"/> Cr	<input type="checkbox"/> Cu <input checked="" type="checkbox"/> Fe <input checked="" type="checkbox"/> K <input type="checkbox"/> Li <input checked="" type="checkbox"/> Mg <input type="checkbox"/> Mn <input type="checkbox"/> Mo <input checked="" type="checkbox"/> Na <input checked="" type="checkbox"/> Ni <input checked="" type="checkbox"/> Pb	<input checked="" type="checkbox"/> Sb <input checked="" type="checkbox"/> Se <input type="checkbox"/> Sn <input type="checkbox"/> Sr <input type="checkbox"/> Ti <input checked="" type="checkbox"/> Tl <input type="checkbox"/> V <input checked="" type="checkbox"/> Zn <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	<input type="checkbox"/> Ultima <input type="checkbox"/> % M <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	<input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> AS <input type="checkbox"/> TSS	<input type="checkbox"/> % Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)



Santee Cooper
One Riverwood Drive
Moncks Corner SC 29461
Phone (843)761-8000 Ext. 5148
Fax. (843)761-4175

Chain of Custody

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LCWILLIA @santecooper.com _____ / _____ / _____ 125915 / JM02.09 G01 / 36500 Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	TOTAL METALS -SEE BELOW	DISSOLVED	SI	DISSOLVED SI
AF54570	CAP-13	1/31/23	1249	ZDM BSB	2	P	G	GW	2	SI-6010	X	X		
601	POZ-3		1117							Hg-7470				
605	POZ-7		0940							ALL OTHERS 6020				
606	POZ-7 DUP		0945											
AF54559	CAP-3	2/1/23	0934							* SEE SHEET FOR RLS				
60	CAP-4		1113							WHERE APPLICABLE				
61	CAP-5		1232										X	X
62	CAP-6		1344											
63	CAP-7		1452											

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sjbrown</i>	35594	2/15/23	1430	<i>OK</i>	<i>JA</i>	2/16/23	1100

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input checked="" type="checkbox"/> Ag <input type="checkbox"/> Cu <input checked="" type="checkbox"/> Sb <input checked="" type="checkbox"/> Al <input checked="" type="checkbox"/> Fe <input checked="" type="checkbox"/> Se <input checked="" type="checkbox"/> As <input checked="" type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input checked="" type="checkbox"/> Ba <input checked="" type="checkbox"/> Mg <input type="checkbox"/> Ti <input checked="" type="checkbox"/> Be <input checked="" type="checkbox"/> Mn <input checked="" type="checkbox"/> Tl <input checked="" type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input checked="" type="checkbox"/> Cd <input checked="" type="checkbox"/> Na <input checked="" type="checkbox"/> Zn <input checked="" type="checkbox"/> Co <input checked="" type="checkbox"/> Ni <input checked="" type="checkbox"/> Hg <input checked="" type="checkbox"/> Cr <input checked="" type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4=HCl 5=Na2S2O3 6=Other (Specify)



Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone (843)761-8000 Ext. 5148
Fax. (843)761-4175

Chain of Custody

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LCWILLIA @santecooper.com _____ / _____ / _____ 125915 / JM02.08.G01 / 36500 Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Analysis Group	
											TOTAL METALS SEE BELOW	DISSOLVED METALS
AF54603	POZ-5D	1/30/23	1308	ZDM BSB	2	P	G	GW	2	SI-6010	X	X
AF54558	CAP-2	1/31/23	1544							Hg-7470		
AF54571	CAP-14		1405							ALL OTHERS 6020		
AF54599	CLFIB-5D	1/24/23	1438	BSB CDM	1							
										* SEE SHEET FOR RLS		

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sjbrown</i>	35594	2/15/23	1430	<i>JA</i>	72	2-16-23	1100
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/init for preservative: _____

<input type="checkbox"/> METALS (all) <input checked="" type="checkbox"/> Ag <input type="checkbox"/> Cu <input checked="" type="checkbox"/> Sb <input checked="" type="checkbox"/> Al <input checked="" type="checkbox"/> Fe <input checked="" type="checkbox"/> Se <input checked="" type="checkbox"/> As <input checked="" type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input checked="" type="checkbox"/> Ba <input checked="" type="checkbox"/> Mg <input type="checkbox"/> Ti <input checked="" type="checkbox"/> Be <input checked="" type="checkbox"/> Mn <input checked="" type="checkbox"/> Tl <input checked="" type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input checked="" type="checkbox"/> Cd <input checked="" type="checkbox"/> Na <input checked="" type="checkbox"/> Zn <input checked="" type="checkbox"/> Co <input checked="" type="checkbox"/> Ni <input checked="" type="checkbox"/> Hg <input checked="" type="checkbox"/> Cr <input checked="" type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> % Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4=HCl 5=Na2S2O3 6=Other (Specify)



Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone (843)761-8000 Ext. 5148
Fax: (843)761-4175

Chain of Custody

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LCWILLIA @santecooper.com _____ / _____ / _____ 125915 / JMD2.09 G01.1 / 36500 Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	TOTAL METALS -SEE BELOW	DISSOLVED	SI	DISSOLVED SI
AF54557	CAP-1	2/6/23	1139	ZDM BSB	2	P	G	GW	2	SI-6010	X	X	X	X
86	CGYP-2		1402							Hg-7470		X		
87	CGYP-2D		1407							ALL OTHERS 6020				
88	CGYP-3		1255										X	X
89	CGYP-4		1532							* SEE SHEET FOR RLS			X	X
AF54568	CAP-11	2/6/23	0917											
69	CAP-12		1019											
AF54602	POZ-4	1/30/23	1126										X	X
04	POZ-6		0937											
07	POZ-8		1410											

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	2/15/23	1430	<i>TA</i>	TA	2-16-23	1100

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input checked="" type="checkbox"/> Ag <input type="checkbox"/> Cu <input checked="" type="checkbox"/> Sb <input checked="" type="checkbox"/> Al <input checked="" type="checkbox"/> Fe <input checked="" type="checkbox"/> Se <input checked="" type="checkbox"/> As <input checked="" type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input checked="" type="checkbox"/> Ba <input checked="" type="checkbox"/> Mg <input type="checkbox"/> Ti <input checked="" type="checkbox"/> Be <input checked="" type="checkbox"/> Mn <input checked="" type="checkbox"/> Tl <input checked="" type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input checked="" type="checkbox"/> Cd <input checked="" type="checkbox"/> Na <input checked="" type="checkbox"/> Zn <input checked="" type="checkbox"/> Co <input checked="" type="checkbox"/> Ni <input checked="" type="checkbox"/> Hg <input checked="" type="checkbox"/> Cr <input checked="" type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> C1 <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> pH <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> % Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)



Chain of Custody

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JMD2.09 G01.1 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	TOTAL METALS SEE BELOW	DISSOLVED METALS	SI TOTAL	SI DISSOLVED
AF54574	CCMAP-2	2/7/23	1417	ZDM BSB	2	P	G	GW	2	SI - 6010	X	X		
80	CCMAP-7		1308							Hg-7470				
84	CCMLF-2		1522							ALL OTHERS - 6020				
85	CGYP-1		1024											
91	CGYP-6		1140							*SEE SHEET FOR RLS			X	X
92	CGYP-7		0914											
AF54564	CAP-8	2/2/23	0942											
65	CAP-9		1113										X	X
66	CAP-9D		1118											
67	CAP-10		1321											

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>sjbrown</i>	35594	2/15/23	1430	<i>ZDM</i>	72	2-16-23	1100

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input checked="" type="checkbox"/> Ag <input type="checkbox"/> Cu <input checked="" type="checkbox"/> Sb <input checked="" type="checkbox"/> Al <input checked="" type="checkbox"/> Fe <input checked="" type="checkbox"/> Se <input checked="" type="checkbox"/> As <input checked="" type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input checked="" type="checkbox"/> Ba <input checked="" type="checkbox"/> Mg <input type="checkbox"/> Ti <input checked="" type="checkbox"/> Be <input checked="" type="checkbox"/> Mn <input checked="" type="checkbox"/> Tl <input checked="" type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input checked="" type="checkbox"/> Cd <input checked="" type="checkbox"/> Na <input checked="" type="checkbox"/> Zn <input checked="" type="checkbox"/> Co <input checked="" type="checkbox"/> Ni <input checked="" type="checkbox"/> Hg <input checked="" type="checkbox"/> Cr <input checked="" type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Napthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> % Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-llimestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-230663-1

Login Number: 230663

List Number: 1

Creator: Sims, Robert D

List Source: Eurofins Savannah

Question	Answer	Comment
Radioactivity wasn't checked or is <=/ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	False	Thermal preservation not required.
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09 G01.1/36500

Job ID: 680-230663-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-23

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 2/28/2023 10:13:10 AM

JOB DESCRIPTION

125915/JM02.09.G01.1/36500

JOB NUMBER

680-230711-1


Eurofins Savannah

Job Notes

The test results in this report meet NELAP requirements for parameters for which accreditation is required or available. Any exceptions to the NELAP requirements are noted. Results pertain only to samples listed in this report. This report may not be reproduced, except in full, without the written approval of the laboratory. Questions should be directed to the person who signed this report.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
2/28/2023 10:13:10 AM

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	12
QC Sample Results	26
QC Association	31
Chronicle	34
Chain of Custody	37
Receipt Checklists	38
Certification Summary	39



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Job ID: 680-230711-1

Laboratory: Eurofins Savannah

Narrative

Job Narrative 680-230711-1

Receipt

The samples were received on 2/16/2023 11:00 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 19.9°C

Metals
Sample AF54575 (680-230711-1) failed MS/MSD recoveries and was re-prepped and analyzed to confirm results per client requ
Both sets of data have been reported.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-230711-1	AF54575	Water	02/08/23 09:30	02/16/23 11:00
680-230711-2	AF54576	Water	02/08/23 12:29	02/16/23 11:00
680-230711-3	AF54577	Water	02/08/23 12:34	02/16/23 11:00
680-230711-4	AF54578	Water	02/08/23 14:48	02/16/23 11:00
680-230711-5	AF54579	Water	02/08/23 10:43	02/16/23 11:00
680-230711-6	AF54573	Water	02/09/23 11:22	02/16/23 11:00
680-230711-7	AF54581	Water	02/09/23 09:42	02/16/23 11:00

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Method Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Method	Method Description	Protocol	Laboratory
6020B	Metals (ICP/MS)	SW846	EET SAV
7470A	Mercury (CVAA)	SW846	EET SAV
3005A	Preparation, Total Recoverable or Dissolved Metals	SW846	EET SAV
7470A	Preparation, Mercury	SW846	EET SAV

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

- 1
- 2
- 3
- 4
- 5**
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Qualifiers

Metals	
Qualifier	Qualifier Description
4	MS, MSD: The analyte present in the original sample is greater than 4 times the matrix spike concentration; therefore, control limits are not applicable.
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
▫	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54575

Lab Sample ID: 680-230711-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	57.2		5.00		ug/L	1		6020B	Total
									Recoverable
Barium	58.3		5.00		ug/L	1		6020B	Total
									Recoverable
Calcium	965000		5000		ug/L	10		6020B	Total
									Recoverable
Calcium	1090000		5000		ug/L	10		6020B	Total
									Recoverable
Cobalt	0.990		0.500		ug/L	1		6020B	Total
									Recoverable
Cobalt	1.12		0.500		ug/L	1		6020B	Total
									Recoverable
Iron	3190		100		ug/L	1		6020B	Total
									Recoverable
Iron	3360		100		ug/L	1		6020B	Total
									Recoverable
Magnesium	149000		250		ug/L	1		6020B	Total
									Recoverable
Magnesium	161000		250		ug/L	1		6020B	Total
									Recoverable
Manganese	6760		5.00		ug/L	1		6020B	Total
									Recoverable
Manganese	7270		5.00		ug/L	1		6020B	Total
									Recoverable
Potassium	8530		1000		ug/L	1		6020B	Total
									Recoverable
Potassium	8990		1000		ug/L	1		6020B	Total
									Recoverable
Sodium	209000		500		ug/L	1		6020B	Total
									Recoverable
Sodium	213000		500		ug/L	1		6020B	Total
									Recoverable
Barium	55.1		5.00		ug/L	1		6020B	Dissolved
Calcium	959000		5000		ug/L	10		6020B	Dissolved
Cobalt	0.910		0.500		ug/L	1		6020B	Dissolved
Iron	2520		100		ug/L	1		6020B	Dissolved
Magnesium	159000		250		ug/L	1		6020B	Dissolved
Manganese	6750		5.00		ug/L	1		6020B	Dissolved
Potassium	8620		1000		ug/L	1		6020B	Dissolved
Sodium	215000		500		ug/L	1		6020B	Dissolved
Mercury	0.402		0.200		ug/L	1		7470A	Total/NA

Client Sample ID: AF54576

Lab Sample ID: 680-230711-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	177		5.00		ug/L	1		6020B	Total
									Recoverable
Calcium	79200		500		ug/L	1		6020B	Total
									Recoverable
Cobalt	6.68		0.500		ug/L	1		6020B	Total
									Recoverable
Iron	2000		100		ug/L	1		6020B	Total
									Recoverable
Magnesium	2690		250		ug/L	1		6020B	Total
									Recoverable
Manganese	79.0		5.00		ug/L	1		6020B	Total
									Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54576 (Continued)

Lab Sample ID: 680-230711-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Sodium	15100		500		ug/L	1		6020B	Total Recoverable
Barium	174		5.00		ug/L	1		6020B	Dissolved
Calcium	82600		500		ug/L	1		6020B	Dissolved
Cobalt	7.36		0.500		ug/L	1		6020B	Dissolved
Iron	1350		100		ug/L	1		6020B	Dissolved
Magnesium	2990		250		ug/L	1		6020B	Dissolved
Manganese	80.0		5.00		ug/L	1		6020B	Dissolved
Sodium	16700		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54577

Lab Sample ID: 680-230711-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	174		5.00		ug/L	1		6020B	Total Recoverable
Calcium	78000		500		ug/L	1		6020B	Total Recoverable
Cobalt	6.71		0.500		ug/L	1		6020B	Total Recoverable
Iron	1770		100		ug/L	1		6020B	Total Recoverable
Magnesium	2690		250		ug/L	1		6020B	Total Recoverable
Manganese	81.8		5.00		ug/L	1		6020B	Total Recoverable
Sodium	14800		500		ug/L	1		6020B	Total Recoverable
Barium	165		5.00		ug/L	1		6020B	Dissolved
Calcium	80900		500		ug/L	1		6020B	Dissolved
Cobalt	6.95		0.500		ug/L	1		6020B	Dissolved
Iron	1300		100		ug/L	1		6020B	Dissolved
Magnesium	2840		250		ug/L	1		6020B	Dissolved
Manganese	81.2		5.00		ug/L	1		6020B	Dissolved
Sodium	15500		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54578

Lab Sample ID: 680-230711-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	229		5.00		ug/L	1		6020B	Total Recoverable
Calcium	122000		500		ug/L	1		6020B	Total Recoverable
Cobalt	5.48		0.500		ug/L	1		6020B	Total Recoverable
Magnesium	3150		250		ug/L	1		6020B	Total Recoverable
Manganese	197		5.00		ug/L	1		6020B	Total Recoverable
Potassium	1000		1000		ug/L	1		6020B	Total Recoverable
Sodium	18400		500		ug/L	1		6020B	Total Recoverable
Barium	197		5.00		ug/L	1		6020B	Dissolved
Calcium	141000		500		ug/L	1		6020B	Dissolved
Cobalt	5.66		0.500		ug/L	1		6020B	Dissolved
Magnesium	4270		250		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54578 (Continued)

Lab Sample ID: 680-230711-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Manganese	227		5.00		ug/L	1		6020B	Dissolved
Potassium	1060		1000		ug/L	1		6020B	Dissolved
Sodium	20000		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54579

Lab Sample ID: 680-230711-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	994		100		ug/L	1		6020B	Total Recoverable
Barium	44.5		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	4.45		0.500		ug/L	1		6020B	Total Recoverable
Calcium	18600		500		ug/L	1		6020B	Total Recoverable
Cobalt	36.4		0.500		ug/L	1		6020B	Total Recoverable
Iron	115		100		ug/L	1		6020B	Total Recoverable
Lead	2.63		2.50		ug/L	1		6020B	Total Recoverable
Magnesium	5790		250		ug/L	1		6020B	Total Recoverable
Manganese	31.9		5.00		ug/L	1		6020B	Total Recoverable
Nickel	28.5		5.00		ug/L	1		6020B	Total Recoverable
Sodium	2850		500		ug/L	1		6020B	Total Recoverable
Zinc	36.7		20.0		ug/L	1		6020B	Total Recoverable
Aluminum	820		100		ug/L	1		6020B	Dissolved
Barium	44.7		5.00		ug/L	1		6020B	Dissolved
Beryllium	4.39		0.500		ug/L	1		6020B	Dissolved
Calcium	20000		500		ug/L	1		6020B	Dissolved
Cobalt	37.0		0.500		ug/L	1		6020B	Dissolved
Magnesium	6100		250		ug/L	1		6020B	Dissolved
Manganese	33.7		5.00		ug/L	1		6020B	Dissolved
Nickel	28.7		5.00		ug/L	1		6020B	Dissolved
Sodium	3100		500		ug/L	1		6020B	Dissolved
Zinc	37.3		20.0		ug/L	1		6020B	Dissolved

Client Sample ID: AF54573

Lab Sample ID: 680-230711-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	58.0		5.00		ug/L	1		6020B	Total Recoverable
Calcium	57400		500		ug/L	1		6020B	Total Recoverable
Magnesium	1580		250		ug/L	1		6020B	Total Recoverable
Manganese	81.6		5.00		ug/L	1		6020B	Total Recoverable
Sodium	7920		500		ug/L	1		6020B	Total Recoverable
Barium	57.0		5.00		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54573 (Continued)

Lab Sample ID: 680-230711-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	58300		500		ug/L	1		6020B	Dissolved
Magnesium	1740		250		ug/L	1		6020B	Dissolved
Manganese	81.1		5.00		ug/L	1		6020B	Dissolved
Sodium	8360		500		ug/L	1		6020B	Dissolved

Client Sample ID: AF54581

Lab Sample ID: 680-230711-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Aluminum	107		100		ug/L	1		6020B	Total Recoverable
Barium	25.8		5.00		ug/L	1		6020B	Total Recoverable
Calcium	1670		500		ug/L	1		6020B	Total Recoverable
Cobalt	17.2		0.500		ug/L	1		6020B	Total Recoverable
Iron	148		100		ug/L	1		6020B	Total Recoverable
Magnesium	465		250		ug/L	1		6020B	Total Recoverable
Manganese	100		5.00		ug/L	1		6020B	Total Recoverable
Sodium	4560		500		ug/L	1		6020B	Total Recoverable
Aluminum	111		100		ug/L	1		6020B	Dissolved
Barium	22.3		5.00		ug/L	1		6020B	Dissolved
Calcium	1760		500		ug/L	1		6020B	Dissolved
Cobalt	15.5		0.500		ug/L	1		6020B	Dissolved
Iron	103		100		ug/L	1		6020B	Dissolved
Magnesium	495		250		ug/L	1		6020B	Dissolved
Manganese	88.5		5.00		ug/L	1		6020B	Dissolved
Sodium	4540		500		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54575

Lab Sample ID: 680-230711-1

Date Collected: 02/08/23 09:30

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:02	02/22/23 15:11	1
Aluminum	100	U	100		ug/L		02/24/23 05:26	02/24/23 18:27	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 15:11	1
Antimony	5.00	U	5.00		ug/L		02/24/23 05:26	02/24/23 18:27	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:02	02/22/23 15:11	1
Arsenic	3.00	U	3.00		ug/L		02/24/23 05:26	02/24/23 18:27	1
Barium	57.2		5.00		ug/L		02/20/23 14:02	02/22/23 15:11	1
Barium	58.3		5.00		ug/L		02/24/23 05:26	02/24/23 18:27	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 15:11	1
Beryllium	0.500	U	0.500		ug/L		02/24/23 05:26	02/24/23 18:27	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 15:11	1
Cadmium	0.500	U	0.500		ug/L		02/24/23 05:26	02/24/23 18:27	1
Calcium	965000		5000		ug/L		02/20/23 14:02	02/22/23 15:32	10
Calcium	1090000		5000		ug/L		02/24/23 05:26	02/25/23 10:52	10
Chromium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 15:11	1
Chromium	5.00	U	5.00		ug/L		02/24/23 05:26	02/24/23 18:27	1
Cobalt	0.990		0.500		ug/L		02/20/23 14:02	02/22/23 15:11	1
Cobalt	1.12		0.500		ug/L		02/24/23 05:26	02/24/23 18:27	1
Iron	3190		100		ug/L		02/20/23 14:02	02/22/23 15:11	1
Iron	3360		100		ug/L		02/24/23 05:26	02/24/23 18:27	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 15:11	1
Lead	2.50	U	2.50		ug/L		02/24/23 05:26	02/24/23 18:27	1
Magnesium	149000		250		ug/L		02/20/23 14:02	02/22/23 15:11	1
Magnesium	161000		250		ug/L		02/24/23 05:26	02/24/23 18:27	1
Manganese	6760		5.00		ug/L		02/20/23 14:02	02/22/23 15:11	1
Manganese	7270		5.00		ug/L		02/24/23 05:26	02/24/23 18:27	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 15:11	1
Nickel	5.00	U	5.00		ug/L		02/24/23 05:26	02/24/23 18:27	1
Potassium	8530		1000		ug/L		02/20/23 14:02	02/22/23 15:11	1
Potassium	8990		1000		ug/L		02/24/23 05:26	02/24/23 18:27	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 15:11	1
Selenium	2.50	U	2.50		ug/L		02/24/23 05:26	02/24/23 18:27	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 15:11	1
Silver	1.00	U	1.00		ug/L		02/24/23 05:26	02/24/23 18:27	1
Sodium	209000		500		ug/L		02/20/23 14:02	02/22/23 15:11	1
Sodium	213000		500		ug/L		02/24/23 05:26	02/24/23 18:27	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 15:11	1
Thallium	1.00	U	1.00		ug/L		02/24/23 05:26	02/24/23 18:27	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:02	02/22/23 15:11	1
Zinc	20.0	U	20.0		ug/L		02/24/23 05:26	02/24/23 18:27	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:12	02/21/23 14:40	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:40	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:12	02/21/23 14:40	1
Barium	55.1		5.00		ug/L		02/20/23 14:12	02/21/23 14:40	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 14:40	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 14:40	1
Calcium	959000		5000		ug/L		02/20/23 14:12	02/22/23 16:49	10

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54575

Lab Sample ID: 680-230711-1

Date Collected: 02/08/23 09:30

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Dissolved (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chromium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:40	1
Cobalt	0.910		0.500		ug/L		02/20/23 14:12	02/21/23 14:40	1
Iron	2520		100		ug/L		02/20/23 14:12	02/21/23 14:40	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 14:40	1
Magnesium	159000		250		ug/L		02/20/23 14:12	02/21/23 14:40	1
Manganese	6750		5.00		ug/L		02/20/23 14:12	02/21/23 14:40	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:40	1
Potassium	8620		1000		ug/L		02/20/23 14:12	02/21/23 14:40	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 14:40	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 14:40	1
Sodium	215000		500		ug/L		02/20/23 14:12	02/21/23 14:40	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 14:40	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:12	02/21/23 14:40	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.402		0.200		ug/L		02/22/23 11:03	02/22/23 14:58	1

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:27	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54576

Lab Sample ID: 680-230711-2

Date Collected: 02/08/23 12:29

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:02	02/22/23 16:00	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:00	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:02	02/22/23 16:00	1
Barium	177		5.00		ug/L		02/20/23 14:02	02/22/23 16:00	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:00	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:00	1
Calcium	79200		500		ug/L		02/20/23 14:02	02/22/23 16:00	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:00	1
Cobalt	6.68		0.500		ug/L		02/20/23 14:02	02/22/23 16:00	1
Iron	2000		100		ug/L		02/20/23 14:02	02/22/23 16:00	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:00	1
Magnesium	2690		250		ug/L		02/20/23 14:02	02/22/23 16:00	1
Manganese	79.0		5.00		ug/L		02/20/23 14:02	02/22/23 16:00	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:00	1
Potassium	1000	U	1000		ug/L		02/20/23 14:02	02/22/23 16:00	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:00	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:00	1
Sodium	15100		500		ug/L		02/20/23 14:02	02/22/23 16:00	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:00	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:02	02/22/23 16:00	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:12	02/21/23 14:44	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:44	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:12	02/21/23 14:44	1
Barium	174		5.00		ug/L		02/20/23 14:12	02/21/23 14:44	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 14:44	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 14:44	1
Calcium	82600		500		ug/L		02/20/23 14:12	02/21/23 14:44	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:44	1
Cobalt	7.36		0.500		ug/L		02/20/23 14:12	02/21/23 14:44	1
Iron	1350		100		ug/L		02/20/23 14:12	02/21/23 14:44	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 14:44	1
Magnesium	2990		250		ug/L		02/20/23 14:12	02/21/23 14:44	1
Manganese	80.0		5.00		ug/L		02/20/23 14:12	02/21/23 14:44	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:44	1
Potassium	1000	U	1000		ug/L		02/20/23 14:12	02/21/23 14:44	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 14:44	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 14:44	1
Sodium	16700		500		ug/L		02/20/23 14:12	02/21/23 14:44	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 14:44	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:12	02/21/23 14:44	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:01	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54576

Lab Sample ID: 680-230711-2

Date Collected: 02/08/23 12:29

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:30	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54577

Lab Sample ID: 680-230711-3

Date Collected: 02/08/23 12:34

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:02	02/22/23 16:04	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:04	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:02	02/22/23 16:04	1
Barium	174		5.00		ug/L		02/20/23 14:02	02/22/23 16:04	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:04	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:04	1
Calcium	78000		500		ug/L		02/20/23 14:02	02/22/23 16:04	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:04	1
Cobalt	6.71		0.500		ug/L		02/20/23 14:02	02/22/23 16:04	1
Iron	1770		100		ug/L		02/20/23 14:02	02/22/23 16:04	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:04	1
Magnesium	2690		250		ug/L		02/20/23 14:02	02/22/23 16:04	1
Manganese	81.8		5.00		ug/L		02/20/23 14:02	02/22/23 16:04	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:04	1
Potassium	1000	U	1000		ug/L		02/20/23 14:02	02/22/23 16:04	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:04	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:04	1
Sodium	14800		500		ug/L		02/20/23 14:02	02/22/23 16:04	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:04	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:02	02/22/23 16:04	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:12	02/21/23 14:48	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:48	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:12	02/21/23 14:48	1
Barium	165		5.00		ug/L		02/20/23 14:12	02/21/23 14:48	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 14:48	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 14:48	1
Calcium	80900		500		ug/L		02/20/23 14:12	02/21/23 14:48	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:48	1
Cobalt	6.95		0.500		ug/L		02/20/23 14:12	02/21/23 14:48	1
Iron	1300		100		ug/L		02/20/23 14:12	02/21/23 14:48	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 14:48	1
Magnesium	2840		250		ug/L		02/20/23 14:12	02/21/23 14:48	1
Manganese	81.2		5.00		ug/L		02/20/23 14:12	02/21/23 14:48	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:48	1
Potassium	1000	U	1000		ug/L		02/20/23 14:12	02/21/23 14:48	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 14:48	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 14:48	1
Sodium	15500		500		ug/L		02/20/23 14:12	02/21/23 14:48	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 14:48	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:12	02/21/23 14:48	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:05	1

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54577

Lab Sample ID: 680-230711-3

Date Collected: 02/08/23 12:34

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:33	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54578

Lab Sample ID: 680-230711-4

Date Collected: 02/08/23 14:48

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:02	02/22/23 16:12	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:12	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:02	02/22/23 16:12	1
Barium	229		5.00		ug/L		02/20/23 14:02	02/22/23 16:12	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:12	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:12	1
Calcium	122000		500		ug/L		02/20/23 14:02	02/22/23 16:12	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:12	1
Cobalt	5.48		0.500		ug/L		02/20/23 14:02	02/22/23 16:12	1
Iron	100	U	100		ug/L		02/20/23 14:02	02/22/23 16:12	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:12	1
Magnesium	3150		250		ug/L		02/20/23 14:02	02/22/23 16:12	1
Manganese	197		5.00		ug/L		02/20/23 14:02	02/22/23 16:12	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:12	1
Potassium	1000		1000		ug/L		02/20/23 14:02	02/22/23 16:12	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:12	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:12	1
Sodium	18400		500		ug/L		02/20/23 14:02	02/22/23 16:12	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:12	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:02	02/22/23 16:12	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:12	02/21/23 14:52	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:52	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:12	02/21/23 14:52	1
Barium	197		5.00		ug/L		02/20/23 14:12	02/21/23 14:52	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 14:52	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 14:52	1
Calcium	141000		500		ug/L		02/20/23 14:12	02/21/23 14:52	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:52	1
Cobalt	5.66		0.500		ug/L		02/20/23 14:12	02/21/23 14:52	1
Iron	100	U	100		ug/L		02/20/23 14:12	02/21/23 14:52	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 14:52	1
Magnesium	4270		250		ug/L		02/20/23 14:12	02/21/23 14:52	1
Manganese	227		5.00		ug/L		02/20/23 14:12	02/21/23 14:52	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 14:52	1
Potassium	1060		1000		ug/L		02/20/23 14:12	02/21/23 14:52	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 14:52	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 14:52	1
Sodium	20000		500		ug/L		02/20/23 14:12	02/21/23 14:52	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 14:52	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:12	02/21/23 14:52	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:08	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54578

Lab Sample ID: 680-230711-4

Date Collected: 02/08/23 14:48

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:37	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54579

Lab Sample ID: 680-230711-5

Date Collected: 02/08/23 10:43

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	994		100		ug/L		02/20/23 14:02	02/22/23 16:08	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:08	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:02	02/22/23 16:08	1
Barium	44.5		5.00		ug/L		02/20/23 14:02	02/22/23 16:08	1
Beryllium	4.45		0.500		ug/L		02/20/23 14:02	02/22/23 16:08	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:08	1
Calcium	18600		500		ug/L		02/20/23 14:02	02/22/23 16:08	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:08	1
Cobalt	36.4		0.500		ug/L		02/20/23 14:02	02/22/23 16:08	1
Iron	115		100		ug/L		02/20/23 14:02	02/22/23 16:08	1
Lead	2.63		2.50		ug/L		02/20/23 14:02	02/22/23 16:08	1
Magnesium	5790		250		ug/L		02/20/23 14:02	02/22/23 16:08	1
Manganese	31.9		5.00		ug/L		02/20/23 14:02	02/22/23 16:08	1
Nickel	28.5		5.00		ug/L		02/20/23 14:02	02/22/23 16:08	1
Potassium	1000	U	1000		ug/L		02/20/23 14:02	02/22/23 16:08	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:08	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:08	1
Sodium	2850		500		ug/L		02/20/23 14:02	02/22/23 16:08	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:08	1
Zinc	36.7		20.0		ug/L		02/20/23 14:02	02/22/23 16:08	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	820		100		ug/L		02/20/23 14:12	02/21/23 15:05	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 15:05	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:12	02/21/23 15:05	1
Barium	44.7		5.00		ug/L		02/20/23 14:12	02/21/23 15:05	1
Beryllium	4.39		0.500		ug/L		02/20/23 14:12	02/21/23 15:05	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 15:05	1
Calcium	20000		500		ug/L		02/20/23 14:12	02/21/23 15:05	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 15:05	1
Cobalt	37.0		0.500		ug/L		02/20/23 14:12	02/21/23 15:05	1
Iron	100	U	100		ug/L		02/20/23 14:12	02/21/23 15:05	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 15:05	1
Magnesium	6100		250		ug/L		02/20/23 14:12	02/21/23 15:05	1
Manganese	33.7		5.00		ug/L		02/20/23 14:12	02/21/23 15:05	1
Nickel	28.7		5.00		ug/L		02/20/23 14:12	02/21/23 15:05	1
Potassium	1000	U	1000		ug/L		02/20/23 14:12	02/21/23 15:05	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 15:05	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 15:05	1
Sodium	3100		500		ug/L		02/20/23 14:12	02/21/23 15:05	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 15:05	1
Zinc	37.3		20.0		ug/L		02/20/23 14:12	02/21/23 15:05	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:17	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54579

Lab Sample ID: 680-230711-5

Date Collected: 02/08/23 10:43

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:40	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54573

Lab Sample ID: 680-230711-6

Date Collected: 02/09/23 11:22

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:02	02/22/23 16:16	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:16	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:02	02/22/23 16:16	1
Barium	58.0		5.00		ug/L		02/20/23 14:02	02/22/23 16:16	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:16	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:16	1
Calcium	57400		500		ug/L		02/20/23 14:02	02/22/23 16:16	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:16	1
Cobalt	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:16	1
Iron	100	U	100		ug/L		02/20/23 14:02	02/22/23 16:16	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:16	1
Magnesium	1580		250		ug/L		02/20/23 14:02	02/22/23 16:16	1
Manganese	81.6		5.00		ug/L		02/20/23 14:02	02/22/23 16:16	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:16	1
Potassium	1000	U	1000		ug/L		02/20/23 14:02	02/22/23 16:16	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:16	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:16	1
Sodium	7920		500		ug/L		02/20/23 14:02	02/22/23 16:16	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:16	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:02	02/22/23 16:16	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	100	U	100		ug/L		02/20/23 14:12	02/21/23 15:09	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 15:09	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:12	02/21/23 15:09	1
Barium	57.0		5.00		ug/L		02/20/23 14:12	02/21/23 15:09	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 15:09	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 15:09	1
Calcium	58300		500		ug/L		02/20/23 14:12	02/21/23 15:09	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 15:09	1
Cobalt	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 15:09	1
Iron	100	U	100		ug/L		02/20/23 14:12	02/21/23 15:09	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 15:09	1
Magnesium	1740		250		ug/L		02/20/23 14:12	02/21/23 15:09	1
Manganese	81.1		5.00		ug/L		02/20/23 14:12	02/21/23 15:09	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 15:09	1
Potassium	1000	U	1000		ug/L		02/20/23 14:12	02/21/23 15:09	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 15:09	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 15:09	1
Sodium	8360		500		ug/L		02/20/23 14:12	02/21/23 15:09	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 15:09	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:12	02/21/23 15:09	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:21	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54573

Lab Sample ID: 680-230711-6

Date Collected: 02/09/23 11:22

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:43	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54581

Lab Sample ID: 680-230711-7

Date Collected: 02/09/23 09:42

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	107		100		ug/L		02/20/23 14:02	02/22/23 16:20	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:20	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:02	02/22/23 16:20	1
Barium	25.8		5.00		ug/L		02/20/23 14:02	02/22/23 16:20	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:20	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 16:20	1
Calcium	1670		500		ug/L		02/20/23 14:02	02/22/23 16:20	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:20	1
Cobalt	17.2		0.500		ug/L		02/20/23 14:02	02/22/23 16:20	1
Iron	148		100		ug/L		02/20/23 14:02	02/22/23 16:20	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:20	1
Magnesium	465		250		ug/L		02/20/23 14:02	02/22/23 16:20	1
Manganese	100		5.00		ug/L		02/20/23 14:02	02/22/23 16:20	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 16:20	1
Potassium	1000	U	1000		ug/L		02/20/23 14:02	02/22/23 16:20	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 16:20	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:20	1
Sodium	4560		500		ug/L		02/20/23 14:02	02/22/23 16:20	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 16:20	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:02	02/22/23 16:20	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Aluminum	111		100		ug/L		02/20/23 14:12	02/21/23 15:13	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 15:13	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:12	02/21/23 15:13	1
Barium	22.3		5.00		ug/L		02/20/23 14:12	02/21/23 15:13	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 15:13	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 15:13	1
Calcium	1760		500		ug/L		02/20/23 14:12	02/21/23 15:13	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 15:13	1
Cobalt	15.5		0.500		ug/L		02/20/23 14:12	02/21/23 15:13	1
Iron	103		100		ug/L		02/20/23 14:12	02/21/23 15:13	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 15:13	1
Magnesium	495		250		ug/L		02/20/23 14:12	02/21/23 15:13	1
Manganese	88.5		5.00		ug/L		02/20/23 14:12	02/21/23 15:13	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 15:13	1
Potassium	1000	U	1000		ug/L		02/20/23 14:12	02/21/23 15:13	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 15:13	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 15:13	1
Sodium	4540		500		ug/L		02/20/23 14:12	02/21/23 15:13	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 15:13	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:12	02/21/23 15:13	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:24	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54581

Lab Sample ID: 680-230711-7

Date Collected: 02/09/23 09:42

Matrix: Water

Date Received: 02/16/23 11:00

Method: SW846 7470A - Mercury (CVAA) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 15:46	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Method: 6020B - Metals (ICP/MS)

Lab Sample ID: MB 680-764150/1-A
Matrix: Water
Analysis Batch: 764596

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 764150

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Aluminum	100	U	100		ug/L		02/20/23 14:02	02/22/23 15:03	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 15:03	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:02	02/22/23 15:03	1
Barium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 15:03	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 15:03	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 15:03	1
Calcium	500	U	500		ug/L		02/20/23 14:02	02/22/23 15:03	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 15:03	1
Cobalt	0.500	U	0.500		ug/L		02/20/23 14:02	02/22/23 15:03	1
Iron	100	U	100		ug/L		02/20/23 14:02	02/22/23 15:03	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 15:03	1
Magnesium	250	U	250		ug/L		02/20/23 14:02	02/22/23 15:03	1
Manganese	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 15:03	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:02	02/22/23 15:03	1
Potassium	1000	U	1000		ug/L		02/20/23 14:02	02/22/23 15:03	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:02	02/22/23 15:03	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 15:03	1
Sodium	500	U	500		ug/L		02/20/23 14:02	02/22/23 15:03	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:02	02/22/23 15:03	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:02	02/22/23 15:03	1

Lab Sample ID: LCS 680-764150/2-A
Matrix: Water
Analysis Batch: 764596

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 764150

Analyte	Spike Added	LCS	LCS	Unit	D	%Rec	%Rec Limits
		Result	Qualifier				
Aluminum	5000	5327		ug/L		107	80 - 120
Antimony	50.0	51.92		ug/L		104	80 - 120
Arsenic	100	110.1		ug/L		110	80 - 120
Barium	100	106.7		ug/L		107	80 - 120
Beryllium	50.0	53.03		ug/L		106	80 - 120
Cadmium	50.0	51.58		ug/L		103	80 - 120
Calcium	5000	5501		ug/L		110	80 - 120
Chromium	100	104.7		ug/L		105	80 - 120
Cobalt	50.0	55.71		ug/L		111	80 - 120
Iron	5000	5568		ug/L		111	80 - 120
Lead	505	532.7		ug/L		106	80 - 120
Magnesium	5010	5330		ug/L		106	80 - 120
Manganese	400	443.6		ug/L		111	80 - 120
Nickel	100	109.9		ug/L		110	80 - 120
Potassium	6970	7619		ug/L		109	80 - 120
Selenium	100	117.6		ug/L		118	80 - 120
Silver	50.0	51.94		ug/L		104	80 - 120
Sodium	5050	5743		ug/L		114	80 - 120
Thallium	50.0	51.12		ug/L		102	80 - 120
Zinc	100	107.0		ug/L		107	80 - 120

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-230711-1 MS

Matrix: Water

Analysis Batch: 764596

Client Sample ID: AF54575

Prep Type: Total Recoverable

Prep Batch: 764150

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec	
	Result	Qualifier	Added	Result	Qualifier				Limits	
Aluminum	100	U	5000	5102		ug/L		101	75 - 125	
Antimony	5.00	U	50.0	51.30		ug/L		103	75 - 125	
Arsenic	3.00	U	100	107.4		ug/L		107	75 - 125	
Barium	57.2		100	157.2		ug/L		100	75 - 125	
Beryllium	0.500	U	50.0	51.80		ug/L		104	75 - 125	
Cadmium	0.500	U	50.0	51.10		ug/L		102	75 - 125	
Chromium	5.00	U	100	99.07		ug/L		99	75 - 125	
Cobalt	0.990		50.0	52.05		ug/L		102	75 - 125	
Iron	3190		5000	8339		ug/L		103	75 - 125	
Lead	2.50	U	505	520.5		ug/L		103	75 - 125	
Magnesium	149000		5010	148600	4	ug/L		-5	75 - 125	
Manganese	6760		400	6989	4	ug/L		56	75 - 125	
Nickel	5.00	U	100	103.8		ug/L		102	75 - 125	
Potassium	8530		6970	15490		ug/L		100	75 - 125	
Selenium	2.50	U	100	108.4		ug/L		108	75 - 125	
Silver	1.00	U	50.0	48.20		ug/L		96	75 - 125	
Sodium	209000		5050	207400	4	ug/L		-37	75 - 125	
Thallium	1.00	U	50.0	50.41		ug/L		101	75 - 125	
Zinc	20.0	U	100	119.5		ug/L		115	75 - 125	

Lab Sample ID: 680-230711-1 MS

Matrix: Water

Analysis Batch: 764596

Client Sample ID: AF54575

Prep Type: Total Recoverable

Prep Batch: 764150

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec	
	Result	Qualifier	Added	Result	Qualifier				Limits	
Calcium	965000		5000	916500	4	ug/L		-971	75 - 125	

Lab Sample ID: 680-230711-1 MSD

Matrix: Water

Analysis Batch: 764596

Client Sample ID: AF54575

Prep Type: Total Recoverable

Prep Batch: 764150

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec		RPD	
	Result	Qualifier	Added	Result	Qualifier				Limits	RPD	Limit	
Aluminum	100	U	5000	5006		ug/L		99	75 - 125		2	20
Antimony	5.00	U	50.0	50.36		ug/L		101	75 - 125		2	20
Arsenic	3.00	U	100	107.3		ug/L		107	75 - 125		0	20
Barium	57.2		100	156.5		ug/L		99	75 - 125		0	20
Beryllium	0.500	U	50.0	50.71		ug/L		101	75 - 125		2	20
Cadmium	0.500	U	50.0	47.74		ug/L		95	75 - 125		7	20
Chromium	5.00	U	100	98.86		ug/L		99	75 - 125		0	20
Cobalt	0.990		50.0	51.56		ug/L		101	75 - 125		1	20
Iron	3190		5000	8354		ug/L		103	75 - 125		0	20
Lead	2.50	U	505	515.7		ug/L		102	75 - 125		1	20
Magnesium	149000		5010	143800	4	ug/L		-102	75 - 125		3	20
Manganese	6760		400	6893	4	ug/L		32	75 - 125		1	20
Nickel	5.00	U	100	103.7		ug/L		102	75 - 125		0	20
Potassium	8530		6970	15260		ug/L		97	75 - 125		1	20
Selenium	2.50	U	100	105.0		ug/L		105	75 - 125		3	20
Silver	1.00	U	50.0	47.87		ug/L		96	75 - 125		1	20
Sodium	209000		5050	202800	4	ug/L		-126	75 - 125		2	20

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-230711-1 MSD
Matrix: Water
Analysis Batch: 764596

Client Sample ID: AF54575
Prep Type: Total Recoverable
Prep Batch: 764150

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	Limit
	Result	Qualifier		Result	Qualifier				Limits		
Thallium	1.00	U	50.0	49.49		ug/L		99	75 - 125	2	20
Zinc	20.0	U	100	99.18		ug/L		95	75 - 125	19	20

Lab Sample ID: 680-230711-1 MSD
Matrix: Water
Analysis Batch: 764596

Client Sample ID: AF54575
Prep Type: Total Recoverable
Prep Batch: 764150

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec	RPD	Limit
	Result	Qualifier		Result	Qualifier				Limits		
Calcium	965000		5000	916200	4	ug/L		-976	75 - 125	0	20

Lab Sample ID: MB 680-764259/1-A
Matrix: Water
Analysis Batch: 764406

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 764259

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Aluminum	100	U	100		ug/L		02/20/23 14:12	02/21/23 13:27	1
Antimony	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 13:27	1
Arsenic	3.00	U	3.00		ug/L		02/20/23 14:12	02/21/23 13:27	1
Barium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 13:27	1
Beryllium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 13:27	1
Cadmium	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 13:27	1
Calcium	500	U	500		ug/L		02/20/23 14:12	02/21/23 13:27	1
Chromium	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 13:27	1
Cobalt	0.500	U	0.500		ug/L		02/20/23 14:12	02/21/23 13:27	1
Iron	100	U	100		ug/L		02/20/23 14:12	02/21/23 13:27	1
Lead	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 13:27	1
Magnesium	250	U	250		ug/L		02/20/23 14:12	02/21/23 13:27	1
Manganese	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 13:27	1
Nickel	5.00	U	5.00		ug/L		02/20/23 14:12	02/21/23 13:27	1
Potassium	1000	U	1000		ug/L		02/20/23 14:12	02/21/23 13:27	1
Selenium	2.50	U	2.50		ug/L		02/20/23 14:12	02/21/23 13:27	1
Silver	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 13:27	1
Sodium	500	U	500		ug/L		02/20/23 14:12	02/21/23 13:27	1
Thallium	1.00	U	1.00		ug/L		02/20/23 14:12	02/21/23 13:27	1
Zinc	20.0	U	20.0		ug/L		02/20/23 14:12	02/21/23 13:27	1

Lab Sample ID: LCS 680-764259/2-A
Matrix: Water
Analysis Batch: 764406

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 764259

Analyte	Spike	LCS	LCS	Unit	D	%Rec	%Rec
		Added	Result				Qualifier
Aluminum	5000	4937		ug/L		99	80 - 120
Antimony	50.0	48.68		ug/L		97	80 - 120
Arsenic	100	102.4		ug/L		102	80 - 120
Barium	100	95.03		ug/L		95	80 - 120
Beryllium	50.0	47.55		ug/L		95	80 - 120
Cadmium	50.0	47.75		ug/L		95	80 - 120
Calcium	5000	4951		ug/L		99	80 - 120
Chromium	100	93.99		ug/L		94	80 - 120

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: LCS 680-764259/2-A
Matrix: Water
Analysis Batch: 764406

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 764259

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec	
							Limits	
Cobalt	50.0	51.55		ug/L		103	80 - 120	
Iron	5000	5209		ug/L		104	80 - 120	
Lead	505	494.4		ug/L		98	80 - 120	
Magnesium	5010	5055		ug/L		101	80 - 120	
Manganese	400	394.4		ug/L		99	80 - 120	
Nickel	100	100.7		ug/L		101	80 - 120	
Potassium	6970	6856		ug/L		98	80 - 120	
Selenium	100	104.2		ug/L		104	80 - 120	
Silver	50.0	48.28		ug/L		97	80 - 120	
Sodium	5050	5206		ug/L		103	80 - 120	
Thallium	50.0	47.24		ug/L		94	80 - 120	
Zinc	100	100.3		ug/L		100	80 - 120	

Lab Sample ID: MB 680-764784/1-A
Matrix: Water
Analysis Batch: 764981

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 764784

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Aluminum	100	U	100		ug/L		02/24/23 05:26	02/24/23 17:26	1
Antimony	5.00	U	5.00		ug/L		02/24/23 05:26	02/24/23 17:26	1
Arsenic	3.00	U	3.00		ug/L		02/24/23 05:26	02/24/23 17:26	1
Barium	5.00	U	5.00		ug/L		02/24/23 05:26	02/24/23 17:26	1
Beryllium	0.500	U	0.500		ug/L		02/24/23 05:26	02/24/23 17:26	1
Cadmium	0.500	U	0.500		ug/L		02/24/23 05:26	02/24/23 17:26	1
Calcium	500	U	500		ug/L		02/24/23 05:26	02/24/23 17:26	1
Chromium	5.00	U	5.00		ug/L		02/24/23 05:26	02/24/23 17:26	1
Cobalt	0.500	U	0.500		ug/L		02/24/23 05:26	02/24/23 17:26	1
Iron	100	U	100		ug/L		02/24/23 05:26	02/24/23 17:26	1
Lead	2.50	U	2.50		ug/L		02/24/23 05:26	02/24/23 17:26	1
Magnesium	250	U	250		ug/L		02/24/23 05:26	02/24/23 17:26	1
Manganese	5.00	U	5.00		ug/L		02/24/23 05:26	02/24/23 17:26	1
Nickel	5.00	U	5.00		ug/L		02/24/23 05:26	02/24/23 17:26	1
Potassium	1000	U	1000		ug/L		02/24/23 05:26	02/24/23 17:26	1
Selenium	2.50	U	2.50		ug/L		02/24/23 05:26	02/24/23 17:26	1
Silver	1.00	U	1.00		ug/L		02/24/23 05:26	02/24/23 17:26	1
Sodium	500	U	500		ug/L		02/24/23 05:26	02/24/23 17:26	1
Thallium	1.00	U	1.00		ug/L		02/24/23 05:26	02/24/23 17:26	1
Zinc	20.0	U	20.0		ug/L		02/24/23 05:26	02/24/23 17:26	1

Lab Sample ID: LCS 680-764784/2-A
Matrix: Water
Analysis Batch: 764981

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 764784

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec	
							Limits	
Aluminum	5000	5407		ug/L		108	80 - 120	
Antimony	50.0	52.35		ug/L		105	80 - 120	
Arsenic	100	108.1		ug/L		108	80 - 120	
Barium	100	101.4		ug/L		101	80 - 120	
Beryllium	50.0	50.87		ug/L		102	80 - 120	

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: LCS 680-764784/2-A
 Matrix: Water
 Analysis Batch: 764981

Client Sample ID: Lab Control Sample
 Prep Type: Total Recoverable
 Prep Batch: 764784

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Cadmium	50.0	51.97		ug/L		104	80 - 120
Calcium	5000	5244		ug/L		105	80 - 120
Chromium	100	100.2		ug/L		100	80 - 120
Cobalt	50.0	54.56		ug/L		109	80 - 120
Iron	5000	5380		ug/L		108	80 - 120
Lead	505	535.5		ug/L		106	80 - 120
Magnesium	5010	5311		ug/L		106	80 - 120
Manganese	400	426.9		ug/L		107	80 - 120
Nickel	100	107.3		ug/L		107	80 - 120
Potassium	6970	7236		ug/L		104	80 - 120
Selenium	100	106.2		ug/L		106	80 - 120
Silver	50.0	51.26		ug/L		103	80 - 120
Sodium	5050	5280		ug/L		105	80 - 120
Thallium	50.0	51.31		ug/L		103	80 - 120
Zinc	100	107.5		ug/L		108	80 - 120

Method: 7470A - Mercury (CVAA)

Lab Sample ID: MB 680-764470/1-A
 Matrix: Water
 Analysis Batch: 764526

Client Sample ID: Method Blank
 Prep Type: Total/NA
 Prep Batch: 764470

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		02/22/23 11:03	02/22/23 14:39	1

Lab Sample ID: LCS 680-764470/2-A
 Matrix: Water
 Analysis Batch: 764526

Client Sample ID: Lab Control Sample
 Prep Type: Total/NA
 Prep Batch: 764470

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	2.50	2.526		ug/L		101	80 - 120

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Metals

Prep Batch: 764150

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Total Recoverable	Water	3005A	
680-230711-2	AF54576	Total Recoverable	Water	3005A	
680-230711-3	AF54577	Total Recoverable	Water	3005A	
680-230711-4	AF54578	Total Recoverable	Water	3005A	
680-230711-5	AF54579	Total Recoverable	Water	3005A	
680-230711-6	AF54573	Total Recoverable	Water	3005A	
680-230711-7	AF54581	Total Recoverable	Water	3005A	
MB 680-764150/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-764150/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
680-230711-1 MS	AF54575	Total Recoverable	Water	3005A	
680-230711-1 MSD	AF54575	Total Recoverable	Water	3005A	

Prep Batch: 764259

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Dissolved	Water	3005A	
680-230711-2	AF54576	Dissolved	Water	3005A	
680-230711-3	AF54577	Dissolved	Water	3005A	
680-230711-4	AF54578	Dissolved	Water	3005A	
680-230711-5	AF54579	Dissolved	Water	3005A	
680-230711-6	AF54573	Dissolved	Water	3005A	
680-230711-7	AF54581	Dissolved	Water	3005A	
MB 680-764259/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-764259/2-A	Lab Control Sample	Total Recoverable	Water	3005A	

Analysis Batch: 764406

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Dissolved	Water	6020B	764259
680-230711-2	AF54576	Dissolved	Water	6020B	764259
680-230711-3	AF54577	Dissolved	Water	6020B	764259
680-230711-4	AF54578	Dissolved	Water	6020B	764259
680-230711-5	AF54579	Dissolved	Water	6020B	764259
680-230711-6	AF54573	Dissolved	Water	6020B	764259
680-230711-7	AF54581	Dissolved	Water	6020B	764259
MB 680-764259/1-A	Method Blank	Total Recoverable	Water	6020B	764259
LCS 680-764259/2-A	Lab Control Sample	Total Recoverable	Water	6020B	764259

Prep Batch: 764470

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Dissolved	Water	7470A	
680-230711-1	AF54575	Total/NA	Water	7470A	
680-230711-2	AF54576	Dissolved	Water	7470A	
680-230711-2	AF54576	Total/NA	Water	7470A	
680-230711-3	AF54577	Dissolved	Water	7470A	
680-230711-3	AF54577	Total/NA	Water	7470A	
680-230711-4	AF54578	Dissolved	Water	7470A	
680-230711-4	AF54578	Total/NA	Water	7470A	
680-230711-5	AF54579	Dissolved	Water	7470A	
680-230711-5	AF54579	Total/NA	Water	7470A	
680-230711-6	AF54573	Dissolved	Water	7470A	
680-230711-6	AF54573	Total/NA	Water	7470A	
680-230711-7	AF54581	Dissolved	Water	7470A	

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Metals (Continued)

Prep Batch: 764470 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-7	AF54581	Total/NA	Water	7470A	
MB 680-764470/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-764470/2-A	Lab Control Sample	Total/NA	Water	7470A	

Analysis Batch: 764526

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Dissolved	Water	7470A	764470
680-230711-1	AF54575	Total/NA	Water	7470A	764470
680-230711-2	AF54576	Dissolved	Water	7470A	764470
680-230711-2	AF54576	Total/NA	Water	7470A	764470
680-230711-3	AF54577	Dissolved	Water	7470A	764470
680-230711-3	AF54577	Total/NA	Water	7470A	764470
680-230711-4	AF54578	Dissolved	Water	7470A	764470
680-230711-4	AF54578	Total/NA	Water	7470A	764470
680-230711-5	AF54579	Dissolved	Water	7470A	764470
680-230711-5	AF54579	Total/NA	Water	7470A	764470
680-230711-6	AF54573	Dissolved	Water	7470A	764470
680-230711-6	AF54573	Total/NA	Water	7470A	764470
680-230711-7	AF54581	Dissolved	Water	7470A	764470
680-230711-7	AF54581	Total/NA	Water	7470A	764470
MB 680-764470/1-A	Method Blank	Total/NA	Water	7470A	764470
LCS 680-764470/2-A	Lab Control Sample	Total/NA	Water	7470A	764470

Analysis Batch: 764596

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Dissolved	Water	6020B	764259
680-230711-1	AF54575	Total Recoverable	Water	6020B	764150
680-230711-1	AF54575	Total Recoverable	Water	6020B	764150
680-230711-2	AF54576	Total Recoverable	Water	6020B	764150
680-230711-3	AF54577	Total Recoverable	Water	6020B	764150
680-230711-4	AF54578	Total Recoverable	Water	6020B	764150
680-230711-5	AF54579	Total Recoverable	Water	6020B	764150
680-230711-6	AF54573	Total Recoverable	Water	6020B	764150
680-230711-7	AF54581	Total Recoverable	Water	6020B	764150
MB 680-764150/1-A	Method Blank	Total Recoverable	Water	6020B	764150
LCS 680-764150/2-A	Lab Control Sample	Total Recoverable	Water	6020B	764150
680-230711-1 MS	AF54575	Total Recoverable	Water	6020B	764150
680-230711-1 MS	AF54575	Total Recoverable	Water	6020B	764150
680-230711-1 MSD	AF54575	Total Recoverable	Water	6020B	764150
680-230711-1 MSD	AF54575	Total Recoverable	Water	6020B	764150

Prep Batch: 764784

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Total Recoverable	Water	3005A	
MB 680-764784/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-764784/2-A	Lab Control Sample	Total Recoverable	Water	3005A	

Analysis Batch: 764981

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Total Recoverable	Water	6020B	764784
MB 680-764784/1-A	Method Blank	Total Recoverable	Water	6020B	764784

Eurofins Savannah

QC Association Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Metals (Continued)

Analysis Batch: 764981 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
LCS 680-764784/2-A	Lab Control Sample	Total Recoverable	Water	6020B	764784

Analysis Batch: 764983

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230711-1	AF54575	Total Recoverable	Water	6020B	764784

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54575

Lab Sample ID: 680-230711-1

Date Collected: 02/08/23 09:30

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			764259	RR	EET SAV	02/20/23 14:12
Dissolved	Analysis	6020B		1	764406	BWR	EET SAV	02/21/23 14:40
Dissolved	Prep	3005A			764259	RR	EET SAV	02/20/23 14:12
Dissolved	Analysis	6020B		10	764596	BWR	EET SAV	02/22/23 16:49
Total Recoverable	Prep	3005A			764150	RR	EET SAV	02/20/23 14:02
Total Recoverable	Analysis	6020B		1	764596	BWR	EET SAV	02/22/23 15:11
Total Recoverable	Prep	3005A			764150	RR	EET SAV	02/20/23 14:02
Total Recoverable	Analysis	6020B		10	764596	BWR	EET SAV	02/22/23 15:32
Total Recoverable	Prep	3005A			764784	RR	EET SAV	02/24/23 05:26
Total Recoverable	Analysis	6020B		1	764981	BWR	EET SAV	02/24/23 18:27
Total Recoverable	Prep	3005A			764784	RR	EET SAV	02/24/23 05:26
Total Recoverable	Analysis	6020B		10	764983	BWR	EET SAV	02/25/23 10:52
Dissolved	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Dissolved	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:27
Total/NA	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Total/NA	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 14:58

Client Sample ID: AF54576

Lab Sample ID: 680-230711-2

Date Collected: 02/08/23 12:29

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			764259	RR	EET SAV	02/20/23 14:12
Dissolved	Analysis	6020B		1	764406	BWR	EET SAV	02/21/23 14:44
Total Recoverable	Prep	3005A			764150	RR	EET SAV	02/20/23 14:02
Total Recoverable	Analysis	6020B		1	764596	BWR	EET SAV	02/22/23 16:00
Dissolved	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Dissolved	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:30
Total/NA	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Total/NA	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:01

Client Sample ID: AF54577

Lab Sample ID: 680-230711-3

Date Collected: 02/08/23 12:34

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			764259	RR	EET SAV	02/20/23 14:12
Dissolved	Analysis	6020B		1	764406	BWR	EET SAV	02/21/23 14:48
Total Recoverable	Prep	3005A			764150	RR	EET SAV	02/20/23 14:02
Total Recoverable	Analysis	6020B		1	764596	BWR	EET SAV	02/22/23 16:04
Dissolved	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Dissolved	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:33
Total/NA	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Total/NA	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:05

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54578

Lab Sample ID: 680-230711-4

Date Collected: 02/08/23 14:48

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			764259	RR	EET SAV	02/20/23 14:12
Dissolved	Analysis	6020B		1	764406	BWR	EET SAV	02/21/23 14:52
Total Recoverable	Prep	3005A			764150	RR	EET SAV	02/20/23 14:02
Total Recoverable	Analysis	6020B		1	764596	BWR	EET SAV	02/22/23 16:12
Dissolved	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Dissolved	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:37
Total/NA	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Total/NA	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:08

Client Sample ID: AF54579

Lab Sample ID: 680-230711-5

Date Collected: 02/08/23 10:43

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			764259	RR	EET SAV	02/20/23 14:12
Dissolved	Analysis	6020B		1	764406	BWR	EET SAV	02/21/23 15:05
Total Recoverable	Prep	3005A			764150	RR	EET SAV	02/20/23 14:02
Total Recoverable	Analysis	6020B		1	764596	BWR	EET SAV	02/22/23 16:08
Dissolved	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Dissolved	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:40
Total/NA	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Total/NA	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:17

Client Sample ID: AF54573

Lab Sample ID: 680-230711-6

Date Collected: 02/09/23 11:22

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			764259	RR	EET SAV	02/20/23 14:12
Dissolved	Analysis	6020B		1	764406	BWR	EET SAV	02/21/23 15:09
Total Recoverable	Prep	3005A			764150	RR	EET SAV	02/20/23 14:02
Total Recoverable	Analysis	6020B		1	764596	BWR	EET SAV	02/22/23 16:16
Dissolved	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Dissolved	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:43
Total/NA	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Total/NA	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:21

Client Sample ID: AF54581

Lab Sample ID: 680-230711-7

Date Collected: 02/09/23 09:42

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Prep	3005A			764259	RR	EET SAV	02/20/23 14:12
Dissolved	Analysis	6020B		1	764406	BWR	EET SAV	02/21/23 15:13

Lab Chronicle

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Client Sample ID: AF54581

Lab Sample ID: 680-230711-7

Date Collected: 02/09/23 09:42

Matrix: Water

Date Received: 02/16/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			764150	RR	EET SAV	02/20/23 14:02
Total Recoverable	Analysis	6020B		1	764596	BWR	EET SAV	02/22/23 16:20
Dissolved	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Dissolved	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:46
Total/NA	Prep	7470A			764470	BCB	EET SAV	02/22/23 11:03
Total/NA	Analysis	7470A		1	764526	BCB	EET SAV	02/22/23 15:24

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858






Chain of Custody

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JMB2.09.601.1 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc sample info • Any other notes	TOTAL METALS -SEE BELOW	NONAL DISSOLVED METALS SEE BELOW
AF54575	CCMAP - 3	2/8/23	0930	ZDM BSB	2	P	G	GW	2	Hg-7470	X	X
76	CCMAP - 4		1229							ALL OTHERS 6020		X
77	CCMAP - 4D		1234									
78	CCMAP - 5		1448							* SEE SHEET FOR RLS.		
79	CCMAP - 6		1043									
AF54573	CCMAP - 1	2/9/23	1122									
AF54581	CCMAP - 8		0942									



680-230711 Chain of Custody

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>S. Brown</i>	35574	2/15/23	1530				

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input checked="" type="checkbox"/> Ag <input checked="" type="checkbox"/> Al <input checked="" type="checkbox"/> As <input type="checkbox"/> B <input checked="" type="checkbox"/> Ba <input checked="" type="checkbox"/> Be <input checked="" type="checkbox"/> Ca <input checked="" type="checkbox"/> Cd <input checked="" type="checkbox"/> Co <input checked="" type="checkbox"/> Cr	<input type="checkbox"/> Cu <input checked="" type="checkbox"/> Fe <input checked="" type="checkbox"/> K <input type="checkbox"/> Li <input checked="" type="checkbox"/> Mg <input type="checkbox"/> Mn <input checked="" type="checkbox"/> Na <input checked="" type="checkbox"/> Ni <input checked="" type="checkbox"/> Pb	<input checked="" type="checkbox"/> Sb <input checked="" type="checkbox"/> Se <input type="checkbox"/> Sn <input type="checkbox"/> Sr <input type="checkbox"/> Ti <input checked="" type="checkbox"/> Tl <input type="checkbox"/> V <input checked="" type="checkbox"/> Zn <input checked="" type="checkbox"/> Hg <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> % Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> YX <input type="checkbox"/> GOFER
----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

[Signature] 2/16/23 100
19.9/19.9

Matrix codes GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO₃ 3=H₂SO₄ 4=HCl 5=Na₂S₂O₃ 6=Other (Specify)

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-230711-1

Login Number: 230711

List Source: Eurofins Savannah

List Number: 1

Creator: Johnson, Corey M

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230711-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-23

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 2/27/2023 9:07:27 AM

JOB DESCRIPTION

125915/JM02.09.G01.1/36500

JOB NUMBER

680-230959-1


Eurofins Savannah

Job Notes

The test results in this report meet NELAP requirements for parameters for which accreditation is required or available. Any exceptions to the NELAP requirements are noted. Results pertain only to samples listed in this report. This report may not be reproduced, except in full, without the written approval of the laboratory. Questions should be directed to the person who signed this report.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
2/27/2023 9:07:27 AM

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	9
QC Sample Results	18
QC Association	19
Chronicle	20
Chain of Custody	22
Receipt Checklists	23
Certification Summary	24



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Job ID: 680-230959-1

Laboratory: Eurofins Savannah

Narrative

Job Narrative 680-230959-1

Receipt

The samples were received on 2/22/2023 10:30 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 2.1°C

HPLC/IC

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Metals

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-230959-1	AF54572	Water	01/24/23 11:46	02/22/23 10:30
680-230959-2	AF54600	Water	01/24/23 10:18	02/22/23 10:30
680-230959-3	AF54561	Water	02/01/23 12:32	02/22/23 10:30
680-230959-4	AF54591	Water	02/07/23 11:40	02/22/23 10:30
680-230959-5	AF54565	Water	02/02/23 11:13	02/22/23 10:30
680-230959-6	AF54557	Water	02/06/23 11:39	02/22/23 10:30
680-230959-7	AF54588	Water	02/06/23 12:55	02/22/23 10:30
680-230959-8	AF54589	Water	02/06/23 15:32	02/22/23 10:30
680-230959-9	AF54602	Water	01/30/23 11:26	02/22/23 10:30

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Method Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Method	Method Description	Protocol	Laboratory
300.0-1993 R2.1	Anions, Ion Chromatography	MCAWW	EET SAV
6010D	Metals, Silica (ICP)	SW846	EET SAV
FILTRATION	Sample Filtration	None	EET SAV

Protocol References:

MCAWW = "Methods For Chemical Analysis Of Water And Wastes", EPA-600/4-79-020, March 1983 And Subsequent Revisions.

None = None

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Qualifiers

HPLC/IC

Qualifier	Qualifier Description
U	Indicates the analyte was analyzed for but not detected.

Metals

Qualifier	Qualifier Description
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
▫	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54572

Lab Sample ID: 680-230959-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
SiO2, Silica	3110		500		ug/L	1		6010D	Dissolved

Client Sample ID: AF54600

Lab Sample ID: 680-230959-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
SiO2, Silica	33000		500		ug/L	1		6010D	Dissolved

Client Sample ID: AF54561

Lab Sample ID: 680-230959-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
SiO2, Silica	28000		500		ug/L	1		6010D	Dissolved

Client Sample ID: AF54591

Lab Sample ID: 680-230959-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
SiO2, Silica	117000		5000		ug/L	10		6010D	Dissolved

Client Sample ID: AF54565

Lab Sample ID: 680-230959-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
SiO2, Silica	38200		500		ug/L	1		6010D	Dissolved

Client Sample ID: AF54557

Lab Sample ID: 680-230959-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
SiO2, Silica	119000		5000		ug/L	10		6010D	Dissolved

Client Sample ID: AF54588

Lab Sample ID: 680-230959-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
SiO2, Silica	86700		5000		ug/L	10		6010D	Dissolved

Client Sample ID: AF54589

Lab Sample ID: 680-230959-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Sulfate	557		5.00		mg/L	5		300.0-1993 R2.1	Total/NA
Chloride	417		2.50		mg/L	5		300.0-1993 R2.1	Total/NA
SiO2, Silica	47900		500		ug/L	1		6010D	Dissolved

Client Sample ID: AF54602

Lab Sample ID: 680-230959-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
SiO2, Silica	22500		500		ug/L	1		6010D	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54572

Lab Sample ID: 680-230959-1

Date Collected: 01/24/23 11:46

Matrix: Water

Date Received: 02/22/23 10:30

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	3110		500		ug/L			02/23/23 18:24	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54600

Lab Sample ID: 680-230959-2

Date Collected: 01/24/23 10:18

Matrix: Water

Date Received: 02/22/23 10:30

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	33000		500		ug/L			02/23/23 18:29	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54561

Lab Sample ID: 680-230959-3

Date Collected: 02/01/23 12:32

Matrix: Water

Date Received: 02/22/23 10:30

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	28000		500		ug/L			02/23/23 18:31	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54591

Lab Sample ID: 680-230959-4

Date Collected: 02/07/23 11:40

Matrix: Water

Date Received: 02/22/23 10:30

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	117000		5000		ug/L			02/26/23 10:42	10

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54565

Lab Sample ID: 680-230959-5

Date Collected: 02/02/23 11:13

Matrix: Water

Date Received: 02/22/23 10:30

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	38200		500		ug/L			02/23/23 18:34	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54557

Lab Sample ID: 680-230959-6

Date Collected: 02/06/23 11:39

Matrix: Water

Date Received: 02/22/23 10:30

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	119000		5000		ug/L			02/26/23 10:44	10

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54588

Lab Sample ID: 680-230959-7

Date Collected: 02/06/23 12:55

Matrix: Water

Date Received: 02/22/23 10:30

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	86700		5000		ug/L			02/26/23 10:45	10

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54589

Lab Sample ID: 680-230959-8

Date Collected: 02/06/23 15:32

Matrix: Water

Date Received: 02/22/23 10:30

Method: MCAWW 300.0-1993 R2.1 - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate	557		5.00		mg/L			02/23/23 18:32	5
Chloride	417		2.50		mg/L			02/23/23 18:32	5

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	47900		500		ug/L			02/23/23 18:42	1

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54602

Lab Sample ID: 680-230959-9

Date Collected: 01/30/23 11:26

Matrix: Water

Date Received: 02/22/23 10:30

Method: SW846 6010D - Metals, Silica (ICP) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	22500		500		ug/L			02/23/23 18:44	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Method: 300.0-1993 R2.1 - Anions, Ion Chromatography

Lab Sample ID: MB 680-764690/2
 Matrix: Water
 Analysis Batch: 764690

Client Sample ID: Method Blank
 Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate	1.00	U	1.00		mg/L			02/23/23 11:20	1
Chloride	0.500	U	0.500		mg/L			02/23/23 11:20	1

Lab Sample ID: LCS 680-764690/4
 Matrix: Water
 Analysis Batch: 764690

Client Sample ID: Lab Control Sample
 Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Sulfate	10.0	10.42		mg/L		104	90 - 110
Chloride	10.0	9.954		mg/L		100	90 - 110

Lab Sample ID: LCSD 680-764690/5
 Matrix: Water
 Analysis Batch: 764690

Client Sample ID: Lab Control Sample Dup
 Prep Type: Total/NA

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Sulfate	10.0	10.32		mg/L		103	90 - 110	1	15
Chloride	10.0	9.995		mg/L		100	90 - 110	0	15

Method: 6010D - Metals, Silica (ICP)

Lab Sample ID: MB 680-764734/1-A
 Matrix: Water
 Analysis Batch: 764991

Client Sample ID: Method Blank
 Prep Type: Dissolved

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
SiO2, Silica	500	U	500		ug/L			02/23/23 18:21	1

Lab Sample ID: LCS 680-764734/2-A
 Matrix: Water
 Analysis Batch: 764991

Client Sample ID: Lab Control Sample
 Prep Type: Dissolved

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
SiO2, Silica	21400	21510		ug/L		101	75 - 125

Lab Sample ID: 680-230959-1 MS
 Matrix: Water
 Analysis Batch: 764991

Client Sample ID: AF54572
 Prep Type: Dissolved

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
SiO2, Silica	3110		21400	24290		ug/L		99	75 - 125

Lab Sample ID: 680-230959-1 MSD
 Matrix: Water
 Analysis Batch: 764991

Client Sample ID: AF54572
 Prep Type: Dissolved

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
SiO2, Silica	3110		21400	24330		ug/L		99	75 - 125	0	20

Eurofins Savannah

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

HPLC/IC

Analysis Batch: 764690

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230959-8	AF54589	Total/NA	Water	300.0-1993 R2.1	
MB 680-764690/2	Method Blank	Total/NA	Water	300.0-1993 R2.1	
LCS 680-764690/4	Lab Control Sample	Total/NA	Water	300.0-1993 R2.1	
LCSD 680-764690/5	Lab Control Sample Dup	Total/NA	Water	300.0-1993 R2.1	

Metals

Filtration Batch: 764734

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230959-1	AF54572	Dissolved	Water	FILTRATION	
680-230959-2	AF54600	Dissolved	Water	FILTRATION	
680-230959-3	AF54561	Dissolved	Water	FILTRATION	
680-230959-4	AF54591	Dissolved	Water	FILTRATION	
680-230959-5	AF54565	Dissolved	Water	FILTRATION	
680-230959-6	AF54557	Dissolved	Water	FILTRATION	
680-230959-7	AF54588	Dissolved	Water	FILTRATION	
680-230959-8	AF54589	Dissolved	Water	FILTRATION	
680-230959-9	AF54602	Dissolved	Water	FILTRATION	
MB 680-764734/1-A	Method Blank	Dissolved	Water	FILTRATION	
LCS 680-764734/2-A	Lab Control Sample	Dissolved	Water	FILTRATION	
680-230959-1 MS	AF54572	Dissolved	Water	FILTRATION	
680-230959-1 MSD	AF54572	Dissolved	Water	FILTRATION	

Analysis Batch: 764991

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230959-1	AF54572	Dissolved	Water	6010D	764734
680-230959-2	AF54600	Dissolved	Water	6010D	764734
680-230959-3	AF54561	Dissolved	Water	6010D	764734
680-230959-5	AF54565	Dissolved	Water	6010D	764734
680-230959-8	AF54589	Dissolved	Water	6010D	764734
680-230959-9	AF54602	Dissolved	Water	6010D	764734
MB 680-764734/1-A	Method Blank	Dissolved	Water	6010D	764734
LCS 680-764734/2-A	Lab Control Sample	Dissolved	Water	6010D	764734
680-230959-1 MS	AF54572	Dissolved	Water	6010D	764734
680-230959-1 MSD	AF54572	Dissolved	Water	6010D	764734

Analysis Batch: 764992

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-230959-4	AF54591	Dissolved	Water	6010D	764734
680-230959-6	AF54557	Dissolved	Water	6010D	764734
680-230959-7	AF54588	Dissolved	Water	6010D	764734

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54572

Lab Sample ID: 680-230959-1

Date Collected: 01/24/23 11:46

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		1	764991	BCB	EET SAV	02/23/23 18:24

Client Sample ID: AF54600

Lab Sample ID: 680-230959-2

Date Collected: 01/24/23 10:18

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		1	764991	BCB	EET SAV	02/23/23 18:29

Client Sample ID: AF54561

Lab Sample ID: 680-230959-3

Date Collected: 02/01/23 12:32

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		1	764991	BCB	EET SAV	02/23/23 18:31

Client Sample ID: AF54591

Lab Sample ID: 680-230959-4

Date Collected: 02/07/23 11:40

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		10	764992	BCB	EET SAV	02/26/23 10:42

Client Sample ID: AF54565

Lab Sample ID: 680-230959-5

Date Collected: 02/02/23 11:13

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		1	764991	BCB	EET SAV	02/23/23 18:34

Client Sample ID: AF54557

Lab Sample ID: 680-230959-6

Date Collected: 02/06/23 11:39

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		10	764992	BCB	EET SAV	02/26/23 10:44

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Client Sample ID: AF54588

Lab Sample ID: 680-230959-7

Date Collected: 02/06/23 12:55

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		10	764992	BCB	EET SAV	02/26/23 10:45

Client Sample ID: AF54589

Lab Sample ID: 680-230959-8

Date Collected: 02/06/23 15:32

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Analysis	300.0-1993 R2.1		5	764690	GE	EET SAV	02/23/23 18:32
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		1	764991	BCB	EET SAV	02/23/23 18:42

Client Sample ID: AF54602

Lab Sample ID: 680-230959-9

Date Collected: 01/30/23 11:26

Matrix: Water

Date Received: 02/22/23 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Dissolved	Filtration	FILTRATION			764734	BCB	EET SAV	02/23/23 15:15
Dissolved	Analysis	6010D		1	764991	BCB	EET SAV	02/23/23 18:44

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858



Chain of Custody

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.09.G-01 / 36500 Rerun request for any flagged QC: Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes			
AFS4572	CBW-1	2/24/23	1146	MDC CDM	1	P	G	GW	1	METHOD-6010	X		
600	PM 1	1	1018	1									
561	CAP 5	2/1/23	1232	ZDM BSB									
591	CGYP-6	2/7/23	1140										
565	CAP-9	2/2/23	1113										
557	CAP-1	2/6/23	1139										
588	CGYP-3	1	1255										
589	CGYP-4	1	1532										
602	POZ-4	2/30/23	1126										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJB</i>	35594	2/21/23	1300	<i>JM</i>	22223	1050	7A

Sample Receiving (Internal Use Only)
 TEMP (°C): 1 Initial:
2.12.1
 Correct pH: Yes No
 Preservative Lot#:
 Date/Time/Injt for preservative:

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	<input type="checkbox"/> Ultimate <input type="checkbox"/> % <input type="checkbox"/> A <input type="checkbox"/> S <input type="checkbox"/> BTU <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	<input type="checkbox"/> IPI <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------



Matrix codes GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-230959-1

Login Number: 230959

List Number: 1

Creator: Sims, Robert D

List Source: Eurofins Savannah

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-230959-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-23

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 4/27/2023 5:32:51 PM Revision 1

JOB DESCRIPTION

12915/JM02.09.G01.1/36500

JOB NUMBER

680-232605-1


Eurofins Savannah

Job Notes

The test results in this report meet NELAP requirements for parameters for which accreditation is required or available. Any exceptions to the NELAP requirements are noted. Results pertain only to samples listed in this report. This report may not be reproduced, except in full, without the written approval of the laboratory. Questions should be directed to the person who signed this report.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
4/27/2023 5:32:51 PM
Revision 1

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	9
QC Sample Results	13
QC Association	16
Chronicle	18
Chain of Custody	20
Receipt Checklists	22
Certification Summary	24



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Job ID: 680-232605-1

Laboratory: Eurofins Savannah

Narrative

Job Narrative 680-232605-1

REVISION

The report being provided is a revision of the original report sent on 4/20/2023. The report (revision 1) is being revised to report a less dilute Se result per client request..

Receipt

The samples were received on 3/27/2023 11:00 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 20.1°C

Metals

Method 6010D: preparation batch 160-605942 and analytical batch 160-606620 The MS/MSD/serial dilution/PDS was analyzed on a different job within the prep batch. The sample chosen for batch QC had a different analyte list and QC requirements. As a result, the MS/MSD/serial dilution/PDS for Boron and Calcium was not applied to this job. AF58977 (680-232605-1), AF58978 (680-232605-2) and AF58979 (680-232605-3) Method performance is demonstrated by acceptable LCS recovery.

Method 6010D: preparation batch 160-605942 and analytical batch 160-606620 The following samples were diluted to bring the concentration of target analytes within the calibration range: AF58977 (680-232605-1), AF58978 (680-232605-2) and AF58979 (680-232605-3). Elevated reporting limits (RLs) are provided.

Method 6010D: preparation batch 160-605942 and analytical batch 160-606635 The following samples were diluted to bring the concentration of target analytes within the calibration range: AF58977 (680-232605-1) and AF58978 (680-232605-2). Elevated reporting limits (RLs) are provided.

Method 6010D: preparation batch 160-605942 and analytical batch 160-608950 The following sample was diluted to bring the concentration of target analytes within the calibration range: AF58978 (680-232605-2). Elevated reporting limits (RLs) are provided.

Method 7470A: The matrix spike / matrix spike duplicate (MS/MSD) recoveries for preparation batch 680-770494 and analytical batch 680-770613 were outside control limits for one or more analytes, see QC Sample Results for detail. Sample matrix interference is suspected because the associated laboratory control sample (LCS) recovery is within acceptance limits.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-232605-1	AF58977	Water	03/20/23 10:37	03/27/23 11:00
680-232605-2	AF58978	Water	03/20/23 10:42	03/27/23 11:00
680-232605-3	AF58979	Water	03/20/23 09:28	03/27/23 11:00
680-232605-4	AF58980	Water	03/20/23 12:20	03/27/23 11:00

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Method Summary

Client: South Carolina Public Service Authority
Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Method	Method Description	Protocol	Laboratory
6010D	Metals (ICP)	SW846	EET SL
6020B	Metals (ICP/MS)	SW846	EET SAV
7470A	Mercury (CVAA)	SW846	EET SAV
3005A	Preparation, Total Recoverable or Dissolved Metals	SW846	EET SAV
3010A	Preparation, Total Metals	SW846	EET SL
7470A	Preparation, Mercury	SW846	EET SAV

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

EET SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Qualifiers

Metals

Qualifier	Qualifier Description
F1	MS and/or MSD recovery exceeds control limits.
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
▫	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Client Sample ID: AF58977

Lab Sample ID: 680-232605-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	10800		500		ug/L	10		6010D	Total/NA
Calcium	397000		5000		ug/L	5		6010D	Total/NA
Arsenic	16.8		3.00		ug/L	1		6020B	Total Recoverable
Barium	29.2		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	9.44		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	0.790		0.500		ug/L	1		6020B	Total Recoverable
Cobalt	99.4		0.500		ug/L	1		6020B	Total Recoverable
Lead	36.1		2.50		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF58978

Lab Sample ID: 680-232605-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	11700		500		ug/L	10		6010D	Total/NA
Calcium	418000		5000		ug/L	5		6010D	Total/NA
Arsenic	17.9		3.00		ug/L	1		6020B	Total Recoverable
Barium	30.7		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	9.79		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	0.630		0.500		ug/L	1		6020B	Total Recoverable
Cobalt	105		0.500		ug/L	1		6020B	Total Recoverable
Lead	37.5		2.50		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF58979

Lab Sample ID: 680-232605-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	51.5		50.0		ug/L	1		6010D	Total/NA
Calcium	192000		2000		ug/L	2		6010D	Total/NA
Barium	105		5.00		ug/L	1		6020B	Total Recoverable
Cobalt	0.660		0.500		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF58980

Lab Sample ID: 680-232605-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Cobalt	15.8		0.500		ug/L	1		6020B	Total Recoverable
Dissolved Cobalt	14.1		0.500		ug/L	1		6020B	Dissolved

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Client Sample ID: AF58977

Lab Sample ID: 680-232605-1

Date Collected: 03/20/23 10:37

Matrix: Water

Date Received: 03/27/23 11:00

Method: SW846 6010D - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	10800		500		ug/L		04/03/23 14:08	04/10/23 09:20	10
Calcium	397000		5000		ug/L		04/03/23 14:08	04/07/23 12:58	5
Lithium	50.0	U	50.0		ug/L		04/03/23 14:08	04/05/23 14:20	1
Molybdenum	40.0	U	40.0		ug/L		04/03/23 14:08	04/05/23 14:20	1
Selenium	15.0	U	15.0		ug/L		04/03/23 14:08	04/05/23 14:20	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:13	1
Arsenic	16.8		3.00		ug/L		03/28/23 12:26	03/29/23 14:13	1
Barium	29.2		5.00		ug/L		03/28/23 12:26	03/29/23 14:13	1
Beryllium	9.44		0.500		ug/L		03/28/23 12:26	03/29/23 14:13	1
Cadmium	0.790		0.500		ug/L		03/28/23 12:26	03/29/23 14:13	1
Chromium	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:13	1
Cobalt	99.4		0.500		ug/L		03/28/23 12:26	03/29/23 14:13	1
Lead	36.1		2.50		ug/L		03/28/23 12:26	03/29/23 14:13	1
Thallium	1.00	U	1.00		ug/L		03/28/23 12:26	03/29/23 14:13	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U F1	0.200		ug/L		03/30/23 09:56	03/30/23 15:41	1
Mercury	0.200	U	0.200		ug/L		04/17/23 08:07	04/17/23 17:48	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Client Sample ID: AF58978

Lab Sample ID: 680-232605-2

Date Collected: 03/20/23 10:42

Matrix: Water

Date Received: 03/27/23 11:00

Method: SW846 6010D - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	11700		500		ug/L		04/03/23 14:08	04/10/23 09:25	10
Calcium	418000		5000		ug/L		04/03/23 14:08	04/07/23 13:03	5
Lithium	50.0	U	50.0		ug/L		04/03/23 14:08	04/05/23 14:24	1
Molybdenum	40.0	U	40.0		ug/L		04/03/23 14:08	04/05/23 14:24	1
Selenium	30.0	U	30.0		ug/L		04/03/23 14:08	04/26/23 09:36	2

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:25	1
Arsenic	17.9		3.00		ug/L		03/28/23 12:26	03/29/23 14:25	1
Barium	30.7		5.00		ug/L		03/28/23 12:26	03/29/23 14:25	1
Beryllium	9.79		0.500		ug/L		03/28/23 12:26	03/29/23 14:25	1
Cadmium	0.630		0.500		ug/L		03/28/23 12:26	03/29/23 14:25	1
Chromium	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:25	1
Cobalt	105		0.500		ug/L		03/28/23 12:26	03/29/23 14:25	1
Lead	37.5		2.50		ug/L		03/28/23 12:26	03/29/23 14:25	1
Thallium	1.00	U	1.00		ug/L		03/28/23 12:26	03/29/23 14:25	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		03/30/23 09:56	03/30/23 15:46	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Client Sample ID: AF58979

Lab Sample ID: 680-232605-3

Date Collected: 03/20/23 09:28

Matrix: Water

Date Received: 03/27/23 11:00

Method: SW846 6010D - Metals (ICP)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	51.5		50.0		ug/L		04/03/23 14:08	04/05/23 14:29	1
Calcium	192000		2000		ug/L		04/03/23 14:08	04/07/23 13:07	2
Lithium	50.0	U	50.0		ug/L		04/03/23 14:08	04/05/23 14:29	1
Molybdenum	40.0	U	40.0		ug/L		04/03/23 14:08	04/05/23 14:29	1
Selenium	15.0	U	15.0		ug/L		04/03/23 14:08	04/05/23 14:29	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:29	1
Arsenic	3.00	U	3.00		ug/L		03/28/23 12:26	03/29/23 14:29	1
Barium	105		5.00		ug/L		03/28/23 12:26	03/29/23 14:29	1
Beryllium	0.500	U	0.500		ug/L		03/28/23 12:26	03/29/23 14:29	1
Cadmium	0.500	U	0.500		ug/L		03/28/23 12:26	03/29/23 14:29	1
Chromium	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:29	1
Cobalt	0.660		0.500		ug/L		03/28/23 12:26	03/29/23 14:29	1
Lead	2.50	U	2.50		ug/L		03/28/23 12:26	03/29/23 14:29	1
Thallium	1.00	U	1.00		ug/L		03/28/23 12:26	03/29/23 14:29	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		03/30/23 09:56	03/30/23 15:47	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Client Sample ID: AF58980

Lab Sample ID: 680-232605-4

Date Collected: 03/20/23 12:20

Matrix: Water

Date Received: 03/27/23 11:00

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Cobalt	15.8		0.500		ug/L		03/28/23 12:26	03/29/23 14:33	1

Method: SW846 6020B - Metals (ICP/MS) - Dissolved

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Dissolved Cobalt	14.1		0.500		ug/L		03/28/23 12:26	03/29/23 14:37	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Method: 6010D - Metals (ICP)

Lab Sample ID: MB 160-605942/1-A
Matrix: Water
Analysis Batch: 606308

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 605942

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Boron	50.0	U	50.0		ug/L		04/03/23 14:08	04/05/23 13:01	1
Calcium	1000	U	1000		ug/L		04/03/23 14:08	04/05/23 13:01	1
Lithium	50.0	U	50.0		ug/L		04/03/23 14:08	04/05/23 13:01	1
Molybdenum	40.0	U	40.0		ug/L		04/03/23 14:08	04/05/23 13:01	1
Selenium	15.0	U	15.0		ug/L		04/03/23 14:08	04/05/23 13:01	1

Lab Sample ID: LCS 160-605942/2-A
Matrix: Water
Analysis Batch: 606308

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 605942

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Calcium	10000	10630		ug/L	106	80 - 120	
Lithium	100	104.7		ug/L	105	80 - 120	
Molybdenum	495	512.3		ug/L	103	80 - 120	
Selenium	500	462.0		ug/L	92	80 - 120	

Method: 6020B - Metals (ICP/MS)

Lab Sample ID: MB 680-770078/1-A
Matrix: Water
Analysis Batch: 770464

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 770078

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Antimony	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:04	1
Arsenic	3.00	U	3.00		ug/L		03/28/23 12:26	03/29/23 14:04	1
Barium	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:04	1
Beryllium	0.500	U	0.500		ug/L		03/28/23 12:26	03/29/23 14:04	1
Cadmium	0.500	U	0.500		ug/L		03/28/23 12:26	03/29/23 14:04	1
Chromium	5.00	U	5.00		ug/L		03/28/23 12:26	03/29/23 14:04	1
Lead	2.50	U	2.50		ug/L		03/28/23 12:26	03/29/23 14:04	1
Thallium	1.00	U	1.00		ug/L		03/28/23 12:26	03/29/23 14:04	1
Cobalt	0.500	U	0.500		ug/L		03/28/23 12:26	03/29/23 14:04	1
Dissolved Cobalt	0.500	U	0.500		ug/L		03/28/23 12:26	03/29/23 14:04	1

Lab Sample ID: LCS 680-770078/2-A
Matrix: Water
Analysis Batch: 770464

Client Sample ID: Lab Control Sample
Prep Type: Total Recoverable
Prep Batch: 770078

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Arsenic	100	103.9		ug/L	104	80 - 120	
Barium	100	98.65		ug/L	99	80 - 120	
Beryllium	50.0	48.85		ug/L	98	80 - 120	
Cadmium	50.0	49.84		ug/L	100	80 - 120	
Chromium	100	106.5		ug/L	106	80 - 120	
Lead	505	505.3		ug/L	100	80 - 120	
Thallium	50.0	48.29		ug/L	97	80 - 120	
Cobalt	50.0	52.03		ug/L	104	80 - 120	

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Method: 6020B - Metals (ICP/MS) (Continued)

Lab Sample ID: LCS 680-770078/2-A
 Matrix: Water
 Analysis Batch: 770464

Client Sample ID: Lab Control Sample
 Prep Type: Total Recoverable
 Prep Batch: 770078

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Dissolved Cobalt	50.0	52.03		ug/L		104	80 - 120

Lab Sample ID: 680-232605-1 MS
 Matrix: Water
 Analysis Batch: 770464

Client Sample ID: AF58977
 Prep Type: Total Recoverable
 Prep Batch: 770078

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits
Antimony	5.00	U	50.0	51.90		ug/L		103	75 - 125
Arsenic	16.8		100	114.0		ug/L		97	75 - 125
Barium	29.2		100	124.6		ug/L		95	75 - 125
Beryllium	9.44		50.0	58.23		ug/L		98	75 - 125
Cadmium	0.790		50.0	50.79		ug/L		100	75 - 125
Chromium	5.00	U	100	104.3		ug/L		101	75 - 125
Lead	36.1		505	537.1		ug/L		99	75 - 125
Thallium	1.00	U	50.0	50.69		ug/L		101	75 - 125
Cobalt	99.4		50.0	146.3		ug/L		94	75 - 125
Dissolved Cobalt	99.4		50.0	146.3		ug/L		94	75 - 125

Lab Sample ID: 680-232605-1 MSD
 Matrix: Water
 Analysis Batch: 770464

Client Sample ID: AF58977
 Prep Type: Total Recoverable
 Prep Batch: 770078

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit
Antimony	5.00	U	50.0	55.56		ug/L		110	75 - 125	7	20
Arsenic	16.8		100	124.3		ug/L		108	75 - 125	9	20
Barium	29.2		100	130.2		ug/L		101	75 - 125	4	20
Beryllium	9.44		50.0	62.44		ug/L		106	75 - 125	7	20
Cadmium	0.790		50.0	54.26		ug/L		107	75 - 125	7	20
Chromium	5.00	U	100	112.1		ug/L		109	75 - 125	7	20
Lead	36.1		505	573.9		ug/L		107	75 - 125	7	20
Thallium	1.00	U	50.0	53.65		ug/L		107	75 - 125	6	20
Cobalt	99.4		50.0	157.1		ug/L		116	75 - 125	7	20
Dissolved Cobalt	99.4		50.0	157.1		ug/L		116	75 - 125	7	20

Method: 7470A - Mercury (CVAA)

Lab Sample ID: MB 680-770494/1-A
 Matrix: Water
 Analysis Batch: 770613

Client Sample ID: Method Blank
 Prep Type: Total/NA
 Prep Batch: 770494

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		03/30/23 09:56	03/30/23 15:38	1

Lab Sample ID: LCS 680-770494/2-A
 Matrix: Water
 Analysis Batch: 770613

Client Sample ID: Lab Control Sample
 Prep Type: Total/NA
 Prep Batch: 770494

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Mercury	2.50	2.360		ug/L		94	80 - 120

Eurofins Savannah

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Method: 7470A - Mercury (CVAA) (Continued)

Lab Sample ID: 680-232605-1 MS										Client Sample ID: AF58977		
Matrix: Water										Prep Type: Total/NA		
Analysis Batch: 770613										Prep Batch: 770494		
Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits			
Mercury	0.200	U F1	1.00	0.2704	F1	ug/L		27	80 - 120			
Lab Sample ID: 680-232605-1 MSD										Client Sample ID: AF58977		
Matrix: Water										Prep Type: Total/NA		
Analysis Batch: 770613										Prep Batch: 770494		
Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit	
Mercury	0.200	U F1	1.00	0.2524	F1	ug/L		25	80 - 120	7	20	
Lab Sample ID: MB 680-773632/1-A										Client Sample ID: Method Blank		
Matrix: Water										Prep Type: Total/NA		
Analysis Batch: 774039										Prep Batch: 773632		
Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil	Fac		
Mercury	0.200	U	0.200		ug/L		04/17/23 08:07	04/17/23 17:37		1		
Lab Sample ID: LCS 680-773632/2-A										Client Sample ID: Lab Control Sample		
Matrix: Water										Prep Type: Total/NA		
Analysis Batch: 774039										Prep Batch: 773632		
Analyte			Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits			
Mercury			2.50	2.485		ug/L		99	80 - 120			

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Metals

Prep Batch: 605942

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total/NA	Water	3010A	
680-232605-2	AF58978	Total/NA	Water	3010A	
680-232605-3	AF58979	Total/NA	Water	3010A	
MB 160-605942/1-A	Method Blank	Total/NA	Water	3010A	
LCS 160-605942/2-A	Lab Control Sample	Total/NA	Water	3010A	

Analysis Batch: 606308

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total/NA	Water	6010D	605942
680-232605-2	AF58978	Total/NA	Water	6010D	605942
680-232605-3	AF58979	Total/NA	Water	6010D	605942
MB 160-605942/1-A	Method Blank	Total/NA	Water	6010D	605942
LCS 160-605942/2-A	Lab Control Sample	Total/NA	Water	6010D	605942

Analysis Batch: 606620

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total/NA	Water	6010D	605942
680-232605-2	AF58978	Total/NA	Water	6010D	605942
680-232605-3	AF58979	Total/NA	Water	6010D	605942

Analysis Batch: 606635

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total/NA	Water	6010D	605942
680-232605-2	AF58978	Total/NA	Water	6010D	605942

Analysis Batch: 608950

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-2	AF58978	Total/NA	Water	6010D	605942

Prep Batch: 770078

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total Recoverable	Water	3005A	
680-232605-2	AF58978	Total Recoverable	Water	3005A	
680-232605-3	AF58979	Total Recoverable	Water	3005A	
680-232605-4	AF58980	Dissolved	Water	3005A	
680-232605-4	AF58980	Total Recoverable	Water	3005A	
MB 680-770078/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-770078/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
680-232605-1 MS	AF58977	Total Recoverable	Water	3005A	
680-232605-1 MSD	AF58977	Total Recoverable	Water	3005A	

Analysis Batch: 770464

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total Recoverable	Water	6020B	770078
680-232605-2	AF58978	Total Recoverable	Water	6020B	770078
680-232605-3	AF58979	Total Recoverable	Water	6020B	770078
680-232605-4	AF58980	Dissolved	Water	6020B	770078
680-232605-4	AF58980	Total Recoverable	Water	6020B	770078
MB 680-770078/1-A	Method Blank	Total Recoverable	Water	6020B	770078
LCS 680-770078/2-A	Lab Control Sample	Total Recoverable	Water	6020B	770078
680-232605-1 MS	AF58977	Total Recoverable	Water	6020B	770078

Eurofins Savannah

QC Association Summary

Client: South Carolina Public Service Authority
Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Metals (Continued)

Analysis Batch: 770464 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1 MSD	AF58977	Total Recoverable	Water	6020B	770078

Prep Batch: 770494

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total/NA	Water	7470A	
680-232605-2	AF58978	Total/NA	Water	7470A	
680-232605-3	AF58979	Total/NA	Water	7470A	
MB 680-770494/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-770494/2-A	Lab Control Sample	Total/NA	Water	7470A	
680-232605-1 MS	AF58977	Total/NA	Water	7470A	
680-232605-1 MSD	AF58977	Total/NA	Water	7470A	

Analysis Batch: 770613

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total/NA	Water	7470A	770494
680-232605-2	AF58978	Total/NA	Water	7470A	770494
680-232605-3	AF58979	Total/NA	Water	7470A	770494
MB 680-770494/1-A	Method Blank	Total/NA	Water	7470A	770494
LCS 680-770494/2-A	Lab Control Sample	Total/NA	Water	7470A	770494
680-232605-1 MS	AF58977	Total/NA	Water	7470A	770494
680-232605-1 MSD	AF58977	Total/NA	Water	7470A	770494

Prep Batch: 773632

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total/NA	Water	7470A	
MB 680-773632/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-773632/2-A	Lab Control Sample	Total/NA	Water	7470A	

Analysis Batch: 774039

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-232605-1	AF58977	Total/NA	Water	7470A	773632
MB 680-773632/1-A	Method Blank	Total/NA	Water	7470A	773632
LCS 680-773632/2-A	Lab Control Sample	Total/NA	Water	7470A	773632

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Client Sample ID: AF58977

Lab Sample ID: 680-232605-1

Date Collected: 03/20/23 10:37

Matrix: Water

Date Received: 03/27/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		1	606308	LKP	EET SL	04/05/23 14:20
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		5	606620	LKP	EET SL	04/07/23 12:58
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		10	606635	CGB	EET SL	04/10/23 09:20
Total Recoverable	Prep	3005A			770078	RR	EET SAV	03/28/23 12:26
Total Recoverable	Analysis	6020B		1	770464	BWR	EET SAV	03/29/23 14:13
Total/NA	Prep	7470A			770494	JKL	EET SAV	03/30/23 09:56
Total/NA	Analysis	7470A		1	770613	JKL	EET SAV	03/30/23 15:41
Total/NA	Prep	7470A			773632	JKL	EET SAV	04/17/23 08:07
Total/NA	Analysis	7470A		1	774039	JKL	EET SAV	04/17/23 17:48

Client Sample ID: AF58978

Lab Sample ID: 680-232605-2

Date Collected: 03/20/23 10:42

Matrix: Water

Date Received: 03/27/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		1	606308	LKP	EET SL	04/05/23 14:24
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		5	606620	LKP	EET SL	04/07/23 13:03
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		10	606635	CGB	EET SL	04/10/23 09:25
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		2	608950	LKP	EET SL	04/26/23 09:36
Total Recoverable	Prep	3005A			770078	RR	EET SAV	03/28/23 12:26
Total Recoverable	Analysis	6020B		1	770464	BWR	EET SAV	03/29/23 14:25
Total/NA	Prep	7470A			770494	JKL	EET SAV	03/30/23 09:56
Total/NA	Analysis	7470A		1	770613	JKL	EET SAV	03/30/23 15:46

Client Sample ID: AF58979

Lab Sample ID: 680-232605-3

Date Collected: 03/20/23 09:28

Matrix: Water

Date Received: 03/27/23 11:00

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		1	606308	LKP	EET SL	04/05/23 14:29
Total/NA	Prep	3010A			605942	CGB	EET SL	04/03/23 14:08
Total/NA	Analysis	6010D		2	606620	LKP	EET SL	04/07/23 13:07
Total Recoverable	Prep	3005A			770078	RR	EET SAV	03/28/23 12:26
Total Recoverable	Analysis	6020B		1	770464	BWR	EET SAV	03/29/23 14:29
Total/NA	Prep	7470A			770494	JKL	EET SAV	03/30/23 09:56
Total/NA	Analysis	7470A		1	770613	JKL	EET SAV	03/30/23 15:47

Eurofins Savannah

Lab Chronicle

Client: South Carolina Public Service Authority
Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Client Sample ID: AF58980

Lab Sample ID: 680-232605-4

Date Collected: 03/20/23 12:20

Matrix: Water

Date Received: 03/27/23 11:00


<u>Prep Type</u>	<u>Batch Type</u>	<u>Batch Method</u>	<u>Run</u>	<u>Dilution Factor</u>	<u>Batch Number</u>	<u>Analyst</u>	<u>Lab</u>	<u>Prepared or Analyzed</u>
Dissolved	Prep	3005A			770078	RR	EET SAV	03/28/23 12:26
Dissolved	Analysis	6020B		1	770464	BWR	EET SAV	03/29/23 14:37
Total Recoverable	Prep	3005A			770078	RR	EET SAV	03/28/23 12:26
Total Recoverable	Analysis	6020B		1	770464	BWR	EET SAV	03/29/23 14:33

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

EET SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566






Santee Cooper
One Riverwood Drive
Monks Corner, SC 29461
Phone (843)761-8000 Ext. 5148
Fax (843)761-4175

Chain of Custody

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.09.601.1 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

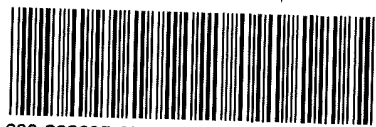Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	TOTAL METALS -SEE BELOW	Hg	CO	DISSOLVED CO
AF58977	CGYP 7	3/20/23	1037	ZM BB	2	P	G	GW	2	Hg-7471 B, L, Mo - 6010	X	X		
AF58978	CGYP-7D		1042							ALL OTHERS 6020				
AF58979	POZ-3		0928							-PLEASE SEND BORON TO				
AF58980	CCMAP-8		1220		2					ST LOUIS (ONE BOTTLE CAN BE SENT.)			X	X
										-PLEASE SEE SHEET FOR RLS				
 680-232605 Chain of Custody														
										PLEASE RETURN COOLER.				

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sj Brown</i>	35594	3/27/23	8:10	<i>Will Hodge</i>	COURIER	3/27/23	8:10
<i>Will Hodge</i>	Courier	3-27-23	11:00	<i>[Signature]</i>		3/27/23	11:00

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: 20.1/20.1 24/3.4
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input checked="" type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input checked="" type="checkbox"/> Se <input checked="" type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input checked="" type="checkbox"/> B <input checked="" type="checkbox"/> Li <input type="checkbox"/> Sr <input checked="" type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input checked="" type="checkbox"/> Be <input type="checkbox"/> Mn <input checked="" type="checkbox"/> Tl <input checked="" type="checkbox"/> Ca <input checked="" type="checkbox"/> Mo <input type="checkbox"/> V <input checked="" type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input checked="" type="checkbox"/> Co <input type="checkbox"/> Ni <input checked="" type="checkbox"/> Hg <input checked="" type="checkbox"/> Cr <input checked="" type="checkbox"/> Pb <input type="checkbox"/> CrVI			Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--	--	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

Chain of Custody Record



Environment Testing



Client Information (Sub Contract Lab)		Sampler: Lab PM Lanier, Jerry A	COC No: 680-732222.1																																								
Client Contact: Shipping/Receiving		Phone: Jerry.Lanier@et.eurofins.com	Page: Page 1 of 1																																								
Company: TestAmerica Laboratories, Inc.		State of Origin: South Carolina	Job #: 680-232605-1																																								
Address: 13715 Rider Trail North, City: Earth City State, Zip: MO, 63045 Phone: 314-298-8566(Tel) 314-298-8757(Fax) Email:		Accreditations Required (See note): NELAP - Florida, State - South Carolina, State Program ...	Preservation Codes: A - HCL B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Amchlor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other: M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2SO3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCAA W - pH 4-5 Y - Trizma Z - other (specify)																																								
Due Date Requested: 4/4/2023		Analysis Requested																																									
TAT Requested (days):		<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>Sample ID</th> <th>Sample Date</th> <th>Sample Time</th> <th>Sample Type (C=Comp, G=grab)</th> <th>Matrix (W=water, S=solid, O=wastefoil)</th> <th>Preservation Code</th> <th>Field Filtered Sample (Yes or No)</th> <th>Perform MS/MSD (Yes or No)</th> <th>Total Number of Containers</th> <th>Special Instructions/Note:</th> </tr> </thead> <tbody> <tr> <td>AF-58977 (680-232605-1)</td> <td>3/20/23</td> <td>10:37 Eastern</td> <td>Water</td> <td>Water</td> <td></td> <td>X</td> <td>X</td> <td>1</td> <td></td> </tr> <tr> <td>AF-58978 (680-232605-2)</td> <td>3/20/23</td> <td>10:42 Eastern</td> <td>Water</td> <td>Water</td> <td></td> <td>X</td> <td>X</td> <td>1</td> <td></td> </tr> <tr> <td>AF-58979 (680-232605-3)</td> <td>3/20/23</td> <td>09:28 Eastern</td> <td>Water</td> <td>Water</td> <td></td> <td>X</td> <td>X</td> <td>1</td> <td></td> </tr> </tbody> </table>		Sample ID	Sample Date	Sample Time	Sample Type (C=Comp, G=grab)	Matrix (W=water, S=solid, O=wastefoil)	Preservation Code	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	Total Number of Containers	Special Instructions/Note:	AF-58977 (680-232605-1)	3/20/23	10:37 Eastern	Water	Water		X	X	1		AF-58978 (680-232605-2)	3/20/23	10:42 Eastern	Water	Water		X	X	1		AF-58979 (680-232605-3)	3/20/23	09:28 Eastern	Water	Water		X	X	1	
Sample ID	Sample Date			Sample Time	Sample Type (C=Comp, G=grab)	Matrix (W=water, S=solid, O=wastefoil)	Preservation Code	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	Total Number of Containers	Special Instructions/Note:																																
AF-58977 (680-232605-1)	3/20/23			10:37 Eastern	Water	Water		X	X	1																																	
AF-58978 (680-232605-2)	3/20/23			10:42 Eastern	Water	Water		X	X	1																																	
AF-58979 (680-232605-3)	3/20/23	09:28 Eastern	Water	Water		X	X	1																																			
Project #: 68008190																																											
Site: SSOW#																																											
<p>Sample Identification - Client ID (Lab ID)</p> <p>Note: Since laboratory accreditations are subject to change, Eurofins Environment Testing Southeast, LLC places the ownership of method, analyte & accreditation compliance upon our subcontract laboratories. This sample shipment is forwarded under chain-of-custody. If the laboratory does not currently maintain accreditation in the State of Origin listed above, the samples must be shipped back to the Eurofins Environment Testing Southeast, LLC laboratory or other instructions will be provided. Any changes to accreditation status should be brought to Eurofins Environment Testing Southeast, LLC attention immediately. If all requested accreditations are current to date, return the signed Chain of Custody attesting to said compliance to Eurofins Environment Testing Southeast, LLC.</p>																																											
<p>Possible Hazard Identification</p> <p>Unconfirmed</p> <p>Deliverable Requested: I, II, III, IV, Other (specify) Primary Deliverable Rank: 1</p>		<p>Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)</p> <p><input type="checkbox"/> Return To Client <input type="checkbox"/> Disposal By Lab <input type="checkbox"/> Archive For _____ Months</p> <p>Special Instructions/QC Requirements:</p>																																									
Empty Kit Relinquished by:		Method of Shipment																																									
Date/Time		Date/Time:																																									
Relinquished by:		Received by: FED EX																																									
Date/Time		Date/Time: MAR 31 2023 0910																																									
Relinquished by:		Received by: <i>Sara Woodington</i>																																									
Date/Time		Date/Time:																																									
Custody Seals Intact: Δ Yes Δ No		Cooler Temperature(s) °C and Other Remarks																																									



Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-232605-1

Login Number: 232605

List Number: 1

Creator: Johnson, Corey M

List Source: Eurofins Savannah

Question	Answer	Comment
Radioactivity wasn't checked or is </= background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-232605-1

Login Number: 232605

List Number: 2

Creator: Worthington, Sierra M

List Source: Eurofins St. Louis

List Creation: 03/31/23 01:07 PM

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <math><6\text{mm}</math> (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
 Project/Site: 12915/JM02.09.G01.1/36500

Job ID: 680-232605-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-23

Laboratory: Eurofins St. Louis

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Alaska (UST)	State	20-001	05-06-25
ANAB	Dept. of Defense ELAP	L2305	04-06-25
ANAB	Dept. of Energy	L2305.01	04-06-25
ANAB	ISO/IEC 17025	L2305	04-06-25
Arizona	State	AZ0813	12-08-23
California	Los Angeles County Sanitation Districts	10259	06-30-22 *
California	State	2886	06-30-23
Florida	NELAP	E87689	06-30-23
HI - RadChem Recognition	State	n/a	06-30-23
Illinois	NELAP	200023	11-30-23
Iowa	State	373	12-01-24
Kansas	NELAP	E-10236	10-31-23
Kentucky (DW)	State	KY90125	12-31-23
Kentucky (WW)	State	KY90125 (Permit KY0004049)	12-31-23
Louisiana (All)	NELAP	04080	06-30-23
Louisiana (DW)	State	LA011	12-31-23
Maryland	State	310	09-30-23
MI - RadChem Recognition	State	9005	06-30-23
Missouri	State	780	06-30-25
Nevada	State	MO000542020-1	07-31-23
New Jersey	NELAP	MO002	06-30-23
New York	NELAP	11616	03-31-24
North Carolina (DW)	State	29700	07-31-23
North Dakota	State	R-207	06-30-23
Oklahoma	NELAP	9997	08-31-23
Oregon	NELAP	4157	09-01-23
Pennsylvania	NELAP	68-00540	02-28-24
South Carolina	State	85002001	06-30-23
Texas	NELAP	T104704193	07-31-23
US Fish & Wildlife	US Federal Programs	058448	07-31-23
USDA	US Federal Programs	P330-17-00028	06-11-23
Utah	NELAP	MO000542021-14	07-31-23
Virginia	NELAP	10310	06-14-23
Washington	State	C592	08-30-23
West Virginia DEP	State	381	10-31-23

* Accreditation/Certification renewal pending - accreditation/certification considered valid.

November 03, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 641316

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on October 13, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Jordan Melton for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 641316 GEL Work Order: 641316

The Qualifiers in this report are defined as follows:


- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80265 Project: SOOP00119
Sample ID: 641316001 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 11:23
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		2.93	+/-1.10	1.39	3.00	pCi/L		JE1	10/24/23	0847	2509217		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.58	+/-1.16			pCi/L		NXL1	11/03/23	1610	2515880		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.655	+/-0.389	0.448	1.00	pCi/L		LXP1	11/02/23	0756	2509249		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			86.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF80266	Project: SOOP00119
Sample ID: 641316002	Client ID: SOOP001
Matrix: GW	
Collect Date: 10-OCT-23 11:28	
Receive Date: 13-OCT-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		3.98	+/-1.26	1.56	3.00	pCi/L		JE1	10/24/23	0847	2509217		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		4.05	+/-1.27			pCi/L		NXL1	11/03/23	1610	2515880		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.0767	+/-0.184	0.368	1.00	pCi/L		LXP1	11/02/23	0756	2509249		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			84.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80267 Project: SOOP00119
Sample ID: 641316003 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 10:15
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	-1.54	+/-1.06	2.22	3.00	pCi/L		JE1	10/24/23	0847	2509217	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.205	+/-1.13			pCi/L		NXL1	11/03/23	1610	2515880	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.205	+/-0.403	0.739	1.00	pCi/L		LXP1	11/02/23	0831	2509249	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			81.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: November 3, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 641316

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2509217										
QC1205547740	641316001	DUP									
Radium-228				2.93	3.95	pCi/L	29.7	(0% - 100%)	JE1	10/24/23	08:47
			Uncertainty	+/-1.10	+/-1.15						
QC1205547741	LCS										
Radium-228				78.3	71.6	pCi/L	91.4	(75%-125%)		10/24/23	08:48
			Uncertainty		+/-3.85						
QC1205547739	MB										
Radium-228			U		0.166	pCi/L				10/24/23	08:47
			Uncertainty		+/-0.981						
Rad Ra-226											
Batch	2509249										
QC1205547810	641316001	DUP									
Radium-226				0.655	1.02	pCi/L	43.9	(0% - 100%)	LXP1	11/02/23	08:31
			Uncertainty	+/-0.389	+/-0.511						
QC1205547812	LCS										
Radium-226				26.9	23.3	pCi/L	86.5	(75%-125%)		11/02/23	08:31
			Uncertainty		+/-2.01						
QC1205547809	MB										
Radium-226			U		0.176	pCi/L				11/02/23	08:31
			Uncertainty		+/-0.345						
QC1205547811	641316001	MS									
Radium-226				134	0.655	pCi/L	78.5	(75%-125%)		11/02/23	08:31
			Uncertainty	+/-0.389	+/-10.4						

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 641316

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 641316**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2509217

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
641316001	AF80265
641316002	AF80266
641316003	AF80267
1205547739	Method Blank (MB)
1205547740	641316001(AF80265) Sample Duplicate (DUP)
1205547741	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2509249

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
641316001	AF80265
641316002	AF80266
641316003	AF80267
1205547809	Method Blank (MB)
1205547810	641316001(AF80265) Sample Duplicate (DUP)
1205547811	641316001(AF80265) Matrix Spike (MS)
1205547812	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where

applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

The matrix spike, 1205547811 (AF80265MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

11/13/23 -RAD

Contract Lab Info: GEL

Contract Lab Due Date (Lab Only): 11 / 20 / 23

Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody

641316
641317



Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LINDA.WILLIAMS@santecooper.com

125915 / JMO2.09.GØ1.1 / 36500

No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Rad 226/228	TOTAL RAD CALC	F, Cl, SO4
AF 80265	CGYP-7	10/10/23	1123	ZM BB	3	P	G	GW	2 1		2	X	1
AF 80266	CGYP-7 DUP		1128										
AF 80267	POZ-3		1515										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	36851	10/13/23	0944	<i>[Signature]</i>	GEL	10/13/23	0944
<i>[Signature]</i>	GEL	10/13/23	1610	<i>[Signature]</i>	GEL	10/13/23	1610

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb,Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOCP</u>		SDG/AR/COC/Work Order: <u>641316 / 641317</u>		
Received By: <u>QG</u>		Date Received: <u>10/18/23</u>		
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other		
		<u>n/a</u>		
Suspected Hazard Information		Yes	No	
		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.		
A) Shipped as a DOT Hazardous?		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___		
B) Did the client designate the samples to be received as radioactive?		COC notation or radioactive stickers on containers equal client designation		
C) Did the RSO classify the samples as radioactive?		Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> <u>SPM</u> / mR/hr Classified as: Rad 1 Rad 2 Rad 3		
D) Did the client designate samples are hazardous?		COC notation or hazard labels on containers equal client designation		
E) Did the RSO identify possible hazards?		If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:		
Sample Receipt Criteria		Yes	NA	
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Circle Applicable: Seals broken Damaged container Leaking container Other (describe)		
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Circle Applicable: Client contacted and provided COC COC created upon receipt		
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Preservation Method: Wet Ice Ice Packs Dry Ice None Other: *all temperatures are recorded in Celsius TEMP: <u>3°C</u>		
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Temperature Device Serial #: <u>IR1-23</u> Secondary Temperature Device Serial # (If Applicable):		
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Circle Applicable: Seals broken Damaged container Leaking container Other (describe)		
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Sample ID's and Containers Affected: If Preservation added, Lot#:		
7	Do any samples require Volatile Analysis?	If Yes, are Bincoros or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)		
		Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)		
		Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:		
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		ID's and tests affected:		
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		ID's and containers affected:		
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)		
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Circle Applicable: No container count on COC Other (describe)		
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
		Circle Applicable: Not relinquished Other (describe)		
Comments (Use Continuation Form if needed):				

JR

PM (or PMA) review: Initials glw Date 10/16/23 Page 1 of 1

List of current GEL Certifications as of 03 November 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-04
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2023-152
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122023-38
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



June 26, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 626523

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on June 16, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Jessica Ward for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 626523 GEL Work Order: 626523

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- J Value is estimated
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66432 Project: SOOP00119
Sample ID: 626523001 Client ID: SOOP001
Matrix: GW
Collect Date: 12-JUN-23 09:11
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.33	0.330	1.00	mg/L		1	RM3	06/20/23	2305	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66433 Project: SOOP00119
Sample ID: 626523002 Client ID: SOOP001
Matrix: GW
Collect Date: 12-JUN-23 09:16
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.30	0.330	1.00	mg/L		1	RM3	06/22/23	1543	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66434 Project: SOOP00119
Sample ID: 626523003 Client ID: SOOP001
Matrix: GW
Collect Date: 12-JUN-23 10:14
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		1.06	0.330	1.00	mg/L		1	RM3	06/21/23	0023	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66435 Project: SOOP00119
Sample ID: 626523004 Client ID: SOOP001
Matrix: GW
Collect Date: 12-JUN-23 11:06
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.98	0.330	1.00	mg/L		1	RM3	06/21/23	0042	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66436 Project: SOOP00119
Sample ID: 626523005 Client ID: SOOP001
Matrix: GW
Collect Date: 12-JUN-23 12:12
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.888	0.330	1.00	mg/L		1	RM3	06/21/23	0124	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66437 Project: SOOP00119
Sample ID: 626523006 Client ID: SOOP001
Matrix: GW
Collect Date: 12-JUN-23 13:39
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		1.69	0.330	1.00	mg/L		1	RM3	06/21/23	0143	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66438 Project: SOOP00119
Sample ID: 626523007 Client ID: SOOP001
Matrix: GW
Collect Date: 14-JUN-23 08:55
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.556	0.330	1.00	mg/L		1	RM3	06/21/23	0202	2446751	1
Nutrient Analysis												
EPA 353.2 Nitrogen, Nitrate/Nitrite "As Received"												
Nitrogen, Nitrate/Nitrite	U	ND	0.0350	0.100	mg/L		5	AXH3	06/19/23	0613	2444686	2

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		
2	EPA 353.2 Low Level		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66442 Project: SOOP00119
Sample ID: 626523008 Client ID: SOOP001
Matrix: GW
Collect Date: 14-JUN-23 10:09
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.09	0.330	1.00	mg/L		1	RM3	06/21/23	0222	2446751	1
Nutrient Analysis												
EPA 353.2 Nitrogen, Nitrate/Nitrite "As Received"												
Nitrogen, Nitrate/Nitrite	U	ND	0.0350	0.100	mg/L		5	AXH3	06/19/23	0619	2444686	2

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		
2	EPA 353.2 Low Level		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: June 26, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 626523

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch	2446751										
QC1205438111	626520001	DUP									
Total Organic Carbon Average		2.70		2.78	mg/L	3.25	^	(+/-1.00)	RM3	06/20/23	20:46
QC1205438113	626523002	DUP									
Total Organic Carbon Average		2.30		2.29	mg/L	0.393	^	(+/-1.00)		06/22/23	16:03
QC1205438110	LCS										
Total Organic Carbon Average	10.0			9.70	mg/L			97 (80%-120%)		06/20/23	17:01
QC1205438109	MB										
Total Organic Carbon Average			U	ND	mg/L					06/20/23	16:52
QC1205438112	626520001	PS									
Total Organic Carbon Average	10.0	2.70		12.8	mg/L			101 (65%-120%)		06/20/23	21:05
QC1205438114	626523002	PS									
Total Organic Carbon Average	10.0	2.30		12.5	mg/L			102 (65%-120%)		06/22/23	16:22

Nutrient Analysis											
Batch	2444686										
QC1205434328	626075001	DUP									
Nitrogen, Nitrate/Nitrite	J	0.0197	J	0.0193	mg/L	2.05	^	(+/-0.0200)	AXH3	06/19/23	06:06
QC1205434327	LCS										
Nitrogen, Nitrate/Nitrite	1.00			1.04	mg/L			104 (90%-110%)		06/19/23	06:03
QC1205434326	MB										
Nitrogen, Nitrate/Nitrite			U	ND	mg/L					06/19/23	06:02

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 626523

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Nutrient Analysis											
Batch	2444686										
	QC1205434329 626075001 PS										
Nitrogen, Nitrate/Nitrite	1.00	J	0.0197	1.07	mg/L		105	(90%-110%)	AXH3	06/19/23	06:07

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected
- Z Paint Filter Test--Particulates passed through the filter, however no free liquids were observed.
- d 5-day BOD--The 2:1 depletion requirement was not met for this sample
- ^ RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.
- N/A RPD or %Recovery limits do not apply.
- ND Analyte concentration is not detected above the detection limit
- NJ Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- E General Chemistry--Concentration of the target analyte exceeds the instrument calibration range
- Q One or more quality control criteria have not been met. Refer to the applicable narrative or DER.
- NI See case narrative
- R Per section 9.3.4.1 of Method 1664 Revision B, due to matrix spike recovery issues, this result may not be reported or used for regulatory compliance purposes.
- B The target analyte was detected in the associated blank.
- e 5-day BOD--Test replicates show more than 30% difference between high and low values. The data is qualified per the method and can be used for reporting purposes
- J See case narrative for an explanation

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**General Chemistry
Technical Case Narrative
Santee Cooper
SDG #: 626523**

Product: Carbon, Total Organic

Analytical Method: SM 5310 B

Analytical Procedure: GL-GC-E-093 REV# 21

Analytical Batch: 2446751

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
626523001	AF66432
626523002	AF66433
626523003	AF66434
626523004	AF66435
626523005	AF66436
626523006	AF66437
626523007	AF66438
626523008	AF66442
1205438109	Method Blank (MB)
1205438110	Laboratory Control Sample (LCS)
1205438111	626520001(AF66443) Sample Duplicate (DUP)
1205438112	626520001(AF66443) Post Spike (PS)
1205438113	626523002(AF66433) Sample Duplicate (DUP)
1205438114	626523002(AF66433) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Technical Information

Sample Re-analysis

Samples 1205438113 (AF66433DUP), 1205438114 (AF66433PS) and 626523002 (AF66433) were reanalyzed due to PS failure. The reanalysis data was reported.

Product: Nitrate/Nitrite Cad Redux Low Level

Analytical Method: EPA 353.2 Low Level

Analytical Procedure: GL-GC-E-128 REV# 11

Analytical Batch: 2444686

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
626523007	AF66438
626523008	AF66442

1205434326	Method Blank (MB)
1205434327	Laboratory Control Sample (LCS)
1205434328	626075001(NonSDG) Sample Duplicate (DUP)
1205434329	626075001(NonSDG) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Technical Information

Sample Dilutions

The following samples 626523007 (AF66438) and 626523008 (AF66442) in this sample group were diluted due to matrix interference. Dilutions may be required for many reasons, including to minimize matrix interferences or to bring over range target analyte concentrations into the linear calibration range.

Analyte	626523	
	007	008
Nitrogen, Nitrate/Nitrite	5X	5X

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.



Chain of Custody

626523

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.09.G01-1 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	TOC	NO3/w.O2	Analysis Group	
AF66432	CLFIB-1	6/12/23	0911	WJK ML	1	G	G	GW	3/1		1			
AF66433	CLFIB-1 DUP		0916											
AF66434	CLFIB-2		1014											
AF66435	CLFIB-3		1106											
AF66436	CLFIB-4		1212											
AF66437	CLFIB-5		1339											
AF66438	CLFIB-5D	6/14/23	0855		2							1		
AF66442	POZ-5D		1009									1		

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	6/16/23	1026	<i>[Signature]</i>	GEL	6/16/23	1026
<i>[Signature]</i>	GEL	6/16/23	1610	<i>[Signature]</i>	GEL	6/16/23	920

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input checked="" type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SCOR</u>		SDGAR/COC/Work Order: <u>626523</u>	
Received By: <u>QG</u>		Date Received: <u>6/16/23</u>	
Carrier and Tracking Number		FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other <u>42</u>	
Suspected Hazard Information		Yes	No
			*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?			Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples to be received as radioactive?			COC notation or radioactive stickers on containers equal client designation
C) Did the RSO classify the samples as radioactive?			Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM/mR/Hr Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?			COC notation or hazard labels on containers equal client designation
E) Did the RSO identify possible hazards?			If D or E is yes, select Hazards below: PCBs Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____
Sample Receipt Criteria		Yes	NA
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Comments/Qualifiers (Required for Non-Conforming Items) Circle Applicable: Seals broken Damaged container Leaking container Other (describe)	
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Circle Applicable: Client contacted and provided COC COC created upon receipt	
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Preservation Method: Wet Ice Ice Packs Dry Ice <u>None</u> Other: *all temperatures are recorded in Celsius TEMP: <u>4°C</u>	
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Temperature Device Serial #: <u>IR4-23</u> Secondary Temperature Device Serial # (If Applicable): _____	
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Circle Applicable: Seals broken Damaged container Leaking container Other (describe)	
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Sample ID's and Containers Affected: If Preservation added, Lot#: _____	
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected: _____	
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		ID's and tests affected: _____	
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		ID's and containers affected: _____	
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)	
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Circle Applicable: No container count on COC Other (describe)	
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
		Circle Applicable: Not relinquished Other (describe)	
Comments (Use Continuation Form if needed):			

JR

PM (or PMA) review: Initials RW Date 6/19/23 Page ____ of ____

List of current GEL Certifications as of 26 June 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

September 01, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 632243

Dear Ms. Gilmetti:


GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on August 04, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,



Caitlin Olive for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 632243 GEL Work Order: 632243

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by _____

Caitlin Olive

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF71896	Project: SOOP00119
Sample ID: 632243001	Client ID: SOOP001
Matrix: GW	
Collect Date: 01-AUG-23 09:53	
Receive Date: 04-AUG-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	-0.250	+/-0.724	1.45	3.00	pCi/L		JE1	08/22/23	0845	2473346	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.30	+/-0.953			pCi/L		NXL1	09/01/23	1121	2475367	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		2.30	+/-0.620	0.321	1.00	pCi/L		LXP1	09/01/23	0947	2473318	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			88.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF71893 Project: SOOP00119
Sample ID: 632243002 Client ID: SOOP001
Matrix: GW
Collect Date: 01-AUG-23 10:45
Receive Date: 04-AUG-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.34	+/-1.17	1.70	3.00	pCi/L		JE1	08/22/23	0846	2473346	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.04	+/-1.23			pCi/L		NXL1	09/01/23	1121	2475367	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.700	+/-0.364	0.335	1.00	pCi/L		LXP1	09/01/23	0947	2473318	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			84	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF71894 Project: SOOP00119
Sample ID: 632243003 Client ID: SOOP001
Matrix: GW
Collect Date: 01-AUG-23 11:52
Receive Date: 04-AUG-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.983	+/-0.864	1.39	3.00	pCi/L		JE1	08/22/23	0846	2473346		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.46	+/-0.939			pCi/L		NXL1	09/01/23	1121	2475367		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.474	+/-0.368	0.530	1.00	pCi/L		LXP1	09/01/23	0947	2473318		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			87.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF71895	Project: SOOP00119
Sample ID: 632243004	Client ID: SOOP001
Matrix: GW	
Collect Date: 01-AUG-23 13:17	
Receive Date: 04-AUG-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.57	+/-1.07	1.65	3.00	pCi/L		JE1	08/22/23	0846	2473346	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.24	+/-1.17			pCi/L		NXL1	09/01/23	1121	2475367	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.670	+/-0.484	0.690	1.00	pCi/L		LXP1	09/01/23	0947	2473318	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			83.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF71891	Project: SOOP00119
Sample ID: 632243005	Client ID: SOOP001
Matrix: GW	
Collect Date: 02-AUG-23 09:03	
Receive Date: 04-AUG-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.128	+/-1.09	1.98	3.00	pCi/L		JE1	08/22/23	0846	2473346	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.10	+/-1.16			pCi/L		NXL1	09/01/23	1121	2475367	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.970	+/-0.409	0.372	1.00	pCi/L		LXP1	09/01/23	0947	2473318	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			85.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF71892	Project: SOOP00119
Sample ID: 632243006	Client ID: SOOP001
Matrix: GW	
Collect Date: 02-AUG-23 09:08	
Receive Date: 04-AUG-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.321	+/-0.911	1.65	3.00	pCi/L		JE1	08/22/23	0846	2473346	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.04	+/-0.983			pCi/L		NXL1	09/01/23	1121	2475367	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.715	+/-0.372	0.342	1.00	pCi/L		LXP1	09/01/23	0947	2473318	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			85.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF71897 Project: SOOP00119
Sample ID: 632243007 Client ID: SOOP001
Matrix: GW
Collect Date: 02-AUG-23 10:00
Receive Date: 04-AUG-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.85	+/-1.39	2.24	3.00	pCi/L		JE1	08/22/23	0846	2473346	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.55	+/-1.52			pCi/L		NXL1	09/01/23	1121	2475367	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		1.70	+/-0.623	0.597	1.00	pCi/L		LXP1	09/01/23	0947	2473318	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			89	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF71898	Project: SOOP00119
Sample ID: 632243008	Client ID: SOOP001
Matrix: GW	
Collect Date: 02-AUG-23 10:05	
Receive Date: 04-AUG-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.63	+/-1.07	1.08	3.00	pCi/L		JE1	08/22/23	0846	2473346	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		4.34	+/-1.15			pCi/L		NXL1	09/01/23	1121	2475367	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.706	+/-0.412	0.415	1.00	pCi/L		LXP1	09/01/23	0947	2473318	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			81.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: September 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF71899	Project: SOOP00119
Sample ID: 632243009	Client ID: SOOP001
Matrix: GW	
Collect Date: 02-AUG-23 11:37	
Receive Date: 04-AUG-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.477	+/-0.639	1.10	3.00	pCi/L		JE1	08/22/23	0846	2473346		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.18	+/-0.766			pCi/L		NXL1	09/01/23	1121	2475367		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.706	+/-0.423	0.520	1.00	pCi/L		LXP1	09/01/23	1020	2473318		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			85	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: September 1, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 632243

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2473346										
QC1205482994	632243001	DUP									
Radium-228	U	-0.250	U	2.00	pCi/L	N/A		N/A	JE1	08/22/23	08:45
	Uncertainty	+/-0.724		+/-1.31							
QC1205482995	LCS										
Radium-228	78.9			72.0	pCi/L		91.3	(75%-125%)		08/22/23	08:45
	Uncertainty			+/-4.46							
QC1205482993	MB										
Radium-228			U	0.164	pCi/L					08/22/23	08:45
	Uncertainty			+/-0.807							
Rad Ra-226											
Batch	2473318										
QC1205482927	632243001	DUP									
Radium-226		2.30		2.08	pCi/L	10.2		(0%-20%)	LXP1	09/01/23	10:20
	Uncertainty	+/-0.620		+/-0.667							
QC1205482929	LCS										
Radium-226	26.3			20.9	pCi/L		79.6	(75%-125%)		09/01/23	10:20
	Uncertainty			+/-1.80							
QC1205482926	MB										
Radium-226			U	0.524	pCi/L					09/01/23	10:20
	Uncertainty			+/-0.407							
QC1205482928	632243001	MS									
Radium-226	133	2.30		137	pCi/L		101	(75%-125%)		09/01/23	10:20
	Uncertainty	+/-0.620		+/-10.4							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 632243

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 632243**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2473346

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
632243001	AF71896
632243002	AF71893
632243003	AF71894
632243004	AF71895
632243005	AF71891
632243006	AF71892
632243007	AF71897
632243008	AF71898
632243009	AF71899
1205482993	Method Blank (MB)
1205482994	632243001(AF71896) Sample Duplicate (DUP)
1205482995	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2473318

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
632243001	AF71896
632243002	AF71893
632243003	AF71894
632243004	AF71895
632243005	AF71891
632243006	AF71892
632243007	AF71897

632243008	AF71898
632243009	AF71899
1205482926	Method Blank (MB)
1205482927	632243001(AF71896) Sample Duplicate (DUP)
1205482928	632243001(AF71896) Matrix Spike (MS)
1205482929	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

The matrix spike, 1205482928 (AF71896MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.



Chain of Custody

032243

Customer Email/Report Recipient: LINDA.WILLIAMS @santecooper.com Date Results Needed by: / / Project/Task/Unit #: 125915 / JM02.09. G01.1 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	RAD 226	RAD 228	TOTAL RAD CALS
AF71896	CCMGP-5	8/1/23	0953	WJK FB	2	F	G	GW	2	• Method # • Reporting limit • Misc. sample info • Any other notes	1	1	X
93	CCMGP-2		1045										
94	CCMGP-3		1152										
95	CCMGP-4		1317										
AF71891	CCMGP-1	8/2/23	0903										
92	CCMGP-1 DUP		0908										
97	CGYP-7		1000										
98	CGYP-7 DUP		1005										
99	POZ-3		1137										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	86951	8/4/23	1007	<i>[Signature]</i>	GEL	8/4/23	1007
<i>[Signature]</i>	GEL	8/4/23	12:00	<i>[Signature]</i>	GEL	8/4/23	1200

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#:
 Date/Time/Init for preservative:

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As Cd Cr Ni Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOOP</u>	SDG/AR/COC/Work Order: <u>632243</u>
Received By: <u>JW</u>	Date Received: <u>8/4/23</u>

Carrier and Tracking Number	Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> <u>Other</u>
-----------------------------	-------------------------------------------------------------------------------------------------------

Suspected Hazard Information	Yes	No	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?		<input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples to be received as radioactive?		<input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive?		<input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): _____ CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?		<input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards?		<input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____

Sample Receipt Criteria	Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1 Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>			Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2 Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>			Circle Applicable: Client contacted and provided COC COC created upon receipt
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>			Preservation Method: Wet Ice Ice Packs Dry ice None Other: _____ *all temperatures are recorded in Celsius TEMP: <u>4°C</u> <u>1/20R</u>
4 Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>			Temperature Device Serial #: <u>IR1-23</u> Secondary Temperature Device Serial # (If Applicable): _____
5 Sample containers intact and sealed?	<input checked="" type="checkbox"/>			Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6 Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>			Sample ID's and Containers Affected: _____ If Preservation added, Lot#: _____
7 Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>			If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)
				Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
				Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected: _____
8 Samples received within holding time?	<input checked="" type="checkbox"/>			ID's and tests affected: _____
9 Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>			ID's and containers affected: _____
10 Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>			Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11 Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>			Circle Applicable: No container count on COC Other (describe)
12 Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>			
13 COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>			Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

List of current GEL Certifications as of 01 September 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



July 17, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 626517

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on June 16, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 626517 GEL Work Order: 626517

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66402	Project: SOOP00119
Sample ID: 626517001	Client ID: SOOP001
Matrix: GW	
Collect Date: 08-JUN-23 10:17	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.874	+/-1.01	1.69	3.00	pCi/L		JE1	06/30/23	1516	2445907		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.97	+/-1.22			pCi/L		NXL1	07/17/23	1000	2448613		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.10	+/-0.686	0.920	1.00	pCi/L		LXP1	07/14/23	0941	2445895		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			86.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66400 Project: SOOP00119
Sample ID: 626517002 Client ID: SOOP001
Matrix: GW
Collect Date: 08-JUN-23 11:04
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.78	+/-1.12	1.47	3.00	pCi/L		JE1	06/30/23	1353	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.41	+/-1.20			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.622	+/-0.422	0.597	1.00	pCi/L		LXP1	07/14/23	0941	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			85.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66401	Project: SOOP00119
Sample ID: 626517003	Client ID: SOOP001
Matrix: GW	
Collect Date: 08-JUN-23 11:09	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.90	+/-1.36	1.78	3.00	pCi/L		JE1	06/30/23	1353	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		4.69	+/-1.45			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.796	+/-0.516	0.716	1.00	pCi/L		LXP1	07/14/23	1014	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			84.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66399	Project: SOOP00119
Sample ID: 626517004	Client ID: SOOP001
Matrix: GW	
Collect Date: 08-JUN-23 12:31	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.737	+/-0.853	1.43	3.00	pCi/L		JE1	06/30/23	1353	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.63	+/-0.964			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.893	+/-0.449	0.402	1.00	pCi/L		LXP1	07/14/23	0941	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			86	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66398	Project: SOOP00119
Sample ID: 626517005	Client ID: SOOP001
Matrix: GW	
Collect Date: 08-JUN-23 14:18	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.03	+/-1.76	2.69	3.00	pCi/L		JE1	06/30/23	1353	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.88	+/-1.80			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.850	+/-0.391	0.325	1.00	pCi/L		LXP1	07/14/23	0941	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			63.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66443 Project: SOOP00119
Sample ID: 626517006 Client ID: SOOP001
Matrix: GW
Collect Date: 13-JUN-23 09:19
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.773	+/-0.691	1.10	3.00	pCi/L		JE1	06/30/23	1353	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.65	+/-0.802			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.873	+/-0.408	0.398	1.00	pCi/L		LXP1	07/14/23	0941	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			85.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66440 Project: SOOP00119
Sample ID: 626517007 Client ID: SOOP001
Matrix: GW
Collect Date: 13-JUN-23 10:32
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.13	+/-1.35	2.27	3.00	pCi/L		JE1	06/30/23	1353	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.53	+/-1.40			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.406	+/-0.386	0.605	1.00	pCi/L		LXP1	07/14/23	0941	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			87.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66444	Project: SOOP00119
Sample ID: 626517008	Client ID: SOOP001
Matrix: GW	
Collect Date: 13-JUN-23 12:21	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.655	+/-1.11	1.93	3.00	pCi/L		JE1	06/30/23	1354	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.10	+/-1.19			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.445	+/-0.436	0.685	1.00	pCi/L		LXP1	07/14/23	0941	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			82.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66445	Project: SOOP00119
Sample ID: 626517009	Client ID: SOOP001
Matrix: GW	
Collect Date: 13-JUN-23 12:26	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		1.80	+/-0.952	1.35	3.00	pCi/L		JE1	06/30/23	1354	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.63	+/-1.04			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.822	+/-0.427	0.393	1.00	pCi/L		LXP1	07/14/23	1014	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			84.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66441	Project: SOOP00119
Sample ID: 626517010	Client ID: SOOP001
Matrix: GW	
Collect Date: 13-JUN-23 15:00	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.78	+/-1.40	2.09	3.00	pCi/L		JE1	06/30/23	1354	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		4.95	+/-1.53			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		2.17	+/-0.611	0.399	1.00	pCi/L		LXP1	07/14/23	1014	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			83.2	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66405	Project: SOOP00119
Sample ID: 626517011	Client ID: SOOP001
Matrix: GW	
Collect Date: 15-JUN-23 09:52	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.954	+/-0.752	1.16	3.00	pCi/L		JE1	06/30/23	1354	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.24	+/-0.808			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.287	+/-0.296	0.458	1.00	pCi/L		LXP1	07/14/23	1047	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			90.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66392	Project: SOOP00119
Sample ID: 626517012	Client ID: SOOP001
Matrix: GW	
Collect Date: 15-JUN-23 13:19	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.55	+/-1.12	1.73	3.00	pCi/L		JE1	06/30/23	1354	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.34	+/-1.21			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.784	+/-0.470	0.578	1.00	pCi/L		LXP1	07/14/23	1014	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			73.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66397	Project: SOOP00119
Sample ID: 626517013	Client ID: SOOP001
Matrix: GW	
Collect Date: 14-JUN-23 11:46	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.166	+/-0.807	1.50	3.00	pCi/L		JE1	06/30/23	1354	2445907		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.03	+/-0.938			pCi/L		NXL1	07/17/23	1000	2448613		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.861	+/-0.478	0.607	1.00	pCi/L		LXP1	07/14/23	1014	2445895		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			84.5	(15%-125%)

Notes:
 Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66396 Project: SOOP00119
Sample ID: 626517014 Client ID: SOOP001
Matrix: GW
Collect Date: 14-JUN-23 12:47
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		13.8	+/-2.14	1.86	3.00	pCi/L		JE1	07/06/23	0909	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		20.9	+/-2.42			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		7.07	+/-1.14	0.600	1.00	pCi/L		LXP1	07/14/23	1014	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			78.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66395	Project: SOOP00119
Sample ID: 626517015	Client ID: SOOP001
Matrix: GW	
Collect Date: 14-JUN-23 13:39	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.549	+/-1.07	1.89	3.00	pCi/L		JE1	06/30/23	1354	2445907	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.48	+/-1.21			pCi/L		NXL1	07/17/23	1000	2448613	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.930	+/-0.551	0.750	1.00	pCi/L		LXP1	07/14/23	1014	2445895	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			83	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 17, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66394	Project: SOOP00119
Sample ID: 626517016	Client ID: SOOP001
Matrix: GW	
Collect Date: 14-JUN-23 14:43	
Receive Date: 16-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.20	+/-1.07	1.73	3.00	pCi/L		JE1	06/30/23	1354	2445907		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.53	+/-1.12			pCi/L		NXL1	07/17/23	1000	2448613		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.331	+/-0.334	0.523	1.00	pCi/L		LXP1	07/14/23	1014	2445895		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			83.2	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: July 17, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 626517

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2445907										
QC1205436495	626517001	DUP									
Radium-228	U	0.874	U	0.348	pCi/L	N/A		N/A	JE1	06/30/23	15:16
	Uncertainty	+/-1.01		+/-0.925							
QC1205436496	LCS										
Radium-228	80.2			64.8	pCi/L		80.9	(75%-125%)		06/30/23	13:53
	Uncertainty			+/-3.93							
QC1205436494	MB										
Radium-228				1.23	pCi/L					06/30/23	13:53
	Uncertainty			+/-0.797							
Rad Ra-226											
Batch	2445895										
QC1205436460	626517001	DUP									
Radium-226		1.10		2.35	pCi/L	72.7		(0% - 100%)	LXP1	07/14/23	10:47
	Uncertainty	+/-0.686		+/-0.868							
QC1205436462	LCS										
Radium-226	26.3			27.0	pCi/L		103	(75%-125%)		07/14/23	10:47
	Uncertainty			+/-2.06							
QC1205436459	MB										
Radium-226			U	0.371	pCi/L					07/14/23	10:47
	Uncertainty			+/-0.315							
QC1205436461	626517001	MS									
Radium-226	127	1.10		144	pCi/L		113	(75%-125%)		07/14/23	10:47
	Uncertainty	+/-0.686		+/-12.0							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 626517

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 626517**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2445907

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
626517001	AF66402
626517002	AF66400
626517003	AF66401
626517004	AF66399
626517005	AF66398
626517006	AF66443
626517007	AF66440
626517008	AF66444
626517009	AF66445
626517010	AF66441
626517011	AF66405
626517012	AF66392
626517013	AF66397
626517014	AF66396
626517015	AF66395
626517016	AF66394
1205436494	Method Blank (MB)
1205436495	626517001(AF66402) Sample Duplicate (DUP)
1205436496	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Method Blank Criteria

The blank result (See Below) is greater than the MDC but less than the required detection limit.

Sample	Analyte	Value
1205436494 (MB)	Radium-228	Result: 1.23 pCi/L > MDA: 1.18 pCi/L <= RDL: 3.00 pCi/L

Technical Information

Recounts

Samples 1205436495 (AF66402DUP) and 626517001 (AF66402) were recounted due to high relative percent difference/relative error ratio. The recounts are reported. Sample 626517014 (AF66396) was re-eluted and recounted to verify sample result. The recount is reported.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2445895

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
626517001	AF66402
626517002	AF66400
626517003	AF66401
626517004	AF66399
626517005	AF66398
626517006	AF66443
626517007	AF66440
626517008	AF66444
626517009	AF66445
626517010	AF66441
626517011	AF66405
626517012	AF66392
626517013	AF66397
626517014	AF66396
626517015	AF66395
626517016	AF66394
1205436459	Method Blank (MB)
1205436460	626517001(AF66402) Sample Duplicate (DUP)
1205436461	626517001(AF66402) Matrix Spike (MS)
1205436462	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information**Additional Comments**

The matrix spike, 1205436461 (AF66402MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

6/26/23 - TOC


Contract Lab Info: GEL

Contract Lab Due Date (Lab Only): 7 / 18 / 23 - RAD

Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody

626517/6520



Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone: (843)761-8000 Ext. 5148
Fax: (843)761-4175

Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LINDA.WILLIAM @santecooper.com

 / /

125915 / JM02.08.G02.3 / 36500

Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments <ul style="list-style-type: none">Method #Reporting limitMisc. sample infoAny other notes	Analysis Group		
											RAD 226/228	TOTAL RAD CALC	TOC
AF66402	CAP-10	6/8/23	1017	WJK ML	2	P	G	GW	2		2	X	
AF66400	CAP-9		1104										
AF66401	CAP-9 DUP		1109										
AF66399	CAP-8		1231										
AF66398	CAP-7		1418										
AF66443	POZ-6	6/13/23	6919		3	P/G			2/3		2	X	1
AF66440	POZ-3		1032										
AF66444	POZ-7		1221										
AF66445	POZ-7 DUP		1226										
AF66441	POZ-4		1500										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	6/16/23	1026	<i>[Signature]</i>	GEL	6/16/23	1026
<i>[Signature]</i>	<i>GEL</i>	6/16/23	140	<i>[Signature]</i>	GEL	6/16/23	1600

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------



Chain of Custody

Customer Email/Report Recipient: LINDA.WILLIAMS@santeecooper.com Date Results Needed by: / / Project/Task/Unit #: 125915 / JM02.08. G02.3 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass-G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Analysis Group		
											RAD 226/228	TOTAL RAD CHC	NO3/NO2
AF66405	CAP-13	6/15/23	0952	WJK ML	2	P	G	GW	2		2	X	
AF66392	CAP-1		1319										
AF66397	CAP-6	6/14/23	1146										
AF66396	CAP-5		1247										
AF66395	CAP-4		1339										
AF66394	CAP-3		1443										
AF66407	CBW-1	6/6/23	0859		1	P	G	GW	1/3				X

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	6/16/23	1026	<i>[Signature]</i>	GEL	6/16/23	1826
<i>[Signature]</i>	<i>GEL</i>	6/16/23	1610	<i>[Signature]</i>	GEL	6/16/23	920

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> % Carbon <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SCAP</u>		SDG/AR/COC/Work Order: <u>626517/6520</u>	
Received By: <u>QG</u>		Date Received: <u>6/16/23</u>	
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other <u>462</u>	
Suspected Hazard Information		Yes	No
A) Shipped as a DOT Hazardous?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
B) Did the client designate the samples are to be received as radioactive?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
C) Did the RSO classify the samples as radioactive?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
D) Did the client designate samples are hazardous?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
E) Did the RSO identify possible hazards?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
Sample Receipt Criteria		Yes	No
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Comments (Use Continuation Form if needed):			

JR

PM (or PMA) review: Initials RW Date 6/19/23 Page ___ of ___

List of current GEL Certifications as of 17 July 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

January 08, 2024

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 648208

Dear Ms. Gilmetti:


GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on December 08, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,



Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 648208 GEL Work Order: 648208

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 8, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF84383 Project: SOOP00119
Sample ID: 648208001 Client ID: SOOP001
Matrix: GW
Collect Date: 05-DEC-23 13:26
Receive Date: 08-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		4.72	+/-1.37	1.64	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		5.52	+/-1.44			pCi/L		NXL1	01/04/24	1425	2545693		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.797	+/-0.425	0.408	1.00	pCi/L		LXP1	01/02/24	0953	2539558		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			76.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 8, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF84384 Project: SOOP00119
Sample ID: 648208002 Client ID: SOOP001
Matrix: GW
Collect Date: 05-DEC-23 13:31
Receive Date: 08-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		3.55	+/-1.39	1.95	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		4.67	+/-1.48			pCi/L		NXL1	01/04/24	1425	2545693		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.12	+/-0.525	0.485	1.00	pCi/L		LXP1	01/02/24	0953	2539558		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			81.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 8, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF84385 Project: SOOP00119
Sample ID: 648208003 Client ID: SOOP001
Matrix: GW
Collect Date: 05-DEC-23 10:14
Receive Date: 08-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		1.21	+/-0.774	1.16	3.00	pCi/L		JE1	12/29/23	1355	2542833	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.49	+/-0.834			pCi/L		NXL1	01/04/24	1425	2545693	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.281	+/-0.311	0.488	1.00	pCi/L		LXP1	01/02/24	1012	2539558	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			89	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: January 8, 2024

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 648208

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2542833										
QC1205605880	648208001	DUP									
Radium-228			4.72	2.46	pCi/L	63		(0% - 100%)	JE1	12/29/23	13:55
			Uncertainty +/-1.37	+/-1.03							
QC1205605881	LCS										
Radium-228			74.3	71.5	pCi/L		96.1	(75%-125%)		12/29/23	13:55
			Uncertainty	+/-4.39							
QC1205605879	MB										
Radium-228				U 0.437	pCi/L					12/29/23	13:55
			Uncertainty	+/-0.605							
Rad Ra-226											
Batch	2539558										
QC1205600116	648208001	DUP									
Radium-226			0.797	1.10	pCi/L	32		(0% - 100%)	LXP1	01/02/24	10:31
			Uncertainty +/-0.425	+/-0.502							
QC1205600120	LCS										
Radium-226			27.0	27.0	pCi/L		100	(75%-125%)		01/02/24	10:52
			Uncertainty	+/-2.37							
QC1205600115	MB										
Radium-226				U 0.0674	pCi/L					01/02/24	10:31
			Uncertainty	+/-0.171							
QC1205600118	648208001	MS									
Radium-226			134	0.797	pCi/L		81.7	(75%-125%)		01/02/24	10:52
			Uncertainty +/-0.425	+/-10.1							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 648208

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 648208**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2542833

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
648208001	AF84383
648208002	AF84384
648208003	AF84385
1205605879	Method Blank (MB)
1205605880	648208001(AF84383) Sample Duplicate (DUP)
1205605881	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2539558

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
648208001	AF84383
648208002	AF84384
648208003	AF84385
1205600115	Method Blank (MB)
1205600116	648208001(AF84383) Sample Duplicate (DUP)
1205600118	648208001(AF84383) Matrix Spike (MS)
1205600120	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where

applicable, with the following exceptions.

Preparation Information

Aliquot Reduced


1205600118 (AF84383MS) Aliquot was reduced due to limited sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Chain of Custody

648208



Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone: (843)761-8000 Ext. 5148
Fax: (843)761-4175

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LINDA WILLIAMS @santeecooper.com / / 125915 / JM02.09.GB1.1 / 36500 Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	RAD 226/228	TOTAL RAD CALC
AF 84383	CGYP-7	12/5/23	1326	ZM BB	2	P	G	GW	2	• Method # • Reporting limit • Misc. sample info • Any other notes	X	X
AF 84384	CGYP-7 DUP		1331									
AF 84385	POE-3		1014									

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	36851	12/8/23	10:08	<i>[Signature]</i>	GEL	12/8/23	10:08
<i>[Signature]</i>	GEL	12/8/23	3:20	<i>[Signature]</i>	GEL	12/8/23	3:20

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: SOOP		SDG/AR/COC/Work Order: 648208			
Received By: Thyasia Tatum		Date Received: 12/19/23			
Carrier and Tracking Number		Circle Applicable: <input type="checkbox"/> FedEx Express <input type="checkbox"/> FedEx Ground <input type="checkbox"/> UPS <input type="checkbox"/> Field Services <input checked="" type="checkbox"/> Courier <input type="checkbox"/> Other			
		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.			
Suspected Hazard Information		<input checked="" type="checkbox"/> Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___			
A) Shipped as a DOT Hazardous?		<input checked="" type="checkbox"/> COC notation or radioactive stickers on containers equal client designation.			
B) Did the client designate the samples are to be received as radioactive?		<input checked="" type="checkbox"/> Maximum Net Counts Observed* (Observed Counts - Area Background Counts): 0 CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3			
C) Did the RSO classify the samples as radioactive?		<input checked="" type="checkbox"/> COC notation or hazard labels on containers equal client designation.			
D) Did the client designate samples are hazardous?		If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____			
E) Did the RSO identify possible hazards?					
Sample Receipt Criteria		Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Preservation Method: <u>Wet Ice</u> Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Temperature Device Serial #: <u>IR2-23</u> Secondary Temperature Device Serial # (If Applicable):
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#:
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)
					Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
					Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and tests affected:
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and containers affected:
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed):					

TEMP **ICHEM - 10°C**
Gchem - 2°C

PM (or PMA) review: Initials **JTW** Date **12/19/23** Page **1** of **1**

List of current GEL Certifications as of 08 January 2024

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-05
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2023-152
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122023-38
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



June 26, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 626520

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on June 16, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Jessica Ward for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 626520 GEL Work Order: 626520

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- J Value is estimated
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66443 Project: SOOP00119
Sample ID: 626520001 Client ID: SOOP001
Matrix: GW
Collect Date: 13-JUN-23 09:19
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.70	0.330	1.00	mg/L		1	RM3	06/20/23	2026	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66440 Project: SOOP00119
Sample ID: 626520002 Client ID: SOOP001
Matrix: GW
Collect Date: 13-JUN-23 10:32
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.85	0.330	1.00	mg/L		1	RM3	06/20/23	2147	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66444 Project: SOOP00119
Sample ID: 626520003 Client ID: SOOP001
Matrix: GW
Collect Date: 13-JUN-23 12:21
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.507	0.330	1.00	mg/L		1	RM3	06/20/23	2206	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66445 Project: SOOP00119
Sample ID: 626520004 Client ID: SOOP001
Matrix: GW
Collect Date: 13-JUN-23 12:26
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average	J	0.503	0.330	1.00	mg/L		1	RM3	06/20/23	2226	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66441 Project: SOOP00119
Sample ID: 626520005 Client ID: SOOP001
Matrix: GW
Collect Date: 13-JUN-23 15:00
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		1.67	0.330	1.00	mg/L		1	RM3	06/20/23	2245	2446751	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 26, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66407 Project: SOOP00119
Sample ID: 626520006 Client ID: SOOP001
Matrix: GW
Collect Date: 06-JUN-23 08:59
Receive Date: 16-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Nutrient Analysis												
EPA 353.2 Nitrogen, Nitrate/Nitrite "As Received"												
Nitrogen, Nitrate/Nitrite		1.49	0.0350	0.100	mg/L		5	AXH3	06/19/23	0612	2444686	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	EPA 353.2 Low Level		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: June 26, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 626520

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch 2446751											
QC1205438111	626520001	DUP									
Total Organic Carbon Average		2.70		2.78	mg/L	3.25 ^		(+/-1.00)	RM3	06/20/23	20:46
QC1205438113	626523002	DUP									
Total Organic Carbon Average		2.30		2.29	mg/L	0.393 ^		(+/-1.00)		06/22/23	16:03
QC1205438110	LCS										
Total Organic Carbon Average	10.0			9.70	mg/L		97	(80%-120%)		06/20/23	17:01
QC1205438109	MB										
Total Organic Carbon Average			U	ND	mg/L					06/20/23	16:52
QC1205438112	626520001	PS									
Total Organic Carbon Average	10.0	2.70		12.8	mg/L		101	(65%-120%)		06/20/23	21:05
QC1205438114	626523002	PS									
Total Organic Carbon Average	10.0	2.30		12.5	mg/L		102	(65%-120%)		06/22/23	16:22
Nutrient Analysis											
Batch 2444686											
QC1205434328	626075001	DUP									
Nitrogen, Nitrate/Nitrite	J	0.0197	J	0.0193	mg/L	2.05 ^		(+/-0.0200)	AXH3	06/19/23	06:06
QC1205434327	LCS										
Nitrogen, Nitrate/Nitrite	1.00			1.04	mg/L		104	(90%-110%)		06/19/23	06:03
QC1205434326	MB										
Nitrogen, Nitrate/Nitrite			U	ND	mg/L					06/19/23	06:02

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 626520

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Nutrient Analysis											
Batch	2444686										
	QC1205434329 626075001 PS										
Nitrogen, Nitrate/Nitrite	1.00	J	0.0197	1.07	mg/L		105	(90%-110%)	AXH3	06/19/23	06:07

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected
- Z Paint Filter Test--Particulates passed through the filter, however no free liquids were observed.
- d 5-day BOD--The 2:1 depletion requirement was not met for this sample
- ^ RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.
- N/A RPD or %Recovery limits do not apply.
- ND Analyte concentration is not detected above the detection limit
- NJ Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- E General Chemistry--Concentration of the target analyte exceeds the instrument calibration range
- Q One or more quality control criteria have not been met. Refer to the applicable narrative or DER.
- NI See case narrative
- R Per section 9.3.4.1 of Method 1664 Revision B, due to matrix spike recovery issues, this result may not be reported or used for regulatory compliance purposes.
- B The target analyte was detected in the associated blank.
- e 5-day BOD--Test replicates show more than 30% difference between high and low values. The data is qualified per the method and can be used for reporting purposes
- J See case narrative for an explanation

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**General Chemistry
Technical Case Narrative
Santee Cooper
SDG #: 626520**

Product: Carbon, Total Organic

Analytical Method: SM 5310 B

Analytical Procedure: GL-GC-E-093 REV# 21

Analytical Batch: 2446751

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
626520001	AF66443
626520002	AF66440
626520003	AF66444
626520004	AF66445
626520005	AF66441
1205438109	Method Blank (MB)
1205438110	Laboratory Control Sample (LCS)
1205438111	626520001(AF66443) Sample Duplicate (DUP)
1205438112	626520001(AF66443) Post Spike (PS)
1205438113	626523002(AF66433) Sample Duplicate (DUP)
1205438114	626523002(AF66433) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Technical Information

Sample Re-analysis

Samples 1205438113 (AF66433DUP) and 1205438114 (AF66433PS) were reanalyzed due to PS failure. The reanalysis data was reported.

Product: Nitrate/Nitrite Cad Redux Low Level

Analytical Method: EPA 353.2 Low Level

Analytical Procedure: GL-GC-E-128 REV# 11

Analytical Batch: 2444686

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
626520006	AF66407
1205434326	Method Blank (MB)
1205434327	Laboratory Control Sample (LCS)
1205434328	626075001(NonSDG) Sample Duplicate (DUP)
1205434329	626075001(NonSDG) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Technical Information

Sample Dilutions

The following sample 626520006 (AF66407) in this sample group was diluted due to matrix interference. Dilutions may be required for many reasons, including to minimize matrix interferences or to bring over range target analyte concentrations into the linear calibration range.

Analyte	626520
	006
Nitrogen, Nitrate/Nitrite	5X

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

6/26/23 - TOC

Contract Lab Info: GEL

Contract Lab Due Date (Lab Only): 7 / 18 / 23 - RAD

Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody

626517/6520



Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LINDA.WILLIAM @santecooper.com

 / /

125915 / JM02.08.G02.3 / 3650

Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass-G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	Analysis Group		
											RAD 226/228	TOTAL RAD CALC	TOC
AF66402	CAP-10	6/8/23	1017	WJK ML	2	P	G	GW	2		2	X	
AF66400	CAP-9		1104										
AF66401	CAP-9 DUP		1109										
AF66399	CAP-8		1231										
AF66398	CAP-7		1418										
AF66443	POZ-6	6/13/23	6919		3	P/G			2/3/		2	X	1
AF66440	POZ-3		1032										
AF66444	POZ-7		1221										
AF66445	POZ-7 DUP		1226										
AF66441	POZ-4		1500										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	6/16/23	1026	<i>[Signature]</i>	GEL	6/16/23	1026
<i>[Signature]</i>	<i>GEL</i>	6/16/23	140	<i>[Signature]</i>	GEL	6/16/23	1600

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Chain of Custody



Customer Email/Report Recipient: LINDA.WILLIAMS@santeecooper.com Date Results Needed by: / / Project/Task/Unit #: 125915 / JM02.08. G02.3 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Analysis Group		
											RAD 226/228	TOTAL RAD CHC	NO3/NO2
AF66405	CAP-13	6/15/23	0952	WJK ML	2	P	G	GW	2		2	X	
AF66392	CAP-1		1319										
AF66397	CAP-6	6/14/23	1146										
AF66396	CAP-5		1247										
AF66395	CAP-4		1339										
AF66394	CAP-3		1443										
AF66407	CBW-1	6/6/23	0859		1	P	G	GW	1/3				X

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	6/16/23	1026	<i>[Signature]</i>	GEL	6/16/23	1826
<i>[Signature]</i>	<i>GEL</i>	6/16/23	1610	<i>[Signature]</i>	GEL	6/16/23	920

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> % Carbon <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SCAP</u>		SDG/AR/COC/Work Order: <u>626517/6520</u>	
Received By: <u>QG</u>		Date Received: <u>6/16/23</u>	
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other <u>462</u>	
Suspected Hazard Information		Yes	No
		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.	
A) Shipped as a DOT Hazardous?		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___	
B) Did the client designate the samples are to be received as radioactive?		<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No COC notation on radioactive stickers on containers equal client designation.	
C) Did the RSO classify the samples as radioactive?		<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>00</u> CPM/mR/Hr Classified as: Rad 1 Rad 2 Rad 3	
D) Did the client designate samples are hazardous?		<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No COC notation on hazard labels on containers equal client designation.	
E) Did the RSO identify possible hazards?		If D or E is yes, select Hazards below. <input type="checkbox"/> PCB's <input type="checkbox"/> Flammable <input type="checkbox"/> Foreign Soil <input type="checkbox"/> RCRA <input type="checkbox"/> Asbestos <input type="checkbox"/> Beryllium Other: _____	
Sample Receipt Criteria		Yes	No
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Circle Applicable: Seals broken Damaged container Leaking container Other (describe)	
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Circle Applicable: Client contacted and provided COC COC created upon receipt	
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Preservation Method: <u>Wet Ice</u> Ice Packs Dry Ice <u>None</u> Other: *all temperatures are recorded in Celsius TEMP: <u>4°C</u>	
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Temperature Device Serial #: <u>IR4-23</u> Secondary Temperature Device Serial # (If Applicable): _____	
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Circle Applicable: Seals broken Damaged container Leaking container Other (describe)	
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Sample ID's and Containers Affected:	
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		If Preservation added, Lot#: _____ If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected: _____	
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		ID's and tests affected:	
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		ID's and containers affected:	
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)	
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Circle Applicable: No container count on COC Other (describe)	
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
		Circle Applicable: Not relinquished Other (describe)	
Comments (Use Continuation Form if needed):			

JR

PM (or PMA) review: Initials RW Date 6/19/23 Page ___ of ___

List of current GEL Certifications as of 26 June 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

January 11, 2024

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 649122

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on December 15, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 649122 GEL Work Order: 649122

The Qualifiers in this report are defined as follows:


- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by _____



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85222 Project: SOOP00119
Sample ID: 649122001 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 13:19
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.18	+/-0.837	1.29	3.00	pCi/L		JE1	12/29/23	1355	2542833	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.83	+/-0.888			pCi/L		NXL1	01/11/24	0958	2551440	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.646	+/-0.296	0.311	1.00	pCi/L		LXP1	01/10/24	0839	2541882	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			87.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85223 Project: SOOP00119
Sample ID: 649122002 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 10:24
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	0.944	+/-1.02	1.71	3.00	pCi/L		JE1	12/29/23	1355	2542833	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.52	+/-1.17			pCi/L		NXL1	01/11/24	0958	2551440	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		2.58	+/-0.567	0.297	1.00	pCi/L		LXP1	01/10/24	0839	2541882	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			92.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85224 Project: SOOP00119
Sample ID: 649122003 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 10:29
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		1.39	+/-0.763	1.07	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.18	+/-0.935			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.79	+/-0.539	0.495	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			89.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85225 Project: SOOP00119
Sample ID: 649122004 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 11:50
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.328	+/-0.652	1.17	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.72	+/-0.827			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.39	+/-0.509	0.561	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			86.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: January 11, 2024

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 649122

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2542833										
QC1205605880	648208001	DUP									
Radium-228		4.72		2.46	pCi/L	63		(0% - 100%)	JE1	12/29/23	13:55
	Uncertainty	+/-1.37		+/-1.03							
QC1205605881	LCS										
Radium-228		74.3		71.5	pCi/L		96.1	(75%-125%)		12/29/23	13:55
	Uncertainty			+/-4.39							
QC1205605879	MB										
Radium-228			U	0.437	pCi/L					12/29/23	13:55
	Uncertainty			+/-0.605							
Rad Ra-226											
Batch	2541882										
QC1205603843	649122001	DUP									
Radium-226		0.646		0.568	pCi/L	12.8		(0% - 100%)	LXP1	01/10/24	09:11
	Uncertainty	+/-0.296		+/-0.341							
QC1205603846	LCS										
Radium-226		17.0		13.0	pCi/L		76.2	(75%-125%)		01/10/24	09:11
	Uncertainty			+/-1.02							
QC1205603841	MB										
Radium-226			U	0.177	pCi/L					01/10/24	09:11
	Uncertainty			+/-0.203							
QC1205603845	649122001	MS									
Radium-226		113		93.8	pCi/L		82.2	(75%-125%)		01/10/24	09:11
	Uncertainty	+/-0.296		+/-6.51							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 649122

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 649122**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2542833

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
649122001	AF85222
649122002	AF85223
649122003	AF85224
649122004	AF85225
1205605879	Method Blank (MB)
1205605880	648208001(AF84383) Sample Duplicate (DUP)
1205605881	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2541882

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
649122001	AF85222
649122002	AF85223
649122003	AF85224
649122004	AF85225
1205603841	Method Blank (MB)
1205603843	649122001(AF85222) Sample Duplicate (DUP)
1205603845	649122001(AF85222) Matrix Spike (MS)
1205603846	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information**Additional Comments**

Aliquots for the matrix spikes, 1205603845 (AF85222MS), were reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Chain of Custody

649122



Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LINDA.WILLIAMS @santeecooper.com _____ / _____ / _____ 1259115 / JM=2.07.GP1.1 / 36500 (Yes) NO

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass-G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	RAD 226/228	TOTAL RAD CALC	Analysis Group	
AF85222	WAP-27	12/11/23	1319	ZM ML	2	G	G	GW	2		X	X		
AF85223	WAP-28		1024											
AF85224	WAP-28 DUP		1029											
AF85225	WAP-29		1150											

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	36851	12/15/23	0923	<i>[Signature]</i>	GEL	12/15/23	1923
<i>[Signature]</i>	GEL	12/15/23	1610	<i>[Signature]</i>	GEL	12/15/23	1810

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particulate Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SDGP</u>		SDG/AR/COC/Work Order: <u>649122</u>		
Received By: <u>QG</u>		Date Received: <u>12/15/23</u>		
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Carrier</u> Other		
Suspected Hazard Information		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.		
A) Shipped as a DOT Hazardous?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___		
B) Did the client designate the samples are to be received as radioactive?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation		
C) Did the RSO classify the samples as radioactive?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> <u>CPM</u> mR/HR Classified as: Rad 1 Rad 2 Rad 3		
D) Did the client designate samples are hazardous?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation		
E) Did the RSO identify possible hazards?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____		
Sample Receipt Criteria	Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1 Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2 Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Preservation Method: <u>Wet Ice</u> Ice Packs Dry ice <u>None</u> Other: _____ *all temperatures are recorded in Celsius TEMP: <u>2°C</u>
4 Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Temperature Device Serial #: <u>IR1-23</u> Secondary Temperature Device Serial # (If Applicable): _____
5 Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6 Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#: _____
7 Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)
				Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
				Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___
8 Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and tests affected:
9 Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and containers affected:
10 Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11 Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No container count on COC Other (describe) <u>only received 1 container for AP85752</u>
12 Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
13 COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed):				

PM (or PMA) review: Initials JW Date 12/16/23 Page 1 of 1

List of current GEL Certifications as of 11 January 2024

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-05
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2023-152
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122023-38
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 6/22/2023 1:09:54 PM

JOB DESCRIPTION

125915/JM02.08.G02.3/36500

JOB NUMBER

680-236600-1


Eurofins Savannah

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
6/22/2023 1:09:54 PM

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	9
QC Sample Results	25
QC Association	26
Chronicle	27
Chain of Custody	30
Receipt Checklists	32
Certification Summary	33



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Job ID: 680-236600-1

Laboratory: Eurofins Savannah

Narrative

Job Narrative
680-236600-1

Receipt

The samples were received on 6/20/2023 10:01 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 20.3°C

Metals

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-236600-1	AF66402	Water	06/08/23 10:17	06/20/23 10:01
680-236600-2	AF66400	Water	06/08/23 11:04	06/20/23 10:01
680-236600-3	AF66401	Water	06/08/23 11:09	06/20/23 10:01
680-236600-4	AF66399	Water	06/08/23 12:31	06/20/23 10:01
680-236600-5	AF66398	Water	06/08/23 14:18	06/20/23 10:01
680-236600-6	AF66443	Water	06/13/23 09:19	06/20/23 10:01
680-236600-7	AF66440	Water	06/13/23 10:32	06/20/23 10:01
680-236600-8	AF66444	Water	06/13/23 12:21	06/20/23 10:01
680-236600-9	AF66445	Water	06/13/23 12:26	06/20/23 10:01
680-236600-10	AF66441	Water	06/13/23 15:00	06/20/23 10:01
680-236600-11	AF66397	Water	06/14/23 11:46	06/20/23 10:01
680-236600-12	AF66396	Water	06/14/23 12:47	06/20/23 10:01
680-236600-13	AF66395	Water	06/14/23 13:39	06/20/23 10:01
680-236600-14	AF66394	Water	06/14/23 14:43	06/20/23 10:01
680-236600-15	AF66405	Water	06/15/23 09:52	06/20/23 10:01
680-236600-16	AF66392	Water	06/15/23 13:19	06/20/23 10:01

1
2
3
4
5
6
7
8
9
10
11
12
13
14

Method Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Method	Method Description	Protocol	Laboratory
7470A	Mercury (CVAA)	SW846	EET SAV
7470A	Preparation, Mercury	SW846	EET SAV

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Qualifiers

Metals	
Qualifier	Qualifier Description
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66402 **Lab Sample ID: 680-236600-1**

No Detections.

Client Sample ID: AF66400 **Lab Sample ID: 680-236600-2**

No Detections.

Client Sample ID: AF66401 **Lab Sample ID: 680-236600-3**

No Detections.

Client Sample ID: AF66399 **Lab Sample ID: 680-236600-4**

No Detections.

Client Sample ID: AF66398 **Lab Sample ID: 680-236600-5**

No Detections.

Client Sample ID: AF66443 **Lab Sample ID: 680-236600-6**

No Detections.

Client Sample ID: AF66440 **Lab Sample ID: 680-236600-7**

No Detections.

Client Sample ID: AF66444 **Lab Sample ID: 680-236600-8**

No Detections.

Client Sample ID: AF66445 **Lab Sample ID: 680-236600-9**

No Detections.

Client Sample ID: AF66441 **Lab Sample ID: 680-236600-10**

No Detections.

Client Sample ID: AF66397 **Lab Sample ID: 680-236600-11**

No Detections.

Client Sample ID: AF66396 **Lab Sample ID: 680-236600-12**

No Detections.

Client Sample ID: AF66395 **Lab Sample ID: 680-236600-13**

No Detections.

Client Sample ID: AF66394 **Lab Sample ID: 680-236600-14**

No Detections.

Client Sample ID: AF66405 **Lab Sample ID: 680-236600-15**

No Detections.

Client Sample ID: AF66392 **Lab Sample ID: 680-236600-16**

No Detections.

This Detection Summary does not include radiochemical test results.

Eurofins Savannah



Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66402

Lab Sample ID: 680-236600-1

Date Collected: 06/08/23 10:17

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:45	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66400

Lab Sample ID: 680-236600-2

Date Collected: 06/08/23 11:04

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:49	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66401

Lab Sample ID: 680-236600-3

Date Collected: 06/08/23 11:09

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:51	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66399

Lab Sample ID: 680-236600-4

Date Collected: 06/08/23 12:31

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:52	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66398

Lab Sample ID: 680-236600-5

Date Collected: 06/08/23 14:18

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:54	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66443

Lab Sample ID: 680-236600-6

Date Collected: 06/13/23 09:19

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:55	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66440

Lab Sample ID: 680-236600-7

Date Collected: 06/13/23 10:32

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:57	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66444

Lab Sample ID: 680-236600-8

Date Collected: 06/13/23 12:21

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:58	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66445

Lab Sample ID: 680-236600-9

Date Collected: 06/13/23 12:26

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 14:03	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66441

Lab Sample ID: 680-236600-10

Date Collected: 06/13/23 15:00

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 14:05	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66397

Lab Sample ID: 680-236600-11

Date Collected: 06/14/23 11:46

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 14:06	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66396

Lab Sample ID: 680-236600-12

Date Collected: 06/14/23 12:47

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 14:08	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66395

Lab Sample ID: 680-236600-13

Date Collected: 06/14/23 13:39

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 14:09	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66394

Lab Sample ID: 680-236600-14

Date Collected: 06/14/23 14:43

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 14:11	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66405

Lab Sample ID: 680-236600-15

Date Collected: 06/15/23 09:52

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 14:12	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66392

Lab Sample ID: 680-236600-16

Date Collected: 06/15/23 13:19

Matrix: Water

Date Received: 06/20/23 10:01

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 14:14	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Method: 7470A - Mercury (CVAA)

Lab Sample ID: MB 680-784720/1-A		Client Sample ID: Method Blank									
Matrix: Water		Prep Type: Total/NA									
Analysis Batch: 785049		Prep Batch: 784720									
Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac		
Mercury	0.200	U	0.200		ug/L		06/21/23 09:47	06/22/23 13:38	1		

Lab Sample ID: LCS 680-784720/2-A		Client Sample ID: Lab Control Sample									
Matrix: Water		Prep Type: Total/NA									
Analysis Batch: 785049		Prep Batch: 784720									
Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits				
Mercury	2.50	2.408		ug/L		96	80 - 120				

Lab Sample ID: 680-236600-1 MS		Client Sample ID: AF66402									
Matrix: Water		Prep Type: Total/NA									
Analysis Batch: 785049		Prep Batch: 784720									
Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
Mercury	0.200	U	1.00	0.9928		ug/L		99	80 - 120		

Lab Sample ID: 680-236600-1 MSD		Client Sample ID: AF66402									
Matrix: Water		Prep Type: Total/NA									
Analysis Batch: 785049		Prep Batch: 784720									
Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Mercury	0.200	U	1.00	0.9964		ug/L		100	80 - 120	0	20

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Metals

Prep Batch: 784720

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-236600-1	AF66402	Total/NA	Water	7470A	
680-236600-2	AF66400	Total/NA	Water	7470A	
680-236600-3	AF66401	Total/NA	Water	7470A	
680-236600-4	AF66399	Total/NA	Water	7470A	
680-236600-5	AF66398	Total/NA	Water	7470A	
680-236600-6	AF66443	Total/NA	Water	7470A	
680-236600-7	AF66440	Total/NA	Water	7470A	
680-236600-8	AF66444	Total/NA	Water	7470A	
680-236600-9	AF66445	Total/NA	Water	7470A	
680-236600-10	AF66441	Total/NA	Water	7470A	
680-236600-11	AF66397	Total/NA	Water	7470A	
680-236600-12	AF66396	Total/NA	Water	7470A	
680-236600-13	AF66395	Total/NA	Water	7470A	
680-236600-14	AF66394	Total/NA	Water	7470A	
680-236600-15	AF66405	Total/NA	Water	7470A	
680-236600-16	AF66392	Total/NA	Water	7470A	
MB 680-784720/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-784720/2-A	Lab Control Sample	Total/NA	Water	7470A	
680-236600-1 MS	AF66402	Total/NA	Water	7470A	
680-236600-1 MSD	AF66402	Total/NA	Water	7470A	

Analysis Batch: 785049

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-236600-1	AF66402	Total/NA	Water	7470A	784720
680-236600-2	AF66400	Total/NA	Water	7470A	784720
680-236600-3	AF66401	Total/NA	Water	7470A	784720
680-236600-4	AF66399	Total/NA	Water	7470A	784720
680-236600-5	AF66398	Total/NA	Water	7470A	784720
680-236600-6	AF66443	Total/NA	Water	7470A	784720
680-236600-7	AF66440	Total/NA	Water	7470A	784720
680-236600-8	AF66444	Total/NA	Water	7470A	784720
680-236600-9	AF66445	Total/NA	Water	7470A	784720
680-236600-10	AF66441	Total/NA	Water	7470A	784720
680-236600-11	AF66397	Total/NA	Water	7470A	784720
680-236600-12	AF66396	Total/NA	Water	7470A	784720
680-236600-13	AF66395	Total/NA	Water	7470A	784720
680-236600-14	AF66394	Total/NA	Water	7470A	784720
680-236600-15	AF66405	Total/NA	Water	7470A	784720
680-236600-16	AF66392	Total/NA	Water	7470A	784720
MB 680-784720/1-A	Method Blank	Total/NA	Water	7470A	784720
LCS 680-784720/2-A	Lab Control Sample	Total/NA	Water	7470A	784720
680-236600-1 MS	AF66402	Total/NA	Water	7470A	784720
680-236600-1 MSD	AF66402	Total/NA	Water	7470A	784720

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66402

Lab Sample ID: 680-236600-1

Date Collected: 06/08/23 10:17

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 13:45

Client Sample ID: AF66400

Lab Sample ID: 680-236600-2

Date Collected: 06/08/23 11:04

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 13:49

Client Sample ID: AF66401

Lab Sample ID: 680-236600-3

Date Collected: 06/08/23 11:09

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 13:51

Client Sample ID: AF66399

Lab Sample ID: 680-236600-4

Date Collected: 06/08/23 12:31

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 13:52

Client Sample ID: AF66398

Lab Sample ID: 680-236600-5

Date Collected: 06/08/23 14:18

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 13:54

Client Sample ID: AF66443

Lab Sample ID: 680-236600-6

Date Collected: 06/13/23 09:19

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 13:55

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66440

Lab Sample ID: 680-236600-7

Date Collected: 06/13/23 10:32

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 13:57

Client Sample ID: AF66444

Lab Sample ID: 680-236600-8

Date Collected: 06/13/23 12:21

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 13:58

Client Sample ID: AF66445

Lab Sample ID: 680-236600-9

Date Collected: 06/13/23 12:26

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 14:03

Client Sample ID: AF66441

Lab Sample ID: 680-236600-10

Date Collected: 06/13/23 15:00

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 14:05

Client Sample ID: AF66397

Lab Sample ID: 680-236600-11

Date Collected: 06/14/23 11:46

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 14:06

Client Sample ID: AF66396

Lab Sample ID: 680-236600-12

Date Collected: 06/14/23 12:47

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 14:08

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Client Sample ID: AF66395

Lab Sample ID: 680-236600-13

Date Collected: 06/14/23 13:39

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 14:09

Client Sample ID: AF66394

Lab Sample ID: 680-236600-14

Date Collected: 06/14/23 14:43

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 14:11

Client Sample ID: AF66405

Lab Sample ID: 680-236600-15

Date Collected: 06/15/23 09:52

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 14:12

Client Sample ID: AF66392

Lab Sample ID: 680-236600-16

Date Collected: 06/15/23 13:19

Matrix: Water

Date Received: 06/20/23 10:01

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			784720	DW	EET SAV	06/21/23 09:47
Total/NA	Analysis	7470A		1	785049	DW	EET SAV	06/22/23 14:14

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

Chain of Custody

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.08.G02.3 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Hg		
AF66402	CAP-10	6/8/23	1017	WJK ML	1	P	G	GW	2	7470 RL ≤ 0.2 mg/L	X		
AF66400	CAP-9		1104										
AF66401	CAP-9 DUP		1109										
AF66399	CAP-8		1231										
AF66398	CAP-7		1418										
AF66443	POZ-6	6/13/23	0919										
40	POZ-3		1032										
44	POZ-7		1221										
45	POZ-7 DUP		1226										
41	POZ-4		1500										

Page 30 of 33

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sjbrown</i>	35594	6/19/23	1300	<i>[Signature]</i>	71	6-20-23	1001
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time

Sample Receiving (Internal Use Only)
 TEMP (°C): 20.5/20.3 Initial:
 Correct pH: Yes No
 Preservative Lot#:



<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	<input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	<input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> AS <input type="checkbox"/> TSS	Acidity Dielectric Strength IFT Dissolved Gases Used Oil Flashpoint Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO₃ 3=H₂SO₄ 4-HCl 5=Na₂S₂O₃ 6-Other (Specify)



Chain of Custody

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC: Yes No
 _____@santeecooper.com _____/_____/_____

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Hg			
AF66397	CAP-6	6/14/23	1146	WJK ML	1	P	G	GW	2	747D RLC 0.2 ug/L	X			
96	CAP-5		1247											
95	CAP-4		1339											
94	CAP-3		1443											
AF66405	CAP-13	6/15/23	0952											
AF66392	CAP-1		1319											

Page 31 of 33

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>sgbrown</i>	35594	6/19/23	1300	<i>TA</i>	TA	6-20-23	1001
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#:
 Date/Time/Init for preservative:

☐ METALS (all) ☐ Ag ☐ Cu ☐ Sb ☐ Al ☐ Fe ☐ Se ☐ As ☐ K ☐ Sn ☐ B ☐ Li ☐ Sr ☐ Ba ☐ Mg ☐ Ti ☐ Be ☐ Mn ☐ Tl ☐ Ca ☐ Mo ☐ V ☐ Cd ☐ Na ☐ Zn ☐ Co ☐ Ni ☐ Hg ☐ Cr ☐ Pb ☐ CrVI	Nutrients ☐ TOC ☐ DOC ☐ TP/TPO4 ☐ NH3-N ☐ F ☐ Cl ☐ NO2 ☐ Br ☐ NO3 ☐ SO4	MISC. ☐ BTEX ☐ Naphthalene ☐ THM/HAA ☐ VOC ☐ Oil & Grease ☐ E. Coli ☐ Total Coliform ☐ pH ☐ Dissolved As ☐ Dissolved Fe ☐ Rad 226 ☐ Rad 228 ☐ PCB	Gypsum ☐ Wallboard Gypsum(all below) ☐ AIM ☐ TOC ☐ Total metals ☐ Soluble Metals ☐ Purity (CaSO4) ☐ % Moisture ☐ Sulfites ☐ pH ☐ Chlorides ☐ Particle Size ☐ Sulfur	Coal ☐ Ultimate ☐ % Moisture ☐ Ash ☐ Sulfur ☐ BTUs ☐ Volatile Matter ☐ CHN Other Tests: ☐ XRF Scan ☐ HGI ☐ Fineness ☐ Particulate Matter	Flyash ☐ Ammonia ☐ LOI ☐ % Carbon ☐ Mineral Analysis ☐ Sieve ☐ % Moisture NPDES ☐ Oil & Grease ☐ As ☐ TSS	Oil Trans. Oil Qual. %Moisture Color Acidity Dielectric Strength IFT Dissolved Gases Used Oil Flashpoint Metals in oil (As,Cd,Cr,Ni,Pb) Hg TX GOFER
----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-236600-1

Login Number: 236600

List Number: 1

Creator: Sims, Robert D

List Source: Eurofins Savannah

Question	Answer	Comment
Radioactivity wasn't checked or is <=/ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	False	Thermal preservation not required.
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.08.G02.3/36500

Job ID: 680-236600-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-23

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 10/20/2023 9:13:29 AM

JOB DESCRIPTION

125915/JM02.09.G01.1/36500

JOB NUMBER

680-241786-1


Eurofins Savannah

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
10/20/2023 9:13:29 AM

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	9
QC Sample Results	12
QC Association	13
Chronicle	14
Chain of Custody	15
Receipt Checklists	16
Certification Summary	17



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Job ID: 680-241786-1

Laboratory: Eurofins Savannah

Narrative

Job Narrative 680-241786-1

Analytical test results meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page unless otherwise noted under the individual analysis. Data qualifiers are applied to indicate exceptions. Noncompliant quality control (QC) is further explained in narrative comments.

Matrix QC may not be reported if insufficient sample or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD may be performed, unless otherwise specified in the method. Surrogate and/or isotope dilution analyte recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in the narrative.

Regulated compliance samples (e.g. SDWA, NPDES) must comply with the associated agency requirements/permits.

Receipt

The samples were received on 10/17/2023 9:42 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 18.4°C

Metals

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.



Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

<u>Lab Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Collected</u>	<u>Received</u>
680-241786-1	AF80265	Water	10/10/23 11:23	10/17/23 09:42
680-241786-2	AF80266	Water	10/10/23 11:28	10/17/23 09:42
680-241786-3	AF80267	Water	10/10/23 10:15	10/17/23 09:42

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Method Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Method	Method Description	Protocol	Laboratory
7470A	Mercury (CVAA)	SW846	EET SAV
7470A	Preparation, Mercury	SW846	EET SAV

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

- 1
- 2
- 3
- 4
- 5**
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Qualifiers

Metals	
Qualifier	Qualifier Description
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Client Sample ID: AF80265

Lab Sample ID: 680-241786-1

No Detections.

Client Sample ID: AF80266

Lab Sample ID: 680-241786-2

No Detections.

Client Sample ID: AF80267

Lab Sample ID: 680-241786-3

No Detections.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Client Sample ID: AF80265

Lab Sample ID: 680-241786-1

Date Collected: 10/10/23 11:23

Matrix: Water

Date Received: 10/17/23 09:42

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		10/19/23 13:07	10/19/23 19:20	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Client Sample ID: AF80266

Lab Sample ID: 680-241786-2

Date Collected: 10/10/23 11:28

Matrix: Water

Date Received: 10/17/23 09:42

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		10/19/23 13:07	10/19/23 19:22	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Client Sample ID: AF80267

Lab Sample ID: 680-241786-3

Date Collected: 10/10/23 10:15

Matrix: Water

Date Received: 10/17/23 09:42

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		10/19/23 13:07	10/19/23 19:24	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Method: 7470A - Mercury (CVAA)

Lab Sample ID: MB 680-803558/1-A

Matrix: Water

Analysis Batch: 803723

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 803558

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		10/19/23 13:07	10/19/23 19:08	1

Lab Sample ID: LCS 680-803558/2-A

Matrix: Water

Analysis Batch: 803723

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 803558

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	2.50	2.199		ug/L		88	80 - 120



QC Association Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Metals

Prep Batch: 803558

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-241786-1	AF80265	Total/NA	Water	7470A	
680-241786-2	AF80266	Total/NA	Water	7470A	
680-241786-3	AF80267	Total/NA	Water	7470A	
MB 680-803558/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-803558/2-A	Lab Control Sample	Total/NA	Water	7470A	

Analysis Batch: 803723

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-241786-1	AF80265	Total/NA	Water	7470A	803558
680-241786-2	AF80266	Total/NA	Water	7470A	803558
680-241786-3	AF80267	Total/NA	Water	7470A	803558
MB 680-803558/1-A	Method Blank	Total/NA	Water	7470A	803558
LCS 680-803558/2-A	Lab Control Sample	Total/NA	Water	7470A	803558

1
2
3
4
5
6
7
8
9
10
11
12
13
14

Lab Chronicle

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Client Sample ID: AF80265

Lab Sample ID: 680-241786-1

Date Collected: 10/10/23 11:23

Matrix: Water

Date Received: 10/17/23 09:42

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			803558	DW	EET SAV	10/19/23 13:07
Total/NA	Analysis	7470A		1	803723	BJB	EET SAV	10/19/23 19:20

Client Sample ID: AF80266

Lab Sample ID: 680-241786-2

Date Collected: 10/10/23 11:28

Matrix: Water

Date Received: 10/17/23 09:42

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			803558	DW	EET SAV	10/19/23 13:07
Total/NA	Analysis	7470A		1	803723	BJB	EET SAV	10/19/23 19:22

Client Sample ID: AF80267

Lab Sample ID: 680-241786-3

Date Collected: 10/10/23 10:15

Matrix: Water

Date Received: 10/17/23 09:42

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			803558	DW	EET SAV	10/19/23 13:07
Total/NA	Analysis	7470A		1	803723	BJB	EET SAV	10/19/23 19:24

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858



Chain of Custody

Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LINDA.WILLIAMS @santeecooper.com

 / /

125915 / JMO2.09.G01.1 / 36500

Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes			
AF80265	CGYP-7	10/10/23	1123	ZM BB	1	P	G	GW	2	7470 RL= 0.2 ug/L	x		
66	CGYP-7 DUP		1128										
67	POZ-3		1015										



Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>S. Brown</i>	35594	10/16/23	1200	<i>C. M...</i>	<i>10/17/23</i>	<i>0942</i>	

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: 18.1/18.4
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO₃ 3=H₂SO₄ 4=HCl 5=Na₂SO₄ 6=Other (Specify)

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-241786-1

Login Number: 241786

List Source: Eurofins Savannah

List Number: 1

Creator: Munro, Caroline

Question	Answer	Comment
Radioactivity wasn't checked or is </= background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	False	Thermal preservation not required.
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-241786-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-23 *

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

* Accreditation/Certification renewal pending - accreditation/certification considered valid.



June 19, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 625517

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on June 09, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 625517 GEL Work Order: 625517

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 19, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66407 Project: SOOP00119
Sample ID: 625517001 Client ID: SOOP001
Matrix: GW
Collect Date: 06-JUN-23 08:59
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.17	0.330	1.00	mg/L		1	TSM	06/14/23	1650	2443166	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 19, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66439 Project: SOOP00119
Sample ID: 625517002 Client ID: SOOP001
Matrix: GW
Collect Date: 05-JUN-23 14:55
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		5.69	0.330	1.00	mg/L		1	TSM	06/14/23	1711	2443166	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: June 19, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 625517

Paramname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch	2443166										
QC1205432039	625517002	DUP									
Total Organic Carbon Average		5.69		5.58	mg/L	1.92		(0%-20%)	TSM	06/14/23	17:31
QC1205432038	LCS										
Total Organic Carbon Average	10.0			9.79	mg/L		97.9	(80%-120%)		06/14/23	15:35
QC1205432037	MB										
Total Organic Carbon Average			U	ND	mg/L					06/14/23	15:25
QC1205432040	625517002	PS									
Total Organic Carbon Average	10.0	5.69		14.8	mg/L		91.5	(65%-120%)		06/14/23	17:51

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected
- Z Paint Filter Test--Particulates passed through the filter, however no free liquids were observed.
- d 5-day BOD--The 2:1 depletion requirement was not met for this sample
- ^ RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.
- N/A RPD or %Recovery limits do not apply.
- ND Analyte concentration is not detected above the detection limit
- NJ Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- E General Chemistry--Concentration of the target analyte exceeds the instrument calibration range
- Q One or more quality control criteria have not been met. Refer to the applicable narrative or DER.

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 625517

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
N1		See case narrative									
R		Per section 9.3.4.1 of Method 1664 Revision B, due to matrix spike recovery issues, this result may not be reported or used for regulatory compliance purposes.									
B		The target analyte was detected in the associated blank.									
e		5-day BOD--Test replicates show more than 30% difference between high and low values. The data is qualified per the method and can be used for reporting purposes									
J		See case narrative for an explanation									

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

Technical Case Narrative
Santee Cooper
SDG #: 625517

General Chemistry

Product: Carbon, Total Organic

Analytical Method: SM 5310 B

Analytical Procedure: GL-GC-E-093 REV# 21

Analytical Batch: 2443166

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
625517001	AF66407
625517002	AF66439
1205432037	Method Blank (MB)
1205432038	Laboratory Control Sample (LCS)
1205432039	625517002(AF66439) Sample Duplicate (DUP)
1205432040	625517002(AF66439) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

6/19/23 - TOC

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 7 / 10 / 23 -RAD Send report to lcwillia@santeecooper.com & sjbrown@santeecooper.com

Chain of Custody

625517



Customer Email/Report Recipient: LCWILLIA@santeecooper.com Date Results Needed by: Project/Task/Unit #: 125915/JM02.09.G01.1/36500 Rerun request for any flagged QC (Yes) No

Analysis Group

Main Chain of Custody table with columns: Labworks ID #, Sample Location/Description, Collection Date, Collection Time, Sample Collector, Total # of containers, Bottle type, Grab (G) or Composite (C), Matrix, Preservative, Comments, RAD, TOTAL RAD, TOC.

Handwritten transfer log table with columns: Relinquished by, Employee#, Date, Time, Received by, Employee #, Date, Time.

Sample Receiving (Internal Use Only) TEMP (°C): Initial: Correct pH: Yes No Preservative Lot#: Date/Time/Init for preservative:

Checklist grid for METALS (all), Nutrients, MISC., Gypsum, Coal, Flyash, and Oil. Includes sub-sections like Ultimate, Other Tests, and NPDES.

SAMPLE RECEIPT & REVIEW FORM

Client: SCOP SDG/AR/COC/Work Order: 625517

Received By: Stacy Boone Date Received: June 9, 2023

Carrier and Tracking Number
Circle Applicable: FedEx Express FedEx Ground UPS Field Services Courier Other
19c 19c 1c

Suspected Hazard Information Yes No *If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.

A) Shipped as a DOT Hazardous? Hazard Class Shipped: UN#: If UN2910, Is the Radioactive Shipment Survey Compliant? Yes No

B) Did the client designate the samples are to be received as radioactive? COC notation or radioactive stickers on containers equal client designation.

C) Did the RSO classify the samples as radioactive? Maximum Net Counts Observed* (Observed Counts - Area Background Counts): CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3

D) Did the client designate samples are hazardous? COC notation or hazard labels on containers equal client designation.

E) Did the RSO identify possible hazards? If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:

Sample Receipt Criteria Yes NA No Comments/Qualifiers (Required for Non-Conforming Items)

1 Shipping containers received intact and sealed? Circle Applicable: Seals broken Damaged container Leaking container Other (describe)

2 Chain of custody documents included with shipment? Circle Applicable: Client contacted and provided COC COC created upon receipt

3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?* Preservation Method: Wet ice Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius

4 Daily check performed and passed on IR temperature gun? Temperature Device Serial #: IR3-23 Secondary Temperature Device Serial # (If Applicable):

5 Sample containers intact and sealed? Circle Applicable: Seals broken Damaged container Leaking container Other (describe)

6 Samples requiring chemical preservation at proper pH? Sample ID's and Containers Affected: If Preservation added, Lot#:

7 Do any samples require Volatile Analysis? If Yes, are Encores or Soil Kits present for solids? Yes No NA (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes No NA (If unknown, select No) Are liquid VOA vials free of headspace? Yes No NA Sample ID's and containers affected:

8 Samples received within holding time? ID's and tests affected:

9 Sample ID's on COC match ID's on bottles? ID's and containers affected:

10 Date & time on COC match date & time on bottles? Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)

11 Number of containers received match number indicated on COC? Circle Applicable: No container count on COC Other (describe)

12 Are sample containers identifiable as GEL provided by use of GEL labels?

13 COC form is properly signed in relinquished/received sections? Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

PM (or PMA) review: Initials JW Date 6/12/23 Page 1 of 1

List of current GEL Certifications as of 19 June 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

November 03, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 641316

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on October 13, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Jordan Melton for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 641316 GEL Work Order: 641316

The Qualifiers in this report are defined as follows:


- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80265 Project: SOOP00119
Sample ID: 641316001 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 11:23
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		2.93	+/-1.10	1.39	3.00	pCi/L		JE1	10/24/23	0847	2509217		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.58	+/-1.16			pCi/L		NXL1	11/03/23	1610	2515880		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.655	+/-0.389	0.448	1.00	pCi/L		LXP1	11/02/23	0756	2509249		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			86.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF80266	Project: SOOP00119
Sample ID: 641316002	Client ID: SOOP001
Matrix: GW	
Collect Date: 10-OCT-23 11:28	
Receive Date: 13-OCT-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		3.98	+/-1.26	1.56	3.00	pCi/L		JE1	10/24/23	0847	2509217		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		4.05	+/-1.27			pCi/L		NXL1	11/03/23	1610	2515880		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.0767	+/-0.184	0.368	1.00	pCi/L		LXP1	11/02/23	0756	2509249		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			84.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80267 Project: SOOP00119
Sample ID: 641316003 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 10:15
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	-1.54	+/-1.06	2.22	3.00	pCi/L		JE1	10/24/23	0847	2509217	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		0.205	+/-1.13			pCi/L		NXL1	11/03/23	1610	2515880	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.205	+/-0.403	0.739	1.00	pCi/L		LXP1	11/02/23	0831	2509249	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			81.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: November 3, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 641316

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2509217										
QC1205547740	641316001	DUP									
Radium-228		2.93		3.95	pCi/L	29.7		(0% - 100%)	JE1	10/24/23	08:47
		Uncertainty	+/-1.10	+/-1.15							
QC1205547741	LCS										
Radium-228		78.3		71.6	pCi/L		91.4	(75%-125%)		10/24/23	08:48
		Uncertainty		+/-3.85							
QC1205547739	MB										
Radium-228			U	0.166	pCi/L					10/24/23	08:47
		Uncertainty		+/-0.981							
Rad Ra-226											
Batch	2509249										
QC1205547810	641316001	DUP									
Radium-226		0.655		1.02	pCi/L	43.9		(0% - 100%)	LXP1	11/02/23	08:31
		Uncertainty	+/-0.389	+/-0.511							
QC1205547812	LCS										
Radium-226		26.9		23.3	pCi/L		86.5	(75%-125%)		11/02/23	08:31
		Uncertainty		+/-2.01							
QC1205547809	MB										
Radium-226			U	0.176	pCi/L					11/02/23	08:31
		Uncertainty		+/-0.345							
QC1205547811	641316001	MS									
Radium-226		134		106	pCi/L		78.5	(75%-125%)		11/02/23	08:31
		Uncertainty	+/-0.389	+/-10.4							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 641316

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 641316**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2509217

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
641316001	AF80265
641316002	AF80266
641316003	AF80267
1205547739	Method Blank (MB)
1205547740	641316001(AF80265) Sample Duplicate (DUP)
1205547741	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2509249

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
641316001	AF80265
641316002	AF80266
641316003	AF80267
1205547809	Method Blank (MB)
1205547810	641316001(AF80265) Sample Duplicate (DUP)
1205547811	641316001(AF80265) Matrix Spike (MS)
1205547812	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where

applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

The matrix spike, 1205547811 (AF80265MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

11/13/23 -RAD

Contract Lab Info: GEL

Contract Lab Due Date (Lab Only): 11 / 20 / 23

Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody

641316
641317



Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LINDA WILLIAMS @santecooper.com

/ /

125915 / JMO2.09.G01.1 / 36500

Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	Rad 226/228	TOTAL RAD CALC	F, Cl, SO4
AF 80265	CGYP-7	10/10/23	1123	ZM BB	3	P	G	GW	2 1	• Method # • Reporting limit • Misc. sample info • Any other notes	2	X	1
AF 80266	CGYP-7 DUP		1128										
AF 80267	POZ-3		1515										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	36851	10/13/23	0944	<i>[Signature]</i>	GEL	10/13/23	0944
<i>[Signature]</i>	GEL	10/13/23	1610	<i>[Signature]</i>	GEL	10/13/23	1610

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOCP</u>		SDG/AR/COC/Work Order: <u>641316 / 641317</u>		
Received By: <u>QG</u>		Date Received: <u>10/18/23</u>		
Carrier and Tracking Number		FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other		
Suspected Hazard Information		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.		
A) Shipped as a DOT Hazardous?		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___		
B) Did the client designate the samples to be received as radioactive?		COC notation or radioactive stickers on containers equal client designation		
C) Did the RSO classify the samples as radioactive?		Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> <u>5</u> <u>SPM/mR/hr</u> Classified as: Rad 1 Rad 2 Rad 3		
D) Did the client designate samples are hazardous?		COC notation or hazard labels on containers equal client designation		
E) Did the RSO identify possible hazards?		If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:		
Sample Receipt Criteria		Yes	NA	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Preservation Method: Wet Ice Ice Packs Dry Ice None Other: *all temperatures are recorded in Celsius TEMP: <u>3°C</u>
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Temperature Device Serial #: <u>IR1-23</u> Secondary Temperature Device Serial # (If Applicable):
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#:
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	If Yes, are Bincoros or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and tests affected:
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and containers affected:
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed):				

JR

n/a

PM (or PMA) review: Initials glw Date 10/16/23 Page 1 of 1

List of current GEL Certifications as of 03 November 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-04
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2023-152
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122023-38
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



July 07, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 625513

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on June 09, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 625513 GEL Work Order: 625513

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66418	Project: SOOP00119
Sample ID: 625513001	Client ID: SOOP001
Matrix: GW	
Collect Date: 06-JUN-23 10:07	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		3.59	+/-1.54	2.23	3.00	pCi/L		JE1	06/29/23	1125	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		4.25	+/-1.57			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.661	+/-0.343	0.316	1.00	pCi/L		LXP1	07/07/23	0950	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			94.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66419	Project: SOOP00119
Sample ID: 625513002	Client ID: SOOP001
Matrix: GW	
Collect Date: 06-JUN-23 11:17	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.760	+/-0.817	1.36	3.00	pCi/L		JE1	06/29/23	1126	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.34	+/-0.902			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.583	+/-0.383	0.496	1.00	pCi/L		LXP1	07/07/23	0950	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			92.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66420 Project: SOOP00119
Sample ID: 625513003 Client ID: SOOP001
Matrix: GW
Collect Date: 06-JUN-23 12:17
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.736	+/-0.975	1.66	3.00	pCi/L		JE1	06/29/23	1126	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.00	+/-1.10			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.26	+/-0.511	0.449	1.00	pCi/L		LXP1	07/07/23	0950	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			90.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66425 Project: SOOP00119
Sample ID: 625513004 Client ID: SOOP001
Matrix: GW
Collect Date: 06-JUN-23 13:29
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.61	+/-1.06	1.39	3.00	pCi/L		JE1	06/29/23	1126	2442125	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.94	+/-1.22			pCi/L		NXL1	07/07/23	1432	2442124	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		1.32	+/-0.599	0.683	1.00	pCi/L		LXP1	07/07/23	1023	2442111	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			88.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66421 Project: SOOP00119
Sample ID: 625513005 Client ID: SOOP001
Matrix: GW
Collect Date: 06-JUN-23 14:58
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.16	+/-1.17	1.95	3.00	pCi/L		JE1	06/29/23	1126	2442125	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.01	+/-1.32			pCi/L		NXL1	07/07/23	1432	2442124	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		1.85	+/-0.606	0.498	1.00	pCi/L		LXP1	07/07/23	1023	2442111	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			88.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66417 Project: SOOP00119
Sample ID: 625513006 Client ID: SOOP001
Matrix: GW
Collect Date: 06-JUN-23 15:45
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.568	+/-0.635	1.06	3.00	pCi/L		JE1	06/29/23	1126	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.39	+/-0.745			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.824	+/-0.390	0.332	1.00	pCi/L		LXP1	07/07/23	1023	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			88.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66431	Project: SOOP00119
Sample ID: 625513007	Client ID: SOOP001
Matrix: GW	
Collect Date: 07-JUN-23 09:04	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		3.78	+/-1.47	2.11	3.00	pCi/L		JE1	06/29/23	1126	2442125	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		6.60	+/-1.69			pCi/L		NXL1	07/07/23	1432	2442124	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		2.81	+/-0.840	0.478	1.00	pCi/L		LXP1	07/07/23	1023	2442111	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			94	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66426	Project: SOOP00119
Sample ID: 625513008	Client ID: SOOP001
Matrix: GW	
Collect Date: 07-JUN-23 10:04	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.960	+/-1.13	1.91	3.00	pCi/L		JE1	06/29/23	1126	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.77	+/-1.20			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.809	+/-0.394	0.344	1.00	pCi/L		LXP1	07/07/23	1023	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			84.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66427 Project: SOOP00119
Sample ID: 625513009 Client ID: SOOP001
Matrix: GW
Collect Date: 07-JUN-23 10:09
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		1.56	+/-0.897	1.30	3.00	pCi/L		JE1	06/29/23	1126	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.44	+/-1.01			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.875	+/-0.454	0.538	1.00	pCi/L		LXP1	07/07/23	1023	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			88.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66428	Project: SOOP00119
Sample ID: 625513010	Client ID: SOOP001
Matrix: GW	
Collect Date: 07-JUN-23 11:35	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		4.17	+/-1.37	1.68	3.00	pCi/L		JE1	07/03/23	1431	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		5.33	+/-1.47			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.16	+/-0.537	0.640	1.00	pCi/L		LXP1	07/07/23	1023	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			78	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66429	Project: SOOP00119
Sample ID: 625513011	Client ID: SOOP001
Matrix: GW	
Collect Date: 07-JUN-23 12:27	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		1.51	+/-0.891	1.26	3.00	pCi/L		JE1	06/29/23	1126	2442125	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		1.67	+/-0.940			pCi/L		NXL1	07/07/23	1432	2442124	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.153	+/-0.300	0.564	1.00	pCi/L		LXP1	07/07/23	1023	2442111	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			85.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66430	Project: SOOP00119
Sample ID: 625513012	Client ID: SOOP001
Matrix: GW	
Collect Date: 07-JUN-23 13:37	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		4.53	+/-1.26	1.43	3.00	pCi/L		JE1	06/29/23	1126	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		5.69	+/-1.34			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.16	+/-0.469	0.412	1.00	pCi/L		LXP1	07/07/23	1057	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			88.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66407	Project: SOOP00119
Sample ID: 625513013	Client ID: SOOP001
Matrix: GW	
Collect Date: 06-JUN-23 08:59	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		4.12	+/-1.22	1.47	3.00	pCi/L		JE1	06/29/23	1126	2442125	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		5.08	+/-1.31			pCi/L		NXL1	07/07/23	1432	2442124	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.968	+/-0.488	0.590	1.00	pCi/L		LXP1	07/07/23	1057	2442111	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			89.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 7, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66439	Project: SOOP00119
Sample ID: 625513014	Client ID: SOOP001
Matrix: GW	
Collect Date: 05-JUN-23 14:55	
Receive Date: 09-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.236	+/-1.04	1.88	3.00	pCi/L		JE1	06/29/23	1126	2442125		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.70	+/-1.34			pCi/L		NXL1	07/07/23	1432	2442124		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		3.47	+/-0.842	0.396	1.00	pCi/L		LXP1	07/07/23	1057	2442111		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			83.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: July 7, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 625513

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2442125										
QC1205429946	625513001	DUP									
Radium-228		3.59		2.51	pCi/L	35.3		(0% - 100%)	JE1	06/29/23	11:25
	Uncertainty	+/-1.54		+/-1.06							
QC1205429947	LCS										
Radium-228		79.7		73.2	pCi/L		91.9	(75%-125%)		06/29/23	11:25
	Uncertainty			+/-4.32							
QC1205429945	MB										
Radium-228			U	1.12	pCi/L					06/29/23	11:25
	Uncertainty			+/-0.786							
Rad Ra-226											
Batch	2442111										
QC1205429911	625513001	DUP									
Radium-226		0.661		0.801	pCi/L	19.1		(0% - 100%)	LXP1	07/07/23	10:57
	Uncertainty	+/-0.343		+/-0.409							
QC1205429913	LCS										
Radium-226		26.3		22.7	pCi/L		86.1	(75%-125%)		07/07/23	10:57
	Uncertainty			+/-2.09							
QC1205429910	MB										
Radium-226			U	0.248	pCi/L					07/07/23	10:57
	Uncertainty			+/-0.256							
QC1205429912	625513001	MS									
Radium-226		129		109	pCi/L		84.1	(75%-125%)		07/07/23	10:57
	Uncertainty	+/-0.343		+/-9.86							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 625513

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 625513**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2442125

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
625513001	AF66418
625513002	AF66419
625513003	AF66420
625513004	AF66425
625513005	AF66421
625513006	AF66417
625513007	AF66431
625513008	AF66426
625513009	AF66427
625513010	AF66428
625513011	AF66429
625513012	AF66430
625513013	AF66407
625513014	AF66439
1205429945	Method Blank (MB)
1205429946	625513001(AF66418) Sample Duplicate (DUP)
1205429947	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Technical Information

Recounts

Sample 625513010 (AF66428) was re-eluted and recounted to verify sample result. The recount is reported.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2442111

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
625513001	AF66418
625513002	AF66419
625513003	AF66420
625513004	AF66425
625513005	AF66421
625513006	AF66417
625513007	AF66431
625513008	AF66426
625513009	AF66427
625513010	AF66428
625513011	AF66429
625513012	AF66430
625513013	AF66407
625513014	AF66439
1205429910	Method Blank (MB)
1205429911	625513001(AF66418) Sample Duplicate (DUP)
1205429912	625513001(AF66418) Matrix Spike (MS)
1205429913	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Chain of Custody

625513



Customer Email/Report Recipient: Date Results Needed by: Project/Task/Unit #: Rerun request for any flagged QC

LCWILLIA @santecooper.com / / 125915 / JM02.09. G01.1 / 36500 Yes No

Analysis Group

Main Chain of Custody table with columns: Labworks ID #, Sample Location/Description, Collection Date, Collection Time, Sample Collector, Total # of containers, Bottle type, Grab (G) or Composite (C), Matrix, Preservative, Comments, RAD 226, RAD 228, TOTAL RAD CALC.

Relinquished by/Received by table with columns: Relinquished by, Employee#, Date, Time, Received by, Employee #, Date, Time.

Sample Receiving (Internal Use Only) TEMP (°C): Initial: Correct pH: Yes No Preservative Lot#: Date/Time/Init for preservative:

Checklist for METALS (all), Nutrients, MISC., Gypsum, Coal, Flyash, and Oil. Includes various chemical and physical test options.



Chain of Custody

Customer Email/Report Recipient: LCWILLIA@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915/JM02.09-G01.1/36500 Rerun request for any flagged QC: (Yes) No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass/ G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	RAD 226/228	TOTAL RAD CALC	TDC
AF66431	CGYP-7	6/7/23	0904	WJK ML	2	P	G	GW	2		1	1	
26	CGYP-2		1004										
27	CGYP-2 DUP		1009										
28	CGYP-3		1135										
29	CGYP-4		1227										
30	CGYP-6		1337										
AF66407	CBW-1	6/6/23	0859		3				2/3/1		1	1	1
AF66439	PM-1	6/5/23	1455		3				2/3/1		1	1	1

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	6/9/23	0946	<i>DUP</i>	GEL	6/9/23	0946
<i>DLW</i>	6616	6/9/23	1436	<i>LSR</i>		6/9/23	14:35

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO <input type="checkbox"/> NH ₃ <input type="checkbox"/> NH ₄ <input type="checkbox"/> NO ₂ <input type="checkbox"/> NO ₃ <input type="checkbox"/> NO _x <input type="checkbox"/> SO ₄	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gas/SL Sulfide Volatile Cyanide Boron Chloride Fluoride Nitrate Nitrite Phosphate Silicate Sulfate Total Solids Total Suspended Solids Total Dissolved Solids Total Soluble Solids Total Suspended Solids Total Dissolved Solids Total Soluble Solids	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> % Ash <input type="checkbox"/> % Sulfur <input type="checkbox"/> % BTU <input type="checkbox"/> % Volatile Matter <input type="checkbox"/> % CHN Other Tests: <input type="checkbox"/> % Sulfur <input type="checkbox"/> % Chlorine <input type="checkbox"/> % Nitrogen <input type="checkbox"/> % Phosphorus <input type="checkbox"/> % Particulate Matter	Hyash <input type="checkbox"/> Ammonia <input type="checkbox"/> Chloride <input type="checkbox"/> % Carbon <input type="checkbox"/> % Moisture <input type="checkbox"/> % Sulfur <input type="checkbox"/> % Nitrogen <input type="checkbox"/> % Phosphorus <input type="checkbox"/> % Particulate Matter INP/DES <input type="checkbox"/> % Moisture <input type="checkbox"/> % Sulfur <input type="checkbox"/> % Nitrogen <input type="checkbox"/> % Phosphorus <input type="checkbox"/> % Particulate Matter
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------



Laboratories LLC

SAMPLE RECEIPT & REVIEW FORM

Client:	SOOP	SDG/AR/COC/Work Order:	625513
Received By:	Stacy Boone	Date Received:	June 9, 2023
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services Courier Other	

Suspected Hazard Information	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?	<input checked="" type="checkbox"/>		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radionactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive?	<input checked="" type="checkbox"/>		COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive?	<input checked="" type="checkbox"/>		Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?	<input checked="" type="checkbox"/>		COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards?	<input checked="" type="checkbox"/>		If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:

Sample Receipt Criterion	Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1 Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2 Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Preservation Method: Wet Ice Ice Packs Dry ice <u>None</u> Other: *all temperatures are recorded in Celsius TEMP: see Tracking
4 Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Temperature Device Serial #: IR2-22 IR3-23 Secondary Temperature Device Serial # (If Applicable):
5 Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6 Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#:
7 Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8 Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and tests affected:
9 Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and containers affected:
10 Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11 Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12 Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
13 COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

PM (or PMA) review: Initials JBW Date 6/12/23 Page 1 of 1

List of current GEL Certifications as of 07 July 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

January 11, 2024

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 649122

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on December 15, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 649122 GEL Work Order: 649122

The Qualifiers in this report are defined as follows:


- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF85222	Project: SOOP00119
Sample ID: 649122001	Client ID: SOOP001
Matrix: GW	
Collect Date: 11-DEC-23 13:19	
Receive Date: 15-DEC-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.18	+/-0.837	1.29	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.83	+/-0.888			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.646	+/-0.296	0.311	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			87.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85223 Project: SOOP00119
Sample ID: 649122002 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 10:24
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.944	+/-1.02	1.71	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.52	+/-1.17			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		2.58	+/-0.567	0.297	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			92.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF85224	Project: SOOP00119
Sample ID: 649122003	Client ID: SOOP001
Matrix: GW	
Collect Date: 11-DEC-23 10:29	
Receive Date: 15-DEC-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		1.39	+/-0.763	1.07	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.18	+/-0.935			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.79	+/-0.539	0.495	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			89.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF85225	Project: SOOP00119
Sample ID: 649122004	Client ID: SOOP001
Matrix: GW	
Collect Date: 11-DEC-23 11:50	
Receive Date: 15-DEC-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.328	+/-0.652	1.17	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.72	+/-0.827			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.39	+/-0.509	0.561	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			86.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: January 11, 2024

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 649122

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2542833										
QC1205605880	648208001	DUP									
Radium-228		4.72		2.46	pCi/L	63		(0% - 100%)	JE1	12/29/23	13:55
	Uncertainty	+/-1.37		+/-1.03							
QC1205605881	LCS										
Radium-228		74.3		71.5	pCi/L		96.1	(75%-125%)		12/29/23	13:55
	Uncertainty			+/-4.39							
QC1205605879	MB										
Radium-228			U	0.437	pCi/L					12/29/23	13:55
	Uncertainty			+/-0.605							
Rad Ra-226											
Batch	2541882										
QC1205603843	649122001	DUP									
Radium-226		0.646		0.568	pCi/L	12.8		(0% - 100%)	LXP1	01/10/24	09:11
	Uncertainty	+/-0.296		+/-0.341							
QC1205603846	LCS										
Radium-226		17.0		13.0	pCi/L		76.2	(75%-125%)		01/10/24	09:11
	Uncertainty			+/-1.02							
QC1205603841	MB										
Radium-226			U	0.177	pCi/L					01/10/24	09:11
	Uncertainty			+/-0.203							
QC1205603845	649122001	MS									
Radium-226		113		93.8	pCi/L		82.2	(75%-125%)		01/10/24	09:11
	Uncertainty	+/-0.296		+/-6.51							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 649122

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 649122**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2542833

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
649122001	AF85222
649122002	AF85223
649122003	AF85224
649122004	AF85225
1205605879	Method Blank (MB)
1205605880	648208001(AF84383) Sample Duplicate (DUP)
1205605881	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2541882

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
649122001	AF85222
649122002	AF85223
649122003	AF85224
649122004	AF85225
1205603841	Method Blank (MB)
1205603843	649122001(AF85222) Sample Duplicate (DUP)
1205603845	649122001(AF85222) Matrix Spike (MS)
1205603846	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information**Additional Comments**

Aliquots for the matrix spikes, 1205603845 (AF85222MS), were reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Chain of Custody

649122



Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LINDA.WILLIAMS @santeecooper.com _____ / _____ / _____ 1259115 / JM=2.07.GP1.1 / 36500 YES NO

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments		
AF85222	WAP-27	12/11/23	1319	ZM ML	2	G	G	GW	2	• Method # • Reporting limit • Misc. sample info • Any other notes	RAD 226/228	TOTAL RAD CALC
AF85223	WAP-28		1024									
AF85224	WAP-28 DUP		1029									
AF85225	WAP-29		1150									

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	36851	12/15/23	0923	<i>[Signature]</i>	GEL	12/15/23	1923
<i>[Signature]</i>	GEL	12/15/23	1610	<i>[Signature]</i>	GEL	12/15/23	1810

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particulate Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SDGP</u>		SDG/AR/COC/Work Order: <u>649122</u>
Received By: <u>QG</u>		Date Received: <u>12/15/23</u>
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Carrier</u> Other
		<u>nlc</u>
Suspected Hazard Information		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive?		COC notation or radioactive stickers on containers equal client designation
C) Did the RSO classify the samples as radioactive?		Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> <u>CPM</u> mR/HR Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?		COC notation or hazard labels on containers equal client designation
E) Did the RSO identify possible hazards?		If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____
Sample Receipt Criteria		Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	Preservation Method: <u>Wet Ice</u> Ice Packs Dry ice <u>None</u> Other: _____ *all temperatures are recorded in Celsius TEMP: <u>2°C</u>
4	Daily check performed and passed on IR temperature gun?	Temperature Device Serial #: <u>IR1-23</u> Secondary Temperature Device Serial # (If Applicable): _____
5	Sample containers intact and sealed?	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	Sample ID's and Containers Affected: If Preservation added, Lot#: _____
7	Do any samples require Volatile Analysis?	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected: _____
8	Samples received within holding time?	ID's and tests affected: _____
9	Sample ID's on COC match ID's on bottles?	ID's and containers affected: _____
10	Date & time on COC match date & time on bottles?	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	Circle Applicable: No container count on COC Other (describe) <u>only received 1 container for AP85752</u> *100 649122
12	Are sample containers identifiable as GEL provided by use of GEL labels?	
13	COC form is properly signed in relinquished/received sections?	Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed):		

PM (or PMA) review: Initials JW Date 12/16/23 Page 1 of 1

List of current GEL Certifications as of 11 January 2024

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-05
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2023-152
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122023-38
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 12/15/2023 11:58:21 AM Revision 1

JOB DESCRIPTION

125915/JM02 09.G011/36500

JOB NUMBER

680-244036-1


Eurofins Savannah

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
12/15/2023 11:58:21 AM
Revision 1

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	9
QC Sample Results	12
QC Association	13
Chronicle	14
Chain of Custody	15
Receipt Checklists	16
Certification Summary	17



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Job ID: 680-244036-1

Laboratory: Eurofins Savannah

Narrative

**Job Narrative
680-244036-1**

REVISION

The report being provided is a revision of the original report sent on 12/13/2023. The report (revision 1) is being revised due to Client wants non-client batch QC reported.

Analytical test results meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page unless otherwise noted under the individual analysis. Data qualifiers are applied to indicate exceptions. Noncompliant quality control (QC) is further explained in narrative comments.

Matrix QC may not be reported if insufficient sample or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD may be performed, unless otherwise specified in the method. Surrogate and/or isotope dilution analyte recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in the narrative.

Regulated compliance samples (e.g. SDWA, NPDES) must comply with the associated agency requirements/permits.

Receipt

The samples were received on 12/8/2023 10:03 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 13.7°C

Metals

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.



Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

<u>Lab Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Collected</u>	<u>Received</u>
680-244036-1	AF84383	Water	12/05/23 13:26	12/08/23 10:03
680-244036-2	AF84384	Water	12/05/23 13:31	12/08/23 10:03
680-244036-3	AF84385	Water	12/05/23 10:14	12/08/23 10:03

1

2

3

4

5

6

7

8

9

10

11

12

13

14

Method Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Method	Method Description	Protocol	Laboratory
7470A	Mercury (CVAA)	SW846	EET SAV
7470A	Preparation, Mercury	SW846	EET SAV

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Qualifiers

Metals

Qualifier	Qualifier Description
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Client Sample ID: AF84383

Lab Sample ID: 680-244036-1

No Detections.

Client Sample ID: AF84384

Lab Sample ID: 680-244036-2

No Detections.

Client Sample ID: AF84385

Lab Sample ID: 680-244036-3

No Detections.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Client Sample ID: AF84383

Lab Sample ID: 680-244036-1

Date Collected: 12/05/23 13:26

Matrix: Water

Date Received: 12/08/23 10:03

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		12/12/23 14:51	12/13/23 12:11	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Client Sample ID: AF84384

Lab Sample ID: 680-244036-2

Date Collected: 12/05/23 13:31

Matrix: Water

Date Received: 12/08/23 10:03

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		12/12/23 14:51	12/13/23 12:13	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Client Sample ID: AF84385

Lab Sample ID: 680-244036-3

Date Collected: 12/05/23 10:14

Matrix: Water

Date Received: 12/08/23 10:03

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		12/12/23 14:51	12/13/23 12:20	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Method: 7470A - Mercury (CVAA)

Lab Sample ID: MB 680-812975/1-A
Matrix: Water
Analysis Batch: 813193

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 812975

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		12/12/23 14:51	12/13/23 12:03	1

Lab Sample ID: LCS 680-812975/2-A
Matrix: Water
Analysis Batch: 813193

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 812975

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	2.50	2.393		ug/L		96	80 - 120

Lab Sample ID: 680-243880-E-3-E MS
Matrix: Water
Analysis Batch: 813193

Client Sample ID: Matrix Spike
Prep Type: Total/NA
Prep Batch: 812975

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	0.200	U	1.00	0.9594		ug/L		96	80 - 120

Lab Sample ID: 680-243880-E-3-F MSD
Matrix: Water
Analysis Batch: 813193

Client Sample ID: Matrix Spike Duplicate
Prep Type: Total/NA
Prep Batch: 812975

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Mercury	0.200	U	1.00	0.9701		ug/L		97	80 - 120	1	20

QC Association Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Metals

Prep Batch: 812975

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-244036-1	AF84383	Total/NA	Water	7470A	
680-244036-2	AF84384	Total/NA	Water	7470A	
680-244036-3	AF84385	Total/NA	Water	7470A	
MB 680-812975/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-812975/2-A	Lab Control Sample	Total/NA	Water	7470A	
680-243880-E-3-E MS	Matrix Spike	Total/NA	Water	7470A	
680-243880-E-3-F MSD	Matrix Spike Duplicate	Total/NA	Water	7470A	

Analysis Batch: 813193

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-244036-1	AF84383	Total/NA	Water	7470A	812975
680-244036-2	AF84384	Total/NA	Water	7470A	812975
680-244036-3	AF84385	Total/NA	Water	7470A	812975
MB 680-812975/1-A	Method Blank	Total/NA	Water	7470A	812975
LCS 680-812975/2-A	Lab Control Sample	Total/NA	Water	7470A	812975
680-243880-E-3-E MS	Matrix Spike	Total/NA	Water	7470A	812975
680-243880-E-3-F MSD	Matrix Spike Duplicate	Total/NA	Water	7470A	812975

Lab Chronicle

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Client Sample ID: AF84383

Lab Sample ID: 680-244036-1

Date Collected: 12/05/23 13:26

Matrix: Water

Date Received: 12/08/23 10:03

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			812975	DW	EET SAV	12/12/23 14:51
Total/NA	Analysis	7470A		1	813193	BCB	EET SAV	12/13/23 12:11

Client Sample ID: AF84384

Lab Sample ID: 680-244036-2

Date Collected: 12/05/23 13:31

Matrix: Water

Date Received: 12/08/23 10:03

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			812975	DW	EET SAV	12/12/23 14:51
Total/NA	Analysis	7470A		1	813193	BCB	EET SAV	12/13/23 12:13

Client Sample ID: AF84385

Lab Sample ID: 680-244036-3

Date Collected: 12/05/23 10:14

Matrix: Water

Date Received: 12/08/23 10:03

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			812975	DW	EET SAV	12/12/23 14:51
Total/NA	Analysis	7470A		1	813193	BCB	EET SAV	12/13/23 12:20

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858


Chain of Custody



Customer Email/Report Recipient: LINDA WILLIAMS @santecooper.com Date Results Needed by: / / Project/Task/Unit #: 125715 / JM02 09-GP11 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Hg			
AF84383	CGYP-7	12/5/23	1326	ZM BB	1	P	G	GW	2	RL<0.2 ug/L 7471	X			
AF84384	CGYP-7 DUP		1331											
AF84385	POZ-3		1014											

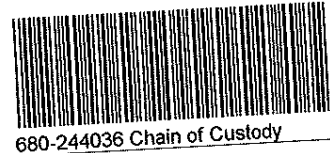

Page 15 of 17

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Skrvy</i>	35574	12/6/23	1200	<i>Zolt</i>		12/8/23	1603

Sample Receiving (Internal Use Only)
TEMP (°C): 13.9/13.7 Initial:
Correct pH: Yes No
Preservative Lot#:
Date/Time/Init for preservative:

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/EPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard <input type="checkbox"/> Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Pineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Total Oil Qual. <input type="checkbox"/> Petroleum <input type="checkbox"/> Color <input type="checkbox"/> Viscosity <input type="checkbox"/> Density <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Heavy Metal <input type="checkbox"/> (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> PAH <input type="checkbox"/> GOWFA
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-244036-1

Login Number: 244036

List Source: Eurofins Savannah

List Number: 1

Creator: Stewart, Rendaisha

Question	Answer	Comment
Radioactivity wasn't checked or is </= background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02 09.G011/36500

Job ID: 680-244036-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-24

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 8/16/2023 10:58:28 AM

JOB DESCRIPTION

125915/JM02.09.G01.1/36500

JOB NUMBER

680-238944-1


Eurofins Savannah

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
8/16/2023 10:58:28 AM

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	10
QC Sample Results	19
QC Association	21
Chronicle	23
Chain of Custody	26
Receipt Checklists	28
Certification Summary	29



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Job ID: 680-238944-1

Laboratory: Eurofins Savannah

Narrative

Job Narrative
680-238944-1

Receipt

The samples were received on 8/10/2023 10:25 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 26.3°C

Metals

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-238944-1	AF71896	Water	08/01/23 09:53	08/10/23 10:25
680-238944-2	AF71893	Water	08/01/23 10:45	08/10/23 10:25
680-238944-3	AF71894	Water	08/01/23 11:52	08/10/23 10:25
680-238944-4	AF71895	Water	08/01/23 13:17	08/10/23 10:25
680-238944-5	AF71891	Water	08/02/23 09:03	08/10/23 10:25
680-238944-6	AF71892	Water	08/02/23 09:08	08/10/23 10:25
680-238944-7	AF71897	Water	08/02/23 10:00	08/10/23 10:25
680-238944-8	AF71898	Water	08/02/23 10:05	08/10/23 10:25
680-238944-9	AF71899	Water	08/02/23 11:37	08/10/23 10:25

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Method Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Method	Method Description	Protocol	Laboratory
6010D	Metals (ICP)	SW846	EET SAV
6020B	Metals (ICP/MS)	SW846	EET SAV
7470A	Mercury (CVAA)	SW846	EET SAV
3005A	Preparation, Total Recoverable or Dissolved Metals	SW846	EET SAV
7470A	Preparation, Mercury	SW846	EET SAV

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858



Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Qualifiers

Metals	
Qualifier	Qualifier Description
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71896

Lab Sample ID: 680-238944-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	67500		500		ug/L	1		6010D	Total Recoverable
Barium	851		5.00		ug/L	1		6020B	Total Recoverable
Cobalt	6.35		0.500		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF71893

Lab Sample ID: 680-238944-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	73400		500		ug/L	1		6010D	Total Recoverable
Arsenic	12.0		3.00		ug/L	1		6020B	Total Recoverable
Barium	21.8		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	3.18		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	0.820		0.500		ug/L	1		6020B	Total Recoverable
Cobalt	84.7		0.500		ug/L	1		6020B	Total Recoverable
Lead	13.4		2.50		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF71894

Lab Sample ID: 680-238944-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	27400		500		ug/L	1		6010D	Total Recoverable
Arsenic	7.66		3.00		ug/L	1		6020B	Total Recoverable
Barium	30.5		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	7.29		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	0.615		0.500		ug/L	1		6020B	Total Recoverable
Cobalt	60.6		0.500		ug/L	1		6020B	Total Recoverable
Lead	9.41		2.50		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF71895

Lab Sample ID: 680-238944-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	222000		500		ug/L	1		6010D	Total Recoverable
Barium	510		5.00		ug/L	1		6020B	Total Recoverable
Cobalt	7.74		0.500		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF71891

Lab Sample ID: 680-238944-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	133000		500		ug/L	1		6010D	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Detection Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71891 (Continued)

Lab Sample ID: 680-238944-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Barium	301		5.00		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF71892

Lab Sample ID: 680-238944-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	139000		500		ug/L	1		6010D	Total Recoverable
Barium	310		5.00		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF71897

Lab Sample ID: 680-238944-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	262000		500		ug/L	1		6010D	Total Recoverable
Arsenic	15.2		3.00		ug/L	1		6020B	Total Recoverable
Barium	27.1		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	9.82		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	0.560		0.500		ug/L	1		6020B	Total Recoverable
Cobalt	61.5		0.500		ug/L	1		6020B	Total Recoverable
Lead	37.0		2.50		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF71898

Lab Sample ID: 680-238944-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	262000		500		ug/L	1		6010D	Total Recoverable
Arsenic	14.0		3.00		ug/L	1		6020B	Total Recoverable
Barium	26.3		5.00		ug/L	1		6020B	Total Recoverable
Beryllium	9.79		0.500		ug/L	1		6020B	Total Recoverable
Cadmium	0.565		0.500		ug/L	1		6020B	Total Recoverable
Cobalt	60.6		0.500		ug/L	1		6020B	Total Recoverable
Lead	36.6		2.50		ug/L	1		6020B	Total Recoverable

Client Sample ID: AF71899

Lab Sample ID: 680-238944-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Calcium	159000		500		ug/L	1		6010D	Total Recoverable
Barium	96.5		5.00		ug/L	1		6020B	Total Recoverable
Cobalt	2.39		0.500		ug/L	1		6020B	Total Recoverable

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71896

Lab Sample ID: 680-238944-1

Date Collected: 08/01/23 09:53

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	67500		500		ug/L		08/11/23 05:22	08/11/23 13:45	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 13:45	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:21	1
Arsenic	3.00	U	3.00		ug/L		08/11/23 05:22	08/11/23 13:21	1
Barium	851		5.00		ug/L		08/11/23 05:22	08/11/23 13:21	1
Beryllium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:21	1
Cadmium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:21	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:21	1
Cobalt	6.35		0.500		ug/L		08/11/23 05:22	08/11/23 13:21	1
Lead	2.50	U	2.50		ug/L		08/11/23 05:22	08/11/23 13:21	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 13:21	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:01	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71893

Lab Sample ID: 680-238944-2

Date Collected: 08/01/23 10:45

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	73400		500		ug/L		08/11/23 05:22	08/11/23 13:47	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 13:47	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:25	1
Arsenic	12.0		3.00		ug/L		08/11/23 05:22	08/11/23 13:25	1
Barium	21.8		5.00		ug/L		08/11/23 05:22	08/11/23 13:25	1
Beryllium	3.18		0.500		ug/L		08/11/23 05:22	08/11/23 13:25	1
Cadmium	0.820		0.500		ug/L		08/11/23 05:22	08/11/23 13:25	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:25	1
Cobalt	84.7		0.500		ug/L		08/11/23 05:22	08/11/23 13:25	1
Lead	13.4		2.50		ug/L		08/11/23 05:22	08/11/23 13:25	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 13:25	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:02	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71894

Lab Sample ID: 680-238944-3

Date Collected: 08/01/23 11:52

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	27400		500		ug/L		08/11/23 05:22	08/11/23 13:49	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 13:49	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:29	1
Arsenic	7.66		3.00		ug/L		08/11/23 05:22	08/11/23 13:29	1
Barium	30.5		5.00		ug/L		08/11/23 05:22	08/11/23 13:29	1
Beryllium	7.29		0.500		ug/L		08/11/23 05:22	08/11/23 13:29	1
Cadmium	0.615		0.500		ug/L		08/11/23 05:22	08/11/23 13:29	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:29	1
Cobalt	60.6		0.500		ug/L		08/11/23 05:22	08/11/23 13:29	1
Lead	9.41		2.50		ug/L		08/11/23 05:22	08/11/23 13:29	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 13:29	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:04	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71895

Lab Sample ID: 680-238944-4

Date Collected: 08/01/23 13:17

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	222000		500		ug/L		08/11/23 05:22	08/11/23 13:51	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 13:51	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:33	1
Arsenic	3.00	U	3.00		ug/L		08/11/23 05:22	08/11/23 13:33	1
Barium	510		5.00		ug/L		08/11/23 05:22	08/11/23 13:33	1
Beryllium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:33	1
Cadmium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:33	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:33	1
Cobalt	7.74		0.500		ug/L		08/11/23 05:22	08/11/23 13:33	1
Lead	2.50	U	2.50		ug/L		08/11/23 05:22	08/11/23 13:33	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 13:33	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:05	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71891

Lab Sample ID: 680-238944-5

Date Collected: 08/02/23 09:03

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	133000		500		ug/L		08/11/23 05:22	08/11/23 13:53	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 13:53	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:37	1
Arsenic	3.00	U	3.00		ug/L		08/11/23 05:22	08/11/23 13:37	1
Barium	301		5.00		ug/L		08/11/23 05:22	08/11/23 13:37	1
Beryllium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:37	1
Cadmium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:37	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:37	1
Cobalt	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:37	1
Lead	2.50	U	2.50		ug/L		08/11/23 05:22	08/11/23 13:37	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 13:37	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:07	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71892

Lab Sample ID: 680-238944-6

Date Collected: 08/02/23 09:08

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	139000		500		ug/L		08/11/23 05:22	08/16/23 10:57	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/16/23 10:57	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:49	1
Arsenic	3.00	U	3.00		ug/L		08/11/23 05:22	08/11/23 13:49	1
Barium	310		5.00		ug/L		08/11/23 05:22	08/11/23 13:49	1
Beryllium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:49	1
Cadmium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:49	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:49	1
Cobalt	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 13:49	1
Lead	2.50	U	2.50		ug/L		08/11/23 05:22	08/11/23 13:49	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 13:49	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:08	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71897

Lab Sample ID: 680-238944-7

Date Collected: 08/02/23 10:00

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	262000		500		ug/L		08/11/23 05:22	08/11/23 14:02	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 14:02	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:53	1
Arsenic	15.2		3.00		ug/L		08/11/23 05:22	08/11/23 13:53	1
Barium	27.1		5.00		ug/L		08/11/23 05:22	08/11/23 13:53	1
Beryllium	9.82		0.500		ug/L		08/11/23 05:22	08/11/23 13:53	1
Cadmium	0.560		0.500		ug/L		08/11/23 05:22	08/11/23 13:53	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:53	1
Cobalt	61.5		0.500		ug/L		08/11/23 05:22	08/11/23 13:53	1
Lead	37.0		2.50		ug/L		08/11/23 05:22	08/11/23 13:53	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 13:53	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:10	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71898

Lab Sample ID: 680-238944-8

Date Collected: 08/02/23 10:05

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	262000		500		ug/L		08/11/23 05:22	08/11/23 14:04	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 14:04	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:57	1
Arsenic	14.0		3.00		ug/L		08/11/23 05:22	08/11/23 13:57	1
Barium	26.3		5.00		ug/L		08/11/23 05:22	08/11/23 13:57	1
Beryllium	9.79		0.500		ug/L		08/11/23 05:22	08/11/23 13:57	1
Cadmium	0.565		0.500		ug/L		08/11/23 05:22	08/11/23 13:57	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 13:57	1
Cobalt	60.6		0.500		ug/L		08/11/23 05:22	08/11/23 13:57	1
Lead	36.6		2.50		ug/L		08/11/23 05:22	08/11/23 13:57	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 13:57	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:11	1

Client Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71899

Lab Sample ID: 680-238944-9

Date Collected: 08/02/23 11:37

Matrix: Water

Date Received: 08/10/23 10:25

Method: SW846 6010D - Metals (ICP) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	159000		500		ug/L		08/11/23 05:22	08/11/23 14:06	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 14:06	1

Method: SW846 6020B - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 14:01	1
Arsenic	3.00	U	3.00		ug/L		08/11/23 05:22	08/11/23 14:01	1
Barium	96.5		5.00		ug/L		08/11/23 05:22	08/11/23 14:01	1
Beryllium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 14:01	1
Cadmium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 14:01	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 14:01	1
Cobalt	2.39		0.500		ug/L		08/11/23 05:22	08/11/23 14:01	1
Lead	2.50	U	2.50		ug/L		08/11/23 05:22	08/11/23 14:01	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 14:01	1

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 12:16	1

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Method: 6010D - Metals (ICP)

Lab Sample ID: MB 680-792885/1-A
 Matrix: Water
 Analysis Batch: 793061

Client Sample ID: Method Blank
 Prep Type: Total Recoverable
 Prep Batch: 792885

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Calcium	500	U	500		ug/L		08/11/23 05:22	08/11/23 13:12	1
Selenium	20.0	U	20.0		ug/L		08/11/23 05:22	08/11/23 13:12	1

Lab Sample ID: LCS 680-792885/2-A
 Matrix: Water
 Analysis Batch: 793061

Client Sample ID: Lab Control Sample
 Prep Type: Total Recoverable
 Prep Batch: 792885

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Selenium	100	92.75		ug/L		93	80 - 120

Method: 6020B - Metals (ICP/MS)

Lab Sample ID: MB 680-792884/1-A
 Matrix: Water
 Analysis Batch: 793058

Client Sample ID: Method Blank
 Prep Type: Total Recoverable
 Prep Batch: 792884

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Antimony	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 12:11	1
Arsenic	3.00	U	3.00		ug/L		08/11/23 05:22	08/11/23 12:11	1
Barium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 12:11	1
Beryllium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 12:11	1
Cadmium	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 12:11	1
Chromium	5.00	U	5.00		ug/L		08/11/23 05:22	08/11/23 12:11	1
Cobalt	0.500	U	0.500		ug/L		08/11/23 05:22	08/11/23 12:11	1
Lead	2.50	U	2.50		ug/L		08/11/23 05:22	08/11/23 12:11	1
Thallium	1.00	U	1.00		ug/L		08/11/23 05:22	08/11/23 12:11	1

Lab Sample ID: LCS 680-792884/2-A
 Matrix: Water
 Analysis Batch: 793058

Client Sample ID: Lab Control Sample
 Prep Type: Total Recoverable
 Prep Batch: 792884

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Arsenic	100	99.41		ug/L		99	80 - 120
Barium	100	99.97		ug/L		100	80 - 120
Beryllium	50.0	48.22		ug/L		96	80 - 120
Cadmium	50.0	47.72		ug/L		95	80 - 120
Chromium	100	105.7		ug/L		106	80 - 120
Cobalt	50.0	52.08		ug/L		104	80 - 120
Lead	500	493.8		ug/L		99	80 - 120
Thallium	50.0	47.88		ug/L		96	80 - 120

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Method: 7470A - Mercury (CVAA)

Lab Sample ID: MB 680-793322/1-A
 Matrix: Water
 Analysis Batch: 793541

Client Sample ID: Method Blank
 Prep Type: Total/NA
 Prep Batch: 793322

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		08/14/23 11:38	08/15/23 11:58	1

Lab Sample ID: LCS 680-793322/2-A
 Matrix: Water
 Analysis Batch: 793541

Client Sample ID: Lab Control Sample
 Prep Type: Total/NA
 Prep Batch: 793322

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Mercury	2.50	2.427		ug/L		97	80 - 120



QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Metals

Prep Batch: 792884

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-238944-1	AF71896	Total Recoverable	Water	3005A	
680-238944-2	AF71893	Total Recoverable	Water	3005A	
680-238944-3	AF71894	Total Recoverable	Water	3005A	
680-238944-4	AF71895	Total Recoverable	Water	3005A	
680-238944-5	AF71891	Total Recoverable	Water	3005A	
680-238944-6	AF71892	Total Recoverable	Water	3005A	
680-238944-7	AF71897	Total Recoverable	Water	3005A	
680-238944-8	AF71898	Total Recoverable	Water	3005A	
680-238944-9	AF71899	Total Recoverable	Water	3005A	
MB 680-792884/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-792884/2-A	Lab Control Sample	Total Recoverable	Water	3005A	

Prep Batch: 792885

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-238944-1	AF71896	Total Recoverable	Water	3005A	
680-238944-2	AF71893	Total Recoverable	Water	3005A	
680-238944-3	AF71894	Total Recoverable	Water	3005A	
680-238944-4	AF71895	Total Recoverable	Water	3005A	
680-238944-5	AF71891	Total Recoverable	Water	3005A	
680-238944-6	AF71892	Total Recoverable	Water	3005A	
680-238944-7	AF71897	Total Recoverable	Water	3005A	
680-238944-8	AF71898	Total Recoverable	Water	3005A	
680-238944-9	AF71899	Total Recoverable	Water	3005A	
MB 680-792885/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 680-792885/2-A	Lab Control Sample	Total Recoverable	Water	3005A	

Analysis Batch: 793058

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-238944-1	AF71896	Total Recoverable	Water	6020B	792884
680-238944-2	AF71893	Total Recoverable	Water	6020B	792884
680-238944-3	AF71894	Total Recoverable	Water	6020B	792884
680-238944-4	AF71895	Total Recoverable	Water	6020B	792884
680-238944-5	AF71891	Total Recoverable	Water	6020B	792884
680-238944-6	AF71892	Total Recoverable	Water	6020B	792884
680-238944-7	AF71897	Total Recoverable	Water	6020B	792884
680-238944-8	AF71898	Total Recoverable	Water	6020B	792884
680-238944-9	AF71899	Total Recoverable	Water	6020B	792884
MB 680-792884/1-A	Method Blank	Total Recoverable	Water	6020B	792884
LCS 680-792884/2-A	Lab Control Sample	Total Recoverable	Water	6020B	792884

Analysis Batch: 793061

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-238944-1	AF71896	Total Recoverable	Water	6010D	792885
680-238944-2	AF71893	Total Recoverable	Water	6010D	792885
680-238944-3	AF71894	Total Recoverable	Water	6010D	792885
680-238944-4	AF71895	Total Recoverable	Water	6010D	792885
680-238944-5	AF71891	Total Recoverable	Water	6010D	792885
680-238944-7	AF71897	Total Recoverable	Water	6010D	792885
680-238944-8	AF71898	Total Recoverable	Water	6010D	792885
680-238944-9	AF71899	Total Recoverable	Water	6010D	792885
MB 680-792885/1-A	Method Blank	Total Recoverable	Water	6010D	792885

Eurofins Savannah

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Metals (Continued)

Analysis Batch: 793061 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
LCS 680-792885/2-A	Lab Control Sample	Total Recoverable	Water	6010D	792885

Prep Batch: 793322

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-238944-1	AF71896	Total/NA	Water	7470A	
680-238944-2	AF71893	Total/NA	Water	7470A	
680-238944-3	AF71894	Total/NA	Water	7470A	
680-238944-4	AF71895	Total/NA	Water	7470A	
680-238944-5	AF71891	Total/NA	Water	7470A	
680-238944-6	AF71892	Total/NA	Water	7470A	
680-238944-7	AF71897	Total/NA	Water	7470A	
680-238944-8	AF71898	Total/NA	Water	7470A	
680-238944-9	AF71899	Total/NA	Water	7470A	
MB 680-793322/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-793322/2-A	Lab Control Sample	Total/NA	Water	7470A	

Analysis Batch: 793541

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-238944-1	AF71896	Total/NA	Water	7470A	793322
680-238944-2	AF71893	Total/NA	Water	7470A	793322
680-238944-3	AF71894	Total/NA	Water	7470A	793322
680-238944-4	AF71895	Total/NA	Water	7470A	793322
680-238944-5	AF71891	Total/NA	Water	7470A	793322
680-238944-6	AF71892	Total/NA	Water	7470A	793322
680-238944-7	AF71897	Total/NA	Water	7470A	793322
680-238944-8	AF71898	Total/NA	Water	7470A	793322
680-238944-9	AF71899	Total/NA	Water	7470A	793322
MB 680-793322/1-A	Method Blank	Total/NA	Water	7470A	793322
LCS 680-793322/2-A	Lab Control Sample	Total/NA	Water	7470A	793322

Analysis Batch: 793702

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-238944-6	AF71892	Total Recoverable	Water	6010D	792885

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71896

Lab Sample ID: 680-238944-1

Date Collected: 08/01/23 09:53

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793061	BJB	EET SAV	08/11/23 13:45
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 13:21
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:01

Client Sample ID: AF71893

Lab Sample ID: 680-238944-2

Date Collected: 08/01/23 10:45

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793061	BJB	EET SAV	08/11/23 13:47
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 13:25
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:02

Client Sample ID: AF71894

Lab Sample ID: 680-238944-3

Date Collected: 08/01/23 11:52

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793061	BJB	EET SAV	08/11/23 13:49
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 13:29
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:04

Client Sample ID: AF71895

Lab Sample ID: 680-238944-4

Date Collected: 08/01/23 13:17

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793061	BJB	EET SAV	08/11/23 13:51
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 13:33
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:05

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71891

Lab Sample ID: 680-238944-5

Date Collected: 08/02/23 09:03

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793061	BJB	EET SAV	08/11/23 13:53
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 13:37
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:07

Client Sample ID: AF71892

Lab Sample ID: 680-238944-6

Date Collected: 08/02/23 09:08

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793702	BJB	EET SAV	08/16/23 10:57
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 13:49
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:08

Client Sample ID: AF71897

Lab Sample ID: 680-238944-7

Date Collected: 08/02/23 10:00

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793061	BJB	EET SAV	08/11/23 14:02
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 13:53
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:10

Client Sample ID: AF71898

Lab Sample ID: 680-238944-8

Date Collected: 08/02/23 10:05

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793061	BJB	EET SAV	08/11/23 14:04
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 13:57
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:11

Lab Chronicle

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Client Sample ID: AF71899

Lab Sample ID: 680-238944-9

Date Collected: 08/02/23 11:37

Matrix: Water

Date Received: 08/10/23 10:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total Recoverable	Prep	3005A			792885	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6010D		1	793061	BJB	EET SAV	08/11/23 14:06
Total Recoverable	Prep	3005A			792884	RR	EET SAV	08/11/23 05:22
Total Recoverable	Analysis	6020B		1	793058	BWR	EET SAV	08/11/23 14:01
Total/NA	Prep	7470A			793322	DW	EET SAV	08/14/23 11:38
Total/NA	Analysis	7470A		1	793541	BJB	EET SAV	08/15/23 12:16

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858



Chain of Custody

santee cooper
 Santee Cooper
 One Riverwood Drive
 Moncks Corner, SC 29461
 Phone: (843)761-8000 Ext. 5148
 Fax: (843)761-4175

Customer Email/Report Recipient: LUNDA.WILLIAMS@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JMo2.09.G01.1 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass-G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	TOTAL METALS - SEE BELOW
AF71896	CCMGP-5	8/1/23	0953	WJK BB	1	P	G	GW	2	Hg-7470 ALLOTHERS 6020	X
AF71893	CCMGP-2		1045							-SEE SHEET FOR RLS.	
AF71894	CCMGP-3		1152								
AF71895	CCMGP-4		1317								
AF71891	CCMGP-1	8/2/23	0903								
AF71892	CCMGP-1 DUP		0908								
AF71897	CGYP-7		1000								
AF71898	CGYP-7 DUP		1005								
AF71899	POZ-3		1137								

Page 26 of 29

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJBrown</i>	35594	8/9/23	1300	<i>TA</i>	TA	8-10-23	1025

Sample Receiving (Internal Use Only)
 TEMP (°C) 26.2/26.3 Initial:
 Correct pH: Yes No
 Preservative Lot#:



<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input checked="" type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input checked="" type="checkbox"/> Se <input checked="" type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input checked="" type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input checked="" type="checkbox"/> Be <input type="checkbox"/> Mn <input checked="" type="checkbox"/> Tl <input checked="" type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input checked="" type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input checked="" type="checkbox"/> Co <input type="checkbox"/> Ni <input checked="" type="checkbox"/> Hg <input checked="" type="checkbox"/> Cr <input checked="" type="checkbox"/> Pb <input type="checkbox"/> CrVI			Nutrients <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum Gypsum (see below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input checked="" type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input checked="" type="checkbox"/> Purity (CaSO4) <input checked="" type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	<input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	<input type="checkbox"/> Oil <input type="checkbox"/> % Carbon <input checked="" type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input checked="" type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	<input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases Used Oil Flashpoint Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--	--	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

Table of Reporting Limits for Groundwater Samples-- Metals Only

Analyte	Unit	GWPS/ MCL/ RSL	Reporting Limits best case
Aluminum	mg/L	0.05 to 0.2	---
Antimony	ug/L	6	5
Arsenic	ug/L	10	5
Arsenic Dissolved	ug/L	---	---
Barium	ug/L	2000	5
Beryllium	ug/L	4	0.5
Boron	ug/L	---	10 to 15
Cadmium	ug/L	5	0.5
Calcium	ug/L	---	0.1
Chromium	ug/L	100	5
Cobalt	ug/L	6	0.5
Copper	mg/L	1	---
Iron	ug/L	300	---
Lead	ug/L	15	1
Lithium	ug/L	40	5
Magnesium	ug/L	---	---
Mercury	ug/L	2	0.2
Molybdenum	ug/L	100	5
Nickel	ug/L	---	---
Potassium	mg/L	---	---
Selenium	ug/L	50	5
Sodium	mg/L	---	---
Thallium	ug/L	2	1
Zinc	ug/L	5000	---

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-238944-1

Login Number: 238944

List Source: Eurofins Savannah

List Number: 1

Creator: Sims, Robert D

Question	Answer	Comment
Radioactivity wasn't checked or is <=/ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	False	Thermal preservation not required.
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-238944-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-23 *

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

* Accreditation/Certification renewal pending - accreditation/certification considered valid.

October 23, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 641317

Dear Ms. Gilmetti:


GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on October 13, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,



Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 641317 GEL Work Order: 641317

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: October 23, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80265 Project: SOOP00119
Sample ID: 641317001 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 11:23
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Ion Chromatography												
EPA 300.0 Fluoride, Liquid "As Received"												
Fluoride		1.70	0.0330	0.100	mg/L		1	HXC1	10/17/23	2249	2509975	1
Chloride		575	6.70	20.0	mg/L		100	HXC1	10/19/23	0731	2509975	2
Sulfate		789	13.3	40.0	mg/L		100					

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	EPA 300.0		
2	EPA 300.0		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: October 23, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80266 Project: SOOP00119
Sample ID: 641317002 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 11:28
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Ion Chromatography												
EPA 300.0 Fluoride, Liquid "As Received"												
Fluoride		1.67	0.0330	0.100	mg/L		1	HXC1	10/18/23	0022	2509975	1
Chloride		579	6.70	20.0	mg/L		100	HXC1	10/19/23	0903	2509975	2
Sulfate		773	13.3	40.0	mg/L		100					

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	EPA 300.0		
2	EPA 300.0		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: October 23, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80267 Project: SOOP00119
Sample ID: 641317003 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 10:15
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Ion Chromatography												
EPA 300.0 Fluoride, Liquid "As Received"												
Fluoride		0.207	0.0330	0.100	mg/L		1	HXC1	10/18/23	0052	2509975	1
Chloride		11.2	0.670	2.00	mg/L		10	HXC1	10/19/23	1107	2509975	2
Sulfate		80.0	1.33	4.00	mg/L		10					

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	EPA 300.0		
2	EPA 300.0		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: October 23, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 641317

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Ion Chromatography											
Batch	2509975										
QC1205549254	641317001	DUP									
Chloride			575	575	mg/L	0.0331		(0%-20%)	HXC1	10/19/23	08:02
Fluoride			1.70	1.69	mg/L	1.01		(0%-20%)		10/17/23	23:20
Sulfate			789	791	mg/L	0.268		(0%-20%)		10/19/23	08:02
QC1205549252	LCS										
Chloride	5.00			4.66	mg/L		93.3	(90%-110%)		10/17/23	20:45
Fluoride	2.50			2.40	mg/L		95.9	(90%-110%)			
Sulfate	10.0			9.55	mg/L		95.5	(90%-110%)			
QC1205549251	MB										
Chloride			U	ND	mg/L					10/17/23	20:15
Fluoride			U	ND	mg/L						
Sulfate			U	ND	mg/L						
QC1205549257	641317001	PS									
Chloride	5.00	5.75		11.3	mg/L		112 *	(90%-110%)		10/19/23	08:33
Fluoride	2.50	1.70		3.98	mg/L		90.9	(90%-110%)		10/17/23	23:51
Sulfate	10.0	7.89		17.9	mg/L		99.6	(90%-110%)		10/19/23	08:33

Notes:

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 641317

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
----------	-----	--------	------	----	-------	------	------	-------	-------	------	------

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected
- Z Paint Filter Test--Particulates passed through the filter, however no free liquids were observed.
- d 5-day BOD--The 2:1 depletion requirement was not met for this sample
- ^ RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.
- N/A RPD or %Recovery limits do not apply.
- ND Analyte concentration is not detected above the detection limit
- NJ Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- E General Chemistry--Concentration of the target analyte exceeds the instrument calibration range
- Q One or more quality control criteria have not been met. Refer to the applicable narrative or DER.
- NI See case narrative
- R Per section 9.3.4.1 of Method 1664 Revision B, due to matrix spike recovery issues, this result may not be reported or used for regulatory compliance purposes.
- B The target analyte was detected in the associated blank.
- e 5-day BOD--Test replicates show more than 30% difference between high and low values. The data is qualified per the method and can be used for reporting purposes
- J See case narrative for an explanation

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**General Chemistry
 Technical Case Narrative
 Santee Cooper
 SDG #: 641317**

Product: Ion Chromatography

Analytical Method: EPA 300.0

Analytical Procedure: GL-GC-E-086 REV# 33

Analytical Batch: 2509975

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
641317001	AF80265
641317002	AF80266
641317003	AF80267
1205549251	Method Blank (MB)
1205549252	Laboratory Control Sample (LCS)
1205549254	641317001(AF80265) Sample Duplicate (DUP)
1205549257	641317001(AF80265) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Matrix Spike (MS)/Post Spike (PS) Recovery Statement

The percent recoveries (%R) obtained from the spike analyses are evaluated when the sample concentration is less than four times (4X) the spike concentration added. The matrix spike recovered outside of the established acceptance limits due to matrix interference and/or non-homogeneity.

Analyte	Sample	Value
Chloride	1205549257 (AF80265PS)	112* (90%-110%)

Technical Information

Sample Dilutions

The following samples 1205549254 (AF80265DUP), 1205549257 (AF80265PS), 641317001 (AF80265), 641317002 (AF80266) and 641317003 (AF80267) were diluted because target analyte concentrations exceeded the calibration range. Dilutions may be required for many reasons, including to minimize matrix interferences or to bring over range target analyte concentrations into the linear calibration range.

Analyte	641317		
	001	002	003
Chloride	100X	100X	10X

Sulfate	100X	100X	10X
---------	------	------	-----

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Chain of Custody

641316
641317



Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LINDA WILLIAMS @santecooper.com

____/____/____

125915 / JMO2.09.GP1.1 / 36500

Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	RAD 226/228	TOTAL RAD CAL	F, Cl, SO4
AF 80266	CGIP-7 DUP		1128										
AF 80267	POZ-3		1015										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	36851	10/13/23	0944	<i>[Signature]</i>	GEL	10/13/23	0944
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	GEL	10/13/23	1610	<i>[Signature]</i>	GEL	10/13/23	1610
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOCP</u>		SDG/AR/COC/Work Order: <u>641316/641317</u>	
Received By: <u>QG</u>		Date Received: <u>10/13/23</u>	
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other	
		<u>n/a</u>	
Suspected Hazard Information		Yes	No
		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.	
A) Shipped as a DOT Hazardous?		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___	
B) Did the client designate the samples me to be received as radioactive?		COC notation or radioactive stickers on containers equal client designation.	
C) Did the RSO classify the samples as radioactive?		Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> GPM/mR/Hr Classified as: Rad 1 Rad 2 Rad 3	
D) Did the client designate samples are hazardous?		COC notation or hazard labels on containers equal client designation.	
E) Did the RSO identify possible hazards?		If D or E is yes, select Hazards below: PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____	
Sample Receipt Criteria		Yes	NA
1 Shipping containers received intact and sealed?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
2 Chain of custody documents included with shipment?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*		<input checked="" type="checkbox"/>	<input type="checkbox"/>
4 Daily check performed and passed on IR temperature gun?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
5 Sample containers intact and sealed?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
6 Samples requiring chemical preservation at proper pH?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
7 Do any samples require Volatile Analysis?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
8 Samples received within holding time?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
9 Sample ID's on COC match ID's on bottles?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
10 Date & time on COC match date & time on bottles?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
11 Number of containers received match number indicated on COC?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
12 Are sample containers identifiable as GEL provided by use of GEL labels?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
13 COC form is properly signed in relinquished/received sections?		<input checked="" type="checkbox"/>	<input type="checkbox"/>
Comments (Use Continuation Form if needed):			

PM (or PMA) review: Initials glw Date 10/14/23 Page 1 of 1

List of current GEL Certifications as of 23 October 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-04
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



July 21, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 627344

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on June 23, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 627344 GEL Work Order: 627344

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66446 Project: SOOP00119
Sample ID: 627344001 Client ID: SOOP001
Matrix: GW
Collect Date: 22-JUN-23 09:46
Receive Date: 23-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting GFPC, Ra228, Liquid "As Received"												
Radium-228		2.71	+/-1.23	1.70	3.00	pCi/L		JE1	07/15/23	1514	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.01	+/-1.27			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226 Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.301	+/-0.311	0.481	1.00	pCi/L		LXP1	07/20/23	1003	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			69.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66424 Project: SOOP00119
Sample ID: 627344002 Client ID: SOOP001
Matrix: GW
Collect Date: 22-JUN-23 10:58
Receive Date: 23-JUN-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.87	+/-1.56	2.35	3.00	pCi/L		JE1	07/15/23	1514	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.32	+/-1.60			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.451	+/-0.350	0.504	1.00	pCi/L		LXP1	07/20/23	1040	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			66.7	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66416	Project: SOOP00119
Sample ID: 627344003	Client ID: SOOP001
Matrix: GW	
Collect Date: 22-JUN-23 12:55	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.80	+/-1.37	1.99	3.00	pCi/L		JE1	07/15/23	1514	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.38	+/-1.41			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.579	+/-0.324	0.317	1.00	pCi/L		LXP1	07/20/23	1040	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			71.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66408	Project: SOOP00119
Sample ID: 627344004	Client ID: SOOP001
Matrix: GW	
Collect Date: 22-JUN-23 13:51	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.63	+/-1.27	1.77	3.00	pCi/L		JE1	07/15/23	1514	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.93	+/-1.31			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.309	+/-0.319	0.493	1.00	pCi/L		LXP1	07/20/23	1040	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			66.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: July 21, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 627344

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2451868										
QC1205446624	627278001	DUP									
Radium-228	U	2.18	U	-2.11	pCi/L	N/A		N/A	JE1	07/15/23	15:12
	Uncertainty	+/-1.50		+/-1.21							
QC1205446625	LCS										
Radium-228	79.2			88.5	pCi/L		112	(75%-125%)		07/15/23	15:13
	Uncertainty			+/-5.00							
QC1205446626	LCSD										
Radium-228	79.2			67.0	pCi/L	27.5*	84.6	(0%-20%)		07/15/23	15:13
	Uncertainty			+/-4.41							
QC1205446623	MB										
Radium-228				2.55	pCi/L					07/15/23	15:12
	Uncertainty			+/-1.41							
Rad Ra-226											
Batch	2451862										
QC1205446613	627278001	DUP									
Radium-226	U	0.000		0.644	pCi/L	200*		(0% - 100%)	LXP1	07/20/23	11:19
	Uncertainty	+/-0.239		+/-0.445							
QC1205446615	LCS										
Radium-226	26.3			21.2	pCi/L		80.5	(75%-125%)		07/20/23	11:19
	Uncertainty			+/-1.83							
QC1205446616	LCSD										
Radium-226	26.3			23.7	pCi/L	11.2	90.1	(0%-20%)		07/20/23	11:19
	Uncertainty			+/-1.96							
QC1205446612	MB										
Radium-226			U	0.311	pCi/L					07/20/23	11:19
	Uncertainty			+/-0.338							
QC1205446614	627278001	MS									
Radium-226	131 U	0.000		139	pCi/L		106	(75%-125%)		07/20/23	11:19
	Uncertainty	+/-0.239		+/-10.7							

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
The Qualifiers in this report are defined as follows:

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 627344

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
U											
	Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.										
J											
	Value is estimated										
X											
	Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier										
H											
	Analytical holding time was exceeded										
<											
	Result is less than value reported										
>											
	Result is greater than value reported										
UI											
	Gamma Spectroscopy--Uncertain identification										
BD											
	Results are either below the MDC or tracer recovery is low										
h											
	Preparation or preservation holding time was exceeded										
R											
	Sample results are rejected										
^											
	RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.										
N/A											
	RPD or %Recovery limits do not apply.										
ND											
	Analyte concentration is not detected above the detection limit										
M											
	M if above MDC and less than LLD										
NJ											
	Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier										
FA											
	Failed analysis.										
UJ											
	Gamma Spectroscopy--Uncertain identification										
Q											
	One or more quality control criteria have not been met. Refer to the applicable narrative or DER.										
K											
	Analyte present. Reported value may be biased high. Actual value is expected to be lower.										
UL											
	Not considered detected. The associated number is the reported concentration, which may be inaccurate due to a low bias.										
L											
	Analyte present. Reported value may be biased low. Actual value is expected to be higher.										
NI											
	See case narrative										
Y											
	Other specific qualifiers were required to properly define the results. Consult case narrative.										
**											
	Analyte is a Tracer compound										
M											
	REMP Result > MDC/CL and < RDL										
J											
	See case narrative for an explanation										

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 627344**

Product: Radium-226+Radium-228 Calculation

Analytical Method: Calculation

Analytical Procedure: GL-RAD-D-003 REV# 45

Analytical Batch: 2451867

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
627344001	AF66446
627344002	AF66424
627344003	AF66416
627344004	AF66408

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2451868

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
627344001	AF66446
627344002	AF66424
627344003	AF66416
627344004	AF66408
1205446623	Method Blank (MB)
1205446624	627278001(AF66414) Sample Duplicate (DUP)
1205446625	Laboratory Control Sample (LCS)
1205446626	Laboratory Control Sample Duplicate (LCSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Method Blank Criteria

The blank result (See Below) is greater than the MDC but less than the required detection limit.

Sample	Analyte	Value
1205446623 (MB)	Radium-228	Result: 2.55 pCi/L > MDA: 2.12 pCi/L <= RDL: 3.00 pCi/L

Duplication Criteria between LCS and LCSD

The Laboratory Control Sample and Laboratory Control Sample Duplicate (See Below) do not meet the duplication requirement; however, they both meet the spiked recovery requirement.

Sample	Analyte	Value
1205446625 (LCS) and 1205446626 (LCSD)	Radium-228	RPD 27.5* (0%-20%)

Technical Information

Negative > 3 sigma TPU

Sample result was more negative than the three sigma TPU. The background control chart was examined and the detector was determined to be fully functional.

Sample	Analyte	Value
1205446624 (AF66414DUP)	Radium-228	Negative Result > 3 sigma value

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2451862

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
627344001	AF66446
627344002	AF66424
627344003	AF66416
627344004	AF66408
1205446612	Method Blank (MB)
1205446613	627278001(AF66414) Sample Duplicate (DUP)
1205446614	627278001(AF66414) Matrix Spike (MS)
1205446615	Laboratory Control Sample (LCS)
1205446616	Laboratory Control Sample Duplicate (LCSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Duplication Criteria between QC Sample and Duplicate Sample

The Sample and the Duplicate, (See Below), did not meet the relative percent difference requirement; however, they do meet the relative error ratio requirement with the value listed below.

Sample	Analyte	Value
1205446613 (AF66414DUP)	Radium-226	RPD 200* (0.0%-100.0%) RER 2.44 (0-3)

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

627344

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 7 / 24 / 23 Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody

santee cooper
 Santee Cooper
 One Riverwood Drive
 Moncks Corner, SC 29461
 Phone: (843)761-8000 Ext. 5148
 Fax: (843)761-4175

Customer Email/Report Recipient: LINDA.WILLIAMS@santecooper.com Date Results Needed by: / / Project/Task/Unit #: 125915 / JMO2.09.G01.1 / 36500 Run request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass/G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	RAP 226	RAP 228	TOTAL RAD CALC.
AF66446	POZ-S	6/22/23	0946	WJK ML	2	P	G	GW	2		1	1	X
AF66424	CCMLF-2		1058										
AF66416	CCMAP-S		1255										
AF66408	CCMAP-1		1351										
										SAMPLES SENT 6/23			
										CHAIN LEFT BEHIND			

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sjbrown</i>	35594	6/26/23	0710	<i>Se</i>	GEL	6/23/23	0917
<i>Se</i>	GEL	6/23/23	1520	<i>SL</i>	GEL	6/23/23	1520
				<i>JHR</i>		6/23/23	

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all)	Nutrients	MISC.	Gypsum	Coal	Flyash	Oil
<input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	<input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	<input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	<input type="checkbox"/> Wallboard <input type="checkbox"/> Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO3) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfides <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input checked="" type="checkbox"/> Sulfur	<input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	<input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Silica <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	<input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> % Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Diethylene Strength <input type="checkbox"/> IPT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code: 1=<4°C 2=HNO3 3=H2SO4 4=HCl 5=Na2S2O3 6=Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: SOOP	SDG/AR/COC/Work Order: 1027278 627344
Received By: Stacy Boone	Date Received: JUNE 23, 2023
Carrier and Tracking Number	Circle Applicable: FedEx Express FedEx Ground UPS Field Services Courier Other _____ 21c 6c 3c

Suspected Hazard Information	Yes	No	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?		<input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ IF UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive?		<input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive?		<input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u> </u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3
D) Did the client designate samples are hazardous?		<input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards?		<input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____

Sample Receipt Criteria	Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1 Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2 Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Circle Applicable: Client contacted and provided COC COC created upon receipt
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Preservation Method: Wet Ice Ice Packs Dry ice None Other: _____ *all temperatures are recorded in Celsius TEMP: _____
4 Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Temperature Device Serial #: IR3-22 IR3-23 Secondary Temperature Device Serial # (If Applicable): _____
5 Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6 Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Sample ID's and Containers Affected: _____ If Preservation added, Lot#: _____
7 Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA freezer)
				Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
				Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected: _____
8 Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		ID's and tests affected: _____
9 Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		ID's and containers affected: _____
10 Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11 Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Circle Applicable: No container count on COC Other (describe) SEE BELOW
12 Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		
13 COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		Circle Applicable: Not relinquished Other (describe)

Comments (Use Continuation Form if needed):

AF66408
66416
66424
66446

}

NOT ON COC, 2EA

PM (or PMA) review: Initials RW Date 6/26/23 Page of

List of current GEL Certifications as of 21 July 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

December 01, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 644996

Dear Ms. Gilmetti:


GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on November 10, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,



Jordan Melton for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 644996 GEL Work Order: 644996

The Qualifiers in this report are defined as follows:


- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- B Either presence of analyte detected in the associated blank, or MDL/IDL < sample value < PQL
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81444 Project: SOOP00119
Sample ID: 644996001 Client ID: SOOP001
Matrix: GW
Collect Date: 08-NOV-23 09:29
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Mercury Analysis-CVAA												
7470 Cold Vapor Mercury, Liquid "As Received"												
Mercury	U	ND	0.0670	0.200	ug/L	1.00	1	JP2	11/30/23	1115	2532022	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
SW846 7470A Prep	EPA 7470A Mercury Prep Liquid	JM13	11/29/23	1215	2532021

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SW846 7470A	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81445 Project: SOOP00119
Sample ID: 644996002 Client ID: SOOP001
Matrix: GW
Collect Date: 08-NOV-23 09:34
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Mercury Analysis-CVAA												
7470 Cold Vapor Mercury, Liquid "As Received"												
Mercury	U	ND	0.0670	0.200	ug/L	1.00	1	JP2	11/30/23	1120	2532022	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
SW846 7470A Prep	EPA 7470A Mercury Prep Liquid	JM13	11/29/23	1215	2532021

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SW846 7470A	

Notes:

Column headers are defined as follows:

DF: Dilution Factor
DL: Detection Limit
MDA: Minimum Detectable Activity
MDC: Minimum Detectable Concentration
Lc/LC: Critical Level
PF: Prep Factor
RL: Reporting Limit
SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81446 Project: SOOP00119
Sample ID: 644996003 Client ID: SOOP001
Matrix: GW
Collect Date: 08-NOV-23 12:29
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Mercury Analysis-CVAA												
7470 Cold Vapor Mercury, Liquid "As Received"												
Mercury		0.470	0.0670	0.200	ug/L	1.00	1	JP2	11/30/23	1140	2532022	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
SW846 7470A Prep	EPA 7470A Mercury Prep Liquid	JM13	11/29/23	1215	2532021

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SW846 7470A	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81447 Project: SOOP00119
Sample ID: 644996004 Client ID: SOOP001
Matrix: GW
Collect Date: 08-NOV-23 10:39
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Mercury Analysis-CVAA												
7470 Cold Vapor Mercury, Liquid "As Received"												
Mercury	U	ND	0.0670	0.200	ug/L	1.00	1	JP2	11/30/23	1123	2532022	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
SW846 7470A Prep	EPA 7470A Mercury Prep Liquid	JM13	11/29/23	1215	2532021

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SW846 7470A	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81448 Project: SOOP00119
Sample ID: 644996005 Client ID: SOOP001
Matrix: GW
Collect Date: 08-NOV-23 11:35
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Mercury Analysis-CVAA												
7470 Cold Vapor Mercury, Liquid "As Received"												
Mercury	U	ND	0.0670	0.200	ug/L	1.00	1	JP2	11/30/23	1125	2532022	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
SW846 7470A Prep	EPA 7470A Mercury Prep Liquid	JM13	11/29/23	1215	2532021

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SW846 7470A	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81449 Project: SOOP00119
Sample ID: 644996006 Client ID: SOOP001
Matrix: GW
Collect Date: 07-NOV-23 14:06
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Mercury Analysis-CVAA												
7470 Cold Vapor Mercury, Liquid "As Received"												
Mercury	U	ND	0.0670	0.200	ug/L	1.00	1	JP2	11/30/23	1126	2532022	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
SW846 7470A Prep	EPA 7470A Mercury Prep Liquid	JM13	11/29/23	1215	2532021

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	SW846 7470A	

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: December 1, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 644996

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Metals Analysis-Mercury											
Batch	2532022										
QC1205586588	644624008	DUP									
Mercury		U	ND	U	ND	ug/L	N/A		JP2	11/30/23	10:27
QC1205586587	LCS										
Mercury	2.00				1.99	ug/L	99.6	(80%-120%)		11/30/23	10:23
QC1205586586	MB										
Mercury			U		ND	ug/L				11/30/23	10:21
QC1205586589	644624008	MS									
Mercury	2.00	U	ND		1.98	ug/L	98.9	(75%-125%)		11/30/23	10:29
QC1205586590	644624008	SDILT									
Mercury		U	ND	U	ND	ug/L	N/A	(0%-10%)		11/30/23	10:31

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- N Metals--The Matrix spike sample recovery is not within specified control limits
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected
- ^ RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.
- N/A RPD or %Recovery limits do not apply.
- ND Analyte concentration is not detected above the detection limit
- E %difference of sample and SD is >10%. Sample concentration must meet flagging criteria

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 644996

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
NJ		Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier									
Q		One or more quality control criteria have not been met. Refer to the applicable narrative or DER.									
FB		Mercury was found present at quantifiable concentrations in field blanks received with these samples. Data associated with the blank are deemed invalid for reporting to regulatory agencies									
N1		See case narrative									
Y		Other specific qualifiers were required to properly define the results. Consult case narrative.									
J		See case narrative for an explanation									

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81444 Project: SOOP00119
Sample ID: 644996001 Client ID: SOOP001
Matrix: GW
Collect Date: 08-NOV-23 09:29
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.29	+/-1.33	2.22	3.00	pCi/L		JE1	11/20/23	0951	2524656		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.15	+/-1.40			pCi/L		NXL1	12/01/23	1403	2533033		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.865	+/-0.414	0.289	1.00	pCi/L		LXP1	11/28/23	0915	2526236		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			93.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81445 Project: SOOP00119
Sample ID: 644996002 Client ID: SOOP001
Matrix: GW
Collect Date: 08-NOV-23 09:34
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	-0.612	+/-0.744	1.59	3.00	pCi/L		JE1	11/20/23	0951	2524656		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.10	+/-0.894			pCi/L		NXL1	12/01/23	1403	2533033		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.10	+/-0.496	0.329	1.00	pCi/L		LXP1	11/28/23	0915	2526236		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			93.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF81446	Project: SOOP00119
Sample ID: 644996003	Client ID: SOOP001
Matrix: GW	
Collect Date: 08-NOV-23 12:29	
Receive Date: 10-NOV-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.52	+/-1.05	1.62	3.00	pCi/L		JE1	11/20/23	0951	2524656		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.14	+/-1.11			pCi/L		NXL1	12/01/23	1403	2533033		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.623	+/-0.341	0.270	1.00	pCi/L		LXP1	11/28/23	0915	2526236		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			85.2	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF81447	Project: SOOP00119
Sample ID: 644996004	Client ID: SOOP001
Matrix: GW	
Collect Date: 08-NOV-23 10:39	
Receive Date: 10-NOV-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.39	+/-1.08	1.73	3.00	pCi/L		JE1	11/20/23	0951	2524656		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.33	+/-1.17			pCi/L		NXL1	12/01/23	1403	2533033		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.935	+/-0.447	0.313	1.00	pCi/L		LXP1	11/28/23	0954	2526236		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			92.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF81448 Project: SOOP00119
Sample ID: 644996005 Client ID: SOOP001
Matrix: GW
Collect Date: 08-NOV-23 11:35
Receive Date: 10-NOV-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		1.80	+/-1.03	1.52	3.00	pCi/L		JE1	11/20/23	0952	2524656	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.40	+/-1.22			pCi/L		NXL1	12/01/23	1403	2533033	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		1.60	+/-0.651	0.591	1.00	pCi/L		LXP1	11/28/23	0954	2526236	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			95.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: December 1, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF81449	Project: SOOP00119
Sample ID: 644996006	Client ID: SOOP001
Matrix: GW	
Collect Date: 07-NOV-23 14:06	
Receive Date: 10-NOV-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	-0.349	+/-0.604	1.32	3.00	pCi/L		JE1	11/20/23	0952	2524656		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.20	+/-0.825			pCi/L		NXL1	12/01/23	1403	2533033		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.20	+/-0.562	0.488	1.00	pCi/L		LXP1	11/28/23	0954	2526236		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			91.9	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: December 1, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 644996

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2524656										
QC1205573617	644996001	DUP									
Radium-228	U	1.29	U	0.0814	pCi/L	N/A		N/A	JE1	11/20/23	09:51
	Uncertainty	+/-1.33		+/-1.34							
QC1205573618	LCS										
Radium-228	75.5			69.2	pCi/L		91.7	(75%-125%)		11/20/23	09:50
	Uncertainty			+/-3.98							
QC1205573616	MB										
Radium-228				1.92	pCi/L					11/20/23	09:50
	Uncertainty			+/-1.08							
Rad Ra-226											
Batch	2526236										
QC1205576422	644996001	DUP									
Radium-226				0.865	pCi/L	12		(0% - 100%)	LXP1	11/28/23	09:54
	Uncertainty			+/-0.414							
QC1205576424	LCS										
Radium-226	53.7			60.6	pCi/L		113	(75%-125%)		11/28/23	09:54
	Uncertainty			+/-3.76							
QC1205576421	MB										
Radium-226			U	0.0617	pCi/L					11/28/23	09:54
	Uncertainty			+/-0.320							
QC1205576423	644996001	MS									
Radium-226	135	0.865		156	pCi/L		115	(75%-125%)		11/28/23	09:54
	Uncertainty			+/-0.414							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 644996

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

Technical Case Narrative
Santee Cooper
SDG #: 644996

Metals

Product: Mercury Analysis Using the Perkin Elmer Automated Mercury Analyzer

Analytical Method: SW846 7470A

Analytical Procedure: GL-MA-E-010 REV# 40

Analytical Batch: 2532022

Preparation Method: SW846 7470A Prep

Preparation Procedure: GL-MA-E-010 REV# 40

Preparation Batch: 2532021

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
644996001	AF81444
644996002	AF81445
644996003	AF81446
644996004	AF81447
644996005	AF81448
644996006	AF81449
1205586586	Method Blank (MB)CVAA
1205586587	Laboratory Control Sample (LCS)
1205586590	644624008(NonSDGL) Serial Dilution (SD)
1205586588	644624008(NonSDGD) Sample Duplicate (DUP)
1205586589	644624008(NonSDGS) Matrix Spike (MS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Method Blank (MB) Statement

The method blanks (MB) analyzed with this SDG met the acceptance criteria. However, where there were negative values in the method blank, the results were evaluated and appropriately flagged on the data.

Sample	Analyte	Value
1205586586 (MB)	Mercury	See applicable report

Radiochemistry

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2524656

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
644996001	AF81444
644996002	AF81445
644996003	AF81446
644996004	AF81447
644996005	AF81448
644996006	AF81449
1205573616	Method Blank (MB)
1205573617	644996001(AF81444) Sample Duplicate (DUP)
1205573618	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Method Blank Criteria

The blank result (See Below) is greater than the MDC but less than the required detection limit.

Sample	Analyte	Value
1205573616 (MB)	Radium-228	Result: 1.92 pCi/L > MDA: 1.60 pCi/L <= RDL: 3.00 pCi/L

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2526236

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
644996001	AF81444
644996002	AF81445
644996003	AF81446

644996004	AF81447
644996005	AF81448
644996006	AF81449
1205576421	Method Blank (MB)
1205576422	644996001(AF81444) Sample Duplicate (DUP)
1205576423	644996001(AF81444) Matrix Spike (MS)
1205576424	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information


Additional Comments

The matrix spike, 1205576423 (AF81444MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Chain of Custody



Santee Cooper
One Riverwood Drive
Moncks Corner, SC 29461
Phone: (843)761-8000 Ext. 5148
Fax: (843)761-4175

Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

lcwillia@santecooper.com 11, 27, 23 125915, JMO2.09.GA.1 + 35600 36500 Yes No 6
Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments	Analysis Group	
AF81444	CCMGP-1	11/8/23	929	ZM/ML	3	P	G	GW	1/2	Rad 226/228 + Total Calc	2	1
AF81445	CCMGP-1 dup		934							7470 RLO 2ug/L		
AF81446	CCMGP-2		1229									
AF81447	CCMGP-3		1039									
AF81448	CCMGP-4		1135									
AF81449	CCMGP-5	11/7/23	1406	ZM ML								

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	35466	11/10/23	0847	<i>[Signature]</i>	GEL	11/10/23	0847
<i>[Signature]</i>	GEL	11/10/23	1510	<i>[Signature]</i>	GEL	11/10/23	1510

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all)			Nutrients	MISC.	Gypsum	Coal	Flyash	Oil
<input type="checkbox"/> Ag	<input type="checkbox"/> Cu	<input type="checkbox"/> Sb	<input type="checkbox"/> TOC	<input type="checkbox"/> BTEX	<input type="checkbox"/> Wallboard	<input type="checkbox"/> Ultimate	<input type="checkbox"/> Ammonia	Trans, Oil Qual.
<input type="checkbox"/> Al	<input type="checkbox"/> Fe	<input type="checkbox"/> Se	<input type="checkbox"/> DOC	<input type="checkbox"/> Naphthalene	<input type="checkbox"/> Gypsum (all below)	<input type="checkbox"/> % Moisture	<input type="checkbox"/> LOI	<input type="checkbox"/> % Moisture
<input type="checkbox"/> As	<input type="checkbox"/> K	<input type="checkbox"/> Sn	<input type="checkbox"/> TP/TPO4	<input type="checkbox"/> THM/HAA	<input type="checkbox"/> AIM	<input type="checkbox"/> Ash	<input type="checkbox"/> % Carbon	Color
<input type="checkbox"/> B	<input type="checkbox"/> Li	<input type="checkbox"/> Sr	<input type="checkbox"/> NH3-N	<input type="checkbox"/> VOC	<input type="checkbox"/> TOC	<input type="checkbox"/> Sulfur	<input type="checkbox"/> % Mineral	Acidity
<input type="checkbox"/> Ba	<input type="checkbox"/> Mg	<input type="checkbox"/> Ti	<input type="checkbox"/> F	<input type="checkbox"/> Oil & Grease	<input type="checkbox"/> Total metals	<input type="checkbox"/> BTUs	<input type="checkbox"/> Mineral Analysis	Dielectric Strength
<input type="checkbox"/> Be	<input type="checkbox"/> Mn	<input type="checkbox"/> Tl	<input type="checkbox"/> Cl	<input type="checkbox"/> E. Coli	<input type="checkbox"/> Soluble Metals	<input type="checkbox"/> Volatile Matter	<input type="checkbox"/> Sieve	IFT
<input type="checkbox"/> Ca	<input type="checkbox"/> Mo	<input type="checkbox"/> V	<input type="checkbox"/> NO2	<input type="checkbox"/> Total Coliform	<input type="checkbox"/> Purity (CaSO4)	<input type="checkbox"/> CHN	<input type="checkbox"/> % Moisture	Dissolved Gases
<input type="checkbox"/> Cd	<input type="checkbox"/> Na	<input type="checkbox"/> Zn	<input type="checkbox"/> Br	<input type="checkbox"/> pH	<input type="checkbox"/> % Moisture	Other Tests:	NPDES	Used Oil
<input type="checkbox"/> Co	<input type="checkbox"/> Ni	<input type="checkbox"/> Hg	<input type="checkbox"/> NO3	<input type="checkbox"/> Dissolved As	<input type="checkbox"/> Sulfites	<input type="checkbox"/> XRF Scan	<input type="checkbox"/> Oil & Grease	Flashpoint
<input type="checkbox"/> Cr	<input type="checkbox"/> Pb	<input type="checkbox"/> CrVI	<input type="checkbox"/> SO4	<input type="checkbox"/> Dissolved Fe	<input type="checkbox"/> pH	<input type="checkbox"/> HGI	<input type="checkbox"/> As	Metals in oil
				<input type="checkbox"/> Rad 226	<input type="checkbox"/> Chlorides	<input type="checkbox"/> Fineness	<input type="checkbox"/> TSS	(As, Cd, Cr, Ni, Pb)
				<input type="checkbox"/> Rad 228	<input type="checkbox"/> Particle Size	<input type="checkbox"/> Particulate Matter		Hg)
				<input type="checkbox"/> PCB	<input type="checkbox"/> Sulfur			1X
								GOFER

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid, C-coal, G-gypsum, FA-flyash, BA-bottom ash, M-misc (describe in comment section)
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

List of current GEL Certifications as of 01 December 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-05
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2023-152
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122023-38
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

November 03, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 641316

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on October 13, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Jordan Melton for
Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 641316 GEL Work Order: 641316

The Qualifiers in this report are defined as follows:


- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80265 Project: SOOP00119
Sample ID: 641316001 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 11:23
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		2.93	+/-1.10	1.39	3.00	pCi/L		JE1	10/24/23	0847	2509217		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.58	+/-1.16			pCi/L		NXL1	11/03/23	1610	2515880		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.655	+/-0.389	0.448	1.00	pCi/L		LXP1	11/02/23	0756	2509249		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			86.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF80266	Project: SOOP00119
Sample ID: 641316002	Client ID: SOOP001
Matrix: GW	
Collect Date: 10-OCT-23 11:28	
Receive Date: 13-OCT-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		3.98	+/-1.26	1.56	3.00	pCi/L		JE1	10/24/23	0847	2509217		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		4.05	+/-1.27			pCi/L		NXL1	11/03/23	1610	2515880		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.0767	+/-0.184	0.368	1.00	pCi/L		LXP1	11/02/23	0756	2509249		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			84.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: November 3, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF80267 Project: SOOP00119
Sample ID: 641316003 Client ID: SOOP001
Matrix: GW
Collect Date: 10-OCT-23 10:15
Receive Date: 13-OCT-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	-1.54	+/-1.06	2.22	3.00	pCi/L		JE1	10/24/23	0847	2509217		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		0.205	+/-1.13			pCi/L		NXL1	11/03/23	1610	2515880		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.205	+/-0.403	0.739	1.00	pCi/L		LXP1	11/02/23	0831	2509249		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			81.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: November 3, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Contact: Ms. Jeanette Gilmetti

Workorder: 641316

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2509217										
QC1205547740	641316001	DUP									
Radium-228				2.93	3.95	pCi/L	29.7	(0% - 100%)	JE1	10/24/23	08:47
			Uncertainty	+/-1.10	+/-1.15						
QC1205547741	LCS										
Radium-228				78.3	71.6	pCi/L	91.4	(75%-125%)		10/24/23	08:48
			Uncertainty		+/-3.85						
QC1205547739	MB										
Radium-228			U		0.166	pCi/L				10/24/23	08:47
			Uncertainty		+/-0.981						
Rad Ra-226											
Batch	2509249										
QC1205547810	641316001	DUP									
Radium-226				0.655	1.02	pCi/L	43.9	(0% - 100%)	LXP1	11/02/23	08:31
			Uncertainty	+/-0.389	+/-0.511						
QC1205547812	LCS										
Radium-226				26.9	23.3	pCi/L	86.5	(75%-125%)		11/02/23	08:31
			Uncertainty		+/-2.01						
QC1205547809	MB										
Radium-226			U		0.176	pCi/L				11/02/23	08:31
			Uncertainty		+/-0.345						
QC1205547811	641316001	MS									
Radium-226				134	0.655	pCi/L	78.5	(75%-125%)		11/02/23	08:31
			Uncertainty	+/-0.389	+/-10.4						

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 641316

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 641316**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2509217

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
641316001	AF80265
641316002	AF80266
641316003	AF80267
1205547739	Method Blank (MB)
1205547740	641316001(AF80265) Sample Duplicate (DUP)
1205547741	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2509249

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
641316001	AF80265
641316002	AF80266
641316003	AF80267
1205547809	Method Blank (MB)
1205547810	641316001(AF80265) Sample Duplicate (DUP)
1205547811	641316001(AF80265) Matrix Spike (MS)
1205547812	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where

applicable, with the following exceptions.

Miscellaneous Information

Additional Comments

The matrix spike, 1205547811 (AF80265MS), aliquot was reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

11/13/23 -RAD

Contract Lab Info: GEL

Contract Lab Due Date (Lab Only): 11 / 20 / 23

Send report to lcwillia@santecooper.com & sjbrown@santecooper.com

Chain of Custody

641316
641317



Customer Email/Report Recipient:

Date Results Needed by:

Project/Task/Unit #:

Rerun request for any flagged QC

LINDA WILLIAMS @santecooper.com

/ /

125915 / JMO2.09.G01.1 / 36500

Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix (see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Rad 226/228	TOTAL RAD CALC	F, Cl, SO4
AF 80265	CGYP-7	10/10/23	1123	ZM BB	3	P	G	GW	2 1		2	X	1
AF 80266	CGYP-7 DUP		1128										
AF 80267	POZ-3		1515										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>[Signature]</i>	36851	10/13/23	0944	<i>[Signature]</i>	GEL	10/13/23	0944
<i>[Signature]</i>	GEL	10/13/23	1610	<i>[Signature]</i>	GEL	10/13/23	1610

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Matrix codes: GW-groundwater, DW-drinking water, SW-surface water, WW-waste water, BW-boiler water, L-limestone, Oil-oil, S-Soil, SL-solid,
 Preservative code- 1=<4°C 2=HNO3 3=H2SO4 4-HCl 5=Na2S2O3 6-Other (Specify)

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SOCP</u>		SDG/AR/COC/Work Order: <u>641316/641317</u>	
Received By: <u>QG</u>		Date Received: <u>10/18/23</u>	
Carrier and Tracking Number		FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other	
Suspected Hazard Information		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.	
A) Shipped as a DOT Hazardous?		Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___	
B) Did the client designate the samples to be received as radioactive?		COC notation or radioactive stickers on containers equal client designation	
C) Did the RSO classify the samples as radioactive?		Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> <u>5</u> <u>SPM/mR/hr</u> Classified as: Rad 1 Rad 2 Rad 3	
D) Did the client designate samples are hazardous?		COC notation or hazard labels on containers equal client designation	
E) Did the RSO identify possible hazards?		If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other:	
Sample Receipt Criteria		Yes	NA
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Comments (Use Continuation Form if needed):			

JR

n/a

TEMP: 3°C

PM (or PMA) review: Initials glw Date 10/16/23 Page 1 of 1

List of current GEL Certifications as of 03 November 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-04
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2023-152
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122023-38
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

January 11, 2024

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 649122

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on December 15, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 649122 GEL Work Order: 649122

The Qualifiers in this report are defined as follows:


- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85222 Project: SOOP00119
Sample ID: 649122001 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 13:19
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.18	+/-0.837	1.29	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.83	+/-0.888			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.646	+/-0.296	0.311	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			87.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85223 Project: SOOP00119
Sample ID: 649122002 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 10:24
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.944	+/-1.02	1.71	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.52	+/-1.17			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		2.58	+/-0.567	0.297	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			92.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85224 Project: SOOP00119
Sample ID: 649122003 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 10:29
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		1.39	+/-0.763	1.07	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.18	+/-0.935			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.79	+/-0.539	0.495	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			89.4	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: January 11, 2024

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF85225 Project: SOOP00119
Sample ID: 649122004 Client ID: SOOP001
Matrix: GW
Collect Date: 11-DEC-23 11:50
Receive Date: 15-DEC-23
Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	0.328	+/-0.652	1.17	3.00	pCi/L		JE1	12/29/23	1355	2542833		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.72	+/-0.827			pCi/L		NXL1	01/11/24	0958	2551440		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.39	+/-0.509	0.561	1.00	pCi/L		LXP1	01/10/24	0839	2541882		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			86.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: January 11, 2024

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 649122

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2542833										
QC1205605880	648208001	DUP									
Radium-228		4.72		2.46	pCi/L	63		(0% - 100%)	JE1	12/29/23	13:55
	Uncertainty	+/-1.37		+/-1.03							
QC1205605881	LCS										
Radium-228		74.3		71.5	pCi/L		96.1	(75%-125%)		12/29/23	13:55
	Uncertainty			+/-4.39							
QC1205605879	MB										
Radium-228			U	0.437	pCi/L					12/29/23	13:55
	Uncertainty			+/-0.605							
Rad Ra-226											
Batch	2541882										
QC1205603843	649122001	DUP									
Radium-226		0.646		0.568	pCi/L	12.8		(0% - 100%)	LXP1	01/10/24	09:11
	Uncertainty	+/-0.296		+/-0.341							
QC1205603846	LCS										
Radium-226		17.0		13.0	pCi/L		76.2	(75%-125%)		01/10/24	09:11
	Uncertainty			+/-1.02							
QC1205603841	MB										
Radium-226			U	0.177	pCi/L					01/10/24	09:11
	Uncertainty			+/-0.203							
QC1205603845	649122001	MS									
Radium-226		113		93.8	pCi/L		82.2	(75%-125%)		01/10/24	09:11
	Uncertainty	+/-0.296		+/-6.51							

- Notes:**
- Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
 - The Qualifiers in this report are defined as follows:
 - U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
 - J Value is estimated
 - X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
 - H Analytical holding time was exceeded
 - < Result is less than value reported

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 649122

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
>											
UI											
BD											
h											
R											
^											
N/A											
ND											
M											
NJ											
FA											
UJ											
Q											
K											
UL											
L											
NI											
Y											
**											
M											
J											

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 649122**

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2542833

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
649122001	AF85222
649122002	AF85223
649122003	AF85224
649122004	AF85225
1205605879	Method Blank (MB)
1205605880	648208001(AF84383) Sample Duplicate (DUP)
1205605881	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2541882

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
649122001	AF85222
649122002	AF85223
649122003	AF85224
649122004	AF85225
1205603841	Method Blank (MB)
1205603843	649122001(AF85222) Sample Duplicate (DUP)
1205603845	649122001(AF85222) Matrix Spike (MS)
1205603846	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Miscellaneous Information**Additional Comments**

Aliquots for the matrix spikes, 1205603845 (AF85222MS), were reduced to conserve sample volume.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Chain of Custody

649122



Customer Email/Report Recipient: _____ Date Results Needed by: _____ Project/Task/Unit #: _____ Rerun request for any flagged QC

LINDA.WILLIAMS @santeecooper.com _____ / _____ / _____ 1259115 / JM=2.07.GP1.1 / 36500 (Yes) NO

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	RAD 226/228	TOTAL RAD CALC	Analysis Group	
AF85222	WAP-27	12/11/23	1319	ZM ML	2	G	G	GW	2		X	X		
AF85223	WAP-28		1024											
AF85224	WAP-28 DUP		1029											
AF85225	WAP-29		1150											

Relinquished by: <u>[Signature]</u>	Employee# <u>36851</u>	Date <u>12/15/23</u>	Time <u>0923</u>	Received by: <u>[Signature]</u>	Employee # <u>GEL</u>	Date <u>12/15/23</u>	Time <u>1423</u>
Relinquished by: <u>[Signature]</u>	Employee# <u>GEL</u>	Date <u>12/15/23</u>	Time <u>1610</u>	Received by: <u>[Signature]</u>	Employee # <u>GEL</u>	Date <u>12/15/23</u>	Time <u>1810</u>
Relinquished by: _____	Employee# _____	Date _____	Time _____	Received by: _____	Employee # _____	Date _____	Time _____

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particulate Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

SAMPLE RECEIPT & REVIEW FORM

Client: <u>SDGP</u>		SDG/AR/COC/Work Order: <u>649122</u>		
Received By: <u>QG</u>		Date Received: <u>12/15/23</u>		
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Carrier</u> Other		
Suspected Hazard Information		*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.		
A) Shipped as a DOT Hazardous?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___		
B) Did the client designate the samples are to be received as radioactive?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation		
C) Did the RSO classify the samples as radioactive?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> <u>CPM</u> mR/HR Classified as: Rad 1 Rad 2 Rad 3		
D) Did the client designate samples are hazardous?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation		
E) Did the RSO identify possible hazards?	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____		
Sample Receipt Criteria	Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1 Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2 Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3 Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Preservation Method: <u>Wet Ice</u> Ice Packs Dry ice <u>None</u> Other: _____ *all temperatures are recorded in Celsius TEMP: <u>2°C</u>
4 Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Temperature Device Serial #: <u>IR1-23</u> Secondary Temperature Device Serial # (If Applicable): _____
5 Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6 Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Sample ID's and Containers Affected: _____ If Preservation added, Lot#: _____
7 Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer)
				Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No)
				Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___
8 Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and tests affected: _____
9 Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	ID's and containers affected: _____
10 Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11 Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: No container count on COC Other (describe) <u>only received 1 container for AP85752</u>
12 Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
13 COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed):				

PM (or PMA) review: Initials JW Date 12/16/23 Page 1 of 1

List of current GEL Certifications as of 11 January 2024

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-00651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	KY90129
Kentucky Wastewater	KY90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2023019
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122024-05
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2023-152
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-23-21
Utah NELAP	SC000122023-38
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



July 21, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 627278

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on June 23, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 627278 GEL Work Order: 627278

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66414	Project: SOOP00119
Sample ID: 627278001	Client ID: SOOP001
Matrix: GW	
Collect Date: 21-JUN-23 11:59	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	2.18	+/-1.50	2.38	3.00	pCi/L		JE1	07/15/23	1513	2451868		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.18	+/-1.52			pCi/L		NXL1	07/21/23	0828	2451867		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.000	+/-0.239	0.530	1.00	pCi/L		LXP1	07/20/23	0925	2451862		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			71.2	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66422	Project: SOOP00119
Sample ID: 627278002	Client ID: SOOP001
Matrix: GW	
Collect Date: 21-JUN-23 13:27	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228		2.50	+/-1.06	1.31	3.00	pCi/L		JE1	07/15/23	1513	2451868		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		3.48	+/-1.17			pCi/L		NXL1	07/21/23	0828	2451867		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		0.983	+/-0.494	0.576	1.00	pCi/L		LXP1	07/20/23	0925	2451862		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			69	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66423	Project: SOOP00119
Sample ID: 627278003	Client ID: SOOP001
Matrix: GW	
Collect Date: 21-JUN-23 14:38	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.19	+/-0.936	1.44	3.00	pCi/L		JE1	07/15/23	1513	2451868		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		1.87	+/-1.05			pCi/L		NXL1	07/21/23	0828	2451867		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226	U	0.680	+/-0.486	0.700	1.00	pCi/L		LXP1	07/20/23	0925	2451862		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			65.5	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66409	Project: SOOP00119
Sample ID: 627278004	Client ID: SOOP001
Matrix: GW	
Collect Date: 20-JUN-23 09:11	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.43	+/-1.49	2.30	3.00	pCi/L		JE1	07/15/23	1513	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.15	+/-1.56			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.721	+/-0.471	0.644	1.00	pCi/L		LXP1	07/20/23	1003	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			69.6	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66415	Project: SOOP00119
Sample ID: 627278005	Client ID: SOOP001
Matrix: GW	
Collect Date: 20-JUN-23 10:17	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.42	+/-1.23	1.73	3.00	pCi/L		JE1	07/15/23	1513	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.78	+/-1.27			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226	U	0.360	+/-0.330	0.498	1.00	pCi/L		LXP1	07/20/23	1003	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			67.3	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66410	Project: SOOP00119
Sample ID: 627278006	Client ID: SOOP001
Matrix: GW	
Collect Date: 20-JUN-23 11:20	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	2.62	+/-1.72	2.70	3.00	pCi/L		JE1	07/18/23	1357	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.27	+/-1.77			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.656	+/-0.431	0.558	1.00	pCi/L		LXP1	07/20/23	1003	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			64.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66411	Project: SOOP00119
Sample ID: 627278007	Client ID: SOOP001
Matrix: GW	
Collect Date: 19-JUN-23 13:09	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Ra228, Liquid "As Received"													
Radium-228	U	1.77	+/-1.26	1.93	3.00	pCi/L		JE1	07/15/23	1513	2451868		1
Radium-226+Radium-228 Calculation "See Parent Products"													
Radium-226+228 Sum		2.94	+/-1.34			pCi/L		NXL1	07/21/23	0828	2451867		2
Rad Radium-226													
Lucas Cell, Ra226, Liquid "As Received"													
Radium-226		1.17	+/-0.449	0.416	1.00	pCi/L		LXP1	07/20/23	1003	2451862		3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer	Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer		GFPC, Ra228, Liquid "As Received"			64.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

- | | |
|---------------------------------------|--------------------------------|
| DF: Dilution Factor | Lc/LC: Critical Level |
| DL: Detection Limit | PF: Prep Factor |
| MDA: Minimum Detectable Activity | RL: Reporting Limit |
| MDC: Minimum Detectable Concentration | SQL: Sample Quantitation Limit |

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66412	Project: SOOP00119
Sample ID: 627278008	Client ID: SOOP001
Matrix: GW	
Collect Date: 19-JUN-23 13:14	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228		2.38	+/-1.19	1.64	3.00	pCi/L		JE1	07/15/23	1513	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		3.00	+/-1.24			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.619	+/-0.371	0.476	1.00	pCi/L		CRO	07/20/23	1640	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			69.1	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: July 21, 2023

Company : Santee Cooper
 Address : P.O. Box 2946101
 OCO3
 Moncks Corner, South Carolina 29461
 Contact: Ms. Jeanette Gilmetti
 Project: ABS Lab Analytical

Client Sample ID: AF66413	Project: SOOP00119
Sample ID: 627278009	Client ID: SOOP001
Matrix: GW	
Collect Date: 19-JUN-23 14:50	
Receive Date: 23-JUN-23	
Collector: Client	

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time Batch	Method
Rad Gas Flow Proportional Counting												
GFPC, Ra228, Liquid "As Received"												
Radium-228	U	1.63	+/-1.22	1.91	3.00	pCi/L		JE1	07/15/23	1514	2451868	1
Radium-226+Radium-228 Calculation "See Parent Products"												
Radium-226+228 Sum		2.32	+/-1.27			pCi/L		NXL1	07/21/23	0828	2451867	2
Rad Radium-226												
Lucas Cell, Ra226, Liquid "As Received"												
Radium-226		0.695	+/-0.374	0.354	1.00	pCi/L		LXP1	07/20/23	1003	2451862	3

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 904.0/SW846 9320 Modified	
2	Calculation	
3	EPA 903.1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Barium-133 Tracer	GFPC, Ra228, Liquid "As Received"			65.8	(15%-125%)

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: July 21, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 627278

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Rad Gas Flow											
Batch	2451868										
QC1205446624	627278001	DUP									
Radium-228	U	2.18	U	-2.11	pCi/L	N/A		N/A	JE1	07/15/23	15:12
	Uncertainty	+/-1.50		+/-1.21							
QC1205446625	LCS										
Radium-228	79.2			88.5	pCi/L		112	(75%-125%)		07/15/23	15:13
	Uncertainty			+/-5.00							
QC1205446626	LCSD										
Radium-228	79.2			67.0	pCi/L	27.5*	84.6	(0%-20%)		07/15/23	15:13
	Uncertainty			+/-4.41							
QC1205446623	MB										
Radium-228				2.55	pCi/L					07/15/23	15:12
	Uncertainty			+/-1.41							
Rad Ra-226											
Batch	2451862										
QC1205446613	627278001	DUP									
Radium-226	U	0.000		0.644	pCi/L	200*		(0% - 100%)	LXP1	07/20/23	11:19
	Uncertainty	+/-0.239		+/-0.445							
QC1205446615	LCS										
Radium-226	26.3			21.2	pCi/L		80.5	(75%-125%)		07/20/23	11:19
	Uncertainty			+/-1.83							
QC1205446616	LCSD										
Radium-226	26.3			23.7	pCi/L	11.2	90.1	(0%-20%)		07/20/23	11:19
	Uncertainty			+/-1.96							
QC1205446612	MB										
Radium-226			U	0.311	pCi/L					07/20/23	11:19
	Uncertainty			+/-0.338							
QC1205446614	627278001	MS									
Radium-226	131 U	0.000		139	pCi/L		106	(75%-125%)		07/20/23	11:19
	Uncertainty	+/-0.239		+/-10.7							

Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).
The Qualifiers in this report are defined as follows:

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 627278

Page 2 of 2

Parname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
U		Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.									
J		Value is estimated									
X		Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier									
H		Analytical holding time was exceeded									
<		Result is less than value reported									
>		Result is greater than value reported									
UI		Gamma Spectroscopy--Uncertain identification									
BD		Results are either below the MDC or tracer recovery is low									
h		Preparation or preservation holding time was exceeded									
R		Sample results are rejected									
^		RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.									
N/A		RPD or %Recovery limits do not apply.									
ND		Analyte concentration is not detected above the detection limit									
M		M if above MDC and less than LLD									
NJ		Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier									
FA		Failed analysis.									
UJ		Gamma Spectroscopy--Uncertain identification									
Q		One or more quality control criteria have not been met. Refer to the applicable narrative or DER.									
K		Analyte present. Reported value may be biased high. Actual value is expected to be lower.									
UL		Not considered detected. The associated number is the reported concentration, which may be inaccurate due to a low bias.									
L		Analyte present. Reported value may be biased low. Actual value is expected to be higher.									
NI		See case narrative									
Y		Other specific qualifiers were required to properly define the results. Consult case narrative.									
**		Analyte is a Tracer compound									
M		REMP Result > MDC/CL and < RDL									
J		See case narrative for an explanation									

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry
Technical Case Narrative
Santee Cooper
SDG #: 627278**

Product: Radium-226+Radium-228 Calculation

Analytical Method: Calculation

Analytical Procedure: GL-RAD-D-003 REV# 45

Analytical Batch: 2451867

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
627278001	AF66414
627278002	AF66422
627278003	AF66423
627278004	AF66409
627278005	AF66415
627278006	AF66410
627278007	AF66411
627278008	AF66412
627278009	AF66413

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Product: GFPC, Ra228, Liquid

Analytical Method: EPA 904.0/SW846 9320 Modified

Analytical Procedure: GL-RAD-A-063 REV# 5

Analytical Batch: 2451868

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
627278001	AF66414
627278002	AF66422
627278003	AF66423
627278004	AF66409
627278005	AF66415
627278006	AF66410
627278007	AF66411
627278008	AF66412
627278009	AF66413
1205446623	Method Blank (MB)

1205446624	627278001(AF66414) Sample Duplicate (DUP)
1205446625	Laboratory Control Sample (LCS)
1205446626	Laboratory Control Sample Duplicate (LCSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Method Blank Criteria

The blank result (See Below) is greater than the MDC but less than the required detection limit.

Sample	Analyte	Value
1205446623 (MB)	Radium-228	Result: 2.55 pCi/L > MDA: 2.12 pCi/L <= RDL: 3.00 pCi/L

Duplication Criteria between LCS and LCSD

The Laboratory Control Sample and Laboratory Control Sample Duplicate (See Below) do not meet the duplication requirement; however, they both meet the spiked recovery requirement.

Sample	Analyte	Value
1205446625 (LCS) and 1205446626 (LCSD)	Radium-228	RPD 27.5* (0%-20%)

Technical Information

Negative > 3 sigma TPU

Sample result was more negative than the three sigma TPU. The background control chart was examined and the detector was determined to be fully functional.

Sample	Analyte	Value
1205446624 (AF66414DUP)	Radium-228	Negative Result > 3 sigma value

Recounts

Sample 627278006 (AF66410) was re-eluted and recounted to verify sample result. The recount is reported.

Product: Lucas Cell, Ra226, Liquid

Analytical Method: EPA 903.1 Modified

Analytical Procedure: GL-RAD-A-008 REV# 15

Analytical Batch: 2451862

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
627278001	AF66414
627278002	AF66422
627278003	AF66423
627278004	AF66409
627278005	AF66415
627278006	AF66410
627278007	AF66411
627278008	AF66412
627278009	AF66413
1205446612	Method Blank (MB)
1205446613	627278001(AF66414) Sample Duplicate (DUP)
1205446614	627278001(AF66414) Matrix Spike (MS)
1205446615	Laboratory Control Sample (LCS)
1205446616	Laboratory Control Sample Duplicate (LCSD)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

Quality Control (QC) Information

Duplication Criteria between QC Sample and Duplicate Sample

The Sample and the Duplicate, (See Below), did not meet the relative percent difference requirement; however, they do meet the relative error ratio requirement with the value listed below.

Sample	Analyte	Value
1205446613 (AF66414DUP)	Radium-226	RPD 200* (0.0%-100.0%) RER 2.44 (0-3)

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.



Chain of Custody

627278

Customer Email/Report Recipient: LINDA.WILLIAMS@santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JMO2-09.001.1 / 36500 Rerun request for any flagged QC: Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	RAD 226	RAD 228	TOTAL RAD CALC
AF66414	CCMAP-6	6/21/23	1159	WJK ML	2	P	G	GW	2				
AF66422	CCMLF-1		1327										
AF66423	CCMLF-1D		1428										
AF66409	CCMAP-2	6/20/23	0911										
AF66415	CCMAP-7		1017										
AF66410	CCMAP-3		1120										
AF66411	CCMAP-4	6/19/23	1309										
AF66412	CCMAP-4 DUP		1314										
AF66413	CCMAP-5		1450										

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>SJB</i>	35594	6/23/23	0917	<i>WJK</i>	GEL	6/23/23	0917
<i>WJK</i>	GEL	6/23/23	1520	<i>STB</i>		6/23/23	15:20

Sample Receiving (Internal Use Only)
TEMP (°C): _____ Initial: _____
Correct pH: Yes No
Preservative Lot#: _____
Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all)			Nutrients	MISC.	Gypsum	Coal	Flyash	Oil
<input type="checkbox"/> Ag	<input type="checkbox"/> Cu	<input type="checkbox"/> Sb						
<input type="checkbox"/> Al	<input type="checkbox"/> Fe	<input type="checkbox"/> Se	<input type="checkbox"/> TOC	<input type="checkbox"/> BTEX	<input type="checkbox"/> Wallboard	<input type="checkbox"/> Ultimate	<input type="checkbox"/> Ammonia	<input type="checkbox"/> Trans. Oil Qual.
<input type="checkbox"/> As	<input type="checkbox"/> K	<input type="checkbox"/> Sn	<input type="checkbox"/> DOC	<input type="checkbox"/> Naphthalene	<input type="checkbox"/> Gypsum(all below)	<input type="checkbox"/> % Moisture	<input type="checkbox"/> LOI	<input type="checkbox"/> %Moisture
<input type="checkbox"/> B	<input type="checkbox"/> Li	<input type="checkbox"/> Sr	<input type="checkbox"/> TP/TPO4	<input type="checkbox"/> THM/HAA	<input type="checkbox"/> AIM	<input type="checkbox"/> Ash	<input type="checkbox"/> % Carbon	<input type="checkbox"/> Color
<input type="checkbox"/> Ba	<input type="checkbox"/> Mg	<input type="checkbox"/> Ti	<input type="checkbox"/> NH3-N	<input type="checkbox"/> VOC	<input type="checkbox"/> TOC	<input type="checkbox"/> Sulfur	<input type="checkbox"/> Mineral Analysis	<input type="checkbox"/> Acidity
<input type="checkbox"/> Be	<input type="checkbox"/> Mn	<input type="checkbox"/> Tl	<input type="checkbox"/> F	<input type="checkbox"/> Oil & Grease	<input type="checkbox"/> Total metals	<input type="checkbox"/> BTUs	<input type="checkbox"/> Sieve	<input type="checkbox"/> Dielectric Strength
<input type="checkbox"/> Ca	<input type="checkbox"/> Mo	<input type="checkbox"/> V	<input type="checkbox"/> Cl	<input type="checkbox"/> E. Coli	<input type="checkbox"/> Soluble Metals	<input type="checkbox"/> Volatile Matter	<input type="checkbox"/> Used Oil	<input type="checkbox"/> IFT
<input type="checkbox"/> Cd	<input type="checkbox"/> Na	<input type="checkbox"/> Zn	<input type="checkbox"/> NO2	<input type="checkbox"/> Total Coliform	<input type="checkbox"/> Purity (CaSO4)	<input type="checkbox"/> CHN	<input type="checkbox"/> % Moisture	<input type="checkbox"/> Dissolved Gases
<input type="checkbox"/> Co	<input type="checkbox"/> Ni	<input type="checkbox"/> Hg	<input type="checkbox"/> Br	<input type="checkbox"/> pH	<input type="checkbox"/> % Moisture	Other Tests:	<input type="checkbox"/> NPDES	<input type="checkbox"/> Flashpoint
<input type="checkbox"/> Cr	<input type="checkbox"/> Pb	<input type="checkbox"/> CrVI	<input type="checkbox"/> NO3	<input type="checkbox"/> SO4	<input type="checkbox"/> Sulfites	<input type="checkbox"/> XRF Scan	<input type="checkbox"/> Oil & Grease	<input type="checkbox"/> Metals in oil
			<input type="checkbox"/> SO4		<input type="checkbox"/> pH	<input type="checkbox"/> HGI	<input type="checkbox"/> As	<input type="checkbox"/> (As,Cd,Cr,Ni,Pb Hg)
					<input type="checkbox"/> Chlorides	<input type="checkbox"/> Fineness	<input type="checkbox"/> TSS	<input type="checkbox"/> TX
					<input type="checkbox"/> Particle Size	<input type="checkbox"/> Particulate Matter		<input type="checkbox"/> GOFER
					<input type="checkbox"/> Sulfur			

List of current GEL Certifications as of 21 July 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



June 19, 2023

Ms. Jeanette Gilmetti
Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461

Re: ABS Lab Analytical
Work Order: 625517

Dear Ms. Gilmetti:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on June 09, 2023. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

The samples were delivered with proper chain of custody documentation and signatures. All sample containers arrived without any visible signs of tampering or breakage. There are no additional comments concerning sample receipt.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at www.gel.com.

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4289.

Sincerely,

Julie Robinson
Project Manager

Purchase Order: 398684
Enclosures



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis Report for

SOOP001 Santee Cooper

Client SDG: 625517 GEL Work Order: 625517

The Qualifiers in this report are defined as follows:

- * A quality control analyte recovery is outside of specified acceptance criteria
- ** Analyte is a Tracer compound
- ** Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Julie Robinson.

Reviewed by



GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 19, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66407 Project: SOOP00119
Sample ID: 625517001 Client ID: SOOP001
Matrix: GW
Collect Date: 06-JUN-23 08:59
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		2.17	0.330	1.00	mg/L		1	TSM	06/14/23	1650	2443166	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

Certificate of Analysis

Report Date: June 19, 2023

Company : Santee Cooper
Address : P.O. Box 2946101
OCO3
Moncks Corner, South Carolina 29461
Contact: Ms. Jeanette Gilmetti
Project: ABS Lab Analytical

Client Sample ID: AF66439 Project: SOOP00119
Sample ID: 625517002 Client ID: SOOP001
Matrix: GW
Collect Date: 05-JUN-23 14:55
Receive Date: 09-JUN-23
Collector: Client

Parameter	Qualifier	Result	DL	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Carbon Analysis												
SM 5310 B Total Organic Carbon "As Received"												
Total Organic Carbon Average		5.69	0.330	1.00	mg/L		1	TSM	06/14/23	1711	2443166	1

The following Analytical Methods were performed:

Method	Description	Analyst	Comments
1	SM 5310 B		

Notes:

Column headers are defined as follows:

DF: Dilution Factor Lc/LC: Critical Level
DL: Detection Limit PF: Prep Factor
MDA: Minimum Detectable Activity RL: Reporting Limit
MDC: Minimum Detectable Concentration SQL: Sample Quantitation Limit

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Report Date: June 19, 2023

Page 1 of 2

Santee Cooper
P.O. Box 2946101
OCO3
Moncks Corner, South Carolina
Ms. Jeanette Gilmetti

Contact:
Workorder: 625517

Paramname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
Carbon Analysis											
Batch	2443166										
QC1205432039	625517002	DUP									
Total Organic Carbon Average		5.69		5.58	mg/L	1.92		(0%-20%)	TSM	06/14/23	17:31
QC1205432038	LCS										
Total Organic Carbon Average	10.0			9.79	mg/L		97.9	(80%-120%)		06/14/23	15:35
QC1205432037	MB										
Total Organic Carbon Average			U	ND	mg/L					06/14/23	15:25
QC1205432040	625517002	PS									
Total Organic Carbon Average	10.0	5.69		14.8	mg/L		91.5	(65%-120%)		06/14/23	17:51

Notes:

The Qualifiers in this report are defined as follows:

- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- J Value is estimated
- X Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- H Analytical holding time was exceeded
- < Result is less than value reported
- > Result is greater than value reported
- h Preparation or preservation holding time was exceeded
- R Sample results are rejected
- Z Paint Filter Test--Particulates passed through the filter, however no free liquids were observed.
- d 5-day BOD--The 2:1 depletion requirement was not met for this sample
- ^ RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.
- N/A RPD or %Recovery limits do not apply.
- ND Analyte concentration is not detected above the detection limit
- NJ Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- E General Chemistry--Concentration of the target analyte exceeds the instrument calibration range
- Q One or more quality control criteria have not been met. Refer to the applicable narrative or DER.

GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

QC Summary

Workorder: 625517

Page 2 of 2

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
N1		See case narrative									
R		Per section 9.3.4.1 of Method 1664 Revision B, due to matrix spike recovery issues, this result may not be reported or used for regulatory compliance purposes.									
B		The target analyte was detected in the associated blank.									
e		5-day BOD--Test replicates show more than 30% difference between high and low values. The data is qualified per the method and can be used for reporting purposes									
J		See case narrative for an explanation									

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

Technical Case Narrative
Santee Cooper
SDG #: 625517

General Chemistry

Product: Carbon, Total Organic

Analytical Method: SM 5310 B

Analytical Procedure: GL-GC-E-093 REV# 21

Analytical Batch: 2443166

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
625517001	AF66407
625517002	AF66439
1205432037	Method Blank (MB)
1205432038	Laboratory Control Sample (LCS)
1205432039	625517002(AF66439) Sample Duplicate (DUP)
1205432040	625517002(AF66439) Post Spike (PS)

The samples in this SDG were analyzed on an "as received" basis.

Data Summary:

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

Certification Statement

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

6/19/23 - TOC

Contract Lab Info: GEL Contract Lab Due Date (Lab Only): 7 / 10 / 23 -RAD Send report to lcwillia@santeecooper.com & sjbrown@santeecooper.com

Chain of Custody

625517



Customer Email/Report Recipient: LCWILLIA@santeecooper.com Date Results Needed by: Project/Task/Unit #: 125915/JM02.09.G01.1/36500 Rerun request for any flagged QC (Yes) No

Analysis Group

Main Chain of Custody table with columns: Labworks ID # (Internal use only), Sample Location/Description, Collection Date, Collection Time, Sample Collector, Total # of containers, Bottle type: (Glass-G/Plastic-P), Grab (G) or Composite (C), Matrix(see below), Preservative (see below), Comments, RAD 226/228, TOTAL RAD CALC, TOC.

Handwritten transfer log table with columns: Relinquished by, Employee#, Date, Time, Received by, Employee #, Date, Time.

Sample Receiving (Internal Use Only) TEMP (°C): Initial: Correct pH: Yes No Preservative Lot#: Date/Time/Init for preservative:

Checklist grid for METALS (all), Nutrients, MISC., Gypsum, Coal, Flyash, and Oil. Includes sub-sections like Ultimate, Other Tests, and NPDES.

SAMPLE RECEIPT & REVIEW FORM

Client: SCOP		SDG/AR/COC/Work Order: 625517			
Received By: Stacy Boone		Date Received: June 9, 2023			
Carrier and Tracking Number		Circle Applicable: FedEx Express FedEx Ground UPS Field Services <u>Courier</u> Other			
		<p>19c 19c 1c</p>			
Suspected Hazard Information	Yes	No	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.		
A) Shipped as a DOT Hazardous?		<input checked="" type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___		
B) Did the client designate the samples are to be received as radioactive?		<input checked="" type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation.		
C) Did the RSO classify the samples as radioactive?		<input checked="" type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u> </u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3		
D) Did the client designate samples are hazardous?		<input checked="" type="checkbox"/>	COC notation or hazard labels on containers equal client designation.		
E) Did the RSO identify possible hazards?		<input checked="" type="checkbox"/>	If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____		
Sample Receipt Criteria		Yes	NA	No	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Preservation Method: Wet ice Ice Packs Dry ice None Other: *all temperatures are recorded in Celsius
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Temperature Device Serial #: IR3-23 IR3-23 Secondary Temperature Device Serial # (If Applicable):
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample ID's and Containers Affected: If Preservation added, Lot#:
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected:
8	Samples received within holding time?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and tests affected:
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	ID's and containers affected:
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided by use of GEL labels?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed):					

TEMP: See Tracking

PM (or PMA) review: Initials zfw Date 6/12/23 Page 1 of 1

List of current GEL Certifications as of 19 June 2023

State	Certification
Alabama	42200
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122023-4
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2022-160
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-22-20
Utah NELAP	SC000122022-37
Vermont	VT87156
Virginia NELAP	460202
Washington	C780

ANALYTICAL REPORT

PREPARED FOR

Attn: Linda Williams
South Carolina Public Service Authority
Santee Cooper
PO BOX 2946101
Moncks Corner, South Carolina 29461-2901

Generated 6/29/2023 11:08:16 AM

JOB DESCRIPTION

125915/JM02.09.G01.1/36500

JOB NUMBER

680-236991-1


Eurofins Savannah

Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing Southeast, LLC Project Manager.

Authorization



Generated
6/29/2023 11:08:16 AM

Authorized for release by
Jerry Lanier, Project Manager I
Jerry.Lanier@et.eurofinsus.com
(912)250-0281

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Sample Summary	5
Method Summary	6
Definitions	7
Detection Summary	8
Client Sample Results	9
QC Sample Results	22
QC Association	23
Chronicle	24
Chain of Custody	27
Receipt Checklists	29
Certification Summary	30



Case Narrative

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Job ID: 680-236991-1

Laboratory: Eurofins Savannah

Narrative

Job Narrative
680-236991-1

Receipt

The samples were received on 6/27/2023 9:30 AM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 14.0°C

Metals

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Sample Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-236991-1	AF66411	Water	06/19/23 13:09	06/27/23 09:30
680-236991-2	AF66412	Water	06/19/23 13:14	06/27/23 09:30
680-236991-3	AF66413	Water	06/19/23 14:50	06/27/23 09:30
680-236991-4	AF66409	Water	06/20/23 09:11	06/27/23 09:30
680-236991-5	AF66415	Water	06/20/23 10:17	06/27/23 09:30
680-236991-6	AF66410	Water	06/20/23 11:20	06/27/23 09:30
680-236991-7	AF66414	Water	06/21/23 11:59	06/27/23 09:30
680-236991-8	AF66422	Water	06/21/23 13:27	06/27/23 09:30
680-236991-9	AF66423	Water	06/21/23 14:38	06/27/23 09:30
680-236991-10	AF66446	Water	06/22/23 09:46	06/27/23 09:30
680-236991-11	AF66424	Water	06/22/23 10:58	06/27/23 09:30
680-236991-12	AF66416	Water	06/22/23 12:55	06/27/23 09:30
680-236991-13	AF66408	Water	06/22/23 13:51	06/27/23 09:30



Method Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Method	Method Description	Protocol	Laboratory
7470A	Mercury (CVAA)	SW846	EET SAV
7470A	Preparation, Mercury	SW846	EET SAV

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

- 1
- 2
- 3
- 4
- 5**
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Definitions/Glossary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Qualifiers

Metals	
Qualifier	Qualifier Description
U	Indicates the analyte was analyzed for but not detected.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Detection Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66411 **Lab Sample ID: 680-236991-1**

No Detections.

Client Sample ID: AF66412 **Lab Sample ID: 680-236991-2**

No Detections.

Client Sample ID: AF66413 **Lab Sample ID: 680-236991-3**

No Detections.

Client Sample ID: AF66409 **Lab Sample ID: 680-236991-4**

No Detections.

Client Sample ID: AF66415 **Lab Sample ID: 680-236991-5**

No Detections.

Client Sample ID: AF66410 **Lab Sample ID: 680-236991-6**

No Detections.

Client Sample ID: AF66414 **Lab Sample ID: 680-236991-7**

No Detections.

Client Sample ID: AF66422 **Lab Sample ID: 680-236991-8**

No Detections.

Client Sample ID: AF66423 **Lab Sample ID: 680-236991-9**

No Detections.

Client Sample ID: AF66446 **Lab Sample ID: 680-236991-10**

No Detections.

Client Sample ID: AF66424 **Lab Sample ID: 680-236991-11**

No Detections.

Client Sample ID: AF66416 **Lab Sample ID: 680-236991-12**

No Detections.

Client Sample ID: AF66408 **Lab Sample ID: 680-236991-13**

No Detections.

This Detection Summary does not include radiochemical test results.

Eurofins Savannah

1
2
3
4
5
6
7
8
9
10
11
12
13
14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66411

Lab Sample ID: 680-236991-1

Date Collected: 06/19/23 13:09

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:03	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66412

Lab Sample ID: 680-236991-2

Date Collected: 06/19/23 13:14

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:11	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66413

Lab Sample ID: 680-236991-3

Date Collected: 06/19/23 14:50

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:12	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66409

Lab Sample ID: 680-236991-4

Date Collected: 06/20/23 09:11

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:14	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66415

Lab Sample ID: 680-236991-5

Date Collected: 06/20/23 10:17

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:15	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66410

Lab Sample ID: 680-236991-6

Date Collected: 06/20/23 11:20

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:17	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66414

Lab Sample ID: 680-236991-7

Date Collected: 06/21/23 11:59

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:18	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66422

Lab Sample ID: 680-236991-8

Date Collected: 06/21/23 13:27

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:20	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66423

Lab Sample ID: 680-236991-9

Date Collected: 06/21/23 14:38

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:22	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66446

Lab Sample ID: 680-236991-10

Date Collected: 06/22/23 09:46

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:23	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66424

Lab Sample ID: 680-236991-11

Date Collected: 06/22/23 10:58

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:25	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66416

Lab Sample ID: 680-236991-12

Date Collected: 06/22/23 12:55

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:29	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Client Sample Results

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66408

Lab Sample ID: 680-236991-13

Date Collected: 06/22/23 13:51

Matrix: Water

Date Received: 06/27/23 09:30

Method: SW846 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:31	1

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

QC Sample Results

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Method: 7470A - Mercury (CVAA)

Lab Sample ID: MB 680-785974/1-A							Client Sample ID: Method Blank			
Matrix: Water							Prep Type: Total/NA			
Analysis Batch: 786208							Prep Batch: 785974			
Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac	
Mercury	0.200	U	0.200		ug/L		06/28/23 13:39	06/29/23 10:00	1	

Lab Sample ID: LCS 680-785974/2-A							Client Sample ID: Lab Control Sample			
Matrix: Water							Prep Type: Total/NA			
Analysis Batch: 786208							Prep Batch: 785974			
Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits			
Mercury	2.50	2.390		ug/L		96	80 - 120			

Lab Sample ID: 680-236991-1 MS							Client Sample ID: AF66411			
Matrix: Water							Prep Type: Total/NA			
Analysis Batch: 786208							Prep Batch: 785974			
Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits	
Mercury	0.200	U	1.00	1.013		ug/L		101	80 - 120	

Lab Sample ID: 680-236991-1 MSD							Client Sample ID: AF66411				
Matrix: Water							Prep Type: Total/NA				
Analysis Batch: 786208							Prep Batch: 785974				
Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Mercury	0.200	U	1.00	1.005		ug/L		101	80 - 120	1	20

QC Association Summary

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Metals

Prep Batch: 785974

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-236991-1	AF66411	Total/NA	Water	7470A	
680-236991-2	AF66412	Total/NA	Water	7470A	
680-236991-3	AF66413	Total/NA	Water	7470A	
680-236991-4	AF66409	Total/NA	Water	7470A	
680-236991-5	AF66415	Total/NA	Water	7470A	
680-236991-6	AF66410	Total/NA	Water	7470A	
680-236991-7	AF66414	Total/NA	Water	7470A	
680-236991-8	AF66422	Total/NA	Water	7470A	
680-236991-9	AF66423	Total/NA	Water	7470A	
680-236991-10	AF66446	Total/NA	Water	7470A	
680-236991-11	AF66424	Total/NA	Water	7470A	
680-236991-12	AF66416	Total/NA	Water	7470A	
680-236991-13	AF66408	Total/NA	Water	7470A	
MB 680-785974/1-A	Method Blank	Total/NA	Water	7470A	
LCS 680-785974/2-A	Lab Control Sample	Total/NA	Water	7470A	
680-236991-1 MS	AF66411	Total/NA	Water	7470A	
680-236991-1 MSD	AF66411	Total/NA	Water	7470A	

Analysis Batch: 786208

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-236991-1	AF66411	Total/NA	Water	7470A	785974
680-236991-2	AF66412	Total/NA	Water	7470A	785974
680-236991-3	AF66413	Total/NA	Water	7470A	785974
680-236991-4	AF66409	Total/NA	Water	7470A	785974
680-236991-5	AF66415	Total/NA	Water	7470A	785974
680-236991-6	AF66410	Total/NA	Water	7470A	785974
680-236991-7	AF66414	Total/NA	Water	7470A	785974
680-236991-8	AF66422	Total/NA	Water	7470A	785974
680-236991-9	AF66423	Total/NA	Water	7470A	785974
680-236991-10	AF66446	Total/NA	Water	7470A	785974
680-236991-11	AF66424	Total/NA	Water	7470A	785974
680-236991-12	AF66416	Total/NA	Water	7470A	785974
680-236991-13	AF66408	Total/NA	Water	7470A	785974
MB 680-785974/1-A	Method Blank	Total/NA	Water	7470A	785974
LCS 680-785974/2-A	Lab Control Sample	Total/NA	Water	7470A	785974
680-236991-1 MS	AF66411	Total/NA	Water	7470A	785974
680-236991-1 MSD	AF66411	Total/NA	Water	7470A	785974

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66411

Lab Sample ID: 680-236991-1

Date Collected: 06/19/23 13:09

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:03

Client Sample ID: AF66412

Lab Sample ID: 680-236991-2

Date Collected: 06/19/23 13:14

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:11

Client Sample ID: AF66413

Lab Sample ID: 680-236991-3

Date Collected: 06/19/23 14:50

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:12

Client Sample ID: AF66409

Lab Sample ID: 680-236991-4

Date Collected: 06/20/23 09:11

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:14

Client Sample ID: AF66415

Lab Sample ID: 680-236991-5

Date Collected: 06/20/23 10:17

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:15

Client Sample ID: AF66410

Lab Sample ID: 680-236991-6

Date Collected: 06/20/23 11:20

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:17

Lab Chronicle

Client: South Carolina Public Service Authority
 Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66414

Lab Sample ID: 680-236991-7

Date Collected: 06/21/23 11:59

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:18

Client Sample ID: AF66422

Lab Sample ID: 680-236991-8

Date Collected: 06/21/23 13:27

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:20

Client Sample ID: AF66423

Lab Sample ID: 680-236991-9

Date Collected: 06/21/23 14:38

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:22

Client Sample ID: AF66446

Lab Sample ID: 680-236991-10

Date Collected: 06/22/23 09:46

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:23

Client Sample ID: AF66424

Lab Sample ID: 680-236991-11

Date Collected: 06/22/23 10:58

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:25

Client Sample ID: AF66416

Lab Sample ID: 680-236991-12

Date Collected: 06/22/23 12:55

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:29

Lab Chronicle

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Client Sample ID: AF66408

Lab Sample ID: 680-236991-13

Date Collected: 06/22/23 13:51

Matrix: Water

Date Received: 06/27/23 09:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	7470A			785974	DW	EET SAV	06/28/23 13:39
Total/NA	Analysis	7470A		1	786208	BJB	EET SAV	06/29/23 10:31

Laboratory References:

EET SAV = Eurofins Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858





Chain of Custody

Customer Email/Report Recipient: LINDA.WILLIAMS @santecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.09.G01.1 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments	Hg
AF66411	CCMAP-4	6/19/23	1309	WJK ML	1	P	G	GW	2	7470 RL= 0.2 ug/L	X
AF66412	CCMAP-4 DUP		1314								
AF66413	CCMAP-5		1450								
AF66409	CCMAP-2	6/20/23	0911								
AF66415	CCMAP-7		1017								
AF66410	CCMAP-3		1120								
AF66414	CCMAP-6	6/21/23	1159								
AF66422	CCMLF-1		1327								
AF66423	CCMLF-1D		1438								



Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sjbrown</i>	35594	6/26/23	1300	<i>C. Moore</i>	142/140	6/27/23	09:30

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI	Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> P <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum(all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil <input type="checkbox"/> Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases <input type="checkbox"/> Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As, Cd, Cr, Ni, Pb, Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------



Chain of Custody

Customer Email/Report Recipient: LINDA.WILLIAMS@santeecooper.com Date Results Needed by: Project/Task/Unit #: 125915 / JM02.09.G01.1 / 36500 Rerun request for any flagged QC Yes No

Analysis Group

Labworks ID # (Internal use only)	Sample Location/ Description	Collection Date	Collection Time	Sample Collector	Total # of containers	Bottle type: (Glass- G/Plastic-P)	Grab (G) or Composite (C)	Matrix(see below)	Preservative (see below)	Comments • Method # • Reporting limit • Misc. sample info • Any other notes	Hg
AF66446	POZ-8	6/22/23	0946	WJK ML	1	P	G	GW	2	7470 RL=0.2 ug/L	X
AF66424	CCMLF-2		1058								
AF66446	CCMAP-8		1255								
AF66408	CCMAP-1		1351								

Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
<i>Sibrown</i>	35594	6/26/23	1300	<i>CM</i>	142140	6/27/23	0930
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time
Relinquished by:	Employee#	Date	Time	Received by:	Employee #	Date	Time

Sample Receiving (Internal Use Only)
 TEMP (°C): _____ Initial: _____
 Correct pH: Yes No
 Preservative Lot#: _____
 Date/Time/Init for preservative: _____

<input type="checkbox"/> METALS (all) <input type="checkbox"/> Ag <input type="checkbox"/> Cu <input type="checkbox"/> Sb <input type="checkbox"/> Al <input type="checkbox"/> Fe <input type="checkbox"/> Se <input type="checkbox"/> As <input type="checkbox"/> K <input type="checkbox"/> Sn <input type="checkbox"/> B <input type="checkbox"/> Li <input type="checkbox"/> Sr <input type="checkbox"/> Ba <input type="checkbox"/> Mg <input type="checkbox"/> Ti <input type="checkbox"/> Be <input type="checkbox"/> Mn <input type="checkbox"/> Tl <input type="checkbox"/> Ca <input type="checkbox"/> Mo <input type="checkbox"/> V <input type="checkbox"/> Cd <input type="checkbox"/> Na <input type="checkbox"/> Zn <input type="checkbox"/> Co <input type="checkbox"/> Ni <input type="checkbox"/> Hg <input type="checkbox"/> Cr <input type="checkbox"/> Pb <input type="checkbox"/> CrVI			Nutrients <input type="checkbox"/> TOC <input type="checkbox"/> DOC <input type="checkbox"/> TP/TPO4 <input type="checkbox"/> NH3-N <input type="checkbox"/> F <input type="checkbox"/> Cl <input type="checkbox"/> NO2 <input type="checkbox"/> Br <input type="checkbox"/> NO3 <input type="checkbox"/> SO4	MISC. <input type="checkbox"/> BTEX <input type="checkbox"/> Naphthalene <input type="checkbox"/> THM/HAA <input type="checkbox"/> VOC <input type="checkbox"/> Oil & Grease <input type="checkbox"/> E. Coli <input type="checkbox"/> Total Coliform <input type="checkbox"/> pH <input type="checkbox"/> Dissolved As <input type="checkbox"/> Dissolved Fe <input type="checkbox"/> Rad 226 <input type="checkbox"/> Rad 228 <input type="checkbox"/> PCB	Gypsum <input type="checkbox"/> Wallboard Gypsum (all below) <input type="checkbox"/> AIM <input type="checkbox"/> TOC <input type="checkbox"/> Total metals <input type="checkbox"/> Soluble Metals <input type="checkbox"/> Purity (CaSO4) <input type="checkbox"/> % Moisture <input type="checkbox"/> Sulfites <input type="checkbox"/> pH <input type="checkbox"/> Chlorides <input type="checkbox"/> Particle Size <input type="checkbox"/> Sulfur	Coal <input type="checkbox"/> Ultimate <input type="checkbox"/> % Moisture <input type="checkbox"/> Ash <input type="checkbox"/> Sulfur <input type="checkbox"/> BTUs <input type="checkbox"/> Volatile Matter <input type="checkbox"/> CHN Other Tests: <input type="checkbox"/> XRF Scan <input type="checkbox"/> HGI <input type="checkbox"/> Fineness <input type="checkbox"/> Particulate Matter	Flyash <input type="checkbox"/> Ammonia <input type="checkbox"/> LOI <input type="checkbox"/> % Carbon <input type="checkbox"/> Mineral Analysis <input type="checkbox"/> Sieve <input type="checkbox"/> % Moisture NPDES <input type="checkbox"/> Oil & Grease <input type="checkbox"/> As <input type="checkbox"/> TSS	Oil Trans. Oil Qual. <input type="checkbox"/> %Moisture <input type="checkbox"/> Color <input type="checkbox"/> Acidity <input type="checkbox"/> Dielectric Strength <input type="checkbox"/> IFT <input type="checkbox"/> Dissolved Gases Used Oil <input type="checkbox"/> Flashpoint <input type="checkbox"/> Metals in oil (As,Cd,Cr,Ni,Pb,Hg) <input type="checkbox"/> TX <input type="checkbox"/> GOFER
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--	--	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Login Sample Receipt Checklist

Client: South Carolina Public Service Authority

Job Number: 680-236991-1

Login Number: 236991

List Source: Eurofins Savannah

List Number: 1

Creator: Munro, Caroline

Question	Answer	Comment
Radioactivity wasn't checked or is <=/ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	False	Thermal preservation not required.
Cooler Temperature is acceptable.	N/A	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Accreditation/Certification Summary

Client: South Carolina Public Service Authority
Project/Site: 125915/JM02.09.G01.1/36500

Job ID: 680-236991-1

Laboratory: Eurofins Savannah

The accreditations/certifications listed below are applicable to this report.

Authority	Program	Identification Number	Expiration Date
South Carolina	State	98001	06-30-23

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

Field Data Sheets

(Note: the color coding is to assist field personnel in determining when the well has stabilized enough to begin sample collection.)

Cross Generating Station CCR Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
PM-1	83.24	8.29	4-24	1/24/2023	1018	26.35

Drawdown: 8.36 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
953	18.15	5.1	57	124	65.3	1.77
958	17.84	4.93	34	104	42.1	1.05
1003	17.45	4.72	39	101	15.3	0.99
1008	17.56	4.73	39	101	4	0.79
1013	17.64	4.82	35	100	9.4	0.72
1018	17.68	4.84	37	100	2.9	0.66

NPDES/CCR/Class 2 Landfill: Al, As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, K, Li, Mg, Mo, Na, Pb, Sb, Se, Tl, Zn

dissolved As Ra 226/228 Nitrate, TOC Cl, F, SO4, TDS

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Zach McHenry and Melanie Goings

**Cross Generating Station
Background Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time
CBW-1	85.80	9.29	14-24	1/24/2023	1146

Drawdown: 9.31 depth to GW (ft)
 Ferric Iron: 0.19 mg/L
 Ferrous Iron: 0.01 mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)
1112	19	4.34	212	181	0.9
1117	18.6	4.38	255	180	0
1122	18.53	4.35	286	180	0
1127	18.47	4.3	307	180	0
1132	18.39	4.33	319	180	0
1137	18.4	4.31	329	181	0
1140	18.33	4.25	338	181	0
1143	18.19	4.22	344	180	0
1146	18.2	4.23	347	181	0

CCR/Class 3 Landfill: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Sb, Se, Tl, Zn, dissolved As
 Ra 226/228 Nitrate, TOC Cl, F, SO4, TDS
CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions: Field data was lost when file wouldn't open. Field data redone on 11/4

Samples were collected by Zach McHenry and Melanie Goings

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-1	91.89	15.93	14'-24'	2/7/2023	1024	27

Drawdown: 16.19 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
953	20.39	4.29	231	2820	0	1.4
958	19.02	3.99	237	2990	0	0.95
1003	19.09	4.07	236	2940	0	0.76
1008	19.28	4.16	227	2900	0	0.64
1013	19.59	4.19	223	2890	0	0.59
1018	19.64	4.27	215	2860	0	0.55
1021	19.81	4.36	210	2850	0	0.51
1024	19.9	4.38	208	2860	0	0.49

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228

Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Zach McHenry and Brian Brase

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-2	84.88	8.09	8'-18'	2/6/2023	1402	21.58

Drawdown: 8.33 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1334	18.8	4.08	274	1510	28.8	0.95
1339	18.87	4.07	281	1470	24.2	0.59
1344	18.91	4.02	282	1450	24.4	0.45
1349	18.82	4.02	281	1450	18.3	0.41
1354	18.97	4.01	280	1450	15.9	0.42
1359	19.09	4.01	278	1460	28.2	0.39
1402	19.15	4.01	277	1460	28.2	0.38

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228

Cl, F, SO4, TDS

Comments/Conditions:

Duplicate @ 1407

Samples were collected by Zach McHenry and Brian Brase

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-3	83.95	6.5	10-20	2/6/2023	1255	23.13

Drawdown: 6.8 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1227	17.9	3.71	280	5150	29.5	0.77
1232	18.09	3.71	300	5120	23.8	0.56
1237	18.22	3.72	293	5150	23.7	0.41
1242	18.46	3.76	284	5190	22.4	0.36
1247	18.5	3.77	277	5200	22.8	0.32
1252	18.53	3.78	274	5210	24.2	0.31
1255	18.52	3.77	273	5250	23.2	0.3

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228

Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Zach McHenry and Brian Brase

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-4	83.49	6.19	10-20	2/6/2023	1532	23.02

Drawdown: 6.45 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1507	19.97	4.01	291	2020	16.3	1.06
1512	20.42	3.99	281	2040	22.4	0.5
1517	20.48	4.01	276	2040	2	0.38
1522	20.89	4.01	273	2030	0	0.33
1527	21.19	4	272	2030	0.7	0.3
1532	21.31	4.01	269	2020	1.6	0.28

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228

Cl, F, SO4, TDS

Comments/Conditions:

Pad submerged under ~2 inches of water

Samples were collected by Zach McHenry and Brian Brase

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-6	83.23	7.06	9-19	2/7/2023	1140	22.34

Drawdown: 7.34 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1117	23.25	3.89	286	3730	0	0.94
1122	22.59	3.83	305	3790	0	0.5
1127	22.03	3.82	303	3860	0	0.39
1132	21.9	3.81	302	3860	0	0.35
1137	21.8	3.8	300	3890	0	0.33
1142	21.82	3.8	298	3900	0	0.31

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228

Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Zach McHenry and Brian Brase

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-7	85.48	9.16	10-20	2/7/2023	914	23.57

Drawdown: 9.49 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
849	17.49	3.74	297	3760	0	1.02
854	17.1	3.78	311	3750	0	0.68
859	17.19	3.79	309	3790	0	0.55
904	17.62	3.81	305	3800	0	0.61
909	17.91	3.82	301	3800	0	0.58
914	18.21	3.82	297	3780	0	0.54

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Zach McHenry and Brian Brase

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-7	85.48	9.95	10-20	3/20/2023	1037	23.54

Drawdown: 10.18 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1009	15.51	3.82	298	4280	8.5	0.8
1014	15.38	3.71	313	4270	5.5	0.65
1019	15.31	3.69	317	4270	8	0.53
1024	15.3	3.68	315	4270	7.8	0.49
1029	15.62	3.7	312	4280	7.2	0.44
1034	15.68	3.7	309	4290	6.9	0.47
1037	15.88	3.72	308	4270	6.2	0.46

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

DUP @ 1042

Samples were collected by Zach McHenry and Brian Brase

**Cross Generating Station
CCR Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
PM-1	83.24	7.85	4-24	6/5/2023	1455	26.37

Drawdown: 8.03 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Spec Cond

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1407	19.47	5.16	50	161	11.1	1.78
1412	21.79	5.15	34	147	29.4	1.24
1417	22.98	5	44	141	17.8	1.03
1422	23.54	5.14	40	142	3.4	1.02
1427	25.57	5.18	39	143	10	1.14
1432	24.82	5.03	52	134	0	0.95
1437	23.75	5.01	52	132	0	1.19
1440	24.03	5.02	50	132	0	1.12
1443	23.98	4.98	53	132	0	0.9
1446	24.38	4.97	54	131	0	1
1449	24.82	5.03	49	130	0	0.82
1452	24.6	5.08	47	130	2.6	0.87
1455	24.77	5.08	47	130	0	0.91

NPDES/CCR/Class 2 Landfill: Al, As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, K, Li, Mg, Mo, Na, Pb, Sb, Se, Tl, Zn

dissolved As Ra 226/228 Nitrate, TOC Cl, F, SO4, TDS

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Marvin Lewis

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-1	91.89	16.79	14'-24'	6/6/2023	1329	26.97

Drawdown: 16.98 depth to GW (ft)

Ferric Iron 1.91 mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1247	27	5.86	16	2210	42.3	3.34
1252	26.07	4.82	120	2430	31.2	0.95
1257	25.44	4.58	148	2480	40.1	0.73
1302	25.49	4.53	158	2520	42.5	0.69
1307	25.75	4.54	161	2530	32.8	0.65
1312	26.02	4.55	161	2530	25.4	0.64
1317	26.57	4.58	160	2520	20	0.62
1320	26.9	4.59	160	2510	19.4	0.61
1323	27.36	4.69	154	2500	18.8	0.59
1326	27.89	4.67	155	2510	17.9	0.59
1329	28.28	4.66	155	2520	16.5	0.59

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228

Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Marvin Lewis

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-3	83.95	8.71	10-20	6/7/2023	1135	23.15

Drawdown: 9.18 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1053	26.88	4.37	185	2910	9.5	1.35
1058	25	3.84	206	3280	4.6	0.77
1103	24.74	3.77	205	3380	18.3	0.7
1108	24.74	3.74	202	3630	27.5	0.66
1113	24.63	3.7	203	3780	29.9	0.67
1118	24.57	3.69	204	3860	26.3	0.66
1123	24.43	3.66	205	3910	18.6	0.66
1126	24.41	3.65	207	3920	14.1	0.65
1129	24.42	3.63	209	3950	10.8	0.65
1132	24.36	3.64	209	3970	8.7	0.65
1135	23.91	3.67	206	4010	7.6	0.66

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228

Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Marvin Lewis

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-6	83.23	7.79	9-19	6/7/2023	1337	22.34

Drawdown: 8.14 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1317	26.27	3.98	298	2520	3.8	1.88
1322	24.97	3.77	279	2440	2.6	0.9
1327	24.71	3.73	266	3850	1.2	0.71
1332	24.86	3.72	264	3870	1.3	0.74
1337	24.84	3.74	259	3900	3.5	0.73

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As

Ra 226/228

Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Marvin Lewis

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-7	85.48	10.21	10-20	6/7/2023	904	23.52

Drawdown: 10.33 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
834	21.35	3.86	157	3690	2.6	1.84
839	21.86	3.81	211	3670	0.9	1.21
844	22.13	3.86	222	3630	0.7	0.99
849	22.42	3.89	225	3620	0.3	0.93
854	22.39	3.91	225	3600	0	0.83
859	22.78	3.91	227	3570	0	0.77
904	23.09	3.92	229	3550	0	0.74

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Marvin Lewis

Former Gypsum Pond Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CCMGP-1	84.3	9.09	38-48	6/6/2023	1545	51.29

Drawdown: 9.13 depth to GW (ft)

Ferric Iron 1.27 mg/L

Ferrous Iron 1.14 mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1512	26.6	6.36	35	796	12.4	3.09
1517	27.13	6.51	-14	806	10.6	1.01
1522	27.65	6.71	-37	808	10.3	0.96
1527	28.14	7.08	-63	814	5.2	1
1532	28.53	7.08	-65	819	2.6	1.26
1537	29.06	7.09	-67	824	2.6	1.88
1542	29.63	7.09	-67	827	2.9	1.99
1545	29.99	7.08	-67	827	2.5	1.92

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Marvin Lewis

Former Gypsum Pond Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CCMGP-2	96.73	21.68	24-34	6/6/2023	1007	36.94

Drawdown: 21.94 depth to GW (ft)

Ferric Iron 3.03 mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
937	21.1	4.58	138	1570	12.3	1.21
942	20.77	4.52	164	1590	9.3	0.82
947	20.82	4.71	158	1600	14.6	0.76
952	21.65	5.10	115	1660	23.3	0.76
957	21.8	4.94	119	1660	19.1	0.76
1002	21.79	5.03	117	1650	17	0.76
1007	21.64	4.96	122	1630	16.2	0.74

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Mavin Lewis

Former Gypsum Pond Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CCMGP-3	84.44	9.73	10-20	6/6/2023	1117	

Drawdown: 9.82 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron 1.66 mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1035	22.21	4.35	209	520	25.3	1.66
1040	21.7	4.01	316	517	103	0.9
1045	21.66	3.92	338	508	103	0.82
1050	21.55	3.88	345	506	80	0.77
1055	21.46	3.88	343	506	65.5	0.73
1100	21.54	3.85	345	504	55.2	0.69
1105	21.67	3.85	344	501	38	0.68
1108	21.88	3.9	343	499	29.4	0.66
1111	21.96	3.86	344	500	35.5	0.68
1114	21.73	3.84	343	503	33.2	0.68
1117	21.53	3.81	345	503	32.7	0.65

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Marvin Lewis

Former Gypsum Pond Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CCMGP-4	84.82	9.44	42.5-52.5	6/6/2023	1217	55.23

Drawdown: 9.51 depth to GW (ft)

Ferric Iron 0.07 mg/L

Ferrous Iron 0.21 mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1147	23.81	10.64	61	529	46.5	2.01
1152	23.16	10.75	44	568	31.4	1.54
1157	22.72	6.77	111	1440	35.4	0.88
1202	22.81	6.40	88	1580	33.3	0.79
1207	22.57	6.38	76	1630	11.3	0.72
1212	22.52	6.4	69	1650	8.7	0.69
1217	22.85	6.39	69	1650	9.7	0.71

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Marvin Lewis

Former Gypsum Pond Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CCMGP-5	79.91	5.9	8-18	6/6/2023	1438	21.25

Drawdown: 5.98 depth to GW (ft)

Ferric Iron 0.13 mg/L

Ferrous Iron 0.08 mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1408	27.12	6.58	-9	370	23.9	2.48
1413	25.01	6.38	32	363	17.7	0.91
1418	23.76	6.26	50	365	43.7	0.79
1423	23.2	6.23	60	373	54.6	0.73
1428	22.85	6.17	67	378	55.35	0.7
1433	22.55	6.13	73	384	55.2	0.67
1438	22.49	6.12	77	390	50.6	0.66

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Juatin Kirk and Marvin Lewis

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-7	85.48	9.47	10-20	7/19/2023	1000	23.49

Drawdown: 9.9 depth to GW (ft)

Ferric Iron 3.21 mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
945	25.04	4.09	188	3450	11.3	1.07
950	24.46	3.91	228	3450	3.9	0.76
955	24.51	3.83	233	3390	1.9	0.69
1000	24.69	3.83	232	3340	0.8	0.66

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:
DUP @ 1005
Samples were collected by Justin Kirk and Brian Brase

Former Gypsum Pond Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CCMGP-3	84.44	8.92	10-20	8/1/2023	1152	23.08

Drawdown: 9.01 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1117	25.23	3.84	286	537	0	2.37
1122	25.14	3.82	305	516	0	0.97
1127	25.21	3.8	304	507	0	0.83
1134	25	3.80	304	508	0.6	0.78
1139	25.88	3.81	304	501	0	0.75
1144	26.69	3.82	303	497	0	0.73
1149	26.52	3.8	305	509	1.1	0.78
1152	25.78	3.8	306	505	1.7	0.78

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Brian Brase

Former Gypsum Pond Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CCMGP-4	84.82	8.64	42.5-52.5	8/1/2023	1317	55.16

Drawdown: 8.7 depth to GW (ft)

Ferric Iron 0.09 mg/L

Ferrous Iron 0.37 mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1217	26.22	9.99	61	509	49	1.48
1222	25.89	9.92	-18	545	61.6	1.07
1227	26.32	7.86	-62	913	21.8	0.88
1232	26.93	6.27	-7	1370	45.6	0.79
1237	27.38	6.8	-48	1540	66.5	0.74
1242	27.23	6.29	-64	1600	56.5	0.74
1247	27.53	6.3	-71	1600	43.1	0.72
1250	27.63	6.3	-73	1610	38.9	0.73
1253	27.94	6.31	-76	1610	32.7	0.72
1256	27.96	6.31	-77	1610	26.9	0.71
1259	28.14	6.31	-78	1620	23.7	0.7
1302	28.09	6.32	-80	1630	20.3	0.71
1305	27.86	6.32	-81	1630	17.3	0.71
1308	27.78	6.31	-82	1630	23.2	0.7
1311	28.07	6.32	-84	1630	10.2	0.69
1314	27.69	6.34	-84	1640	8.6	0.7
1317	27.29	6.34	-85	1640	9.2	0.7

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Brian Brase

Former Gypsum Pond Groundwater Monitoring Wells

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CCMGP-5	79.91	4.87	8-18	8/1/2023	953	21.23

Drawdown: 4.91 depth to GW (ft)

Ferric Iron 1.4 mg/L

Ferrous Iron 1.28 mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
928	23.75	6.38	-46	416	0	2.14
933	23.22	6.41	-54	421	0	1.35
938	23.24	6.36	-53	410	0	1.09
943	23.06	6.36	-56	421	0	0.92
948	23.07	6.36	-55	421	0	0.86
953	23.21	6.35	-52	420	0	0.83

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
 Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

Samples were collected by Justin Kirk and Brian Brase

**Cross Generating Station
Former Gypsum Pond Groundwater Monitoring Wells**

Well ID	TOC Elevation (feet)	GW Depth (feet)	Screen Intervals (ft, bgs)	Sample Date	Sample Time	Total Well Depth
CGYP-7	85.48	10.18	10-20	10/10/2023	1123	23.51

Drawdown: 10.5 depth to GW (ft)

Ferric Iron +++ mg/L

Ferrous Iron +++ mg/L

Time	Temp round 1 (celcius)	pH round 1 (units)	Eh ORP (mV)	Spec Cond round 1 (uS/cm)	Turbidity (NTU)	Dissolved Oxygen (ppm)
1055	24.45	3.79	127	3240	14.4	1.55
1100	24.66	3.59	211	3350	7.8	1.27
1105	24.85	3.59	234	3340	2.2	1.08
1110	24.88	3.60	240	3320	1.5	1.05
1115	25.03	3.61	241	3280	1.3	0.93
1120	25.11	3.62	241	3260	0.8	0.85
1123	25.24	3.63	241	3240	0.9	0.84

CCR Only: As, Ba, Be, B, Ca, Cd, Co, Cr, Fe, Hg, Li, Mo, Pb, Se, Tl, Zn, dissolved As
Ra 226/228 Cl, F, SO4, TDS

Comments/Conditions:

DUP @ 1128

Samples were collected by Zach McHenry and Brian Brase

Appendix C – Well Construction Records

